

**MANATEE COUNTY GOVERNMENT
INVITATION FOR BID (IFB) #09-0490-OV
SATELLITE LIFT STATIONS REHABILITATION / PRIORITY 1
(#1, #6, #7, #8, #12, #15, #30-A, #2-M, #12-D)**

Manatee County, a political subdivision of the State of Florida, (hereinafter "Manatee County" or the "County" or "Owner") will receive sealed bids from individuals, corporations, partnerships, and other legal entities organized under the laws of the State of Florida or authorized to conduct business in the State of Florida.

INFORMATION CONFERENCE

In order to insure that all prospective bidders have sufficient information and understanding of the County's needs, an **information conference** will be held **February 25, 2009 at 11:00 A.M.** at the Manatee County Administrative Center, 1112 Manatee Avenue West, **Suite 505, Heron Conference Room, 5th Floor,** Bradenton, Florida. All interested bidders are encouraged to attend.

NOTE: Article B.04 Inspection of Site shall be a requirement to be considered for this bid. Contact Information for Site Visitation included in Article B.04.

Deadline for Clarifications Requests: March 10, 2009. Reference Article A.03 of this Invitation for Bid.

TIME AND DATE DUE: March 18, 2009 at 2:00 P.M.

TABLE OF CONTENTS

00010 Information to Bidders	Pages 00010 - 1-8
00020 Basis of Award	Pages 00020 - 1-2
00030 Terms and Conditions	Pages 00030 - 1-7
00100 Instruction to Bidders	Pages 00100 - 1-3
00300 Bid Form	Pages 00300 - 1-39
00430 Contractor's Questionnaire	Pages 00430 - 1-3
00491 Certification Forms	Pages 00491 - 1-4
00500 Form of Agreement	Pages 00500 - 1-4
00550 Project Management	Pages 00550 - 1-12
00700 General Conditions	Pages 00700 - 1-17
Technical Specifications (188 Total Pages)	October 2008
Drawings, Priority 1 (6 Total Pages)	October 24, 2008

Important Note: A prohibition of Lobbying has been enacted. Please review paragraph A.24 carefully to avoid violation and possible sanctions.

FOR INFORMATION CONTACT: Olga Valcich

(941) 749-3055 FAX (941) 749-3034

Email: olga.valcich@mymanatee.org

SECTION 00010
INFORMATION TO BIDDERS

A.01 OPENING LOCATION

These bids will be publicly opened at Manatee County Purchasing, 1112 Manatee Avenue West, Suite 803, Bradenton, Florida 34205 in the presence of County officials at the time and date stated, or soon thereafter. All bidders or their representatives are invited to be present.

A.02 BID INFORMATION AND BID DOCUMENTS

Bids and Proposals on <http://www.mymanatee.org>

Bid or Proposal documents and Notices of Source Selection related to those Bids or Proposals are available for download in a portable document format (.PDF) file on the Manatee County web page on the Purchasing tab under "Bids and Proposals." You may view and print these files using Adobe Acrobat software. A free copy of the Adobe software may be downloaded from the County's web site.

Manatee County collaborates with the Manatee Chamber of Commerce on distributing solicitations using the RFP Tool web page on the Chambers website: <http://www.ManateeChamber.com> to post Bid and Proposal documents in a portable document format (.PDF) file. This step is in addition to the posting on Manatee County Government web pages.

Manatee County may also use an internet service provider to distribute Bids and Proposals. A link to that service <http://www.DemandStar.com>, is provided on this website under the Tab "DemandStar". Participation in the DemandStar system is not a requirement for doing business with Manatee County.

Note: The County posts the Notice of Source Selection seven calendar days prior to the effective date of the award.

IT IS THE RESPONSIBILITY OF EACH VENDOR, PRIOR TO SUBMITTING THEIR BID OR PROPOSAL, TO CONTACT THE MANATEE COUNTY PURCHASING OFFICE (see contact information on front page of this document) TO DETERMINE IF ADDENDA WERE ISSUED AND TO MAKE SUCH ADDENDA A PART OF THEIR BID OR PROPOSAL.

A public internet connection is available during regular business hours in the lobby of the Purchasing Division. If you have any questions which cannot be answered by these sources, please contact the individual named on the front page of the bid or proposal.

A.03 DEADLINE FOR CLARIFICATION REQUESTS

For this Invitation for Bid, **March 10, 2009** shall be the deadline to submit all inquiries, suggestions or requests concerning interpretation, clarification or additional information pertaining to this Invitation for Bid.

This deadline has been established to maintain fair treatment for all potential bidders, while maintaining the expedited nature of the Economic Stimulus that the contracting of this work may achieve.

A.04 BID FORM DELIVERY REQUIREMENTS

Any bids received after the stated time and date will not be considered. It shall be the sole responsibility of the bidder to have their bid delivered to Manatee County Purchasing for receipt on or before the stated time and date. If a bid is sent by U.S. Mail, the bidder shall be responsible for its timely delivery to Purchasing. Bids delayed by mail shall not be considered, shall not be opened at the public opening, and arrangements shall be made for their return at the bidder's request and expense. Telegraphic bids and/or facsimile bids will not be considered.

A.05 CLARIFICATION & ADDENDA

Each bidder shall examine all Invitation for Bid documents and shall judge all matters relating to the adequacy and accuracy of such documents. Any inquiries, suggestions or requests concerning interpretation, clarification or additional information pertaining to the Invitation for Bid shall be made through the Manatee County Purchasing Office. The County shall not be responsible for oral interpretations given by any County employee, representative, or others. The issuance of a written addendum is the only official method whereby interpretation, clarification or additional information can be given.

If any addenda are issued to this Invitation for Bid, the County will Broadcast the addenda on the DemandStar distribution system to "Planholders" on this web service, and post the documents on the Purchasing Division's web page at <http://www.myanatee.org> which may be accessed by clicking on the "Purchasing" button on the left side of the screen and then clicking on the "Bids and Proposals" button. It shall be the responsibility of each bidder, prior to submitting their bid, to contact Manatee County Purchasing (see contact on front page) to determine if addenda were issued and to make such addenda a part of their bid. **Bidders must fully comply with the bid Contract Documents, terms and conditions.**

A.06 SEALED & MARKED

One original and two copies of your **signed bid** shall be submitted in one sealed package, clearly marked on the outside "**Sealed Bid #09-0490-OV, Satellite Lift Stations Rehabilitation / Priority 1, Bradenton, FL** with your company name and addressed to:

Manatee County Purchasing
1112 Manatee Avenue West, Suite 803
Bradenton, Florida 34205

A.07 LEGAL NAME

Bids shall clearly indicate the legal name, address and telephone number of the bidder. Bids shall be signed above the typed or printed name and title of the signer. The signer must have the authority to bind the bidder to the submitted bid.

A.08 BID EXPENSES

All expenses for making bids to the County are to be borne by the bidder.

A.09 IRREVOCABLE OFFER

Any bid may be withdrawn up until the date and time set for opening of the bid. Any bid not so withdrawn shall, upon opening, constitute an irrevocable offer for a period of 90 days to sell to Manatee County the goods and/or services set forth in the attached Contract Documents until one or more of the bids have been duly accepted by the County.

A.10 DISCLOSURE

Upon receipt, responses become "Public Records" and shall be subject to public disclosure consistent with Chapter 119, Florida Statutes. Section 119.071(1)(b)1.a states that sealed bids shall be exempt from inspection or copying until such time as the County provides a notice of a decision or within 10 days after the date the bids are opened, whichever is earlier.

A.11 RESERVED RIGHTS

The County reserves the right to accept or reject any and/or all bids, to waive irregularities and technicalities, and to request resubmission. Also, the County reserves the right to accept all or any part of the bid and to increase or decrease quantities to meet additional or reduced requirements of the County. Any sole response received by the first submission date may or may not be rejected by the County depending on available competition and current needs of the County. For all items combined, the bid of the lowest responsive, responsible bidder will be accepted, unless all bids are rejected. The lowest responsible bidder shall mean that bidder who makes the lowest bid to sell goods and/or services of a quality which conforms closest to or most exceeds the quality of goods and/or services set forth in the attached Contract Documents or otherwise required by the County, and who is fit and capable to perform the bid as made.

To be responsive, a bidder shall submit a bid which conforms in all material respects to the requirements set forth in this Invitation For Bid.

To be a responsible bidder, the bidder shall have the capability in all respects to perform fully the contract requirements, and the tenacity, perseverance, experience, integrity, reliability, capacity, facilities, equipment, and credit which will assure good faith performance. Also, the County reserves the right to make such investigation as it deems necessary to determine the ability of any bidder to deliver the goods or service requested. Information the County deems necessary to make this determination shall be provided by the bidder. Such information may include, but shall not be limited to: current financial statements, verification of availability of equipment and personnel, and past performance records.

A.12 COLLUSION

By offering a submission to this Invitation For Bid, the bidder certifies that the bidder has not divulged, discussed or compared their bid with other bidders, and has not colluded with any other bidder or parties to this bid whatsoever. Also, bidder certifies, and in the case of a joint bid each party thereto certifies as to their own organization, that in connection with this bid:

- a. any prices and/or cost data submitted have been arrived at independently, without consultation, communication, or agreement, for the purpose of restricting competition, as to any matter relating to such prices and or cost data, with any other bidder or with any competitor;
- b. any prices and or cost data quoted for this bid have not been knowingly disclosed by the bidder and will not knowingly be disclosed by the bidder, prior to the scheduled opening, directly or indirectly to any other bidder or to any competitor;
- c. no attempt has been made or will be made by the bidder to induce any other person or firm to submit or not to submit a bid for the purpose of restricting competition;

A.12 COLLUSION(Continued)

- d. the only person or persons interested in this bid, principal or principals is/are named therein and that no person other than therein mentioned has any interest in this bid or in the contract to be entered into; and
- e. no person or agency has been employed or retained to solicit or secure this contract upon an agreement or understanding or a commission, percentage, brokerage, or contingent fee excepting bona fide employees or established commercial agencies maintained by bidder for purpose of doing business.

A.13 APPLICABLE LAWS

Bidder or Proposer must be authorized to transact business in the State of Florida. All applicable laws and regulations of the State of Florida and ordinances and regulations of Manatee County will apply to any resulting agreement. Any involvement with any Manatee County procurement shall be in accordance with Manatee County Purchasing Code Ordinance 08-43, as amended. An actual or prospective Bidder or Proposer who is aggrieved in connection with the solicitation or award of a contract may protest to the Board of County Commissioners of Manatee County as required in Section 2-26/61 of the Purchasing Code.

A protest with respect to this Invitation For Bid or Request for Proposal shall be submitted in writing prior to the scheduled opening date of this proposal, unless the aggrieved person did not know and could not have been reasonably expected to have knowledge of the facts giving rise to such protest prior to the scheduled opening date of this proposal. The protest shall be submitted within seven calendar days after such aggrieved person knows or could have reasonably been expected to know the facts giving rise thereto.

A.14 CODE OF ETHICS

With respect to this proposal, if any Bidder or Proposer violates or is a party to a violation of the Code of Ethics of Manatee County per Manatee County Purchasing Code Ordinance 08-43, Article 3, Ethics in Public Contracting, and / or the State of Florida per Florida Statutes, Chapter 112, Part III, Code of Ethics for Public Officers and Employees, such Bidder or Proposer may be disqualified from performing the work described in this proposal or from furnishing the goods or services for which the proposal is submitted and shall be further disqualified from submitting any future bids or proposals for work or for goods or services for Manatee County.

The County anticipates that all statements made and materials submitted in a proposal will be truthful. If a bidder or proposer is determined to be untruthful in its proposal or any related presentation, such bidder or proposer may be disqualified from further consideration regarding this Invitation For Bid or Request for Proposal.

A.15 BID FORMS

Bids must be submitted on attached County forms, although additional pages may be attached. **Bidders must fully comply with all bid Contract Documents, terms, and conditions.** Failure to comply shall result in contract default, whereupon, the defaulting vendor shall be required to pay for any and all re-procurement costs, damages, and attorney fees as incurred by the County.

A.16 DISCOUNTS

Any and all discounts must be incorporated in the prices contained in the bid; and not shown separately. The prices as shown on the bid form shall be the price used in determining award(s).

A.17 TAXES

Manatee County is exempt from Federal Excise and State Sales Taxes (F.E.T. Exempt Cert. No. 59-78-0089K and FL Sales Tax Exempt Cert. No. 51-02-027548-53C); therefore, the bidder is prohibited from delineating a separate line item in his bid for any sales or service taxes. Nothing herein shall affect the bidder's normal tax liability.

A.18 MATHEMATICAL ERRORS

Bids submitted shall be based on the quantities stated on the Bid Form. Quantities shall be used for the comparison of Bids. Payment to the Contractor will be made based on the actual quantity of work completed and accepted at the date of payment request, in accordance with the terms of the contract.

In the event of multiplication/extension error(s), the unit price shall prevail. In the event of addition error(s), the extended totals shall prevail. All bids shall be reviewed mathematically and corrected, if necessary, using these standards prior to additional evaluation. Calculations shall be factored to the second decimal point.

A.19 DESCRIPTIVE INFORMATION

Unless otherwise specifically provided in the Contract Documents, all equipment, materials and articles incorporated in the work covered by this contract shall be new and of the most suitable grade for the purpose intended. Unless otherwise specifically provided in the Contract Documents, reference to any equipment, material, article or patented process, by trade name, brand name, make or catalog number, shall be regarded as establishing a standard of quality and shall not be construed as limiting competition.

A.20 PUBLIC CONTRACTING AND ENVIRONMENTAL CRIMES CERTIFICATION

In accordance with Ordinance 08-43, adding Article 5, Manatee County Board of County Commissioners adopted a policy prohibiting the award of County contracts to persons, business entities, or affiliates of business entities who have not submitted written certification to the County that they have not been convicted of bribery, attempted bribery, collusion, restraints of trade, price fixing, and violations of certain environmental laws. A Non-Conviction Certification Form is attached for this purpose.

A.21 DRUG FREE WORK PLACE

The Manatee County Board of County Commissioners adopted a policy regarding Bidders maintaining a Drug Free Work Place, prohibiting the award of bids to any person or entity that has not submitted written certification to the County that it has complied with those requirements [Reference Resolution R-93-22, Manatee County Purchasing Policies, Section 4, E (1) (a)]. A Drug Free Work Place Certification Form is attached to this bid for this purpose.

A.22 PUBLIC ENTITY CRIMES

In accordance with Section 287.133, Florida Statutes, a person or affiliate who has been placed on the convicted vendor list following a conviction for a public entity crime may not submit a bid on a contract to provide any goods or services to a public entity, may not submit a bid on a contract with a public entity for the construction or repair of a public building or public work, may not submit bids on leases or real property to a public entity, may not be awarded or perform work as a contractor, supplier, subcontractor, or consultant under a contract with any public entity, and may not transact business with any public entity in excess of the threshold amount provided in Section 287.017 for Category Two (as of 01/01/2005 is \$25,000) for a period of 36 months from the date of being placed on the convicted vendor list.

A.23 AMERICAN DISABILITIES ACT

The Board of County Commissioners of Manatee County, Florida, does not discriminate upon the basis of any individual's disability status. This non-discrimination policy involves every aspect of the County's functions including one's access to, participation, employment, or treatment in its programs or activities. Anyone requiring reasonable accommodation for an **Information Conference** or **Bid Opening** should contact the person named on the first page of this Bid Document at least twenty-four (24) hours in advance of either activity.

A.24 LOBBYING

After the issuance of any Invitation For Bid or Request For Proposal, prospective bidders, proposers or any agent, representative or person acting at the request of such bidder or proposer shall not contact, communicate with or discuss any matter relating in any way to the Invitation for Bids or Request for Proposals with any officer, agent or employee of Manatee County other than the Purchasing Director or as directed in the Invitation for Bids or Request for Proposals. This prohibition begins with the issuance of any Invitation for Bids, or Request for Proposals, and ends upon execution of the final contract or when the invitation or request has been cancelled. Violators of this prohibition shall be subject to sanctions as provided in the Manatee County Purchasing Code.

The County reserves the right to amend or to add to the names listed as persons to contact. All amendments or additions to the names listed as persons to contact shall be issued by Purchasing, in writing.

A.25 EQUAL EMPLOYMENT OPPORTUNITY CLAUSE

Manatee County, in accordance with the provisions of Title VI of the Civil Rights Act of 1964 and the Regulations of the Department of Commerce (15 CFR, Part 8) issued pursuant to such Act, hereby notifies all bidders that it will affirmatively ensure that in any contract entered into pursuant to this advertisement, minority business enterprises will be afforded full opportunity to submit bids in response to this advertisement and will not be discriminated against on the grounds of race, color or national origin in consideration for an award.

A.26 MBE/WBE

The State of Florida, **Office of Supplier Diversity** provides the certification process and the database for identifying certified MBE/WBE firms. This service may be directly accessed at: <http://www.osd.dms.state.fl.us/iframe.htm>

If you have any questions regarding this State service, please contact their office at (850) 487-0915.

NOTE: ANY OR ALL STATEMENTS CONTAINED IN THE FOLLOWING SECTIONS SHALL HAVE PRECEDENCE: BASIS OF AWARD, TERMS AND CONDITIONS OF THE CONTRACT, OR CONTRACT DOCUMENTS WHICH VARY FROM THE INFORMATION TO BIDDERS.

SECTION 00020
BASIS OF AWARD

B.01 BASIS OF AWARD

Award shall be to the most responsive, responsible bidder meeting specifications and having the lowest Total Bid Price for **Bid "A"**, or the lowest Total Bid Price for **Bid "B"**, for the requirements listed on the Bid Form for the Work as set forth in this Invitation For Bid. Bid Prices shall include costs for furnishing all labor, equipment and/or materials for the completion of the Work in accordance with and in the manner set forth and described in the Contract Documents to the County's satisfaction within the prescribed time.

Two schedules for Completion of the Work shall be considered. Each bid for completion by the specified stated time shall be offered as a separate "Total Bid Price". The County has the sole authority to select the bid based on the Completion Time which is in the best interest of the County. Only one award shall be made.

Bid Form includes payment for Discretionary Work (Bid Item No. 33) which may or may not be utilized at the Owner's discretion in order to satisfactorily complete the project in accordance with the Plans and Specifications provided herein.

Bid Item Number 33a: Discretionary Stone and Shell Work, Bid Item Number 33b: Discretionary Fence Work and Bid Item Number 33c: Fence Gate: Payment for work included under these Bid Items shall be made at the applicable contract unit price. Contractor shall bid per complete installation. This shall include the material, equipment and labor to provide and place stone or shell as required, properly construct fencing per the specifications, including all line, gate, and corner posts, top rails, hardware, etc. These items are discretionary items and shall be used at the Owner's discretion. Reference Section 01150, Measurement and Payment, Part II, Bid Items 2.33 thru 2.33c pages 38 and 39 of the Infrastructure Engineering Standard Specifications dated October 2008.

In evaluating bids, the County shall consider the qualifications of the bidders; and if required, may also consider the qualifications of the subcontractors, suppliers, and other persons and organizations proposed. County may also consider the operating costs, maintenance requirements, performance data and guarantees of major items of materials and equipment proposed for incorporation in the Work.

Whenever two or more bids are equal with respect to price, quality and service, the bid received from a local business shall be given preference in award. Whenever two or more bids which are equal with respect to price, quality and service are received, and both bids or neither of these bids are received from a local business, the award shall be determined by a chance drawing conducted by the Purchasing Office and open to the public.

Local business is defined as a business duly licensed and authorized to engage in the sale of goods and/or services to be procured, which has a place of business in Manatee County with full time employees at that location.

B.02 QUALIFICATIONS OF BIDDERS

Each bidder must secure all licenses required (in accordance with Chapter 489 Florida Statutes) for the Work which is the subject of this bid; and, upon request, shall submit a true copy of all applicable licenses. The minimum license requirement for this project is a **General Contractor's and / or Underground Utility License.**

To demonstrate qualifications to perform the Work, each bidder must be prepared to submit within five days of County's request; written evidence such as financial data, previous experience, present commitments and other such data as may be requested. Bidder must be able to provide evidence of Bidder's qualification to do business in the state of Florida. Each bidder shall submit as a portion of their bid a completed Contractor's Questionnaire included as Section 00430.

A complete list of all subcontractors proposed for any portion of the Work may be requested of any Bidder deemed necessary by the Owner.

B.03 PREPARATION OF CONTRACT

A written notice confirming award or recommendation thereof will be forwarded to the Successful Bidder accompanied by the required number of unsigned counterparts of the Agreement. Within 10 days thereafter, Successful Bidder shall sign and deliver the required number of counterparts of the Agreement with any other required documents to County. (Note: Contract must be approved and executed by Manatee County Board of County Commissioners to be valid.)

B.04 INSPECTION OF SITE

Inspection of Site shall be a requirement to be considered for award of this bid. For coordination of Site Inspection, bidders shall contact the Owner's Representative, Mr. Jim Marble, Lift Station Superintendent at 941-755-1853, Extension 5277.

SECTION 00030
GENERAL TERMS AND CONDITIONS OF THE CONTRACT

C.01 CONTRACT FORMS

The agreement resulting from the acceptance of a bid shall be in the form of the agreement stated in this bid.

C.02 ASSIGNMENT OF CONTRACT

Contractor shall not assign, transfer, convey, sublet or otherwise dispose of this Contract or of his right, title, or interest therein, or his power to execute such Contract, or to assign any monies due or to become due there under to any other person, firm or corporation unless first obtaining the written consent of the County. The giving of such consent to a particular subcontractor assignment shall not dispense with the necessity of such consent to any further or other assignment.

C.03 COMPLETION OF WORK

The Work will be completed and ready for final inspection within the specified calendar days from the date the Contract Time commences to run. Two bids shall be considered based on **Bid "A" 360 calendar days** and **Bid "B" based on 315 calendar days**. The County has the sole authority to select the bid based on the Completion Time which is in the best interest of the County. Only one award shall be made.

C.04 LIQUIDATED DAMAGES

If the Contractor refuses or fails to prosecute the Work, or any separable part thereof, with such diligence as will hinder its completion within the time specified, the County may seek damages. The actual damages for delay will be impossible to determine and in lieu thereof, the Contractor shall pay to the Owner the sum of **\$1,423.00** as fixed, agreed, and liquidated damages for each calendar day of the delay until the Work is finally accepted by the County and the Contractor and his Surety shall be liable for the amount thereof.

C.05 PAYMENT

Contractor may apply for partial payment on monthly estimates, based on the amount of Work done or completed in compliance with the provisions of the Contract. Contractor shall submit an application, on a form provided or approved by the County, of an approximate estimate of the proportionate value of the Work done, items and locations of the Work performed up to and including the last day of the period then ending. The County will then review said estimate and make any necessary revisions so that the estimate can receive approval for payment. If the Contractor and the County do not agree on the approximate estimate of the proportionate value of the Work done for any pay period, the determination of the County will be binding. The amount of said estimate after deducting any required retainage and all previous payments shall be due and payable to the Contractor within 20 days after the pay estimate has been approved by the County. It is the Contractor's responsibility for the care of the materials. Any damage to or loss of said materials is the full responsibility of the Contractor. Any Periodical Pay Estimate signed by the Contractor shall be final as to the Contractor for any or all work covered by the Periodical Pay Estimate.

C.05 PAYMENT (Continued)

Any requests for payment of materials stored on site must be accompanied with a paid receipt. The Contractor warrants and guarantees that title to all work, materials and equipment covered by any application for payment, whether incorporated in the project or not, will pass to the County at the time of payment free and clear of all liens, claims, security interests and encumbrances (hereafter referred to as "Liens").

The Contractor agrees to furnish an affidavit stating that all laborers, material men, and subcontractors have been paid on the project for Work covered by the application for payment and that a partial or complete release of lien, as may be necessary, be properly executed by the material men, laborers, subcontractors on the project for Work covered by the application for payment, sufficient to secure the County from any claim whatsoever arising out of the aforesaid Work.

When the Contractor has completed the Work in compliance with the terms of the Contract Documents, he shall notify the County in writing that the project is ready for final inspection. The County will then advise the Contractor as to the arrangements for final inspection and what Work, if any, is required to prepare the project or a portion thereof for final inspection. When the County determines the project or portion thereof is ready for final inspection, the County shall perform same. Upon completion of final inspection, the County will notify Contractor of all particulars in which this inspection reveals that the Work is incomplete or defective. Contractor shall immediately take such measures as are necessary to complete such Work or remedy such deficiencies. When all such errors have been corrected, a final re-inspection will be made. The process will be repeated until, in the opinion of the County, the project has been completed in compliance with the terms of the Contract Documents.

When final acceptance has been made by the County, the County will make final payment of the Contract amount, plus all approved additions, less approved deductions and previous payments made. The Contract will be considered complete when all work has been finished, the final inspection made, approved as-builts received, and the project finally accepted in writing by the County. The Contractor's responsibility shall then terminate except as otherwise stated.

C.06 RETAINAGE

A **retainage** of 2.5% of the total contract amount shall be withheld from payments after 75% completion of the Work. Upon substantial completion, this retainage shall be reduced to 1% of the total contract amount plus such amount as the Owner may reasonably deem necessary to repair, replace, complete or correct any damaged, defective, incorrect or incomplete work. Upon final acceptance, the remaining retainage shall be included in the final payment.

C.07 WARRANTY AND GUARANTEE PROVISIONS

All work, materials, and equipment furnished as defined herein shall be guaranteed and warranted by the contractor for a minimum period of three (3) years, unless otherwise specified, from final acceptance by the Owner to be free from defects due either to faulty materials or equipment or faulty workmanship.

All materials, equipment, and workmanship furnished and installed by the contractor is warranted and guaranteed by the contractor to be such as to meet the required standards and to accomplish the purposes and functions required standards and to accomplish the purposes and functions of the project as defined, detailed, and specified herein.

The Owner shall, following discovery thereof, promptly give written notice to the contractor of faulty materials, equipment, or workmanship within the period of the guarantee and the contractor shall promptly replace any part of the faulty equipment, material, or workmanship at his own cost. These warranty and guarantee provisions create no limitations on the Owner as to any claims or actions for breach of guaranty or breach of warranty that the Owner might have against parties other than the contractor, and do not constitute exclusive remedies of the Owner against the contractor.

C.8 ROYALTIES AND PATENTS

The contractor shall pay all royalties and license fees for equipment or processes in conjunction with the equipment and/or services being furnished. Contractor shall defend all suits or claims for infringement of any patent, trademark or copyright, and shall save the County harmless from loss on account thereof, including costs and attorney's fees.

C.9 AUTHORIZED PRODUCT REPRESENTATION

The contractor, by virtue of submitting the name and specifications of a manufacturer's product, will be required to furnish the named manufacturer's product. Failure to perform accordingly may, in the County's sole discretion, be deemed a breach of contract, and shall constitute grounds for the County's immediate termination of the contract.

C.10 REGULATIONS

It shall be the responsibility of the bidder to assure compliance with any OSHA, EPA and/or other federal or state of Florida rules, regulations or other requirements, as each may apply.

C.11 CANCELLATION

Any failure of the contractor to furnish or perform the Work (including, but not limited to, commencement of the Work, failure to supply sufficient skilled workers or suitable materials or equipment) in accordance with the contract, the County may order the stop of the Work, or any portion thereof, until the cause for such order has been eliminated. If the contractor persistently fails to perform the Work in accordance with the contract, the County reserves the right to terminate the contract and select the next qualified bidder or re-advertise this procurement in part or in whole. The County reserves the right to cancel all or any undelivered or unexecuted portion of this contract with or without cause.

C.12 INDEMNIFICATION

The contractor covenants and agrees to indemnify and save harmless the County, its agents and employees, from and against all claims, suits, actions, damages, causes of action, or judgments arising out of the terms of the resulting agreement for any personal injury, loss of life, or damage to the property sustained as a result of the performance or non-performance of services or delivery of goods; from and against any orders, judgments, or decrees, which may be entered against the County, its agents or employees; and from and against all costs, attorney's fees, expenses and other liabilities incurred in the defense of any such claim, suit or action, and the investigation thereof. Nothing in the award, resulting agreement, contract or Purchase Order shall be deemed to affect the rights, privileges and immunities of the County as set forth in Florida Statute Section 768.28.

C.13 MANUALS, SCHEMATICS, HANDBOOKS

All manuals, schematics and handbooks shall be provided which are applicable to the equipment delivered. An operators manual, parts manual and technician manual must also be provided. Parts lists (manuals) must include OEM part numbers for items not manufactured by the bidder. Vendor shall furnish two (2) copies of each.

C.14 INSURANCE

The contractor will not commence work under a contract until all insurance under this section and such insurance coverage as might be required by the County has been obtained. The contractor shall obtain, and submit to Purchasing within 10 calendar days of request, at his expense, the following minimum amounts of insurance (inclusive of any amounts provided by an umbrella or excess policy):

a. Workers' Compensation/Employers' Liability

Part One - There shall be no maximum limit (other than as limited by the applicable statute) for liability imposed by Florida Workers' Compensation Act or any other coverage required by the contract documents which are customarily insured under Part One of the standard Workers' Compensation Policy.

Part Two - The minimum amount of coverage required by the contract documents which are customarily insured under Part Two of the standard Workers' Compensation Policy shall be:

<u>\$100,000</u>	(Each Accident)
<u>\$500,000</u>	(Disease-Policy Limit)
<u>\$100,000</u>	(Disease-Each Employee)

b. Commercial General Liability

The limits are to be applicable only to work performed under this contract and shall be those that would be provided with the attachment of the Amendment of Limits of Insurance (Designated Project or Premises) endorsement (ISO Form CG 25 03) to

C.14 INSURANCE (Continued)

a Commercial General Liability Policy with the following minimum limits.

General Aggregate:

Products/Completed Operations Aggregate	<u>\$1,000,000</u>
Personal and Advertising Injury	<u>\$300,000</u>
Each Occurrence	<u>\$300,000</u>
Fire Damage (Any One Fire)	<u>\$Nil</u>
Medical Expense (Any One Person)	<u>\$Nil</u>

c. Business Auto Policy

Each Occurrence Bodily Injury and Property Damage Liability Combined	<u>\$300,000</u>
Annual Aggregate (if applicable):	<u>\$1,000,000</u>

d. Owners Protective Liability Coverage

The minimum OPC Policy limits per occurrence and, if subject to an aggregate, annual aggregate to be provided by the contractor shall be the same as the amounts shown above as the minimum per occurrence and general policy aggregate limits respectively required for the Commercial General Liability coverage. The limits afforded by the OPC Policy and any excess policies shall apply only to the Owner and the Owner's officials, officers, agents and employees and only to claims arising out of or in connection with the work under this contract.

e. Property Insurance

If this contract includes construction of or additions to above ground buildings or structures, contractor shall provide "**Builder's Risk**" insurance with the minimum amount of insurance to be 100% of the value of such addition(s), building(s), or structure(s).

f. Installation Floater

If this contract does not include construction of or additions to above ground building or structures, **but does involve** the installation of machinery or equipment, contractor shall provide an "**Installation Floater**" with the minimum amount of insurance to be 100% of the value of such addition(s), building(s), or structure(s).

g. Certificates of Insurance and Copies of Policies

Certificates of Insurance in triplicate evidencing the insurance coverage specified in the six above paragraphs a., b., c., d., e., and f., shall be filed with the Purchasing Director before operations are begun. The required certificates of insurance shall name the types of policy, policy number, date of expiration, amount of coverage, companies affording coverage, and also shall refer specifically to the bid number, project title and location of project. Insurance shall remain in force at least one year after completion and acceptance of the project by the County, in the amounts and types as stated herein, with coverage for all products and services completed under this contract.

C.14 INSURANCE (Continued)

ADDITIONAL INSURED: The contractor shall name Manatee County as additional insured in each of the applicable policies.

If the initial insurance expires prior to the completion of operations and/or services by the contractor, renewal certificates of insurance and required copies of policies shall be furnished by the contractor and delivered to the Purchasing Director thirty (30) days prior to the date of their expiration.

Nothing herein shall in any manner create any liability of the County in connection with any claim against the contractor for labor, services, or materials, or of subcontractors; and nothing herein shall limit the liability of the contractor or contractor's sureties to the County or to any workers, suppliers, material men or employees in relation to this contract.

C.15 BID BOND/CERTIFIED CHECK

By offering a submission to this Invitation For Bid, the bidder agrees should the bidder's bid be accepted, to execute the form of contract and present the same to Manatee County for approval within 10 days after being notified of the awarding of the contract. The bidder further agrees that failure to execute and deliver said form of contract **within 10 days** will result in damages to Manatee County and as guarantee of payment of same a bid bond/certified check shall be enclosed within the submitted sealed bid in the amount of five (5%) percent of the total amount of the bid. The bidder further agrees that in case the bidder fails to enter into a contract, as prescribed by Manatee County, the bid bond/certified check accompanying the bid shall be forfeited to Manatee County as agreed liquidated damages. If the County enters into a contract with a bidder, or if the County rejects any and/or all bids, accompanying bond will be promptly returned.

C.16 PERFORMANCE AND PAYMENT BONDS

The successful bidder shall furnish surety bonds as security for faithful performance of the contract awarded as a result of this bid, and for the payment of all persons performing labor and/or furnishing material in connection therewith. Surety of such bonds shall be in an amount equal to the bid award (100% each) and from a duly authorized and nationally recognized surety company, authorized to do business in Florida, satisfactory to this County. The attorney-in-fact who signs the bonds must file with the bonds a certificate and effective dated copy of power-of-attorney. (Reference Florida Statute 255.05)

Furnishing the performance and payment bonds shall be requisite to execution of a contract with the County. Said performance and payment bonds will remain in force for the duration of the contract with the premiums paid by the contractor. Failure of successful bidder to execute such contract and to supply the required bonds shall be just cause for annulment of the award.

The County may then contract with another acceptable bidder or re-advertise this Invitation For Bid. If another bidder is accepted, and notice given within 90 days after the opening of bids, this acceptance shall bind the bidder as though they were originally the successful bidder.

C.16 PERFORMANCE AND PAYMENT BONDS (Continued)

Failure of the County at any time, to require performance by the contractor of any provisions set out in the contract will in no way affect the right of the County, thereafter, to enforce the provisions. Bonds to remain in effect for one year after final payment becomes due.

C.17 PROJECT SCHEDULE

The successful bidder will be required to submit a detailed construction schedule upon notification of award or its intent.

C.18 NO DAMAGES FOR DELAY

No claim for damages or any claim other than for an extension of time shall be made or asserted against the County by reason of any delays. The Contractor shall not be entitled to an increase in the Total Contract Price or payment or compensation of any kind from the County or direct, indirect, consequential impact or other costs, expenses for damages, including but not limited to costs of acceleration or inefficiency arising because of delay, disruption, interference or hindrance from any cause whatsoever; provided, however, that this provision shall not preclude recovery or damages by the Contractor for hindrance or delays due solely to fraud, bad faith, or active interference on part of the County or its agents. Otherwise, the Contractor shall only be entitled to extensions of the Contract Time as the sole and exclusive remedy for such resulting delay, in accordance with and to the extend specifically provided above.

C.19 NO INTEREST

Any monies not paid by the County when claimed to be due to the Contractor under this Contract shall not be subject to interest including prejudgment interest. Any monies not paid by the County when claimed to be due to the Contractor for damages awarded in the case of construction delays shall not be subject to prejudgment interest.

C.20 CONSTRUCTION OF CONTRACT

This Contract and the rights and responsibilities hereunder shall not be construed more strongly against either party, regardless of the extent to which such party may have participated in the preparation hereof.

SECTION 00100
INSTRUCTIONS TO BIDDERS

D.01 THE WORK

The work included in this contract consists of the rehabilitation to upgrade nine (9) lift stations. The work includes, but is not limited to the removal and replacement of base elbows, piping, valves, and fittings in wet well and valve vault. Install new fiberglass or spray on wet well liner, new HDPE discharge piping, and stilling well. Install new valves and fittings in the valve vault. Grout the existing and install new PVC drain from the valve vault to the wet well. Tap and valve conduit for telemetry. Also included in the rehabilitation is by-pass pumping; removal and disposal of construction debris; and other miscellaneous items as noted on the plans.

Contractor shall furnish all shop drawings, work drawings, labor, materials, equipment tools, services and incidentals necessary to complete all work required by these Specifications and as shown on the Contract Drawings.

The Contractor shall perform the work complete, in place and ready for continuous service and shall include any repairs, replacements, and / or restoration required as a result of damages caused prior to acceptance by the Owner.

The Contractor shall furnish and install all materials, equipment and labor which is reasonably and properly inferable and necessary for the proper completion of the work, whether specifically indicated in the Contract Documents or not.

LOCATIONS:

- 1) #1 Lift Station, RTU 54, 111 6th Street South
Project No. 402-5112080-LS 1
- 2) #6 Lift Station, RTU 59, 5901 Marina Dr.
Project No. 402-5112280-LS 6
- 3) #7 Lift Station, RTU 62, 6900 Holmes Blvd.
Project No. 402-5112380-LS 7
- 4) #8 Lift Station, RTU 63, 7205 Marina Dr.
Project No. 402-5112480-LS 8
- 5) #12 Lift Station, RTU 65, 501 Magnolia Ave.
Project No. 402-5112580-LS 12
- 6) #15 Lift Station, RTU 67, 420 N. Bay Blvd.
Project No. 402-5112780-LS 15
- 7) #30-A Lift Station, RTU 125, 2921 47th Ave. West
Project No. 402-5112880-LS 30-A

D.01 THE WORK (Continued)**Locations:**

- 8) #2-M Lift Station, RTU 205, 4326 124th St., CT. West
Project No. 402-5112180-LS 2-M
- 9) #12-D Lift Station, RTU 221, 7830 DeSoto Memorial Highway
Project No. 402-5112680-LS 12-D

D.02 SECURING OF DOCUMENTS

Complete individual copies of the bidding documents for the project and/or products can be obtained at the Manatee County Public Works Department located at: 1022 26th Avenue East, Bradenton, FL 34208: 941-708-7450, Extension 7349 between the hours of 8:00 AM and 4:00 PM Monday through Friday at no charge. Complete set of the Bidding Documents must be used in preparing bids. Neither Owner nor Engineer assumes any responsibility for errors and misinterpretations resulting from the use of incomplete sets of Bidding Documents.

D.03 SUBCONTRACTORS, SUPPLIERS AND OTHERS

The identity of subcontractors, suppliers, and other persons and organizations (including those who are to furnish the principal items of material and equipment) may be requested by the Owner for each bid item from any of the Bidders; and the Bidder shall respond within five days after the date of such request. Such list shall be accompanied by an experience statement with pertinent information regarding similar projects and other evidence of qualification for each such subcontractor, supplier, persons or organization if requested by Owner. If Owner, after due investigation, has reasonable objection to any proposed subcontractor, supplier, other person or organization, Owner may, before the Notice of Award is given, request the apparent successful Bidder to submit an acceptable substitute without an increase in Contract Price or Contract Time.

If apparent successful Bidder declines to make any such substitution, Owner may award the contract to the next lowest qualified Bidder that proposes to use acceptable subcontractors, suppliers, and other persons who Owner does not make written objection to. Contractor shall not be required to employ any subcontractor, supplier, other person or organization who Contractor has reasonable objection to.

Subcontractors shall be bound by the terms and conditions of this contract insofar as it applies to their Work, but this shall not relieve the prime contractor from the full responsibility to the Owner for the proper completion of all Work to be executed under this contract.

Note: Contractor shall supply a list providing a description of the work which shall be performed by the proposed subcontractors along with the names and locations of the subcontractors.

D.04 BIDS

Bids are to be submitted in triplicate, one original and two copies, upon the County supplied forms. All blank spaces must be filled in as noted with amounts extended and totaled and no changes shall be made in the wording of the forms or in the items mentioned therein. In the event a change is made in your submittal, the Bidder shall write its initials by the change. Any bid may be rejected which contains any omissions, alterations, irregularities of any kind, or which shall in any manner fail to conform to bid requirements.

A bid made by an individual, either in his/her own or proper person or under a trade or firm name, shall be executed under the individual's signature. If made by a partnership, the bid shall be executed by two or more of the general partners. If made by a corporation, the bid shall be executed by its President or other legally authorized corporate officer or agent.

D.05 EXAMINATION OF CONTRACT DOCUMENTS AND SITE

It is the responsibility of each Bidder before submitting a Bid, to (a) examine the Bid Documents thoroughly; (b) visit the site to become familiar with local conditions that may affect cost, progress, performance, or furnishing of the Work; (c) consider federal, state, and local codes, laws, and regulations that may affect costs, progress, performance, or furnishing of the Work; (d) study and carefully correlate Bidder's observations with the Bid Documents; and (e) notify Owner of all conflicts, errors, or discrepancies in the Bid Document. The accuracy of the existing utility locations shown on the plans is approximate and without express or implied warranty. Each Bidder may, at Bidder's own expense, make or obtain any additional examinations, investigations, explorations, tests and studies, and obtain any additional information and data which pertain to the physical conditions at or contiguous to the site or otherwise which may affect cost, progress, performance or furnishing of the Work and which Bidder deems necessary to determine his Bid for performing and furnishing the Work in accordance with the time, price and other terms and conditions of the Contract Documents.

Owner will provide each Bidder access to the site to conduct such explorations and tests. Bidder shall fill all holes, clean up and restore the site to its former condition upon completion of such explorations. The lands upon which the Work is to be performed, rights-of-way and easements for access thereto, and other lands designated for use by Contractor in performing the Work are identified in the Contract Documents. All additional lands and access thereto required for temporary construction facilities or storage of materials and equipment are to be provided by Contractor. Easements for permanent structures or permanent changes in existing structures are to be obtained and paid for by Owner unless otherwise provided in the Contract Documents.

NOTE: Questions received six calendar days or less from the date of the bid opening may not be answered.

SECTION 00300 (Submit in Triplicate)
BID FORM "A" – For Satellite Lift Station Rehabilitation Priority 1

Subtotal #1 Lift Station \$ _____
 Subtotal #6 Lift Station \$ _____
 Subtotal #7 Lift Station \$ _____
 Subtotal #8 Lift Station \$ _____
 Subtotal #12 Lift Station \$ _____
 Subtotal #15 Lift Station \$ _____
 Subtotal #30-A Lift Station \$ _____
 Subtotal #2-M Lift Station \$ _____
 Subtotal #12-D Lift Station \$ _____

TOTAL BID PRICE "A" \$ _____ **Based on a Completion time of
360 calendar days**

Two schedules for Completion of Work shall be considered. Each bid for completion by the specified stated time shall be offered as a separate "Total Bid Price". The County has the sole authority to select the base bid on the Completion Time which is in the best interest of the County. Only one award shall be made.

We, the undersigned, hereby declare that we have carefully reviewed the bid documents, and with full knowledge and understanding of the aforementioned herewith submit this bid, meeting each and every specification, term, and condition contained in the Invitation for Bids.

We understand that the bid technical specifications, terms, and conditions in their entirety shall be made a part of any agreement or contract between Manatee County and the successful bidder. Failure to comply shall result in contract default, whereupon, the defaulting contractor shall be required to pay for any and all re-procurement costs, damages, and attorney fees as incurred by the County.

Communications concerning this Bid shall be addressed as follows:

Person's Name: _____

Address: _____ Phone: _____

Date: _____ FL Contractor License# _____

Bidder is a WBE/MBE Vendor? _____ Certification # _____

COMPANY'S NAME: _____

AUTHORIZED SIGNATURE(S) _____

Name and Title of Above Signer(s) _____

CO. MAILING ADDRESS: _____

STATE OF INCORPORATION: _____ (if applicable)

TELEPHONE: () _____ FAX: () _____

Addendum No. _____ Dated: _____ Addendum No. _____ Dated _____

ACKNOWLEDGE SITE VISIT: (Name): _____ Date _____

SECTION 00300 (Submit In Triplicate)
BID FORM "B" – For Satellite Lift Station Rehabilitation Priority 1

Subtotal #1 Lift Station	\$ _____	
Subtotal #6 Lift Station	\$ _____	
Subtotal #7 Lift Station	\$ _____	
Subtotal #8 Lift Station	\$ _____	
Subtotal #12 Lift Station	\$ _____	
Subtotal #15 Lift Station	\$ _____	
Subtotal #30-A Lift Station	\$ _____	
Subtotal #2-M Lift Station	\$ _____	
Subtotal #12-D Lift Station	\$ _____	
TOTAL BID PRICE "B"	\$ _____	Based on a Completion time of 315 calendar days

Two schedules for Completion of Work shall be considered. Each bid for completion by the specified stated time shall be offered as a separate "Total Bid Price". The County has the sole authority to select the base bid on the Completion Time which is in the best interest of the County. Only one award shall be made.

We, the undersigned, hereby declare that we have carefully reviewed the bid documents, and with full knowledge and understanding of the aforementioned herewith submit this bid, meeting each and every specification, term, and condition contained in the Invitation for Bids.

We understand that the bid technical specifications, terms, and conditions in their entirety shall be made a part of any agreement or contract between Manatee County and the successful bidder. Failure to comply shall result in contract default, whereupon, the defaulting contractor shall be required to pay for any and all re-procurement costs, damages, and attorney fees as incurred by the County.

Communications concerning this Bid shall be addressed as follows:

Person's Name: _____

Address: _____ Phone: _____

Date: _____ FL Contractor License# _____

Bidder is a WBE/MBE Vendor? _____ Certification # _____

COMPANY'S NAME: _____

AUTHORIZED SIGNATURE(S) _____

Name and Title of Above Signer(s) _____

CO. MAILING ADDRESS: _____

STATE OF INCORPORATION: _____ (if applicable)

TELEPHONE: () _____ FAX: () _____

Addendum No. _____ Dated: _____ Addendum No. _____ Dated _____

ACKNOWLEDGE SITE VISIT: (Name): _____ Date: _____

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112080 - LS #1

SECTION 00300

BID "A"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #1

(Bid "A" - Based on Completion Time of 360 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	INTENTIONALLY LEFT BLANK				
4	WET WELL FIBERGLASS LINER	420	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	INTENTIONALLY LEFT BLANK				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	INTENTIONALLY LEFT BLANK				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	INTENTIONALLY LEFT BLANK				
15	6" PVC W.W. VENT. WITH S.S. SCREEN	1	EA	\$	\$
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	INTENTIONALLY LEFT BLANK				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	6" PLUG VALVE	1	EA	\$	\$
21	INTENTIONALLY LEFT BLANK				
22	INTENTIONALLY LEFT BLANK				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "A" LS #1

00300-3

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112080 - LS #1

SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #1****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	INTENTIONALLY LEFT BLANK				
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#1					\$

Bidder: _____

Bid Form "A" LS #1

00300-4

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112080-LS #1

SECTION 00300

BID "B"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #1****(Bid "B" - Based on Completion Time of 315 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	INTENTIONALLY LEFT BLANK				
4	WET WELL FIBERGLASS LINER	420	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	INTENTIONALLY LEFT BLANK				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	INTENTIONALLY LEFT BLANK				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	INTENTIONALLY LEFT BLANK				
15	6" PVC W.W. VENT. WITH S.S. SCREEN	1	EA	\$	\$
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	INTENTIONALLY LEFT BLANK				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	6" PLUG VALVE	1	EA	\$	\$
21	INTENTIONALLY LEFT BLANK				
22	INTENTIONALLY LEFT BLANK				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "B" LS #1

00300-5

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112080-LS #1

SECTION 00300

BID "B"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #1****(Bid "B" - Based on Completion Time of 315 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	INTENTIONALLY LEFT BLANK				
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "B" Based on 315 calendar day completion time - LS#1					\$

Bidder: _____

Bid Form "B" LS #1

00300-6

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112280-LS #6

SECTION 00300

BID "A"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #6

(Bid "A" - Based on Completion Time of 360 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	380	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	<i>INTENTIONALLY LEFT BLANK</i>				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	<i>INTENTIONALLY LEFT BLANK</i>				
15	<i>INTENTIONALLY LEFT BLANK</i>				
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	<i>INTENTIONALLY LEFT BLANK</i>				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	<i>INTENTIONALLY LEFT BLANK</i>				
21	8" PLUG VALVE	1	EA	\$	\$
22	<i>INTENTIONALLY LEFT BLANK</i>				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "A" LS #6

00300-7

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112280-LS #6

SECTION 00300

BID "A"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #6

(Bid "A" - Based on Completion Time of 360 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	INTENTIONALLY LEFT BLANK				
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#6					\$

Bidder: _____

Bid Form "A" LS #6

00300-8

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112280-LS #6

SECTION 00300

BID "B"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #6****(Bid "B" - Based on Completion Time of 315 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	INTENTIONALLY LEFT BLANK				
4	WET WELL FIBERGLASS LINER	380	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	INTENTIONALLY LEFT BLANK				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	INTENTIONALLY LEFT BLANK				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	INTENTIONALLY LEFT BLANK				
15	INTENTIONALLY LEFT BLANK				
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	INTENTIONALLY LEFT BLANK				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	INTENTIONALLY LEFT BLANK				
21	8" PLUG VALVE	1	EA	\$	\$
22	INTENTIONALLY LEFT BLANK				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "B" LS #6

00300-9

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112280-LS #6

SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #6

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	INTENTIONALLY LEFT BLANK				
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "B" Based on 315 calendar day completion time - LS#6					\$

Bidder: _____

Bid Form "B" LS #6

00300-10

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112380-LS #7

SECTION 00300

BID "A"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #7

(Bid "A" - Based on Completion Time of 360 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	INTENTIONALLY LEFT BLANK				
4	WET WELL FIBERGLASS LINER	905	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	6" PVC STILLING WELL	1	EA	\$	\$
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	INTENTIONALLY LEFT BLANK				
11	6" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
12	DUCTILE IRON FITTINGS	205	LB	\$	\$
13	INTENTIONALLY LEFT BLANK				
14	6" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
15	INTENTIONALLY LEFT BLANK				
16	INTENTIONALLY LEFT BLANK				
17	6" SWING CHECK VALVE	2	EA	\$	\$
18	INTENTIONALLY LEFT BLANK				
19	6" GATE VALVE	3	EA	\$	\$
20	INTENTIONALLY LEFT BLANK				
21	INTENTIONALLY LEFT BLANK				
22	10" PLUG VALVE	1	EA	\$	\$
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "A" LS #7

00300-11

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112380-LS #7

SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #7****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	INTENTIONALLY LEFT BLANK				
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#7					\$

Bidder: _____

Bid Form "A" LS #7

00300-12

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112380-LS #7

SECTION 00300

BID "B"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #7****(Bid "B" - Based on Completion Time of 315 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	905	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	6" PVC STILLING WELL	1	EA	\$	\$
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	<i>INTENTIONALLY LEFT BLANK</i>				
11	6" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
12	DUCTILE IRON FITTINGS	205	LB	\$	\$
13	<i>INTENTIONALLY LEFT BLANK</i>				
14	6" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
15	<i>INTENTIONALLY LEFT BLANK</i>				
16	<i>INTENTIONALLY LEFT BLANK</i>				
17	6" SWING CHECK VALVE	2	EA	\$	\$
18	<i>INTENTIONALLY LEFT BLANK</i>				
19	6" GATE VALVE	3	EA	\$	\$
20	<i>INTENTIONALLY LEFT BLANK</i>				
21	<i>INTENTIONALLY LEFT BLANK</i>				
22	10" PLUG VALVE	1	EA	\$	\$
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "B"LS #7

00300-13

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112380-LS #7

SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #7

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	INTENTIONALLY LEFT BLANK				
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "B" Based on 315 calendar day completion time - LS#7					\$

Bidder: _____

Bid Form "B"LS #7

00300-14

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112480-LS #8

SECTION 00300

BID "A"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #8

(Bid "A" - Based on Completion Time of 360 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	285	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	<i>INTENTIONALLY LEFT BLANK</i>				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEMS	1	EA	\$	\$
14	<i>INTENTIONALLY LEFT BLANK</i>				
15	6" PVC W.W.VENT.W ITH S.S. SCREEN	1	EA	\$	\$
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	<i>INTENTIONALLY LEFT BLANK</i>				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	6" PLUG VALVE	1	EA	\$	\$
21	<i>INTENTIONALLY LEFT BLANK</i>				
22	<i>INTENTIONALLY LEFT BLANK</i>				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "A" LS #8

00300-15

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112480-LS #8

SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #8****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	INTENTIONALLY LEFT BLANK				
28	INTENTIONALLY LEFT BLANK				
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#8					\$

Bidder: _____

Bid Form "A" LS #8

00300-16

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112480-LS #8

SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #8

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	INTENTIONALLY LEFT BLANK				
4	WET WELL FIBERGLASS LINER	285	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	INTENTIONALLY LEFT BLANK				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	INTENTIONALLY LEFT BLANK				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEMS	1	EA	\$	\$
14	INTENTIONALLY LEFT BLANK				
15	6" PVC W.W.VENT.W ITH S.S. SCREEN	1	EA	\$	\$
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	INTENTIONALLY LEFT BLANK				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	6" PLUG VALVE	1	EA	\$	\$
21	INTENTIONALLY LEFT BLANK				
22	INTENTIONALLY LEFT BLANK				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "B" LS #8

00300-17

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112480-LS #8

SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #8

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	INTENTIONALLY LEFT BLANK				
28	INTENTIONALLY LEFT BLANK				
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 315 calendar day completion time - LS#8					\$

Bidder: _____

Bid Form "B" LS #8

00300-18

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112580-LS #12

SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #12****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	600	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	6" PVC STILLING WELL	1	EA	\$	\$
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	295	LB	\$	\$
13	<i>INTENTIONALLY LEFT BLANK</i>				
14	6" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
15	<i>INTENTIONALLY LEFT BLANK</i>				
16	<i>INTENTIONALLY LEFT BLANK</i>				
17	6" SWING CHECK VALVE	2	EA	\$	\$
18	<i>INTENTIONALLY LEFT BLANK</i>				
19	6" GATE VALVE	3	EA	\$	\$
20	<i>INTENTIONALLY LEFT BLANK</i>				
21	8" PLUG VALVE	1	EA	\$	\$
22	<i>INTENTIONALLY LEFT BLANK</i>				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form LS "A" #12

00300-19

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112580-LS #12

SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #12****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#12					\$

Bidder: _____

Bid Form LS "A" #12

00300-20

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112580-LS #12

SECTION 00300

BID "B"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #12****(Bid "B" - Based on Completion Time of 315 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	600	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	6" PVC STILLING WELL	1	EA	\$	\$
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	295	LB	\$	\$
13	<i>INTENTIONALLY LEFT BLANK</i>				
14	6" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
15	<i>INTENTIONALLY LEFT BLANK</i>				
16	<i>INTENTIONALLY LEFT BLANK</i>				
17	6" SWING CHECK VALVE	2	EA	\$	\$
18	<i>INTENTIONALLY LEFT BLANK</i>				
19	6" GATE VALVE	3	EA	\$	\$
20	<i>INTENTIONALLY LEFT BLANK</i>				
21	8" PLUG VALVE	1	EA	\$	\$
22	<i>INTENTIONALLY LEFT BLANK</i>				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "B" LS #12

00300-21

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112580-LS #12

SECTION 00300

BID "B"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #12****(Bid "B" - Based on Completion Time of 315 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "B" Based on 315 calendar day completion time - LS#12					\$

Bidder: _____

Bid Form "B" LS #12

00300-22

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112780-LS #15

SECTION 00300

BID "A"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #15

(Bid "A" - Based on Completion Time of 360 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	WET WELL SPRAY LINER SYSTEM	440	SF	\$	\$
4	INTENTIONALLY LEFT BLANK				
5	INTENTIONALLY LEFT BLANK				
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	INTENTIONALLY LEFT BLANK				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	INTENTIONALLY LEFT BLANK				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE Discharge Piping System	1	EA	\$	\$
14	INTENTIONALLY LEFT BLANK				
15	INTENTIONALLY LEFT BLANK				
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	INTENTIONALLY LEFT BLANK				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	6" PLUG VALVE	1	EA	\$	\$
21	INTENTIONALLY LEFT BLANK				
22	INTENTIONALLY LEFT BLANK				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "A" LS #15

00300-23

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112780-LS #15

SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #15****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#15					\$

Bidder: _____

Bid Form "A" LS #15

00300-24

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112780-LS #15

SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #15

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	WET WELL SPRAY LINER SYSTEM	440	SF	\$	\$
4	<i>INTENTIONALLY LEFT BLANK</i>				
5	<i>INTENTIONALLY LEFT BLANK</i>				
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	<i>INTENTIONALLY LEFT BLANK</i>				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE Discharge Piping System	1	EA	\$	\$
14	<i>INTENTIONALLY LEFT BLANK</i>				
15	<i>INTENTIONALLY LEFT BLANK</i>				
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	<i>INTENTIONALLY LEFT BLANK</i>				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	6" PLUG VALVE	1	EA	\$	\$
21	<i>INTENTIONALLY LEFT BLANK</i>				
22	<i>INTENTIONALLY LEFT BLANK</i>				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "B" LS #15

00300-25

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112780-LS #15

SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #15

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "B" Based on 315 calendar day completion time - LS#15					\$

Bidder: _____

Bid Form "B" LS #15

00300-26

BID FORM

IFB 09-0490-OV

(Submite in Triplicate) - Project No. 402-5112880-LS #30-A

SECTION 00300**BID "A"****IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #30-A****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	505	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	<i>INTENTIONALLY LEFT BLANK</i>				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	<i>INTENTIONALLY LEFT BLANK</i>				
15	6" PVC W.W. VENT. WITH S.S. SCREEN	1	EA	\$	\$
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	<i>INTENTIONALLY LEFT BLANK</i>				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	<i>INTENTIONALLY LEFT BLANK</i>				
21	8" PLUG VALVE	1	EA	\$	\$
22	<i>INTENTIONALLY LEFT BLANK</i>				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "A" LS#30-A

00300-27

BID FORM

IFB 09-0490-OV

(Submite in Triplicate) - Project No. 402-5112880-LS #30-A

SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #30-A****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	<i>INTENTIONALLY LEFT BLANK</i>				
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#30-A					\$

Bidder: _____

Bid Form "A" LS#30-A

00300-28

BID FORM

IFB 09-0490-OV

(Submite in Triplicate) - Project No. 402-5112880-LS #30-A

SECTION 00300

BID "B"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #30-A****(Bid "B" - Based on Completion Time of 315 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	505	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	<i>INTENTIONALLY LEFT BLANK</i>				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	<i>INTENTIONALLY LEFT BLANK</i>				
15	6" PVC W.W. VENT. WITH S.S. SCREEN	1	EA	\$	\$
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	<i>INTENTIONALLY LEFT BLANK</i>				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	<i>INTENTIONALLY LEFT BLANK</i>				
21	8" PLUG VALVE	1	EA	\$	\$
22	<i>INTENTIONALLY LEFT BLANK</i>				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid "B" LS#30-A

00300-29

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112880-LS #30-A

SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #30-A

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	<i>INTENTIONALLY LEFT BLANK</i>				
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "B" Based on 315 calendar day completion time - LS#30-A					\$

Bidder: _____

Bid "B" LS#30-A

00300-30

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112180 - LS #2-M

SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #2-M****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	340	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	<i>INTENTIONALLY LEFT BLANK</i>				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	<i>INTENTIONALLY LEFT BLANK</i>				
15	6" PVC W.W. VENT. WITH S.S. SCREEN	1	EA	\$	\$
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	<i>INTENTIONALLY LEFT BLANK</i>				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	6" PLUG VALVE	1	EA	\$	\$
21	<i>INTENTIONALLY LEFT BLANK</i>				
22	<i>INTENTIONALLY LEFT BLANK</i>				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "A" LS #2-M

00300-31

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112180 - LS #2-M

SECTION 00300

BID "A"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #2-M

(Bid "A" - Based on Completion Time of 360 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#2-M					\$

Bidder: _____

Bid Form "A" LS #2-M

00300-32

BID FORM
 (Submit in Triplicate)
 (Submit in Triplicate) - Project No. 402-5112180 - LS #2-M
 SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #2-M

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	INTENTIONALLY LEFT BLANK				
4	WET WELL FIBERGLASS LINER	340	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	INTENTIONALLY LEFT BLANK				
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	INTENTIONALLY LEFT BLANK				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	INTENTIONALLY LEFT BLANK				
15	6" PVC W.W. VENT. WITH S.S. SCREEN	1	EA	\$	\$
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	INTENTIONALLY LEFT BLANK				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	6" PLUG VALVE	1	EA	\$	\$
21	INTENTIONALLY LEFT BLANK				
22	INTENTIONALLY LEFT BLANK				
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "B" LS #2-M

00300-33

BID FORM
 (Submit in Triplicate)
 (Submit in Triplicate) - Project No. 402-5112180 - LS #2-M
 SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 - LS #2-M

(Bid "B" - Based on Completion Time of 315 calendar days)

25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	DOUBLE CHECK BACKFLOW PREVENTER	1	EA	\$	\$
28	RELOCATE WATER SERVICE	1	EA	\$	\$
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	CONCRETE VALVE VAULT SECTION	1	EA	\$	\$
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "B" Based on 315 calendar day completion time - LS#2-M					\$

Bidder: _____

Bid Form "B" LS #2-M

00300-34

BID FORM
 (Submit in Triplicate)
 (Submit in Triplicate) - Project No. 402-5112680 - LS #12-D
 SECTION 00300

BID "A"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 -LS #12-D****(Bid "A" - Based on Completion Time of 360 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	INTENTIONALLY LEFT BLANK				
4	WET WELL FIBERGLASS LINER	430	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	6" PVC Stilling Well	1	EA	\$	\$
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	INTENTIONALLY LEFT BLANK				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	INTENTIONALLY LEFT BLANK				
15	INTENTIONALLY LEFT BLANK				
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	INTENTIONALLY LEFT BLANK				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	INTENTIONALLY LEFT BLANK				
21	INTENTIONALLY LEFT BLANK				
22	10" PLUG VALVE	1	EA	\$	\$
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "A" LS #12-D

00300-35

BID FORM

IFB 09-0490-OV

(Submit in Triplicate)

(Submit in Triplicate) - Project No. 402-5112680 - LS #12-D

SECTION 00300

BID "A"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 -LS #12-D

(Bid "A" - Based on Completion Time of 360 calendar days)

25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	INTENTIONALLY LEFT BLANK				
28	INTENTIONALLY LEFT BLANK				
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	INTENTIONALLY LEFT BLANK				
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "A" Based on 360 calendar day completion time - LS#12-D					\$

Bidder: _____

Bid Form "A" LS #12-D

00300-36

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112680 - LS #12-D

SECTION 00300

BID "B"**IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 -LS #12-D****(Bid "B" - Based on Completion Time of 315 calendar days)**

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
1	PLUG INFLUENT LINE	1	EA	\$	\$
2	BY-PASS PUMPING	1	EA	\$	\$
3	<i>INTENTIONALLY LEFT BLANK</i>				
4	WET WELL FIBERGLASS LINER	430	SF	\$	\$
5	NEW CONCRETE WET WELL TOP W/ALUM. HATCH	1	EA	\$	\$
6	REMOVE BASE ELLS, PIPING, VALVES, BRACING, ETC.	1	LS	\$	\$
7	6" PVC Stilling Well	1	EA	\$	\$
8	PIPE BRACING SYSTEM	1	EA	\$	\$
9	PUMP GUIDE RAIL SYSTEM	1	EA	\$	\$
10	4" PUMP BASE ELLS & BASE PLATES	2	EA	\$	\$
11	<i>INTENTIONALLY LEFT BLANK</i>				
12	DUCTILE IRON FITTINGS	135	LB	\$	\$
13	4" HDPE DISCHARGE PIPING SYSTEM	1	EA	\$	\$
14	<i>INTENTIONALLY LEFT BLANK</i>				
15	<i>INTENTIONALLY LEFT BLANK</i>				
16	4" SWING CHECK VALVE	2	EA	\$	\$
17	<i>INTENTIONALLY LEFT BLANK</i>				
18	4" GATE VALVE	2	EA	\$	\$
19	6" GATE VALVE	1	EA	\$	\$
20	<i>INTENTIONALLY LEFT BLANK</i>				
21	<i>INTENTIONALLY LEFT BLANK</i>				
22	10" PLUG VALVE	1	EA	\$	\$
23	3" PVC DRAIN	1	EA	\$	\$
24	SS ADJUSTABLE PIPE SUPPORT	4	EA	\$	\$

Bidder: _____

Bid Form "B" LS #12-D

00300-37

BID FORM

IFB 09-0490-OV

(Submit in Triplicate) - Project No. 402-5112680 - LS #12-D

SECTION 00300

BID "B"

IFB 09-0490-OV - Satellite Lift Station Rehabilitation Priority 1 -LS #12-D

(Bid "B" - Based on Completion Time of 315 calendar days)

ITEM NO.	DESCRIPTION	EST. QTY.	U/M	UNIT PRICE	EXTENDED PRICE
25	6" QUICK CONNECT	1	EA	\$	\$
26	UNDERGROUND CONDUIT	25	FT	\$	\$
27	INTENTIONALLY LEFT BLANK				
28	INTENTIONALLY LEFT BLANK				
29	DRAIN DOWN & CLEAN W W	1	EA	\$	\$
30	CONCRETE WET WELL BARRELL SECTION	1	EA	\$	\$
30a	INTENTIONALLY LEFT BLANK				
31	MOBILIZATION (NOT TO EXCEED 10% OF TOTAL BID)	1	LS	\$	\$
32	MISCELLANEOUS WORK & CLEAN UP	1	LS		
33	DISCRETIONARY WORK	1	LS		\$10,000.00
33a	DISCRETIONARY: STONE AND SHELL & MULCH		CY	\$	
33b	DISCRETIONARY: VINYL COATED 6 FT. GALV. CHAIN LINK FENCE		LF	\$	
33c	DISCRETIONARY: GATE, 6 FT. FOR VINYL COATED CHAIN LINK FENCE		EA	\$	
Subtotal Bid Price - Bid "B" Based on 315 calendar day completion time - LS#12-D					\$

Bidder: _____

Bid Form "B" LS #12-D

00300-38

**SWORN STATEMENT
THE FLORIDA TRENCH SAFETY ACT**

THIS FORM MUST BE SIGNED IN THE PRESENCE OF A NOTARY PUBLIC OR BY AN OFFICER AUTHORIZED TO ADMINISTER OATHS.

1. This Sworn Statement is submitted with IFB No. #09-0490-OV
2. This Sworn Statement is submitted by _____, whose business address is _____ and, if applicable, its Federal Employer Identification Number (FEIN) is _____. If the entity has no FEIN, include the Social Security Number of the individual signing this sworn statement _____.
3. Name of individual signing this Sworn Statement is: _____, whose relationship to the above entity is _____.
4. The Trench Safety Standards that will be in effect during the construction of this project shall include, but are not limited to: Laws of Florida, Chapters 90-96, TRENCH SAFETY ACT, and OSHA RULES AND REGULATIONS 29 CFR 1926.650 Subpart P, effective October 1, 1990.
5. The undersigned assures that the entity will comply with the applicable Trench Safety Standards and agrees to indemnify and hold harmless the Owner and Engineer, and any of their agents or employees from any claims arising from the failure to comply with said standard.
6. The undersigned has appropriated the following costs for compliance with the applicable standards:

Trench Safety Measure (Description)	Units of Measure (LF, SY)	Unit Quantity	Unit Cost	Extended Cost
a. _____	_____	_____	\$ _____	\$ _____
b. _____	_____	_____	\$ _____	\$ _____
c. _____	_____	_____	\$ _____	\$ _____
d. _____	_____	_____	\$ _____	\$ _____

7. The undersigned intends to comply with these standards by instituting the following procedures:

_____.

THE UNDERSIGNED, in submitting this Bid, represents that they have reviewed and considered all available geotechnical information and made such other investigations and tests as they may deem necessary to adequately design the trench safety system(s) to be utilized on this project.

(AUTHORIZED SIGNATURE / TITLE)

SWORN to and subscribed before me this ___ day of _____, 20__.
(impress official seal)

Notary Public, State of Florida
My commission expires: _____

SECTION 00430
CONTRACTOR'S QUESTIONNAIRE
(Submit in Triplicate)

The Bidder warrants the truth and accuracy of all statements and answers herein contained. (Include additional sheets if necessary.)

THIS QUESTIONNAIRE MUST BE COMPLETED AND SUBMITTED WITH YOUR BID.

1. LICENSE # and COMPANY'S NAME: _____
CO. PHYSICAL ADDRESS: _____
TELEPHONE NUMBER: () _____ FAX: () _____

2. Bidding as an; individual: ____; a partnership: ____; a corporation; ____; a joint venture; ____

3. If a partnership: list names and addresses of partners; if a corporation: list names of officers, directors, shareholders, and state of incorporation; if joint venture: list names and address of venturers and the same if any venturer is a corporation for each such corporation, partnership, or joint venture:

4. Your organization has been in business (under this firm's name) as a _____
for how many years? _____

5. Describe and give the date and owner of the last three government projects you've completed which are similar in cost, type, size, and nature as the one proposed (for a public entity). Include contact name and phone number:

6. Have you ever been assessed liquidated damages under a contract during the past five (5) years? If so, state when, where (contact name, address, and phone number) and why.

7. Have you ever failed to complete work awarded to you? If so, state when, where (contact name, address, phone number) and why?

8. Have you ever been debarred or prohibited from bidding on a governmental entity's construction project? If yes, name the entity and describe the circumstances:

9. Name three individuals, governmental entities, or corporations for which you have performed similar work and to which you refer. Include contact name and phone number:

1. _____

2. _____

3. _____

10. What specific steps have you taken to examine the physical conditions at or contiguous to the site, including but not limited to, the location of existing underground facilities?

11. What specific physical conditions, including, but not limited to, the location of existing underground facilities have you found which will, in any manner, affect cost, progress, performance, or finishing of the work?

12. Will you subcontract any part of this Work? If so, describe which major portion(s):

13. If any, list (with contract amount) WBE/MBE to be utilized:

14. What equipment do you own to accomplish this Work?

15. What equipment will you purchase/rent for the Work? (specify which)

16. List the following in connection with the Surety which is providing the Bond(s):

Surety's Name: _____

Surety's Address: _____

Name, address and phone number of Surety's resident agent for service of process in Florida:

Phone: (_____) _____

SECTION 00491
Drug Free Work Place Certification
 SWORN STATEMENT PURSUANT TO RESOLUTION R-93-22
 DRUG FREE WORK PLACES

THIS FORM MUST BE SIGNED AND SWORN TO IN THE PRESENCE OF A NOTARY PUBLIC OR OTHER OFFICIAL AUTHORIZED TO ADMINISTER OATHS.

This sworn statement is submitted to the Manatee County Board of County Commissioners by _____
 [print individual's name and title]

_____ for _____
 [print name of entity submitting sworn statement]

whose business address is _____

and (if applicable) its Federal Employer Identification Number (FEIN) is _____ (If the entity has no
 FEIN, include the Social Security Number of the individual signing this sworn statement: _____).

I understand that no person or entity shall be awarded or receive a county contract for public improvements, procurement of goods or services (including professional services) or a county lease, franchise, concession or management agreement, or shall receive a grant of county monies unless such person or entity has submitted a written certification to the County that it will provide a drug free work place by:

(1) providing a written statement to each employee notifying such employee that the unlawful manufacture, distribution, dispensation, possession or use of a controlled substance as defined by 893.02(4), Florida Statutes, as the same may be amended from time to time, in the person's or entity's work place is prohibited specifying the actions that will be taken against employees for violation of such prohibition. Such written statement shall inform employees about:

- (i) the dangers of drug abuse in the work place;
- (ii) the person's or entity's policy of maintaining a drug free environment at all its work places, including but not limited to all locations where employees perform any task relating to any portion of such contract, business transaction or grant;
- (iii) any available drug counseling, rehabilitation, and employee assistance programs; and
- (iv) the penalties that may be imposed upon employees for drug abuse violations.

(2) Requiring the employee to sign a copy of such written statement to acknowledge his or her receipt of same and advice as to the specifics of such policy. Such person or entity shall retain the statements signed by its employees. Such person or entity shall also post in a prominent place at all of its work places, a written statement of its policy containing the foregoing elements (i) through (iv).

(3) Notifying the employee in the statement required by subsection (1) that as a condition of employment the employee will:

- (i) abide by the terms of the statement; and
- (ii) notify the employer of any criminal drug statute conviction for a violation occurring in the work place no later than five (5) days after such a conviction.

(4) Notifying the County within ten (10) days after receiving notice under subsection (3) from an employee or otherwise receiving actual notice of such conviction.

(5) Imposing appropriate personnel action against such employee up to and including termination; or requiring such employee to satisfactorily participate in a drug abuse assistance or rehabilitation program approved for such purposes by a federal, state, or local health, law enforcement, or other appropriate agency.

(6) Making a good faith effort to continue to maintain a drug free work place through implementation of sections (1) through (5) stated above.

I UNDERSTAND THAT THE SUBMISSION OF THIS FORM TO THE CONTRACTING OFFICER FOR MANATEE COUNTY IS VALID THROUGH DECEMBER 31 OF THE CALENDAR YEAR IN WHICH IT IS FILED. I ALSO UNDERSTAND THAT ANY CONTRACT OR BUSINESS TRANSACTION SHALL PROVIDE FOR SUSPENSION OF PAYMENTS, OR TERMINATION, OR BOTH, IF THE CONTRACTING OFFICER OR THE COUNTY ADMINISTRATOR DETERMINES THAT:

- (1) Such person or entity has made false certification.
- (2) Such person or entity violates such certification by failing to carry out the requirements of sections (1), (2), (3), (4), (5), or (6) or Resolution R-01-36 Section 4, E (1) (a) or
- (3) Such a number of employees of such person or entity have been convicted of violations occurring in the work place as to indicate that such person or entity has failed to make a good faith effort to provide a drug free work place as required by Resolution R-01-36 Section 4, E (1) (a).

[Signature]

STATE OF FLORIDA
COUNTY OF _____

Sworn to and subscribed before me this _____ day of _____, 20____ by _____.

Personally known _____ OR Produced identification _____

Notary Public Signature My commission expires _____

[Print, type or stamp Commissioned name of Notary Public]

PUBLIC CONTRACTING AND ENVIRONMENTAL CRIMES CERTIFICATION

SWORN STATEMENT PURSUANT TO ARTICLE 5,
MANATEE COUNTY PURCHASING CODE

THIS FORM MUST BE SIGNED AND SWORN TO IN THE PRESENCE OF A NOTARY PUBLIC OR OTHER OFFICIAL AUTHORIZED TO ADMINISTER OATHS.

This sworn statement is submitted to the Manatee County Board of County Commissioners by _____
 [print individual's name and title]

_____ for _____
 [print name of entity submitting sworn statement]

whose business address is: _____

and (if applicable) its Federal Employer Identification Number (FEIN) is _____. If the entity has no

FEIN, include the Social Security Number of the individual signing this sworn statement: _____

I understand that no person or entity shall be awarded or receive a county contract for public improvements, procurement of goods or services (including professional services) or a county lease, franchise, concession or management agreement, or shall receive a grant of county monies unless such person or entity has submitted a written certification to the County that it has not:

- (1) been convicted of bribery or attempting to bribe a public officer or employee of Manatee County, the State of Florida, or any other public entity, including, but not limited to the Government of the United States, any state, or any local government authority in the United States, in that officer's or employee's official capacity; or
- (2) been convicted of an agreement or collusion among bidders or prospective bidders in restraint of freedom of competition, by agreement to bid a fixed price, or otherwise; or
- (3) been convicted of a violation of an environmental law that, in the sole opinion of the County's Purchasing Director, reflects negatively upon the ability of the person or entity to conduct business in a responsible manner; or
- (4) made an admission of guilt of such conduct described in items (1), (2) or (3) above, which is a matter of record, but has not been prosecuted for such conduct, or has made an admission of guilt of such conduct, which is a matter of record, pursuant to formal prosecution. An admission of guilt shall be construed to include a plea of nolo contendere; or
- (5) where an officer, official, agent or employee of a business entity has been convicted of or has admitted guilt to any of the crimes set forth above on behalf of such and entity and pursuant to the direction or authorization of an official thereof (including the person committing the offense, if he is an official of the business entity), the business shall be chargeable with the conduct herein above set forth. A business entity shall be chargeable with the conduct of an affiliated entity, whether wholly owned, partially owned, or one which has common ownership or a common Board of Directors. For purposes of this Form, business entities are affiliated if, directly or indirectly, one business entity controls or has the power to control another business entity, or if an individual or group of individuals controls or has the power to control both entities. Indicia of control shall include, without limitation, interlocking management or ownership, identity of interests among family members, shared organization of a business entity following the ineligibility of a business entity under this Article, or using substantially the same management, ownership or principles as the ineligible entity.

Any person or entity who claims that this Article is inapplicable to him/her/it because a conviction or judgement has been reversed by a court of competent jurisdiction, shall prove the same with documentation satisfactory to the County's Purchasing Director. Upon presentation of such satisfactory proof, the person or entity shall be allowed to contract with the County.

I UNDERSTAND THAT THE SUBMISSION OF THIS FORM TO THE CONTRACTING OFFICER FOR MANATEE COUNTY IS VALID THROUGH DECEMBER 31 OF THE CALENDAR YEAR IN WHICH IT IS FILED. I ALSO UNDERSTAND THAT ANY CONTRACT OR BUSINESS TRANSACTION SHALL PROVIDE FOR SUSPENSION OF PAYMENTS, OR

TERMINATION, OR BOTH, IF THE CONTRACTING OFFICER OR THE COUNTY ADMINISTRATOR DETERMINES THAT SUCH PERSON OR ENTITY HAS MADE FALSE CERTIFICATION.

[Signature]

STATE OF FLORIDA
COUNTY OF _____

Sworn to and subscribed before me this _____ day of _____, 20____ by _____.

Personally known _____ OR Produced identification _____
[Type of identification]

Notary Public Signature My commission expires _____

[Print, type or stamp Commissioned name of Notary Public]

Signatory Requirement - In the case of a business entity other than a partnership or a corporation, this affidavit shall be executed by an authorized agent of the entity. In the case of a partnership, this affidavit shall be executed by the general partner(s). In the case of a corporation, this affidavit shall be executed by the corporate president.

SECTION 00500
FORM OF AGREEMENT
BETWEEN THE
COUNTY OF MANATEE, FLORIDA
AND THE CONTRACTOR AS IDENTIFIED BELOW
ON THE BASIS OF A STIPULATED UNIT COST CONTRACT PRICE

THIS AGREEMENT is made and entered into by and between the COUNTY OF MANATEE, a political subdivision of the state of Florida, hereinafter referred to as the "OWNER" and _____, hereinafter referred to as the "CONTRACTOR," duly authorized to transact business in the state of Florida, with offices located at _____.

Article 1. WORK

CONTRACTOR shall furnish all labor, materials, supplies, and other items required to complete the Work for IFB No. **IFB#09-0490-Satellite Lift Station Rehabilitation Priority 1, Bradenton, FL** in strict accordance with Contract Documents and any duly authorized subsequent addenda thereto, all of which are made a part hereof.

Article 2. ENGINEER

The County of Manatee, Project Management Department, is responsible as the OWNER and _____ hereinafter referred to as "ENGINEER," designed this project and is responsible for technical/engineering reviews and decisions. The ENGINEER is a member of the OWNER'S project management team which is collectively responsible in ensuring the Work is completed in accordance with the Contract Documents. All communications involving this project will be addressed to:

County of Manatee
 Public Works Department,
 Project Management Division
 Attn: Salvatore Bordonaro, Project Manager
 IFB 09-0490-OV
 Satellite Lift Stations
 Rehabilitation – Priority 1
 1022 26th Avenue East
 Bradenton, FL 34208
 Phone: (941)708-7450 Ext. 7341

County of Manatee
 Public Works Department
 Infrastructure Engineering Division
 4422-B 66th Street West
 Bradenton, FL 34210
 Phone: (941)792-8811

Where the terms ENGINEER and/or OWNER are used in the Contract Documents, it shall mean the OWNER'S project management team.

Article 3. CONTRACTOR'S REPRESENTATIONS

In order to induce OWNER to enter into this Agreement, CONTRACTOR makes the following representations:

- 3.1 CONTRACTOR has familiarized itself with the nature and extent of the Bid Documents, Work, site, locality and all local conditions and laws and regulations that in any manner may affect cost, progress, performance or furnishing of the Work.
- 3.2 CONTRACTOR has studied carefully all drawings of the physical conditions upon which CONTRACTOR is entitled to rely.
- 3.3 CONTRACTOR has obtained and carefully studied (or assumes responsibility for obtaining and carefully studying) all such examinations, investigations, explorations, tests, reports and studies which pertain to the physical conditions at or contiguous to the site or which otherwise may affect the cost, progress, performance or furnishing of the Work as CONTRACTOR considers necessary for the performance or furnishing of the Work at the Contract Price, within the Contract Time and in accordance with the other terms and conditions of the Bid Documents; and no additional examinations, investigations, explorations, tests, reports, studies or similar information or data are or will be required by CONTRACTOR for such purposes.
- 3.4 CONTRACTOR has reviewed and checked all information and data shown or indicated on the Bid Documents with respect to existing underground facilities at or contiguous to the site and assumes responsibility for the accurate location of said underground facilities. Any additional examinations, investigations, explorations, tests, reports, studies or similar information or data in respect of said underground facilities conducted by the CONTRACTOR will be done at the CONTRACTOR'S expense.
- 3.5 CONTRACTOR has correlated the results of all such observations, examinations, investigations, explorations, tests, reports and studies with the terms and conditions of the Bid.
- 3.6 CONTRACTOR has given OWNER written notice of all conflicts, errors or discrepancies that have been discovered in the Bid Documents and the written resolution thereof by OWNER is acceptable to CONTRACTOR.

- 3.7 CONTRACTOR shall schedule and perform the Work subject to OWNER'S approval and shall hold OWNER harmless from all liabilities incurred due to CONTRACTOR'S failure to coordinate with the OWNER.

Article 4. CONTRACT DOCUMENTS

The Contract Documents which comprise the entire Agreement between OWNER and CONTRACTOR concerning the Work consist of the following:

- 4.1 This Agreement and Bid Document IFB#09-0490-OV
- 4.2 Performance and/or other Bonds and Insurance Certificate(s)
- 4.3 Drawings (not attached)
- 4.4 Addenda numbers ___ to ___, inclusive.
- 4.5 CONTRACTOR'S Bid Form and any other information submitted by Contractor prior to Notice of Award.
- 4.6 The following which may be delivered or issued after the effective date of the Agreement and are not attached hereto: all written Change Orders and other documents amending, modifying, or supplementing the Contract Documents.
- 4.7 The documents listed in paragraphs above are attached to this Agreement (except as noted otherwise above). There are no Contract Documents other than those listed above in this Article 4.

Article 5. MISCELLANEOUS

- 5.1 Terms used in this Agreement are defined in Article 1 of the General Conditions.
- 5.2 No assignment by a party hereto of any rights under or interest in the Contract Documents will be binding on another party hereto without the written consent of the party sought to be bound; and specifically but without limitation, monies that may become due and monies that are due may not be assigned without such consent (except to the extent that the effect of this restriction may be limited by law); and unless specifically stated to the contrary in any written consent to an assignment, no assignment will release or discharge the assignee from any duty or responsibility under the Contract Documents.
- 5.3 OWNER and CONTRACTOR each binds itself, its partners, successors, assigns and legal representatives to the other party hereto, its partners, successors, assigns and legal representatives in respect of all covenants, agreements and obligations contained in the Contract Documents.

The OWNER will pay, and the CONTRACTOR will accept in full consideration for the performance of the Work (IFB No. #09-0490-OV Satellite Lift Stations Rehabilitation Priority 1,) subject to additions and deductions as provided therein, the sum of _____ Dollars and _____ Cents (\$ _____) for Bid " _____ " based on Completion Time of _____ calendar days and the sum of \$1,423.00 as liquidated damages for each calendar day of delay.

CONTRACTOR

BY: _____
Signature

Type Name and Title of Signer

The foregoing instrument was acknowledged before me this _____ day of _____, 2009, by _____, who is personally known to me or who has produced _____ as identification.

(impress official seal)

Notary Public, State of Florida
My commission expires: _____

APPROVED, with a quorum present and voting this _____ day of _____, 2009.

ATTEST: R.B. SHORE
Clerk of the Circuit Court

COUNTY OF MANATEE, FLORIDA by its
Board of County Commissioners

BY: _____
CHAIRMAN

APPLICATION FOR PAYMENT

Project: _____
 From: _____ To: _____

Request No. _____ Project No. _____
 Purchase Order Number: _____
 County Bid No.: _____
 Consultant: _____

CONTRACT PAYMENT SUMMARY

Original contract amount:				\$
Change order(s):				
Change order summary:				
Number	Date Approved	Additive	Deductive	
	SAMPLE SHEET ONLY OBTAIN CURRENT VERSION OF FORM FROM PROJECT MANAGER			
SUBTOTALS:				
Net change order subtotal (Additive less Deductive):				\$
Current Contract Amount (CCA): (Original Amount + Change Order(s))				\$
	Previous Status	Current Status		
Value of the Work in Place	\$	\$		
Value of Stored Materials	\$	\$		
Total Earned (\$ and % of CCA)	\$	\$	%	
Retainage (\$ and % of CCA)	\$	\$	%	
Net Earned (Total earned minus retainage)				\$
TOTAL PREVIOUS PAYMENTS				\$
AMOUNT DUE THIS PAYMENT (Net Earned minus Previous Payments)				\$

CONTRACTOR'S AFFIDAVIT OF NOTICE

CERTIFICATE: The undersigned CONTRACTOR certifies that all items and amounts shown on this application for payment are on account of work performed, materials supplied and/or materials stored on site and paid for by Contractor in accordance with the Contract Documents with due consideration for previous Payment(s), if any, received by the Contractor from the County, and that the current payment shown is now due.

NOTARY: State of Florida County of _____

CONTRACTOR: Signature: _____
 Name of person authorized to sign Affidavit of Notice _____

Sworn to (or affirmed) and subscribed before me this _____ day of _____, _____, by _____
 TITLE _____

(Name of person giving notice) Contractor name, address and telephone No.: _____

(Signature of Notary Public - State of Florida)
 Print, Type or Stamp Commissioned Name of Notary Public: _____

Personally Known _____ or Produced Identification _____
 Type of Identification Produced: _____

VERIFICATION, RECOMMENDATION, CONCURRENCES AND APPROVALS

(Signatures) (Date)

Quantities verified by: _____

Consultant / Engineer: _____

Project Manager: _____

Department Head: _____

Payment Approved by the Board of County Commissioners: _____

Attested to by the Clerk of Circuit Court: _____

PAY APPLICATION SCHEDULE (CONTINUATION SHEET)

PAGE ___ OF ___ PAGES.

KEY: COLS. A THROUGH F ARE FROM ORIGINAL BID COL. G IS THE CHANGE ORDER NUMBER W.I.P. = WORK-IN-PLACE COL. "Q" = 100 x P / (F + J).....MAY NOT EXCEED 100%
 DESCRIPTION OF WORK UNIT PRICE UNIT CHANGE ORDERS +/- VAL. QTY +/- # VALUE F G H I J K L M N O P Q

ITEM NO.	DESCRIPTION OF WORK	UNIT PRICE	UNIT	CHANGE ORDERS		+/- VAL.	QTY	#	VALUE	F	G	H	I	J	K	PREVIOUS W.I.P.		CURRENT W.I.P.		TOTAL W.I.P.		
																QTY	VALUE	QTY	VALUE	QTY	VALUE	
A																						
	SAMPLE SHEET ONLY OBTAIN CURRENT VERSION OF FORM FROM PROJECT MANAGER																					
TOTALS																						

ATTACH STORED-MATERIAL SCHEDULE

CONTRACT CHANGE ORDER		Change Order No.:	
		Contract Amount: (Present Value)	
		Project Number:	
PROJECT:			
NO. OF ITEM	DESCRIPTION OF ITEM AND CHANGE	DECREASE	INCREASE
	SAMPLE SHEET ONLY OBTAIN CURRENT VERSION OF FORM FROM PROJECT MANAGER		
		TOTAL DECREASE:	TOTAL INCREASE:
Contractor: Address: City / State: Contractor Signature: _____		THE NET CHANG ADJUSTS THE CURRENT CONTRACT AMOUNT FROM TO	
		_____ CALENDAR DAYS ARE ADDED TO THE SCHEDULE WHICH CHANGES FINAL COMPLETION TO _____	
RECOMMENDATION, CONCURRENCES AND APPROVALS			
		SIGNATURES	DATE
Consultant (as applicable): _____		_____	_____
Project Engineer: _____		_____	_____
Project Manager: _____		_____	_____
Department Head: _____		_____	_____
Approved by the Manatee County Board of County Commissioners: _____ <div style="text-align: center;">Chairman</div>		_____	_____
Clerk of the Circuit Court: _____		_____	_____

CONTRACT CHANGE ORDER		Change Order No:	
Page 2 (Continuation)		Project Number:	
NO. OF ITEM	DESCRIPTION OF ITEM AND CHANGE	DECREASE	INCREASE
	SAMPLE SHEET ONLY OBTAIN CURRENT VERSION OF FORM FROM PROJECT MANAGER		
		DECREASE SUBTOTAL:	INCREASE SUBTOTAL:

CONTRACT CHANGE ORDER

Page 3 (Continuation)

Change Order No:

Project Number:

NO. OF ITEM	DESCRIPTION OF ITEM AND CHANGE	DECREASE	INCREASE
	<p>SAMPLE SHEET ONLY OBTAIN CURRENT VERSION OF FORM FROM PROJECT MANAGER</p>		
		DECREASE SUBTOTAL:	INCREASE SUBTOTAL:

JUSTIFICATION FOR CHANGE

Change Order No :

Project Number:

1. NECESSITY FOR CHANGE:

SAMPLE SHEET ONLY
OBTAIN CURRENT VERSION OF FORM
FROM PROJECT MANAGER

- 2. Is change an alternate bid? (yes / no)
- 3. Does change substantially alter the physical size of the project? (yes / no)
(If yes, explain)
- 4. Effect of this change on other "Prime" contractors?
- 5. Has the Surety and insurance company been notified, if applicable?

DISCRETIONARY WORK - FIELD DIRECTIVE PROJECT:	FIELD DIRECTIVE NO:
	PROJECT NO.:

ITEM	DESCRIPTION OF ITEM AND CHANGE	DECREASE
	<p>SAMPLE SHEET ONLY OBTAIN CURRENT VERSION OF FORM FROM PROJECT MANAGER</p>	

	DECREASE
--	-----------------

CONTRACTOR: _____ ADDRESS: _____ CITY/STATE: _____	THE DISCRETIONARY WORK AMOUNT IS DECREASED \$ _____ FROM \$ _____ TO \$ _____ WITH NO CHANGE TO THE TOTAL CONTRACT AMOUNT.
CONTRACTOR SIGNATURE: _____	TIME CAN ONLY BE ADDED BY CHANGE ORDER

RECOMMENDATION, CONCURRENCES AND APPROVALS

	SIGNATURES	DATE
CONSULTANT:	_____	_____
PROJECT ENGINEER:	_____	_____
PROJECT MANAGER:	_____	_____
SENIOR PROJECT MANAGER:	_____	_____

CERTIFICATE OF SUBSTANTIAL COMPLETION (S.C.)	CHECK ONE:	
	Partial:	Total:
Project Title:	Date Submitted:	
Contractor Data: Name: Address: City/State/zip:	Project No.:	
	S.C. Date (Proposed)	
<p>If the "Partial" completion box above is checked, the following description applies to the work for which substantial completion is being sought. Otherwise, the work described in the Contract including approved changes, if any, is certified to be substantially complete: (Description of the portion of work substantially completed):</p> <p style="text-align: center;">SAMPLE SHEET ONLY OBTAIN CURRENT VERSION OF FORM FROM PROJECT MANAGER</p> <p style="text-align: center;">(USE CONTINUATION SHEETS IF NECESSARY)</p>		
<p>A tentative list of items to be completed or corrected is attached hereto. This list may not be all-inclusive, and the failure to include an item does not alter the Contractor's responsibility to complete all of the contract work in accordance with the Contract Documents. The items in the tentative list shall be completed or corrected by the Contractor within _____ days of substantial completion. The approved substantial completion date is: _____.</p>		
_____ Contractor Signature / Date		_____ Engineer's Approval / Date
_____ Printed Name and Title		_____ Printed Name and Title
<p>The Contractor shall be responsible for security, operation, safety, maintenance, HVAC, insurance and warranties in accordance with the Contract. The County will assume the responsibility for paying the cost of electrical power from midnight of the date of Engineer's approval as indicated above.</p> <p>ATTACH THE INSPECTOR'S FINAL WALKTHROUGH LIST OF DEFICIENCIES.</p>		

**FINAL RECONCILIATION, WARRANTY PERIOD DECLARATION
AND CONTRACTOR'S AFFIDAVIT**

Project Title:	Date Submitted:
Contractor Data:	Project No.:
Name: SAMPLE SHEET ONLY	Warranty (months):
Address: OBTAIN CURRENT VERSION OF FORM	
City/State/zip: FROM PROJECT MANAGER	

This Final Reconciliation is for the work performed for Manatee County by the above named Contractor, hereinafter called CONTRACTOR, pursuant to a contract dated _____, as amended, and acts as an addendum thereto.

It is agreed that all quantities and prices in the attached Final Pay Estimate No. _____ are correct, that the amount of \$ _____, including retainage, is due to the CONTRACTOR, that no claims are outstanding as between the parties, and that the above stated sum represents the entirety of monies owed the CONTRACTOR.

It is further agreed that the warranty period for CONTRACTOR'S work pursuant to the Contract is from _____ to _____.

As (title) _____ for CONTRACTOR, I have authority to bind said CONTRACTOR, and as such make this final reconciliation, declaration and affidavit for the purpose of inducing Manatee County to make final payment to CONTRACTOR for work done at / upon _____ under said contract:

CONTRACTOR has paid all social security and withholding taxes accrued in connection with this construction project.

CONTRACTOR has paid all workers' compensation and other insurance premiums incurred in connection with this construction project.

CONTRACTOR has paid for all required permits in connection with this construction project.

All laborers, materialmen, suppliers, subcontractors and service professionals who worked for and/or supplied materials, equipment and/or services to the CONTRACTOR under this construction contract have been paid in full.

(Affiant Signature)

NOTARY:

State of Florida County of _____, Sworn to (or affirmed) and subscribed before me this ____ day of _____, _____, by _____ (person giving notice).

Signature of Notary Public - State of Florida: _____

Print, Type or Stamp Commissioned Name of Notary Public:

Personally known ____ or produced identification ____

Type of Identification Produced:

SECTION 00700
GENERAL CONDITIONS

ARTICLE I - DEFINITIONS

Whenever used in the Bid Documents, the following terms have the meaning indicated which are applicable to both the singular and plural thereof:

Addendum - Written or graphic instruments issued prior to the opening of bids which clarify or change the bidding documents or the contract documents.

Agreement - The written Agreement between Owner and Contractor covering the Work to be performed; other contract documents are attached to the Agreement and made a part thereof as provided therein.

Written Amendment - A written amendment of the contract documents, signed by Owner and Contractor on or after the effective date of the Agreement and normally dealing with the non-engineering or non-technical rather than strictly work related aspects of the contract documents.

Application for Payment - The form accepted by Project Representative which is to be used by Contractor in requesting progress or final payments and which is to include such supporting documentation as is required by the contract documents.

Award - Acceptance of the bid from the person, firm, or corporation which in the Owner's sole and absolute judgment will under all circumstances best serve the public interest. Award shall be made by a majority vote of a quorum of Manatee County Board of County Commissioners in open session; or by the Purchasing Director in accordance with Ordinance 08-43, Manatee County Purchasing Ordinance.

Bid - The offer of the bidder submitted on the prescribed form setting forth the prices for the Work to be performed.

Bidder - One who submits a bid directly to the Owner, as distinct from a sub-bidder, who submits a bid to a Bidder.

Bidding Documents - Consists of the Invitation For Bid, which includes but is not limited to: the bid form, drawings, Contract Documents, terms and conditions, and the proposed contract documents (including all Addenda issued prior to receipt of bids); and becomes a part of the Agreement.

Bonds - Performance and payment bonds and other instruments of security.

Change Order - A document recommended by Project Representative which is signed by Contractor and Owner and authorizes an addition, deletion, or revision in the Work, or an adjustment in the contract price or the contract time, issued on or after the effective date of the Agreement.

Compensable Delay - Any delay beyond the control and without the fault or negligence of the Contractor resulting from Owner-caused changes in the Work, differing site conditions, suspensions of the Work, or termination for convenience by Owner.

Contract Documents - The Agreement, Addenda (which pertain to the contract documents), Contractor's bid (including documentation accompanying the bid and any post-bid documentation submitted prior to the Notice of Award), the bonds, the specifications and the drawings, together with all amendments, modifications and supplements issued on or after the effective date of the Agreement.

Contract Price - The monies payable by Owner to Contractor under the contract documents as stated in the Agreement.

Contract Time - The number of days or the date stated in the Notice to Proceed for the completion of the Work.

Contractor - The person, firm or corporation with whom Owner has entered into an Agreement.

Days - All references to days are to be considered calendar days except as specified differently.

Defective - An adjective which when modifying the work refers to work that is unsatisfactory, faulty or deficient, or does not conform to the contract documents, or does not meet the requirements of any inspection, reference standard, test or approval referred to in the contract documents, or has been damaged prior to Project Representative's recommendation of final payment (unless responsibility for the protection thereof has been assumed by Owner).

Discretionary - Payment for all work that shall be made only at the Owner's discretion in order to satisfactorily complete the project in accordance with the Plans and Specifications.

Drawings - The drawings which show the character and scope of the Work to be performed and which have been prepared or approved by Engineer and are referred to in the bidding and contract documents.

Effective Date of the Agreement - The date indicated in the Agreement on which it becomes effective (date of execution).

Excusable Delay - Any delay beyond the control and without the negligence of the Contractor, the Owner, or any other contractor caused by events or circumstances such as, but not limited to, acts of God or of the public enemy, fires, floods, freight embargoes, acts of government other than Owner, or epidemics. Labor disputes and above average rainfall shall give rise only to excusable delays.

Float or Slack Time - The time available in the progress schedule during which an unexpected activity can be completed without delaying substantial completion of the Work.

Field Order - A written order issued by Project Representative which orders minor changes in the Work, but which does not involve a change in the contract price or the contract time.

Inexcusable Delay - Any delay caused by events or circumstances within the control of the Contractor, such as inadequate crewing, slow submittals, etc., which might have been avoided by the exercise of care, prudence, foresight, or diligence on the part of the Contractor.

Non-prejudicial Delay - Any delay impacting a portion of the Work within the available total float or slack time and not necessarily preventing completion of the Work within the contract time.

Notice of Award - The written notice to the successful bidder stating Award has been approved by the Board of County Commissioners; or by the Purchasing Director in accordance with Ordinance 08-43, Manatee County Purchasing Code.

Notice of Intent to Award - The written notice to the apparent low bidder stating Award has been recommended with final Award to be authorized by the Board of County Commissioners.

Notice to Proceed - Written notice by Owner (after execution of contract) to Contractor fixing the date on which the contract time will commence to run and on which Contractor shall start to perform (ten (10) days from date of such notice) Contractor's obligations under the contract documents.

Owner - Manatee County, Florida, Board of County Commissioners.

Preconstruction Conference - Prior to starting the Work, a meeting scheduled by Owner with Contractor to review the Work schedules, to establish procedures for handling shop drawings and other submissions, for processing periodical pay estimates, and such other matters as may be pertinent to the project.

Prejudicial Delay - Any excusable or compensable delay impacting the Work and exceeding the total float available in the progress schedule, thus preventing completion of the Work within the contract time unless the Work is accelerated.

Pre-operation Testing - All field inspections, installation checks, water tests, performance tests and necessary corrections required of Contractor to demonstrate that individual components of the work have been properly constructed and do operate in accordance with the contract documents for their intended purposes.

Project - The total construction of which the Work to be provided under the contract documents may be the whole or a part as indicated elsewhere in the contract documents.

Project Representative - The authorized representative of Owner who is assigned to the project or any part thereof.

Shop Drawings - All drawings, diagrams, illustrations, schedules and other data which are specifically prepared by or for Contractor to illustrate some portion of the Work and all illustrations, brochures, standard schedules, performance charts, instructions, diagrams and other information prepared by a supplier and submitted by Contractor to illustrate material or equipment for some portion of the Work.

Specifications - Those portions of the contract documents consisting of written technical descriptions of materials, equipment, construction systems, standards and workmanship as applied to the Work and certain administrative details applicable thereto.

Subcontractor - An individual or corporation having a direct contact with Contractor or with any other subcontractor for the performance of a part of the Work at the site. Such person or firm has contractual relations with the Contractor, not with the Owner.

Substantial Completion - The Work (or a specified part thereof) has progressed to the point when, in the opinion of the Engineer as evidenced by Engineer's definitive certificate of Substantial Completion, it is sufficiently complete in accordance with contract documents so that the work can be utilized for the purposes for which it is intended; or if there be no such certificate issued, when final payment is due.

Successful Bidder - The lowest qualified, responsible and responsive bidder to whom an award is made.

Supplier - A manufacturer, fabricator, supplier, distributor, materialman or vendor.

Underground Facilities - All pipelines, conduits, ducts, cables, wires, manholes, vaults, tanks, tunnels or other such facilities or attachments and any encasement containing such facilities which have been installed underground to furnish any of the following services or materials: electricity, gases, steam, liquid petroleum products, telephone or other communications, cable television, sewage and drainage removal, traffic or other control systems or water.

Unit Price Work - Work to be paid for on the basis of unit prices.

Work - The entire completed construction or the various separately identifiable parts thereof required to be furnished under the contract documents. Work is the result of performing services, furnishing labor and furnishing and incorporating materials and equipment into the construction, all as required by the contract documents.

Work Directive Change - A written directive to contractor, issued on or after the effective date of the Agreement and signed by Owner and recommended by Project Representative ordering an addition, deletion or revision in the Work, or responding to differing or unforeseen physical conditions under which the Work is to be performed or to emergencies. A work directive change may not change the contract price or the contract time; but is evidence that the parties expect that the change directed or documented by a work directive change will be incorporated in a subsequently issued change order following negotiations by the parties as to its effect, if any, on the contract price or contract time.

ARTICLE 2 - PRELIMINARY MATTERS

Computation of Time: When time is referred to in the contract documents by days, it will be computed to exclude the first and include the last day of such period. If the last day of any such period falls on a Saturday or Sunday or legal holiday, such day will be omitted from the computation.

- 2.1 The Contractor must submit a proposed schedule of the Work at the preconstruction conference. The purpose of this schedule is to enable the Owner to govern the Work, to protect the functions of the local government and its citizens and to aid in providing appropriate surveillance. The Owner shall have the right to reschedule work provided such rescheduling is in accord with the remainder of terms of the contract. The schedule shall show, as a minimum, the approximate dates on which each segment of the work is expected to be started and finished, the proposed traffic flows during each month, the anticipated earnings by the Contractor for each month and the approximate number of crews and equipment to be used. The Owner, after necessary rescheduling and obtaining additional information for specific purposes, shall review and approve the schedule. The Contractor shall also forward to the Owner, as soon as practicable after the first day of each month, a summary report of the progress of the various parts of the work under the contract, in fabrication and in the field, stating the existing status, estimated time of completion and cause of delay, if any. Together with the summary report, the Contractor shall submit any necessary revisions to the original schedule for the Owner's review and approval. In addition, more detailed schedules may be required by the Owner for daily traffic control.

- 2.2 A Notice to Proceed may be given at any time within thirty (30) days after the effective date of the Agreement. The contract time will commence at the time specified in such notice. Contractor shall start to perform the Work on the date specified in the notice to proceed, but no work shall be done at the site prior to the date on which the contract time commences to run.
- 2.3 If at any time the materials and appliances to be used appear to the Owner as insufficient or improper for securing the quality of work required or the required rate of progress, the Owner may order the Contractor to increase his efficiency or to improve the character of his work and the Contractor shall conform to such an order. The failure of the Owner to demand any increase of such efficiency or any improvement shall not release the Contractor from his obligation to secure the quality of work or the rate of progress necessary to complete the Work within the limits imposed by the contract. The Owner may require the Contractor to remove from the Work such employees as the Owner deems incompetent, careless, insubordinate or otherwise objectionable, or whose continued employment on the Work is deemed to be contrary to the Owner's interest.
- 2.4 The Owner reserves the right to let other Contracts in connection with this Work. The Contractor shall afford other Contractors reasonable opportunity for the introduction and storage of their materials and execution of their Work, and promptly connect and coordinate the Work with theirs.

ARTICLE 3 - CONTRACT DOCUMENTS: INTENT, AMENDING, RE-USE

- 3.1 The contract documents comprise the entire Agreement between Owner and Contractor concerning the work. The contract documents are complementary; what is called for by one is as binding as if called for by all. The contract documents will be construed in accordance with the laws and ordinances of the State of Florida and the County of Manatee.

Should a conflict exist within the contract documents, the precedence in ascending order of authority is as follows: 1) Standard Printed Contract Documents, 2) Special Conditions, 3) General Conditions and 4) Drawings. Note: Computed dimensions shall govern over scaled dimensions.

- 3.2 It is the intent of the contract documents to describe a functionally complete project (or part thereof) to be constructed in accordance with the contract documents. Any work, materials or equipment that may reasonably be inferred from the contract documents as being required to produce the intended result will be supplied whether or not specifically called for. When words which have a well-known technical or trade meaning are used to describe work, materials, or equipment, such words shall be interpreted in accordance with that meaning. Reference to standard specifications, manuals or codes of any technical society, organization or association, or to the laws or regulations of any governmental authority, whether such reference be specific or by implication, shall mean the latest standard specification, manual, code or laws or regulations in effect at the time of opening of bids, except as may be otherwise specifically stated. However, no provision of any referenced standard specification, manual or code (whether or not specifically incorporated by reference in the contract documents) shall be effective to change the duties and responsibilities of Owner, Contractor or Engineer, or any of their agents or employees from those set forth in the Contract Documents.

- 3.3 The contract documents may be amended to provide for additions, deletions and revisions in the Work or to modify the terms and conditions thereof in one or more of the following ways:
- 3.3.1 A Formal Written Amendment
 - 3.3.2 A Change Order
 - 3.3.3 A Work Directive Change
 - 3.3.4 Administrative Contract Adjustment (ACA)
- 3.4 In addition, the requirements of the contract documents may be supplemented and minor variations and deviations in the Work may be authorized in one or more of the following ways:
- 3.4.1 A Field Order
 - 3.4.2 Engineer's approval of a Shop Drawing or sample.

ARTICLE 4 - CONTRACTOR'S RESPONSIBILITIES

- 4.1 Contractor shall keep on the Work at all times during its progress a competent resident superintendent; who shall be the Contractor's representative at the site and shall have authority to act on behalf of Contractor. All communications given to the superintendent shall be as binding as if given to Contractor.
- 4.2 Contractor shall provide competent, suitable qualified personnel to survey and lay out the Work and perform construction as required by the contract documents. Contractor shall at all times maintain good discipline and order at the site. Except in connection with the safety or protection of persons or the Work or property at the site or adjacent thereto and except as otherwise indicated in the contract documents, all Work at the site shall be performed during regular working hours and Contractor will not permit overtime work or the performance of work on Saturday, Sunday or legal holiday without Owner's written consent given after prior notice to Engineer (at least 72 hours in advance).
- 4.2.1 Contractor shall pay for all additional engineering charges to the Owner for any overtime work which may be authorized. Such additional engineering charges shall be a subsidiary obligation of Contractor and no extra payment shall be made by Owner on account of such overtime work. At Owner's option, overtime costs may be deducted from Contractor's monthly payment request or Contractor's retainage prior to release of final payment.
- 4.3 Unless otherwise specified, Contractor shall furnish and assume full responsibility for all bonds, insurance, materials, equipment, labor, transportation, construction equipment and machinery, tools, appliances, fuel, power, light, heat, telephone, water, sanitary facilities, temporary facilities and all other facilities and incidentals necessary for the furnishing, performance, testing, start-up and completion of the Work.
- 4.4 All materials and equipment shall be of good quality and new, except as otherwise provided in the contract documents. If required by Engineer, Contractor shall furnish satisfactory evidence

(including reports of required tests) as to the kind and quality of materials and equipment. All materials and equipment shall be applied, installed, connected, erected, used, cleaned and conditioned in accordance with the instruction of the applicable supplier except as otherwise provided in the contract documents.

- 4.5 Contractor shall be fully responsible to Owner for all acts and omissions of the subcontractors, suppliers and other persons and organizations performing or furnishing any of the Work under a direct or indirect contract with Contractor just as Contractor is responsible for Contractor's own acts and omissions. Nothing in the Contract Documents shall create any contractual relationship between Owner or Engineer and any such subcontractor, supplier or other person or organization, nor shall it create any obligation on the part of Owner to pay or to see to the payment of any monies due any such subcontractor, supplier or other person or organization.
- 4.6 Permits: Unless otherwise provided, Contractor shall obtain and pay for all construction permits and licenses. Owner shall assist Contractor, when necessary, in obtaining such permits and licenses. Contractor shall pay all governmental charges and inspection fees necessary for the prosecution of the Work.
- 4.7 During the progress of the Work, Contractor shall keep the premises free from accumulation of waste materials rubbish and other debris resulting from the Work. At the completion of the Work, Contractor shall remove all waste materials, rubbish and debris from and about the premises as well as all tools, appliances, construction equipment and machinery and surplus materials and shall leave the site clean and ready for occupancy by Owner. Contractor shall restore to original conditions all property not designated for alteration by the Contract Documents.
- 4.8 Contractor shall not load nor permit any part of any structure to be loaded in any manner that will endanger the structure, nor shall Contractor subject any part of the Work or adjacent property to stresses or pressures that will endanger it.
- 4.9 Safety and Protection: Contractor shall comply with the Florida Department of Commerce Safety Regulations and any local safety regulations. Contractor shall be responsible for initiating, maintaining and supervising all safety precautions and programs in connection with the Work. Contractor shall take all necessary precautions for the safety of and shall provide the necessary protection to prevent damage, injury or loss to:
- 4.9.1 all employees on the work and other persons and organizations who may be affected thereby;
 - 4.9.2 all the work and materials and equipment to be incorporated therein, whether in storage on or off the site; and
 - 4.9.3 other property at the site or adjacent thereto, including trees, shrubs, lawns, walks, pavements, roadways, structures, utilities and underground facilities not designated for removal, relocation or replacement in the course of construction.

Contractor shall comply with all applicable laws and regulations of any public body having jurisdiction for the safety of persons or property or to protect them from damage, injury or loss; and shall erect and maintain all necessary safeguards for such safety and protection. Contractor shall provide and maintain all passageways, guard fences, lights and other facilities for the protection required by public authority or local conditions. Contractor shall provide reasonable

maintenance of traffic way for the public and preservation of the Owner's business, taking into full consideration all local conditions. Contractor's duties and responsibilities for the safety and protection of the work shall continue until such time as all the work is completed.

- 4.10 Emergencies: In emergencies affecting the safety or protection of persons or the work or property at the site or adjacent thereto, Contractor, without special instruction or authorization from Engineer or Owner, is obligated to act to prevent threatened damage, injury or loss. Contractor shall give Owner prompt written notice if Contractor believes that any significant changes in the work or variations from the contract documents have been caused thereby. If Owner determines that a change in the contract documents is required because of the action taken in response to an emergency, a Work Directive Change or Change Order will be issued to document the consequences of the changes or variation.
- 4.11 For substitutes not included with the bid, but submitted after the effective date of the Agreement, Contractor shall make written application to Engineer for acceptance thereof, certifying that the proposed substitute will perform adequately the functions and achieve the results called for by the general design, be similar and of equal substance to that specified and be suited to the same use as that specified. The application will also contain an itemized estimate of all costs and delays or schedule impacts that will result directly or indirectly from review, acceptance and provisions of such substitute, including costs of redesign and claims of other contractors affected by the resulting change, all of which will be considered by the Engineer in evaluating the proposed substitute. Engineer may require Contractor to furnish at Contractor's expense, additional data about the proposed substitute. In rendering a decision, Owner/Engineer and Contractor shall have access to any available float time in the construction schedule. In the event that substitute materials or equipment not included as part of the bid, but proposed after the effective date of the agreement, are accepted and are less costly than the originally specified materials or equipment, then the net difference in cost shall be credited to the Owner and an appropriate change order executed.
- 4.11.1 If a specific means, method, technique, sequence of procedure of construction is indicated in or required by the contract documents, Contractor may furnish or utilize a substitute means, method, sequence, technique or procedure of construction acceptable to Engineer if Contractor submits sufficient information to allow Engineer to determine that the substitute proposed is equivalent to that indicated or required by the contract documents.
- 4.11.2 Engineer will be allowed a reasonable time within which to evaluate each proposed substitute. Engineer will be the sole judge of acceptability and no substitute will be ordered, installed or utilized without Engineer's prior written acceptance which will be evidenced by either a change order or an approved shop drawing. Owner may require Contractor to furnish at Contractor's expense a special performance guarantee or other surety with respect to any substitute.
- 4.11.3 Contractor shall reimburse Owner for the charges of Engineer and Engineer's Consultants for evaluating each proposed substitute submitted after the effective date of the Agreement and all costs resulting from any delays in the work while the substitute was undergoing review.

- 4.12 The Contractor shall furnish, free of charge, all labor, stakes, surveys, batter boards for structures, grade lines and other materials and supplies and shall set construction stakes and batter boards for establishing lines, position of structures, slopes and other controlling points necessary for the proper prosecution of the construction work. Where rights-of-way, easements, property lines or any other conditions which make the lay-out of the project or parts of the project critical are involved, the Contractor will employ a competent surveyor who is registered in the State of Florida for lay-out and staking. These stakes and marks shall constitute the field control by and in accord with which the Contractor shall govern and execute the work. The Contractor will be held responsible for the preservation of all stakes, marks and if for any reason any of the stakes or marks or batter boards become destroyed or disturbed, they will be immediately and accurately replaced by the Contractor.
- 4.13 The Contractor has, by careful examination, satisfied himself as to the nature and location of the work and all other matters which can in any way affect the work under this contract, including, but not limited to details pertaining to boring, as shown on the drawings, are not guaranteed to be more than a general indication of the materials likely to be found adjacent to holes bored at the site of the work, approximately at the locations indicated. The Contractor shall examine boring data, where available, and make his own interpretation of the subsoil investigations and other preliminary data, and shall base his bid on his own opinion of the conditions likely to be encountered. In no event shall an extension of time be considered for any conditions that existed at the time of bidding, nor shall the Contractor receive extra compensation for completion of the project as intended by the drawings and in keeping with the contract documents. No verbal agreement or conversation with any officer, agent or employee of the Owner, before or after the execution of this contract, shall affect or modify any of the terms or obligations herein contained.
- 4.14 If the Contractor, in the course of the work, finds that the drawings and/or Contract Documents cannot be followed, he shall immediately inform the Owner in writing, and the Owner shall promptly check the accuracy of the information. Any work done after such discovery, until any necessary changes are authorized, will be done at the Contractor's risk.

ARTICLE 5 - OWNER'S RESPONSIBILITIES

- 5.1 Owner shall furnish the data required of Owner under the contract documents promptly and shall make payments to the Contractor within a reasonable time (no more than 45 days) after the Work has been accepted by the County. The form of all submittals, notices, change orders and other documents permitted or required to be used or transmitted under the contract documents shall be determined by the Owner/Engineer. Standard County forms shall be utilized.
- 5.2 The Owner shall provide the lands upon which the Work under this contract is to be done, except that the Contractor shall provide all necessary additional land required for the erection of temporary construction facilities and storage of his materials, together with right of access to same.
- 5.3 The Owner shall have the right to take possession of and use any completed portions of the work, although the time for completing the entire work or such portions may not have expired, but such taking possession and use shall not be deemed an acceptance of any work not completed in accordance with the Contract Documents.

ARTICLE 6 - CHANGES IN THE WORK

- 6.1 Without invalidating the Agreement and without notice to any surety, Owner may, at any time, order additions, deletions or revisions in the Work. These will be authorized by a written amendment, a change order, or a work directive change. Upon receipt of any such document, Contractor shall promptly proceed with the Work involved which will be performed under the applicable conditions of the contract documents (except as otherwise specifically provided).
- 6.2 Contractor shall not be entitled to an increase in the contract price or an extension of the contract time with respect to any Work performed that is not required by the contract documents as amended, modified and supplemented.
- 6.3 Owner and Contractor shall execute appropriate change orders (or written amendments) covering changes in the Work which are ordered by Owner, or which may be required because of acceptance of defective Work.
- 6.4 At any time Engineer may request a quotation from Contractor for a proposed change in the Work and within twenty-one (21) calendar days after receipt, Contractor shall submit a written and detailed proposal for an increase or decrease in the contract price or contract time for the proposed change. Engineer shall have 21 calendar days after receipt of the detailed proposal to respond in writing. The proposal shall include an itemized estimate of all costs and time for performance that will result directly or indirectly from the proposed change. Unless otherwise directed, itemized estimates shall be in sufficient detail to reasonably permit an analysis by Engineer of all material, labor, equipment, subcontracts, overhead costs and fees, and shall cover all Work involved in the change, whether such Work was deleted, added, changed or impacted. Notwithstanding the request for quotation, Contractor shall carry on the Work and maintain the progress schedule. Delays in the submittal of the written and detailed proposal will be considered non-prejudicial.

ARTICLE 7 - CHANGE OF CONTRACT PRICE

- 7.1 The contract price constitutes the total compensation (subject to authorized adjustments) payable to Contractor for performing the Work. All duties, responsibilities and obligations assigned to or undertaken by Contractor shall be at his expense without change in the contract price.
- 7.2 The contract price may only be changed by change order or by a written amendment. Any claim for an increase or decrease in the contract price shall be based on written notice delivered by the party making the claim to the other party. Notice of the amount of the claim with supporting data shall be delivered within ten (10) days from the beginning of such occurrence and shall be accompanied by claimant's written statement that the amount claimed covers all known amounts (direct, indirect and consequential) to which the claimant is entitled as a result of the occurrence of said event.
- 7.3 The value of any Work covered by a change order or of any claim for an increase or decrease in the contract price shall be determined in one of the following ways (at Owner's discretion):

- 7.3.1 Where the Work involved is covered by unit prices contained in the contract documents, cost will be determined by application of such unit prices to the quantities of the items involved.
 - 7.3.2 By mutual acceptance of lump sum.
 - 7.3.3 On the basis of the cost of the Work, plus a 20% Contractor's fee for overhead and profit. (Contractor shall submit an itemized cost breakdown together with supporting data.)
- 7.4 Either Owner or Contractor may make a claim for an adjustment in the contract price. The unit price of an item of unit price Work shall be subject to re-evaluation and adjustment under the following conditions:
- 7.4.1 If the total cost of a particular item of unit price Work amounts to 5% or more of the contract price and the variation in the quantity of the particular item of unit price Work performed by Contractor differs by more than 15% from the estimated quantity of such item indicated in the Agreement; and
 - 7.4.2 If there is no corresponding adjustment with respect to any other item of Work; and
 - 7.4.3 If a Contractor believes that it has incurred additional expense as a result thereof; or
 - 7.4.4 If Owner believes that the quantity variation entitles it to an adjustment in the unit price; or
 - 7.4.5 If the parties are unable to agree as to the effect of any such variations in the quantity of unit price Work performed.

ARTICLE 8 - CHANGE OF CONTRACT TIME

- 8.1 Contract time may only be changed by a change order or a written amendment. Any claim for an extension or shortening of the contract time shall be based on written notice delivered by the party making the claim to the other party. Notice of the extent of the claim with supporting data shall be delivered within fifteen (15) days from detection or beginning of such occurrence and shall be accompanied by the claimant's written statement that the adjustment claimed is the entire adjustment to which the claimant has reason to believe it is entitled as a result of the occurrence of said event.
- 8.2 The contract time will be extended in an amount equal to time lost due to delays beyond the control of Contractor. Such delays shall include, but not be limited to, acts or neglect by Owner or others performing additional work; or to fires, floods, epidemics, abnormal weather conditions or acts of God.
- 8.3 All time limits stated in the contract documents are of the essence.

ARTICLE 9 - WARRANTY, TEST/INSPECTION, CORRECTION

- 9.1 Contractor warrants (for a minimum period of three years or as otherwise stated herein) and guarantees to Owner that all work will be in accordance with the contract documents and will not be defective; that Owner, representatives of Owner, governmental agencies with jurisdictional interests will have access to the work at reasonable time for their observation, inspecting and testing (Contractor shall give Engineer timely notice of readiness of the work for all required approvals and shall assume full responsibility, including costs, in obtaining required tests, inspections, and approval certifications and/or acceptance, unless otherwise stated by Owner).
- 9.2 If any work (including work of others) that is to be inspected, tested, or approved is covered without written concurrence of Engineer, it must, if requested by Engineer, be uncovered for observation. Such uncovering shall be at Contractor's expense unless Contractor has given Engineer timely notice of Contractor's intention to cover the same and Engineer has not acted with reasonable promptness in response to such notice. Neither observations by Engineer nor inspections, tests, or approvals by others shall relieve Contractor from Contractor's obligations to perform the work in accordance with the contract documents.
- 9.3 If the work is defective, or Contractor fails to supply sufficient skilled workers, or suitable materials or equipment, or fails to furnish or perform the work in such a way that the completed work will conform to the contract documents, Owner may order Contractor to stop the work, or any portion thereof and terminate payments to the Contractor until the cause for such order has been eliminated. Contractor shall bear all direct, indirect and consequential costs for satisfactory reconstruction or removal and replacement with non-defective work, including, but not limited to fees and charges of engineers, architects, attorneys and other professionals and any additional expenses experienced by Owner due to delays to other Contractors performing additional work and an appropriate deductive change order shall be issued. Contractor shall further bear the responsibility for maintaining schedule and shall not be entitled to an extension of the contract time and the recovery of delay damages due to correcting or removing defective work.
- 9.3.1 If Contractor fails within seven (7) days after written notice to correct defective work, or fails to perform the work in accordance with the contract documents, or fails to comply with any other provision of the contract documents, Owner may correct and remedy any such deficiency. To the extent necessary to complete corrective and remedial action, Owner may exclude Contractor from all or part of the site, take possession of all or part of the work, Contractor's tools, construction equipment and machinery at the site or for which Owner has paid Contractor but which are stored elsewhere. All direct, indirect and consequential costs of Owner in exercising such rights and remedies will be charged against Contractor in an amount approved as to reasonableness by Engineer and a change order will be issued incorporating the necessary revisions.
- 9.3.2 If within three years after the date of completion or such longer period of time as may be prescribed by laws or regulations or by the terms of any applicable special guarantee required by the contract documents, any work is found to be defective, Contractor shall promptly, without cost to Owner and in accordance with Owner's written instructions, either correct such defective work or if it has been rejected by Owner, remove it from the site and replace it with non-defective work. If Contractor does not promptly comply with the terms of such instruction, Owner may have the

defective work corrected/removed and all direct, indirect and consequential costs of such removal and replacement will be paid by Contractor.

ARTICLE 10 - SUSPENSION/TERMINATION OF WORK

- 10.1 Owner may, at any time and without cause, suspend the work or any portion thereof for a period of not more than ninety (90) days by written notice to Contractor, which will fix the date on which work will be resumed. Contractor shall be allowed an increase in the contract price or an extension of the contract time, or both, directly attributable to any suspension if Contractor makes an approved claim therefore.
- 10.2 Owner may terminate the contract if Contractor commences a voluntary case under any chapter of the Bankruptcy Code or any similar action by filing a petition under any other federal or state law relating to the bankruptcy or insolvency; if a petition is filed against the Contractor under any chapter of the Bankruptcy Code or similar relief under any other federal or state law; if Contractor persistently fails to perform the work in accordance with the contract documents; if Contractor disregards laws or regulations of any public body having jurisdiction or the Engineer; or otherwise violates in any substantial way any provisions of the contract.
- 10.2.1 Owner may, after giving Contractor (and the surety, if there is one) seven (7) days written notice and to the extent permitted by laws and regulations, terminate the services of Contractor; exclude Contractor from the site and take possession of the work and of all Contractor's tools, construction equipment and machinery at the site and use the same to the full extent they could be used (without liability to Contractor for trespass or conversion); incorporate in the work all materials and equipment stored at the site or for which owner has paid Contractor but which are stored elsewhere, and finish the work as Owner may deem expedient. In such case, Contractor shall not be entitled to receive any further payment beyond an amount equal to the value of material and equipment not incorporated in the work, but delivered and suitably stored, less the aggregate of payments previously made. If the direct and indirect costs of completing the work exceed the unpaid balance of the contract price, Contractor shall pay the difference to Owner. Such costs incurred by Owner shall be verified by Owner and incorporated in a change order; but in finishing the work, Owner shall not be required to obtain the lowest figure for the work performed. Contractor's obligations to pay the difference between such costs and such unpaid balance shall survive termination of the Agreement.
- 10.3 If, through no act or fault of Contractor, the work is suspended for a period of more than ninety (90) days by Owner or under an order of court or other public authority, or Engineer fails to act on any application or fails to pay Contractor any sum finally determined to be due; then Contractor may, upon seven (7) days written notice to Owner terminate the Agreement and recover from Owner payment for all work executed, any expense sustained plus reasonable termination expenses. In lieu of terminating the Agreement, if Engineer has failed to act on any application of payment or Owner has failed to make any payment as aforesaid, Contractor may upon seven (7) days written notice to Owner stop the work until payment of all amounts then due.

ARTICLE 11 - CONTRACT CLAIMS

- 11.1 The rendering of a decision by Engineer with respect to any such claim, dispute or other matter (except any which have been waived by the making or acceptance of final payment) will be a condition precedent to any exercise by Owner or Contractor of such right or remedies as either may otherwise have under the contract documents or by laws or regulations in respect of any such claim, dispute or other matter. No action, either at law or at equity, shall be brought in connection with any such claim, dispute or other matter later than thirty (30) days after the date on which Owner/Engineer has rendered such written decision in respect thereof. Failure to bring an action within said thirty (30) day period shall result in Engineer's decision being final and binding on the Contractor. In no event may any such action be brought after the time at which instituting such proceedings would be otherwise barred by the applicable statute of limitations.
- 11.2 Before bringing any action in court pertaining to any claim, dispute or other matter in question(s) arising out of or relating to the contract documents or the breach thereof, or Engineer's final decision, except for claims which have been waived by the making and acceptance of final payment, the Contractor shall first submit written notice(s) of contract claims to the Purchasing Director for a decision; the Contractor may request a conference with the Purchasing Director. Claims include, without limitation, disputes arising under the contract and those based upon breach of contract, mistake, misrepresentation, or other cause for modification or revision. Contract claims shall use the process detailed in Section 2-26-63, Manatee County Purchase Code, Ordinance 08-43.

ARTICLE 12 - RESIDENT PROJECT REPRESENTATIVE - DUTIES, RESPONSIBILITIES

- 12.1 Resident Project Representative is Engineer/Owner's Agent, who will act as directed by and under the supervision of the Engineer, and who will confer with Owner/Engineer regarding his actions. Resident Project Representative's dealing in matters pertaining to the on-site work shall, in general, be only with the Owner/Engineer and Contractor and dealings with subcontractors shall only be through or with the full knowledge of Contractor.
- 12.2 Resident Project Representative will:
- 12.2.1 Review the progress schedule, schedule of shop drawing submissions and schedule of values prepared by Contractor and consult with Owner/Engineer concerning their acceptability.
 - 12.2.2 Attend preconstruction conferences. Arrange a schedule of progress meetings and other job conferences as required in consultation with Owner/Engineer and notify those expected to attend in advance. Attend meetings and maintain and circulate copies of minutes thereof.
 - 12.2.3 Serve as Owner/Engineer's liaison with Contractor, working principally through Contractor's superintendent and assist him in understanding the intent of the contract documents. As requested by Owner/Engineer, assist in obtaining additional details or information when required at the job site for proper execution of the Work.
 - 12.2.4 Receive and record date of receipt of shop drawings and samples, receive samples which are furnished at the site by Contractor and notify Owner/Engineer of their availability for examination.

- 12.2.5 Advise Owner/Engineer and Contractor or his superintendent immediately of the commencement of any work requiring a shop drawing or sample submission if the submission has not been approved by the Owner/Engineer.
- 12.2.6 Conduct on-site observations of the work in progress to assist Owner/Engineer in determining if the work is proceeding in accordance with the contract documents and that completed work will conform to the contract documents.
- 12.2.7 Report to Owner/Engineer whenever he believes that any work is unsatisfactory, faulty or defective or does not conform to the contract documents, or does not meet the requirements of any inspections, tests or approvals required or if work has been damaged prior to final payment; and advise Owner/Engineer when he believes work should be corrected or rejected or should be uncovered of observation or requires special testing, inspection or approval.
- 12.2.8 Verify that tests, equipment and system start-ups and operating and maintenance instructions are conducted as required by the contract documents and in the presence of the required personnel, and that Contractor maintains adequate records thereof; observe, record and report to Engineer appropriate details relative to the test procedures and start-ups.
- 12.2.9 Accompany visiting inspectors representing public or other agencies having jurisdiction over the project, record the outcome of these inspections and report to Owner/Engineer.
- 12.2.10 Transmit to Contractor, Owner/Engineer's clarifications and interpretations of the contract documents.
- 12.2.11 Consider and evaluate Contractor's suggestions or modifications in drawings or Contract Documents and report them with recommendations to Owner/Engineer.
- 12.2.12 Maintain at the job site orderly files for correspondence, reports of job conferences, shop drawings and sample submissions, reproductions of original contract documents including all addenda, change orders, field orders, additional drawings issued subsequent to the execution of the contract, Owner/Engineer's clarifications and interpretations of the contract documents, progress reports and other project related documents.
- 12.2.13 Keep a diary or log book, recording hours on the job site, weather conditions, data relative to questions of extras or deductions; list of visiting officials and representatives or manufacturers, fabricators, suppliers and distributors; daily activities, decisions, observations in general and specific observations in more detail as in the case of observing test procedures. Send copies to Owner/Engineer.
- 12.2.14 Record names, addresses and telephone numbers of all Contractors, subcontractors and major suppliers of materials and equipment.

- 12.2.15 Furnish Owner/Engineer periodic reports as required of progress of the work and Contractor's compliance with the approved progress schedule and schedule of shop drawing submissions.
 - 12.2.16 Consult with Owner/Engineer in advance of scheduling major tests, inspections or start of important phases of the work.
 - 12.2.17 Report immediately the occurrence of any accident.
 - 12.2.18 Review applications for payment with Contractor for compliance with the established procedure for their submission and forward them with recommendations to Owner/Engineer, noting particularly their relation to the schedule of values, work completed and materials and equipment delivered at the site but not incorporated in the work.
 - 12.2.19 During the course of the work, verify that certificates, maintenance and operations manuals and other data required to be assembled and furnished by Contractor are applicable to the items actually installed, and deliver this material to Owner/Engineer for his review prior to final acceptance of the work.
 - 12.2.20 Before Owner/Engineer issues a Certificate of Substantial Completion, submit to Contractor a list of observed items requiring completion or correction.
 - 12.2.21 Conduct final inspection in the company of Owner/Engineer and Contractor and prepare a final list of items to be completed or corrected.
 - 12.2.22 Verify that all items on final list have been completed or corrected and make recommendations to Owner/Engineer concerning acceptance.
- 12.3 Except upon written instructions of Owner/Engineer, Resident Project Representative:
- 12.3.1 Shall not authorize any deviation from the contract documents or approve any substitute materials or equipment;
 - 12.3.2 Shall not exceed limitations on Owner/Engineer's authority as set forth in the contract documents;
 - 12.3.3 Shall not undertake any of the responsibilities of Contractor, Subcontractors or Contractor's Superintendent, or expedite the work;
 - 12.3.4 Shall not advise on or issue directions relative to any aspect of the means, methods, techniques, sequences or procedures of construction unless such is specifically called for in the contract documents;
 - 12.3.5 Shall not advise on or issue directions as to safety precautions and programs in connection with the work;
 - 12.3.6 Shall not authorize Owner to occupy the project in whole or in part; and
 - 12.3.7 Shall not participate in specialized field or laboratory tests.

ARTICLE 13 - APPRENTICES

- 13.1 In accordance with the requirement of Section 446.011, Florida Statutes, the following requirements to safeguard the welfare of apprentices and trainees shall be a part of this contract, if applicable:
- 13.1.1 Contractor agrees to hire for the performance of the contract, a number of apprentices or trainees in each occupation which bears to the average number of the journeymen in that occupation to be employed in the performance of the contract, the ratio of at least one apprentice or trainee to every five journeymen.
 - 13.1.2 Contractor agrees, when feasible to assure that 25% of such apprentices or trainees are in their first year of training, except when the number of apprentices or trainees to be hired is fewer than four.
 - 13.1.3 Contractor agrees to submit, at three month intervals, to the Bureau of Apprenticeship of the Division of Labor, records of employment by trade of the number of apprentices or trainees employed; race of all apprentices; the number of apprentices or trainees in their first year of training; and total hours of work of all apprentices, trainees, and journeymen.
 - 13.1.4 Contractor agrees to submit to the Bureau of Apprenticeship of the Division of Labor, at three month intervals, a statement describing steps taken toward making a diligent effort in the hiring of apprentices and trainees and containing a breakdown by craft of hours worked and wages paid for first year apprentices or trainees, other apprentices or trainees and journeymen.

NOTE: The form of all submittals, notices, change orders and other documents permitted or required to be used or transmitted under the Contract shall be determined by the County. Standard County forms shall be utilized.

END OF SECTION

CONTRACT DOCUMENTS

FOR

Satellite Lift Station Rehabilitation (2008) Priority 1

PROJECT #: 402-5112080-LS 1
402-5112280-LS 6
402-5112380-LS 7
402-5112480-LS 8
402-5112580-LS 12
402-5112780-LS 15
402-5112880-LS 30A
402-5112180-LS 2M
402-5112680-LS 12D

October, 2008

PROJECT OWNER:

County of Manatee, Florida
c/o Manatee County Purchasing
1112 Manatee Avenue West
Bradenton, Florida 34205
(941) 748-4501

PREPARED BY:

Engineering Division
Manatee County Public Works Department
4422-B 66th Street West
Bradenton, Florida 34210
(941) 792-8811

INFRASTRUCTURE ENGINEERING STANDARD SPECIFICATIONS

DIVISION 1	GENERAL REQUIREMENTS	4
SECTION 01005	GENERAL REQUIREMENTS	4
SECTION 01010	SUMMARY OF WORK	15
SECTION 01015	CONTROL OF WORK	17
SECTION 01030	SPECIAL PROJECT PROCEDURES	21
SECTION 01045	CUTTING AND PATCHING	25
SECTION 01050	FIELD ENGINEERING AND SURVEYING	27
SECTION 01090	REFERENCE STANDARDS	29
SECTION 01150	MEASUREMENT AND PAYMENT	32
SECTION 01152	REQUESTS FOR PAYMENT	40
SECTION 01153	CHANGE ORDER PROCEDURES	41
SECTION 01200	PROJECT MEETINGS	44
SECTION 01310	CONSTRUCTION SCHEDULE & PROJECT RESTRAINTS	46
SECTION 01340	SHOP DRAWINGS, PROJECT DATA AND SAMPLES	51
SECTION 01370	SCHEDULE OF VALUES	56
SECTION 01380	CONSTRUCTION PHOTOGRAPHS	57
SECTION 01410	TESTING AND TESTING LABORATORY SERVICES	59
SECTION 01510	TEMPORARY AND PERMANENT UTILITIES	61
SECTION 01570	TRAFFIC REGULATION	63
SECTION 01580	PROJECT IDENTIFICATION AND SIGNS	65
SECTION 01600	MATERIAL AND EQUIPMENT	68
SECTION 01620	STORAGE AND PROTECTION	70
SECTION 01700	CONTRACT CLOSEOUT	72
SECTION 01710	CLEANING	75
SECTION 01720	PROJECT RECORD DOCUMENTS	77
SECTION 01730	OPERATING AND MAINTENANCE DATA	80
SECTION 01740	WARRANTIES AND BONDS	83
DIVISION 2	SITE WORK	85
SECTION 02064	MODIFICATIONS TO EXISTING STRUCTURES, PIPING AND EQUIPMENT	85
SECTION 02221	TRENCHING, BEDDING AND BACKFILL FOR PIPE	89
SECTION 02223	EXCAVATION BELOW GRADE AND CRUSHED STONE OR SHELL REFILL	93
SECTION 02260	FINISH GRADING	94
SECTION 02276	TEMPORARY EROSION AND SEDIMENTATION CONTROL	96
SECTION 02444	FENCING	98
SECTION 02480	LANDSCAPING	105
SECTION 02485	SEEDING AND SODDING	110
SECTION 02615	DUCTILE IRON PIPE AND FITTINGS	113
SECTION 02620	POLYETHYLENE (PE) PRESSURE PIPE	115
SECTION 02622	POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS (AWWA SPECIFICATIONS C-900 & C-905)	117
SECTION 02627	SANITARY SEWER MANHOLE AND WET WELL FIBERGLASS LINERS	

		120
SECTION 02640	VALVES AND APPURTENANCES	124
SECTION 02720	SANITARY SEWER BYPASS PUMPING	139
SECTION 02999	MISCELLANEOUS WORK AND CLEANUP	142
DIVISION 3	CONCRETE	144
SECTION 03200	CONCRETE REINFORCEMENT	144
SECTION 03300	CAST-IN-PLACE CONCRETE	147
SECTION 03350	CONCRETE FINISHES	152
SECTION 03410	PRECAST CONCRETE STRUCTURES	155
DIVISION 5	METALS	160
SECTION 05500	MISCELLANEOUS METAL	160
SECTION 09970	SURFACE PROTECTION SPRAY SYSTEM	167
DIVISION 13	SPECIAL CONSTRUCTION	173
SECTION 13350	LIFT STATION REHABILITATION	173
SECTION 15094	PIPE HANGERS AND SUPPORTS	175
DIVISION 16	ELECTRICAL	181
SECTION 16050	ELECTRICAL - GENERAL PROVISIONS	181
SECTION 16110	CONDUITS AND FITTINGS	185

DIVISION 1 GENERAL REQUIREMENTS

SECTION 01005 GENERAL REQUIREMENTS

PART 1 GENERAL

1.01 SCOPE AND INTENT

A. Description

The work to be done consists of the furnishing of all labor, materials and equipment, and the performance of all work included in this Contract.

B. Work Included

The Contractor shall furnish all labor, superintendence, materials, plant, power, light, heat, fuel, water, tools, appliances, equipment, supplies, shop drawings, working drawings and other means of construction necessary or proper for performing and completing the work. He shall obtain and pay for all required permits necessary for the work, other than those permits such as the DEP permit and railroad permit which may have already been obtained. He shall perform and complete the work in the manner best calculated to promote rapid construction consistent with safety of life and property and to the satisfaction of the Engineer, and in strict accordance with the Contract Documents. The Contractor shall clean up the work and maintain it during and after construction, until accepted, and shall do all work and pay all costs incidental thereto. He shall repair or restore all structures and property that may be damaged or disturbed during performance of the work.

The cost of incidental work described in these General Requirements, for which there are no specific Contract Items, shall be considered as part of the general cost of doing the work and shall be included in the prices for the various Contract Items. No additional payment will be made therefor.

The Contractor shall provide and maintain such modern plant, tools, and equipment as may be necessary, in the opinion of the Engineer, to perform in a satisfactory and acceptable manner all the work required by this Contract. Only equipment of established reputation and proven efficiency shall be used. The Contractor shall be solely responsible for the adequacy of his workmanship, materials and equipment, prior approval of the Engineer notwithstanding.

C. Public Utility Installations and Structures

Public utility installations and structures shall be understood to include all poles, tracks, pipes, wires, conduits, house service connections, vaults, manholes and all other appurtenances and facilities pertaining thereto whether owned or controlled by the Owner, other governmental bodies or privately owned by individuals, firms or corporations, used to serve the public with transportation, traffic control, gas, electricity, telephone, sewage, drainage, water or other public or private property which may be affected by the work shall be deemed included hereunder.

The Contractor shall protect all public utility installations and structures from damage during the work. Access across any buried public utility installation or structure shall be made only in such locations and by means approved by the Engineer. The Contractor shall so arrange his operations as to avoid any damage to these facilities. All required protective devices and

construction shall be provided by the Contractor at his expense. All existing public utilities damaged by the Contractor which are shown on the Plans or have been located in the field by the utility shall be repaired by the Contractor, at his expense, as approved by the Engineer. No separate payment shall be made for such protection or repairs to public utility installations or structures.

Public utility installations or structures owned or controlled by the Owner or other governmental body, which are required by this contract to be removed, relocated, replaced or rebuilt by the Contractor not identified in any separate bid item shall be considered as a part of the general cost of doing the work and shall be included in the prices bid for the various contract items. No separate payment shall be made therefor.

Where public utility installations or structures owned or controlled by the Owner or other governmental body are encountered during the course of the work, and are not indicated on the Plans or in the Specifications, and when, in the opinion of the Engineer, removal, relocation, replacement or rebuilding is necessary to complete the work under this Contract, such work shall be accomplished by the utility having jurisdiction, or such work may be ordered, in writing by the Engineer, for the contractor to accomplish. If such work is accomplished by the utility having jurisdiction, it will be carried out expeditiously and the Contractor shall give full cooperation to permit the utility to complete the removal, relocation, replacement or rebuilding as required. If such work is accomplished by the Contractor, it will be in accordance with the General and Supplemental General Conditions.

The Contractor shall give written notice to Owner and other governmental utility departments and other owners of public utilities of the location of his proposed construction operations, at least forty-eight hours in advance of breaking ground in any area or on any unit of the work. This can be accomplished by making the appropriate contact with the "Sunshine State One-Call of Florida, Inc. Call Center ("Call Sunshine") and per all requirements provided for in the Florida Underground Facilities Damage Prevention and Safety Act (Florida Statutes, Title XXXIII, Chapter 556).

The maintenance, repair, removal, relocation or rebuilding of public utility installations and structures, when accomplished by the Contractor as herein provided, shall be done by methods approved by the Engineer.

1.02 PLANS AND SPECIFICATIONS

A. Plans

When obtaining data and information from the Plans, figures shall be used in preference to scaled dimensions, and large scale drawings in preference to small scale drawings.

B. Copies Furnished to Contractor

The Contractor shall furnish each of the subcontractors, manufacturers, and material men such copies of the Contract Documents as may be required for their work. Additional copies of the Plans and Specifications, when requested, may be furnished to the Contractor at cost of reproduction.

C. Supplementary Drawings

When, in the opinion of the Engineer, it becomes necessary to explain more fully the work to be done or to illustrate the work further or to show any changes which may be required,

drawings known as Supplementary Drawings, with specifications pertaining thereto, will be prepared by the Engineer and five paper prints thereof will be given to the Contractor.

D. Contractor to Check Plans and Data

The Contractor shall verify all dimensions, quantities and details shown on the Plans, Supplementary Drawings, Schedules, Specifications or other data received from the Engineer, and shall notify him of all errors, omissions, conflicts, and discrepancies found therein. Failure to discover or correct errors, conflicts or discrepancies shall not relieve the Contractor of full responsibility for unsatisfactory work, faulty construction or improper operation resulting therefrom nor from rectifying such conditions at his own expense. He will not be allowed to take advantage of any errors or omissions, as full instructions will be furnished by the Engineer, should such errors or omissions be discovered. All schedules are given for the convenience of the Engineer and the Contractor and are not guaranteed to be complete. The Contractor shall assume all responsibility for the making of estimates of the size, kind, and quality of materials and equipment included in work to be done under the Contract.

E. Specifications

The Technical Specifications consist of three parts: General, Products and Execution. The General Section contains General Requirements which govern the work. Products and Execution modify and supplement these by detailed requirements for the work and shall always govern whenever there appears to be a conflict.

F. Intent

All work called for in the Specifications applicable to this Contract, but not shown on the Plans in their present form, or vice versa, shall be of like effect as if shown or mentioned in both. Work not specified in either the Plans or in the Specifications, but involved in carrying out their intent or in the complete and proper execution of the work, is required and shall be performed by the Contractor as though it were specifically delineated or described.

The apparent silence of the Specifications as to any detail, or the apparent omission from them of a detailed description concerning any work to be done and materials to be furnished, shall be regarded as meaning that only the best general practice is to prevail and that only material and workmanship of the best quality is to be used, and interpretation of these Specifications shall be made upon that basis.

The inclusion of the Related Requirements (or work specified elsewhere) in the General part of the specifications is only for the convenience of the Contractor, and shall not be interpreted as a complete list of related Specification Sections.

1.03 MATERIALS AND EQUIPMENT

A. Manufacturer

The names of proposed manufacturers, material men, suppliers and dealers who are to furnish materials, fixtures, equipment, appliances or other fittings shall be submitted to the Engineer for approval. Such approval must be obtained before shop drawings will be checked. No manufacturer will be approved for any materials to be furnished under this Contract unless he shall be of good reputation and have a plant of ample capacity. He shall, upon the request of the Engineer, be required to submit evidence that he has manufactured a

similar product to the one specified and that it has been previously used for a like purpose for a sufficient length of time to demonstrate its satisfactory performance.

All transactions with the manufacturers or subcontractors shall be through the Contractor, unless the Contractor shall request, in writing to the Engineer, that the manufacturer or subcontractor deal directly with the Engineer. Any such transactions shall not in any way release the Contractor from his full responsibility under this Contract.

Any two or more pieces or material or equipment of the same kind, type or classification, and being used for identical types of services, shall be made by the same manufacturer.

B. Delivery

The Contractor shall deliver materials in ample quantities to insure the most speedy and uninterrupted progress of the work so as to complete the work within the allotted time. The Contractor shall also coordinate deliveries in order to avoid delay in, or impediment of, the progress of the work of any related Contractor.

C. Tools and Accessories

The Contractor shall, unless otherwise stated in the Contract Documents, furnish with each type, kind or size of equipment, one complete set of suitably marked high grade special tools and appliances which may be needed to adjust, operate, maintain or repair the equipment. Such tools and appliances shall be furnished in approved painted steel cases, properly labeled and equipped with good grade cylinder locks and duplicate keys.

Spare parts shall be furnished as specified.

Each piece of equipment shall be provided with a substantial nameplate, securely fastened in place and clearly inscribed with the manufacturer's name, year of manufacture, serial number, weight and principal rating data.

D. Installation of Equipment.

The Contractor shall have on hand sufficient proper equipment and machinery of ample capacity to facilitate the work and to handle all emergencies normally encountered in work of this character.

Equipment shall be erected in a neat and workmanlike manner on the foundations at the locations and elevations shown on the Plans, unless directed otherwise by the Engineer during installation. All equipment shall be correctly aligned, leveled and adjusted for satisfactory operation and shall be installed so that proper and necessary connections can be made readily between the various units.

The Contractor shall furnish, install and protect all necessary anchor and attachment bolts and all other appurtenances needed for the installation of the devices included in the equipment specified. Anchor bolts shall be as approved by the Engineer and made of ample size and strength for the purpose intended. Substantial templates and working drawings for installation shall be furnished.

The Contractor shall, at his own expense, furnish all materials and labor for, and shall properly bed in non-shrink grout, each piece of equipment on its supporting base that rests on masonry foundations.

Grout shall completely fill the space between the equipment base and the foundation. All metal surfaces coming in contact with concrete or grout shall receive a coat of coal tar epoxy equal to Koppers 300M.

E. Service of Manufacturer's Engineer

The Contract prices for equipment shall include the cost of furnishing (as required by equipment specifications sections) a competent and experienced engineer or superintendent who shall represent the manufacturer and shall assist the Contractor, when required, to install, adjust, test and place in operation the equipment in conformity with the Contract Documents. After the equipment is placed in permanent operation by the Owner, such engineer or superintendent shall make all adjustments and tests required by the Engineer to prove that such equipment is in proper and satisfactory operating condition, and shall instruct such personnel as may be designated by the Owner in the proper operation and maintenance of such equipment.

1.04 INSPECTION AND TESTING

A. General

Inspection and testing of materials will be performed by the Owner unless otherwise specified.

For tests specified to be made by the Contractor, the testing personnel shall make the necessary inspections and tests and the reports thereof shall be in such form as will facilitate checking to determine compliance with the Contract Documents. Three (3) copies of the reports shall be submitted and authoritative certification thereof must be furnished to the Engineer as a prerequisite for the acceptance of any material or equipment.

If, in the making of any test of any material or equipment, it is ascertained by the Engineer that the material or equipment does not comply with the Contract, the Contractor will be notified thereof and he will be directed to refrain from delivering said material or equipment, or to remove it promptly from the site or from the work and replace it with acceptable material, without cost to the Owner.

Tests of electrical and mechanical equipment and appliances shall be conducted in accordance with recognized test codes of the ANSI, ASME, or the IEEE, except as may otherwise be stated herein.

The Contractor shall be fully responsible for the proper operation of equipment during tests and instruction periods and shall neither have nor make any claim for damage which may occur to equipment prior to the time when the Owner formally takes over the operation thereof.

B. Costs

All inspection and testing of materials furnished under this Contract will be performed by the Owner or duly authorized inspection engineers or inspections bureaus without cost to the Contractor, unless otherwise expressly specified.

The cost of shop and field tests of equipment and of certain other tests specifically called for in the Contract Documents shall be borne by the Contractor and such costs shall be deemed to be included in the Contract price.

Materials and equipment submitted by the Contractor as the equivalent to those specifically named in the Contract may be tested by the Owner for compliance. The Contractor shall reimburse the Owner for the expenditures incurred in making such tests on materials and equipment which are rejected for non-compliance.

C. Inspections of Materials

The Contractor shall give notice in writing to the Engineer, at least two weeks in advance of his intention to commence the manufacture or preparation of materials especially manufactured or prepared for use in or as part of the permanent construction. Such notice shall contain a request for inspection, the date of commencement and the expected date of completion of the manufacture or preparation of materials. Upon receipt of such notice, the Engineer will arrange to have a representative present at such times during the manufacture as may be necessary to inspect the materials or he will notify the Contractor that the inspection will be made at a point other than the point of manufacture, or he will notify the Contractor that inspection will be waived. The Contractor must comply with these provisions before shipping any material. Such inspection shall not release the Contractor from the responsibility for furnishing materials meeting the requirements of the Contract Documents.

D. Certificate of Manufacture

When inspection is waived or when the Engineer so requires, the Contractor shall furnish to him authoritative evidence in the form of Certificates of Manufacture that the materials to be used in the work have been manufactured and tested in conformity with the Contract Documents. These certificates shall be notarized and shall include copies of the results of physical tests and chemical analyses, where necessary, that have been made directly on the product or on similar products of the manufacturer.

E. Shop Tests of Operating Equipment

Each piece of equipment for which pressure, duty, capacity, rating, efficiency, performance, function or special requirements are specified shall be tested in the shop of the maker in a manner which shall conclusively prove that its characteristics comply fully with the requirements of the Contract Documents. No such equipment shall be shipped to the work until the Engineer notifies the Contractor, in writing, that the results of such tests are acceptable.

Five copies of the manufacturer's actual test data and interpreted results thereof, accompanied by a certificate of authenticity sworn to by a responsible official of the manufacturing company, shall be forwarded to the Engineer for approval.

The cost of shop tests and of furnishing manufacturer's preliminary and shop test data of operating equipment shall be borne by the Contractor.

F. Preliminary Field Tests

As soon as conditions permit, the Contractor shall furnish all labor, materials, and instruments and shall make preliminary field tests of equipment. If the preliminary field tests disclose any equipment furnished under this Contract which does not comply with the requirements of the Contract Documents, the Contractor shall, prior to the acceptance tests, make all changes, adjustments and replacements required. The furnishing Contractor shall assist in the preliminary field tests as applicable.

G. Final Field Tests

Upon completion of the work and prior to final payment, all equipment and piping installed under this Contract shall be subjected to acceptance tests as specified or required to prove compliance with the Contract Documents.

The Contractor shall furnish labor, fuel, energy, water and all other materials, equipment and instruments necessary for all acceptance tests, at no additional cost to the Owner. The Supplier shall assist in the final field tests as applicable.

H. Failure of Tests

Any defects in the materials and equipment or their failure to meet the tests, guarantees or requirements of the Contract Documents shall be promptly corrected by the Contractor. The decision of the Engineer as to whether or not the Contractor has fulfilled his obligations under the Contract shall be final and conclusive. If the Contractor fails to make these corrections or if the improved materials and equipment, when tested, shall again fail to meet the guarantees of specified requirements, the Owner, notwithstanding its partial payment for work, and materials and equipment, may reject the materials and equipment and may order the Contractor to remove them from the site at his own expense.

In case the Owner rejects any materials and equipment, then the Contractor shall replace the rejected materials and equipment within a reasonable time. If he fails to do so, the Owner may, after the expiration of a period of thirty (30) calendar days after giving him notice in writing, proceed to replace such rejected materials and equipment, and the cost thereof shall be deducted from any compensation due or which may become due the Contractor under his Contract.

I. Final Inspection

During such final inspections, the work shall be clean and free from water. In no case will the final pay application be prepared until the Contractor has complied with all requirements set forth and the Engineer has made his final inspection of the entire work and is satisfied that the entire work is properly and satisfactorily constructed in accordance with the requirements of the Contract Document.

1.05 TEMPORARY STRUCTURES

A. Temporary Fences

If, during the course of the work, it is necessary to remove or disturb any fence or part thereof, the Contractor shall, at his own expense, if so ordered by the Engineer, provide a suitable temporary fence which shall be maintained until the permanent fence is replaced. The Engineer shall be solely responsible for the determination of the necessity for providing a temporary fence and the type of temporary fence to be used.

1.06 TEMPORARY SERVICES

A. First Aid

The Contractor shall keep upon the site, at each location where work is in progress, a completely equipped first aid kit and shall provide ready access thereto at all times when people are employed on the work.

1.07 LINES AND GRADES

A. Grade

All work under this Contract shall be constructed in accordance with the lines and grades shown on the Plans, or as given by the Owner/Engineer. The full responsibility for keeping alignment and grade shall rest upon the Contractor.

B. Safeguarding Marks

The Contractor shall safeguard all points, stakes, grade marks, monuments and bench marks made or established on the work, bear the cost of reestablishing them if disturbed, and bear the entire expense of rectifying work improperly installed due to not maintaining or protecting or to removing without authorization such established points, stakes and marks.

The Contractor shall safeguard all existing and known property corners, monuments and marks adjacent to but not related to the work and, if required, shall bear the cost of reestablishing them if disturbed or destroyed.

C. Datum Plane

All elevations indicated or specified refer to the Mean Sea Level Datum of the NGVD 1929 Datum and/or NAVD 1988.

1.08 ADJACENT STRUCTURES AND LANDSCAPING

A. Responsibility

The Contractor shall also be entirely responsible and liable for all damage or injury as a result of his operations to all other adjacent public and private property, structures of any kind and appurtenances thereto met with during the progress of the work. The cost of protection, replacement in their original locations and conditions or payment of damages for injuries to such adjacent public and private property and structures affected by the work, whether or not shown on the Plans, and the removal, relocation and reconstruction of such items called for on the Plans or specified shall be included in the various Contract Items and no separate payments will be made therefor. Where such public and private property, structures of any kind and appurtenances thereto are not shown on the Plans and when, in the opinion of the Engineer, additional work is deemed necessary to avoid interference with the work, payment therefore will be made as provided for in the General Conditions.

Contractor is expressly advised that the protection of buildings, structures, tunnels, tanks, pipelines, etc. and related work adjacent and in the vicinity of his operations, wherever they may be, is solely his responsibility. Conditional inspection of buildings or structures in the immediate vicinity of the project which may reasonably be expected to be affected by the Work shall be performed by and be the responsibility of the Contractor.

Contractor shall, before starting operations, make an examination of the interior and exterior of the adjacent structures, buildings, facilities, etc., and record by notes, measurements, photographs, etc., conditions which might be aggravated by open excavation and

construction. Repairs or replacement of all conditions disturbed by the construction shall be made to the satisfaction of the Owner and to the satisfaction of the Engineer. This does not preclude conforming to the requirements of the insurance underwriters. Copies of surveys, photographs, reports, etc., shall be given to the Engineer.

Prior to the beginning of any excavations, the Contractor shall advise the Engineer of all buildings or structures on which he intends to perform work or which performance of the project work will affect.

B. Protection of Trees

1. All trees and shrubs shall be adequately protected by the Contractor with boxes and otherwise and in accordance with ordinances governing the protection of trees. No excavated materials shall be placed so as to injure such trees or shrubs. Trees or shrubs destroyed by negligence of the Contractor or his employees shall be replaced by him with new stock of similar size and age, at the proper season and at the sole expense of the Contractor.
2. Beneath trees or other surface structures, where possible, pipelines may be built in short tunnels, backfilled with excavated materials, except as otherwise specified, or the trees or structures carefully supported and protected from damage.
3. The Owner may order the Contractor, for the convenience of the Owner, to remove trees along the line or trench excavation. If so ordered, the Owner will obtain any permits required for removal of trees. Such tree removal ordered shall be paid for under the appropriate Contract Items.

C. Lawn Areas

Lawn areas shall be left in as good condition as before the starting of the work. Where sod is to be removed, it shall be carefully removed, and later replaced, or the area where sod has been removed shall be restored with new sod in the manner described in the Workmanship and Materials Paragraph in Section 02485, Seeding & Sodding.

D. Restoration of Fences

Any fence, or part thereof, that is damaged or removed during the course of the work shall be replaced or repaired by the Contractor and shall be left in as good a condition as before the starting of the work. The manner in which the fence is repaired or replaced and the materials used in such work shall be subject to the approval of the Engineer. The cost of all labor, materials, equipment, and work for the replacement or repair of any fence shall be deemed included in the appropriate Contract Item or items, or if no specific Item is provided therefore, as part of the overhead cost of the work, and no additional payment will be made therefore.

1.09 PROTECTION OF WORK AND PUBLIC

A. Barriers and Lights

During the prosecution of the work, the Contractor shall put up and maintain at all times such barriers and lights as will effectually prevent accidents. The Contractor shall provide suitable barricades, red lights, "danger" or "caution" or "street closed" signs and watchmen at all places where the work causes obstructions to the normal traffic or constitutes in any way a hazard to the public, in accordance with state and local requirements.

B. Smoke Prevention

A strict compliance with ordinances regulating the production and emission of smoke will be required. No open fires will be permitted.

C. Noise

The Contractor shall eliminate noise to as great an extent as practicable at all times. Air compressing plants shall be equipped with silencers and the exhaust of all engines or other power equipment shall be provided with mufflers. In the vicinity of hospitals and schools, special care shall be used to avoid noise or other nuisances. The Contractor shall strictly observe all local regulations and ordinances covering noise control.

Except in the event of an emergency, no work shall be done between the hours of 7:00 P.M. and 7:00 A.M., or on weekends. If the proper and efficient prosecution of the work requires operations during the night or weekends, the written permission of the Owner shall be obtained before starting such items of the work.

D. Access to Public Services

Neither the materials excavated nor the materials or plant used in the construction of the work shall be so placed as to prevent free access to all fire hydrants, valves or manholes.

E. Dust prevention

The Contractor shall prevent dust nuisance from his operations or from traffic by keeping the roads and/or construction areas sprinkled with water at all times.

1.10 CUTTING AND PATCHING

The Contractor shall do all cutting, fitting or patching of his portion of the work that may be required to make the several parts thereof join and coordinate in a manner satisfactory to the Engineer and in accordance with the Plans and Specifications. The work must be done by competent workmen skilled in the trade required by the restoration.

1.11 CLEANING

A. During Construction

During construction of the work, the Contractor shall, at all times, keep the site of the work and adjacent premises as free from material, debris and rubbish as is practicable and shall remove the same from any portion of the site if, in the opinion of the Engineer, such material, debris, or rubbish constitutes a nuisance or is objectionable.

The Contractor shall remove from the site all of his surplus materials and temporary structures when no further need therefore develops.

B. Final Cleaning

At the conclusion of the work, all equipment, tools, temporary structures and materials belonging to the Contractor shall be promptly taken away, and he shall remove and promptly dispose of all water, dirt, rubbish or any other foreign substances.

The Contractor shall thoroughly clean all equipment and materials installed by him and shall deliver such materials and equipment undamaged in a bright, clean, polished and new operating condition.

1.12 MISCELLANEOUS

A. Protection Against Siltation and Bank Erosion

1. The Contractor shall arrange his operations to minimize siltation and bank erosion on construction sites and on existing or proposed water courses and drainage ditches.
2. The Contractor, at his own expense, shall remove any siltation deposits and correct any erosion problems as directed by the Engineer which results from his construction operations.

B. Protection of Wetland Areas

The Contractor shall properly dispose of all surplus material, including soil, in accordance with Local, State and Federal regulations. Under no circumstances shall surplus material be disposed of in wetland areas as defined by the Florida Department of Environmental Protection or Southwest Florida Water Management District.

C. Existing Facilities

The work shall be so conducted to maintain existing facilities in operation insofar as is possible. Requirements and schedules of operations for maintaining existing facilities in service during construction shall be as described in the Special Provisions.

D. Use of Chemicals

All chemicals used during project construction or furnished for project operation, whether herbicide, pesticide, disinfectant, polymer, reactant, or of other classification, must show approval of either EPA or USDA. Use of all such chemicals and disposal of residues shall be in strict conformance with instructions.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01010 SUMMARY OF WORK

PART 1 GENERAL

1.01 WORK COVERED BY CONTRACT DOCUMENTS/REQUIREMENTS INCLUDED

- A. The work included in this contract consists of the rehabilitation to upgrade nine (9) lift stations. The work includes, but is not limited to: removal, furnishing and installing; Remove and replace base elbows, piping, valves, and fittings in wet well and valve vault. Install new fiberglass or spray on wet well liner, new HDPE discharge piping, and stilling well. Install new valves and fittings in the valve vault.. Grout the existing and install new PVC drain from the valve vault to the wet well. Tap & valve and conduit for telemetry Also included in the rehabilitation; by-pass pumping; removal and disposal of construction debris; and other miscellaneous items as noted on the plans.
- B. The Contractor shall furnish all shop drawings, working drawings, labor, materials, equipment, tools, services and incidentals necessary to complete all work required by these Specifications and as shown on the Contract Drawings.
- C. The Contractor shall perform the work complete, in place and ready for continuous service and shall include any repairs, replacements, and/or restoration required as a result of damages caused prior to acceptance by the Owner.
- D. The Contractor shall furnish and install all materials, equipment and labor which is reasonably and properly inferable and necessary for the proper completion of the work, whether specifically indicated in the Contract Documents or not.

1.02 CONTRACTS

Construct all the Work under a single contract.

1.03 WORK SEQUENCE

- A. All work done under this Contract shall be done with a minimum of inconvenience to the users of the system or facility. The Contractor shall coordinate his work with private property owners such that existing utility services are maintained to all users to the maximum extent possible.
- B. The Contractor shall, if necessary and feasible, construct the work in stages to accommodate the Owner's use of the premises during the construction period; coordinate the construction schedule and operations with the Owner's Representative.
- C. The Contractor shall, where feasible, construct the Work in stages to provide for public convenience and not close off public use of any facility until completion of construction to provide alternative usage.

1.04 CONSTRUCTION AREAS

- A. The Contractor shall: Limit his use of the construction areas for work and for storage, to allow for:
 - 1. Work by other Contractors.
 - 2. Owner's Use.

3. Public Use.

- B. Coordinate use of work site under direction of Engineer or Owner's Representative.
- C. Assume full responsibility for the protection and safekeeping of products under this Contract, stored on the site.
- D. Move any stored products under the Contractor's control, which interfere with operations of the Owner or separate contractor.
- E. Obtain and pay for the use of additional storage of work areas needed for Contractor operations.

1.05 OWNER OCCUPANCY

- A. It is assumed that portions of the Work will be completed prior to completion of the entire Work. Upon completion of construction of each individual facility, including testing, if the Owner, at its sole discretion, desires to accept the individual facility, the Contractor will be issued a dated certificate of completion and acceptance for each individual facility. The Owner will assume ownership and begin operation of the individual facility on that date and the three-year guaranty period shall commence on that date. The Owner has the option of not accepting the entire work as a whole until it is completed, tested and approved by the Engineer and Owner.

1.06 PARTIAL OWNER OCCUPANCY

The Contractor shall schedule his operations for completion of portions of the Work, as designated, for the Owner's occupancy prior to substantial completion of the entire work.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01015 CONTROL OF WORK

PART 1 GENERAL

1.01 WORK PROGRESS

The Contractor shall furnish personnel and equipment which will be efficient, appropriate and adequately sized to secure a satisfactory quality of work and a rate of progress which will insure the completion of the work within the time stipulated in the Contract. If at any time such personnel appears to the Engineer to be inefficient, inappropriate, or insufficient for securing the quality of work required for producing the rate of progress aforesaid, he may order the Contractor to increase the efficiency, change the character, or increase the personnel and equipment and the Contractor shall conform to such order. Failure of the Engineer to give such order shall in no way relieve the Contractor of his obligations to secure the quality of the work and rate of progress required.

1.02 PRIVATE LAND

The Contractor shall not enter or occupy private land outside of easements, except by permission of the affected property owner.

1.03 WORK LOCATIONS

Work shall be located substantially as indicated on the drawings, but the Engineer reserves the right to make such modifications in locations as may be found desirable to avoid interference with existing structures or for other reasons.

1.04 OPEN EXCAVATIONS

- A. All open excavations shall be adequately safeguarded by providing temporary barricades, caution signs, lights and other means to prevent accidents to persons and damage to property. The Contractor shall, at his own expense, provide suitable and safe bridges and other crossings for accommodating travel by pedestrians and workmen. Bridges provided for access to private property during construction shall be removed when no longer required. If the excavation becomes a hazard, or if it excessively restricts traffic at any point, the Engineer may require special construction procedures such as limiting the length of open trench, prohibiting stacking excavated material in the street and requiring that the trench shall not remain open overnight.
- B. The Contractor shall take precautions to prevent injury to the public due to open trenches. All trenches, excavated material, equipment, or other obstacles which could be dangerous to the public shall be barricaded and well lighted at all times when construction is not in progress.

1.05 DISTRIBUTION SYSTEMS AND SERVICES

- A. The Contractor shall avoid interruptions to water, telephone, cable TV, sewer, gas, or other related utility services. He shall notify the Engineer and the appropriate agency well in advance of any requirement for dewatering, isolating, or relocating a section of a utility, so that necessary arrangements may be made.
- B. If it appears that utility service will be interrupted for an extended period, the Engineer may order the Contractor to provide temporary service lines at the Contractor's expense. Inconvenience of the users shall be kept to the minimum, consistent with existing conditions.

The safety and integrity of the systems are of prime importance in scheduling work.

1.06 PROTECTION AND RELOCATION OF EXISTING STRUCTURES AND UTILITIES

- A. The Contractor shall assume full responsibility for the protection of all buildings, structures and utilities, public or private, including poles, signs, services to building utilities, gas pipes, water pipes, hydrants, sewers, drains and electric and telephone cables and other similar facilities, whether or not they are shown on the Drawings. The Contractor shall carefully support and protect all such structures and utilities from injury of any kind. Any damage resulting from the Contractor's operation shall be repaired by the Contractor at his expense.
- B. The Contractor shall bear full responsibility for obtaining locations of all underground structures and utilities (including existing water services, drain lines and sewers). Services to buildings shall be maintained and all costs or charges resulting from damage thereto shall be paid by the Contractor.
- C. Protection and temporary removal and replacement of existing utilities and structures as described in this Section shall be a part of the work under the Contract and all costs in connection therewith shall be included in the unit prices established in the Bid.
- D. If, in the opinion of the Engineer, permanent relocation of a utility owned by the Owner is required, he may direct the Contractor, in writing, to perform the work. Work so ordered will be paid for at the Contract unit prices, if applicable, or as extra work as classified in the General Conditions. If relocation of a privately owned utility is required, the Owner will notify the utility to perform the work as expeditiously as possible. The Contractor shall fully cooperate with the Owner and utility and shall have no claim for delay due to such relocation. The Contractor shall notify public utility companies in writing at least 48 hours (excluding Saturdays, Sundays and legal holidays) before excavating near their utilities.

1.07 TEST PITS

Test pits for the purpose of locating underground pipeline or structures in advance of the construction shall be excavated and backfilled by the Contractor immediately after the utility location and the surface shall be restored in a manner equal or better than the original condition. No separate payment will be made.

1.08 CARE AND PROTECTION OF PROPERTY

- A. The Contractor shall be responsible for the preservation of all public and private property and shall use every precaution necessary to prevent damage thereto. If any direct or indirect damage is done to public or private property by or on account of any act, omission, neglect, or misconduct in the execution of the work on the part of the Contractor, such property shall be restored by the Contractor, at his expense, to a condition equal or better to that existing before the damage was done, or he shall make good the damage in another manner acceptable to the Engineer.
- B. All sidewalks which are disturbed by the Contractor's operations shall be restored to their original or better condition by the use of similar or comparable materials. All curbing shall be restored in a condition equal to the original construction and in accordance with the best modern practice.
- C. Along the location of this work, all fences, walks, bushes, trees, shrubbery and other physical features shall be protected and restored in a thoroughly workmanlike manner unless

otherwise shown on the drawings. Fences and other features removed by the Contractor shall be replaced in the location indicated by the Engineer as soon as conditions permit. All grass areas beyond the limits of construction which have been damaged by the Contractor shall be regraded and sodded to equal or exceed original conditions.

- D. Trees close to the work which drawings do not specify to be removed, shall be boxed or otherwise protected against injury. The Contractor shall trim all branches that are liable to damage because of his operations, but in no case shall any tree be cut or removed without prior notification to the Engineer. All injuries to bark, trunk, limbs and roots of trees shall be repaired by dressing, cutting and painting according to approved methods, using only approved tools and materials.
- E. The protection, removal and replacement of existing physical features along the line of work shall be a part of the work under the Contract and all costs in connection therewith shall be included in the unit and/or lump sum prices established under the items in the Bid.

1.09 MAINTENANCE OF TRAFFIC

- A. Open pits, trenches, unpaved streets, debris, or other obstructions due to construction that will prevent the normal flow of traffic during an extended construction stoppage, for any reason, shall be minimized. In the event an extended construction stoppage is found to be necessary, Contractor shall, at his own expense, provide normal traffic flow during extended construction stoppage. Extended stoppage will be defined by the Engineer.
- B. All excavated material shall be placed so that vehicular and pedestrian traffic may be maintained at all times. If the Contractor's operations cause traffic hazards, he shall repair the road surface, provide temporary roadways, erect wheel guards or fences, or take other safety measures which are satisfactory to the Engineer and Owner.
- C. Detours around construction areas will be subject to the approval of the Owner and the Engineer. Where detours are permitted, the contractor shall provide all necessary barricades and signs as required to divert the flow of traffic. While traffic is detoured, the Contractor shall expedite construction operations and periods when traffic is being detoured, will be strictly controlled by the Owner.

1.10 WATER FOR CONSTRUCTION PURPOSES

- A. In locations where public water supply is available, the Contractor may purchase water for all construction purposes.
- B. The Contractor shall be responsible for paying for all water tap fees incurred for the purpose of obtaining a potable water service or temporary use meter.

1.11 MAINTENANCE OF FLOW

The Contractor shall at his own cost, provide for the flow of sewers, drains and water courses interrupted during the progress of the work and shall immediately cart away and remove all offensive matter. The entire procedure of maintaining existing flow shall be fully discussed with the Engineer and Owner well in advance of the interruption of any flow.

1.12 CLEANUP

During the course of the work, the Contractor shall keep the site of his operations in as clean

and neat a condition as is possible. He shall dispose of all residue resulting from the construction work and at the conclusion of the work, he shall remove and haul away any surplus excavation, broken pavement, lumber, equipment, temporary structures and any other refuse remaining from the construction operations and shall leave the entire site of the work in a neat and orderly condition.

1.13 COOPERATION WITHIN THIS CONTRACT

- A. All firms or person authorized to perform any work under this Contract shall cooperate with the General Contractor and his subcontractors or trades and shall assist in incorporating the work of other trades where necessary or required.
- B. Cutting and patching, drilling and fitting shall be carried out where required by the trade or subcontractor having jurisdiction, unless otherwise indicated herein or directed by the Engineer.

1.14 PROTECTION OF CONSTRUCTION AND EQUIPMENT

- A. All newly constructed work shall be carefully protected from injury in any way. No wheeling or walking or placing of heavy loads on it shall be allowed and all portions injured shall be reconstructed by the Contractor at his own expense.
- B. All structures shall be protected in a manner approved by the Engineer. Should any of the floors or other parts of the structures become heaved, cracked, or otherwise damaged, all such damaged portions of the work shall be completely repaired and made good by the Contractor, at his own expense and to the satisfaction of the Engineer. If, in the final inspection of the work, any defects, faults, or omissions are found, the Contractor shall cause the same to be repaired or removed and replaced by proper materials and workmanship without extra compensation for the materials and labor required. Further, the Contractor shall be fully responsible for the satisfactory maintenance and repair of the construction and other work undertaken herein, for at least the warranty period described in the Contract.
- C. Further, the Contractor shall take all necessary precautions to prevent damage to any structure due to water pressure during and after construction and until such structure is accepted and taken over by the Owner.

1.15 CONSTRUCTION WITHIN RIGHT-OF-WAY

Where pipe lines are installed within FDOT right-of-way, all excavation backfill and compaction for the purpose of reconstructing roadways and/or adjacent slopes contiguous thereto shall be in accordance with FDOT or Manatee County Standards and Specifications, whichever is applicable. Contractor shall satisfy the authorized representative of the FDOT with respect to proper safety procedures, construction methods, required permitting, etc., within the FDOT right-of-way.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01030 SPECIAL PROJECT PROCEDURES

PART 1 GENERAL

1.01 PERMITS

Upon notice of award, the Contractor shall immediately apply for all applicable permits not previously obtained by the Owner to do the work from the appropriate governmental agency or agencies. No work shall commence until all applicable permits have been obtained and copies delivered to the Engineer. The costs for obtaining all permits shall be borne by the Contractor.

1.02 CONNECTIONS TO EXISTING SYSTEM

The Contractor shall perform all work necessary to locate, excavate and prepare for connections to the terminus of the existing systems all as shown on the Drawings or where directed by the Owner/Engineer. The cost for this work and for the actual connection to the existing systems shall be included in the price bid for the project and shall not result in any additional cost to the Owner. The termination point for each contract shall be as shown on the Contract Drawings.

1.03 RELOCATIONS

The Contractor shall be responsible for the coordination of the relocation of structures, including but not limited to light poles, power poles, signs, sign poles, fences, piping, conduits and drains that interfere with the positioning of the work as set out on the Drawings. No relocation of the items under this Contract shall be done without approval from the Engineer.

1.04 EXISTING UNDERGROUND PIPING, STRUCTURES AND UTILITIES

- A. The attention of the Contractor is drawn to the fact that during excavation, the possibility exists of the Contractor encountering various water, sewer, gas, telephone, electrical, or other utility lines not shown on the Drawings. The Contractor shall exercise extreme care before and during excavation to locate and flag these lines as to avoid damage to the existing lines. Cost for relocation of all existing lines shall be included in the price bid for the project. Should damage occur to an existing line, the Contractor shall bear the cost of all repairs.
- B. It is the responsibility of the Contractor to ensure that all utility or other poles, the stability of which may be endangered by the close proximity of excavation, are temporarily stayed in position while work proceeds in the vicinity of the pole and that the utility or other companies concerned be given reasonable advance notice of any such excavation by the Contractor.
- C. The existing utility locations are shown without express or implied representation, assurance, or guarantee that they are complete or correct or that they represent a true picture of underground piping to be encountered. The Contractor shall be responsible for notifying the various utility companies to locate their respective utilities in advance of construction in conformance with all requirements provided for in the Florida Underground Facilities Damage Prevention and Safety Act (Florida Statutes, Title XXXIII, Chapter 556).
- D. The existing piping and utilities that interfere with new construction shall be rerouted as shown, specified, or required. Before any piping and utilities not shown on the Drawings are disturbed, the Contractor shall notify the Engineer of the location of the pipeline or utility and

shall reroute or relocate the pipeline or utility as directed. Cost for relocation of existing pipelines or utilities shall be included in the price bid for the project.

- E. The Contractor shall exercise care in any excavation to locate all existing piping and utilities. All utilities which do not interfere with complete work shall be carefully protected against damage. Any existing utilities damaged in any way by the Contractor shall be restored or replaced by the Contractor at his expense as directed by the Engineer and/or the owner of the utility.
- F. It is intended that wherever existing utilities such as water, sewer, gas, telephone, electrical, or other service lines must be crossed, deflection of the pipe within recommended limits and cover shall be used to satisfactorily clear the obstruction unless otherwise indicated in the Drawings. However, when in the opinion of the Engineer this procedure is not feasible, he may direct the use of fittings for a utilities crossing as detailed on the Drawings. No deflections will be allowed in gravity sanitary sewer lines or in existing storm sewer lines.

1.05 SUSPENSION OF WORK DUE TO WEATHER

Refer to FDOT Standards and Specifications Book, Section 8.

1.06 HURRICANE PREPAREDNESS PLAN

- A. Within 30 days of the date of Notice to Proceed, the Contractor shall submit to the Engineer and Owner a Hurricane Preparedness Plan. The plan should outline the necessary measures which the Contractor proposes to perform at no additional cost to the Owner in case of a hurricane warning.
- B. In the event of inclement weather, or whenever Engineer shall direct, Contractor shall insure that he and his Subcontractors shall carefully protect work and materials against damage or injury from the weather. If, in the opinion of the Engineer, any portion of work or materials is damaged due to the failure on the part of the Contractor or Subcontractors to protect the work, such work and materials shall be removed and replaced at the expense of the Contractor.

1.07 POWER SUPPLY

Electricity as may be required for construction and permanent power supply shall be secured and purchased by the Contractor.

1.08 SALVAGE

Any existing equipment or material, including, but not limited to, valves, pipes, fittings, couplings, etc., which is removed or replaced as a result of construction under this project may be designated as salvage by the Engineer or Owner and if so shall be protected for a reasonable time until picked up by the Owner. Any equipment or material not worthy of salvaging, as directed by the Engineer, shall be disposed of by the Contractor at no additional cost.

1.09 DEWATERING

- A. The Contractor shall do all groundwater pumping necessary to prevent flotation of any part of the work during construction operations with his own equipment.

- B. The Contractor shall pump out water and wastewater which may seep or leak into the excavations for the duration of the Contract and with his own equipment. He shall dispose of this water in an appropriate manner.

1.10 ADDITIONAL PROVISIONS

- A. Before commencing work on any of the existing pipelines, structures or equipment, the Contractor shall notify the Engineer, in writing, at least 10 calendar days in advance of the date he proposes to commence such work.
- B. The Contractor shall provide, at his own expense, all necessary temporary facilities for access to and for protection of, all existing facilities. The Owner's personnel must have ready access at all times to the existing facilities. The Contractor is responsible for all damage to existing structures, equipment and facilities caused by his construction operations and must repair all such damage when and as ordered by the Engineer.

1.11 CONSTRUCTION CONDITIONS

The Contractor shall strictly adhere to the specific requirements of the governmental unit(s) and/or agency (ies) having jurisdiction over the work. Wherever there is a difference in the requirements of a jurisdictional body and these Specifications, the more stringent shall apply.

1.12 PUBLIC NUISANCE

- A. The Contractor shall not create a public nuisance including but not limited to encroachment on adjacent lands, flooding of adjacent lands, excessive noise or dust.
- B. Sound levels must meet Manatee County Ordinance #87-34, (which amends Ordinance 81-3, The Manatee County Noise Control Ordinance). Sound levels in excess of such ordinance are sufficient cause to have the work halted until equipment can be quieted to these levels. Work stoppage by the Engineer or County for excessive noise shall not relieve the Contractor of the other portions of this specification including, but not limited to contract time and contract price.
- C. No extra charge may be made for time lost due to work stoppage resulting from the creation of a public nuisance.

1.13 WARRANTIES

- A. All material supplied under these Specifications shall be warranted by the Contractor and the manufacturers for a period of three (3) years. Warranty period shall commence on the date of Owner acceptance.
- B. The material shall be warranted to be free from defects in workmanship, design and materials. If any part of the system should fail during the warranty period, it shall be replaced at no expense to the Owner.
- C. The manufacturer's warranty period shall run concurrently with the Contractor's warranty or guarantee period. No exception to this provision shall be allowed. The Contractor shall be responsible for obtaining warranties from each of the respective suppliers or manufacturers for all the material specified under these contract specifications,

- D. In the event that the manufacturer is unwilling to provide a three-year warranty commencing at the time of Owner acceptance, the Contractor shall obtain from the manufacturer a four (4) year warranty starting at the time of equipment delivery to the job site. This four-year warranty shall not relieve the Contractor of the three-year warranty starting at the time of Owner acceptance of the equipment.

1.14 FUEL STORAGE & FILLING

- A. If the contractor is storing fuel on site, or doing his own fuel filling of portable equipment (other than hand-held equipment), he is responsible for any required response, clean-up or reporting required, at no additional cost to the county.
- B. The Contractor shall prepare and submit a fuel storage / spill abatement plan prior to start of construction if required.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01045 CUTTING AND PATCHING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall be responsible for all cutting, fitting and patching, including excavation and backfill, required to complete the work or to:
 - 1. Make its several parts fit together properly.
 - 2. Uncover portions of the work to provide for installation of ill-timed work.
 - 3. Remove and replace defective work.
 - 4. Remove and replace work not conforming to requirements of Contract Documents.
 - 5. Provide penetrations of non-structural surfaces for installation of piping and electrical conduit.

PART 2 PRODUCTS

2.01 MATERIALS

Comply with specifications and standards for each specific product involved.

PART 3 EXECUTION

3.01 INSPECTION

- A. Inspect existing conditions of project, including elements subject to damage or to movement during cutting and patching.
- B. After uncovering work, inspect conditions affecting installation of products, or performance of work.
- C. Report unsatisfactory or questionable conditions to Engineer. Do not proceed with work until Engineer has provided further instructions.

3.02 PREPARATION

- A. Provide adequate temporary support as necessary to assure structural value to integrity of affected portion of work.
- B. Provide devices and methods to protect other portions of project from damage.
- C. Provide protection from elements for that portion of the project which may be exposed by cutting and patching work and maintain excavations free from water.

3.03 PERFORMANCE

- A. Execute cutting and demolition by methods which will prevent damage to other work and will provide proper surfaces to receive installation of repairs.
- B. Execute excavating and backfilling by methods which will prevent settlement or damage to other work.

- C. Fit and adjust products to provide a finished installation to comply with specified products, functions, tolerances and finishes.
- D. Restore work which has been cut or removed; install new products to provide completed work in accordance with the requirements of the Contract Documents.
- E. Replace surfaces airtight to pipes, sleeves, ducts, conduit and other penetrations through surfaces.
- F. Refinish entire surfaces as necessary to provide an even finish to match adjacent finishes.

END OF SECTION

SECTION 01050 FIELD ENGINEERING AND SURVEYING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall provide and pay for field surveying service required for the project.
- B. The Contractor shall furnish and set all necessary stakes to establish the lines and grades as shown on the Contract Drawings and layout each portion of the Work of the Contract.
 - 1. All survey work required in execution of Project.
 - 2. All costs of construction layout shall be included in the unit and lump sum prices contained in the respective divisions of the Contract Bid Form.
 - 3. Civil, structural or other professional engineering services specified or required to execute Contractor's construction methods.

1.02 QUALIFICATION OF SURVEYOR AND ENGINEER

All construction staking shall be conducted by or under the supervision of a Florida Registered Professional Surveyor and Mapper approved by the Owner. The Contractor shall be responsible for the layout of all such lines and grades, which will be subject to verification by the Engineer.

1.03 SURVEY REFERENCE POINTS

- A. Existing basic horizontal and vertical control points for the Project are designated on the Contract Drawings.
- B. Locate and protect all survey monumentation, property corners and project control points prior to starting work and preserve all permanent reference points during construction. All costs associated with the replacement of all survey monumentation, property corners and project control points shall be borne by the Contractor.

Make no changes or relocations without prior written notice to Engineer.

Report to Engineer when any reference point is lost or destroyed, or requires relocation because of necessary changes in grades or locations.

Require surveyor to replace project control points which may be lost or destroyed.

Establish replacements based on original survey control.

1.04 PROJECT SURVEY REQUIREMENTS

The Contractor shall establish temporary bench marks as needed, referenced to data established by survey control points.

1.05 RECORDS

Maintain a complete, accurate log of all control and survey work as it progresses.

The Contractor shall employ a Professional Engineer or Surveyor registered in the State of Florida to verify survey data and properly prepare record drawings per Section 01720.

1.06 SUBMITTALS

- A. Submit name and address of Professional Surveyor and Mapper to Engineer for Owner's approval.
- B. Submit certificate signed by the Professional Surveyor and Mapper certifying that elevations and locations of improvements are in conformance, or nonconformance, with Contract Documents.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01090 REFERENCE STANDARDS

PART 1 GENERAL

1.01 REQUIREMENTS

Abbreviations and acronyms used in Contract Documents to identify reference standards.

- A. Application: When a standard is specified by reference, comply with requirements and recommendations stated in that standard, except when requirements are modified by the Contract Documents, or applicable codes established stricter standards.
- B. Publication Date: The most recent publication in effect on the date of issue of Contract Documents, except when a specific publication date is specified.

1.03 ABBREVIATIONS, NAMES AND ADDRESSES OR ORGANIZATIONS

Obtain copies of reference standards direct from publication source, when needed for proper performance of work, or when required for submittal by Contract Documents.

AA	Aluminum Association 818 Connecticut Avenue, N.W. Washington, DC 20006
AASHTO	American Association of State Highway and Transportation Officials 444 North Capital Street, N.W. Washington, DC 20001
ACI	American Concrete Institute Box 19150 Reford Station Detroit, MI 48219
AI	Asphalt Institute Asphalt Institute Building College Park, MD 20740
AISC	American Institute of Steel Construction 1221 Avenue of the Americas New York, NY 10020
AISI	American Iron and Steel Institute 1000 16th Street NW Washington, DC 20036
ANSI	American National Standards Institute 1430 Broadway New York, NY 10018
ASHRAE	American Society of Heating, Refrigerating and Air Conditioning Engineers 179I Tullie Circle, N.E. Atlanta, GA 30329

ASME	American Society of Mechanical Engineers 345 East 47th Street New York, NY 10017
ASTM	American Society for Testing and Materials 1916 Race Street Philadelphia, PA 19103
AWWA	American Water Works Association 6666 West Quincy Avenue Denver, CO 80235
AWS	American Welding Society 2501 N.W. 7th Street Miami, FL 33125
CRSI	Concrete Reinforcing Steel Institute 180 North LaSalle Street, Suite 2110 Chicago, IL 60601
FDEP	Florida Department of Environmental Protection 3900 Commonwealth Blvd. Tallahassee, Florida 32399
FDOT	Florida Department of Transportation Standards Specifications for Road and Bridge Construction Maps & Publication Sales - Mail Station 12 605 Suwannee St. Tallahassee, FL 32399-0450
FS	Federal Specification General Services Administration Specifications and Consumer Information Distribution Section (WFSIS) Washington Navy Yard, Bldg. 197 Washington, DC 20407
MCUOD	Manatee County Utility Operations Department 4410 66th St. W. Bradenton, FL 34210
MLSFA	Metal Lath/Steel Framing Association 221 North LaSalle Street Chicago, IL 60601
MMA	Monorail Manufacturer's Association 1326 Freeport Road Pittsburgh, PA 15238
NAAMM	National Association of Architectural Metal Manufacturers 221 North LaSalle Street Chicago, IL 60601
NEMA	National Electrical Manufacturer's Assoc.

2101 L Street N.W.
Washington, DC 20037

OHSA Occupational Safety and Health Assoc.
5807 Breckenridge Pkwy., Suite A
Tampa, FL 33610-4249

PCA Portland Cement Association
5420 Old Orchard Road
Skokie, IL 20076

PCI Prestressed Concrete Institute
20 North Wacker Drive
Chicago, IL 60606

SDI Steel Door Institute
712 Lakewood Center North
Cleveland, OH 44107

SMACNA Sheet Metal and Air Conditioning Contractor's National Association
8224 Old Court House Road
Vienna, VA 22180

SSPC Steel Structures Painting Council
402 24th Street, Suite 600
Pittsburgh, PA 15213

SWFWMD Southwest Florida Water Management District
2379 Broad Street
Brooksville, FL 34604-6899

UL Underwriter's Laboratories, Inc.
333 Pfingston Road
Northbrook, IL 60062

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01150 MEASUREMENT AND PAYMENT

PART 1 GENERAL

1.01 SCOPE

- A. The scope of this section of the Contract Documents is to further define the items included in each Bid Item in the Bid Form section of the Contract Documents. Payment will be made based on the specified items included in the description in this section for each bid item.
- B. All contract prices included in the Bid Form section will be full compensation for all shop drawings, working drawings, labor, materials, tools, equipment and incidentals necessary to complete the construction as shown on the Drawings and/or as specified in the Contract Documents to be performed under this Contract. Actual quantities of each item bid on a unit price basis will be determined upon completion of the construction in the manner set up for each item in this section of the Specifications. Payment for all items listed in the Bid Form will constitute full compensation for all work shown and/or specified to be performed under this Contract.

1.02 ESTIMATED QUANTITIES

The quantities shown are approximate and are given only as a basis of calculation upon which the award of the Contract is to be made. The Owner/Engineer does not assume any responsibility for the final quantities, nor shall the Contractor claim misunderstanding because of such estimate of quantities. Final payment will be made only for satisfactorily completed quantity of each item.

1.03 WORK OUTSIDE AUTHORIZED LIMITS

No payment will be made for work constructed outside the authorized limits of work.

1.04 MEASUREMENT STANDARDS

Unless otherwise specified for the particular items involved, all measurements of distance shall be taken horizontally or vertically.

1.05 AREA MEASUREMENTS

In the measurement of items to be paid for on the basis of area of finished work, the lengths and/or widths to be used in the calculations shall be the final dimensions measured along the surface of the completed work within the neat lines shown or designated.

1.06 LUMP SUM ITEMS

Where payment for items is shown to be paid for on a lump sum basis, no separate payment will be made for any item of work required to complete the lump sum items. Lump sum contracts shall be complete, tested and fully operable prior to request for final payment. Contractor may be required to provide a break-down of the lump sum totals.

1.07 UNIT PRICE ITEM

Separate payment will be made for the items of work described herein and listed on the Bid Form. Any related work not specifically listed, but required for satisfactory completion of the work shall be considered to be included in the scope of the appropriate listed work items.

No separate payment will be made for the following items and the cost of such work shall be included in the applicable pay items of work. Final payments shall not be requested by the Contractor or made by the Owner until as-built (record) drawings have been submitted and approved by the Engineer.

1. Shop Drawings, Working Drawings.
2. Clearing, grubbing and grading except as hereinafter specified.
3. Trench excavation, including necessary pavement removal and rock removal, except as otherwise specified.
4. Dewatering and disposal of surplus water.
5. Structural fill, backfill, and grading.
6. Replacement of unpaved roadways, and shrubbery plots.
7. Cleanup and miscellaneous work.
8. Foundation and borrow materials, except as hereinafter specified.
9. Testing and placing system in operation.
10. Any material and equipment required to be installed and utilized for the tests.
11. Pipe, structures, pavement replacement, asphalt and shell driveways and/or appurtenances included within the limits of lump sum work, unless otherwise shown.
12. Maintaining the existing quality of service during construction.
13. Maintaining or detouring of traffic.
14. Appurtenant work as required for a complete and operable system.
15. Seeding and hydromulching.
16. As-built Record Drawings.

PART 2 BID ITEMS

2.01 BID ITEM NO. 1: PLUG INFLUENT LINE

Payment for all work included in this Bid Item shall be made at the applicable Contract price bid for furnishing and installing for temporary plugging of the influent gravity line, in accordance with these specifications.

2.02 BID ITEM NO. 2: BY-PASS PUMPING

Payment for all work included in this Bid Item shall be made at the applicable Contract price bid for furnishing and installing the necessary by-pass pumping including, but not limited to, pumps, back-up pumps, pipe, temporary lines, vacuum trucks, specialized equipment, on-site monitoring, all requirements of the approved pumping plan, and other items implied, but not shown on the Contract Drawings and listed on the Bid Form. Payment shall also include full payment for appurtenances, including, but not limited to, barricades, fasteners, needed anchors, or other methods or restraint needed to secure the equipment and piping.

2.03 BID ITEM NO. 3: WET WELL SPRAY LINER SYSTEM

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price at the completion of spray lining the wet well as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation for all labor, materials and equipment required to perform all of the work for spray Lining the wet well as shown on the Contract Drawings and listed on the Bid Form.

2.04 BID ITEM NO. 4: WET WELL FIBERGLASS LINER SYSTEM

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price

at the completion of installation of the fiberglass wet well liner as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation for all labor, materials and equipment required to perform all of the work for installation of the fiberglass wet well liner as shown on the Contract Drawings and listed on the Bid Form.

2.05 BID ITEM NO. 5: CONCRETE WET WELL TOP W/ ALUMINIUM HATCH

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price at the completion of installation of the concrete wet well top w/ aluminum hatch as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation for all labor, materials and equipment required to perform all of the work for installation of the concrete wet well top w/ aluminum hatch as shown on the Contract Drawings and listed on the Bid Form.

2.06 BID ITEM NO. 6: REMOVE DISCHARGE PIPING, BRACING, VALVES, ETC.

Payment for all work included under this Bid Item shall be made at the Contract price bid as lump sum for removing and disposing of all existing piping, base ells, bracing, pump rails, valves, fittings, etc. as shown on the Contract Drawings and listed in the Bid Documents. Manatee County shall have the option to pick up at the site, any removed valve or fitting for possible reuse. The Contractor shall be responsible for proper disposal of all removed materials not picked up by the Utility Operations Department, in accordance with these specifications.

2.07 BID ITEM NO. 7: 6" PVC STILLING WELL

Payment for all work included under this Bid Item shall be made at the Contract unit price bid for each 6" PVC stilling well furnished and installed as shown on the Contract Drawings and listed in the Bid Documents, all in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.08 BID ITEM NO. 8: PIPE BRACING SYSTEM

Payment for all work included under this Bid Item shall be made at the Contract price bid for each pipe bracing system furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, installation of stainless steel pipe bracing systems in each lift station in conformance with these specifications. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.09 BID ITEM NO. 09: PUMP GUIDE RAIL SYSTEM

Payment for all work under this Bid Item shall be made at the Contract unit price bid for each complete pump guide rail system furnished and installed at each lift station, in accordance with these Specifications, as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation including repair the concrete, drill & install anchor bolts, etc.

2.10 BID ITEM NO. 10: 4" PUMP BASE ELLS & BASE PLATES

Payment for all work included under this Bid Item shall be made at the Contract unit price bid for each pump base ell and its associated base plate, furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include all other items, materials and incidentals necessary to complete this bid item, ready for approval and acceptance by the Engineer/Owner.

2.11 BID ITEM NO. 10: 6" PUMP BASE ELLS & BASE PLATES

Payment for all work included under this Bid Item shall be made at the Contract unit price bid for each pump base ell and its associated base plate, furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include all other items, materials and incidentals necessary to complete this bid item, ready for approval and acceptance by the Engineer/Owner.

2.12 BID ITEM NO. 12: DUCTILE IRON FITTINGS

Payment for all work included in these Bid Items will be made at the applicable Contract unit price bid for furnishing and installing ductile iron fitting (epoxy lined) as shown on the Contract Drawings and including, but is not limited to, spool pieces, elbows, cross, tee, adapters, couplings, flanges, gaskets, bolts, etc. Payment will be made for each complete fitting installed and will represent full compensation for all labor, material, support, bracing, testing and equipment required to complete these Bid Items.

2.13 BID ITEM NO. 13: 4" HDPE DISCHARGE PIPING SYSTEM

Payment for all work included under this Bid Item shall be made at the Contract unit price bid for each complete discharge piping system furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The discharge piping system includes shop and/or factory fabricated HDPE systems. The bid price shall include, but is not limited to, adapters, couplings, flanges, gaskets, bolts, fused fittings, etc.; and shall include all other items, materials and incidentals necessary to complete this bid item, in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner.

2.14 BID ITEM NO. 14: 6" HDPE DISCHARGE PIPING SYSTEM

Payment for all work included under this Bid Item shall be made at the Contract unit price bid for each complete discharge piping system furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The discharge piping system includes shop and/or factory fabricated HDPE systems. The bid price shall include, but is not limited to, adapters, couplings, flanges, gaskets, bolts, fused fittings, etc.; and shall include all other items, materials and incidentals necessary to complete this bid item, in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner.

2.15 BID ITEM NO. 15: 6" PVC WET WELL VENTILATION PIPE.

Payment for all work included in this Bid Item shall be made at the Contract unit price bid for each PVC wet well ventilation pipe furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, replacement of the existing ventilation pipe with new PVC and stainless steel screening in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.16 BID ITEM NO. 16: 4" SWING CHECK VALVES

Payment for all work included in this Bid Item shall be made at the Contract unit price bid for each 4" check valve furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, replacement of the existing check valves with new 4" iron bodied flanged check valves, in accordance with these Specifications,

ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.17 BID ITEM NO. 17: 6" SWING CHECK VALVES

Payment for all work included in this Bid Item shall be made at the Contract unit price bid for each 6" check valve furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, replacement of the existing check valves with new 6" iron bodied flanged check valves, in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.18 BID ITEM NO. 18: 4" GATE VALVES

Payment for all work included in this Bid Item shall be made at the Contract unit price bid for each 4" gate valve furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, replacement of the existing gate valves with new 4" iron bodied flanged gate valves in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.19 BID ITEM NO. 19: 6" GATE VALVES

Payment for all work included in this Bid Item shall be made at the Contract unit price bid for each 6" gate valve furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, replacement of the existing gate valves with new 6" iron bodied flanged gate valves in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.20 BID ITEM NO. 20: 6" PLUG VALVES

Payment for all work included in this Bid Item shall be made at the Contract unit price bid for each 6" plug valve furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, replacement of the existing gate valves with new 6" iron bodied flanged plug valves in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.21 BID ITEM NO. 21: 8" PLUG VALVES

Payment for all work included in this Bid Item shall be made at the Contract unit price bid for each 8" plug valve furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, replacement of the existing gate valves with new 8" iron bodied flanged plug valves in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.22 BID ITEM NO. 22: 10" PLUG VALVES

Payment for all work included in this Bid Item shall be made at the Contract unit price bid for each 10" plug valve furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, replacement of the existing gate

valves with new 10" iron bodied flanged plug valves in accordance with these Specifications, ready for approval and acceptance by the Engineer/Owner. The bid price shall include, but is not limited to, all other items, materials and incidentals to complete the installation.

2.23 BID ITEM NO. 23: 3" PVC DRAIN

Payment for all work included in this Bid Item shall be made at the Contract unit price bid lump sum for removing and disposing of the existing floor drain casting and grout filling the existing line and floor depression in the valve vault. This item also includes rotary core boring new holes in the valve vault and wet well, installation of a new PVC drain line, and proper sealing of the holes and sealing the new line to the wet well liner. The Contractor shall be responsible for proper disposal of all removed materials and safety / confined space practices, in accordance with these specifications

2.24 BID ITEM NO. 24: STAINLESS STEEL ADJUSTIBLE PIPE SUPPORTS

Payment for all work included in this Bid Item will be made at the applicable Contract unit price bid for furnishing and installing a complete SS adjustable pipe support assembly, including mounting, adjusting, and all required hardware as shown on the Contract Drawings. Payment will be made for each complete installation and will represent full compensation for all labor, material, support, bracing, testing and equipment required to complete this Bid Item.

2.25 BID ITEM NO. 25: 6" QUICK DISCONNECT

Payment for all work included in this Bid Item will be made at the applicable Contract unit price bid for furnishing and installing a complete 6" Quick Connect assembly, including installation and testing, and adjusting as shown on the Contract Drawings. Payment will be made for each complete installation and will represent full compensation for all labor, material, support, bracing, testing and equipment required to complete this Bid Item.

2.26 BID ITEM NO. 26: UNDERGROUND CONDUIT

Payment for all work included under this Bid Item shall be made at the Contract price bid per foot of conduit furnished and installed as shown on the Contract Drawings and listed in the Bid Documents. The bid price shall include, but is not limited to, hand digging the trench, backfill, all other items, materials and incidentals to complete the installation.

2.27 BID ITEM NO. 27 - DOUBLE CHECK BACKFLOW PREVENTER

Payment for all work included in this Bid Item will be made at the applicable Contract unit price bid for furnishing and installing a complete Double Check Backflow Preventer assembly, including installation and testing, and adjusting as shown on the Contract Drawings. Payment will be made for each complete installation and will represent full compensation for all labor, material, support, bracing, testing and equipment required to complete this Bid Item.

2.28 BID ITEM 28 - RELOCATE WATER SERVICES

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price bid for each service type for furnishing and installing the listed 1 water service lines, both short and long side, as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation for all labor, material, excavation, including rock, bedding, backfill, compaction, testing and disinfection and equipment required to complete these Bid Items.

2.29 BID ITEM NO. 29: DRAIN DOWN, CLEAN WET WELL

Payment for all work included in this Bid Item shall be made at the Contract unit price bid lump sum for draining down and cleaning the wet well prior to working in the wet well. The Contractor shall be responsible for proper disposal of all removed materials and safety / confined space practices, in accordance with these specifications.

2.30 BID ITEM NO. 30 & 30a: CONCRETE WET WELL and VALVE VAULT SECTIONS

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price at the completion of installation of the pre-cast type II reinforced concrete sections as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation for all labor, materials and equipment required to perform all of the work for installation of the pre-cast type II reinforced concrete sections as shown on the Contract Drawings and listed on the Bid Form, including demolition, top slab removal/replacement, caulking, etc.

2.31 BID ITEM NO. 31: MOBILIZATION

Measurement and payment for this Bid Item shall include full compensation for the required 100 percent (100%) Performance Bond, 100 Percent (100%) Payment Bond, all required insurance for the project and the Contractor's mobilization and demobilization costs as shown in the Bid Form.

Payment for mobilization shall not exceed 10 percent (10%) of the total Contract cost unless the Contractor can prove to the Owner that his actual mobilization cost exceeds 10 percent (10%).

2.32 BID ITEM NO. 32: MISCELLANEOUS WORK AND CLEANUP

Payment for all work included under this Bid Item shall be made at the Contract lump sum price bid listed in the Bid Form and shall represent full compensation for all labor, materials and equipment required to perform all the work as shown on the Contract Drawings and specified herein and any other miscellaneous work not specifically included for payment under other Bid Items obviously necessary to complete the Contract. Partial payments will be based on the breakdown of the Bid Item in accordance with the Schedule of Values submitted by the Contractor and approved by the Engineer. Payment shall also include full compensation for project photographs, as-built record drawings, project signs, stormwater and erosion control devices, well pointing, rubbish and spoil removal, sodding, asphalt pavement repair, replacement, repair, or relocation of all signs, walls, gates, fences and any and all other items required to complete the project in accordance with Contract Documents.

2.33 BID ITEM NO. 33: DISCRETIONARY

Payment for all work under this Bid Item and listed in the Bid Form shall be made only at the Owner's discretion in order to satisfactorily complete the project in accordance with the Plans and Specifications

2.33a BID ITEM NO. 33a: DISCRETIONARY - STONE AND SHELL WORK

Payment for all work included under this Bid Item shall be made at the applicable contract unit price bid per complete installation. This includes the material, equipment and labor to provide and place stone or shell as required. This is a discretionary item.

2.33b BID ITEM NO. 33b: DISCRETIONARY - FENCE WORK

Payment for all work included under this Bid Item shall be made at the applicable contract unit price bid per complete installation. This includes the material, equipment and labor to properly construct fence per the specifications, including all line, gate, and corner posts, top rails, hardware, etc. This is a discretionary item.

2.33c BID ITEM NO. 33c: DISCRETIONARY - FENCE GATE

Payment for all work included under this Bid Item shall be made at the applicable contract unit price bid per complete installation. This includes the material, equipment and labor to apply or place materials as required. This is a discretionary item.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01152 REQUESTS FOR PAYMENT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Submit Applications for Payment to the Project Manager or as directed at the preconstruction meeting, in accordance with the schedule established by Conditions of the Contract and Agreement between Owner and Contractor.

1.02 FORMAT AND DATA REQUIRED

- A. Submit payment requests in the form provided by the Owner with itemized data typed in accordance with the Bid Form.
- B. Provide construction photographs in accordance with Contract Documents.

1.03 SUBSTANTIATING DATA FOR PROGRESS PAYMENTS

- A. When the Owner or the Engineer requires substantiating data, Contractor shall submit suitable information with a cover letter.
- B. Submit one copy of data and cover letter for each copy of application.

1.04 PREPARATION OF APPLICATION FOR FINAL PAYMENT

Fill in application form as specified for progress payments.

1.05 SUBMITTAL PROCEDURE

- A. Submit applications for payment at the times stipulated in the Agreement.
- B. Number: Three (3) copies of each application; all signed and certified by the Contractor.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01153 CHANGE ORDER PROCEDURES

PART 1 GENERAL

1.01 DEFINITION

- A. Change Order: Major change in contract scope or time that must be approved by the Board.
- B. Administrative Change Adjustment: Minor change order under 10% of project cost or 20% time, does not have to be Board approved.
- C. Field Directive Change: Change to contract quantity that does not require a change of scope or time extension.

1.02 REQUIREMENTS INCLUDED

- A. The Contractor shall promptly implement change order procedures:
 - 1. Provide full written data required to evaluate changes.
 - 2. Maintain detailed records of work done on a time-and-material/force account basis.
 - 3. Provide full documentation to Engineer on request.
- B. The Contractor shall designate a member of the Contractor's organization who:
 - 1. Is authorized to accept changes to the Work.
 - 2. Is responsible for informing others in the Contractor's employ of the authorized changes into the Work.
- C. The Board of County Commissioners executes all Change Orders.

1.03 PRELIMINARY PROCEDURES

- A. Project Manager may initiate changes by submitting a Request to Contractor. Request will include:
 - 1. Detailed description of the change, products, costs and location of the change in the Project.
 - 2. Supplementary or revised Drawings and Specifications.
 - 3. The projected time extension for making the change.
 - 4. A specified period of time during which the requested price will be considered valid.
 - 5. Such request is for information only and is not an instruction to execute the changes, nor to stop work in progress.
- B. Contractor may initiate changes by submitting a written notice to the Project Manager, containing:
 - 1. Description of the proposed changes.
 - 2. Statement of the reason for making the changes.
 - 3. Statement of the effect on the Contract Sum and the Contract Time.
 - 4. Statement of the effect on the work of separate contractors.
 - 5. Documentation supporting any change in Contract Sum or Contract Time, as appropriate.

1.04 FIELD DIRECTIVE CHANGE

- A. In lieu of a Change Order, the Project Manager may issue a Field Directive change for the Contractor to proceed with additional work within the original intent of the Project.
- B. Field Directive change will describe changes in the work, with attachments of backup information to define details of the change.
- C. Contractor must sign and date the Field Directive change to indicate agreement with the terms therein.

1.05 DOCUMENTATION OF PROPOSALS AND CLAIMS

- A. Support each quotation for a lump sum proposal and for each unit price which has not previously been established, with sufficient substantiating data to allow the Engineer/Owner to evaluate the quotation.
- B. On request, provide additional data to support time and cost computations:
 - 1. Labor required.
 - 2. Equipment required.
 - 3. Products required.
 - a. Recommended source of purchase and unit cost.
 - b. Quantities required.
 - 4. Taxes, insurance and bonds.
 - 5. Credit for work deleted from Contract, similarly documented.
 - 6. Overhead and profit.
 - 7. Justification for any change in Contract Time.
- C. Support each claim for additional costs and for work done on a time-and-material/force account basis, with documentation as required for a lump-sum proposal, plus additional information.
 - 1. Name of the Owner's authorized agent who ordered the work and date of the order.
 - 2. Date and time work was performed and by whom.
 - 3. Time record, summary of hours work and hourly rates paid.
 - 4. Receipts and invoices for:
 - a. Equipment used, listing dates and time of use.
 - b. Products used, listing of quantities.
 - c. Subcontracts.

1.06 PREPARATION OF CHANGE ORDERS

- A. Project Manager will prepare each Change Order.
- B. Change Order will describe changes in the Work, both additions and deletions, with attachments as necessary to define details of the change.
- C. Change Order will provide an accounting of the adjustment in the Contract Sum and in the Contract Time.

1.07 LUMP SUM/FIXED PRICE CHANGE ORDER

- A. Project Manager initiates the form, including a description of the changes involved and attachments based upon documents and proposals submitted by the Contractor, or requests from the Owner, or both.
- B. Once the form has been completed, all copies should be sent to Contractor for approval. After approval by Contractor, all copies should be sent to Owner for approval. The Owner will distribute executed copies after approval by the Board of County Commissioners.

1.08 UNIT PRICE CHANGE ORDER

- A. Contents of Change Orders will be based on, either:
 - 1. Owner's definition of the scope of the required changes.
 - 2. Contractor's Proposal for a change, as approved by the Owner.
 - 3. Survey of completed work.
- B. The amounts of the unit prices to be:
 - 1. Those stated in the Agreement.
 - 2. Those mutually agreed upon between Owner and Contractor.

1.09 TIME AND MATERIAL/FORCE ACCOUNT CHANGE ORDER/CONSTRUCTION CHANGE AUTHORIZATION

- A. At completion of the change, Contractor shall submit itemized accounting and supporting data as provided in the Article "Documentation of Proposals and Claims" of this Section.
- B. Engineer will determine the allowable cost of such work, as provided in General Conditions and Supplementary Conditions.
- C. Engineer will sign and date the Change Order to establish the change in Contract Sum and in Contract Time.
- D. Owner and Contractor will sign and date the Change Order to indicate their agreement therewith.

1.10 CORRELATION WITH CONTRACTOR'S SUBMITTALS

- A. Periodically revise Schedule of Values and Application for Payment forms to record each change as a separate item of work, and to record the adjusted Contract Sum.
- B. Periodically revise the Construction Schedule to reflect each change in Contract Time. Revise sub schedules to show changes for other items of work affected by the changes.
- C. Upon completion of work under a Change Order, enter pertinent changes in Record Documents.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01200 PROJECT MEETINGS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Owner or Engineer shall schedule the pre-construction meeting, periodic progress meetings and special meetings, if required, throughout progress of work.
- B. Representatives of contractors, subcontractors and suppliers attending meetings shall be qualified and authorized to act on behalf of the entity each represents.
- C. The Contractor shall attend meetings to ascertain that work is expedited consistent with Contract Documents and construction schedules.

1.02 PRE-CONSTRUCTION MEETING

A. Attendance:

- 1. Owner's Engineer.
- 2. Owner's Project Manager
- 3. Contractor.
- 4. Resident Project Representative.
- 5. Related Labor Contractor's Superintendent.
- 6. Major Subcontractors.
- 7. Major Suppliers.
- 8. Others as appropriate.

B. Suggested Agenda:

- 1. Distribution and discussion of:
 - a. List of major subcontractors.
 - b. Projected Construction Schedules.
 - c. Coordination of Utilities
- 2. Critical work sequencing.
- 3. Project Coordination.
 - a. Designation of responsible personnel.
 - b. Emergency contact persons with phone numbers.
- 4. Procedures and processing of:
 - a. Field decisions.
 - b. Submittals.
 - c. Change Orders.
 - d. Applications for Payment.
- 5. Procedures for maintaining Record Documents.
- 6. Use of premises:
 - a. Office, work and storage areas.
 - b. Owner's REQUIREMENTS.
- 7. Temporary utilities.
- 8. Housekeeping procedures.
- 9. Liquidated damages.
- 10. Equal Opportunity Requirements.
- 11. Laboratory testing.
- 12. Project / Job meetings: Progress meeting, other special topics as needed.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01310 CONSTRUCTION SCHEDULE & PROJECT RESTRAINTS

PART 1 GENERAL

1.01 GENERAL

- A. Construction under this contract must be coordinated with the Owner and accomplished in a logical order to maintain utilization and flow through existing facilities and public properties and rights-of-way and to allow construction to be completed within the time allowed by Contract Documents and in the manner set forth in the Contract.

1.02 CONSTRUCTION SCHEDULING GENERAL PROVISIONS

- A. No work shall be done between 7:00 p.m. and 7:00 a.m. nor on weekends or legal holidays without written permission of the Owner. However, emergency work may be done without prior permission.
- B. Night work may be established by the Contractor as regular procedure with the written permission of the Owner. Such permission, however, may be revoked at any time by the Owner if the Contractor fails to maintain adequate equipment and supervision for the proper execution and control of the work at night.
- C. Due to potential health hazards and requirements of the State of Florida and the U.S. Environmental Protection Agency, existing facilities must be maintained in operation.
- D. The Contractor shall be fully responsible for providing all temporary piping, plumbing, electrical hook-ups, lighting, temporary structure, or other materials, equipment and systems required to maintain the existing facility's operations. All details of temporary piping and temporary construction are not necessarily shown on the Drawings or covered in the Specifications. However, this does not relieve the Contractor of the responsibility to insure that construction will not interrupt proper facility operations.
- E. The Contractor shall designate an authorized representative of his firm who shall be responsible for development and maintenance of the schedule and of progress and payment reports. This representative of the Contractor shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the commitments of the Contractor's schedule.

1.03 PROGRESS OF THE WORK

The work shall be executed with such progress as may be required to prevent any delay to the general completion of the work. The work shall be executed at such times and in or on such parts of the project and with such forces, materials and equipment to assure completion of the work in the time established by the Contract and in the manner set forth in the Contract.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. The Contractor shall submit a critical path schedule as described herein.
- B. The planning, scheduling, management and execution of the work is the sole responsibility of

the Contractor. The progress schedule requirement is established to allow Engineer to review Contractor's planning, scheduling, management and execution of the work; to assist Engineer in evaluating work progress and make progress payments and to allow other contractors to cooperate and coordinate their activities with those of the Contractor.

2.02 FORM OF SCHEDULES

- A. Prepare schedules using the latest version of Microsoft Project, or other Owner approved software, in the form of a horizontal bar chart diagram. The diagram shall be time-scaled and sequenced by work areas. Horizontal time scale shall identify the first work day of each week.
- B. Activities shall be at least as detailed as the Schedule of Values. Activity durations shall be in whole working days. In addition, man-days shall be shown for each activity or tabulated in an accompanying report.
- C. Diagrams shall be neat and legible and submitted on sheets at least 8-1/2 inches by 11 inches suitable for reproduction. Scale and spacing shall allow space for notations and future revisions.

2.03 CONTENT OF SCHEDULES

- A. Each monthly schedule shall be based on data as of the last day of the current pay period.
- B. Description for each activity shall be brief, but convey the scope of work described.
- C. Activities shall identify all items of work that must be accomplished to achieve substantial completion, such as items pertaining to Contractor's installation and testing activities; items pertaining to the approval of regulatory agencies; contractor's time required for submittals, fabrication and deliveries; the time required by Engineer to review all submittals as set forth in the Contract Documents; items of work required of Owner to support pre-operational, startup and final testing; time required for the relocation of utilities. Activities shall also identify interface milestones with the work of other contractors performing work under separate contracts with Owner.
- D. Schedules shall show the complete sequence of construction by activities. Dates for beginning and completion of each activity shall be indicated as well as projected percentage of completion for each activity as of the first day of each month.
- E. Submittal schedule for shop drawing review, product data, and samples shall show the date of Contractor submittal and the date approved submittals will be required by the Engineer, consistent with the time frames established in the Specifications.
- F. For Contract change orders granting time extensions, the impact on the Contract date(s) shall equal the calendar-day total time extension specified for the applicable work in the Contract change orders.
- G. For actual delays, add activities prior to each delayed activity on the appropriate critical path(s). Data on the added activities of this type shall portray all steps leading to the delay and shall further include the following: separate activity identification, activity description indicating cause of the delay, activity duration consistent with whichever set of dates below applies, the actual start and finish dates of the delay or, if the delay is not finished, the actual start date and estimated completion date.

- H. For potential delays, add an activity prior to each potentially delayed activity on the appropriate critical path(s). Data for added activities of this type shall include alternatives available to mitigate the delay including acceleration alternatives and further show the following: separate activity identification, activity description indicating cause of the potential delay and activity duration equal to zero work days.

2.04 SUPPORTING NARRATIVE

- A. Status and scheduling reports identified below shall contain a narrative to document the project status, to explain the basis of Contractor's determination of durations, describe the Contract conditions and restraints incorporated into the schedule and provide an analysis pertaining to potential problems and practical steps to mitigate them.
- B. The narrative shall specifically include:
 - 1. Actual completion dates for activities completed during the monthly report period and actual start dates for activities commenced during the monthly report period.
 - 2. Anticipated start dates for activities scheduled to commence during the following monthly report period.
 - 3. Changes in the duration of any activity and minor logic changes.
 - 4. The progress along the critical path in terms of days ahead or behind the Contract date.
 - 5. If the Monthly Status Report indicates an avoidable delay to the Contract completion date or interim completion dates as specified in the Agreement, Contractor shall identify the problem, cause and the activities affected and provide an explanation of the proposed corrective action to meet the milestone dates involved or to mitigate further delays.
 - 6. If the delay is thought to be unavoidable, the Contractor shall identify the problem, cause, duration, specific activities affected and restraints of each activity.
 - 7. The narrative shall also discuss all change order activities whether included or not in the revised/current schedule of legal status. Newly introduced change order work activities and the CPM path(s) that they affect, must be specifically identified. All change order work activities added to the schedule shall conform with the sequencing and Contract Time requirements of the applicable Change Order.
 - 8. Original Contract date(s) shall not be changed except by Contract change order. A revision need not be submitted when the foregoing situations arise unless required by Engineer. Review of a report containing added activities will not be construed to be concurrence with the duration or restraints for such added activities; instead the corresponding data as ultimately incorporated into the applicable Contract change order shall govern.
 - 9. Should Engineer require additional data, this information shall be supplied by Contractor within 10 calendar days.

2.05 SUBMITTALS

- A. Contractor shall submit estimated and preliminary progress schedules (as identified in the Terms and Conditions of the Contract and the General Conditions), monthly status reports, a start-up schedule and an as-built schedule report all as specified herein.
- B. All schedules, including estimated and preliminary schedules, shall be in conformance with the Contract Documents.

- C. The finalized progress schedule discussed in the Contract Documents shall be the first monthly status report and as such shall be in conformance with all applicable specifications contained herein.
- D. Monthly Status Report submittals shall include three copies of a time-scaled (days after notice to proceed) diagram showing all contract activities and supporting narrative. The initial detailed schedule shall use the notice to proceed as the start date. The finalized schedule, if concurred with by Owner, shall be the work plan to be used by the contractor for planning, scheduling, managing and executing the work.
- E. The schedule diagram shall be formatted as above. The diagram shall include (1) all detailed activities included in the preliminary and estimated schedule submittals, (2) calendar days prior to substantial completion, (3) summary activities for the remaining days. The critical path activities shall be identified, including critical paths for interim dates, if possible.
- F. The Contractor shall submit monthly progress schedules with each month's application for payment.
- G. Contractor shall submit three monthly status reports which will be retained by the Owner and Engineer.

2.06 MONTHLY STATUS REPORTS

- A. Contractor shall submit three copies of detailed schedule status reports on a monthly basis with the Application for Payment. The first such status report shall be submitted with the first Application for Payment and include data as of the last day of the pay period. The Monthly Report shall include a "marked-up" copy of the latest detailed schedule of legal status and a supporting narrative including updated information as described above. The Monthly Report will be reviewed by Engineer and Contractor at a monthly schedule meeting and Contractor will address Engineer's comments on the subsequent monthly report. Monthly status reports shall be the basis for evaluating Contractor's progress.
- B. The "marked-up" diagram shall show, for the latest detailed schedule of legal status, percentages of completion for all activities, actual start and finish dates and remaining durations, as appropriate. Activities not previously included in the latest detailed schedule of legal status shall be added, except that contractual dates will not be changed except by change order. Review of a marked-up diagram by Engineer will not be construed to constitute concurrence with the time frames, duration, or sequencing for such added activities; instead the corresponding data as ultimately incorporated into an appropriate change order shall govern.

2.07 STARTUP SCHEDULE

- A. At least 60 calendar days prior to the date of substantial completion, Contractor shall submit a time-scaled (days after notice to proceed) diagram detailing the work to take place in the period between 60 days prior to substantial completion, together with a supporting narrative. Engineer shall have 10 calendar days after receipt of the submittal to respond. Upon receipt of Engineer's comments, Contractor shall make the necessary revisions and submit the revised schedule within 10 calendar days. The resubmittal, if concurred with by Owner, shall be the Work Plan to be used by Contractor for planning, managing, scheduling and executing the remaining work leading to substantial completion.

- B. The time-scaled diagram shall use the latest schedule of legal status for those activities completed ahead of the last 60 calendar days prior to substantial completion and detailed activities for the remaining 60-day period within the time frames outlined in the latest schedule of legal status.
- C. Contractor will be required to continue the requirement for monthly reports, as outlined above. In preparing this report, Contractor must assure that the schedule is consistent with the progress noted in the startup schedule.

2.08 REVISIONS

- A. All revised Schedule Submittals shall be made in the same form and detail as the initial submittal and shall be accompanied by an explanation of the reasons for such revisions, all of which shall be subject to review by Engineer and concurrence by Owner. The revision shall incorporate all previously made changes to reflect current as-built conditions. Minor changes to the approved submittal may be approved at monthly meetings; a minor change is not considered a revision in the context of this paragraph.
- B. A revised schedule submittal shall be submitted for review when required by Engineer.

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01340 SHOP DRAWINGS, PROJECT DATA AND SAMPLES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall submit to the Engineer for review and approval: working drawings, shop drawings, test reports and data on materials and equipment (hereinafter in this section called data), and material samples (hereinafter in this section called samples) as are required for the proper control of work, including, but not limited to those working drawings, shop drawings, data and samples for materials and equipment specified elsewhere in the Specifications and in the Contract Drawings.
- B. Within thirty (30) calendar days after the effective date of the Agreement, the Contractor shall submit to the Engineer, a complete list of preliminary data on items for which Shop Drawings are to be submitted. Included in this list shall be the names of all proposed manufacturers furnishing specified items and the date on which each Shop Drawing shall be submitted. Review of this list by the Engineer shall in no way relieve the Contractor from submitting complete Shop Drawings and providing materials, equipment, etc., fully in accordance with the Specifications. This procedure is required in order to expedite final review of Shop Drawings.
- C. The Contractor is to maintain an accurate updated submittal log and will bring this log to each scheduled progress meeting with the Owner and the Engineer. This log should include the following items:
 - 1. Submittal description and number assigned.
 - 2. Date to Engineer.
 - 3. Date returned to Contractor (from Engineer).
 - 4. Status of Submittal (No exceptions taken, returned for confirmation or resubmittal, rejected).
 - 5. Date of Resubmittal and Return (as applicable).
 - 6. Date material released (for fabrication).
 - 7. Projected date of fabrication.
 - 8. Projected date of delivery to site.
 - 9. Projected date and required lead time so that product installation does not delay contact.
 - 10. Status of O&M manuals submitted.

1.03 CONTRACTOR'S RESPONSIBILITY

- A. It is the duty of the Contractor to check all drawings, data and samples prepared by or for him before submitting them to the Engineer for review. Each and every copy of the Drawings and data shall bear Contractor's stamp showing that they have been so checked. Shop drawings submitted to the Engineer without the Contractor's stamp will be returned to the Contractor for conformance with this requirement. Shop drawings shall indicate any deviations in the submittal from requirements of the contract Documents.
- B. Determine and verify:
 - 1. Field measurements.
 - 2. Field construction criteria.
 - 3. Catalog numbers and similar data.

4. Conformance with Specifications and indicate all variances from the Specifications.
- C. The Contractor shall furnish the Engineer a schedule of Shop Drawing submittals fixing the respective dates for the submission of shop and working drawings, the beginning of manufacture, testing and installation of materials, supplies and equipment. This schedule shall indicate those that are critical to the progress schedule.
- D. The Contractor shall not begin any of the work covered by a drawing, data, or a sample returned for correction until a revision or correction thereof has been reviewed and returned to him, by the Engineer, with No Exceptions Taken or Approved As Noted.
- E. The Contractor shall submit to the Engineer all drawings and schedules sufficiently in advance of construction requirements to provide no less than twenty-one (21) calendar days for checking and appropriate action from the time the Engineer receives them.
- F. The Contractor shall submit five (5) copies of descriptive or product data submittals to complement shop drawings for the Engineer plus the additional copies if the Contractor requires more than 1 being returned. The Engineer shall retain four (4) sets.
- G. The Contractor shall be responsible for and bear all cost of damages which may result from the ordering of any material or from proceeding with any part of work prior to the completion of the review by Engineer of the necessary Shop Drawings.

1.04 ENGINEER'S REVIEW OF SHOP DRAWINGS AND WORKING DRAWINGS

- A. The Engineer's review of drawings, data and samples submitted by the Contractor shall cover only general conformity to the Specifications, external connections and dimensions which affect the installation.
- B. The review of drawings and schedules shall be general and shall not be construed:
 1. As permitting any departure from the Contract requirements.
 2. As relieving the Contractor of responsibility for any errors, including details, dimensions and materials.
 3. As approving departures from details furnished by the Engineer, except as otherwise provided herein.
- C. If the drawings or schedules as submitted describe variations and show a departure from the Contract requirements which the Engineer finds to be in the interest of the Owner and to be so minor as not to involve a change in Contract Price or time for performance, the Engineer may return the reviewed drawings without noting any exception.
- D. When reviewed by the Engineer, each of the Shop and Working Drawings shall be identified as having received such review being so stamped and dated. Shop Drawings stamped "REJECTED" and with required corrections shown shall be returned to the Contractor for correction and resubmittal.
- E. Resubmittals will be handled in the same manner as first submittals. On resubmittals, the Contractor shall direct specific attention, in writing or on resubmitted Shop Drawings, to revisions other than the corrections requested by the Engineer on previous submissions. The Contractor shall make any corrections required by the Engineer.

- F. If the Contractor considers any correction indicated on the drawings to constitute a change to the Contract Drawings or Specifications, the Contractor shall give written notice thereof to the Engineer.
- G. The Engineer shall review a submittal/resubmittal a maximum of three (3) times after which cost of review shall be borne by the Contractor. The cost of engineering shall be equal to the Engineer's actual payroll cost.
- H. When the Shop and Working Drawings have been completed to the satisfaction of the Engineer, the Contractor shall carry out the construction in accordance therewith and shall make no further changes therein except upon written instructions from the Engineer.
- I. No partial submittals shall be reviewed. Incomplete submittals shall be returned to the Contractor and shall be considered not approved until resubmitted.

1.05 SHOP DRAWINGS

- A. When used in the Contract Documents, the term "Shop Drawings" shall be considered to mean Contractor's plans for material and equipment which become an integral part of the Project. These drawings shall be complete and detailed. Shop Drawings shall consist of fabrication, drawings, setting drawings, schedule drawings, manufacturer's scale drawings and wiring and control diagrams. Cuts, catalogs, pamphlets, descriptive literature and performance and test data, shall be considered only as supportive to required Shop Drawings as defined above.
- B. Drawings and schedules shall be checked and coordinated with the work of all trades involved, before they are submitted for review by the Engineer and shall bear the Contractor's stamp of approval and original signature as evidence of such checking and coordination. Drawings or schedules submitted without this stamp of approval and original signature shall be returned to the Contractor for resubmission.
- C. Each Shop Drawing shall have a blank area 3-1/2 inches by 3-1/2 inches, located adjacent to the title block. The title block shall display the following:
 - 1. Number and title of the drawing.
 - 2. Date of Drawing or revision.
 - 3. Name of project building or facility.
 - 4. Name of contractor and subcontractor submitting drawing.
 - 5. Clear identification of contents and location of the work.
 - 6. Specification title and number.
- D. If drawings show variations from Contract requirements because of standard shop practice or for other reasons, the Contractor shall describe such variations in his letter of transmittal. If acceptable, proper adjustment in the contract shall be implemented where appropriate. If the Contractor fails to describe such variations, he shall not be relieved of the responsibility of executing the work in accordance with the Contract, even though such drawings have been reviewed.
- E. Data on materials and equipment shall include, without limitation, materials and equipment lists, catalog sheets, cuts, performance curves, diagrams, materials of construction and similar descriptive material. Materials and equipment lists shall give, for each item thereon, the name and location of the supplier or manufacturer, trade name, catalog reference, size, finish and all other pertinent data.

- F. For all mechanical and electrical equipment furnished, the Contractor shall provide a list including the equipment name and address and telephone number of the manufacturer's representative and service company so that service and/or spare parts can be readily obtained.
- G. All manufacturers or equipment suppliers who proposed to furnish equipment or products shall submit an installation list to the Engineer along with the required shop drawings. The installation list shall include at least five installations where identical equipment has been installed and have been in operation for a period of at least one (1) year.
- H. Only the Engineer will utilize the color "red" in marking shop drawing submittals.

1.06 WORKING DRAWINGS

- A. When used in the Contract Documents, the term "working drawings" shall be considered to mean the Contractor's fabrication and erection drawings for structures such as roof trusses, steelwork, precast concrete elements, bulkheads, support of open cut excavation, support of utilities, groundwater control systems, forming and false work; underpinning; and for such other work as may be required for construction of the project.
- B. Copies of working drawings as noted above, shall be submitted to the Engineer where required by the Contract Documents or requested by the Engineer and shall be submitted at least thirty (30) days (unless otherwise specified by the Engineer) in advance of their being required for work.
- C. Working drawings shall be signed by a registered Professional Engineer, currently licensed to practice in the State of Florida and shall convey, or be accompanied by, calculation or other sufficient information to completely explain the structure, machine, or system described and its intended manner of use. Prior to commencing such work, working drawings must have been reviewed without specific exceptions by the Engineer, which review will be for general conformance and will not relieve the Contractor in any way from his responsibility with regard to the fulfillment of the terms of the Contract. All risks of error are assumed by the Contractor; the Owner and Engineer shall not have responsibility therefor.

1.07 SAMPLES

- A. The Contractor shall furnish, for the review of the Engineer, samples required by the Contract Documents or requested by the Engineer. Samples shall be delivered to the Engineer as specified or directed. The Contractor shall prepay all shipping charges on samples. Materials or equipment for which samples are required shall not be used in work until reviewed by the Engineer.
- B. Samples shall be of sufficient size and quantity to clearly illustrate:
 - 1. Functional characteristics of the product, with integrally related parts and attachment devices.
 - 2. Full range of color, texture and pattern.
 - 3. A minimum of two samples of each item shall be submitted.
- C. Each sample shall have a label indicating:
 - 1. Name of product.

2. Name of Contractor and Subcontractor.
 3. Material or equipment represented.
 4. Place of origin.
 5. Name of Producer and Brand (if any).
 6. Location in project.
(Samples of finished materials shall have additional markings that will identify them under the finished schedules.)
 7. Reference specification paragraph.
- D. The Contractor shall prepare a transmittal letter in triplicate for each shipment of samples containing the information required above. He shall enclose a copy of this letter with the shipment and send a copy of this letter to the Engineer. Review of a sample shall be only for the characteristics or use named in such and shall not be construed to change or modify any Contract requirements.
- E. Reviewed samples not destroyed in testing shall be sent to the Engineer or stored at the site of the work. Reviewed samples of the hardware in good condition will be marked for identification and may be used in the work. Materials and equipment incorporated in work shall match the reviewed samples. If requested at the time of submission, samples which failed testing or were rejected shall be returned to the Contractor at his expense.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01370 SCHEDULE OF VALUES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall submit to the Engineer a Schedule of Values allocated to the various portions of the work, within 10 days after date of Notice to Proceed.
- B. Upon request of the Engineer, the Contractor shall support the values with data which will substantiate their correctness.
- C. The Schedule of Values shall be used only as the basis for the Contractor's Applications for Payment.

1.02 FORM AND CONTENT OF SCHEDULE OF VALUES

- A. Schedule of Values will be considered for approval by Engineer upon Contractor's request. Identify schedule with:
 - 1. Title of Project and location.
 - 2. Project number.
 - 3. Name and address of Contractor.
 - 4. Contract designation.
 - 5. Date of submission.
- B. Schedule of Values shall list the installed value of the component parts of the work in sufficient detail to serve as a basis for computing values for progress payments during construction.
- C. Follow the table of contents for the Contract Document as the format for listing component items for structures:
 - 1. Identify each line item with the number and title of the respective major section of the specification.
 - 2. For each line item, list sub values of major products or operations under item.
- D. Follow the bid sheets included in this Contract Documents as the format for listing component items for pipe lines.
- E. The sum of all values listed in the schedule shall equal the total Contract sum.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01380 CONSTRUCTION PHOTOGRAPHS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall employ a competent photographer to take construction record photographs or perform video, recording including furnishing all labor, materials, equipment and incidentals necessary to obtain photographs and/or video recordings of all construction areas.
- B. Preconstruction record information shall consist of video recordings on digital video disks (DVD).
- C. Construction progress information shall consist of photographs and digital photographs on a recordable compact disc (CD-R).

1.02 QUALIFICATIONS

- A. All photography shall be done by a competent camera operator who is fully experienced and qualified with the specified equipment.
- B. For the video recording, the audio portion should be done by a person qualified and knowledgeable in the specifics of the Contract, who shall speak with clarity and diction so as to be easily understood.

1.03 PROJECT PHOTOGRAPHS

- A. Provide two prints of each photograph with each pay application.
- B. Provide one recordable compact disc with digital photographs with each pay application.
- C. Negatives:
 - 1. All negatives shall remain the property of photographer.
 - 2. The Contractor shall require that photographer maintain negatives or protected digital files for a period of two years from date of substantial completion of the project.
 - 3. Photographer shall agree to furnish additional prints to Owner and Engineer at commercial rates applicable at time of purchase. Photographer shall also agree to participate as required in any litigation requiring the photographer as an expert witness.
- D. The Contractor shall pay all costs associated with the required photography and prints. Any parties requiring additional photography or prints shall pay the photographer directly.
- E. All project photographs shall be a single weight, color image. All finishes shall be smooth surface and glossy and all prints shall be 8 inches x 10 inches.
- F. Each print shall have clearly marked on the back, the name of the project, the orientation of view, the date and time of exposure, name and address of the photographer and the photographers numbered identification of exposure.
- G. All project photographs shall be taken from locations to adequately illustrate conditions prior

to construction, or conditions of construction and state of progress. The Contractor shall consult with the Engineer at each period of photography for instructions concerning views required.

1.04 VIDEO RECORDINGS

- A. Video, recording shall be done along all routes that are scheduled for construction. Video, recording shall include full, recording of both sides of all streets and the entire width of easements plus 10 feet on each side on which construction is to be performed. All video recording shall be in full color.
- B. A complete view, in sufficient detail with audio description of the exact location shall be provided.
- C. The engineering plans shall be used as a reference for stationing in the audio portion of the recordings for easy location identification.
- D. Two complete sets of video recordings shall be delivered to the Engineer on digital video disks (DVD) for the permanent and exclusive use of the Engineer prior to the start of any construction on the project.
- E. All video recordings shall contain the name of the project, the date and time of the video, recording, the name and address of the photographer and any other identifying information required.
- F. Construction shall not start until preconstruction video recordings are completed, submitted and accepted by the Engineer. In addition, no progress payments shall be made until the preconstruction video recordings are accepted by the Engineer.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01410 TESTING AND TESTING LABORATORY SERVICES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Owner shall employ and pay for the services of an independent testing laboratory to perform testing specifically indicated on the Contract Documents or called out in the Specifications. Owner may elect to have materials and equipment tested for conformity with the Contract Documents at any time.
 - 1. Contractor shall cooperate fully with the laboratory to facilitate the execution of its required services.
 - 2. Employment of the laboratory shall in no way relieve the Contractor's obligations to perform the work of the Contract.

1.02 LIMITATIONS OF AUTHORITY OF TESTING LABORATORY

- A. Laboratory is not authorized to:
 - 1. Release, revoke, alter or enlarge on requirements of Contract Documents.
 - 2. Approve or accept any portion of the Work.
 - 3. Perform any duties of the Contractor.

1.03 CONTRACTOR'S RESPONSIBILITIES

- A. Cooperate with laboratory personnel; provide access to Work and/or to Manufacturer's operations.
- B. Secure and deliver to the laboratory adequate quantities of representational samples of materials proposed to be used and which require testing.
- C. Provide to the laboratory the preliminary design mix proposed to be used for concrete, and other material mixes which require control by the testing laboratory.
- D. Materials and equipment used in the performance of work under this Contract are subject to inspection and testing at the point of manufacture or fabrication. Standard specifications for quality and workmanship are indicated in the Contract Documents. The Engineer may require the Contractor to provide statements or certificates from the manufacturers and fabricators that the materials and equipment provided by them are manufactured or fabricated in full accordance with the standard specifications for quality and workmanship indicated in the Contract Documents. All costs of this testing and providing statements and certificates shall be a subsidiary obligation of the Contractor and no extra charge to the Owner shall be allowed on account of such testing and certification.
- E. Furnish incidental labor and facilities:
 - 1. To provide access to work to be tested.
 - 2. To obtain and handle samples at the project site or at the source of the product to be tested.
 - 3. To facilitate inspections and tests.
 - 4. For storage and curing of test samples.

- F. Notify laboratory sufficiently in advance of operations to allow for laboratory assignment of personnel and scheduling of tests.
 - 1. When tests or inspections cannot be performed due to insufficient notice, Contractor shall reimburse Owner for laboratory personnel and travel expenses incurred due to Contractor's negligence.
- G. Employ and pay for the services of the same or a separate, equally qualified independent testing laboratory to perform additional inspections, sampling and testing required for the Contractor's convenience and as approved by the Engineer.
- H. If the test results indicate the material or equipment complies with the Contract Documents, the Owner shall pay for the cost of the testing laboratory. If the tests and any subsequent retests indicate the materials and equipment fail to meet the requirements of the Contract Documents, the contractor shall pay for the laboratory costs directly to the testing firm or the total of such costs shall be deducted from any payments due the Contractor.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01510 TEMPORARY AND PERMANENT UTILITIES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

The Contractor shall be responsible for furnishing all requisite temporary utilities, i.e., power, water, sanitation, etc. The Contractor shall obtain and pay for all permits required as well as pay for all temporary usages. The Contractor shall remove all temporary facilities upon completion of work.

1.02 REQUIREMENTS OF REGULATORY AGENCIES

- A. Comply with National Electric Code.
- B. Comply with Federal, State and Local codes and regulations and with utility company requirements.
- C. Comply with County Health Department regulations.

PART 2 PRODUCTS

2.01 MATERIALS, GENERAL

Materials for temporary utilities may be "used". Materials for electrical utilities shall be adequate in capacity for the required usage, shall not create unsafe conditions and shall not violate requirements of applicable codes and standards.

2.02 TEMPORARY ELECTRICITY AND LIGHTING

Arrange with the applicable utility company for temporary power supply. Provide service required for temporary power and lighting and pay all costs for permits, service and for power used.

2.03 TEMPORARY WATER

- A. The Contractor shall arrange with Manatee County Utilities Customer Service office to provide water for construction purposes, i.e., meter, pay all costs for installation, maintenance and removal, and service charges for water used.
- B. The Contractor shall protect piping and fitting against freezing.

2.04 TEMPORARY SANITARY FACILITIES

- A. The Contractor shall provide sanitary facilities in compliance with all laws and regulations.
- B. The Contractor shall service, clean and maintain facilities and enclosures.

PART 3 EXECUTION

3.01 GENERAL

- A. The Contractor shall maintain and operate systems to assure continuous service.

- B. The Contractor shall modify and extend systems as work progress requires.

3.02 REMOVAL

- A. The Contractor shall completely remove temporary materials and equipment when their use is no longer required.
- B. The Contractor shall clean and repair damage caused by temporary installations or use of temporary facilities.

END OF SECTION

SECTION 01570 TRAFFIC REGULATION

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall be responsible for providing safe and expeditious movement of traffic through construction zones. A construction zone is defined as the immediate areas of actual construction and all abutting areas which are used by the Contractor and which interfere with the driving or walking public.
- B. The Contractor shall remove temporary equipment and facilities when no longer required, restore grounds to original or to specified conditions.

1.02 TRAFFIC CONTROL

- A. The necessary traffic control shall include, but not be limited to, such items as proper construction warning signs, signals, lighting devices, markings, barricades, channelization and hand signaling devices. The Contractor shall be responsible for installation and maintenance of all devices and detour routes and signage for the duration of the construction period. The Contractor shall utilize the appropriate traffic plan from the FDOT Maintenance of Traffic Standards, Series 600 of the FDOT Roadway & Traffic Design Standards, Latest Edition.
- B. Should there be the necessity to close any portion of a roadway carrying vehicles or pedestrians the Contractor shall submit a Traffic Control Plan (TCP) at least 5 days before a partial or full day closure, and at least 8 days before a multi-day closure. TCP shall be submitted, along with a copy of their accreditation, by a certified IMSA or ATSA Traffic Control Specialist.
 - 1. At no time will more than one (1) lane of a roadway be closed to vehicles and pedestrians without an approved road closure from the County Transportation Department. With any such closings, adequate provision shall be made for the safe expeditious movement of each.
 - 2. All traffic control signs must be in place and inspected at least 1 day in advance of the closure. Multi-day closures notification signs shall be in place at least 3 days in advance of the closure. All signs must be covered when no in effect, and checked twice a day by the Worksite Traffic Supervisor when they are in effect.
- C. The Contractor shall be responsible for removal, relocation, or replacement of any traffic control device in the construction area which exists as part of the normal preconstruction traffic control scheme. Any such actions shall be performed by the Contractor under the supervision and in accordance with the instructions of the applicable highway department unless otherwise specified.
- D. The Engineer will consult with the Owner immediately on any vehicular or pedestrian safety or efficiency problem incurred as a result of construction of the project.
- E. The Contractor shall provide ready access to businesses and homes in the project area during construction. The Contractor shall be responsible for coordinating this work with affected homeowners.

- F. When conditions require the temporary installation of signs, pavement markings and traffic barriers for the protection of workers and traffic, the entire array of such devices shall be depicted on working drawings for each separate stage of work. These drawings shall be submitted to the Engineer for review and approval prior to commencement of work on the site.
- G. Precast concrete traffic barriers shall be placed adjacent to trenches and other excavations deeper than six inches below the adjacent pavement surface.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01580 PROJECT IDENTIFICATION AND SIGNS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Furnish, install and maintain County project identification signs.
- B. Remove signs on completion of construction.
- C. Allow no other signs to be displayed except for traffic control and safety.

1.02 PROJECT IDENTIFICATION SIGN (COUNTY)

- A. One painted sign, of not less than 32 square feet (3 square meters) area, with painted graphic content to include:
 - 1. Title of Project.
 - 2. Name of Owner.
 - 3. Names and titles of authorities as directed by Owner.
 - 4. Prime Contractor.
- B. Graphic design, style of lettering and colors: As approved by the Engineer and subject to approval of the Owner.
- C. Erect on the site at a lighted location of high public visibility, adjacent to main entrance to site, as approved by the Engineer and the Owner

1.03 INFORMATIONAL SIGNS

- A. Painted signs with painted lettering, or standard products.
 - 1. Size of signs and lettering: as required by regulatory agencies, or as appropriate to usage.
 - 2. Colors: as required by regulatory agencies, otherwise of uniform colors throughout project.
- B. Erect at appropriate locations to provide required information.

1.04 QUALITY ASSURANCE

- A. Sign Painter: Professional experience in type of work required.
- B. Finishes, Painting: Adequate to resist weathering and fading for scheduled construction period.

1.05 PUBLIC NOTIFICATION


- A. Door Hangers: Manatee County Project Management shall generate and the General Contractor shall distribute door hangers to all residents who will be impacted by project construction.

- 1.0 Residents impacted include anyone who resides inside, or within 500 feet of project limits of construction.
- B. Door Hangers shall be distributed prior to start of construction of the project. Hangers shall be affixed to doors of residents via elastic bands or tape.

EXAMPLE:

PLEASE PARDON THE INCONVENIENCE WHILE THE ROADWAY IS BEING
RECONSTRUCTED IN YOUR NEIGHBORHOOD

This project consists of utility improvements and the reconstruction of ??? Boulevard from U.S. ??? to ??? Street West. The project is expected to begin in August, 200X and be completed in July 200X.

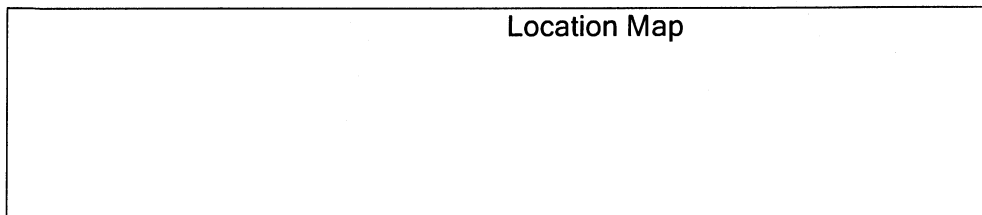

WE HOPE TO KEEP ANY INCONVENIENCE TO A MINIMUM. HOWEVER, IF YOU
HAVE ANY PROBLEMS, PLEASE CONTACT THE FOLLOWING:

- | | | | |
|----|-------------------------------------------------------------------|----|------------------------------------------------------|
| A. | Contractor
Contractor Address
Contractor Phone (Site Phone) | C. | Project Manager
PM Address
PM Phone No. & Ext. |
| B. | Project Inspector
Inspector Phone Number | | |

AFTER HOURS EMERGENCY NUMBER - (941) 747-HELP
THANK YOU FOR YOUR UNDERSTANDING AND PATIENCE
MANATEE COUNTY GOVERNMENT - PROJECT MANAGEMENT DEPT.

PART 2 PRODUCTS

2.01 SIGN MATERIALS

- A. Structure and Framing: May be new or used, wood or metal, in sound condition structurally adequate to work and suitable for specified finish.
- B. Sign Surfaces: Exterior softwood plywood with medium density overlay, standard large sizes to minimize joints.
1. Thickness: As required by standards to span framing members, to provide even, smooth surface without waves or buckles.
- C. Rough Hardware: Galvanized.

- D. Paint: Exterior quality, as specified in the Contract Documents.

PART 3 EXECUTION

3.01 PROJECT IDENTIFICATION SIGN

- A. Paint exposed surface or supports, framing and surface material; one coat of primer and one coat of exterior paint.
- B. Paint graphics in styles, size and colors selected.

3.02 MAINTENANCE

The Contractor shall maintain signs and supports in a neat, clean condition; repair damages to structures, framing or sign.

3.03 REMOVAL

The Contractor shall remove signs, framing, supports and foundations at completion of project.

END OF SECTION

SECTION 01600 MATERIAL AND EQUIPMENT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Material and equipment incorporated into the work:
 - 1. Conform to applicable specifications and standards.
 - 2. Comply with size, make, type and quality specified, or as specifically approved in writing by the Engineer.
 - 3. Manufactured and Fabricated Products:
 - a. Design, fabricate and assemble in accordance with the best engineering and shop practices.
 - b. Manufacture like parts of duplicate units to standard sizes and gages, to be interchangeable.
 - c. Two or more items of the same kind shall be identical and manufactured by the same manufacturer.
 - d. Products shall be suitable for service conditions.
 - e. Equipment capacities, sizes and dimensions shown or specified shall be adhered to unless variations are specifically approved in writing.
 - 4. Do not use material or equipment for any purpose other than that for which it is specified.
 - 5. All material and equipment incorporated into the project shall be new.

1.02 MANUFACTURER'S INSTRUCTIONS

- A. When Contract Documents require that installation of work shall comply with manufacturer's printed instructions, obtain and distribute copies of such instructions to parties involved in the installation, including two copies to Engineer. Maintain one set of complete instructions at the job site during installation and until completion.
- B. Handle, install, connect, clean, condition and adjust products in strict accordance with such instructions and in conformity with specified requirements. Should job conditions or specified requirements conflict with manufacturer's instructions, consult with Engineer prior to proceeding. Do not proceed with work without clear instructions.

1.03 TRANSPORTATION AND HANDLING

- A. Arrange deliveries of products in accordance with construction schedules, coordinate to avoid conflict with work and conditions at the site.
 - 1. Deliver products in undamaged condition, in manufacturer's original containers or packaging, with identifying labels intact and legible.
 - 2. Immediately on delivery, inspect shipments to assure compliance with requirements of Contract Documents and approved submittals and that products are properly protected and undamaged.
- B. Provide equipment and personnel to handle products by methods to prevent soiling or damage to products or packaging.

1.04 SUBSTITUTIONS AND PRODUCT OPTIONS

Contractor's Options:

1. For products specified only by reference standard, select any product meeting that standard.
2. For products specified by naming one or more products or manufacturers and "or equal", Contractor must submit a request for substitutions of any product or manufacturer not specifically named in a timely manner so as not to adversely affect the construction schedule.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01620 STORAGE AND PROTECTION

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Provide secure storage and protection for products to be incorporated into the work and maintenance and protection for products after installation and until completion of Work.

1.02 STORAGE

- A. Store products immediately on delivery and protect until installed in the Work, in accord with manufacturer's instructions, with seals and labels intact and legible.
- B. Exterior Storage
 - 1. Provide substantial platform, blocking or skids to support fabricated products above ground to prevent soiling or staining.
 - a. Cover products, subject to discoloration or deterioration from exposure to the elements, with impervious sheet coverings. Provide adequate ventilation to avoid condensation.
 - b. Prevent mixing of refuse or chemically injurious materials or liquids.
- A. Arrange storage in manner to provide easy access for inspection.

1.03 MAINTENANCE OF STORAGE

- A. Maintain periodic system of inspection of stored products on scheduled basis to assure that:
 - 1. State of storage facilities is adequate to provide required conditions.
 - 2. Required environmental conditions are maintained on continuing basis.
 - 3. Surfaces of products exposed to elements are not adversely affected. Any weathering of products, coatings and finishes is not acceptable under requirements of these Contract Documents.
- B. Mechanical and electrical equipment which requires servicing during long term storage shall have complete manufacturer's instructions for servicing accompanying each item, with notice of enclosed instructions shown on exterior of package.
 - 1. Equipment shall not be shipped until approved by the Engineer. The intent of this requirement is to reduce on-site storage time prior to installation and/or operation. Under no circumstances shall equipment be delivered to the site more than one month prior to installation without written authorization from the Engineer.
 - 2. All equipment having moving parts such as gears, electric motors, etc. and/or instruments shall be stored in a temperature and humidity controlled building approved by the Engineer until such time as the equipment is to be installed.
 - 3. All equipment shall be stored fully lubricated with oil, grease, etc. unless otherwise instructed by the manufacturer.
 - 4. Moving parts shall be rotated a minimum of once weekly to insure proper lubrication and to avoid metal-to-metal "welding". Upon installation of the equipment, the Contractor shall start the equipment, at least half load, once weekly for an adequate period of time to insure that the equipment does not deteriorate from lack of use.
 - 5. Lubricants shall be changed upon completion of installation and as frequently as

- required, thereafter during the period between installation and acceptance.
6. Prior to acceptance of the equipment, the Contractor shall have the manufacturer inspect the equipment and certify that its condition has not been detrimentally affected by the long storage period. Such certifications by the manufacturer shall be deemed to mean that the equipment is judged by the manufacturer to be in a condition equal to that of equipment that has been shipped, installed, tested and accepted in a minimum time period. As such, the manufacturer will guaranty the equipment equally in both instances. If such a certification is not given, the equipment shall be judged to be defective. It shall be removed and replaced at the Contractor's expense.

1.04 PROTECTION AFTER INSTALLATION

- A. Provide protection of installed products to prevent damage from subsequent operations. Remove when no longer needed, prior to completion of work.
- B. Control traffic to prevent damage to equipment and surfaces.
- C. Provide coverings to protect finished surfaces from damage.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01700 CONTRACT CLOSEOUT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Comply with requirements stated in Conditions of the Contract and in Specifications for administrative procedures in closing out the work.

1.02 SUBSTANTIAL COMPLETION

- A. The Contractor shall submit the following items when the Contractor considers the work to be substantially complete:
 - 1. A written notice that the work, or designated portion thereof, is substantially complete.
 - 2. A list of items to be completed or corrected.
- B. Within a reasonable time after receipt of such notice, the Engineer and Owner shall make an inspection to determine the status of completion.
- C. Project record documents and operations and maintenance manuals must be submitted before the project shall be considered substantially complete.
- D. If the Engineer determines that the work is not substantially complete:
 - 1. The Engineer shall notify the Contractor in writing, stating the reasons.
 - 2. The Contractor shall remedy the deficiencies in the work and send a second written notice of substantial completion to the Engineer.
 - 3. The Engineer shall reinspect the work.
- E. When the Engineer finds that the work is substantially complete:
 - 1. He shall prepare and deliver to the Owner a tentative Certificate of Substantial Completion (Manatee County Project Management Form PMD-8) with a tentative list of the items to be completed or corrected before final payment.
 - 2. The Engineer shall consider any objections made by the Owner as provided in Conditions of the Contract. When the Engineer considers the work substantially complete, he will execute and deliver to the Owner and the Contractor a definite Certificate of Substantial Completion (Manatee County Project Management Form PMD-8) with a revised tentative list of items to be completed or corrected.

1.03 FINAL INSPECTION

- A. When the Contractor considered the work to be complete, he shall submit written certification stating that:
 - 1. The Contract Documents have been reviewed.
 - 2. The work has been inspected for compliance with Contract Documents.
 - 3. The work has been completed in accordance with Contract Documents.
 - 4. The equipment and systems have been tested in the presence of the Owner's representative and are operational.
 - 5. The work is completed and ready for final inspection.

- B. The Engineer shall make an inspection to verify the status of completion after receipt of such certification.
- C. If the Engineer determines that the work is incomplete or defective:
 - 1. The Engineer shall promptly notify the Contractor in writing, listing the incomplete or defective work.
 - 2. The Contractor shall take immediate steps to remedy the stated deficiencies and send a second written certification to Engineer that the work is complete.
 - 3. The Engineer shall reinspect the work.
- D. Upon finding the work to be acceptable under the Contract Documents, the Engineer shall request the Contractor to make closeout submittals.
- E. For each additional inspection beyond a total of three (3) inspections for substantial and final completion due to the incompleteness of the work, the Contractor shall reimburse the Owner for the Engineer's fees.

1.04 CONTRACTOR'S CLOSEOUT SUBMITTALS TO ENGINEER

- A. Project Record Documents (prior to substantial completion).
- B. Operation and maintenance manuals (prior to substantial completion).
- C. Warranties and Bonds.
- E. Evidence of Payment and Release of Liens: In accordance with requirements of General and Supplementary Conditions.
- F. Certification letter from Florida Department of Transportation and Manatee County Department of Transportation, as applicable.
- G. Certificate of Insurance for Products and Completed Operations.
- H. Final Reconciliation, Warranty Period Declaration, and Contractor's Affidavit (Manatee County Project Management Form PMD-9).

1.05 FINAL ADJUSTMENT OF ACCOUNTS

- A. Submit a final statement of accounting to the Engineer.
- B. Statement shall reflect all adjustments to the Contract Sum:
 - 1. The original Contract Sum.
 - 2. Additions and deductions resulting from:
 - a. Previous Change Orders
 - b. Unit Prices
 - c. Penalties and Bonuses
 - d. Deductions for Liquidated Damages
 - e. Other Adjustments
 - 3. Total Contract Sum, as adjusted.
 - 4. Previous payments.
 - 5. Sum remaining due.

- C. Project Management shall prepare a final Change Order, reflecting approved adjustments to the Contract Sum which were not previously made by Change Orders.

1.06 FINAL APPLICATION FOR PAYMENT

Contractor shall submit the final Application for Payment in accordance with procedures and requirements stated in the Conditions of the Contract.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01710 CLEANING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Execute cleaning during progress of the work and at completion of the work, as required by the General Conditions.

1.02 DISPOSAL REQUIREMENTS

Conduct cleaning and disposal operations to comply with all Federal, State and Local codes, ordinances, regulations and anti-pollution laws.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Use only those cleaning materials which will not create hazards to health or property and which will not damage surfaces.
- B. Use only those cleaning materials and methods recommended by manufacturer of the surface material to be cleaned.
- C. Use cleaning materials only on surfaces recommended by cleaning material manufacturer.

PART 3 EXECUTION

3.01 DURING CONSTRUCTION

- A. Execute periodic cleaning to keep the work, the site and adjacent properties free from accumulation of waste materials, rubbish and wind-blown debris, resulting from construction operations.
- B. Provide on-site containers for the collection of waste materials, debris and rubbish.
- C. Remove waste materials, debris and rubbish from the site periodically and dispose of at legal disposal areas away from the site.

3.02 DUST CONTROL

- A. Clean interior spaces prior to the start of finish painting and continue cleaning on an as-needed basis until painting is finished.
- B. Schedule operations so that dust and other contaminants resulting from cleaning process will not fall on wet or newly-coated surfaces.

3.03 FINAL CLEANING

- A. Employ skilled workmen for final cleaning.
- B. Broom clean exterior paved surfaces; rake clean other surfaces of the grounds.

- C. Prior to final completion or Owner occupancy, Contractor shall conduct an inspection of sight-exposed interior and exterior surfaces and all work areas to verify that the entire work is clean.

END OF SECTION

SECTION 01720 PROJECT RECORD DOCUMENTS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Contractor shall maintain at the site for the Owner one record copy of:
 - 1. Drawings.
 - 2. Specifications.
 - 3. Addenda.
 - 4. Change Orders and other modifications to the Contract.
 - 5. Engineer's field orders or written instructions.
 - 6. Approved shop drawings, working drawings and samples.
 - 7. Field test records.
 - 8. Construction photographs.

1.02 MAINTENANCE OF DOCUMENTS AND SAMPLES

- A. Store documents and samples in Contractor's field office apart from documents used for construction.
 - 1. Provide files and racks for storage of documents.
 - 2. Provide locked cabinet or secure storage space for storage of samples.
- B. File documents and samples in accordance with CSI format.
- C. Maintain documents in a clean, dry, legible, condition and in good order. Do not use record documents for construction purposes.
- D. Make documents and samples available at all times for inspection by the Engineer.

1.03 MARKING DEVICES

- A. Provide felt tip marking pens for recording information in the color code designated by the Engineer.

1.04 RECORDING

- A. Label each document "PROJECT RECORD" in neat large printed letters.
- B. Record information concurrently with construction progress.
- C. Do not conceal any work until required information is recorded.
- D. Drawings; Legibly mark to record actual construction:
 - 1. All underground piping with elevations and dimensions. Changes to piping location. Horizontal and vertical locations of underground utilities and appurtenances, referenced to permanent surface improvements. Actual installed pipe material, class, etc. Locations of drainage ditches, swales, water lines and force mains shall be shown every 200 feet (measured along the centerline) or alternate lot lines, whichever is closer. Dimensions at these locations shall indicate distance from centerline of right-

- of-way to the facility.
2. Field changes of dimension and detail.
 3. Changes made by Field Order or by Change Order.
 4. Details not on original contract drawings.
 5. Equipment and piping relocations.
 6. Locations of all valves, fire hydrants, manholes, water and sewer services, water and force main fittings, underdrain cleanouts, catch basins, junction boxes and any other structures located in the right-of-way or easement, shall be located by elevation and by station and offset based on intersection P.I.'s and centerline of right-of-way. For facilities located on private roads, the dimensioning shall be from centerline of paving or another readily visible baseline.
 7. Elevations shall be provided for all manhole rim and inverts; junction box rim and inverts; catch basin rim and inverts; and baffle, weir and invert elevations in control structures. Elevations shall also be provided at the PVI's and at every other lot line or 200 feet, whichever is less, of drainage swales and ditches. Bench marks and elevation datum shall be indicated.
 8. Slopes for pipes and ditches shall be recalculated, based on actual field measured distances, elevations, pipe sizes, and type shown. Cross section of drainage ditches and swales shall be verified.
 9. Centerline of roads shall be tied to right-of-way lines. Elevation of roadway centerline shall be given at PVI's and at all intersections.
 10. Record drawings shall show bearings and distances for all right-of-way and easement lines, and property corners.
 11. Sidewalks, fences and walls, if installed at the time of initial record drawing submittal, shall be located every 200 feet or alternate lot lines, whichever is closer. Dimensions shall include distance from the right-of-way line and the back of curb and lot line or easement line.
 12. Sanitary sewer mainline wyes shall be located from the downstream manhole. These dimensions shall be provided by on-site inspections or televising of the sewer following installation.
 13. Elevations shall be provided on the top of operating nuts for all water and force main valves.
 14. Allowable tolerance shall be ± 6.0 inches for horizontal dimensions. Vertical dimensions such as the difference in elevations between manhole inverts shall have an allowable tolerance of $\pm 1/8$ inch per 50 feet (or part thereof) of horizontal distance up to a maximum tolerance of ± 2 inch.
 15. Properly prepared record drawings on mylar, together with two copies, shall be certified by a design professional (Engineer and/or Surveyor registered in the State of Florida), employed by the Contractor, and submitted to the Owner/Engineer.
- E. Specifications and Addenda; Legibly mark each Section to record:
1. Manufacturer, trade name, catalog number and supplier of each product and item of equipment actually installed.
 2. Changes made by field order or by change order.
- F. Shop Drawings (after final review and approval):
1. Five sets of record drawings for each process equipment, piping, electrical system and instrumentation system.

1.05 SUBMITTAL

- A. Prior to substantial completion and prior to starting the bacteria testing of water lines, deliver signed and sealed Record Documents and Record Drawings to the Engineer. These will be reviewed and verified by the inspector. If there are any required changes or additions, these shall be completed and the entire signed and sealed set resubmitted prior to final pay application.
- B. The Contractor shall employ a Professional Engineer or Surveyor registered in the State of Florida to verify survey data and properly prepare record drawings. Record drawings shall be certified by the professional(s) (Engineer or Surveyor licensed in Florida), as stipulated by the Land Development Ordinance and submitted on signed and dated mylar drawings together with a recordable compact disk (CD).
- C. The CD shall contain media in AutoCad Version 12 or later, or in any other CAD program compatible with AutoCad in DWG or DXF form. All fonts, line types, shape files or other pertinent information used in the drawing and not normally included in AutoCad shall be included on the media with a text file or attached noted as to its relevance and use.
- D. Accompany submittal with transmittal letter; containing:
 - 1. Date.
 - 2. Project title and number.
 - 3. Contractor's name and address.
 - 4. Title and number of each Record Document.
 - 5. Signature of Contractor or his authorized representative.

Note: The data required to properly prepare these record drawings shall be obtained at the site, at no cost to the County by the responsible design professional or his/her duly appointed representative. The appointed representative shall be a qualified employee of the responsible design professional or a qualified inspector retained by the responsible design professional on a project-by-project basis.

PART 2 STANDARDS

2.01 MINIMUM RECORD DRAWING STANDARDS FOR ALL RECORD DRAWINGS SUBMITTED TO MANATEE COUNTY

- A. Record drawings shall be submitted to at least the level of detail in the contract documents. It is anticipated that the original contract documents shall serve as at least a background for all record information. Original drawings in CAD format may be requested of the Engineer.
- B. Drawings shall meet the criteria of paragraph 1.04 D above.

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01730 OPERATING AND MAINTENANCE DATA

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Compile product data and related information appropriate for Owner's maintenance and operation of products furnished under Contract.

Prepare operating and maintenance data as specified in this and as referenced in other pertinent sections of Specifications.

- B. Instruct Owner's personnel in maintenance of products and equipment and systems.
- C. Provide three (3) sets of operating and maintenance manuals for each piece of equipment provided within this Contract.

1.02 FORM OF SUBMITTALS

- A. Prepare data in form of an instructional manual for use by Owner's personnel.

- B. Format:

1. Size: 8-1/2 inch x 11 inch
2. Paper: 20 pound minimum, white, for typed pages
3. Text: Manufacturer's printed data or neatly typewritten
4. Drawings:
 - a. Provide reinforced punched binder tab, bind in with text.
 - b. Fold larger drawings to size of text pages.
5. Provide fly-leaf for each separate product or each piece of operating equipment.
 - a. Provide typed description of product and major component parts of equipment.
 - b. Provide indexed tabs.
6. Cover: Identify each volume with typed or printed title "OPERATING AND MAINTENANCE INSTRUCTIONS". List:
 - a. Title of Project.
 - b. Identity of separate structures as applicable.
 - c. Identity of general subject matter covered in the manual.

- C. Binders:

1. Commercial quality three-ring binders with durable and cleanable plastic covers.
2. Maximum ring size: 1 inch.
3. When multiple binders are used, correlate the data into related consistent groupings.

1.03 MANUAL FOR EQUIPMENT AND SYSTEMS

- A. Submit three copies of complete manual in final form.

- B. Content for each unit of equipment and system, as appropriate:

1. Description of unit and component parts.
 - a. Function, normal operating characteristics and limiting conditions.
 - b. Performance curves, engineering data and tests.

- c. Complete nomenclature and commercial number of replaceable parts.
- 2. Operating Procedures:
 - a. Start-up, break-in, routine and normal operating instructions.
 - b. Regulation, control, stopping, shut-down and emergency instructions.
 - c. Summer and winter operating instructions.
 - d. Special operating instructions.
- 3. Maintenance Procedures:
 - a. Routine operations.
 - b. Guide to "trouble-shooting".
 - c. Disassembly, repair and reassembly.
 - d. Alignment, adjusting and checking.
- 4. Servicing and lubricating schedule.
 - a. List of lubricants required.
- 5. Manufacturer's printed operating and maintenance instructions.
- 6. Description of sequence of operation by control manufacturer.
- 7. Original manufacturer's parts list, illustrations, assembly drawings and diagrams required for maintenance.
 - a. List of predicted parts subject to wear.
 - b. Items recommended to be stocked as spare parts.
- 8. As installed control diagrams by controls manufacturer.
- 9. Each contractor's coordination drawings.
 - a. As installed color coded piping diagrams.
- 10. Charts of valve tag numbers, with location and function of each valve.
- 11. List of original manufacturer's spare parts, manufacturer's current prices and recommended quantities to be maintained in storage.
- 12. Other data as required under pertinent sections of specifications.

C. Content, for each electric and electronic system, as appropriate:

- 1. Description of system and component parts.
 - a. Function, normal operating characteristics and limiting conditions.
 - b. Performance curves, engineering data and tests.
 - c. Complete nomenclature and commercial number of replaceable parts.
- 2. Circuit directories of panelboards.
 - a. Electrical service.
 - b. Controls.
 - c. Communications.
- 3. As-installed color coded wiring diagrams.
- 4. Operating procedures:
 - a. Routine and normal operating instructions.
 - b. Sequences required.
 - c. Special operating instructions.
- 5. Maintenance procedures:
 - a. Routine operations.
 - b. Guide to "trouble-shooting".
 - c. Disassembly, repair and reassembly.
 - d. Adjustment and checking.
- 6. Manufacturer's printed operating and maintenance instructions.
- 7. List of original manufacture's spare parts, manufacturer's current prices and recommended quantities to be maintained in storage.
- 8. Prepare and include additional data when the need for such data becomes apparent during instruction of Owner's personnel.

- D. Prepare and include additional data when the need for such data becomes apparent during instruction on Owner's personnel.
- E. Additional requirements for operating and maintenance data: Respective sections of Specifications.

1.04 SUBMITTAL SCHEDULE

- A. Submit one copy of completed data in final form fifteen days prior to substantial completion.
 - 1. Copy will be returned after substantial completion, with comments (if any).
- B. Submit two copies of approved data in final form. Final acceptance will not be provided until the completed manual is received and approved.

1.05 INSTRUCTION OF OWNER'S PERSONNEL

- A. Prior to final inspection or acceptance, fully instruct Owner's designated operating and maintenance personnel in operation, adjustment and maintenance of products, equipment and systems.
- B. Operating and maintenance manual shall constitute the basis of instruction.
 - 1. Review contents of manual with personnel in full detail to explain all aspects of operations and maintenance.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01740 WARRANTIES AND BONDS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Compile specified warranties and bonds.
- B. Compile specified service and maintenance contracts.
- C. Co-execute submittals when so specified.
- D. Review submittals to verify compliance with Contract Documents.
- E. Submit to Engineer for review and transmittal to Owner.

1.02 SUBMITTAL REQUIREMENTS

- A. Assemble warranties, bonds and service and maintenance contracts, executed by each of the respective manufacturers, suppliers and subcontractors.
- B. Number of original signed copies required: Two each.
- C. Table of Contents: Neatly typed, in orderly sequence. Provide complete information for each item.
 - 1. Product or work item.
 - 2. Firm, with name of principal, address and telephone number.
 - 3. Scope.
 - 4. Date of beginning of warranty, bond or service and maintenance contract.
 - 5. Duration of warranty, bond or service maintenance contract.
 - 6. Provide information for Owner's personnel:
 - a. Proper procedure in case of failure.
 - b. Instances which might affect the validity of warranty or bond.
 - 7. Contractor, name of responsible principal, address and telephone number.

1.03 FORM OF SUBMITTALS

- A. Prepare in duplicate packets.
- B. Format:
 - 1. Size 8-1/2 inch x 11 inch punched sheets for standard 3-ring binder. Fold larger sheets to fit into binders.
 - 2. Cover: Identify each packet with typed or printed title "WARRANTIES AND BONDS".
List:
 - a. Title of Project.
 - b. Name of Contractor.
- C. Binders: Commercial quality, three-ring, with durable and cleanable plastic covers.

1.04 TIME OF SUBMITTALS

- A. Make submittals within ten days after date of substantial completion and prior to final request for payment.
- B. For items of work, where acceptance is delayed materially beyond date of substantial completion, provide updated submittal within ten days after acceptance, listing date of acceptance as start of warranty period.

1.05 SUBMITTALS REQUIRED

- A. Submit warranties, bonds, service and maintenance contracts as specified in respective sections of Specifications.
- B. Approval by the Owner of all documents required under this section is a pre-requisite to requesting a final inspection and final payment

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

DIVISION 2 SITE WORK

SECTION 02064 MODIFICATIONS TO EXISTING STRUCTURES, PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish all labor, materials, equipment and incidentals required to modify, alter and/or convert existing structures as shown or specified and as required for the installation of piping, mechanical equipment and appurtenances. Existing piping and equipment shall be removed and dismantled as necessary for the performance of facility alterations in accordance with the requirements herein specified.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION

3.01 GENERAL

- A. The Contractor shall cut, repair, reuse, excavate, demolish or otherwise remove parts of the existing structures or appurtenances, as indicated on the Contract Drawings, herein specified, or necessary to permit completion of the work under this Contract. The Contractor shall dispose of surplus materials resulting from the above work in an approved manner. The work shall include all necessary cutting and bending of reinforcing steel, structural steel, or miscellaneous metal work found embedded in the existing structures.
- B. The Contractor shall dismantle and remove all existing equipment, piping, and other appurtenances required for the completion of the work. Where called for or required, the contractor shall cut existing pipelines for the purpose of making connections thereto. Anchor bolts for equipment and structural steel removed shall be cut off one inch below the concrete surface. Surface shall be finished as specified in the Contract Documents.
- C. At the time that a new connection is made to an existing pipeline, additional new piping, extending to and including a new valve, shall be installed. Pipe anchorage, if required, shall also be installed as directed by the Engineer.
- D. No existing structure, equipment, or appurtenance shall be shifted, cut, removed, or otherwise altered except with the express approval of and to the extent approved by the Engineer.
- E. When removing materials or portions of existing utility pipelines and/or structures or when making openings in walls and partitions, the Contractor shall take all precautions and use all necessary barriers and other protective devices so as not to damage the structures beyond the limits necessary for the new work, and not to damage the structures or contents by falling or flying debris. Unless otherwise permitted, line drilling will be required in cutting existing concrete.
- F. Materials and equipment removed in the course of making alterations and additions shall remain the property of the Owner, except that items not salvageable, as determined by the Engineer and the Owner, shall become the property of the Contractor to be disposed of by

him off the work site at his own place of disposal. Operating equipment shall be thoroughly cleaned, lubricated, and greased for protection during prolonged storage.

- G. All alterations to existing utility pipes and structures shall be done at such time and in such manner as to comply with the approved time schedule. So far as possible before any part of the work is started, all tools, equipment, and materials shall be assembled and made ready so that the work can be completed without delay.
- H. All workmanship and new materials involved in constructing the alterations shall conform to the General Specifications for the classes of work insofar as such specifications are applicable.
- I. All cutting of existing concrete or other material to provide suitable bonding to new work shall be done in a manner to meet the requirements of the respective section of these Specifications covering the new work. When not covered, the work shall be carried on in the manner and to the extent directed by the Resident Project Representative.
- J. Surfaces of seals visible in the completed work shall be made to match as nearly as possible the adjacent surfaces.
- K. Non-shrink grout shall be used for setting wall castings, sleeves, leveling pump bases, doweling anchors into existing concrete and elsewhere as shown.
- L. Where necessary or required for the purpose of making connections, the Contractor shall cut existing pipelines in a manner to provide an approved joint. Where required, he shall use flanges, or provide Dresser Couplings, all as required.
- M. The Contractor shall provide flumes, hoses, piping and other related items to divert or provide suitable plugs, bulkheads, or other means to hold back the flow of water or other liquids, all as required in the performance of the work under this Contract.
- N. Care shall be taken not to damage any part of existing buildings or foundations or outside structures.

3.02 CONNECTING TO EXISTING PIPING AND EQUIPMENT

The Contractor shall verify exact location, material, alignment, joint, etc. of existing piping and equipment prior to making the connections called out in the Drawings. The verifications shall be performed with adequate time to correct any potential alignment or other problems prior to the actual time of connection. A Manatee County representative must be present for all tie-ins for a visual inspection.

3.03 REMOVAL AND ABANDONMENT OF ASBESTOS CEMENT PIPE AND APPURTENANCES

- A. All work associated with the removal or abandonment of existing asbestos cement pipe and appurtenances shall be performed by a licensed asbestos abatement contractor or subcontractor registered in the State of Florida.
- B. The asbestos abatement contractor or subcontractor shall contact the appropriate regulatory agencies prior to removal or abandonment of any asbestos material and shall obtain all required permits and licenses and issue all required notices. The Contractor shall be responsible for all fees associated with permits, licenses and notices to the governing

regulatory agencies.

- C. All work associated with removal or abandonment of asbestos cement pipe and appurtenances shall be performed in accordance with the standards listed below and all other applicable local, State, or Federal standards.
 - 1. Florida Administrative Code, Chapter 17-251, "Asbestos".
 - 2. National Emission Standards Hazardous Air Pollution (NESHAP), 40 CFR, Part 61, Subpart M, latest revision.
 - 3. Occupational Safety and Health Act, 29 CFR
 - 4. The Environmental Protection Agency (EPA) Asbestos Abatement Worker Protection Rule.
 - 5. Florida Statute 455.300.

3.04 ASBESTOS CEMENT PIPE REMOVAL

- A. All asbestos cement pipe sections shown on the Drawings to be removed, and all related valves, fittings and appurtenances shall be removed in their entirety and disposed of by the Contractor in accordance with this Section. After removal of the facilities, all trenches shall be backfilled in accordance with the Contract Documents. The cost of disposing of the removed materials shall be borne by the Contractor.
- B. The Contractor shall make necessary provisions for the Engineer's representative to monitor all removal operations.
- C. The cutting of existing asbestos-cement (A/C, aka "Transite") pipe shall be by hand saw only activities by a licensed asbestos abatement contractor. No machine cutting shall be allowed. Removal of all portions of pipe shall be double bagged prior to shipment. Longer sections of pipe removed may be shipped without double bagging. An asbestos manifest form must accompany each and every shipment of such pipe or pipe material waste to the Manatee County Lena Road Landfill. Prior to each shipment, a minimum of 24 hours notice to the Landfill field office (Phone #748-5543) is required.

3.05 IN-PLACE GROUTING OF EXISTING PIPE

- A. Where water and wastewater utility pipes are to be abandoned in place, they shall be filled with a sand/cement grout as specified herein. When such pipes are constructed with asbestos cement materials, the abandonment activities shall be performed by a licensed asbestos abatement contractor as specified in these Specifications.
- B. Grout shall be injected within the pipe sections indicated on the Drawings. The ends of these sections shall be capped and/or plugged. The grouting program shall consist of pumping sand-cement grout with suitable chemical additives at pressures necessary to fill the pipe sections shown on the Drawings to prevent the potential for future collapse.
- C. The pump used for grouting should be a continuous flow, positive displacement model with a pugmill type mixing vat having a minimum shaft speed of 60 rpm and incorporated as an integral part of the equipment. Alternate equipment may be used subject to the approval of the Engineer. The rate of pumping shall not exceed six (6) cubic feet per minute. The pumping pressures shall be in the range of 100 to 150 psi.
- D. The Contractor shall provide standpipes and/or additional means of visual inspection as required by the Engineer to determine if adequate grout material has filled the entire pipe

section(s). The Contractor shall make necessary provisions for the Engineer's representative to monitor all grouting operations.

- E. All pipe to be abandoned shall be capped or plugged with a fitting or material that will prevent soil or other material from entering the pipe. All caps and plugs shall be subject to approval by the Engineer.

END OF SECTION

SECTION 02221 TRENCHING, BEDDING AND BACKFILL FOR PIPE

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals necessary to perform all excavation, backfill, fill, grading, trench protection or other related work required to complete the piping work shown on the Drawings and specified herein. The work shall include, but not be limited to: vaults; duct conduit; pipe; roadways and paving; backfilling; required fill or borrow operations; grading; disposal of surplus and unsuitable materials; and all related work such as sheeting, bracing and dewatering.
- B. Prior to commencing work, the Contractor shall examine the site and review test borings if available, or undertake his own subsurface investigations and take into consideration all conditions that may affect his work.
- C. The Contractor is responsible for the protection of every tree which is scheduled to remain in the project area. This includes trees which may or may not be shown on the plans. Every tree shall be adequately protected in place at no additional cost to the County. This includes, but is not limited to protecting the root systems and adjusting grades as necessary for tree/root protection.

1.02 PROTECTION

- A. Sheeting and Bracing in Excavations:
 - 1. In connection with construction of underground structures, the Contractor shall properly construct and maintain cofferdams. These shall consist of: sheeting and bracing as required to support the sides of excavations, to prevent any movement which could in any way diminish the width of the excavation below that necessary for proper construction and to protect adjacent structures, existing yard pipe and/or foundation material from disturbance, undermining, or other damage. Care shall be taken to prevent voids outside of the sheeting, but if voids are formed, they shall be immediately filled and rammed.
 - 2. Trench sheeting for pipes: no sheeting is to be withdrawn if driven below, mid-diameter of any pipe and no wood sheeting shall be cut off at a level lower than one foot above the top of any pipe unless otherwise directed by the Engineer. During the progress of the work, the Engineer may direct the Contractor in writing to leave additional wood sheeting in place. If steel sheeting is used for trench sheeting, removal shall be as specified above, unless written approval is given for an alternate method of removal.
 - 3. All sheeting and bracing not left in place shall be carefully removed in such a manner as not to endanger the construction or other structures, utilities, existing piping, or property. Unless otherwise approved or indicated on the Drawings or in the Specification, all sheeting and bracing shall be removed after completion of the piping or structure, care being taken not to disturb or otherwise injure the pipeline or finished masonry. All voids left or caused by withdrawal of sheeting shall be immediately refilled with sand by ramming with tools specifically made for that purpose, by watering, or as may otherwise be directed.
 - 4. The Contractor shall construct, to the extent he deems it desirable for his method of operation, the cofferdams and sheeting outside the neat lines of the pipeline trench or foundation unless otherwise indicated on the Drawings or directed by the

Owner/Engineer. Sheeting shall be plumb and securely braced and tied in position. Sheeting, bracing and cofferdams shall be adequate to withstand all pressures to which the pipeline or structure will be subjected. Pumping, bracing and other work within the cofferdam shall be done in a manner to avoid disturbing any construction of the pipeline or the enclosed masonry. Any movement or bulging which may occur shall be corrected by the Contractor at his own expense so as to provide the necessary clearances and dimensions.

5. Drawings of the cofferdams and design computations shall be submitted to the Engineer and approved prior to any construction. However, approval of these drawings shall not relieve the Contractor of the responsibility for the cofferdams. The drawings and computations shall be prepared and stamped by a Registered Professional Engineer in the State of Florida and shall be in sufficient detail to disclose the method of operation for each of the various stages of construction, if required, for the completion of the pipeline and substructures.

B. Dewatering, Drainage and Flotation

1. The Contractor shall construct and place all pipelines, concrete work, structural fill, bedding rock and limerock base course, in-the-dry. In addition, the Contractor shall make the final 24" of excavation for this work in-the-dry and not until the water level is a minimum of 6" below proposed bottom of excavation.
2. The Contractor shall, at all times during construction, provide and maintain proper equipment and facilities to remove promptly and dispose of properly all water entering excavation and keep such excavations dry so as to obtain a satisfactory undisturbed subgrade foundation condition until the fill, structure, or pipes to be built thereon have been completed to such extent that they will not be floated or otherwise damaged by allowing water levels to return to natural elevations.
3. Dewatering shall at all times be conducted in such a manner as to preserve the natural undisturbed bearing capacity of the subgrade soils at proposed bottom of excavation.
4. Wellpoints may be required for dewatering the soil prior to final excavation for deeper in-ground structures or piping and for maintaining the lowered groundwater level until construction has been completed to avoid the structure, pipeline, or fill from becoming floated or otherwise damaged. Wellpoints shall be surrounded by suitable filter sand and no fines shall be removed by pumping. Pumping from wellpoints shall be continuous and standby pumps shall be provided.
5. The Contractor shall furnish all materials and equipment to perform all work required to install and maintain the proposed drainage systems for handling groundwater and surface water encountered during construction of structures, pipelines and compacted fills.
6. Where required, the Contractor shall provide a minimum of two operating groundwater observation wells at each structure to determine the water level during construction of the pipeline or structure. Locations of the observation wells shall be at structures and along pipelines as approved by the Engineer prior to their installation. The observation wells shall be extended to 6 inches above finished grade, capped with screw-on caps protected by 24" x 24" wide concrete base and left in place at the completion of this Project.
7. Prior to excavation, the Contractor shall submit his proposed method of dewatering and maintaining dry conditions to the Engineer for approval. Such approval shall not relieve the Contractor of the responsibility for the satisfactory performance of the system. The Contractor shall be responsible for correcting any disturbance of natural bearing soils for damage to pipeline or structures caused by an inadequate

dewatering system or by interruption of the continuous operation of the system as specified.

8. As part of his request for approval of a dewatering system, the Contractor shall demonstrate the adequacy of the proposed system and wellpoint filter sand by means of a test installation. Discharge water shall be clear, with no visible soil particles in a one quart sample. Discharge water shall not flow directly into wetlands or Waters of the State as defined by FDEP and SWFWMD.
9. During backfilling and construction, water levels shall be measured in observation wells located as directed by the Engineer.
10. Continuous pumping will be required as long as water levels are required to be below natural levels.

PART 2 PRODUCTS

2.01 MATERIALS

A. General

1. Materials for use as fill and backfill shall be described below. For each material, the Contractor shall notify the Engineer of the source of the material and shall furnish the Engineer, for approval, a representative sample weighing approximately 50 pounds, at least ten calendar days prior to the date of anticipated use of such material.
2. Additional materials shall be furnished as required from off-site sources and hauled to the site.

B. Structural Fill

1. Structural fill in trenches shall be used below spread footing foundations, slab-on-grade floors and other structures as backfill within three feet of the below grade portions of structures.
2. Structural fill material shall be a minimum of 60 percent clean sand, free of organic, deleterious and/or compressible material. Minimum acceptable density shall be 98 percent of the maximum density as determined by AASHTO T-180. Rock in excess of 2-1/2" in diameter shall not be used in the fill material. If the moisture content is improper for attaining the specified density, either water shall be added or material shall be permitted to dry until the proper moisture content for compaction is reached.

C. Common Fill

1. Common fill material shall be free from organic matter, muck or marl and rock exceeding 2-1/2" in diameter. Common fill shall not contain broken concrete, masonry, rubble or other similar materials. Existing soil may be used to adjust grades over the site with the exception of the construction area.
2. Material falling within the above specification, encountered during the excavation, may be stored in segregated stockpiles for reuse. All material which, in the opinion of the Engineer, is not suitable for reuse shall be spoiled as specified herein for disposal of unsuitable materials by the Contractor.

D. Crushed Stone

1. Crushed stone may be used for pipe bedding, manhole bases, as a drainage layer below structures with underdrains and at other locations indicated on the Drawings.

2. Crushed stone shall be size No. 57 with gradation as noted in Table 1 of Section 901 of Florida Department of Transportation, Construction of Roads and Bridges.

PART 3 EXECUTION

3.01 TRENCH EXCAVATION AND BACKFILLING

- A. Excavation for all trenches required for the installation of pipes and electrical ducts shall be made to the depths indicated on the Drawings and in such manner and to such widths as will give suitable room for laying the pipe or installing the ducts within the trenches.
- B. Rock shall be removed to a minimum 6" clearance around the bottom and sides of all the pipe or ducts being laid.
- C. Where pipes or ducts are to be laid in limerock bedding or encased in concrete, the trench may be excavated by machinery to or just below the designated subgrade provided that the material remaining in the bottom of the trench is no more than slightly disturbed.
- D. Where the pipes or ducts are to be laid directly on the trench bottom, the lower part of the trenches shall not be excavated to grade by machinery. The last of the material being excavated manually, shall be done in such a manner that will give a flat bottom true to grade so that pipe or duct can be evenly supported on undisturbed material. Bell holes shall be made as required.
- E. Backfilling over pipes shall begin as soon as practicable after the pipe has been laid, jointed and inspected and the trench filled with suitable compacted material to the mid-diameter of the pipe.
- F. Backfilling over ducts shall begin not less than three days after placing concrete encasement.
- G. All backfilling shall be prosecuted expeditiously and as detailed on the Drawings.
- H. Any space remaining between the pipe and sides of the trench shall be packed full by hand shovel with selected earth, free from stones having a diameter greater than 2" and thoroughly compacted with a tamper as fast as placed, up to a level of one foot above the top of the pipe.
- I. The filling shall be carried up evenly on both sides with at least one man tamping for each man shoveling material into the trench.
- J. The remainder of the trench above the compacted backfill, as just described above, shall be filled and thoroughly compacted by rolling, ramming, or puddling, as the Engineer may direct, sufficiently to prevent subsequent settling.

END OF SECTION

**SECTION 02223 EXCAVATION BELOW GRADE AND CRUSHED STONE OR
SHELL REFILL**

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. If in the opinion of the Engineer, the material at or below the normal grade of the bottom of the trench is unsuitable for pipe or structure foundation, it shall be removed to the depth directed by the Engineer and replaced by crushed stone or washed shell.

PART 2 PRODUCTS (NOT USED)

PART 3 MATERIALS

3.01 EXCAVATION AND DRAINAGE

- A. Whatever the nature of unstable material encountered or the groundwater conditions, trench stabilization shall be complete and effective.
- B. Should the Contractor excavate below the grade shown on the Contract drawings because of negligence or for his own convenience; due to failure in properly dewatering the trench; disturbs the subgrade before dewatering is sufficiently complete; he shall be directed by the Engineer to excavate below grade. The work of excavating below grade and furnishing and placing the approved refill material shall be performed at the Contractor's expense.

3.02 REFILL

- A. Should the material at the level of trench bottom consist of fine sand, sand and silt or soft earth, the subgrade material shall be removed as directed by the Engineer and the excavation shall be refilled with crushed stone or washed shell.

END OF SECTION

SECTION 02260 FINISH GRADING

PART 1 GENERAL

1.01 WORK INCLUDED

- A. The Contractor shall finish grade sub-soil.
- B. The Contractor shall cut out areas to receive stabilizing base course materials for paving and sidewalks.
- C. The Contractor shall place, finish grade and compact top soil.

1.02 PROTECTION

The Contractor shall prevent damage to existing fencing, trees, landscaping, natural features, bench marks, pavement and utility lines. Damage shall be corrected at no cost to the Owner.

PART 2 PRODUCTS

- A. Topsoil: Shall be friable loam free from subsoil, roots, grass, excessive amount of weeds or other organics, stones, and foreign matter; acidity range (pH) of 5.5 to 7.5; containing a minimum of 4 percent and a maximum of 25 percent organic matter. The Contractor may use topsoil stockpiles on site if they conform to these requirements.

PART 3 EXECUTION

3.01 SUB-SOIL PREPARATION

- A. The Contractor shall rough grade sub-soil systematically to allow for a maximum amount of natural settlement and compaction. Uneven areas and low spots shall be eliminated. Debris, roots, branches or other organics, stones, and sub-soil shall be removed by the Contractor and disposed of in a manner consistent with the latest Manatee County Standards as well as any affected regulatory agency. Should contaminated soil be found, the Contractor shall notify the Engineer.
- B. The Contractor shall cut out areas to sub-grade elevation to stabilize base material for paving and sidewalks.
- C. The Contractor shall bring sub-soil to required profiles and contour grades gradually; and blend slopes into level areas.
- D. The Contractor shall slope the structure grade a minimum of two (2) inches in ten (10) feet unless indicated otherwise on the Drawings.
- E. The Contractor shall cultivate sub-grade to a depth of 3 inches where the topsoil is to be placed. He shall repeat cultivation in areas where equipment use has compacted sub-soil.
- F. The Contractor shall not make grade changes which causes water to flow onto adjacent lands.

3.02 PLACING TOPSOIL

- A. The Contractor shall place topsoil in areas where seeding, sodding and planting is to be performed. He shall place from the following minimum depths, up to finished grade elevations:
 - 1. 6 inches for seeded areas
 - 2. 4-1/2 inches for sodded areas
 - 3. 24 inches for shrub beds
 - 4. 18 inches for flower beds
- B. The Contractor shall use topsoil in a dry state as determined by the Engineer. He shall place the material during dry weather.
- C. The Contractor shall use fine grade topsoil eliminating rough and low areas to ensure positive drainage. He shall maintain levels, profiles and contours of the sub-grades.
- D. The Contractor shall remove stone, roots, grass, weeds, debris, and other organics or foreign material while spreading the material.
- E. The Contractor shall manually spread topsoil around trees, plants and structures to prevent damage which may be caused by grading equipment.
- F. The Contractor shall lightly compact and place the topsoil.

3.03

SURPLUS MATERIAL

- A. The Contractor shall remove surplus sub-soil and topsoil from site at his expense.
- B. The Contractor shall leave stockpile areas and entire job site clean and raked, ready for landscaping operations.

END OF SECTION

SECTION 02276 TEMPORARY EROSION AND SEDIMENTATION CONTROL

PART 1 GENERAL

1.01 DESCRIPTION

- A. The work specified in this Section consists of the design, provision, maintenance and removal of temporary erosion and sedimentation controls as necessary.
- B. Temporary erosion controls include, but are not limited to: grassing, mulching, netting, watering, and the reseeding of on-site surfaces and spoil and borrow area surfaces, interceptor ditches at ends of berms and other such work at those locations which will ensure that erosion during construction will be either eliminated or maintained within acceptable limits as established by the Owner/Engineer.
- C. Temporary sedimentation controls include, but are not limited to: silt dams, traps, barriers, and appurtenances at the foot of sloped surfaces which shall ensure that sedimentation pollution will be either eliminated or maintained within acceptable limits as established by the Owner/Engineer.
- D. The Contractor is responsible for providing effective temporary erosion and sediment control measures during construction or until final controls become effective.

1.02 REFERENCE DOCUMENTS

- A. Florida Building Code.
- B. FDEP/COE Dredge and Fill Regulations and/or Permit as applicable.
- C. SWFWMD Permit Regulations and/or Permit as applicable.
- D. Florida Stormwater, Erosion and Sedimentation Control Inspector's Manual.

PART 2 PRODUCTS

2.01 EROSION CONTROL

- A. Netting - fabricated of material acceptable to the Owner.
- B. Seed and sod.

2.02 SEDIMENTATION CONTROL

- A. Bales - clean, seed free cereal hay type.
- B. Netting - fabricated of material acceptable to the Owner.
- C. Filter stone - crushed stone conforming to Florida Dept of Transportation specifications.
- D. Concrete block - hollow, non-load-bearing type.
- E. Concrete - exterior grade not less than one inch thick.

PART 3 EXECUTION

3.01 EROSION CONTROL

- A. Minimum procedures for grassing shall be:
1. Scarify slopes to a depth of not less than six inches and remove large clods, rock, stumps, roots larger than 1/2 inch in diameter and debris.
 2. Sow seed within twenty-four (24) hours after the ground is scarified with either mechanical seed drills or rotary hand seeders.
 3. Apply mulch loosely and to a thickness of between 3/4-inch and 1-1/2 inches.
 4. Apply netting over mulched areas on sloped surfaces.
 5. Roll and water seeded areas in a manner which will encourage sprouting of seeds and growing of grass. Reseed areas which exhibit unsatisfactory growth. Backfill and seed eroded areas.

3.02 SEDIMENTATION CONTROL

- A. The Contractor shall install and maintain silt dams, traps, barriers, and appurtenances as shown on the approved descriptions and working drawings. Deteriorated hay bales and dislodged filter stone shall be replaced by the Contractor at his expense.

3.03 PERFORMANCE

- A. The Contractor, at his own expense, shall immediately take whatever steps are necessary to correct any deficiencies of the temporary erosion and sediment control measures employed if they fail to produce results or do not comply with the requirements of the State of Florida or any other federal, governmental or regulatory agency.

END OF SECTION

SECTION 02444 FENCING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, material, equipment and incidentals necessary for complete installation of chain link fence systems. The fencing shall be installed according to manufacturer's specifications unless otherwise directed or authorized by the Owner/Engineer.
- B. The Contractor's security fencing is at his expense and option and is not covered in this Section.

1.02 QUALITY ASSURANCE

- A. Standards of Manufacture shall comply with the standards of the Chain Link Fence Manufacturer's Institute for "Galvanized Steel Chain Link Fence Fabric" and as herein specified.
- B. Provide each type of steel fence and gates as a complete unit produced by a single manufacturer, including, but not limited to accessories, fittings, fasteners and appurtenances complete and ready for use.
- C. Acceptable Manufacturers: Anchor, Cyclone, or approved equal
- D. Erector Qualifications: The Contractor or approved subcontractor, must have a minimum of two years experience in similar fence installation.

1.03 SUBMITTALS

- A. Product Data:

For Steel Fences and Gates, the Contractor shall submit for review and approval to the Owner/Engineer, five (5) copies of the manufacturer's technical data, details of fabrication, installation instructions and procedures for steel fences and gates. The Contractor shall be responsible for a copy of each instruction to be given to the Installer.

- B. Samples:

The Contractor shall submit two samples approximate size 6-inches long, or 6-inches square of fabric material, framework members and typical accessories to the Owner/Engineer for review and approval.

- C. Certificates:

The Contractor shall provide manufacturer's certification that materials meet or exceed the Contract Document requirements.

PART 2 PRODUCTS

2.01 GENERAL

- A. The pipe sizes indicated are commercial pipe sizes.

- B. The tube sizes indicated are nominal outside dimension.
- C. Framework and appurtenances shall be finished with not less than minimum weight of zinc per sq. ft. and shall comply with the following:
 - 1. Pipe: ASTM A53 (1.8 oz. zinc psf)
 - 2. Square tubing: ASTM A 123 (2.0 oz. zinc psf)
 - 3. Hardware and Accessories: ASTM A 153 (zinc weight per Table I).
- D. All fence components shall be galvanically compatible.
- E. Vinyl coatings for fabric, posts, rails, gates, and all other fittings and components shall be thermally fused polyvinyl chloride; heavy mil coating per ASTM F 668.

2.02 FABRIC

Fabric shall be 0.148 inch (9 gage) steel wire, 2-inch diamond mesh and both top and bottom salvages shall be twisted and barbed for fabric over 60-inches high. Finish shall be hot dipped galvanized, ASTM A 392, Class II.

2.03 POSTS, RAILS AND BRACES

- A. End, Corner and Pull Posts:
 - 1. The Contractor shall furnish end, corner and pull posts of the minimum size and weight as follows:
 - a. Up to 5 foot fabric height
 - (1) 2.375-inch OD pipe weighing 3.65 pounds per linear ft.
 - (2) 2.50-inch square tubing weighing 5.59 pounds per linear foot.
 - b. Over 5 foot fabric height
 - (1) 2.875-inch OD pipe weighing 5.79 pounds per linear foot.
 - (2) 2.50-inch square tubing weighing 5.59 lbs. per linear foot.
- B. Line Post:
 - 1. The Contractor shall furnish line posts of the minimum sizes and weight as follows. Post shall be spaced 10 foot o.c. maximum, unless otherwise indicated:
 - a. Up to 5 foot fabric height.
 - (1) 1.90-inch OD pipe weighing 2.72 pounds per linear foot.
 - b. Over 5 foot fabric height.
 - (1) 2.375-inch OD pipe weighing 3.65 pounds per linear foot.
- C. Gate Posts:
 - 1. The Contractor shall furnish gate posts for supporting single gate leaf, or one leaf of a double gate installation, for nominal gate widths as follows:
 - a. Up to 6 feet wide.
 - (1) 2.875-inch OD pipe weighing 5.79 pounds per linear foot.
 - (2) 2-1/2 inch square tubing weighing 5.59 pounds per linear foot.
 - b. Over 6 feet and up to 13 feet wide.
 - (1) 4-inch OD pipe weighing 9.11 pounds per linear foot.
 - c. Over 13 feet and up to 18 feet wide.

- (1) 6.625 inches OD weighing 18.97 pounds per linear foot.
- d. Over 18 feet.
- (1) 8.625 inches OD weighing 28.55 pounds per linear foot.

D. Top Rails:

- 1. The Contractor shall furnish the following top rails unless otherwise indicated:
 - a. 1.660-inch OD pipe weighing 2.27 pounds per linear foot.

E. Post Brace Assembly:

- 1. The Contractor shall furnish bracing assemblies at the end, gate, at both sides of corner and pull posts, with the horizontal brace located at mid-height of the fabric.
- 2. Use 1.660-inch OD pipe weighing 2.27 pounds per linear foot for horizontal brace and 3/8-inch diameter rod with turnbuckles for diagonal truss.

F. Tension Wire:

- 1. The Contractor shall furnish tension wire consisting of galvanized 0.177 inch (7 gage) coiled spring wire as per ASTM A824 at the bottom of the fabric only.

G. Barbed Wire Supporting Arms:

- 1. The Contractor shall furnish pressed steel, wrought iron, or malleable iron barbed wire supporting arms, complete with provisions for anchorage to posts and attaching three rows of barbed wire to each arm. Supporting arms may be attached either to posts or integral with post top weather cap. The Contractor shall provide a single 45 degree arm for each post where indicated.

H. Barbed Wire:

- 1. The Contractor shall furnish barbed wire. It shall be 2 strand, 12-1/2 gauge wire with 14 gauge, 4-point barbs spaced 5-inch o.c., galvanized, complying with ASTM A121, Class 3.

I. Post Tops:

- 1. The Contractor shall furnish post tops. Tops shall be pressed steel, wrought iron, or malleable iron of ASTM F626 designed as a weathertight closure cap (for tubular posts). The Contractor shall furnish one cap for each post unless equal protection is afforded by a combination of post top cap and barbed wire supporting arm. The Contractor shall furnish caps with openings to permit through passage of the top rail.

J. Stretcher Bars:

- 1. The Contractor shall furnish stretcher bars. Bars shall be one piece lengths equal to the full height of the fabric, with a minimum cross-section of 3/16-inch x 3/4-inch. The Contractor shall provide one stretcher bar for each gate and end post and two bars for each corner and pull post, except where fabric is integrally woven into the post.

K. Stretcher Bar Bands:

- 1. The Contractor shall furnish stretcher bar bands. Bands shall be steel, wrought iron, or

malleable iron, a maximum space of 15-inch o.c. to secure stretcher bars to end, corner, pull and gate posts.

2.04 GATES

- A. The Contractor shall provide fabricated gate perimeter frames of tubular members. Additional horizontal and vertical members shall ensure proper gate operation and attachment of fabric, hardware and accessories. The maximum space of the frame members shall not be more than 8-inches apart. Fabrication is as follows:
1. Up to 5 feet high, or leaf width 8 feet or less.
 - a. 1.660-inch OD pipe weighing 2.27 pounds per linear foot.
 - b. 1.5 inch sq. tubing weighing 2.27 pounds per linear foot.
 2. Over 5 feet high, or leaf width exceeding 8 feet.
 - a. 1.90 inch OD pipe weighing 2.72 pounds per linear foot.
 - b. 2-inch square tubing weighing 2.60 pounds per linear foot.
- B. The Contractor shall assemble gate frames by welding or with special malleable or pressed steel fittings and rivets for rigid connections. He shall use the same fabric width as for the fence, unless otherwise indicated in the Contract Documents or authorized by the Owner/Engineer. He shall install the fabric with stretcher bars at vertical edges. The bars may also be used at the top and bottom edges. The contractor shall attach stretchers to the gate frame at a maximum spacing of 15-inch o.c. He shall attach the hardware with rivets or by other means which will prevent removal or breakage.
- C. The Contractor shall install diagonal cross-bracing consisting of 3/8-inch diameter adjustable length truss rods on gates as necessary to ensure frame rigidity without sag or twist.
- D. The Contractor shall install barbed wire above the gates. He shall extend the end members of gate frames 12-inches above the top member which will be prepared for three strands of wire. The Contractor shall provide necessary clips for securing wire to extensions.
- E. Gate Hardware:
1. The Contractor shall furnish the following hardware and accessories for each gate.
 - a. Hinges: Pressed or forged steel or malleable iron to suit gate size, non-lift-off type, offset to permit 180 degrees gate opening. Provide 1-1/2 pair of hinges for each leaf over six feet nominal height.
 - b. Latch: Forked type of plunger-bar type to permit operation from either side of gate with padlock eye as integral part of latch.
 - c. Keeper: Provide keeper for all vehicle gates, which automatically engages the gate leaf and holds it in the open position until manually released.
 - d. Double Gates: Provide gate stops for double gates, consisting of mushroom type of flush plate with anchors. Set in concrete to engage the center drip drop rod or plunger bar. Include locking device and padlock eyes as an integral part of the latch, using one padlock for locking both gate leaves.
 - e. Where gates are between masonry piers, provide "J" with 4-inch square anchor plate to masonry contractor for building in.

2.05 MISCELLANEOUS MATERIALS AND ACCESSORIES

- A. Wire Ties: The Contractor shall tie fabric to line posts. He shall use 9 gauge wire ties spaced 12-inches o.c. For tying fabric to rails and braces, he shall use 9 gauge wire ties spaced 24-

inches o.c. For tying fabric to tension wire, he shall use 11 gauge hog rings spaced 24-inches o.c. The finish of ties shall match the fabric finish.

- B. Concrete: The Contractor shall provide portland cement concrete in compliance with ASTM C-150 and the Contract Documents. Aggregates shall comply with ASTM C-33. The Contractor shall mix the materials to obtain a minimum 28-day compressive strength of 2500 psi, using a minimum of 4 sacks of cement per cubic yard, a maximum size aggregate of 1-inch, a maximum 3-inch slump and air entrainment of 2 percent to 4 percent.
- C. Privacy Decorative Slating (PDS) shall be PVC, bottom locking, non-fin type, sized to match the fabric height and color in both the fence and gates.

PART 3 EXECUTION

3.01 INSTALLATION

- A. The Contractor shall not start the fence installation prior to the final grade completion, and the finish elevations established, unless otherwise authorized by the Owner/Engineer.
- B. The Contractor shall repair damaged coatings in the shop or in the field by recoating utilizing manufacturers recommended repair compounds and as applied per manufacturer's recommendations.
- C. Excavation:
 - 1. For post footings, the Contractor shall drill holes in firm, undisturbed or compacted soil of the diameters and spacings shown or called out in the Contract Documents.
 - a. For holes not shown or called out on the Contract Documents, the Contractor shall excavate minimum diameters recommended by the fence manufacturer.
 - b. Post holes shall be in true alignment and of sufficient size to provide a permanent concrete foundation. Concrete shall be poured against undisturbed earth sides and bottom. All holes shall be 48-inches deep with posts and corner posts placed in the concrete to a depth of 36-inches. The gate posts shall be set in the concrete to a depth of 42-inches below the surface in firm, undisturbed soil. Holes shall be well centered on the posts. A minimum diameter of 12-inches shall be required for all post holes.
 - c. Excavated soil shall be removed from the Owner's property.
 - d. If solid rock is encountered near the surface, the Contractor shall drill into rock at least 12-inches for line posts and at least 18-inches for end, pull, corner or gate posts. Hole shall be drilled to at least 1-inch greater diameter than the largest dimension of the post to be place.
 - e. If the Contractor encounters solid rock below solid overburden, he shall drill to the full depth required; however, rock penetration need not exceed the minimum depths specified.
- D. Setting Posts:
 - 1. The Contractor shall remove loose and foreign materials from the sides and bottoms of holes, and moisten soil prior to placing concrete.
 - a. Center and align posts in holes above bottom of excavation.
 - b. Place concrete around posts in a continuous pour and vibrate or tamp for consolidation. Check each post for vertical and top alignment and hold in position during placement and finishing operations. The top of concrete shall

extend 2-inches above finish grade.

- c. Trowel finish tops of footings and slope or dome to direct water away from posts. Extend footings for gate posts to the underside of bottom hinge. Set keeps, stops, sleeves and other accessories into concrete as required.
- d. Keep exposed concrete surfaces moist for at least 7 days after placement, or cure with membrane curing materials, or other acceptable curing method.
- e. Grout-in posts set into sleeved holes, concrete constructions, or rock excavations with non-shrink portland cement grout, or other acceptable grouting material.

E. Concrete Strength:

The Contractor shall allow the concrete to attain at least 75% of its minimum 28-day compressive strength no sooner than 7 days after placement, before rails, tension wires, barbed wire, or fabric is installed. The Contractor shall not stretch and tension fabric or wires and shall not hang gates until the concrete has attained its full design strength.

F. Top Rails:

The Contractor shall run the rail continuously through post caps or extension arms and bend to radius for curved runs. He shall provide expansion coupling as recommended by fencing manufacturer.

G. Brace Assemblies:

The Contractor shall install braces so that posts are plumb when diagonal rod is under proper tension.

H. Tension Wire:

The Contractor shall install tension wires by weaving through the fabric and tying to each post with not less than 0.170 inch galvanized wire, or by securing the wire to the fabric.

I. Fabric:

The Contractor shall leave approximately 3-inches between finish grade and bottom salvage, except where the bottom of the fabric extends into the concrete. He shall pull the fabric taut and tie it to posts, rails and tension wires. He shall install fabric on the security side of the fence and anchor it to the framework so that the fabric remains in tension after the pulling force is released.

J. Stretcher Bars:

The Contractor shall thread through or clamp the bars to the fabric 4-inches o.c. and secure them to posts with metal bands spaced 15-inches o.c.

K. Barbed Wire:

The Contractor shall install 3 parallel wires on each extension arm on the security side of fence, unless otherwise indicated. He shall pull the wire taut and fasten securely to each extension arm.

L. Gate:

The Contractor shall install gates plumb, level and secure for full opening without interference. He shall install ground-set items in concrete for anchorage, as recommended by the fence manufacturer. He shall adjust hardware for smooth operation and lubricate where necessary.

M. Tie Wires:

The Contractor shall use U-shaped wire, conforming to the diameter of the attached pipe, and shall clasp the pipe and fabric firmly with twisted ends of at least 2 full turns. He shall bend the end of the wire to minimize hazard to persons or clothing.

N. Fasteners:

The Contractor shall install nuts for tension band and hardware bolts on the side of fence opposite the fabric side. Pen ends of bolts or score threads to prevent removal of nuts.

3.02 INSTALLATION

- A. Fence shall be constructed such that each run of fence between corner posts or gate posts has equal spacing between the line posts. Spacing shall not exceed 10 feet, and shall not exceed 8 feet for fabric with privacy decorative slatting.

END OF SECTION

SECTION 02480 LANDSCAPING

PART 1 GENERAL

1.10 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment, and incidentals required to install trees, ground cover, and shrubs, to place accessory planting materials, to maintain and guarantee all planted areas. All work shall be in strict accordance with sound nursery practice and shall include maintenance and watering of all of the work of this Contract until final completion and acceptance by the Owner.
- B. The landscaping shall be performed by a contractor or subcontractor who specializes in landscaping and who is fully familiar and experienced in projects of this type and scope. The landscaping contractor or subcontractor shall be subject to the approval of the Engineer.
- C. The Contractor shall provide all landscaping complete and ready for use as specified in the Contract Documents and as shown on the Drawings.

1.02 SUBMITTALS

- A. The Contractor shall submit to the Owner/Engineer for review and approval, shop drawings and complete written maintenance instructions for each type of plant furnished under this Contract.
- B. The Contractor shall submit representative samples of any or all of required accessory planting materials as requested by the Owner/Engineer.

1.03 OBSTRUCTIONS BELOW GROUND

- A. The Owner/Engineer may change the location of plant material if underground construction, utilities or obstructions are encountered in excavation of planting areas or pits.
- B. The Contractor shall make such changes without additional compensation from the Owner.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Plant species and size shall conform to those indicated in the Plant List and in plan locations shown on the Drawings. Nomenclature shall conform to the Florida Department of Agriculture: "Grades and Standards for Nursery Plants". The designated authority for identification of plants shall be in conformance with FDOT Standard Specification Section 580-2.1.1 Plants.
- B. Plants shall be sound, healthy, vigorous, free from plant diseases, insects, pests, or their eggs and shall have healthy normal root systems. Plants shall be nursery grown stock, freshly dug. No heeled in, cold storage, or collected stock shall be accepted.
- C. Shape and Form

1. Plant material shall be symmetrical, typical for the variety and species, and shall conform to the measurements specified in the Plant List.
 2. Plants used where symmetry is required shall be matched as nearly as possible.
 3. Plants shall not be pruned prior to delivery except as authorized by the Owner/Engineer.
 4. All plants shall have been transplanted or root pruned at least once in the past three years.
 5. Unless otherwise noted, street trees shall be free of branches up to six feet, with the single leader well branched, and with straight trunks.
 6. Shrubs shall have been transplanted twice, have fully developed root systems, be heavily canned with foliage to base, fulfill dimensions required, and be typical of species.
 7. Ground covers shall have sturdy fibrous root systems and shall be heavily leafed.
- D. Measurement: The height and/or width of trees shall be measured from the ground or across the normal spread of branches with the plants in their normal position. This measurement shall not include the immediate terminal growth.
- E. Substitutions in plant species or size shall be made only with the written approval of the Engineer.
- F. Ground cover plants shall be planted in beds of four inches of approved topsoil. The beds shall be thoroughly disked into the soil. The compacted and settled finished surface shall be set to the required grade. Plants shall be spaced as described in the Contract Documents or shown on the Contract Drawings, or otherwise directed by the Owner/Engineer and in accordance with the best practices of the trade.
- G. Planting Soil
1. Soil for backfilling around plants and planting beds shall be a good grade of garden loam as approved by the Owner/Engineer. Soil shall be free of heavy clay, coarse sand, stones, lumps, sticks, or other foreign material. The soil shall not be delivered or used in a muddy condition.
 2. The soil shall be taken from ground that has never been stripped. There shall be a slight acid reaction to the soil with no excess of calcium or carbonate. The soil shall be free from excess weeds or other objectionable material.
 3. Soil for trees and shrubs shall be delivered in a loose, friable condition. All trees shall average approximately one cubic yard per tree, except Sabal Palmetto, which shall be planted with clean sand. There shall be a minimum of 4-inches of planting soil in ground cover areas and 1/8 cubic yard per shrub or vine.
 4. No marl shall be allowed in ground cover planting beds.
- H. Before plants are backfilled with planting soil, fertilizer tablets, Agriform 20-10-5 or equal, shall be placed in each pit. The Contractor shall provide three tablets for each tree and one for each shrub or vine.
- I. Tree Staking: All tree staking and bracing shall be included herein in accordance with sound nursery practice and shall be in accordance with the Contract Documents. The Contractor shall furnish all materials required for staking and bracing as approved.
- J. Landscaping stones shall be inert and nonleaching. The Contractor shall provide physical samples for approval prior to installation. Crushed limerock shall not be

acceptable.

PART 3 EXECUTION

3.01 PLANTING PROCEDURES

- A. Plant Locations: All plants shall be located as shown on the Drawings, to dimensions if shown, to scale if not dimensioned. Large areas or beds shall be scaled and the plants spaced evenly. Approval by the Engineer is required before any plants may be installed.
- B. Tree Pits: Pits for trees shall be at least two feet greater in diameter than the specified diameter of the ball. Pits shall be of sufficient depth to allow a 12-inch layer of planting soil under the ball when it is set to grade. Bottom of pit shall be loosened prior to backfilling.
- C. Digging and Handling
 - 1. Plants shall be handled at all times so that roots or balls are adequately protected from sun or drying winds. Tops or roots of plant allowed to dry out will be rejected.
 - 2. Balled and burlapped plants shall be moved with firm, natural balls of soil, not less than one foot diameter of ball to every one inch caliper of trunk, and a depth of not less than 2/3 of ball diameter. No plant shall be accepted when the ball of earth surrounding its roots has been cracked or broken. All trees, except palms, shall be dug with ball and burlapped. Root pruning shall have been done at minimum of four weeks before planting at the job.
 - 3. Bare root plants shall be dug with spread of root and of sufficient depth to insure full recovery of plant.
- D. Cabbage Palms (Sable Palmetto):
 - 1. Cabbage Palms shall be taken from moist black sand areas. Only a minimum of fronds shall be removed from the crown to facilitate moving and handling. Clear trunk or overall height shall be as specified after the minimum of fronds have been removed.
 - 2. Cabbage Palms buds shall be tied to a suitable support with a burlap strip, to be left in place until the tree is well established in its new location.
 - 3. Cabbage Palms shall be planted in sand, thoroughly washed in during planting operations, and with a dished or saucer depression left at the soil line for future waterings. Palms with marred or burned trunks will be accepted at the discretion of the Engineer only.
 - 4. Trees moved by winch or crane shall be thoroughly protected from chain marks, girdling or bark slippage by means of burlap, wood battens, or other approved method.
- E. When balled or burlapped plants are set, planting soil shall be carefully tamped under and around the base of the balls to prevent voids. All burlap, rope, wires, etc., shall be removed from the sides and tops of balls, but no burlap shall be pulled from underneath. Roots of bare rooted plants shall be properly spread out and planting soil carefully worked in among them.
- F. All plants shall be set straight or plumb, in locations shown on the Drawings. Except as

otherwise specified, plants shall be planted in pits which shall be set at such level that, after settlement, they bear the same relation to the finished grade or the surrounding ground as they bore to the grade of the soil from which they are taken.

- G. Pruning shall be carefully done by experienced plantsmen. Prune immediately upon acceptance by the Owner, including any broken branches, thinning small branches and tipping back main branches (except main leaders).
- H. Excess soil and debris shall be disposed of off the project site unless ordered stockpiled by the Engineer.

3.02 NORMAL MAINTENANCE OF PLANT MATERIALS

- A. Plant material maintenance shall begin when planting operations start and shall extend until final acceptance of work.
- B. Maintain all plant materials under this Contract to the satisfaction of the Engineer. Maintenance shall include necessary watering, cultivation, weeding, pruning, spraying, tightening and repair to guy wires, removal of dead material, resetting, and other work required to conform with referenced standards and accepted nursery standards as approved.
- C. Plant materials which are in a tilted or in a leaning position shall be properly righted.
- D. After final acceptance by the Owner and until one calendar year after acceptance of all plantings, the landscaping contractor or subcontractor shall make monthly inspections of materials and report in writing to the Engineer the conditions of the plants and the necessary requirements to keep the plants in a healthy growing condition.

3.03 TREE AND PLANT PROTECTION

- A. The Contractor shall remove all trees (if any) within the limit of landscaping shown on the detail sheet except those designated to be salvaged (if any). Prior to removal of said trees, the Contractor shall obtain a tree removal permit, if required. All other trees in the vicinity of the work shall be protected against damage by the Contractor until all work under the Contract has been completed.
- B. Consult with the Engineer, and remove agreed-on roots and branches which interfere with construction. Employ qualified tree surgeon to remove, and to treat cuts.
- C. Provide temporary barriers to a height of six feet around each group of trees and plants.
- D. Protect root zones of trees and plants
 - 1. Do not allow vehicular traffic or parking.
 - 2. Do not store materials or products.
 - 3. Prevent dumping or refuse or chemically injurious materials or liquids.
 - 4. Prevent puddling or continuous running water.
- E. Carefully supervise excavating, grading, and filling, and subsequent construction operations, to prevent damage.
- F. In case of inadvertent damage to any tree or plant by the Contractor or any of his

subcontractors or employees, the Contractor shall provide replacement of each such damaged tree or plant with a new one of acceptable type, size and quality.

- G. Completely remove barricades, including foundations, when construction has progressed to the point that they are no longer needed, and when approved by the Engineer.
- H. Clean and repair damage caused by installation, fill and grade the areas of the site to required elevations and slopes, and clean the area.

3.04 GUARANTEE

The life and satisfactory condition of all plant material planted shall be guaranteed by the Contractor for a minimum of one calendar year. Guarantee shall include complete replacement with material of the same kind and size as in the original work if not in a healthy condition, as determined by the Engineer, at the end of the guarantee period.

3.05 REPLACEMENT

- A. At the end of the guarantee period, any plant required under this Contract that is dead or not in satisfactory growth as determined by the Engineer, shall be removed. Plants replaced shall be guaranteed for 90 days after date of replacement.
- B. Replacement of plants necessary during guarantee period shall be the responsibility of the Contractor, except for possible replacements of plants resulting from removal, vandalism, acts of neglect on the part of others, or acts of God.
- C. All replacements shall be plants of the same kind and size as specified in the Drawings. They shall be furnished and planted as herein specified. The cost shall be the responsibility of the Contractor.

END OF SECTION

SECTION 02485 SEEDING AND SODDING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials and equipment necessary to satisfactorily return all construction areas to their original conditions or better.
- B. Work shall include furnishing and placing seed or sod, fertilizing, planting, watering and maintenance until acceptance by Engineer/Owner.

1.02 RELATED WORK NOT INCLUDED

Excavation, filling and grading required to establish elevation shown on the Drawings are included under other sections of these Specifications.

1.03 QUALITY ASSURANCE

- A. It is the intent of this Specification that the Contractor is obliged to deliver a satisfactory stand of grass as specified. If necessary, the Contractor shall repeat any or all of the work, including grading, fertilizing, watering and seeding or sodding at no additional cost to the Owner until a satisfactory stand is obtained. For purposes of grassing, a satisfactory stand of grass is herein defined as a full lawn cover over areas to be sodded or seeded, with grass free of weeds, alive and growing, leaving no bare spots larger than 3/4 square yard within a radius of 8 feet.
- B. All previously grassed areas where pipelines are laid shall be sodded. All sodding and grassing shall be installed in accordance with these Specifications or as directed by the Engineer.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Fertilizer: The fertilizer shall be of the slow-release type meeting the following minimum requirements: 12 percent nitrogen, 8 percent phosphorus, 8 percent potassium; 40 percent other available materials derived from organic sources. At least 50 percent of the phosphoric acid shall be from normal super phosphate or an equivalent source which will provide a minimum of two units of sulfur. The amount of sulfur shall be indicated on the quantitative analysis card attached to each bag or other container. Fertilizer shall be uniform in composition, dry and free flowing delivered to sites in original unopened containers bearing manufacturer's statement or guarantee.
- B. Seeding/Grassing: The Contractor shall grass all unpaved areas disturbed during construction which do not require sod. All grassing shall be completed in conformance with FDOT Specifications, Sections 570 and 981. The grassed areas shall be mulched and fertilized in accordance with FDOT Specifications, except that no additional payment will be made for mulching, fertilizing and/or watering.
- C. Sodding: Sod shall be provided as required on the construction drawings or at locations as directed by the Engineer in accordance with Florida Department of Transportation, Specifications Section 575 and 981. The Contractor shall furnish bahia grass sod or match

existing sod. Placement and watering requirements shall be in accordance with FDOT Specifications Section 575, except that no additional payment will be made for placement and/or watering. This cost shall be included in the Contract price bid for sodding.

- D. Topsoil: Topsoil stockpiled during excavation may be used as necessary. If additional topsoil is required to replace topsoil removed during construction, it shall be obtained off site at no additional cost to the Owner. Topsoil shall be fertile, natural surface soil, capable of producing all trees, plants and grassing specified herein.
- E. Water: It is the Contractor's responsibility to supply all water to the site, as required during seeding and sodding operations and through the maintenance period and until the work is accepted. The Contractor shall make whatever arrangements that may be necessary to ensure an adequate supply of water to meet the needs for his work. He shall also furnish all necessary hose, equipment, attachments and accessories for the adequate irrigation of lawns and planted areas as may be required. Water shall be suitable for irrigation and free from ingredients harmful to plant life.

PART 3 EXECUTION

3.01 INSTALLATION

- A. When the trench backfill has stabilized sufficiently, the Contractor shall commence work on lawns and grassed areas, including fine grading as necessary and as directed by the Engineer.
- B. Finish Grading: Areas to be seeded or sodded shall be finish graded, raked, and debris removed. Soft spots and uneven grades shall be eliminated. The Engineer shall approve the finish grade of all areas to be seeded or sodded prior to seed or sod application.
- C. Protection: Seeded and sodded areas shall be protected against traffic or other use by placing warning signs or erecting barricades as necessary. Any areas damaged prior to acceptance by the Owner shall be repaired by the Contractor as directed by the Engineer.

3.02 CLEANUP

Soil or similar materials spilled onto paved areas shall be removed promptly, keeping those areas as clean as possible at all times. Upon completion of seeding and sodding operations, all excess soil, stones and debris remaining shall be removed from the construction areas.

3.03 LANDSCAPE MAINTENANCE

- A. Any existing landscape items damaged or altered during construction by the Contractor shall be restored or replaced as directed by the Engineer.
- B. Maintain landscape work for a period of 90 days immediately following complete installation of work or until Owner accepts project. Watering, weeding, cultivating, restoration of grade, mowing and trimming, protection from insects and diseases, fertilizing and similar operations as needed to ensure normal growth and good health for live plant material shall be included at no additional cost to the Owner.

3.04 REPAIRS TO LAWN AREAS DISTURBED BY CONTRACTOR'S OPERATORS

Lawn areas planted under this Contract and all lawn areas damaged by the Contractor's

operation shall be repaired at once by proper soil preparation, fertilizing and sodding, in accordance with these Specifications.

END OF SECTION

SECTION 02615 DUCTILE IRON PIPE AND FITTINGS

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required to install ductile iron pipe and restrained joint ductile iron pipe and cast iron or ductile iron restrained joint fittings, complete, as shown on the Drawings and specified in these Standards.
- B. Fittings are noted on the drawings for the Contractor's convenience and do not relieve him from laying and jointing different or additional items where required.
- C. The Contractor shall furnish all labor, materials, equipment and incidentals required to install push-on joint or restrained joint ductile iron pipe, complete as shown on the Drawings and Specifications.
- D. Newly installed pipe shall be kept clean and free of all foreign matter. All DI pipe installed underground shall be poly wrapped unless noted otherwise on the plans.

1.02 SUBMITTALS

- A. The Contractor shall submit to the Engineer, within ten days after receipt of Notice to Proceed, a list of materials to be furnished, the names of the suppliers and the appropriate shop drawings for all ductile iron pipe and fittings.
- B. The Contractor shall submit the pipe manufacturer's certification of compliance with the applicable sections of the Specifications.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Ductile iron pipe shall conform to ANSI/AWWA C150/A21.50 and ANSI/AWWA C151/A21.51. Thickness of pipe shall be Class 50 or pressure Class 350. All pipe not buried shall be Class 53. All ductile iron pipe shall be clearly marked on the outside of the barrel to readily identify it from cast iron.
- B. Unrestrained joint pipe shall be supplied in lengths not to exceed 21 feet. Unless otherwise called for in the Contract Documents, unrestrained joint pipe shall be either the rubber-ring type push-on joint or standard mechanical joint pipe as manufactured by the American Cast Iron Pipe Company, U.S. Pipe and Foundry Company, or approved equal.
- C. All fittings shall be pressure rated for 350 psi and meet the requirement of AWWA C110 or AWWA C153. Rubber gaskets shall conform to ANSI A21.11 for mechanical and push-on type joints for diameters up to 14" diameter. Gaskets for 16" diameter and larger pipe shall be EPDM (Ethylene-Propylene Dine Monomer) such as the "Fastite Gasket" of American Ductile Iron Pipe Co., or approved equal.
- D. Water Mains: All ductile iron pipe and fittings shall have a standard thickness cement lining on the inside in accordance with AWWA/ANSI C104/A21.4 and a coal tar enamel coating on the outside. The coal tar enamel shall be in accordance with ANSI A21.4. All interior linings shall be EPA/NSF approved.

- E. Force Main Fittings: All ductile iron fittings shall have a factory applied fusion bonded epoxy or epoxy and polyethylene lining on the inside in accordance with manufacturer's specifications and a coal tar enamel coating on the outside. The coal tar enamel shall be in accordance with ANSI A21.4. The interior lining is to be based on manufacturer's recommendation for long-term exposure to raw sewage. It shall have a minimum ten year warranty covering failure of the lining and bond failure between liner and pipe.
- F. Restrained joints shall be provided at all horizontal and vertical bends and fittings, at casings under roads and railroads and at other locations shown on the Contract Drawings. Restrained joint pipe fittings shall be designed and rated for the following pressures: 350 psi for pipe sizes up to and including 24" diameter; 250 psi for pipe sizes 30" diameter and above.

2.02

IDENTIFICATION

- A. Each length of pipe and each fitting shall be marked with the name of the manufacturer, size and class and shall be clearly identified as ductile iron pipe. All gaskets shall be marked with the name of the manufacturer, size and proper insertion direction.
- B. Pipe shall be poly wrapped blue for potable water mains, purple for reclaimed water mains and green for sewage force mains. All potable water pipe shall be NSF certified and copies of lab certification shall be submitted to the Engineer.

END OF SECTION

SECTION 02620 POLYETHYLENE (PE) PRESSURE PIPE

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required to install polyethylene pressure pipe, fittings and appurtenances as shown on the Drawings and specified in the Contract Documents and these Standards.
- B. Newly installed pipe shall be kept clean and free of all foreign matter & gouges.
- C. All pipe shall be correctly color coded / identified.

1.02 QUALIFICATIONS

All polyethylene pipe, fittings and appurtenances shall be furnished by a single manufacturer who is fully experienced, reputable and qualified in the manufacture of the items to be furnished.

1.03 SUBMITTALS

- A. The Contractor shall submit to the Engineer, within ten days after receipt of Notice to Proceed, a list of materials to be furnished, the names of the suppliers and the appropriate shop drawings for all polyethylene pipe and fittings.
- B. The Contractor shall submit the pipe manufacturer's certification of compliance with the applicable sections of the Specifications.
- C. The Contractor shall submit shop drawings showing installation method and the proposed method and specialized equipment to be used.

PART 2 PRODUCTS

2.01 POLYETHYLENE PRESSURE PIPE

- A. Polyethylene pipe 4" diameter and larger shall be high-density PE 3408 polyethylene resin per ASTM D 3350, Cell Classification 345464C, Class 160, DR 11, CPChem DriscoPlex 4000, 4300 or 4500 or an approved equal, meeting the requirements of AWWA C906. All pipe materials used in potable water systems shall comply with NSF Standard 61. Outside diameters of water, reclaimed water and pressure sewer HDPE pipes shall be ductile iron size (DIPS).
- B. Polyethylene pipe and tubing 3" diameter and smaller shall be pressure Class 200, DR 9 "Driscopipe 5100", Endo Pure by Endot, or equal, meeting the requirements of AWWA C901 (latest revision) and the following ASTM requirements:

Material Designation PPI/ASTM PE 3408
Material Classification ASTM D-1248 III C5 P34
Cell Classification ASTM D-3350

2.02 JOINTS

- A. Where PE pipe is joined to PE pipe, it shall be by thermal butt fusion. Thermal fusion shall be accomplished in accordance with the written instructions of the pipe manufacturer and fusion equipment supplier. The installer of the thermal butt fused PE pipe shall have received training in heat fusion pipe joining methods and shall have had experience in performing this type of work.
- B. Where thermal butt fusion cannot be used, or when specifically called for on the plans, electro-fused couplings may be used. Fusion shall be in accordance with the written instructions of the fitting manufacturer.
- C. Flanged joints, mechanical joints, tapping saddles, and molded fittings shall be in accordance with AWWA C901, C906 or C909, ASTM D3350 and D3140, as applicable. Fusion and mechanical connections are allowed, chemical (solvents, epoxies, etc.) are not allowed.

2.03 DETECTION

- A. Direct buried HDPE pipe shall have 3" detectable metallic tape of the proper color placed directly above the pipe and 12" below finished grade or 6" detectable tape between 12" and 24" below finished grade.
- B. Direct buried or horizontal directional drilled HDPE pipe shall also have a tracer wire installed along the pipe alignment. The tracer wire to be used shall be a solid, 10 gauge, high strength, copper clad steel wire with a polyethylene jacket of appropriate color manufactured by Copperhead Industries or Manatee County approved equal.

2.04 IDENTIFICATION

- A. Pipe shall bear identification markings in accordance with AWWA C906.
- B. Pipe shall be color coded blue for water, purple (Pantone 522 C) for reclaimed water or green for pressure sewer using a solid pipe color or embedded colored stripes. Where stripes are used, there shall be a minimum of three stripes equally spaced.

PART 3 EXECUTION

3.01 INSTALLING POLYETHYLENE PRESSURE PIPE AND FITTINGS

All polyethylene pressure pipe shall be installed by direct bury, directional bore, or a method approved by the Owner/Engineer prior to construction. If directional bore is used, or if directed by the Owner/Engineer, the entire area of construction shall be surrounded by silt barriers during construction.

3.02 INSPECTION AND TESTING

All pipelines shall remain undisturbed for 24 hours to develop complete strength at all joints. All pipelines shall be subjected to a hydrostatic pressure and leak test per section 02617.

END OF SECTION

SECTION 02622 POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS (AWWA SPECIFICATIONS C-900 & C-905)

PART 1 GENERAL

1.01 SCOPE OF WORK

The Contractor shall furnish all labor, materials, equipment and incidentals required to install the plastic piping, fittings and appurtenances complete and ready for use as specified in the Contract Documents and these Standards.

1.02 DESCRIPTION OF SYSTEM

The Contractor shall install the piping in the locations as shown on the Drawings.

1.03 QUALIFICATIONS

All plastic pipe, fittings and appurtenances shall be furnished by a single manufacturer who is fully experienced, reputable, qualified and specializes in the manufacture of the items to be furnished. The pipe and fittings shall be designed, constructed and installed in accordance with the best practices and methods and shall comply with these Specifications.

1.04 SUBMITTALS

- A. The Contractor shall submit shop drawings to the Engineer including, but not limited to, dimensions and technical specifications for all piping.
- B. The Contractor shall submit to the Engineer, samples of all materials specified herein.
- C. The Contractor shall submit and shall comply with pipe manufacturer's recommendation for handling, storing and installing pipe and fittings.
- D. The Contractor shall submit pipe manufacturer's certification of compliance with these Specifications.

1.05 TOOLS

The Contractor shall supply special tools, solvents, lubricants, and caulking compounds required for proper installation.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Pressure Class-Rated Polyvinyl Chloride (PVC) Pipe
 - 1. Pressure class-rated PVC pipe and accessories four to twelve inches (4"-12") in diameter, shall meet the requirements of AWWA Specification C-900 "Polyvinyl Chloride (PVC) Pressure Pipe". Pipe shall be Class 150, meeting requirements of Dimension Ratio (DR) 18 and shall have the dimension of ductile iron outside diameters. Each length of pipe shall be hydrotested to four (4) times its class pressure by the manufacturer in accordance with AWWA C-900.
 - 2. PVC pipe 14" through 36" shall meet the requirements of AWWA Standard C-905,

Polyvinyl Chloride (PVC) Water Transmission Pipe. Pipe 14" thru 24" for potable and reclaim water shall meet the requirements for dimension ratio (DR) 18. Each length of pipe shall be tested at twice the pressure rating (PR 235 psi) for a minimum dwell of 5 seconds in accordance with AWWA C-905. Fourteen inch (14") thru 36" PVC pipe for sewer force mains shall meet AWWA C-905 requirements for dimension ratio (DR) 21.

Each length of pipe shall be tested at twice the pressure rating (PR 200 psi) for a minimum dwell of five seconds in accordance with AWWA C-905. Pipe shall be listed by Underwriters Laboratories. Provisions shall be made for expansion and contraction at each joint with an elastomeric ring, and shall have an integral thickened bell as part of each joint. PVC Class pipe shall be installed as recommended by the manufacturer. Pipe shall be furnished in nominal lengths of approximately 20 feet, unless otherwise directed by the Engineer. Pipe and accessories shall bear the NSF mark indicating pipe size, manufacturer's names, AWWA and/or ASTM Specification number, working pressure, and production code.

3. Gaskets for 16" diameter and larger pipe used for potable water pipe shall be EPDM (Ethylene-Propylene Dine Monomer).
4. PVC pipe 3" and less in diameter may be constructed using pipe conforming to ASTM D2241 with push-on joints. Pipe shall be 200 psi pipe-SDR 21 unless otherwise specified by the Engineer. This PVC pipe shall not be used for working pressures greater than 125 psi.
5. Pipe shall be blue for potable water mains, green for sewage force mains and purple for reclaimed water mains. All potable water pipe shall be NSF certified and copies of lab certification shall be submitted to the Engineer.
6. Where colored pipe is unavailable, white PVC color coded spiral wrapped pipe shall be installed.

B. Joints

1. The PVC joints for pipe shall be of the push-on type unless otherwise directed by the Engineer so that the pipe and fittings may be connected on the job without the use of solvent cement or any special equipment. The push-on joint shall be a single resilient gasket joint designed to be assembled by the positioning of a continuous, molded resilient ring gasket in an annular recess in the pipe or fitting socket and the forcing of the plain end of the entering pipe into the socket, thereby compressing the gasket radially to the pipe to form a positive seal. The gasket and annular recess shall be designed and shaped so that the gasket is locked in place against displacement as the joint is assembled. The resilient ring joint shall be designed for thermal expansion or contraction with a total temperature change of at least 75 degrees F in each joint per length of pipe. The bell shall consist of an integral wall section with a solid cross section elastomeric ring which shall meet requirements of ASTM F-477. The thickened bell section shall be designed to be at least as strong as the pipe wall. Lubricant furnished for lubricating joints shall be nontoxic, shall not support the growth of bacteria, shall have no deteriorating effects on the gasket or pipe material, and shall not impart color, taste, or odor to the water. Gaskets shall be suitable for use with potable water, reclaimed water or sanitary sewer as applicable.
2. Restrained joints shall be provided at all horizontal and vertical bends and fittings, at casings under roads and railroads and at other locations shown on the Contract Drawings. PVC joints for pipe shall be restrained by the following methods: thrust blocks, restraining glands such as Certa-Lok Restraining Joint Municipal Water Pipe by the Certain Teed Corporation of Valley Forge, PA, or approved equal. All Grip, Star Grip by Star Products, MJR by Tyler Pipe, Tyler, Texas. Restrained joint PVC pipe shall be installed in strict accordance with the manufacturer's recommendation.

C. Fittings

1. All fittings for class-rated PVC pipe shall be ductile iron with mechanical joints and shall conform to the specifications for ductile iron fittings, unless otherwise directed. Class 200, C-900 PVC fittings are allowable for sewage force main applications up to and including 12" diameter only. DR ratio shall be the same as the pipe.
2. The manufacturer of the pipe shall supply all polyvinyl chloride accessories as well as any adapters and/or specials required to perform the work as shown on the Drawings and specified herein. Standard double bell couplings will not be accepted where the pipe will slip completely through the coupling.

PART 3 EXECUTION

3.01 INSTALLATION

The Contractor shall install the plastic pipe in strict accordance with the manufacturer's technical data and printed instructions. Direct bury pipe shall have 3" detectable metallic tape of the proper color placed directly above the pipe 12" below finished grade or 6" detectable tape between 12" and 24" below grade.

3.02 INSPECTION AND TESTING

- A. All pipe lines shall remain undisturbed for 24 hours to develop complete strength at all joints. All pipe lines shall be subjected to a hydrostatic pressure test for two (2) hours at full working pressure, but not less than 180 psi for water/reclaimed (150 psi for force main). All visible leaks shall be repaired and retested for approval by the County. Prior to testing, the pipe lines shall be supported in a manner approved by the Engineer to prevent movement during tests.

END OF SECTION

SECTION 02627 SANITARY SEWER MANHOLE AND WET WELL FIBERGLASS LINERS

PART 1 GENERAL

1.01 SCOPE OF WORK

The Contractor shall furnish all labor, equipment and materials required to install fiberglass liners with the largest diameter to fit inside the structure and leave a 2" to 3" annular space for grouting purposes.

1.02 SUBMITTALS

The Contractor shall submit to the Engineer manufacturer's data and detailed shop drawings in conformance with the Contract Documents.

1.03 GENERAL REQUIREMENTS

The Contractor shall complete work on individual manholes and wet wells without interruption to the sewage collection system. A sewage bypass system shall be used, as required and approved by the Engineer per Section 02720.

1.04 SAFETY REQUIREMENTS

- A. The Contractor shall provide adequate traffic control and take all necessary precautions for the protection of the work and the safety of the public. This includes, but is not limited to, barricades which shall flash from sunset to sunrise, barricades of substantial construction and night visibility and suitable warning signs, placed and illuminated at night as to show in advance where construction, barricades or detours exists. Traffic control warning signs and barricades which shall be in strict accordance with the provisions of the Florida Dept. of Transportation Manual of Traffic Controls and Safety Practices for Street and Highway Construction, Maintenance and Utility Operations, latest revision.
- B. Access to fire hydrants adjacent to the work area shall be provided for fire-fighting equipment at all times.

PART 2 PRODUCTS

2.01 MASONRY

- A. Brick: ASTM C32-91 or latest revision, Specification for Sewer and Manhole Brick (made from clay or shale). Sound, hard and uniformly burned, regular and uniform in shape and size, of compact texture. Grade MA.
- B. Cement: ASTM C150-92 or most recent revisions, specification for portland cement, Type II.
- C. Sand: Washed silica sand, ASTM C144, latest revision. specification for aggregate for masonry mortar.
- D. Concrete shall be 4000 PSI chat mix.
- E. Sprayed on surface protection system shall be in accordance with Section 09970

2.02 FIBERGLASS LINERS

- A. Fiberglass Reinforced Plastic (FRP) liners shall be one-piece construction FRP plain end cylinder pipe with an integral corbel design if required. Liner diameter shall fit into the existing structure. The Contractor shall measure the existing structure prior to construction and is responsible for the liner fit. The Contractor shall submit factory certification for fiberglass liners. The reducer cone, if required, shall have a modified hemispherical shape with at least a 3-inch high FRP reinforcement collar and a 4-inch minimum width flat surface to support adjustment rings for a cast-iron ring and cover. The cylinder pipe-to-reducer cone joint shall be factory-installed. No vertical seams or joints shall be allowed.
- B. FRP liners shall be fabricated with premium grade isophthalic polyester resin, fiberglass chopped strand, woven roving and continuous reinforcements. Sand filler shall not be permitted in the FRP laminate.
- C. FRP liners shall be designed and fabricated in accordance with ASTM D3753, FRP laminate shall conform to ASTM C582 and Chemical Resistance Tests shall conform to ASTM C581. FRP liners shall be chemically resistant to normal domestic sanitary sewer environments as well as corrosive soil, groundwater and sea water environments. Manhole liners shall be designed to withstand a 16,000 pound vertical dynamic wheel load (AASHTO H-20 loading).
- D. FRP liners shall be manufactured by an established national manufacturer with at least five years experience producing FRP sanitary sewer manhole liners.
- E. All liners delivered to the job site shall be inspected for the following prior to installation:
 - 1. Inside surfaces of each section shall be free of bles, dents, ridges, and other defects that result in a variation of inside diameter of more than 1/8-inch.
 - 2. The interior and exterior surfaces of the liner shall be completely free from pinholes, cracks, pits, or defects which is detrimental to the intended use of product. No liner will be installed which has apparent holes or openings which will permit the passage of liquid or gases through the liner well.
 - 3. Factory repairs shall not be permitted.
 - 4. On site repairs shall not be permitted.
 - 5. The FRP liner shall have a warranty against defects in material and workmanship for a period of one year.

2.03 MANHOLE INSERTS

The manhole inserts shall be as manufactured by FRW Industries, Conroe, Texas or equal. Inserts shall be complete with a self-cleaning relief valve. Relief valve shall operate on a pressure differential of 1/2 psi.

PART 3 EXECUTION

3.01 MANHOLE PREPARATION

- A. All concrete manholes shall be tested with a rebound or impact hammer. Testing procedures shall be those recommended by hammer manufacturer. The test area shall be between 2 and 3 feet above the benches or any area showing visible deterioration. Any concrete manhole testing below 2800 psi will be omitted from the rehabilitation specified within this bid. The Contractor shall submit five copies of test results to the Owner. The Owner shall have the right to verify any or all of the test results.

- B. The Contractor shall excavate an area around the top of the existing manhole sufficiently wide and deep for removal of soil, castings, ring and cover, and reducer corbel section.
- C. The Contractor shall remove the frame and cover, manhole insert and corbel cone section without damaging the existing manhole walls. Care is to be taken not to allow brick or soil to fall into the existing manhole. The Contractor shall remove or reinsert loose brick which protrude more than one inch from the interior wall of the manhole and which could interfere with the insertion of the fiberglass liner. If the shelf of the manhole invert is not level around the perimeter, form a flat shelf with mortar.
- D. The Contractor shall salvage manhole, frame and cover. Manhole inserts shall be salvaged if in working order. Corbel cone section shall be removed from site.
- E. The Contractor shall thoroughly clean manhole by high pressure water jet, 1500 psi high pressure steam acid wash, or wire brushing, then neutralize with a sodium carbonate solution. He shall remove all loose concrete, mortar, scale, brick or other deteriorated concrete or masonry prior to repair and shall prevent all scale, grit, sludge or other debris from entering the sewer system and remove and properly dispose of off the job site.
- F. The Contractor shall seal all leaks in manholes so that all infiltration is stopped. Sealing shall be accomplished by drilling from the inside of the manhole and injecting acrylamide grout to the exterior side of the manhole.

3.02 WET WELL PREPARATION

- A. Remove top slab / cover, all internal pipes, lines & fittings. Remove base grout as required.
- B. The Contractor shall thoroughly clean wet well by high pressure water jet, 1500 psi high pressure steam acid wash, or wire brushing, then neutralize with a sodium carbonate solution. He shall remove all loose concrete, mortar, scale, old liner material or other deteriorated concrete or masonry prior to repair and properly dispose of off the job site.
- F. The Contractor shall seal all leaks in so that all infiltration is stopped. Sealing shall be accomplished by drilling from the inside of the wet well and injecting acrylamide grout to the exterior side of the wet well.

3.03 FIBERGLASS LINER INSTALLATION

- A. The bottom of the liner shall be cut by the Contractor to fit the existing base as closely as possible. Cut outs in the liner shall be made to accommodate existing inlets, drops and cleanouts. Cuts shall be precisely made with a power saw specialty blade or jigsaw.
- B. The Contractor shall lower the liner into the existing structure and set it into a quick-setting grout mixture. Adequate bottom seal shall be obtained to prevent the loss of grout from the annular space. Six inches of quick-setting grout shall be placed above the bottom seal in the annular void area to insure a proper bottom seal. The Contractor shall use C-900 PVC or other Owner-approved corrosion-resistant pipe sleeves. Quick-setting mortar shall be used to seal around all drops, cleanouts, laterals and existing pipe.
- C. The interior of the fiberglass liner shall be braced to prevent cracking. The annular space shall be filled with a portland cement concrete.

- D. Where the corbel/cone section is removed, a new casting shall be formed to a diameter equal to the outside diameter of the existing manhole and to the height of the flat surface of the manhole liner. This area shall be filled with Portland cement concrete and may be poured at the same time as the annular space.
- E. The Contractor shall notify the Project Manager and Inspector at least 48 hours in advance, giving the start time and estimated completion time, of the liner installation.

3.04 MANHOLE GRADE ADJUSTMENT

- A. The Contractor shall set precast concrete grade rings on top of manhole to provide grade adjustment in setting manhole frames.
- B. Setting Manhole Frames:
 - 1. The existing ring and cover shall be reused and finished to grade by construction of a chimney on the flat shoulder of the manhole liner using brick and mortar precast concrete rings. The concrete rings shall be placed directly on the manhole liner.
 - 2. The Contractor shall set manhole frames and covers to match the finished grade as shown on the Contract Drawings or as directed by the Engineer. He shall set frames on concentric manholes with the opening mortar so that the space between the top of the manhole to the bottom of the frame shall be completely filled and made watertight. He shall place a ring or mortar around the outside of the bottom flange at least one inch thick and pitched away from the frame. He shall extend the mortar to the outer edge of the masonry, finish smooth and flush with the top of the flange.
- C. Invert Reconstruction: The Contractor shall reconstruct inverts with Type II cement to provide a smooth flowing channel of similar shape and size of the sewer and connections. All inverts shall follow grades of pipes entering manholes. He shall provide a true curve of the largest radius possible for changes in direction of sewer and entering branch or branches.
- D. Miscellaneous Work
 - 1. The Contractor shall observe watertightness and repair any visible leakage.
 - 2. The Contractor shall backfill around the new casting and compact the backfill.
- E. Manhole Inserts: Watertight manhole inserts shall be installed in all rehabilitated sanitary sewer manholes. Neoprene gasket shall be installed under the lip of the insert. If the rehabilitated manhole was not equipped with a manhole insert or if the salvaged manhole insert is not in working order, the Contractor shall provide a new manhole insert.

END OF SECTION

SECTION 02640 VALVES AND APPURTENANCES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required and install complete and ready for operation all valves and appurtenances as shown on the Drawings and as specified herein.
- B. All valves and appurtenances shall be of the size shown on the Drawings and, to the extent possible, all equipment of the same type on the Project shall be from one manufacturer.
- C. All valves and appurtenances shall have the name of the manufacturer and the working pressure for which they are designed cast in raised letters upon some appropriate part of the body.
- D. All valves shall have a factory applied, fusion bonded epoxy coating on interior and exterior unless noted otherwise in the plans or this specification.
- E. The equipment shall include, but not be limited to, the following:
 - 1. Gate valves (Sec. 2.01)
 - 2. Pressure Sustaining and Check Valves (Sec. 2.02)
 - 3. Ball Valves for PVC Pipe (Sec. 2.03)
 - 4. Butterfly Valves (Sec. 2.04)
 - 5. Plug Valves (Sec. 2.05)
 - 6. Valve Actuators (Sec. 2.06)
 - 7. Air Release Valves (Sec. 2.07)
 - 8. Valves Boxes (Sec. 2.08)
 - 9. Corporation Cocks (Sec. 2.09)
 - 10. Flange Adapter Couplings (Sec. 2.10)
 - 11. Flexible Couplings (Sec. 2.11)
 - 12. Hose Bibs (Sec. 2.12)
 - 13. Slow Closing Air and Vacuum Valves (Sec. 2.13)
 - 14. Surge Anticipator Valve (Sec. 2.14)
 - 15. Check Valves (Sec. 2.15)
 - 16. Hydrants (Sec. 2.16)
 - 17. Restraining Clamps (Sec. 2.17)
 - 18. Tapping Sleeves and Tapping Valves (Sec. 2.18)
 - 19. Single Acting Altitude Valves (Sec. 2.19)

1.02 DESCRIPTION OF SYSTEMS

All of the equipment and materials specified herein are intended to be standard for use in controlling the flow of potable water, reclaim water, wastewater, etc., depending on the applications.

1.03 QUALIFICATIONS

All of the types of valves and appurtenances shall be products of well established reputable firms who are fully experienced and qualified in the manufacture of the particular equipment to be furnished. The equipment shall be designed, constructed and installed in accordance with

the best practices and methods and shall comply with these Specifications as applicable. Valves shall be as covered under mechanical devices in Section 8 of ANSI/NSF Standard 61.

1.04 SUBMITTALS

- A. Submit to the Engineer within 30 days after execution of the contract a list of materials to be furnished, the names of the suppliers and the date of delivery of materials to the site.
- B. Complete shop drawings of all valves and appurtenances shall be submitted to the Engineer for approval in accordance with the Specifications.

1.05 TOOLS

Special tools, if required for normal operation and maintenance shall be supplied with the equipment.

PART 2 PRODUCTS

2.01 GATE VALVES

- A. All buried valves shall have cast or ductile iron three (3) piece valve bodies.
- B. Where indicated on the drawings or necessary due to locations, size, or inaccessibility, chain wheel operators shall be furnished with the valves. Such operators shall be designed with adequate strength for the valves with which they are supplied and provide for easy operation of the valve. Chains for valve operators shall be galvanized.
- C. Where required, gate valves shall be provided with a box cast in a concrete slab and a box cover. Length of box shall include slab thickness. Box cover opening shall be for valve stem and nut. Valve wrenches and extension stems shall be provided by the manufacturer to actuate the valves. The floor box and cover shall be equal to those manufactured by Rodney Hunt Machine Company, Orange, Massachusetts, Clow, DeZurik or approved equal.
- D. Gate valves with 3"-20" diameters shall be resilient seated, manufactured to meet or exceed the requirements of AWWA C509 or C515 and UL/FM of latest revision and in accordance with the following specifications. Valves shall have an unobstructed waterway equal to or greater than the full nominal diameter of the valve.
- E. Wrench nut shall be provided for operating the valve.
- F. Valves shall be suitable for an operating pressure of 200 psi and shall be tested in accordance with AWWA C509 or C515.
- G. All bonnet bolts, nuts and studs shall be stainless steel.

2.02 PRESSURE SUSTAINING AND CHECK VALVE

- A. Pressure sustaining and check valve shall be pilot operated diaphragm actuated valve with cast iron body, bronze trim, and 125-pound flanged ends. The valve shall be hydraulically operated, diaphragm type globe valve. The main valve shall have a single removable seat and a resilient disc, of rectangular cross section, surrounded on three and a half sides. The stainless steel stem shall be fully guided at both ends by a bearing in the valve cover, and an integral bearing in the valve seat. It shall be sleeved at both ends with delrin. No external

packing glands are permitted and there shall be no pistons operating the main valve or any controls. The valve shall be equipped with isolation cocks to service the pilot system while permitting flow if necessary. Main valve and all pilot controls shall be manufactured in the United States of America. Valve shall be single chamber type, with seat cut to 5 degrees taper.

- B. Valve shall maintain a minimum (adjustable) upstream pressure to a preset (adjustable) maximum. The pilot system shall consist of two direct acting, adjustable, spring loaded diaphragm valves.
- C. Valve shall be cast iron (ASTM A48) with main valve trim of brass (QQB-B-626) and bronze (ASTM B61). The pilot control valves shall be cast brass (ASTM B62) with 303 stainless steel trim. All ferrous surfaces inside and outside shall have a 2-part epoxy coating. Valve shall be similar in all respects to CLA-VAL Company, Model 692G-01ABKG, as manufactured by CLA-VAL Company, Winter Park, Florida, or similar pressure sustaining and check valve as manufactured by Golden Alderson; or approved equal.

2.03 BALL VALVES FOR PVC PIPE

- A. Ball valves for PVC pipe shall be of PVC Type 1 with union, socket, threaded or flanged ends as required. Ball valves shall be full port, full flow, all plastic construction, 150 psi rated with teflon seat seals and T-handles. PVC ball valves shall be as manufactured by Celanese Piping Systems, Inc., Wallace and Tiernan, Inc., Plastiline, Inc., or approved equal.
- B. All valves shall be mounted in such a position that valve position indicators are plainly visible when standing on the floor.

2.04 BUTTERFLY VALVES

- A. Butterfly valves shall conform to the AWWA Standard Specifications for Rubber Seated Butterfly Valves, Designated C504, except as hereinafter specified. Valves, except as specified hereinafter, shall be Class 150A or B, except that valves furnished downstream of the high service pumps shall be Class 250 and equal to those manufactured by Henry Pratt Company, DeZurik, Kennedy, or approved equal. Ductile iron conforming to ASTM A536, Grade 65-45-12 shall be provided for all Class 250 valves. All valves shall be leak tested at 200 psi.
- B. The face-to-face dimensions of flanged end valves shall be in accordance with Table 1 of above mentioned AWWA Specification for short-body valve. Adequate two-way thrust bearings shall be provided. Flange drilling shall be in accordance with ANSI B16.1.
- C. Valve seats shall be an EPDM elastomer. Valve seats 24 inches and larger shall be field adjustable and replaceable without dismounting operator disc or shaft and without removing the valve from the line. All retaining segments and adjusting devices shall be of corrosion resistant material with stainless Nylock screws and be capable of the 1/8-inch adjustment. Valves 20 inches and smaller shall have bonded or mechanically restrained seats as outlined in AWWA C 504. Where the EPDM seat is mounted on the valve body, the mating edge of the valve disc shall be 18-8 stainless steel or Nickel-Chrome, 80-20%. Where the EPDM seat is mounted on the valve disc, the valve body shall be fitted with an 18-8 stainless steel seat offset from the shaft, mechanically restrained and covering 360 degrees of the peripheral opening or seating surface.
- D. The valve body shall be constructed of ductile iron or close grain cast iron per ASTM A126,

Class B with integrally cast hubs for shaft bearing housings of the through boss-type. Butterfly valves of the "wafer" or "spool" type will not be accepted.

- E. The valve shaft shall be turned, ground, and polished constructed of 18-8, ASTM A-276, Type 304 stainless steel and designed for both torsional and shearing stresses when the valve is operated under its greatest dynamic or seating torque. Shaft shall be of either a one piece unit extending full size through the valve disc and valve bearing or it may be of a stub shaft design. Shaft bearings shall be teflon or nylon, self-lubricated type.
- F. All valves shall be subject to hydrostatic and leakage tests at the point of manufacture. The hydrostatic test for Class 250 valves shall be performed with an internal hydrostatic pressure equal to 500 psi applied to the inside of the valve body of each valve for a period of five minutes. During the hydrostatic test, there shall be no leakage through the metal, the end joints or the valve shaft seal. The leakage test for the Class 250 valves shall be performed at a differential pressure of 230 psi and against both sides of the valve. No adjustment of the valve disc shall be necessary after pressure test for normal operation of valve. The Class 150 valves shall be tested in conformance with AWWA C-504.
- G. In general, the butterfly valve operators shall conform to the requirements of Section 3.8 of the AWWA Standard Specifications for Rubber Seated Butterfly Valves, Designation C504, insofar as applicable, and as herein specified.
- H. Gearing for the operators shall be totally enclosed in a gear case in accordance with paragraph 3.8.3 of the above mentioned AWWA Standard Specification.
- I. Operators shall be capable of seating and unseating the disc against the full design pressure of velocity, as specified for each class, into a dry system downstream and shall transmit a minimum torque to the valve. Operators shall be rigidly attached to the valve body.
- J. The manufacturer shall certify that the required tests on the various materials and on the completed valves have been satisfactory and that the valves conform with all requirements of this Specification and the AWWA standard.
- K. Where indicated on the Drawings, extension stems, floor stands, couplings, stem guides, and floor boxes as required shall be furnished and installed.

2.05 PLUG VALVES

- A. All plug valves shall be eccentric plug valves capable of sustaining 150 psi in either direction without leaking.

Exception: Single direction plug valves may be used if it is clearly demonstrated they will never be required to resist pressure in both directions either in service or during pipe line testing.
- B. Plug valves shall be tested in accordance with current AWWA Standard C-504-80 Section 5. Each valve shall be performance tested in accordance with paragraph 5.2 and shall be given a leakage test and hydrostatic test as described in paragraphs 5.3 and 5.4. The manufacturer shall furnish certified copies of reports covering proof of design testing as described in Section 5.5.
- C. Plug valves shall be of the non-lubricated eccentric type with resilient faced plugs and shall be furnished with end connections as shown on the Plans. Flanged valves shall be faced and

drilled to the ANSI 150 lb. standard. Mechanical joint ends shall be to the AWWA Standard C111-72. Bell ends shall be to the AWWA Standard C100-55 Class B. Screwed ends shall be to the NPT standard.

- D. Plug valve bodies shall be of ASTM A126 Class B Semi-steel, 31,000 psi tensile strength minimum in compliance with AWWA Standard C507-73, Section 5.1 and AWWA Standard C504-70 Section 6.4. Port areas for valves 20-inches and smaller shall be 80 percent of full pipe area. Valves 24 inch and larger shall have a minimum port area between 80 and 100 percent of full nominal pipe area. All exposed nuts, bolts, springs, washers, etc. shall be zinc or cadmium plated. Resilient plug facings shall be of Hycar or Neoprene.
- E. Plug valves shall be furnished with permanently lubricated stainless steel or oil-impregnated bronze upper and lower plug stem bushings. These bearings shall comply with current AWWA Standards.

2.06 VALVE ACTUATORS

A. General

- 1. All valve actuators shall conform to Section 3.8 of the AWWA Standard Specification and shall be either manual or motor operated.
- 2. Actuators shall be capable of seating and unseating the disc against the full design pressure and velocity, as specified for each class, into a dry system downstream, and shall transmit a minimum torque to the valve. Actuators shall be rigidly attached to the valve body.
- 3. Butterfly valve actuators shall conform to the requirements of Section 3.8 of the AWWA Standard specifications for Rubber Seated Butterfly Valves, Designated C504, insofar as applicable and as herein specified.

B. Manual Actuators

- 1. Manual actuators shall have permanently lubricated, totally enclosed gearing with handwheel and gear ratio sized on the basis of actual line pressure and velocities. Actuators shall be equipped with handwheel, position indicator, and mechanical stop-limiting locking devices to prevent over travel of the disc in the open and closed positions. They shall turn counter-clockwise to open valves. Manual actuators shall be of the traveling nut, self-locking type and shall be designed to hold the valve in any intermediate position between fully open and fully closed without creeping or fluttering. Actuators shall be fully enclosed and designed to produce the specified torque with a maximum pull of 80 pounds on the handwheel or chainwheel. Actuator components shall withstand an input of 450 foot pounds for 30" and smaller and 300 foot pounds for larger than 30" size valves at extreme actuator positions without damage. Valves located above grade shall have handwheel and position indicator, and valves located below grade shall be equipped with a two inch (2") square AWWA operating nut located at ground level and cast iron extension type valve box. Valve actuators shall conform to AWWA C504, latest revision.

C. Motor Actuators (Modulating)

- 1. The motor actuated valve controller shall include the motor, actuator unit gearing, limit switch gearing, limit switches, position transmitter which shall transmit a 4-20 mA DC signal, control power transformer, electronic controller which will position the valve based on a remote 4-20 milliamp signal, torque switches, bored and key-wayed drive

- sleeve for non-rising stem valves, declutch lever and auxiliary handwheel as a self-contained unit.
2. The motor shall be specifically designed for valve actuator service using 480 volt, 60 Hertz, three phase power as shown, on the electrical drawings. The motor shall be sized to provide an output torque and shall be the totally enclosed, non-ventilated type. The power gearing shall consist of helical gears fabricated from heat treated alloy steel forming the first stage of reduction. The second reduction stage shall be a single stage worm gear. The worm shall be of alloy steel with carburized threads hardened and ground for high efficiency. The worm gear shall be of high tensile strength bronze with hobbled teeth. All power gearing shall be grease lubricated. Ball or roller bearings shall be used throughout. Preference will be given to units having a minimum number of gears and moving parts. Spur gear reduction shall be provided as required.
 3. Limit switches and gearing shall be an integral part of the valve control. The limit switch gearing shall be made of bronze and shall be grease lubricated, intermittent type and totally enclosed to prevent dirt and foreign matter from entering the gear train. Limit switches shall be of the adjustable type capable of being adjusted to trip at any point between fully opened valve and fully closed valve.
 4. The speed of the actuator shall be the responsibility of the system supplier with regard to hydraulic requirements and response compatibility with other components within the control loop. Each valve controller shall be provided with a minimum of two rotor type gear limit switches, one for opening and one for closing. The rotor type gear limit switch shall have two normally open and two normally closed contacts per rotor. Gear limit switches must be geared to the driving mechanism and in step at all times whether in motor or manual operation. Provision shall be made for two additional rotors as described above, each to have two normally open and two normally closed contacts. Each valve controller shall be equipped with a double torque switch. The torque switch shall be adjustable and will be responsive to load encountered in either direction of travel. It shall operate during the complete cycle without auxiliary relays or devices to protect the valve, should excessive load be met by obstructions in either direction of travel. The torque switch shall be provided with double-pole contacts.
 5. A permanently mounted handwheel shall be provided for manual operation. The handwheel shall not rotate during electric operations, but must be responsive to manual operation at all times except when being electrically operated. The motor shall not rotate during hand operation nor shall a fused motor prevent manual operation. When in manual operating position, the unit will remain in this position until motor is energized at which time the valve operator will automatically return to electric operation and shall remain in motor position until handwheel operation is desired. This movement from motor operation to handwheel operation shall be accomplished by a positive declutching lever which will disengage the motor and motor gearing mechanically, but not electrically. Hand operation must be reasonably fast. It shall be impossible to place the unit in manual operation when the motor is running. The gear limit switches and torque switches shall be housed in a single easily accessible compartment integral with the power compartment of the valve control. All wiring shall be accessible through this compartment. Stepping motor drives will not be acceptable.
 6. The motor with its control module must be capable of continuously modulating over its entire range without interruption by heat protection devices. The system, including the operator and control module must be able to function, without override protection of any kind, down to zero dead zone.
 7. All units shall have strip heaters in both the motor and limit switch compartments.
 8. The actuator shall be equipped with open-stop-close push buttons, an auto-manual selector switch, and indicating lights, all mounted on the actuator or on a separate

- locally mounted power control station.
9. The electronics for the electric operator shall be protected against temporary submergence.
 10. Actuators shall be Limitorque L120 with Modutronic Control System containing a position transmitter with a 4-20MA output signal or equal.

D. Motor Actuators (Open-Close)

1. The electronic motor-driven valve actuator shall include the motor, actuator gearing, limit switch gearing, limit switches, torque switches, fully machined drive sleeve, declutch lever, and auxiliary handwheel as a self-contained unit.
2. The motor shall be specifically designed for valve actuator service and shall be of high torque totally enclosed, nonventilated construction, with motor leads brought into the limit switch compartment without having external piping or conduit box.
 - (a) The motor shall be of sufficient size to open or close the valve against maximum differential pressure when voltage to motor terminals is 10% above or below nominal voltage.
 - (b) The motor shall be prelubricated and all bearings shall be of the anti-friction type.
3. The power gearing shall consist of helical gears fabricated from heat treated steel and worm gearing. The worm shall be carburized and hardened alloy steel with the threads ground after heat treating. The worm gear shall be of alloy bronze accurately cut with a hobbing machine. All power gearing shall be grease lubricated. Ball or roller bearings shall be used throughout.
4. Limit switches and gearing shall be an integral part of the valve actuator. The switches shall be of the adjustable rotor type capable of being adjusted to trip at any point between fully opened valve and fully closed valve. Each valve controller shall be provided with a minimum of two rotor type gear limit switches, one for opening and one for closing (influent valves require additional contacts to allow stopping at an intermediate position). The rotor type gear limit switch shall have two normally open and two normally closed contacts per toro. Additional switches shall be provided if shown on the control and/or instrumentation diagrams. Limit switches shall be geared to the driving mechanism and in step at all times whether in motor or manual operation. Each valve actuator shall be equipped with a double torque switch. The torque switch shall be adjustable and will be responsive to load encountered in either direction of travel. It shall operate during the complete cycle without auxiliary relays or devices to protect the valve should excessive load be met by obstructions in either direction of travel. Travel and thrusts shall be independent of wear in valve disc or seat rings.
5. A permanently mounted handwheel shall be provided for manual operation. The handwheel shall not rotate during electric operation except when being electrically operated. The motor shall not rotate during hand operation, nor shall a fused motor prevent manual operation. When in manual operating position, the unit will remain in this position until motor is energized at which time the valve actuator will automatically return to electric operation and shall remain in motor position until handwheel operation is desired. Movement from motor operation to handwheel operation shall be accomplished by a positive declutching lever which will disengage the motor and motor gearing mechanically, but not electrically. Hand operation must be reasonably fast. It shall be impossible to place the unit in manual operation when the motor is running.
6. Valve actuators shall be equipped with an integral reversing controller and three phase overload relays, Open-Stop-Close push buttons, local-remote-manual selector switch, control circuit transformer, three-phase thermal overload relays and two pilot

lights in a NEMA 4X enclosure. In addition to the above, a close coupled air circuit breaker or disconnect switch shall be mounted and wired to the valve input power terminals for the purpose of disconnecting all underground phase conductors.

7. The valve actuator shall be capable of being controlled locally or remotely via a selector switch integral with the actuator. In addition, an auxiliary dry contact shall be provided for remote position feedback.
8. Valve A.C. motors shall be designed for operation on a 480 volt, 3-phase service. Valve control circuit shall operate from a fuse protected 120 volt power supply.
9. Motor operators shall be as manufactured by Limitorque Corporation, Type L120 or approved equal.

2.07 AIR RELEASE VALVES

The air release valves for use in water or force mains shall be installed as shown on the Drawings. The valves shall have a cast iron body cover and baffle, stainless steel float, bronze water diffuser, Buna-N or Viton seat, and stainless steel trim. The fittings shall be threaded. The air release valves shall be Model 200A or 400A as manufactured by APCO Valve and Primer Corporation, Schaumburg, Illinois; or approved equal.

2.08 VALVE BOXES

- A. Buried valves shall have cast-iron three piece valve boxes or HDPE adjustable valve boxes. Cast iron valve boxes shall be provided with suitable heavy bonnets and shall extend to such elevation at or slightly above the finished grade surface as directed by the Engineer. The barrel shall be two-piece, screw type, having a 5-1/4 inch shaft. The upper section shall have a flange at the bottom with sufficient bearing area to prevent settling and shall be complete with cast iron covers. Covers shall have WATER, SEWER, or RECLAIM, as applicable, cast into the top.
- B. All valves shall have actuating nuts extended to within four (4) feet of the top of the valve box. All valve extensions will have a centering guide plate two (2) inches maximum below the actuating nut. The valve extension shall be fastened to the existing nut with a set screw. Valve boxes shall be provided with a concrete base and a valve nameplate engraved with lettering 1/8-inch deep as shown on the Drawings.
- C. HDPE adjustable valve boxes shall be one complete assembled unit composed of the valve box and extension stem. All moving parts of the extension stem shall be enclosed in a housing to prevent contact with the soil. Valve box assembly shall be adjustable to accommodate variable trench depths.
- D. The entire assembly shall be made of heavy wall high density polyethylene. All exterior components shall be joined with stainless steel screws. The valve box top section shall be adaptable to fit inside a valve box upper section.
- E. The stem assembly shall be of a telescoping design that allows for variable adjustment length. The stem material shall be of plated steel square tubing. The stem assembly shall have a built-in device that keeps the stem assembly from disengaging at its fully extended length. The extension stem must be torque tested to 1000 foot pounds. Covers shall have WATER, SEWER or RECLAIMED clearly and permanently impressed into the top surface.

2.09 CORPORATION COCKS

Corporation cocks for connections to cast-iron, ductile iron or steel piping shall be all brass or

bronze suitable for 180 psi operating pressure and similar to Mueller Co. H-10046 or approved equal by Clow Corp., and shall be of sizes required and/or noted on the Drawings.

2.10 FLANGE ADAPTER COUPLINGS

Flange adapter couplings shall be of the size and pressure rating required for each installation and shall be suitable for use on either cast iron or ductile iron pipe. They shall be similar or approved equal to Dresser Company, Style 128. All couplings shall have a sufficient number of factory installed anchor studs to meet or exceed a minimum test pressure rating of 230 psi minimum.

2.11 FLEXIBLE COUPLINGS

Flexible couplings shall be either the split type or the sleeve type as shown on the Drawings.

1. Split type coupling shall be used with all interior piping and with exterior pipings noted on the Drawings. The couplings shall be mechanical type for radius groove piping. The couplings shall mechanically engage and lock grooved pipe ends in a positive couple and allow for angular deflection and contracting and expansion.
2. Couplings shall consist of malleable iron, ASTM Specification A47, Grade 32510 housing clamps in two or more parts, a single chlorinated butyl composition sealing gasket with a "C" shaped cross-section and internal sealing lips projecting diagonally inward, and two or more oval track head type bolts with hexagonal heavy nuts conforming to ASTM Specification A 183 and A194 to assemble the housing clamps. Bolts and nuts shall be hot dipped galvanized after fabrication.
3. Victaulic type couplings and fittings may be used in lieu of flanged joints. Pipes shall be radius grooved as specified for use with the Victaulic couplings. Flanged adapter connections at fittings, valves, and equipment shall be Victaulic Vic Flange Style 741, equal by Gustin-Bacon Group, Division of Certain-Teed Products, Kansas City, Kansas, or approved equal.
4. Sleeve type couplings shall be used with all buried piping. The couplings shall be of steel and shall be Dresser Style 38 or 40, as shown on the Drawings, or equal. The coupling shall be provided with hot dipped galvanized steel bolts and nuts unless indicated otherwise.
5. All couplings shall be furnished with the pipe stop removed.
6. Couplings shall be provided with gaskets of a composition suitable for exposure to the liquid within the pipe.
7. If the Contractor decides to use victaulic couplings in lieu of flanged joints, he shall be responsible for supplying supports for the joints.

2.12 HOSE BIBS

Hose bibs shall be 3/4" or 1" brass, polished chromium plated brass, with vacuum breaker as noted on the drawings.

2.13 SLOW CLOSING AIR AND VACUUM VALVES

- A. The Contractor shall furnish and install slow closing air and vacuum valves as shown on the Drawings which shall have two (2) independent valves bolted together. The air and vacuum valve shall have all stainless steel float, guided on both ends with stainless shafts. The air and vacuum valve seat shall be Buna-N to insure drop tight closure. The Buna-N seat shall be fastened to the cover stainless shoulder screws in a manner to prevent distortion of the seat. The float shall be guided at both ends with stainless steel bushings.

- B. The valve cover shall have a male lip designed to fit into the body register for accurate alignment of the float into the Buna-N seat. The valve cover shall have 250-pound class flanged outlet connection.
- C. The surge check valve shall be bolted to the inlet of the air and vacuum valve and consist of a body, seat, disc, and compression spring. A surge check unit shall operate on the interphase between the kinetic energy and relative velocity flows of air and water, so that after air passes through, and water rushes into the surge check, the disc starts to close, reducing the rate of flow of water into the air valve by means of throttling orifices in the disc to prevent water hammer in the air valves. The surge check orifices must be adjustable type for regulation in the field to suit operating conditions. Valve shall be rated for 250-pound class working pressure.
- D. The complete slow closing air and vacuum valve with air release valve shall have been flow tested in the field, substantiated with test data to show reduction of surge pressure in the valve. Flow test data shall be submitted with initial shop drawings for approval.
- E. Valve exterior to be painted Red Oxide, Phenolic TT-P86, Primer or approved equal for high resistance to corrosion.
- F. All materials of construction shall be certified in writing to conform to ASTM specifications as follows:

Air Valve Cover, Body, and Surge Check Body	Cast Iron	ASTM A48, Class 30
Float	Stainless Steel	ASTM A240
Surge Check Seat and Disc	Stainless Steel	ASTM A582
Air Valve Seat	Buna-N	
Spring	Stainless Steel	T302

2.14 SURGE ANTICIPATOR VALVES

- A. Surge anticipator valves shall be furnished for the pumping systems as shown on the Drawings. The valve shall be hydraulically operated, pilot controlled, and diaphragm or piston actuated. The main valve shall be cast iron conforming to ASTM A48 with bronze trim conforming to ASTM B61 and flanged ends conforming to ANSI B161.1. The main valve shall be globe type with a single removable seat and a resilient disc.
- B. The diaphragm actuated valve shall have a stainless steel stem guided at both ends by a bearing in the valve cover and an integral bearing surface in the seat. No external packing glands shall be permitted. The valve shall be fully serviceable without removing it from the line. The pilot system shall be of noncorrosive construction and provided with isolation cocks.
- C. The piston actuated valve shall operate on the differential piston principle. The valve piston shall be guided on its outside diameter. The valve shall be able to operate in any position and

shall be fully serviceable without removing it from the line. The pilot system shall be provided with isolation cocks, and be of noncorrosive materials of construction.

- D. The valve shall be designed specifically to minimize the effects of water hammer, resulting from power failure at the pumping station, or from normal stopping and starting of pumping operators. The valve shall open hydraulically on a down surge, or low pressure wave created when the pump stops, remain open during the low pressure cycle in order to be open when the high pressure wave returns. The high pressure pilot shall be adjustable over a 20 to 200 psi range and the low pressure pilot shall be adjustable over a 15 to 75 psi range. The valve shall be the 250 Class.

2.15 CHECK VALVES

- A. Check valves for cast iron and ductile iron pipe lines shall be swing type and shall meet the material requirements of AWWA Specification C508. The valves shall be iron body, bronze mounted, single disc, 175 psi working water pressure and nonshock. Valves shall be as manufactured by Mueller, Clow, American, Kennedy, M&H, or approved equal.
- B. When there is no flow through the line, the disc shall hang lightly against its seat in practically a vertical position. When open, the disc shall swing clear of the waterway.
- C. Check valves shall have bronze seat and body rings, extended bronze hinge pins and bronze nuts on the bolts of bolted covers.
- D. Valves shall be so constructed that disc and body seat may easily be removed and replaced without removing the valve from the line. Valves shall be fitted with an extended hinge arm with outside lever and weight. Weights provided and approved by the Engineer shall be installed.

2.16 HYDRANTS

Hydrants shall be AVK Series 27 DRX Barrel (nostalgic style with stainless steel bolts) Kennedy Type K-81, American Darling B-84-B or Mueller Super Centurian A423, or approved equal and shall conform to the "Standard Specification for Fire Hydrants for Ordinary Water Works Service", AWWA C502, and UL/FM certified, and shall in addition meet the specific requirements and exceptions which follow:

1. Hydrants shall be according to manufacturer's standard pattern and of standard size, and shall have one 4-1/2" steamer nozzle and two 2-1/2" hose nozzles.
2. Hydrant inlet connections shall have mechanical joints for 6" ductile-iron pipe.
3. Hydrant valve opening shall have an area at least equal to that area of a 5-1/4" minimum diameter circle and be obstructed only by the valve rod. Each hydrant shall be able to deliver 500 gallons minimum through its two 2-1/2" hose nozzles when opened together with a loss of not more than 2 psi in the hydrants.
4. Each hydrant shall be designed for installation in a trench that will provide 5-ft. cover.
5. Hydrants shall be hydrostatically tested as specified in AWWA C502.
6. Hydrants shall be rated at 200 psi.
7. All nozzle threads shall be American National Standard.
8. Each nozzle cap shall be provided with a Buna N rubber washer.
9. Hydrants shall be so arranged that the direction of outlets may be turned 90 degrees without interference with the drip mechanism and without the mechanism obstructing the discharge from any outlet.
10. Hydrants must be capable of being extended without removing any operating parts.

11. Hydrants shall have bronze-to-bronze seatings as per AWWA C502-85.
12. Hydrant main valve closure shall be of the compression type opening against the pressure and closing with the pressure. The resilient seat material shall meet the requirements of AWWA C-509 and shall preferably be EPDM Elastomer.
13. Internal and below ground iron parts (bonnet, nozzle section and base) shall have a fusion bonded epoxy coating per AWWA C550. Aboveground external hydrant parts (cap, bonnet and nozzle section) shall be either epoxy coated together with a UV resistant polyester coating or have two shop coats of paint per AWWA C502. The lower stand pipe or barrel shall be protected with asphaltic coatings per AWWA C502.
14. Exterior nuts, bolts and washer shall be stainless steel. Bronze nuts may be used below grade.
15. All internal operating parts shall be removable without requiring excavation.

2.17 RESTRAINING CLAMPS

Restraining clamp assemblies as detailed in the drawings for use at hydrant connections to water mains, or at fittings where shown on the Drawings, shall be as manufactured by American Cast Iron Pipe, Star Pipe Products, U.S. Pipe; or approved equal.

2.18 TAPPING SLEEVES AND GATE VALVES

- A. Tapping valves shall meet the requirement of AWWA C500. The valves shall be flanged, shall be mechanical joint outlet with nonrising stem, designed for vertical burial and shall open left or counterclockwise. Stuffing boxes shall be the "O-ring" type. Operating nut shall be AWWA Standard 2" square for valves 2" and up. The valves shall be provided with an overload seat to permit the use of full size cutters. Gaskets shall cover the entire area of flange surfaces and shall be supplied with EPDM wedges up to 30" diameter.
- B. Tapping sleeves and saddles shall seal to the pipe by the use of a confined "O" ring gasket, and shall be able to withstand a pressure test of 180 psi for one hour with no leakage in accordance with AWWA C110, latest edition. A stainless steel 3/4" NPT test plug shall be provided for pressure testing. All bolts joining the two halves shall be stainless steel and shall be included with the sleeve or saddle. Sleeves and saddles shall be protected from corrosion by being fusion applied epoxy coated, or be made of 18-8 Type 304 stainless steel. Saddle straps shall be 18-8 Type 304 stainless steel.

2.19 SINGLE ACTING ALTITUDE VALVES

- A. Function
 1. The altitude control valve shall be of the single acting type, closing off tightly when the water reaches the maximum predetermined level in the tank to prevent overflow; and opening to permit replenishing of the tank supply when the water level drops approximately 6" to 12" below the maximum level.
 2. A hand operated valve in the power water line to the top of the piston shall permit adjustment of the speed of valve closing. The tank water level control shall be by means of a diaphragm operated, spring loaded, three way pilot which directs power water to or from the top of the main valve piston. The three way pilot shall be of bronze construction. The diaphragm surface exposed to the tank head shall be not less than 57 sq. inches. It shall be possible to adjust the spring above the diaphragm for water level control approximately 20% above or below the factory setting.

- B. Description

1. The main valve shall operate on the differential piston principle such that the area on the underside of the piston is no less than the pipe area on the upper surface of the piston is of a greater area than the underside of the piston.
2. The valve piston shall be guided on its outside diameter by long stroke stationary Vee ports which shall be downstream of the seating surface to minimize the consequences of throttling. Throttling shall be done by the valve Vee ports and not the valve seating surfaces.
3. The valve shall be capable of operating in any position and shall incorporate only one flanged cover at the valve top from which all internal parts shall be accessible. There shall be no stems, stem guides, or spokes within the waterway. There shall be no springs to assist the valve operation.

C. Construction

1. The valve body shall be of cast iron ASTM A-126 with flanges conforming to the latest ANSI Standards. The valve shall be extra heavy construction throughout. The valve interior trim shall be bronze B-62 as well as the main valve operation.
2. The valve seals shall be easily renewable while no diaphragm shall be permitted within the main valve body.
3. All controls and piping shall be of non-corrosive construction.
4. A visual valve position indicator shall be provided for observing the valve piston position at any time.

D. Figure Number

The valves shall be the 20" Globe type (Fig. 3200-D) as manufactured by GA Industries of Mars, Pennsylvania, or approved equal.

PART 3 EXECUTION

3.01 INSTALLATION

- A. All valves and appurtenances shall be installed in the location shown, true to alignment and rigidly supported. Any damage occurring to the above items before they are installed shall be repaired to the satisfaction of the Engineer.
- B. After installation, all valves and appurtenances shall be tested at least two hours at the working pressure corresponding to the class of pipe, unless a different test pressure is specified. If any joint proves to be defective, it shall be repaired to the satisfaction of the Engineer.
- C. Install all floor boxes, brackets, extension rods, guides, the various types of operators and appurtenances as shown on the Drawings that are in masonry floors or walls, and install concrete inserts for hangers and supports as soon as forms are erected and before concrete is poured. Before setting these items, the Contractor shall check all plans and figures which have a direct bearing on their location and he shall be responsible for the proper location of these valves and appurtenances during the construction of the structures.
- D. Pipe for use with flexible couplings shall have plain ends as specified in the respective pipe sections.
- E. Flanged joints shall be made with high strength, low alloy Corten bolts, nuts and washers.

Mechanical joints shall be made with mild corrosion resistant alloy steel bolts and nuts. All exposed bolts shall be painted the same color as the pipe. All buried bolts and nuts shall be heavily coated with two (2) coats of bituminous paint comparable to Inertol No. 66 Special Heavy.

- F. Prior to assembly of split couplings, the grooves as well as other parts shall be thoroughly cleaned. The ends of the pipes and outside of the gaskets shall be moderately coated with petroleum jelly, cup grease, soft soap or graphite paste, and the gasket shall be slipped over one pipe end. After the other pipe has been brought to the correct position, the gasket shall be centered properly over the pipe ends with the lips against the pipes. The housing sections then shall be placed. After the bolts have been inserted, the nuts shall be tightened until the housing sections are firmly in contact, metal-to-metal, without excessive bolt tension.
- G. Prior to the installation of sleeve-type couplings, the pipe ends shall be cleaned thoroughly for a distance of 8". Soapy water may be used as a gasket lubricant. A follower and gasket, in that order, shall be slipped over each pipe to a distance of about 6" from the end.
- H. Valve boxes with concrete bases shall be installed as shown on the Drawings. Mechanical joints shall be made in the standard manner. Valve stems shall be vertical in all cases. Place cast iron box over each stem with base bearing on compacted fill and the top flush with final grade. Boxes shall have sufficient bracing to maintain alignment during backfilling. Knobs on cover shall be parallel to pipe. Remove any sand or undesirable fill from valve box.

3.02 HYDRANTS

- A. Hydrants shall be set at the locations designated by the Engineer and/or as shown on the Drawings and shall be bedded on a firm foundation. A drainage pit on crushed stone as shown on the Drawings shall be filled with gravel or crushed stone and satisfactorily compacted. During backfilling, additional gravel or crushed stone shall be brought up around and 6" over the drain port. Each hydrant shall be set in true vertical alignment and shall be properly braced. Concrete thrust blocks shall be placed between the back of the hydrant inlet and undisturbed soil at the end of the trench. Minimum bearing area shall be as shown on the plans. Felt paper shall be placed around the hydrant elbow prior to placing concrete. **CARE MUST BE TAKEN TO INSURE THAT CONCRETE DOES NOT PLUG THE DRAIN PORTS.** Concrete used for backing shall be as specified herein.
- B. When installations are made under pressure, the flow of water through the existing main shall be maintained at all times. The diameter of the tap shall be a minimum of 2" less than the inside diameter of the branch line.
- C. The entire operation shall be conducted by workmen thoroughly experienced in the installation of tapping sleeves and valves, and under the supervision of qualified personnel furnished by the manufacturer. The tapping machine shall be furnished by the Contractor if tap is larger than 12" in diameter.
- D. The Contractor shall determine the locations of the existing main to be tapped to confirm the fact that the proposed position for the tapping sleeve will be satisfactory and no interference will be encountered such as the occurrence of existing utilities or of a joint or fitting at the location proposed for the connection. No tap will be made closer than 30" from a pipe joint.
- E. Tapping valves shall be set in vertical position and be supplied with a 2" square operating nut for valves 2" and larger. The valve shall be provided with an oversized seat to permit the use

of full sized cutters.

- F. Tapping sleeves and valves with boxes shall be set vertically or horizontally as indicated on the Drawings and shall be squarely centered on the main to be tapped. Adequate support shall be provided under the sleeve and valve during the tapping operation. Sleeves shall be no closer than 30" from water main joints. Thrust blocks shall be provided behind all tapping sleeves. Proper tamping of supporting earth around and under the valve and sleeve is mandatory. After completing the tap, the valve shall be flushed to ensure that the valve seat is clean.

3.03 SHOP PAINTING

Ferrous surfaces of valves and appurtenances shall receive a coating of rust-inhibitive primer. All pipe connection openings shall be capped to prevent the entry of foreign matter prior to installation.

3.04 FIELD PAINTING

All metal valves and appurtenances specified herein and exposed to view shall be painted.

3.05 INSPECTION AND TESTING

Completed pipe shall be subjected to hydrostatic pressure test for two hours at 180 psi. All leaks shall be repaired and lines retested as approved by the Engineer. Prior to testing, the pipelines shall be supported in an approved manner to prevent movement during tests.

END OF SECTION

SECTION 02720 SANITARY SEWER BYPASS PUMPING

PART 1 GENERAL

1.01 SCOPE

The Contractor shall furnish all labor, materials, equipment and incidentals required to maintain existing and anticipated flows within the affected portion of the collection system throughout the construction period.

1.02 PUBLIC IMPACTS

The contractor shall not create a public nuisance due to excessive noise or dust, nor impact the public with flooding of adjacent lands, discharge of raw sewage, or release of other potential hazards, nor shall he encroach on or limit access to adjacent lands. No extra charge may be made for increased costs to the contractor due to any of the above.

1.03 SUBMITTALS

- A. The Contractor shall, within 30 days of the date of the Notice to Proceed, submit to the Project Manager a detailed Pumping Plan for each site by-pass pumping will be needed. The Pumping Plan shall address all measures and systems to prevent a sanitary sewer overflow (SSO) as defined by the EPA. The Plan shall include as a minimum:
1. Working drawings and sketches showing work location, pump location, piping layout & routing. Show all proposed encroachment and access impacts on adjacent properties or facilities.
 2. Pump, control, alarm and pipe specifications or catalog cuts. Detailed sketch of controls and alarm system.
 3. Power requirements and details on methods to provide by-pass power or fueling.
 4. Calculation and determination of response times to prevent an SSO after a high water alarm. If anticipated peak flows are 750 G.P.M. or greater, an operator is required on site at all times pump is in service. If the anticipated peak flows are less than 750 G.P.M. an operator may not be required to be on site at all times; show operator on-site schedule.
 5. Procedures to be taken in case of power, pump, or piping failures; including contact names and numbers for emergency notifications.
 6. Frequency and specific responsibility for monitoring pump operation, fuel levels, pump maintenance and entire length of piping.

PART 2 PRODUCTS

2.01 EQUIPMENT

- A. Pumps:
1. By-pass pumping system shall consist of at least a primary pump and a backup pump. Each pump shall have a minimum pumping capacity of 150% of the anticipated peak flows. If a lift station by-pass, 150% of the lift station capacity (G.P.M. & T.D.H) for the lift station being by-passed.
 2. Pumps shall be low noise or sound attenuated. The noise level at any operating condition, in any direction, shall not exceed 70dBA at a distance of twenty three (23)

feet (7 meters) from the pump and/or power source.

B. Controls:

The by-pass pump system shall be equipped with automatic controls and an alarm system. The automatic controls will automatically start the backup pump in the event of a high water condition or failure of the primary pump. The alarm system will immediately notify the Contractor of a pump failure or high water condition.

C. Pipe:

Pipe shall be of adequate size and capacity to match the pumps. Pipe type and materials will depend on the particulars of the site conditions, and shall be detailed in the Pumping Plan. Contractor will provide all connections.

PART 3 EXECUTION

3.01 SITE CONDITIONS

Site conditions will vary by site. Contractor is responsible to determine and address requirements such as traffic control, excavation, connections & fittings, impacts on access to adjacent properties, routing and support of by-pass piping, etc., in the Pumping Plan.

3.02 ON-SITE MONITORING

- A. All by-pass operations where the anticipated flow rates are 750 G.P.M or greater shall require an employee on-site at all times (full-time on-site monitoring attended by personnel experienced with the pumps and controls, with demonstrated ability to monitor, turn on & off, and switch between pumps while the by-pass pump system is in service.
- B. By-pass operations where the anticipated flow rates are less than 750 G.P.M may not require an employee on-site at all times while the by-pass pump system is in operation. The Contractor shall have personnel experienced with the pumps and controls on site within the calculated response time to prevent an SSO after a high water alarm.
- C. During by-pass operations, the Contractor shall have posted on site with the permit, a copy of the approved Plan and the name and 24 hour contact number of the primary response person, the job site superintendent, and the construction company owner.

3.03 OPERATIONS

- A. The Contractor is responsible for securing and providing power, fuel, site security, traffic control and all other supplies, materials and permits required for the by-pass pumping.
- B. Contractor shall demonstrate automatic pump switching and alarm system to the satisfaction of: the County inspector, Project Manager, or Lift Stations Superintendent prior to beginning by-pass pumping. Satisfactory demonstration shall be documented by the inspector's, PM's or Lift Station Superintendent's dated signature on the posted copy of the approved Pumping Plan.

3.04 DAMAGE RESTORATION & REMEDIATION

- A. The Contractor shall be responsible for any pre-pump notifications, all restoration of pre-pump conditions and any damage caused by by-pass operations.
- B. Should there be an SSO caused by or as a direct result of the by-pass pumping, the contractor is responsible for all immediate & long term response, notifications, clean up, mitigation, etc. Copies of all written response plans, notifications, documentation, mitigation plans, etc., shall be submitted to the County Project Manager.

END OF SECTION

SECTION 02999 MISCELLANEOUS WORK AND CLEANUP

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. This Section includes items and operations which are not specified in detail as separate items, but may be sufficiently described as to the kind and extent of work involved. The Contractor shall furnish all labor, materials, equipment and incidentals necessary to complete all work under this Section.
- B. The work of this Section may include, but is not limited to the following:
1. Restoration of roads, sidewalks, driveways, curbing and gutters, fences, guardrails, lawns, shrubbery and any other existing items damaged or destroyed.
 2. Crossing utilities.
 3. Relocation of existing water, reclaim water, or sewer lines less than four inches diameter, water and sanitary sewer services, low pressure gas lines, telephone lines, electric lines, cable TV lines as shown on the Contract Drawings.
 4. Restoring easements (servitudes) and rights-of-way.
 5. Clean up.
 6. Incidental work (project photographs, testing, shop drawings, traffic control, record drawings, etc.).
 7. Excavation and Embankment - As defined in the Florida Department of Transportation Standard Specifications for Road and Bridge Construction (1991 Edition or latest revision).
 8. Stormwater and erosion control devices.

1.02 SUBMITTAL OF LUMP SUM BREAKDOWN

Contractor shall submit to the Owner/Engineer, a breakdown of the lump sum bid for Miscellaneous Work and Cleanup Item in the Proposal within 10 days after date of Notice to Proceed.

1.03 WORK SPECIFIED UNDER OTHER SECTIONS

All work shall be completed in a workmanlike manner by competent workmen in full compliance with all applicable sections of the Contract Documents.

PART 2 PRODUCTS

2.01 MATERIALS

Materials required for this Section shall equal or exceed materials that are to be restored. The Contractor may remove and replace or reuse existing materials with the exception of paving.

PART 3 EXECUTION

3.01 RESTORING OF SIDEWALKS, ROADS, CURBING, FENCES AND GUARDRAILS

- A. The Contractor shall protect existing sidewalks & curbing. If necessary, sidewalks & curbing shall be removed from joint to joint and replaced after backfilling. Curbing damaged during

construction because of the Contractor's negligence or convenience, shall be replaced with sidewalks & curbing of equal quality and dimension at no cost to the Owner.

- B. At the locations necessary for the Contractor to remove, store and replace existing fences and guardrails during construction, the sections removed shall be only at the direction of the Engineer. If any section of fence is damaged due to the Contractor's negligence, it shall be replaced at no cost to the Owner with fencing equal to or better than that damaged and the work shall be satisfactory to the Engineer.
- C. Guardrails in the vicinity of the work shall be protected from damage by the Contractor. Damaged guardrails shall be replaced in a condition equal to those existing
- D. Road crossings shall be restored in accordance with the Contract Documents and current FDOT Standards. Compensation for road restoration shall be included under the Road Restoration Bid Item if specified or under Miscellaneous Cleanup if it is not specified.

3.02 CROSSING UTILITIES

This item shall include any extra work required in crossing culverts, water courses, drains, water mains and other utilities, including all sheeting and bracing, extra excavation and backfill, or any other work required or implied for the proposed crossing, whether or not shown on the Drawings.

3.03 RELOCATIONS OF EXISTING GAS LINES, TELEPHONE LINES, ELECTRIC LINES AND CABLE TV LINES

The Contractor shall notify the proper utility involved when relocation of these utility lines is required. The Contractor shall coordinate all relocation work by the utility so that construction shall not be hindered.

3.04 RESTORING THE EASEMENTS AND RIGHTS-OF-WAY

The Contractor shall be responsible for all damage to private property due to his operations. He shall protect from injury all walls, fences, cultivated shrubbery, pavement, underground facilities, including water, sewer and reclaimed water lines and services, or other utilities which may be encountered along the easement. If removal and replacement is required, it shall be done in a workmanlike manner, at his expense, so that the replacement are equivalent to that which existed prior to construction.

3.05 STORMWATER AND EROSION CONTROL DEVICES

The Contractor shall be responsible for, provide, and install all stormwater and erosion control devices necessary to insure satisfactory compliance with the Florida Department of Environmental Protection Stormwater, Erosion, and Sedimentation Control Inspector's Manual.

END OF SECTION

DIVISION 3 CONCRETE

SECTION 03200 CONCRETE REINFORCEMENT

PART 1 GENERAL

1.01 WORK INCLUDED

- A. Reinforcing steel bars and welded steel wire fabric for cast-in-place concrete, complete with tie wire.
- B. Support chairs, bolsters, bar supports and spacers, for reinforcing.

1.02 QUALITY ASSURANCE

Perform concrete reinforcing work in accordance with ACI 318 unless specified otherwise in this Section.

1.03 REFERENCES

- A. ACI 318 - Building Code Requirements for Reinforced Concrete.
- B. ASTM A185 - Welded Steel Wire Fabric for Concrete Reinforcement.
- C. ASTM A615 - Deformed and Plain Billet Steel Bars for Concrete Reinforcement.
- D. CRSI 63 - Recommended practice for placing reinforcing bars.
- E. CRSI 65 - Recommended practice for placing bar supports, specifications and nomenclature.
- F. ACI 315 - American Concrete Institute - Manual of Standard Practice.

1.04 SHOP DRAWINGS

- A. Submit shop drawings in accordance with Contract Documents.
- B. Indicate bar sizes, spacings, locations and quantities of reinforcing steel and wire fabric, bending and cutting schedules and supporting and spacing devices.
- C. Manufacturer's Literature: Manufacturer's specifications and installation instructions for splice devices.

PART 2 PRODUCTS

2.01 REINFORCING

- A. Reinforcing steel: Grade 60, Minimum Yield Strength 60,000 psi, deformed billet steel bars, ASTM A615; plain finish.
- B. Welded steel wire fabric: Deformed wire, ASTM A497; smooth wire ASTM A185 in flat sheets; plain finish.

2.02 ACCESSORY MATERIALS

- A. Tie wire: Minimum 16 gauge annealed type, or patented system accepted by Engineer.
- B. Chairs, bolsters, bar supports, spacers: Sized and shaped for strength and support of reinforcing during construction conditions.
- C. Special chairs, bolsters, bar supports, spacers (where adjacent to architectural concrete surfaces): Stainless steel type sized and shaped as required.

2.03 FABRICATION

- A. Fabricate concrete reinforcing in accordance with ACI 315.
- B. Locate reinforcing splices, not indicated on Drawings, at points of minimum stress. Location of splices shall be reviewed by Engineer.
- C. Where indicated, weld reinforcing bars in accordance with AWS D12.1.

PART 3 EXECUTION

3.01 PLACEMENT

- A. Reinforcing shall be supported and secured against displacement. Do not deviate from true alignment.
- B. Before placing concrete, ensure reinforcing is clean, free of loose scale, dirt, or other foreign coatings which would reduce bond to concrete.

3.02 QUALITY ASSURANCE

- A. Acceptable Manufacturers: Regularly engaged in manufacture of steel bar and welded wire fabric reinforcing.
- B. Installer Qualifications: Three years experience in installation of steel bar and welded wire fabric reinforcing.
- C. Allowable Tolerances:
 - 1. Fabrication:
 - a. Sheared length: +1 in.
 - b. Depth of truss bars: +0, -1/2 in.
 - c. Stirrups, ties and spirals: $\pm 1/4$ in.
 - d. All other bends: ± 1 in.
 - 2. Placement:
 - a. Concrete cover to form surfaces: $\pm 1/4$ in.
 - b. Minimum spacing between bars: 1 in.
 - c. Top bars in slabs and beams:
 - (1) Members 8 in. deep or less: $\pm 1/4$ in.
 - (2) Members more than 8 in.: $\pm 1/2$ in.
 - d. Crosswise of members: Spaced evenly within 2 in. of stated separation.
 - e. Lengthwise of members: Plus or minus 2 in.
 - 3. Maximum bar movement to avoid interference with other reinforcing steel, conduits, or

embedded items: 1 bar diameter.

3.04 PRODUCT DELIVERY, STORAGE AND HANDLING

- A. Deliver reinforcement to project site in bundles marked with metal tags indicating bar size and length.
- B. Handle and store materials to prevent contamination.

3.05 INSTALLATION

A. Placement:

- 1. Bar Supports: CRSI 65.
- 2. Reinforcing Bars: CRSI 63.

B. Steel Adjustment:

- 1. Move within allowable tolerances to avoid interference with other reinforcing steel, conduits, or embedded items.
- 2. Do not move bars beyond allowable tolerances without concurrence of Engineer.
- 3. Do not heat, bend, or cut bars without concurrence of Engineer.

C. Splices:

- 1. Lap splices: Tie securely with wire to prevent displacement of splices during placement of concrete.
- 2. Splice devices: Install in accordance with manufacturer's written instructions.
- 3. Do not splice bars without concurrency of Engineer, except at locations shown on Drawings.

D. Wire Fabric:

- 1. Install in longest practicable length.
- 2. Lap adjoining pieces one full mesh minimum, and lay splices with 16 gauge wire.
- 3. Do not make end laps midway between supporting beams, or directly over beams of continuous structures.
- 4. Offset end laps in adjacent widths to prevent continuous laps.

E. Cleaning: Remove dirt, grease, oil, loose mill scale, excessive rust, and foreign matter that will reduce bond with concrete.

F. Protection During Concreting: Keep reinforcing steel in proper position during concrete placement.

END OF SECTION

SECTION 03300 CAST-IN-PLACE CONCRETE

PART 1 GENERAL

1.01 WORK INCLUDED

Poured-in-place concrete slabs, thrust blocks, pile caps and pipe support cradles.

1.02 QUALITY ASSURANCE

Perform cast-in-place concrete work in accordance with ACI 318, unless specified otherwise in this Section.

1.03 TESTING LABORATORY SERVICES

- A. Inspection and testing will be performed by the testing laboratory currently under contract to Manatee County in accordance with the Contract Documents.
- B. Provide free access to work and cooperate with appointed firm.
- C. Submit proposed mix design of each class of concrete to inspection and testing firm for review prior to commencement of work.
- D. Tests of cement and aggregates may be performed to ensure conformance with requirements stated herein.
- E. Three concrete test cylinders will be taken for every 100 cu. yds. or part thereof of each class of concrete placed each day. Smaller pours shall have cylinders taken as directed by the Engineer.
- F. One slump test will be taken for each set of test cylinders taken.

1.04 REFERENCES

- A. ASTM C33 - Concrete Aggregates
- B. ASTM C150 - Portland Cement
- C. ACI 318 - Building Code Requirements for Reinforced Concrete
- D. ASTM C260 - Air Entraining Admixtures for Concrete
- E. ASTM C94 - Ready-Mixed Concrete
- F. ACI 304 - Recommended Practice for Measuring, Mixing, Transporting and Placing Concrete
- G. ACI 305 - Recommended Practice for Hot Weather Concreting

PART 2 PRODUCTS

2.01 CONCRETE MATERIALS

- A. Cement: Moderate-Type II, High early strength-Type III, Portland type, ASTM C150.

- B. Fine and Coarse Aggregates: ASTM C33.
- C. Water: Clean and free from injurious amounts of oil, alkali, organic matter, or other deleterious material.

2.02 ADMIXTURES

- A. Air Entrainment: ASTM C260.
- B. Chemical: ASTM C494 Type A - water reducing admixture.

2.03 ACCEPTABLE MANUFACTURERS

Acceptable Products:

1. Pozzolith
2. WRDA

2.04 ACCESSORIES

Non-shrink grout: Premixed compound consisting of non-metallic aggregate, cement, water reducing and plasticizing agents; capable of developing minimum compressive strength of 2400 psi in 2 days and 7000 psi in 28 days.

2.05 CONCRETE MIXES

- A. Mix concrete in accordance with ASTM C94.
- B. Provide concrete of following strength:
 1. Required concrete strengths as determined by 28 day cylinders shall be as shown on the Drawings, but shall not be less than 3000 psi.
 2. Select proportions for normal weight concrete in accordance with ACI 301 3.8 Method 1, Method 2, or Method 3. Add air entraining agent to concrete to entrain air as indicated in ACI 301 Table 3.4.1.
 3. All mixes shall be in accordance with FDOT Specifications.
- C. Use set-retarding admixtures during hot weather only when accepted by Engineer.
- D. Add air entraining agent to concrete mix for concrete work exposed to exterior.

2.06 FORMS

- A. Forms shall be used for all concrete masonry, including footings. Form shall be so constructed and placed that the resulting concrete will be of the shape, lines, dimensions, appearance and to the elevations indicated on the Drawings.
- B. Forms shall be made of wood, metal, or other approved material. Wood forms shall be constructed of sound lumber or plywood of suitable dimensions, free from knotholes and loose knots; where used for expose surfaces, boards shall be dressed and matched. Plywood shall be sanded smooth and fitted with tight joints between panels. Metal forms shall be of an approved type for the class of work involved and of the thickness and design

required for rigid construction.

- C. Edges of all form panels in contact with concrete shall be flush within 1/32-inch and forms for plane surfaces shall be such that the concrete will be plane within 1/16-inch in four feet. Forms shall be tight to prevent the passage of mortar and water and grout.
- D. Forms for walls shall have removable panels at the bottom for cleaning, inspection and scrubbing-in of bonding paste. Forms for walls of considerable height shall be arranged with tremies and hoppers for placing concrete in a manner that will prevent segregation and accumulation of hardened concrete on the forms or reinforcement above the fresh concrete.
- E. Molding or bevels shall be placed to produce a 3/4-inch chamfer on all exposed projecting corners, unless otherwise shown on the Drawings. Similar chamfer strips shall be provided at horizontal and vertical extremities of all wall placements to produce "clean" separation between successive placements as called for on the Plans.
- F. Forms shall be sufficiently rigid to withstand vibration, to prevent displacement or sagging between supports and constructed so the concrete will not be damaged by their removal. The Contractor shall be entirely responsible for their adequacy.
- G. Forms, including new pre-oiled forms, shall be oiled before reinforcement is placed, with an approved nonstaining oil or liquid form coating having a non-paraffin base.
- H. Before form material is re-used, all surfaces in contact with concrete shall be thoroughly cleaned, all damaged places repaired, all projecting nails withdrawn, all protrusions smoothed and in the case of wood forms pre-oiled.
- I. Form ties encased in concrete shall be designed so that after removal of the projecting part, no metal shall be within 1-inch of the face of the concrete. That part of the tie to be removed shall be at least 1/2-inch diameter or be provided with a wood or metal cone at least 1/2-inch in diameter and 1-inch long. Form ties in concrete exposed to view shall be the cone-washer type equal to the Richmond "Tyscru". Throughbolts or common wire shall not be used for form ties.

PART 3 EXECUTION

3.01 PLACING CONCRETE

- A. Place concrete in accordance with ACI 304.
- B. Notify Engineer minimum 24 hours prior to commencement of concreting operations.
- C. Verify anchors, seats, plates and other items to be cast into concrete are placed, held securely and will not cause hardship in placing concrete. Rectify same and proceed with work.
- D. Maintain records of poured concrete items. Record date, location of pour, quantity, air temperature and test samples taken.
- E. Ensure reinforcement, inserts, embedded parts, formed expansion and contraction joints are not disturbed during concrete placement.
- F. Prepare previously placed concrete by cleaning with steel brush and applying bonding agent.

Apply bonding agent in accordance with manufacturer's recommendations.

- G. Pour concrete continuously between predetermined construction and control joints. Do not break or interrupt successive pours such that cold joints occur.
- H. In locations where new concrete is dowelled to existing work, drill holes in existing concrete, insert steel dowels and pack solidly with non-shrink grout.
- I. Excessive honeycomb or embedded debris in concrete is not acceptable. Notify Engineer upon discovery.
- J. Conform to ACI 305 when concreting during hot weather.

3.02 SCREEDING

Screed surfaces level, maintaining flatness within a maximum deviation of 1/8" in 10 feet.

3.03 PATCHING

Allow Engineer to inspect concrete surfaces immediately upon removal of forms. Patch imperfections as directed. All patching procedures shall be submitted to and approved by the Engineer prior to use.

3.04 DEFECTIVE CONCRETE

- A. Modify or replace concrete not conforming to required lines, details and elevations.
- B. Repair or replace concrete not properly placed resulting in excessive honeycomb and other defects. Do not patch, fill, touch-up, repair, or replace exposed architectural concrete except upon express direction of Engineer for each individual area.

3.05 CONCRETE FINISHING

Provide concrete surfaces to be left exposed, columns, beams and joists with smooth rubbed finish.

3.06 CURING AND PROTECTION

Beginning immediately after placement, protect concrete from premature drying, excessively hot or cold temperatures and mechanical injury. Maintain concrete with minimal moisture loss at relatively constant temperature for a period of 7 days or until concrete strengths reaches 75% of the 28 day design strength.

Protection against moisture loss may be obtained with spray on curing compounds or plastic sheets. Protection against heat or cold may be obtained with insulated curing blankets or forms.

3.07 CONCRETE DRIVEWAY RESTORATION

Concrete driveways shall be restored with 6 inches of 3,000 psi concrete with W2.5 X W2.5, 6X6 wire mesh. Place ½ inch expansion joint between back of curb and new concrete. Area beneath restoration shall be mechanically tamped prior to placing concrete.

3.08**CONCRETE SIDEWALK RESTORATION**

Concrete sidewalks across driveways shall be restored with 6 inches of 3,000 psi concrete with W2.5 X W2.5, 6X6 wire mesh. Place ½ inch expansion joint between back of curb and new concrete. Area beneath restoration shall be mechanically tamped prior to placing concrete.

Concrete sidewalks outside of driveways shall be restored with 4 inches of 3,000 psi concrete per FDOT Design Standards, Sections 522 & 310

END OF SECTION

SECTION 03350 CONCRETE FINISHES

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish all labor, materials, equipment and incidentals required to finish cast-in-place concrete surfaces as specified herein.

1.02 SUBMITTALS

Submit to the Engineer as provided in the Contract Documents, the proposed chemical hardener manufacturer's surface preparation and application procedures.

1.03 SCHEDULE OF FINISHES

- A. Concrete for the Project shall be finished in the various specified manners either to remain as natural concrete or to receive an additional applied finish or material under another Section.
- B. The base concrete for the following conditions shall be finished as noted and as further specified herein:
 - 1. Exterior, exposed concrete slabs and stairs - broomed finish.
 - 2. Interior, exposed concrete slabs - steel trowel finish.
 - 3. Concrete on which process liquids flow or in contact with sludge - steel trowel finish.
 - 4. Concrete where not exposed in the finished work and not scheduled to receive an additional applied finish or material - off-form finish.
 - 5. Provide concrete surfaces to be left exposed such as walls, columns, beams and joists with smooth rubbed finish.

1.04 RESPONSIBILITY FOR CHANGING FINISHES

- A. The surface finishes specified for concrete to receive additional applied finishes or materials are the finishes required for the proper application of the actual products specified under other Sections. Where different products are approved for use, it shall be the Contractor's responsibility to determine if changes in finishes are required and to provide the proper finishes to receive these products.
- B. Changes in finishes made to accommodate product different from those specified shall be performed at no additional cost to the Owner. Submit the proposed new finishes and their construction methods to the Engineer for approval.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Portland cement and component materials required for finishing the concrete surfaces shall be as specified in the Contract Documents.
- B. Hardener shall be Lapidolith as manufactured by Sonneborn Building Products or approved equal. Hardener shall be used on all floors, stair treads and platforms.

PART 3 EXECUTION

3.01 FORMED SURFACES

- A. Forms shall not be stripped before the concrete has attained a strength of at least 50 percent of the ultimate design strength. This is equivalent to approximately five "100 day-degrees" of moist curing.
- B. Care shall be exercised to prevent damaging edges or obliterating the lines of chamfers, rustications, or corners when removing the forms or doing any work adjacent thereto.
- C. Clean all exposed concrete surfaces and adjoining work stained by leakage of concrete, to the satisfaction of the Engineer.
- D. Off-form finish. Fins and other projections shall be removed as approved. Tie cone holes and other minor defects shall be filled with non-shrink grout specified under the Contract Documents.

3.02 FLOORS AND SLABS

- A. Floors and slabs shall be screeded to the established grades and shall be level with a tolerance of 1/8-inch when checked with a 10 foot straight edge, except where drains occur, in which case floors shall be pitched to drains as indicated. Failure to meet either of above shall be cause for removal, grinding, or other correction as approved by the Engineer.
- B. Following screeding as specified above, power steel trowel as follows:

- 1. Immediately after final screeding, a dry cement/sand shake in the proportion of 2-sacks of portland cement to 350-pounds of coarse natural concrete sand shall be sprinkled evenly over the surface at the rate of approximately 500 pounds per 1,000 square feet of floor. Neat, dry cement shall not be sprinkled on the surface. This shake shall be thoroughly floated into the surface with an approved disc type power compacting machine weighing at least 200 pounds if a 20-inch disc is used or 300 pounds if a 24-inch disc is used (such as a "Kelly Float" as manufactured by the Weisner-Rapp Corporation of Buffalo, New York). A mechanical blade-type float or trowel is not acceptable for this work.

NOTE: This operation (application of the cement/sand shake) may be eliminated at the discretion of the Engineer if the base slab concrete exhibits adequate fattiness and homogeneity.

- 2. In lieu of power steel troweling, small areas as defined by the Engineer shall be compacted by hand steel troweling with the dry cement/sand shake as ordered.
- 3. The floor or slab shall be compacted to a smooth surface and the floating operation continued until sufficient mortar is brought to the surface to fill all voids. The surfaces shall be tested with a straight edge to detect high and low spots which shall be eliminated.
- 4. Compaction shall be continued only until thorough densification is achieved and a small amount of mortar is brought to the surface. Excessive floating shall be avoided.

- C. After Paragraph 3.02 A and B procedures are accomplished, floors and slabs for particular

conditions shall be completed as scheduled in one of the following finishes:

1. Wood float finish. Hand wood float, maintaining the surface tolerance to provide a grained, nonslip finish as approved.
 2. Broomed finish. Hand wood float maintaining the surface tolerance and then broom with a stiff bristle broom in the direction of drainage to provide a nonslip finish as approved.
 3. Steel trowel finish. Hand steel trowel to a perfectly smooth, hard even finish free from high or low spots or other defects as approved.
- D. Floors, stair treads and platforms shall be given a floor hardener. Application shall be according to manufacturer's instructions.

3.03 APPROVAL OF FINISHES

- A. All concrete surfaces will be inspected during the finishing process by the Engineer.
- B. Surfaces which, in the opinion of the Engineer, are unsatisfactory shall be refinished or reworked until approved by the Engineer.

END OF SECTION

SECTION 03410 PRECAST CONCRETE STRUCTURES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all materials, labor and equipment and construct valve vaults, meter vaults, concrete pipe and accessory items, consisting of precast sections as shown on the Drawings and as specified herein.
- B. The forms, dimensions, concrete and construction methods shall be approved by the Engineer in advance of construction.
- C. These Specifications are intended to give a general description of what is required, but do not purport to cover all of the structural design details which will vary in accordance with the requirements of the plans. It is, however, intended to cover the furnishing, shop testing, delivery and complete installation of all precast structures whether specifically mentioned in these Specifications or not.
- D. The supplier of the precast items shall coordinate his work with that of the Contractor to insure that the units will be delivered and installed in the excavation provided by the Contractor, in accordance with the Contractor's construction schedule.
- E. The Contractor will ensure coordination of the precast structures fabrication with the supplier to achieve the proper structural top slab openings, spacings and related dimensions for the selected equipment frames and covers. The top slabs, frames, covers, and subsurface structures outside of roadways shall be capable of live load of 300 pounds per square foot unless noted otherwise.
- F. All interior surfaces of valve vaults and meter vaults shall be painted with two coats of coal tar epoxy paint dry film thickness of 8 mils each coat, as approved by the Engineer.

1.02 SUBMITTALS

- A. Submit to the Engineer in accordance with the Contract Documents, shop drawings showing details of construction, reinforcing, and joints.
- B. Shop Drawings
 - 1. Content
 - a. Dimensions and finishes.
 - b. Estimated camber.
 - c. Reinforcing and connection details.
 - d. Lifting and erection inserts.
 - e. Other items cast into members.
 - 2. Show location of unit by same identification mark placed on member.
 - 3. Include design calculations.
- C. Manufacturer's Literature: Manufacturer's recommended installation instructions.
- D. Manufacturer's certificates of material conformance with Specifications.

- E. Test Reports: Reports of tests on concrete. A minimum of three compression test cylinders will be required for each pour.

1.03 INSPECTION

- A. The quality of all materials, the process of manufacture and the finished sections shall be subject to inspection and approval by the Engineer, or other representatives of the Owner. Such inspection may be made at the place of manufacture, or at the site after delivery, or at both places and the sections shall be subject to rejection at any time due to failure to meet any of the Specification requirements; even though sample sections may have been accepted as satisfactory at the place of manufacture. Sections rejected after delivery to the project site shall be marked for identification and shall be removed from the project site at once. All sections which have been damaged after delivery will be rejected and if already installed, shall be acceptably repaired, if permitted, or removed and replaced entirely at the Contractor's expense.
- B. At the time of inspection, the sections will be carefully examined for compliance with the applicable ASTM designation and these Specifications and with the approved manufacturer's drawings.
 - 1. All sections shall be inspected for general appearance, dimension, "scratch-strength", blisters, cracks, roughness, soundness, etc. The surface shall be dense and close-textured.
 - 2. All sections shall meet the manufacturing tolerance requirements of ASTM C-478 or the following casting tolerances, whichever are more severe:

Wall Thickness $\pm 3/8"$
Inside Diameter $\pm 3/8"$
Outside Diameter $\pm 1/2"$
Height or Length $\pm 3/8"$
- C. Imperfections may be repaired, subject to the approval of the Engineer, after demonstration by the manufacturer that strong and permanent repairs result. Repairs shall be carefully inspected before final approval. Cement mortar used for repairs shall have a minimum compressive strength of 4,000 psi at the end of 7 days and 5,000 psi at the end of 28 days, when tested in 3-inch by 6-inch cylinders stored in the standard manner. Epoxy mortar may be utilized for repairs subject to the approval of the Engineer.

PART 2 PRODUCTS

2.01 PRECAST CONCRETE SECTIONS

- A. Joints between precast concrete sections shall be set by plastic shims and filled with non-metallic non-shrink grout as specified in the Contract Documents and shown on the Drawings.
- B. The top slab sections shall be fitted with water tight hatches as specified in the Construction Drawings. The frames and covers will be sized for the openings shown on the Contract Drawings.
- C. The various precast sections shall have the inside dimensions and minimum thickness of concrete as indicated on the Drawings. All precast and cast-in-place concrete members shall conform to the Building Code Requirements for Reinforced Concrete ACI 318 and applicable ASTM Standards.
- D. Fillets shall be provided and installed in the wet wells as shown on the Drawings. They shall be

constructed using concrete fill and shall conform to the Contract Documents.

- E. Precast structures shall be constructed to the dimensions as shown on the Drawings and as specified in these Specifications. Flow channels, inverts, and benches in manholes shall be precast, not constructed after installation. Provide a true curve of the largest radius possible for changes in direction of sewer and entering branch or branches.
- F. Type II cement shall be used, typically at a compressive strength of 4,000 psi, except as otherwise approved.
- G. The date of manufacture and the name or trademark of the manufacturer shall be clearly marked on the inside of each precast section.
- H. Sections shall be cured by an approved method and shall not be shipped until at least seven (7) days after having been fabricated.
- I. Each precast section manufactured in accordance with the Drawings shall be clearly marked to indicate the intended installation location. The Contractor shall be responsible for the installation of the correct precast sections in their designated locations.
- J. Wet wells, and manholes receiving flow from lift stations shall be precast with a cast in place PVC protective liner.
 - 1. The prefabricated wetwell or manhole liner shall be a non-load bearing component installed and adequately anchored inside a new precast concrete wetwell or manhole riser during the concrete casting process at the concrete precaster's manufacturing facility. The liner must be fully supported during the casting process.
 - 2. The liners shall be resistant to the chemical environment normally found in the gravity wastewater transmission systems to which they will be exposed.
 - 3. The liner shall have a warranty against defect in material and workmanship for a period of three years.
 - 4. After assembly and installation, in the field, all internal seams are to be sealed by bonding or welding per the manufacturer's standard method and details.
 - 5. Any repairs or other modifications to the liner, such as patching or sealing PVC sleeves used for pipe penetrations of the structure, shall sealed by bonding or welding per the PVC liner manufacturer's standard methods and details.

PART 3 EXECUTION

3.01 INSTALLATION

- A. The Contractor shall be responsible for handling ground water to provide firm, dry subgrade for the structure, shall prevent water rising on new poured-in-place concrete or grouted joint sections within 24 hours after placing and shall guard against flotation or other damage resulting from ground water or flooding.
- B. A minimum of an 8-inch shell base compacted layer of washed shell or crushed stone shall be placed as a foundation for the wet well base slabs and valve and/or meter vault pits.
- B. Backfill materials around the wet well and above the pipe bedding shall be select material as specified in the Contract Documents.
- D. Precast bases, conforming to all requirements of ASTM C478 and above listed requirements for

precast sections, may be used.

- E. The structure shall not be set into the excavation until the installation procedure and excavation have been approved by the Engineer.
- F. The base may be cast-in-place concrete placed on a thoroughly compacted crushed rock subbase. The tops of the cast-in-place bases shall be shaped to mate with the precast barrel section and shall be adjusted in grade so that the top slab section is at the approximately correct elevation.
- G. Precast concrete structure sections shall be set so as to be vertical and with sections in true alignment with a 1/4-inch maximum tolerance to be allowed. The outside and inside joint shall be filled with a non-shrink grout and finished flush with the adjoining surfaces. Allow joints to set for 24 hours before backfilling. Backfilling shall be done in a careful manner, bringing the fill up evenly on all sides. The Contractor shall install the precast sections in a manner that will result in a watertight joint. Leaking joints are not acceptable.
- H. Holes in the concrete sections required for handling or other purposes shall be plugged with a non-shrink grout or by grout in combination with concrete plugs.
- I. Where holes must be cut in the precast sections to accommodate pipes, cutting shall be done prior to setting them in place to prevent any subsequent jarring which may loosen the mortar joints.
- J. Frames and hatches specified and furnished shall be cast in the cover slab prior to setting. Normal installation shall include 6" to 12" of concrete grade rings between the top of the cone section and the cover plate ring slab.

ASTM A48-74, or most recent revision, Specification for Gray Iron Castings, Class 30 or Grade 60-45-10 Ductile Iron meeting the requirements of ASTM A536-72, or most recent revision, Specification for Ductile Iron Castings. Cast in a true symmetrical pattern of tough, dense and even grained iron, free from warping, scales, lumps, blisters, sandholes, or any defects of any kind. Provide indented pattern lids with lettering as shown on the Drawings. Machine or grind frames and lids at touching surfaces to provide firm seats and prevent rocking. Remove and replace any set not matching perfectly. All frames and covers shall be designed to withstand an HS20-44 wheel loading as defined by AASHTO specifications.

- K. Manhole inserts: Watertight manhole inserts shall be required for all sanitary sewer manholes installed. Inserts shall be as manufactured by FRW Industries, Conroe, Texas, or approved equal. Inserts shall be complete with a self-cleaning relief valve. Relief valves shall operate on a pressure differential of 1/2 psi. Neoprene gaskets shall be installed under the insert lip to insure a leakproof seal.
- L. Penetrations and connections into precast or existing structures shall be accomplished by rotary core boring.

3.04 TESTING

- A. After constructed to its finished height and before being backfilled, each manhole shall be tested for water tightness.
 - 1. Plug pipe lines and perform vacuum test. Observing all recommended safety measures induce a backpressure of 5.0 p.s.i. equivalent to 10" Hg (mercury). The

manhole assembly is considered satisfactory if the vacuum loss is less than 1" Hg for the length of time listed in the following table:

Time of Test in Seconds			
Depth Feet	Manhole Diameter in Feet		
	4	5	6
4	10	13	16
8	20	26	32
12	30	39	48
16	40	52	64
20	50	65	80
24	60	78	96
T	5	6.5	8

Note: Add "T" seconds for each additional 2'- of depth.

- B. Failure to pass this test requires the Contractor to correct the problems and retest. The Contractor will replace leaking gaskets and/or concrete sections and retest the completed manhole. No manhole will be accepted without successfully passing this test.

END OF SECTION

DIVISION 5 METALS

SECTION 05500 MISCELLANEOUS METAL

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, equipment and incidentals required and install covers, grates, frames and other miscellaneous metals as shown on the Drawings and specified herein. The miscellaneous metal items include but are not limited to the following:
1. All metal frames, ladders, stairs, stair rails, floor opening frames including gratings and supports.
 2. Prefabricated access hatches and frames.
 3. Anchors and anchor bolts except those specified to be furnished with all equipment.
 4. Railings, posts and supports both interior and exterior.
 5. Cast iron frames, covers, grates, drain leaders and drains.
 6. Bridge crane track supports.
 7. Stair nosings, steel plates, overhead steel door frames, angle frames, plates and channels.
 8. Exterior H.V.A.C. hoods.
 9. Pump guide rail system.

1.02 COORDINATION

- A. The work in this Section shall be completely coordinated with the work of other Sections. Verify at the site both the dimensions and work of other trades adjoining items of work in this Section before fabrication and installation of items herein specified.
- B. Furnish to the pertinent trades all items included under this Section that are to be built into the work of other Sections.

1.03 SHOP DRAWINGS AND SAMPLES

- A. Detail drawings, as provided for in the Contract Documents, showing sizes of members, method of assembly, anchorage, and connection to other members shall be submitted to the Engineer for approval before fabrication.
- B. Samples shall be submitted at the request of the Engineer for concurrent review with Shop Drawings.

1.04 FIELD MEASUREMENTS

- A. Field measurements shall be taken at the site to verify or supplement indicated dimensions and to insure proper fitting of all items.

1.05 REFERENCED SPECIFICATIONS

- A. Unless otherwise specified, materials shall conform to the following:

Structural Steel	ASTM A36
Welded & Seamless Steel Pipe	ASTM A53
Gray Iron Castings	ASTM A48, Class 30
Galvanizing, general	ASTM A123
Galvanizing, hardware	ASTM A153
Galvanizing, assemblies	ASTM A386
Aluminum (Extruded Shapes)	6061-T6 (Alum. alloy)
Aluminum (Extruded Pipe)	6061-T6 (Alum. alloy)
Aluminum Bar Structural	6061-T6 (Alum. alloy)
Bolts and Nuts	ASTM, A307
Stainless Steel Bolts, Fasteners	AISI, Type 316
Stainless Steel Plate and Sheet, Wire	AISI, Type 316
Welding Rods for Steel	AWS Spec. for Arc Welding

PART 2 PRODUCTS

2.01 ANCHORS, BOLTS AND FASTENING DEVICES

- A. Anchors, bolts, etc., shall be furnished as necessary for installation of the work of this Section.
- B. Compound masonry anchors shall be of the type shown or required and shall be equal to Star Slug in compounded masonry anchors manufactured by Star Expansion Industries, equal by Phillips Drill Co., Rawlplug, or equal. Anchors shall be minimum "two unit" type.
- C. The bolts used to attach the various members to the anchors shall be the sizes shown or required. Stainless steel shall be attached to concrete or masonry by means of stainless steel machine bolts and iron or steel shall be attached with steel machine bolts unless otherwise specifically noted.
- D. For structural purposes, unless otherwise noted, expansion bolts shall be Wej-it "Ankr-Tite", Phillips Drill Co. "Wedge Anchors", or Hilti "Kwik-Bolt". When length of bolt is not called for on the Drawings, the length of bolt provided shall be sufficient to place the wedge portion of the bolt a minimum of 1-inch behind the reinforcing steel within the concrete. Material shall be as noted on the Drawings. If not listed, all materials shall be stainless steel.

2.02 ALUMINUM ITEMS

- A. Aluminum gratings shall be of serrated I-Bar Aluminum Alloy 6061-T6, fabricated to the depths and thicknesses shown on the Drawings and shall be Reliance Steel Products Company, I-Lok Type 7/8 R4 Aluminum Grating; IKG Industries, "Galok" Aluminum I-Bar Grating Type S194-I, or equal. All openings 2 inches and greater in diameter shall be banded with a bar of the same depth and thickness as the main bearing bars of the grating, or furnished with continuous cross bridges. Each cut bar shall be welded to the band if banding is utilized. The ends of all grating sections shall be likewise banded. Clamps and bolts used for attaching grating to supporting members shall be stainless steel. All grating shall be clamped unless noted otherwise. Clamps shall be as recommended by the manufacturer.

- B. Stair treads shall be as specified above for grating and shall have abrasive nonslip nosing.
- C. Aluminum nosing at concrete stairs shall be an extrusion of 4-inch minimum width with abrasive filled and shall be Wooster Products, Inc., Alumogrit Treads, Type 116; equal by Barry Pattern and Foundry Co.; Andco; or equal. Embedded anchors shall be furnished with a minimum of three anchors per tread.
- D. Aluminum ladders shall be fabricated to the dimensions and details and installed as shown on the Drawings. Treads to be of cast aluminum by Dixie Metals, Inc. of Fort Lauderdale, Florida or equal.
- E. Aluminum Handrails, Mechanically Fastened Type:
 - 1. All aluminum mechanically fastened type pipe handrails and guardrails shall be clear anodized aluminum finish and installed as specified herein and indicated on the Drawings. Handrails shall be made of nominal 1-1/2 inches inside diameter pipe (Schedule 40) fabricated or seamless 6063-T6 alloy. The supplier of the handrail system shall supply all necessary fittings, rackets, transition, corner and connector pieces, toeboards, protective gaskets, etc., for a complete job at the locations, indicated on the Drawings. All mounting hardware including bolts, studs, nuts, etc., shall be stainless steel Type 316. Bends shall be smooth and accurate to the details shown. Railings shall be the "Rigid Rail System" as manufactured by Reynolds Aluminum of Reynolds Metal Company as Reynolds II pipe railing system or the "Connectorail System" as manufactured by Julius Blum & Co., Inc., Carlstadt, New Jersey. The handrail systems shall comply with all OSHA and D Section 1208.2 of the Standard Building Code.
 - 2. Spacing of posts where posts are required shall be as noted on shop drawings, but in all cases, shall be uniform and shall not exceed the requirements of OSHA and Section 1208.2 of the Standard Building Code. Shorter spacing may be used where required to maintain the maximum spacing. The fabricator of the aluminum handrail and guardrail system shall be responsible for the design and preparation of shop drawings and design calculations (signed and sealed by Florida Registered Engineer) to meet OSHA requirements and Section 1208.2 of Standard Building Code.
 - 3. All railings shall be erected in line and plumb. Field splicing and expansion compensation shall be accomplished using internal splice sleeves. Make provisions for removable railing sections as detailed and where shown on the Drawings.
 - 4. Where handrail or guardrail posts are set in concrete as per the manufacturer's requirements the posts shall be set into aluminum sheeves cast in the concrete and firmly cemented with 1651 epoxy resin by E-Bond Epoxies, Oakland Park, Florida, Moulded Reinforced Plastics, Inc., Fort Lauderdale, Florida or equal. Collars shall be placed on the posts and fastened in place, as shown and as detailed on approved shop drawings.
 - 5. Where handrail is supported from structural members, it shall be done by the use of approved sockets, flanges, brackets, or other approved means which will

provide neat and substantial support for the pipe railing.

6. All railing shall be properly protected by paper, or by an approved coating or by both against scratching, splashes or mortar, paint, or other defacements during transportation and erection and until adjacent work by other trades has been completed.
- F. Toeboards: Contractor shall furnish and install aluminum toeboards conforming to latest OSHA requirements on all railings and other locations where indicated on the Drawings.
1. Toeboards shall consist of an extruded 6063-T6 aluminum shape bolted by means of a pipe clamp to the railing posts without requiring any drilling or welding of the toeboard to the railing posts as manufactured by Reynolds Aluminum, Julies Blum & Company, Thompson Fabricating Company or equal. Toeboards shall have pitched top and tear drop bottom to prevent accumulation of dirt, or other material.
 2. All fastening hardware shall be Type 316 stainless steel.
- G. Kickplates, if required, shall be fabricated and installed as shown on the Drawings.
- H. Aluminum safety gate shall be fabricated of extruded aluminum.
- I. Prefabricated checkerplate aluminum floor hatches shall be Type "JD", or "KD" as manufactured by Bilco Co., Babcock-Davis Associates, Inc.; Type "AM" Inland-Ryerson Construction Products Co., Milcor Division; or equal, sized as shown. Hatches with either dimension over 3 feet-6 inches shall be double leaf type. Hatches shall be designed for a live load of 300 pounds per square foot. Hatches shall be watertight.
- J. Ship ladders shall be of all aluminum construction as detailed. Treads shall have abrasive nosing as manufactured by Reliance Steel Products Co., IKG Industries, or equal.
- K. Checkplate aluminum cover plates shall be fabricated to the details shown and installed at the locations shown.
- L. Structural aluminum angle and channel door frames shall be provided as shown on the Drawings and shall be anodized. Frames shall be fabricated with not less than three anchors on each jamb.
- M. Miscellaneous aluminum shapes and plates shall be fabricated as shown. Angle frames for hatches, beams, grates, etc., shall be furnished complete with welded strap anchors attached. Furnish all miscellaneous aluminum shown, but not otherwise detailed. Structural shapes and extruded items shall conform to the detail dimensions on the Plans within the tolerances published by the American Aluminum Association.

2.03 STEEL ITEMS

- A. Sleeves shall be steel or cast iron pipe in walls and floors with end joints as shown on the Drawings. All pipe sleeves shall have center anchor around circumference as shown.

- B. Miscellaneous steel pipe for sleeves and lifting attachments and other uses as required shall be Schedule 40 pipe fabricated according to the details as shown on the Drawings.
- C. Miscellaneous steel shall be fabricated and installed in accordance with the Drawings and shall include: beams, angles, support brackets, closure angles in roof at edge of T-beams; base plates to support ends of T-beams; door frames; splice plates, anchor bolts; lintels and any other miscellaneous steel called for on the Drawings and not otherwise specified.

2.04 CAST IRON ITEMS

- A. Outside pipe clean-out frames and covers shall be heavy duty, R-6013-R-6099 series as manufactured by Neenah Foundry Co., or equal. All outside pipe clean-outs shall be 6-inch diameter.
- B. Frames and covers for valve vaults and manholes shall be of a good quality, strong, tough even grained cast iron except as otherwise specified below. Castings shall be as manufactured by the U. S. Foundry, Neenah Foundry, Mechanics Iron Foundry, or equal. Covers to have letters "WATER", "SEWER" or "DRAIN", as applicable, embossed on top.

PART 3 EXECUTION

3.01 FABRICATION

- A. All miscellaneous metal work shall be formed true to detail, with clean, straight, sharply defined profiles and smooth surfaces of uniform color and texture and free from defects impairing strength or durability.
- B. Connections and accessories shall be of sufficient strength to safely withstand stresses and strains to which they will be subjected. Steel accessories and connection to steel or cast iron shall be steel, unless otherwise specified. Threaded connections shall be made so that the threads are concealed by fitting.
- C. Welded joints shall be rigid and continuously welded or spot welded as specified or shown. The face of welds shall be dressed flush and smooth. Exposed joints shall be close fitting and jointed where least conspicuous.
- D. Welding of parts shall be in accordance with the Standard Code of Arc and Gas Welding in Building Construction of the AWS and shall only be done where shown, specified, or permitted by the Engineer. All welding shall be done only by welders certified as to their ability to perform welding in accordance with the requirements of the AWS Code. Component parts of built-up members to be welded shall be adequately supported and clamped or held by other adequate means to hold the parts in proper relation for welding.
- E. Welding of aluminum work shall be on the unexposed side as much as possible in order to prevent pitting or discoloration.
- F. All aluminum finish exposed surfaces, except as specified below, shall have manufacturer's standard mill finish. Aluminum handrails shall be given an anodic oxide treatment in accordance with the Aluminum Association Specification AA-C22-

A41. A coating of methacrylate lacquer shall be applied to all aluminum shipment from the factory.

- G. Castings shall be of good quality, strong, tough, even-grained, smooth, free from scale, lumps, blisters, sand holes, and defects of any kind which render them unfit for the service for which they are intended. Castings shall be thoroughly cleaned and will be subjected to a hammer inspection in the field by the Engineer. All finished surfaces shown on the Drawings and/or specified shall be machined to a true plane surface and shall be true and seat at all points without rocking. Allowances shall be made in the patterns so that the thickness specified or shown shall not be reduced in obtaining finished surfaces. Castings will not be acceptable if the actual weight is less than 95 percent of the theoretical weight computed from the dimensions shown. The Contractor shall provide facilities for weighing castings in the presence of the Engineer showing true weights, certified by the supplier.
- H. All steel finish work shall be thoroughly cleaned, in accordance with the Contract Documents, of all loose mill scale, rust, and foreign matter before shipment and shall be given one shop coat of primer compatible with finish coats specified in Painting Section after fabrication but before shipping. Paint shall be applied to dry surfaces and shall be thoroughly and evenly spread and well worked into joints and other open spaces. Abrasions in the field shall be touched up with primer immediately after erection. Final painting is specified in the Contract Documents.
- I. Galvanizing, where required, shall be the hot-dip zinc process after fabrication. Following all manufacturing operations, all items to be galvanized shall be thoroughly cleaned, pickled, fluxed, and completely immersed in a bath of molten zinc. The resulting coating shall be adherent and shall be the normal coating to be obtained by immersing the items in a bath of molten zinc and allowing them to remain in the bath until their temperature becomes the same as the bath. Coating shall be not less than 2 oz. per sq. ft. of surface.

3.01 INSTALLATION

- A. Install all furnished items imbedded in concrete or other masonry. Items to be attached to concrete or masonry after such work is completed shall be installed in accordance with the details shown. Fastening to wood plugs in masonry will not be permitted. All dimensions shall be verified at the site before fabrication is started.
- B. All steel surfaces to come in contact with exposed concrete or masonry shall receive a protective coating of an approved heavy bitumastic troweling mastic applied in accordance with the manufacturer's instructions prior to installation.
- C. Where aluminum is embedded in concrete, apply a heavy coat of approved bitumastic troweling mastic in accordance with the manufacturer's instructions prior to installation.
- D. Where aluminum contacts masonry or concrete, provide a 1/32-inch neophrene gasket between the aluminum and the concrete or masonry.
- E. Where aluminum contacts a dissimilar metal, apply a heavy brush coat of zinc-chromate primer and provide a 1/32-inch neoprene gasket between the aluminum and the dissimilar metal.

- C. Where aluminum contacts wood, apply two coats of aluminum metal and masonry paint to the wood.

END OF SECTION

SECTION 09970 SURFACE PROTECTION SPRAY SYSTEM

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required to install and test the coating system complete and ready for operation for the structures listed in the specifications and as shown on the Drawings.
- B. The work includes coating of all surfaces as shown and specified on the Drawings. This includes, but is not limited to stairs, walls, floors, concrete divider, concrete slabs, manholes wet wells, and all other work obviously required to be coated unless otherwise specified herein or on the Drawings. The omission of minor items in the Schedule of Work shall not relieve the Contractor of his obligation to include such items where they come within the general intent of the Specification as stated herein.

1.02 RELATED WORK

- A. Bypass pumping is the responsibility of the General Contractor.
- B. Concrete surface cleaning in each lift station is the responsibility of the General contractor.
- C. Removal and offsite disposal of rubble is the responsibility of the General Contractor.

1.03 SUBMITTALS

- A. Submit to the Engineer shop drawings and schedules of all surfacing systems and appurtenances required. Submit design data and specification data sheets listing all parameters used in the surfacing system design and thickness calculations based on applicable provisions of ASTM.
- B. Submit to the Engineer the name of the surfacing supplier, a list of materials to be furnished, and the qualification (per 1.05 A) of the application contractor.

1.04 REFERENCE STANDARDS

- A. American Society for Testing and Materials (ASTM)

ASTM D-638
ASTM D-790
- B. Where reference is made to one of the above standards, the revision in effect at the time of bid opening shall apply.

1.05 QUALIFICATIONS

- A. The Contractor performing the surfacing work shall be fully qualified, experienced a minimum of seven years and equipped to complete this work expeditiously and in a satisfactory manner. The Contractor shall submit the following information to the Engineer for review and approval before any surfacing work is performed.

1. The number of years of experience in performing this type of specialized work must be seven years minimum.
 2. Name of the surfacing manufacturer and supplier for this work and previous work listed below. The Contractor shall be an approved installer as certified and licensed by the surfacing manufacturer and equipment supplier.
 3. A list of clients that the Contractor has performed this type of work.
 - a. The list shall contain names and telephone numbers of persons who can be called to verify previous satisfactory performance.
 - b. Installation dates and a description of the actual work performed.
 - c. The surfacing manufacturer shall provide an installation list of his product used for similar sewer rehabilitation projects. The list shall provide the same information as required in paragraphs 3.a and 3.b above.
- B. The Owner reserves the right to approve or disapprove the Contractor, based on the submitted qualifications.

1.06 GUARANTEE

All surfacing shall be guaranteed by the Contractor for a period of five years from the date of acceptance. During this period, all defects discovered in the surfacing, as determined by the Owner's Engineer, shall be repaired or replaced in a satisfactory manner at no cost to the Owner, this shall include, but is not limited to, all work and costs associated with the shut down of any pump stations and all bypass operations needed for the proper repairs to be made.

1.07 QUALITY ASSURANCE

- A. All surfacing products shall be from a single manufacturer. The supplier shall be responsible for the provisions of all test requirements specified in ASTM Standards D-638 and D-790 as applicable.
- B. The Contractor shall employ specialty workers who have proven ability to perform the Work included herein. This will consist of a minimum of two years or two project experiences installing this product. This is a requirement for each and every employee.

1.08 DELIVERY, STORAGE AND HANDLING

- A. Care shall be taken in shipping, handling and placing to avoid damaging. Any material damaged in shipment shall be replaced as directed by the Engineer.
- B. Any material showing deterioration, or which has been exposed to any other adverse storage condition that may have caused damage, even though no such damage can be seen, shall be marked as rejected and removed at once from the work.

PART 2 PRODUCTS

2.01 GENERAL

- A. The material sprayed onto the surface shall be a urethane resin system formulated for the application within a sanitary sewer environment. The urethane will exhibit suitable corrosion resistance to corrosive gases and fluids found within domestic sanitary sewage. Unless dictated by varying effluent, the spray system shall be a urethane and exhibit the cured physical strengths specified herein.
- B. When cured, the surface coating shall form a continuous, tight-fitting, hard, impermeable surfacing data which is suitable for sewer system service and chemically resistant to any chemicals or vapors normally found in domestic sewage.
- C. The surface shall be an integral part of the structure being rehabilitated after being placed and cured. The surface shall cover the complete interior of the existing structure. The surface shall provide a continuous watertight seal or barrier.
 - 1. The surface shall effectively seal the interior surfaces of the structure and prevent any penetration or leakage of groundwater infiltration.
 - 2. Provide water resistance data on surface based on ASTM Standards.
 - 3. The surface shall be compatible with the thermal conditions of existing sewer lift stations and manholes. Surface temperature will range from 30 to 80 degrees F. Provide test data on thermal compatibility based on ASTM Standards.

2.02 MATERIALS

- A. Approved materials include Spraywall polyurethane by Sprayroq or Aquatapoxy A-6 or Raven 405 epoxy by Raven Lining Systems or Polyurethane Lining System by Protective Liner Systems.
- B. Polyurethane spray application shall comply with the following specifications:

The cured urethane system shall conform to the minimum physical standards, as listed below. The long-term data is for a 50-year design life of the process.

<u>Cured Urethane</u>	<u>Standard</u>	<u>Long-Term Data</u>
Tensile Stress	ASTM D-638	5,000 psi
Flexural Stress	ASTM D-790	10,000 psi
Flexural Modulus	ASTM D-790	550,000 psi

- C. Epoxy spray application shall be 100% VOC free / 100% solids.

PART 3 EXECUTION

3.01 SURFACE PREPARATION

- A. The contractor shall clean each structure and shall dispose of any resulting material.
- B. All contaminants including: oils, grease, incompatible existing coatings, waxes, form release, curing compounds, efflorescence, sealers, salts, or other contaminants shall be removed.

- C. All concrete or mortar that is not sound or has been damaged by chemical exposure shall be removed to a sound concrete surface or replaced.
- D. Surface preparation method(s) should be based upon the conditions of the substrate, service environment and the requirements of the protective coating to be applied.
- E. Surfaces to receive protective coating shall be cleaned and abraded to produce a sound surface with adequate profile and porosity to provide a strong bond between the protective coating and the substrate. Generally, this can be achieved with a high pressure water cleaning using equipment capable of 5,000 psi at 4 gpm. Other methods such as abrasive blasting, shotblasting, grinding, scarifying or acid etching may also be used. Detergent water cleaning and hot water blasting may be necessary to remove oils, grease or other hydrocarbon residues from the concrete. Whichever method(s) are used, they shall be performed in a manner that provides a uniform, sound clean neutralized surface that is not excessively damaged.
- F. Infiltration shall be stopped by using a material which is compatible with and is suitable for topcoating with the specified protective coating.
- G. The area between the manhole and the manhole ring and any other area that might exhibit movement or cracking due to expansion and contraction, shall be grouted with a flexible grout or gel before surface coating spray application.
- H. All surfaces should be inspected by the Inspector during and after preparation and before the repair material is applied.
- I. No separate payment shall be made for any preparatory work required prior to application of the surface coating.

3.02 INSTALLATION

- A. The Contractor shall notify the Project Manager at least 48 hours in advance, giving the date, start time and estimated completion time for the work being conducted.
- B. The Contractor shall provide bypass pumping of sewage flows (as required) where and when the rehabilitation work is being performed. No flows will be permitted in the structure until the spray coating has properly cured to the manufacturer's specifications.
- C. The installation of the surface coating shall be in complete accordance with the applicable provisions of ASTM and the manufacturer's specifications. A representative of the manufacturer shall be present during the actual installation.
 - 1. Prior to placing the surface coating, the manufacturer's representative must approve the surface preparation work and installation conditions including temperatures.
 - 2. All surfaces shall be sufficiently smooth and even, to ensure good flow handling characteristics when complete.
 - 3. All surfaces shall have the surface coating applied to the required thickness by spray application.
- D. Application procedures shall conform to the recommendations of the protective coating manufacturer, including material handling, mixing, environmental controls during application,

safety, and spray equipment.

- E. The spray equipment shall be specifically designed to accurately ratio and apply the specified protective coating materials and shall be regularly maintained and in proper working order.
- F. The protective coating material must be spray applied by a Certified Applicator of the protective coating manufacturer.
- G. Polyurethane spray application shall be applied such that all surfaces shall be coated in accordance with the manufactures recommended thickness but not be less than 125 mils.
- H. Epoxy spray application shall be applied such that all surfaces shall be coated in accordance with the following:
 - 1. Specified surfaces shall be coated by spray application of a moisture tolerant, solvent-free, 100% solids, epoxy protective coating as further described herein. Spray application shall be to a minimum wet film thickness in accordance with the following table:

Concrete, New/Smooth	80-100 mils for immersion, 60-80 mils for atmospheric, splash and spill exposure
Concrete, Rough	100-125+ mils
Masonry/Brick	125-150+ mils
Steel	16-80 mils for immersion, 16-40 mils for atmospheric, splash and spill exposure; also profile dependent
Fiberglass Systems	40-60 mils tack coat, 9 oz/yd ² fabric, 40-60 mils top coat. Varies with circumstances

- 2. Airless spray application equipment approved by the coating manufacturer shall be used to apply each coat of the protective coating. Air assisted spray application equipment may be acceptable, especially for thinner coats (<10 mils), only if the air source is filtered to completely remove all oil and water.
- 3. If necessary, subsequent topcoating or additional coats of the protective coating should occur as soon as the basecoat becomes tack free, ideally within 12 hours but no later than the recoat window for the specified products. Additional surface preparation procedures will be required if this recoat window is exceeded.

3.03 FIELD TESTING AND ACCEPTANCE

- A. Field acceptance of surface coatings shall be based on the Engineer's evaluation of the proper surfacing of the structure and the appropriate installation and curing test data along with review of the structure inspections.
- B. The surface coatings shall provide a continuous monolithic surfacing with uniform thickness throughout the structure interior. If the thickness of the coating surface is not uniform or is less than specified, it shall be repaired or replaced at no additional cost to the Owner.
 - 1. The Engineer will measure the surface cured thickness from a specimen retrieved by

the Contractor. The Contractor shall retrieve the specimen by physically cutting through the surfacing (by drilling or coring). There will be up to three thickness measurement locations in each structure. A suitable non-destructive type of thickness measurement may also be used.

2. All the surface coating thickness measurement locations shall be repaired by the Contractor in accordance with the manufacturer's recommendations. These repairs shall be included in the five year surface coating guarantee.
- C. All pipe connections shall be open and clear.
 - D. There shall be no cracks, voids, pinholes, uncured spots, dry spots, lifts, delaminations or other type defects.
 - E. If any defective surface coating is discovered after it has been installed, it shall be repaired or replaced in a satisfactory manner within 72 hours and at no additional cost to the Owner. This requirement shall apply for the entire five year guarantee period.

END OF SECTION

DIVISION 13 SPECIAL CONSTRUCTION

SECTION 13350 LIFT STATION REHABILITATION

PART 1 GENERAL

The Contractor shall furnish all labor, materials, equipment and incidentals required to remove / replace and install the internal equipment for a complete automatic, underground lift station and adjacent concrete valve and meter vault. The principal items of equipment shall include two submersible motor-driven sewage pumps (supplied and installed by Manatee County), valves, internal piping, pressure gauge, and meters (if required). All materials shall be new, without defects and of the best quality. All materials furnished and all work done shall be in strict accordance with all local requirements and codes.

1.01 EQUIPMENT

A. Valve / Meter Vault: Precast concrete vault(s) shall be constructed as shown on the drawings and in accordance with section 03410. The vault(s) shall have a two (2) inch PVC drain with a P-trap return to the wetwell. The valve vault shall be adequate size to allow a minimum 12" clearance between all flange fittings and any concrete surfaces.

A. Entrance Hatches: The lift station wetwell and vault(s) shall be equipped with an aluminum access cover sized as shown on the drawings. The wetwell access cover and valve pit access cover shall be constructed of aluminum with a minimum load rating of 300 lbs./sq. ft. and equipped with stainless steel hinges, hasp, and a device to lock the doors in an open position when the lid is raised (Bilco or approved equal).

B. Sewage Pumps and Electrical (By MC)

C. Piping and Fittings

Lift Station wetwell shall be as called out on the plans; types allowable are listed below. All flanged fittings in the wetwell and vault shall be connected using stainless steel hardware (nuts, bolts and washers). All mechanical joint fittings shall use grip rings restraint systems with Corten bolts.

1. PVC: C900, class 200, DR-14 or Schedule 80 with push-joint 90's.
2. HDPE: DR11 with shop fused butt joints and flanges.
3. Stainless Steel, either welded or grooved joint, per the plans.

F. Pump Hardware

1. Lifting chains shall be 3/8" stainless steel type 316 attached to the pump lifting bail using stainless steel shackles. All pump mounting systems shall be of the front loading slide rail type BPIU, from Barney's Pump). All rails and mounting hardware shall be stainless steel.
2. A stainless steel hanger shall be installed in each wetwell for supporting floatball and pump cables. The hanger shall be constructed of 1/4" x 2" type 316 stainless steel flat stock with individual hooks for each floatball and pump cable constructed of 1/4" type 316 stainless steel rod stock. All fasteners, brackets, and other hardware installed in the wetwell and valve vault shall be type 316 stainless steel.
3. Pump base plate for HDPE piping installations shall be as detailed in the Manatee

County Utility Standards, latest edition, or as shown on the plans.

G. Painting

All paint and other coatings shall be applied in accordance with the project manufacturer's specifications for the surfaces being coated. The exterior of the valve pit and wetwell top below grade shall be coated with at least two (2) coats of a coal tar epoxy coating containing 78% volume of solids. The minimum thickness of each coat when dry shall be 8 mils. The interior surfaces of the valve vault shall be coated with two coats of Tnemec Series 69 Hi-Build epoxy coating or equal. The exterior surfaces of the valve vault and wetwell top exposed above grade shall be coated with at least two (2) coats of H & C Silicone acrylic concrete stain, Patio Green, Manufactured by FLR Paints, Inc. The interior and exterior of all ductile iron fittings and valves shall be per sections 02615 or 02640 of these specifications.

2.01 ELECTRICAL

- A. Service and Metering (by MC): Electric service and meter are existing.
- B. Conductors: Manatee County will pull new pump power cords, contractor to pull all other conductors. MC will connect leads and conductors at the control panel unless noted otherwise.
- C. Conduit (by MC) or as shown on the plans.
- C. Control Panel (by MC) or as shown on the plans
- D. Gate Valves: All gate valves shall be resilient seated non rising stem. All valves inside the valve vault shall be equipped with handwheel.
- E. Link Seals: All piping penetrations of the wetwell and valve vault shall be through a grouted-in PVC sleeve that is bonded to the liner, sealed to the pipe using Link Seal Model S seals or approved equal. Install with bolts facing the outside of the wet well.

3.01 PERMITS

The Contractor shall be responsible for and shall pay for any permits and/or inspections required.

4.01 SHOP DRAWINGS AND INSPECTIONS

Shop drawings shall be submitted for approval in accordance with these Specifications prior to construction. When calling for inspection, the contractor should have these approved drawings available for review by the inspectors prior to acceptance by MC for maintenance. All inspections shall be arranged by contacting the Project Manager.

5.01 LANDSCAPING

The Contractor shall grade and fill the construction area to its original lines and grades and sod all disturbed or damaged grassed areas. Manatee County Public Works Dept. shall restore the landscaping and shrubs around the lift station.

END OF SECTION

SECTION 15094 PIPE HANGERS AND SUPPORTS

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish all labor, materials, equipment and incidentals and install pipe hangers, supports, concrete inserts and anchor bolts including all metallic hanging and supporting devices for supporting exposed piping.

1.02 QUALIFICATIONS

- A. Hangers and supports shall be of approved standard design where possible and shall be adequate to maintain the supported load in proper position under all operating conditions. The minimum working factor of safety for pipe supports shall be five (5) times the ultimate tensile strength of the material.

Note: Lift Stations have their own pipe support hanger and support design and detail, shown in the Utility Standards if not shown on the plans.

- B. All pipe and appurtenances connected to equipment shall be supported in such a manner as to prevent any strain being imposed on the equipment. When manufacturers have indicated requirements that piping loads shall not be transmitted to their equipment, the Contractor shall submit a certification stating that such requirements have been complied with.

1.03 SUBMITTALS

- A. Submit to the Engineer for approval, as provided in the Contract Documents, shop drawings of all items to be furnished under this Section.
- B. Submit to the Engineer, for approval, samples of all materials specified herein.
- C. All pipe hangers, supports, hanger rods, clamps, concrete inserts and wall brackets, etc., whether specified or not, shall be submitted (together with load calculations) to the Engineer for approval, if requested.

PART 2 PRODUCTS

2.01 GENERAL

- A. All pipe and tubing shall be supported as required to prevent significant stresses in the pipe or tubing material, valves, and fittings and to support and secure the pipe in the intended position and alignment. All supports shall be designed to adequately secure the pipe against excessive dislocation due to thermal expansion and contraction, internal flow forces, and all probable external forces such as equipment, pipe, and personnel contact. All pipe supports shall be approved prior to installation.
- B. All materials used in manufacturing hangers and supports shall be capable of meeting the respective ASTM Standard Specifications with regard to tests and physical and chemical properties, and be in accordance with MSS SP-58.
- C. Hangers and supports shall be spaced in accordance with ANSI B31.1.0 except that the

maximum unsupported span shall not exceed 10 feet unless otherwise specified herein.

- D. Unless otherwise specified herein, pipe hangers and supports shall be as manufactured by Grinnell Co., Inc., Carpenter and Patterson, Inc., or equal. Any reference to a specific figure number of a specific manufacturer is for the purpose of establishing a type and quality of product and shall not be considered as proprietary. Any item comparable in type, style, quality, design and performance will be considered for approval.

2.02 PIPE HANGERS AND SUPPORTS FOR METAL PIPE

- A. Suspended single pipes shall be supported by hangers suspended by steel rods from galvanized concrete inserts, beam clamps, or ceiling mounting bolts.

The following sizes are minimum requirements and are subject to the Engineer's approval:

1. Hanger rods shall be rolled steel machine threaded with load ratings conforming to ASTM Specifications and the strength of the rod shall be based on root diameter. Hanger rods shall have the following minimum diameters:

<u>Pipe Size, Inches</u>	<u>Min. Rod Diameter, In.</u>
Less than 2-1/2	3/8
2-1/2 through 4	1/2
4	5/8
6	3/4
8-12	7/8
14-18	1
20-30	1-1/4
Above 30	See SPECIAL SUPPORTS Paragraph 2.04

2. Where applicable, structural attachments shall be beam clamps. Beam clamps, for rod sizes 1/2-inch through 3/4-inch shall be equal to Grinnell Fig. No. 229, and for rod sizes 7/8-inch through 1-1/4 inches shall be equal to Grinnell Fig. No. 228, or equal.
3. Concrete inserts for pipe hangers shall be continuous metal inserts designed to be used in ceilings, walls or floors, spot inserts for individual pipe hangers, or ceiling mounting bolts for individual pipe hangers and shall be as manufactured by Unistrut Corp., Wayne, Michigan; Carpenter and Patterson, Inc., Laconia, New Hampshire; Richmond or equal and shall be as follows:
- Continuous concrete inserts shall be used where applicable and/or as shown on the Drawings and shall be used for hanger rod sizes up to and including 3/4-inch diameter. Inserts to be used where supports are parallel to the main slab reinforcement shall be Series P3200 by Unistrut Corp., Fig. 1480 Type 2 by Carpenter and Patterson, Inc. or equal. Inserts to be used where supports are perpendicular to the main slab reinforcement shall be Series P3300 by Unistrut Corp., Fig. 1480 Type I by Carpenter and Patterson, Inc., or equal.
 - Spot concrete inserts shall be used where applicable and shall be used for hanger sizes up to and including 7/8-inch diameter. Inserts shall be Fig. 650 by Carpenter and Patterson, Inc. for hanger rod sizes 1/2-inch through and including 3/4-inch and Fig. 266 by Carpenter and Patterson, Inc., for 7/8-inch hanger rods.
 - Ceiling mounting bolts shall be used where applicable and be for hanger rod sizes 1-inch through and including 1-1/4 inches shall be Fig. 104M as manufactured by Carpenter and Patterson, Inc. or equal.
 - All pipe hangers shall be capable of vertical adjustment under load and after

- erection. Turnbuckles, as required and where applied, shall be equal to Grinnell Fig. No. 230.
4. Wall or column supported pipes shall be supported by welded steel brackets equal to Grinnell Fig. 194, 195 and 199 as required, for pipe sizes up to and including 20-inch diameter. Additional wall bearing plates shall be provided where required.
 - a. Where the pipe is located above the bracket, the pipe shall be supported by an anchor chair and U-bolt assembly supported by the bracket for pipes 4-inches and larger or by a U-bolt for pipes smaller than 4-inches. Anchor chairs shall be equal to Carpenter & Patterson Fig. 127. U-bolts shall be equal to Grinnell Fig. 120 and 137.
 - b. Where the pipe is located below the bracket, the pipes shall be supported by pipe hangers suspended by steel rods from the bracket. Hangers and steel rods shall be as specified above.
 - c. Wall or column supported pipes 2-inches and smaller may be supported by hangers equal to Carpenter and Patterson Figures 74, 179 or 237 as required.
 5. Floor supported pipes 3-inches and larger in diameter shall be supported by either cast-in-place concrete supports or adjustable pipe saddle supports as directed by the Engineer. In general, concrete supports shall be used when lateral displacement of the pipes is probable (unless lateral support is provided), and adjustable pipe saddle type supports shall be used where lateral displacement of the pipes is not probable.
 - a. Each concrete support shall conform to the details shown on the Drawings. Concrete shall be poured after the pipe is in place with temporary supports. Top edges and vertical corners of each concrete support shall have 1-inch bevels. Each pipe shall be secured on each concrete support by a wrought iron or steel anchor strap anchored to the concrete with cast-in-place bolts or with expansion bolts. Where directed by the Engineer, vertical reinforcement bars shall be grouted into drilled holes in the concrete floor to prevent overturning or lateral displacement of the concrete support. Unless otherwise approved by the Engineer, maximum support height shall be five (5) feet.
 - b. Concrete piers used to support base elbows and tees shall be similar to that specified above.
Piers may be square or rectangular.
 - c. Each adjustable pipe saddle support shall be screwed or welded to the corresponding size 150 lb. companion flanges or slip-on welding flanges respectively. Supporting pipe shall be of Schedule 40 steel pipe construction. Each flange shall be secured to the concrete floor by a minimum of two (2) expansion bolts per flange. Adjustable saddle supports shall be equal to Grinnell Fig. No. 264. Where used under base fittings, a suitable flange shall be substituted for the saddle.
 - d. Floor supported pipes less than 3-inches shall be supported by fabricated steel supports.
 6. Vertical piping shall be supported as follows:
 - a. Where pipes change from horizontal to vertical, the pipes shall be supported on the horizontal runs within two feet of the change in direction by pipe supports as previously specified herein.
 - b. For vertical runs exceeding 15 feet, pipes shall be supported by approved pipe collars, clamps, brackets, or wall rests at all points required to insure a rigid installation.
 - c. Where vertical piping passes through a steel floor sleeve, the pipe shall be supported by a friction type pipe clamp which is supported by the pipe sleeve. Pipe clamps shall be equal to Grinnell Fig. 262.
 7. Anchor bolts shall be equal to Kwik-Bolt as manufactured by Hilti Fastening Systems, Tulsa, Oklahoma or Wej-it manufactured by Wej-it Expansion Products, Inc.,

Bloomfield, Colorado.

8. All rods, hangers, inserts, brackets, and components shall be furnished with galvanized finish.

2.03 PIPE HANGERS AND SUPPORTS FOR PLASTIC PIPE

- A. Single plastic pipes shall be supported by pipe supports as previously specified herein.
- B. Multiple, suspended, horizontal plastic pipe runs, where possible, and rubber hose shall be supported by ladder type cable trays such as the Electray Ladder by Husky-Burndy, the Globetray by the Metal Products Division of United States Gypsum, or equal. Ladder shall be of mild steel construction. Rung spacing shall be approximately 18 inches for plastic pipe and 12 inches for rubber hose. Tray width shall be approximately 6-inch for single runs of rubber hose and 12 inches for double runs of rubber hose. Ladder type cable trays shall be furnished complete with all hanger rods, rod couplings, concrete inserts, hanger clips, etc. required for a complete support system. Individual plastic pipes shall be secured to the rungs of the cable tray by strap clamps or fasteners equal to Globe Model M-CAC, Huskey-Burndy Model SCR or equal. Spacing between clamps shall not exceed 9 feet. The cable trays shall provide continuous support along the length of the pipe.
- C. Individual clamps, hangers, and supports in contact plastic pipe shall provide firm support, but not so firm as to prevent longitudinal movement due to thermal expansion and contraction.

2.04 SPECIAL SUPPORTS

- A. The pipes shall be supported by means of a supporting framework suitably anchored into the floor or curbing. The vertical piping shall be suitably secured to horizontal support members connected at each end to vertical support members and spaced as required to provide a rigid installation.
 1. The complete supporting system shall be as manufactured by the Unistrut Corporation, Globe-Strut as manufactured by the Metal Products Division of U.S. Gypsum, or equal.
 2. Vertical and horizontal supporting members shall be U-shaped channels similar to Unistrut Series P1000. Vertical piping shall be secured to the horizontal members by pipe clamps or pipe straps equal to Unistrut Series P1100M and Series P2558. All components shall be of mild steel.
 3. The assemblies shall be furnished complete with all nuts, bolts, and fittings required for a complete assembly.
 4. The design of each individual framing system shall be the responsibility of the Contractor. Shop drawings shall be submitted and shall show all details of the installation including dimensions and types of supports.
- B. Any required pipe supports for which the supports specified in the Section are not applicable, including pipe supports for above 30-inch pipe, shall be fabricated or constructed from standard aluminum shapes in accordance with Specifications, concrete and anchor hardware similar to items previous specified herein and shall meet the minimum requirements listed below and be submitted to the approval of the Engineer.
 1. Pipe support systems shall meet all requirements of this Section and all related Sections of this Specification.
 2. Complete design details of the entire pipe support systems shall be provided by the Contractor, for approval by the Engineer.

3. The pipe support system shall not impose loads on the supporting structures, in excess of the loads for which the supporting structure is designed.
 4. Hanger rods for above 30-inch pipe shall be a minimum of 1-1/2 inch diameter and shall not exceed the manufacturer's standard maximum recommended safe load.
- C. Pipe supports in lift stations shall be as shown in the Utility Standards details.

PART 3 EXECUTION

3.01 INSTALLATION

- A. All pipes, horizontal and vertical, shall be rigidly supported from the building structure by approved supports. Supports shall be provided at changes in direction and elsewhere as shown in the Drawings or specified herein. No piping shall be supported from other piping or from metal stairs, ladders, and walkways, unless it is so indicated on the Drawings, or specifically directed or authorized by the Engineer.
- B. All pipe supports shall be designed with liberal strength and stiffness to support the respective pipes under the maximum combination of peak loading conditions to include pipe weight, liquid weight, liquid movement, and pressure forces, thermal expansion and contraction, vibrations, and all probable externally applied forces. Prior to installation, all pipe supports shall be approved by the Engineer.
- C. Pipe supports shall be provided to minimize lateral forces through valves, both sides of split type couplings, and sleeve type couplings and to minimize all pipe forces to pump housings. Pump housings shall not be utilized to support connecting pipes.
- D. Pipe supports shall be provided as follows:
1. Cast iron and ductile iron shall be supported at a maximum support spacing of 10 feet-0-inches with a minimum of one support per pipe section at the joints.
 2. Supports for multiple PVC pipes shall be continuous wherever possible. Individually supported PVC pipes shall be supported as recommended by the manufacturer except that support spacing shall not exceed five (5) feet.
 3. Support spacing for galvanized steel pipe and copper tubing shall not exceed five (5) feet.
 4. All vertical pipes shall be supported at each floor or at intervals of at least 15 feet by approved pipe collars, clamps, brackets, or wall rests and at all points necessary to insure rigid construction.
- E. Pipe supports shall not result in point loadings, but shall distribute pipe loads evenly along the pipe circumference.
- F. Effects of thermal expansion and contraction of the pipe shall be accounted for in pipe support selection and installation.
- G. Inserts for pipe hangers and supports shall be installed on forms before concrete is poured. Before setting these items, all drawings and figures shall be checked which have a direct bearing on the pipe locations. Responsibility for the proper location of pipe supports is included under this Section.
- H. Continuous metal inserts shall be embedded flush with the concrete surface.

3.02

PRIME COATING

- A. Prior to prime coating, all pipe hangers and supports shall be thoroughly clean, dry, and free from all mill-scale, rust, grease, dirt, paint, and other foreign substances to the satisfaction of the Engineer.
- B. All submerged pipe supports shall be prime coated with TNEMEC 69-1211 Epoxy Primer or equal. All other pipe supports shall be prime coated with TNEMEC 66-1211, or equal.
- C. Finish coating shall be compatible with the prime coating used and shall be applied as specified in the Contract Documents.

END OF SECTION

DIVISION 16 ELECTRICAL

SECTION 16050 ELECTRICAL - GENERAL PROVISIONS

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, materials, devices, equipment, appurtenances, and incidentals required for a complete electrical system as hereinafter specified and/or shown on the Contract Drawings. This work may necessarily include interfacing with and/or completely installing devices and/or equipment furnished under other sections of these Specifications.
- B. It is the intent of these Specifications that the electrical system be suitable in every way for the service required. All materials and all work/labor which may be reasonably implied as being incidental to the requirements of this Section shall be furnished at no additional cost to the Owner.
- C. All power interruptions to existing equipment shall be at the Owner's convenience. Each interruption shall have prior approval. Request(s) for power interruption(s) shall be made at least forty-eight (48) hours in advance.
- D. The work shall include complete testing of all electrical components, including wiring.
- E. All workmanship shall be of the highest quality. Substandard work will be rejected and it shall be replaced entirely at the Contractor's expense with no cost to the Owner.
- F. It shall be the responsibility of each bidder or his authorized representative to physically visit the job site in order that he may be personally acquainted with the area(s), buildings and/or structures intended for use in the installation/construction under this Specification. The submittal of a proposal/bid by a bidder shall be considered evidence that he has complied with this requirement and accepts all responsibility for a complete knowledge of all factors governing his work. Therefore, failure to comply with this requirement of the Specifications will NOT be grounds for the successful bidder (Contractor) to request approval of change orders and/or additional monetary compensation.

1.02 TEMPORARY ELECTRICAL SERVICE

- A. The Contractor shall make the requisite arrangements for securing temporary electrical power for his use in accordance with Section 01510 of these Specifications.

1.03 CODES, INSPECTIONS AND FEES

- A. All materials and installations shall be in accordance with the National Electrical Code (latest edition) and the latest editions of all applicable national, state, county and local codes.
- B. To the extent that any item is routinely tested and rated by the Underwriter's Laboratories, Inc., that item shall bear the U.L. label. Additionally, all items shall be manufactured to the applicable NEMA standards.
- C. The Contractor shall make the necessary arrangements for obtaining all requisite permits and inspections and pay any applicable fees.

1.04 TESTS

- A. The Contractor shall test all items individually and as a system for proper operation.
- B. The Contractor shall, at his expense, make all the requisite repairs, adjustments and/or alterations to correct any shortcomings found as a result of the tests performed under Item 1.04.A above.
- C. A representative of the Owner shall be present during all testing. The Owner shall be notified at least two (2) days prior to any testing.

1.05 SLEEVES AND FORMS FOR OPENINGS

- A. Provide and place all sleeves for conduits penetrating floors, walls, partitions, etc. Locate all necessary slots for electrical work and form before concrete is poured.

1.06 CUTTING AND PATCHING

- A. All cutting and patching shall be done in a thoroughly workmanlike manner - i.e., care shall be taken when cutting not to damage or mar surrounding areas, and when patching to match the original finish as closely as possible while providing a watertight seal. Refer to Item 1.01.E above.

1.07 INTERPRETATION OF DRAWINGS

- A. The layouts and arrangements as shown on the Contract Drawings are indicative of the physical arrangements desired; however, they are not intended to restrict the Contractor's freedom to accommodate the exact conditions as found in the field. Any deviations from the arrangements shown must be approved by the Owner prior to the final placement of the item(s) in question.
- B. The Contract Drawings are not intended to show exact locations of conduit runs.
- C. Circuit and conduit layouts shown are not intended to indicate the exact installation details. The Contractor shall furnish and install all requisite items, including all fittings, junction boxes, etc., to insure that the electrical system operates in conformance with the Specifications and the specific requirements of an individual piece of equipment.
- D. Where circuits are shown as "home-runs", all necessary fittings and boxes shall be provided for a complete conduit installation.
- E. All three-phase circuits shall be run in separate conduits unless otherwise shown on the Contract Drawings.
- F. Surface mounted items such as panelboards, junction boxes, conduit, etc., shall be supported by spacers to provide a clearance between the equipment and the mounting surface.
- G. The Owner shall make the final decision in determining the exact location(s) and mounting height(s) of any item(s) or piece(s) of equipment in question.
- H. All connections to equipment shall be made in accordance with the approved shop and manufacturer's drawings, regardless of the number of conductors shown on the Contract Bid

Drawings.

- I. The Contractor shall coordinate the work of the different trades in order to prevent interferences between conduit(s), piping and other non-electrical equipment. In case any interference develops, an authorized representative of the Owner shall decide which equipment, conduit(s) or piping must be relocated, regardless of which was installed first. Any such interferences shall be remedied solely at the Contractor's expense without any additional cost to the Owner.

1.08 EQUIPMENT SIZING AND HANDLING

- A. The Contractor shall thoroughly check all entryways, doors, hallways, stairways, buildings and structures through which equipment must be transported to reach its final location.
- B. If necessary for safe passage of the equipment, the manufacturer shall be required to ship his material in sections sized to pass through the restricted areas. This requirement holds even if such equipment sizing differs from the manufacturer's standard shipping section.
- C. To the extent possible, the equipment shall be kept upright at all times. If equipment has to be tilted for ease of passage through restricted areas, the manufacturer shall provide specific handling instructions as well as any requisite bracing in order to assure both the functional integrity of the equipment and the validity of the equipment warranty.

1.09 SUBMITTALS

- A. As specified under Section 01340 of these Specifications, the Contractor shall submit shop drawings and/or manufacturer's cut sheets for approval of all materials, equipment, devices, apparatus, and other items as required by the Owner.
 1. Prior to submittal by the Contractor, all shop drawings shall be checked for accuracy and Contract requirements. Shop drawings shall bear the date checked and shall be accompanied by a statement that the shop drawings have been examined for conformity to the Specifications and Contract Drawings. This statement shall also list all discrepancies with the Specifications and Contract Drawings. Shop drawings not so checked and noted shall be returned unchecked by the Owner.
 2. The Owner's check shall be only for conformance with the design concept of the Project and compliance with the Specifications and Contract Drawings. The responsibility for, or the necessity of, furnishing materials and workmanship required by the Specifications and Contract Drawings which may not be indicated on the shop drawings is included under the work of this Section.
 3. No material shall be ordered, no equipment manufacturing shall be started, nor shall any shop work/fabrication commence until the Owner has approved the shop drawings. Any deviation from this requirement of the Specifications shall be entirely at the risk and expense of the Contractor without any additional cost to the Owner.
- B. Record Drawings: As the work progresses, the Contractor shall legibly record all field changes on a set of Contract Drawings. When the project is completed, the Contractor shall furnish the Owner with a complete set of reproducible "as-built" drawings.

1.10 MANUFACTURER'S SERVICES

- A. The Contractor shall arrange for an authorized manufacturer's representative who shall be an experienced field service engineer to be present for the inspection, installation, testing, calibration, adjusting and start-up of any item(s) or piece(s) of equipment as deemed necessary by the Owner.
- B. In addition to the duties of Item 1.11.A above, the manufacturer's representative shall also instruct the Owner's personnel in the proper operation and maintenance of the item(s) in question.

1.11 MATERIALS

- A. All materials used shall be new, unused and as hereinafter specified. Where not specifically called out, all materials shall be of the very best quality of their respective kinds. Unless specifically otherwise approved in writing by the Owner, only material manufactured in the United States shall be used!
- B. Where applicable, all materials and equipment shall conform with the requirements of Item 1.03.B above.
- C. Electrical equipment shall at all times during construction be adequately protected against both mechanical injury and damage by water. Electrical equipment shall be stored indoors in dry shelters. Any damaged equipment shall be replaced by the Contractor at his own expense.
- D. All items shall be manufactured from the materials specified - substitute materials will NOT be acceptable.
- E. Only the specified manufacturer's equipment shall be used unless an "or approved equal" is noted. The Owner shall be the sole determiner of what constitutes an "approved equal".

1.12 GUARANTEES AND WARRANTIES

- A. All items furnished under the Electrical Specifications shall be guaranteed and/or warranted, in writing, against defects in materials, construction and workmanship as specified under Section 01740 of these Specifications.

END OF SECTION

SECTION 16110 CONDUITS AND FITTINGS

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish and install the conduits, fittings, devices and appurtenances as hereinafter specified and/or as shown on the Contract Drawings.

1.02 SUBMITTALS

The requirements of Section 01340 and Section 16050 shall be met.

1.03 APPLICATIONS

- A. Except where otherwise shown on the Contract Drawings, or hereinafter specified, all wiring shall be run in rigid conduits.
- B. Galvanized rigid steel conduits shall be used at all locations aboveground and within structures and buildings except where otherwise shown on the Contract Drawings.
- C. Galvanized rigid steel conduits shall be used at all locations for shielded instrumentation and shielded control wiring except where otherwise shown on the Contract Drawings.
- D. Schedule 80 PVC conduits shall be used for all underground, under-slab and in-slab applications except where otherwise shown on the Contract Drawings.
- E. Schedule 80 PVC conduits shall be used in highly corrosive areas such as chlorine storage areas, digesters, fluoride storage and handling areas, etc.
- F. All conduits of a given type shall be the product of one manufacturer.
- G. Except where otherwise shown on the Contract Drawings, or hereinafter specified, all boxes shall be metal.
- H. Flush mounted switch, receptacle and control station boxes shall be pressed steel.
- I. Surface mounted switch, receptacle and control station boxes shall be cast or malleable iron.
- J. Devices designated as NEMA Type 4 shall be 316 stainless steel, gasketed.
- K. Devices designated as NEMA Type 4X shall be fiberglass, gasketed, except as otherwise shown on the Contract Documents.
- L. Combination expansion-deflection fittings shall be used where conduits cross structural expansion joints.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Rigid Conduit

1. Rigid steel conduit shall be hot-dipped galvanized as manufactured by the Youngstown Sheet and Tube Company, Wheeling-Pittsburg Steel Corp., or approved equal.
 2. Rigid PVC conduit shall be Carlon Plus 80 rigid PVC non-metallic conduit (extra heavy wall EPC-80) as manufactured by Carlon, or approved equal.
 3. Electrical metallic tubing shall be hot-dipped galvanized steel as manufactured by U.S. Steel Corp., Youngstown Sheet and Tube Company, or approved equal.
- B. Liquidtight, Flexible Conduit
1. Liquidtight, flexible metal conduits shall be Sealtite, Type UA, as manufactured by Anaconda, American Flexible Conduit Co., Inc., or approved equal.
 2. Liquidtight, flexible non-metallic conduits shall be Carflex Liquidtight Flexible Non-Metallic Conduit as manufactured by Carlon, or approved equal.
- C. Rigid Conduit Fittings
1. Rigid Steel Conduit Fittings:
 - a. Steel elbows, bends, sweeps, nipples, couplings, etc., shall be hot-dipped galvanized as manufactured by Youngstown Sheet and Tube Company, or approved equal.
 - b. Conduit hubs shall be as manufactured by Meyers Electric Products, Inc., or approved equal.
 2. Rigid Non-Metallic Conduit Fittings: PVC elbows, bends, sweeps, nipples, couplings, device boxes, etc., shall be Plus 80 fittings as manufactured by Carlon, or approved equal.
 3. EMT Conduit Fittings: EMT fittings shall be hot-dipped galvanized steel, rain-tight, concrete tight, compression type, as manufactured by Crouse-Hinds, Appleton Electric Company, or approved equal.
- D. Flexible Conduit Fittings
1. Flexible Metal Conduit Fittings: Fittings used with flexible metal conduit shall be of the screw-in type as manufactured by Thomas and Betts Company, or approved equal.
 2. Flexible Non-Metallic Conduit Fittings: Fittings used with flexible non-metallic conduit shall be Carflex Liquidtight Non-metallic Fittings as manufactured by Carlon, or approved equal.
- E. Flexible Couplings: Flexible couplings shall be as manufactured by Crouse-Hinds, Appleton Electric Company, or approved equal.
- F. Wall Seals: Conduit wall seals shall be type "WSK" as manufactured by the O.Z. Electrical Manufacturing Company, or approved equal.
- G. Expansion Fittings: Combination expansion-deflection fittings shall be type "XD" as manufactured by Crouse-Hinds, or approved equal.
- H. Boxes
1. Device Boxes
 - a. Flush mounted wall device boxes shall be galvanized pressed steel as manufactured by the Raco Manufacturing Company, or approved equal.
 - b. Surfaced mounted wall device boxes shall be cast or malleable iron as manufactured by Crouse-Hinds, Appleton Electric Company, or approved equal.

- c. Flush mounted in-floor device boxes shall be cast metal, shall be watertight, shall have adjustable cover frames, and shall be as manufactured by Russell & Stoll Company, Steel City Electric, or approved equal.
 - 2. Other Boxes
 - a. Terminal boxes, junction boxes, pull boxes, etc., except as otherwise specified and/or shown on the Contract Drawings, shall be hot-dipped galvanized steel.
 - b. The boxes shall have continuously welded seams which shall be ground smooth prior to being galvanized.
 - c. The box bodies shall be flanged, shall be not less than 14-gauge metal, and shall not have holes or knockouts.
 - d. The box covers shall be not less than 12-gauge metal, shall be gasketed, and shall be fastened to the box bodies with stainless steel screws.
 - e. The boxes shall be as manufactured by Hoffman Engineering Company, or approved equal.
- I. Conduit Mounting Devices: Hangers, rods, channel, backplates, clips, straps, beam clamps, etc., shall be hot-dipped galvanized iron or steel as manufactured by Appleton Electric Company, Thomas and Betts Company, Unistrut Corp., or approved equal.
- J. Fixture Support System
 - 1. The fixture support system shall be the channel type and shall be furnished complete with all requisite mounting hardware and appurtenances.
 - 2. The channel, mounting hardware and related appurtenances shall be hot-dipped galvanized steel.
 - 3. The fixture support system shall be as manufactured by the Unistrut Corp., or approved equal.

PART 3 EXECUTION

3.01 INSTALLATION


- A. No conduit smaller than 3/4-inch electrical trade size shall be used nor shall either 1-1/4-inch conduit or 3-1/2-inch conduit be used. Minimum size underground, under slab or in-slab shall be 1-inch.
- B. No wires shall be pulled until the individual conduit runs are complete in all details. Additionally, each conduit shall be cleaned and reamed and certified clear of all burrs and obstructions before any wire is pulled.
- C. The ends of all conduits shall be tightly capped to exclude dust and moisture during construction.
- D. For all galvanized steel conduits, the field-cut threads shall be thoroughly cleaned and coated with a cold galvanizing compound which contains 95% pure zinc metal. The galvanizing compound shall be as manufactured by ZRC Products Company, or approved equal. This treatment shall also be used on any nipples, elbows, etc., that are not supplied with galvanized threads.
- E. Conduits shall be supported at intervals of 8-feet or less, as required to obtain a rigid installation.
- F. Exposed conduits shall be run parallel with and/or perpendicular to the surrounding surface(s). No diagonal runs will be allowed.

- G. Single conduits shall be supported by one-hole pipe clamps in combination with one-screw backplates to provide space between the conduits and the mounting surface.
- H. Multiple horizontal runs of conduits shall be supported by trapeze type hangers (channel) suspended by threaded rod, 3/8-inch minimum diameter.
- I. Multiple vertical runs of conduits shall be supported by structurally mounted channel in combination with conduit clamps.
- J. Conduit support devices shall be attached to structural steel by welding or beam or channel clamps as indicated on the Contract Drawings.
- K. Conduit support devices shall be attached to concrete surfaces by "spot type" concrete inserts.
- L. Conduits terminating in pressed steel boxes shall have double locknuts and insulated bushings.
- M. Conduits terminating in gasketed enclosures shall be terminated with conduit hubs.
- N. Conduit wall seals, waterproof type, shall be used at all locations where conduits penetrate walls.
- O. Liquidtight, flexible conduit - metal or non-metallic as shown on the Contract Drawings - shall be used for all motor terminations and for all connections/terminations where vibration is anticipated.
- P. Flexible couplings shall be used in hazardous locations for all motor terminations and for all connections/terminations where vibration is anticipated.
- Q. Conduit stubouts for future construction shall be capped at both ends with threaded PVC conduit caps.
- R. The cement used for PVC conduit installations shall be as manufactured by Carlon, or approved equal.
- S. Galvanized steel conduits entering manholes and/or below grade pull boxes shall be terminated with grounding type bushings which shall be connected to a 5/8-inch by 10-foot long driven ground rod with No. 6 AWG bare copper wire.
- T. Galvanized rigid steel conduit shall be used for all risers. The underground portion of the riser and a 12-inch section of the riser immediately above the ground or slab/floor level shall be painted with a bitumastic coating.
- U. The use of electrical metallic tubing shall be restricted to low voltage applications (600V or less) in non-process areas where specifically approved by the owner on a "per installation" basis - e.g., above suspended ceilings in office areas.

3.02 GUARANTEES AND WARRANTIES

The Contractor shall guarantee and warrant all materials and labor provided under this Section in accordance with Section 01740 and Section 16050 of these Specifications.


END OF SECTION



MANATEE COUNTY, FLORIDA SATELLITE LIFT STATION REHABILITATION (2008) PRIORITY 1

OCTOBER 2008

SATELLITE LIFT STATION REHABILITATION (2008)		
RTU	NAME	PROJECT NUMBER
54	#1 111 6TH ST. S.	402-5112080-LS 1
59	#6 5901 MARINA DR.	402-5112280-LS 6
62	#7 6800 HOLMES BLVD.	402-5112380-LS 7
63	#8 7205 MARINA DR.	402-5112580-LS 8
65	#12 501 MAGNOLIA AV.	402-5112780-LS 12
67	#15 420 N. BAY BLVD.	402-5112880-LS 15
125	30-A 2921 47th AVE. W.	402-5112880-LS 30A
205	2-M 4326 124th ST. CT. W.	402-5112180-LS 2M
221	12-D 7830 DESOTO MEMORIAL HIWAY	402-5112680-LS 12D

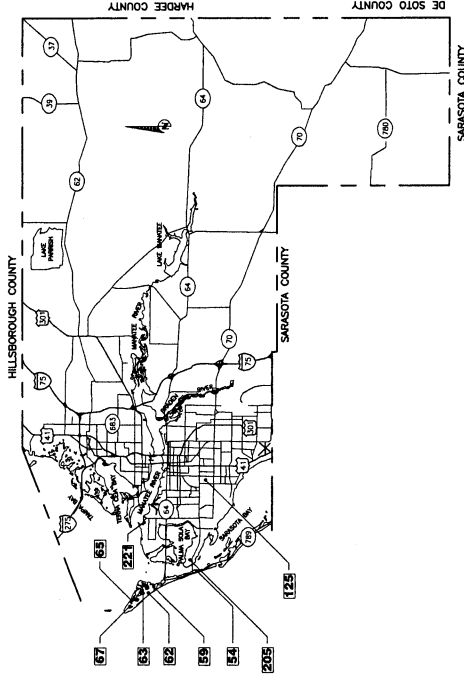


NO. | INDEX OF SHEETS


1. COVER SHEET
2. LOCATION MAPS
3. GENERAL NOTES & LEGEND
4. PLAN & ELEVATION (EXISTING)
5. PLAN & ELEVATION (PROPOSED)
6. DETAILS

PROJECT DESCRIPTION
REHABILITATE NINE SEWAGE LIFT STATIONS BY REPLACING DISCHARGE PIPING AND VALVES


SEC. TWP. RGE SURVEY BOOK NO. PROJECT NUMBER	SEE COVER SHEET By _____ Checked _____ Date _____ Drawn _____ WT _____ Designed _____	NOISE THESE PLANS DO NOT REFLECT A TRUE BOUNDARY OR RIGHTS-OF-WAY LINES SHOWN IS APPROXIMATE AND IS BASED ON INFORMATION CONTAINED IN THE SUBDIVISION RECORDS AND ON TOPOGRAPHIC DATA COLLECTED ON THE COUNTY AND ON TOPOGRAPHIC DATA COLLECTED ON THE COUNTY AND ON TOPOGRAPHIC DATA COLLECTED ON THE COUNTY. THE RIGHTS-OF-WAY LINES SHOWN ARE NOT INTENDED TO INDICATE THE EXACT PROPERTY CORNERS.	WAYNE R. TROKLER/62204 Engineer / Reg. No.	PUBLIC WORKS DEPT.-ENGINEERING DIVISION 4422-B 66th Street West, Bradenton, FL 34210	NO. REVISION DESCRIPTION 1 RAISED TOP OF WW AND W. ABOVE FLOOD ELEV.	BY DATE BLR 10/24/08	DATE 10/24/08
SATELLITE LIFT STATION REHABILITATION (2008)							
PRIORITY 1							
COVER SHEET							
						Sheet 1 6	

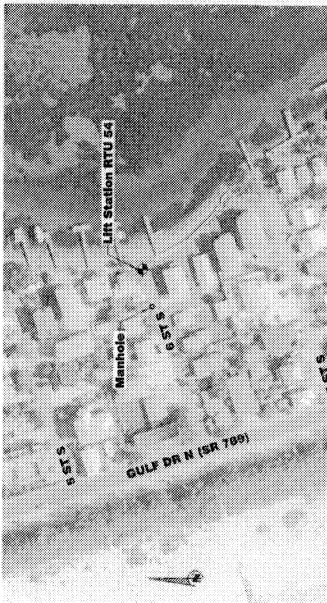


LIFT Station #1, RTU 54, 116 6th STREET SOUTH, BRADENTON BEACH
PROJECT NUMBER: 402-5112080-LS 1, STR 04-35-16

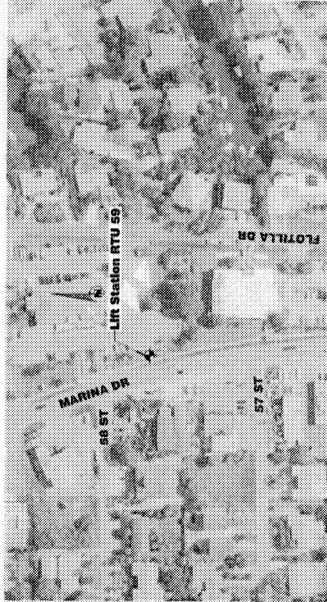


LIFT Station #6, RTU 59, 5901 MARINA DR, HOLMES BEACH
PROJECT NUMBER: 402-5112280-LS 6, STR 20-34-16

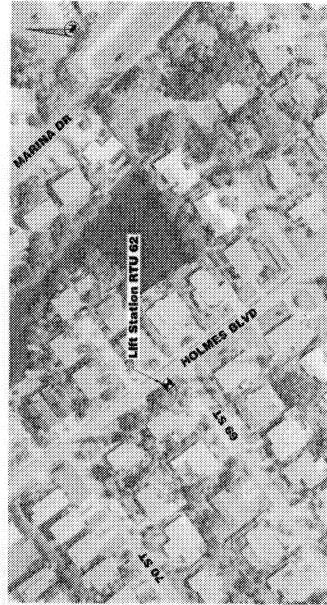


LIFT Station #7, RTU 62, 6900 HOLMES BLVD, HOLMES BEACH
PROJECT NUMBER: 402-5112380-LS 7, STR 20-34-16

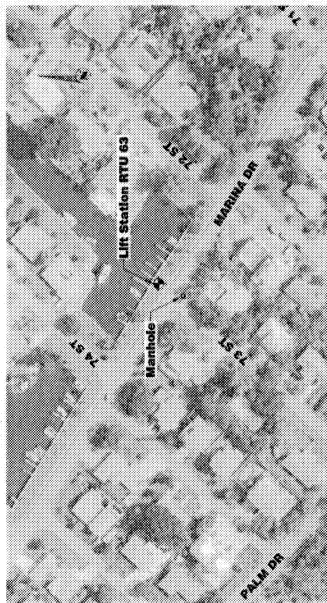


LIFT Station #8, RTU 63, 7205 MARINA DRIVE, HOLMES BEACH
PROJECT NUMBER: 402-5112480-LS 8, STR 20-34-16

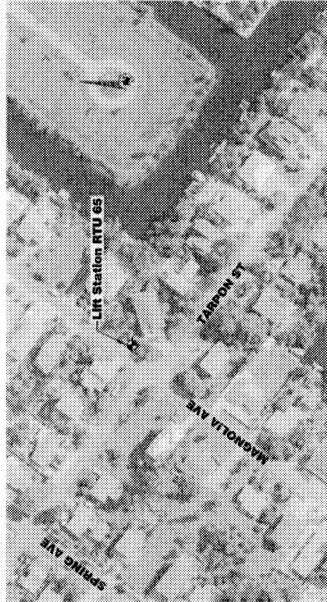


LIFT Station #12, RTU 65, 501 MAGNOLIA AVE, ANNA MARIA
PROJECT NUMBER: 402-5112580-LS 12, STR 18-34-16

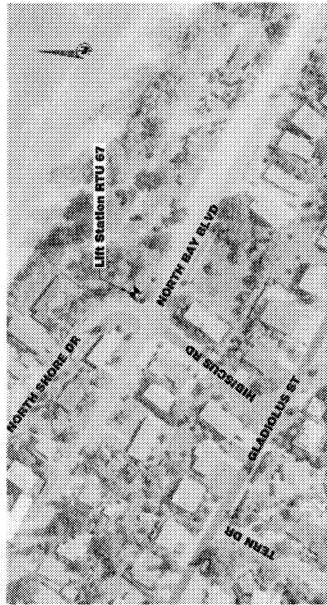


LIFT Station #15, RTU 67, 420 NORTH BAY BLVD, ANNA MARIA
PROJECT NUMBER: 402-5112780-LS 15, STR 07-34-16

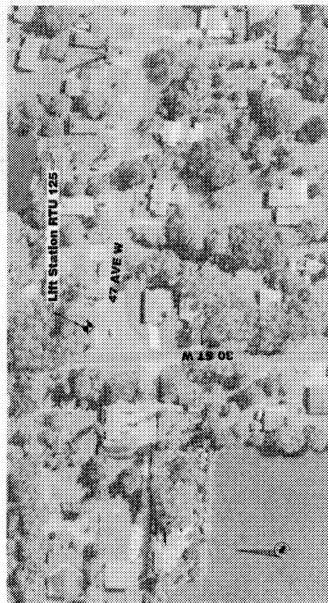

LIFT Station 30-A, RTU 125, 2921 47th AVENUE W, BRADENTON
PROJECT NUMBER: 402-5112880-LS 30 A, STR 10-35-17

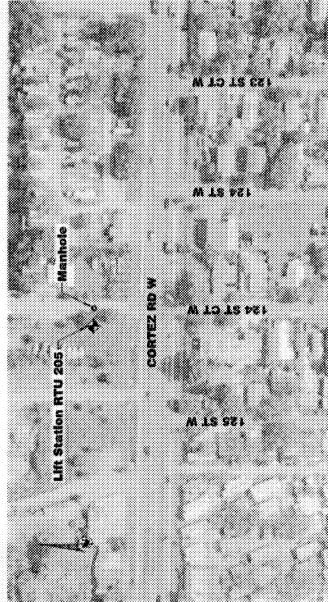

LIFT Station 2-M, RTU 205, 4326 124 ST CT W, CORTEZ
PROJECT NUMBER: 402-5112180-LS 2M, STR 03-35-16

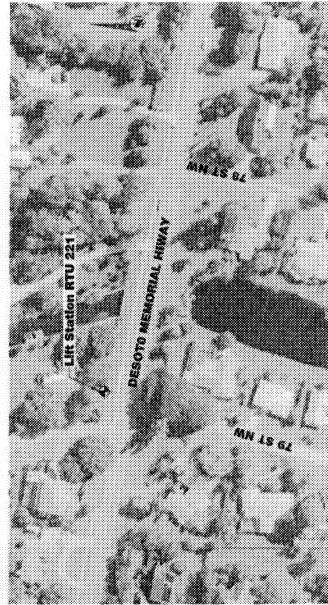

LIFT Station #12-D, RTU 221, 7830 DESOTO MEMORIAL HWY, PALMA SOLA
PROJECT NUMBER: 402-5112680-LS 12 D, STR 19-34-17

SEC. TWP. RGE SEE COVER SHEET

PROJECT NUMBER	By	Checked	Date
Surveyed	---	---	---
Drawn	BR	---	---
Designed	WT	---	---

THESE PLANS DO NOT REFLECT A TRAC BOUNDARY OR RIGHT-OF-WAY LINES SHOWN IS APPROXIMATE AND IS BASED ON INFORMATION CONTAINED IN THE SUBDIVISION RECORD AND ON TOPOGRAPHIC DATA COLLECTED ON THE COUNTY AND ON TOPOGRAPHIC DATA COLLECTED BY THE PUBLIC WORKS DEPARTMENT. THE EXACT PROPERTY CORNERS INDICATE THE EXACT PROPERTY CORNERS.

WAYNE R. TROLEY/A2204
Engineer / Reg. No.

NO. REVISION DESCRIPTION
1 RABED TOP OF WW AND VV ABOVE FLOOD ELEV.

BY	DATE
BLR	10/24/08

SATELLITE LIFT STATION REHABILITATION (2008)
PRIORITY 1
LOCATOR MAPS



LIFT STATION SCHEDULE (EXISTING)

LIFT STATION NAME	#1	#6	#7	#8	#12	#15	30-A	2-M	12-D
RADIO TELEMETRY UNIT (RTU)	54	59	62	63	65	67	125	205	221
WET WELL DIAMETER	6"	6"	12"	6"	6"	6"	8"	6"	8"
DISCHARGE PIPING DIAMETER	4"	4"	6"	4"	6"	4"	4"	4"	4"
FORCE MAIN DIAMETER	6"	8"	10"	6"	8"	6"	8"	6"	8" 10" 12"
INFLUENT PIPE SIZE	8"	10"	16"	6"	12"	8"	12"	8"	10"
INFLUENT INVERT ELEVATION	-12.61	-8.29	-12.73	-11.42	-11.27	-11.31	6.2	-8.33	-2.89
BOTTOM SLAB ELEVATION	-17.01	-13.06	-19.33	-15.77	-17.12	-17.81	0.3	-13.33	-6.6
WET WELL HATCH ELEVATION	3.90	4.40	4.67	4.19	4.37	4.31		6.16	9.30
VALVE WELLS HATCH ELEVATION	3.53	4.52	3.04	3.15	4.24	4.02		3.99	8.70
WET WELL VENT PIPE	DIP	NA	NA	DIP	PKC	PKC	DIP	DIP	NA
L.S. DESIGN CAPACITY gpm/TD	300/55	260/27	680/30	200/24	525/32	250/40	350/19	275/25	275/43
DISCHARGE PIPING PROFILE	STACKED	STD.	STACKED	STACKED	STACKED	STACKED	STACKED	STACKED	STACKED
CONCRETE RISER ON TOP OF WW	YES	YES	YES	YES	YES	YES	YES	YES	YES



NOTES:

1. THE WET WELL AND VALVE WELLS CONFIGURATION SHOWN ON THESE GRAPHICS IS FOR IDENTIFICATION OF COMPONENTS TO BE REMOVED. THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS, ELEVATIONS, CONFIGURATION, ETC. FOR ACCURACY.
2. THE TABLE CONTENT WAS TAKEN FROM RECORD DRAWING INFORMATION DATED FROM THE 1970'S. THE CONTRACTOR/BIDDER SHALL VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS.
3. THE DISCHARGE PIPING ELEVATIONS AND CONFIGURATION SHOWN AT EACH WET WELL EXIT POINT, THE CONTRACTOR/BIDDER SHALL DETERMINE THE DISCHARGE PIPING ELEVATIONS DURING THE SITE VISITS.
4. REMOVAL AND REINSTALLATION OF THE PUMPS DURING THE REHABILITATION SHALL BE DONE BY MANATEE COUNTY PERSONNEL IN COORDINATION WITH THE CONTRACTOR.
5. BY-PASS PUMPING IS THE RESPONSIBILITY OF THE CONTRACTOR.
6. MANATEE COUNTY GOVERNMENT WILL PROVIDE ONE (1) LIFT STATION SHUT-DOWN AT NO COST TO THE CONTRACTOR. ADDITIONAL SHUT-DOWNS WILL COST THE CONTRACTOR \$3,500 EACH, IF NEEDED.

PLAN STANDARD DISCHARGE PIPING

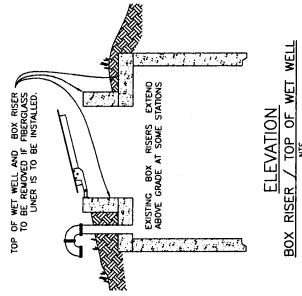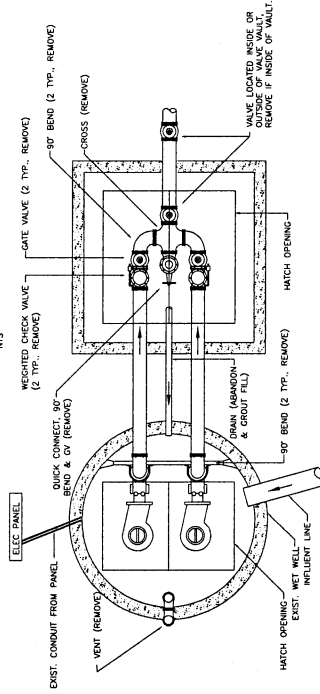

PLAN STACKED HORIZONTAL DISCHARGE PIPING

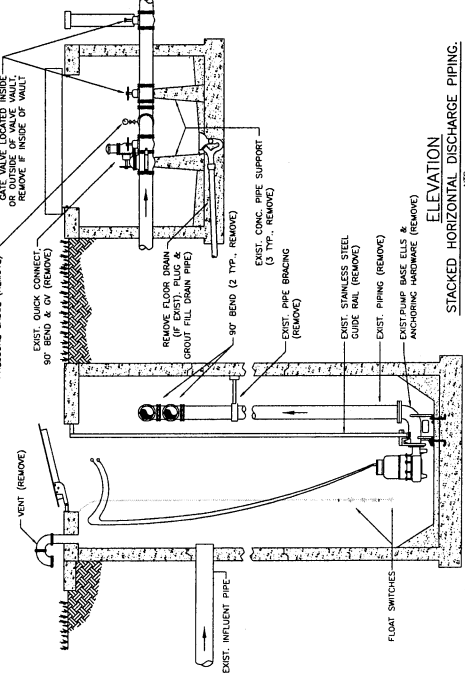
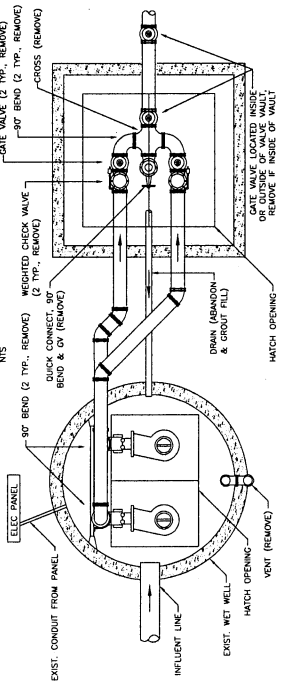


DATE: 10/24/08
 BY: BLR
 REVISION DESCRIPTION: RAISED TOP OF WW AND VV ABOVE FLOOD ELEV.
 NO. 1
 PUBLIC WORKS DEPT. - ENGINEERING DIVISION
 MANATEE COUNTY
 4422-B 86th Street West, Bradenton, FL 34210
 WAYNE R. TROALER/62204
 Engineer / Reg. No.
 THESE PLANS DO NOT REFLECT A TITLE BOUNDARY OR RIGHTS-OF-WAY LINES SHOWN IS APPROXIMATE AND IS FOR INFORMATION ONLY. THE SHADOWN PLAT BOARDS-OF-WAY LINES SHOWN ARE FOR RECORD ONLY. COUNTY AND ON TOPOGRAPHIC DATA COLLECTED ON THE RIGHTS-OF-WAY LINES SHOWN ARE NOT INTENDED TO INDICATE THE EXACT PROPERTY CORNERS.
 SEE COVER SHEET
 SURVEY BOOK NO.
 PROJECT NUMBER
 By: []
 Checked: []
 Date: []
 Surveyed: []
 Drawn: BR
 Designed: WT
SATELLITE LIFT STATION REHABILITATION (2008)
PRIORITY 1
EXISTING CONDITIONS
PLAN & ELEVATION
 SHEET 4 OF 6

LIFT STATION WORK SCHEDULE

LIFT STATION NAME	#1	#6	#7	#8	#12	#15	30-A	2-M	12-D
NEW W.W. LINER TYPE	FG	FG	FG	FG	FG	FG	FG	FG	FG
INSTALL STILLING WELL	NO	NO	YES	NO	YES	NO	NO	NO	YES
RELOCATE P.V. TO OUTSIDE OF VALVE VAULT	N/A	YES	YES	YES	YES	YES	YES	YES	YES
NEW HOBE PIPING IN W.W.	4"	4"	4"	4"	4"	4"	4"	4"	4"
NEW BASE ELL	YES	YES	YES	YES	YES	YES	YES	YES	NO
BASE TOP OF WET WELL	YES	YES	YES	YES	YES	YES	YES	YES	NO
RAISE TOP OF VALVE VAULT	YES	YES	YES	YES	YES	YES	YES	YES	NO

PLAN STACKED HORIZONTAL DISCHARGE PIPING

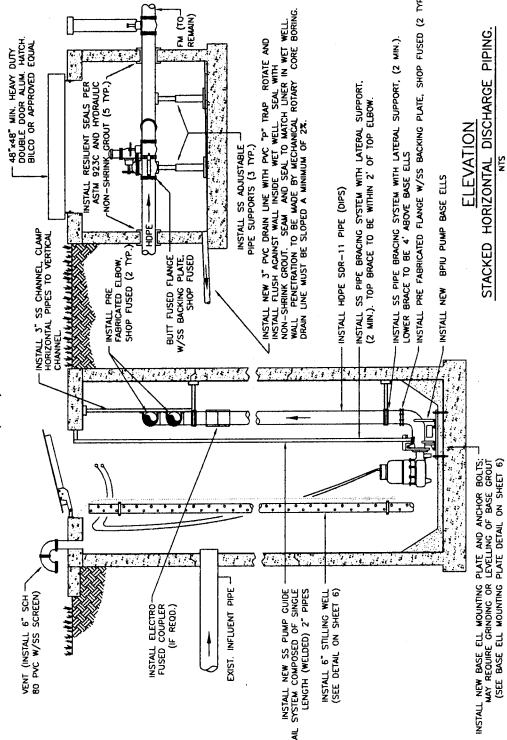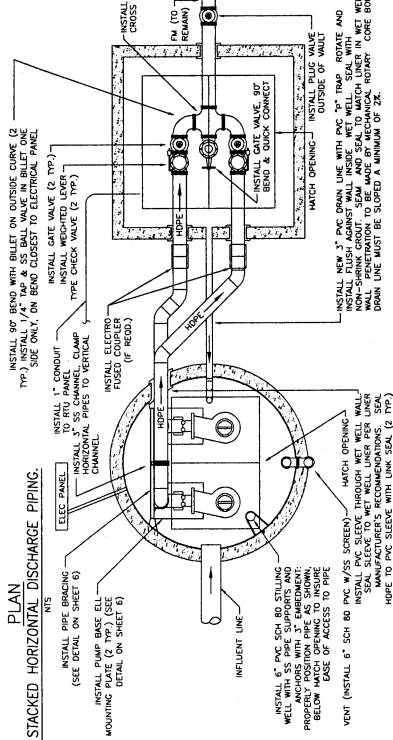

SEC. TYP. RCE	SEE COVER SHEET	NOISE
SURVEY BOOK NO.	SEE COVER SHEET	WAYNE R. TROJER/62204
PROJECT NUMBER	SEE COVER SHEET	Engineer / Reg. No.
By	Checked	Date
Surveyed		
Drawn		
Designed		



NOTES:

- PVC RESTRAINTS SHALL BE EBAA IRON MEGA FLANGE. MECA LUG OR APPROVED EQUAL.
- ALL PVC CONNECTIONS TO IRON BODIED FLANGE FITTINGS SHALL BE MADE USING EBAA IRON MEGA FLANGE OR APPROVED EQUAL FLANGE ADAPTERS.
- ALL BURIED FITTINGS SHALL BE RESTRAINED MECHANICALLY.
- ALL DRIPING DOWNSTREAM FROM THE CROSS IN THE VALVE VAULT SHALL BE DR-14 C-900.
- ALL METAL APPURTENANCES INCLUDING BOLTS, NUTS AND WASHERS INSIDE THE WET WELL AND VALVE VAULT SHALL BE STAINLESS STEEL TYPE 316. ALL BOLTS SHALL BE TREATED WITH NEVER SEIZE PRIOR TO ASSEMBLY.
- VERTICAL PUMP DISCHARGE PIPING IN THE WET WELL SHALL BE BRACED 4" ABOVE THE PUMP BASE ELL. AT EACH STACKED DISCHARGE TYPE LIFT STATIONS, INSTALL A 3" STAINLESS STEEL CHANNEL VERTICALLY FROM THE TOP HORIZONTAL PIPE BRACE WITH THE OTHER END ANCHORED TO THE WET WELL TOP. THE HORIZONTAL PIPING SHALL BE CLAMPED TO THIS VERTICAL BRACE.
- FLEXIBLE GASKET CONNECTORS SHALL MEET THE REQUIREMENTS OF ASTM C-923 LATEST REVISION AND ARE REQUIRED AT ALL PIPING THRU CONCRETE LOCATIONS.
- MANATEE COUNTY UTILITY OPERATIONS DEPT. SHALL HAVE THE OPTION TO PICK-UP AT THE SITE ANY REMOVED ITEM SUCH AS VALVES FOR POSSIBLE REUSE. THE OPERATOR SHALL BE RESPONSIBLE FOR THE PROPER DISPOSITION OF REMOVED ITEMS NOT PICKED UP BY THE UTILITY OPERATIONS DEPT.
- ALL ACCESS COVERS SHALL BE ALUMINUM, WITH STAINLESS STEEL SURFACES IN CONTACT WITH LOADING SURFACES. ALL ACCESS COVERS SHALL BE TOTAL 16 MILS DFT. ALL ACCESS COVERS SHALL BE EQUIPPED WITH A LOCKING STAPLE OR BAR FOR USE. THE UTILITY OPERATIONS DEPARTMENT.
- ALL ACCESS COVERS SHALL BE ALUMINUM, WITH STAINLESS STEEL SURFACES IN CONTACT WITH LOADING SURFACES. ALL ACCESS COVERS SHALL BE TOTAL 16 MILS DFT. ALL ACCESS COVERS SHALL BE EQUIPPED WITH A LOCKING STAPLE OR BAR FOR USE. THE UTILITY OPERATIONS DEPARTMENT.

WATER SERVICE WORK SCHEDULE

LIFT STATION	WATER SERVICE (HOSE BIB) / BFP LOCATION	BFP UPGRADES
#1	NO CHANGE	UPGRADE TO US-15 STANDARD
#6	RELOCATE TO E. SIDE OF LS BETWEEN WW AND W	NO CHANGE
#7	NO CHANGE	UPGRADE TO US-15 STANDARD
#8	NO CHANGE	NO CHANGE
#12	RELOCATE TO E. SIDE OF LS BETWEEN WW AND W	UPGRADE TO US-15 STANDARD
#15	RELOCATE TO E. SIDE OF WW AT LEAST 6' FROM ELECTRIC PANEL	UPGRADE TO US-15 STANDARD
30-A	RELOCATE TO N. SIDE OF LS BETWEEN WW AND W	UPGRADE TO US-15 STANDARD
2-M	NO CHANGE	UPGRADE TO US-15 STANDARD
12-D	NO CHANGE	NO CHANGE

LS # 6 PLAN

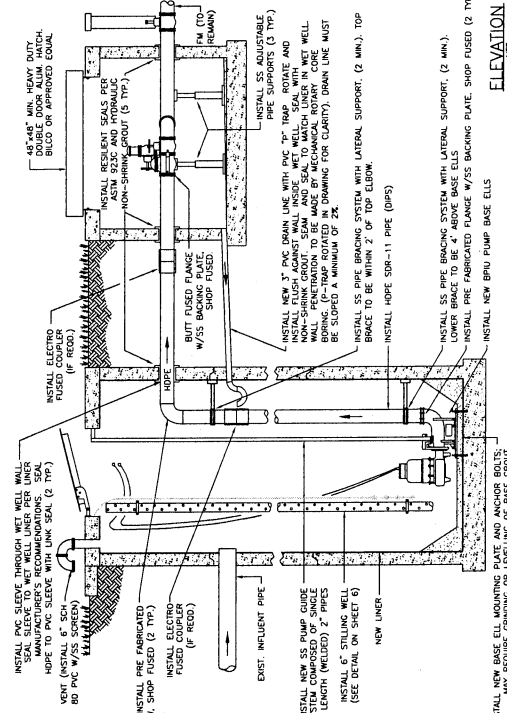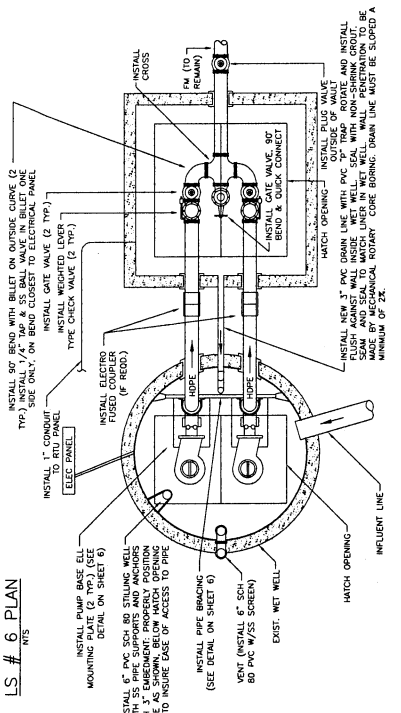

SEC. TYP. RCE	SEE COVER SHEET	NOISE
SURVEY BOOK NO.	SEE COVER SHEET <td>WAYNE R. TROJER/62204</td>	WAYNE R. TROJER/62204
PROJECT NUMBER	SEE COVER SHEET <td>Engineer / Reg. No.</td>	Engineer / Reg. No.
By	Checked	Date
Surveyed		
Drawn		
Designed		

SATELLITE LIFT STATION REHABILITATION (2008)

PRIORITY 1

PROPOSED CONDITIONS PLAN & ELEVATION

Sheet 5 of 6

NO.	REVISION DESCRIPTION	BY	DATE
1	RAISED TOP OF WW AND W ABOVE FLOOD ELEV.	BLT	10/24/08

PUBLIC WORKS DEPT.-ENGINEERING DIVISION

4422-B 66th Street West, Bradenton, FL 34210

Signature & Date

THESE PLANS DO NOT REFLECT A TRUE BOUNDARY OR RIGHTS-OF-WAY LINES SHOWN OR APPROXIMATE OR BASED ON INFORMATION CONTAINED HEREIN. THE SUBDIVISION COUNTY AND ON TOPOGRAPHIC DATA COLLECTED ON THE RIGHTS-OF-WAY LINES SHOWN ARE NOT INTENDED TO INDICATE THE EXACT PROPERTY CORNERS.

