




# SATELLITE LIFT STATION R&R 2023 GROUP 1 402-0019707 / 5001301

December, 2022

**BID PLANS**

L.S. NAME	RTU	ADDRESS	PROJECT JL NO.	INFLUENT MH
*WINN DIXIE PLAZA WEST	159	3534 53RD AVE. W, BRADENTON	402.5163880	PRIVATE
18-AC	486	6510 14TH ST. W, BRADENTON	402.5163881	PUBLIC
TIDEVUE 2	502	4305 10TH ST. CT. E., ELLENTON	402.5163882	PUBLIC
PORT MANATEE STOCKADE	556	14490 HARLEE RD., PALMETTO	402.5163883	PUBLIC
LAKWOOD RANCH REPUMP	603	8155 LAKEWOOD RANCH BLVD., BRADENTON	402.5163884	PUBLIC

(\* ) THE MANHOLE ADJACENT TO THE LIFT STATIONS IS PRIVATELY OWNED AND MAINTAINED AND CAN NOT BE UTILIZED FOR BYPASS PUMPING.

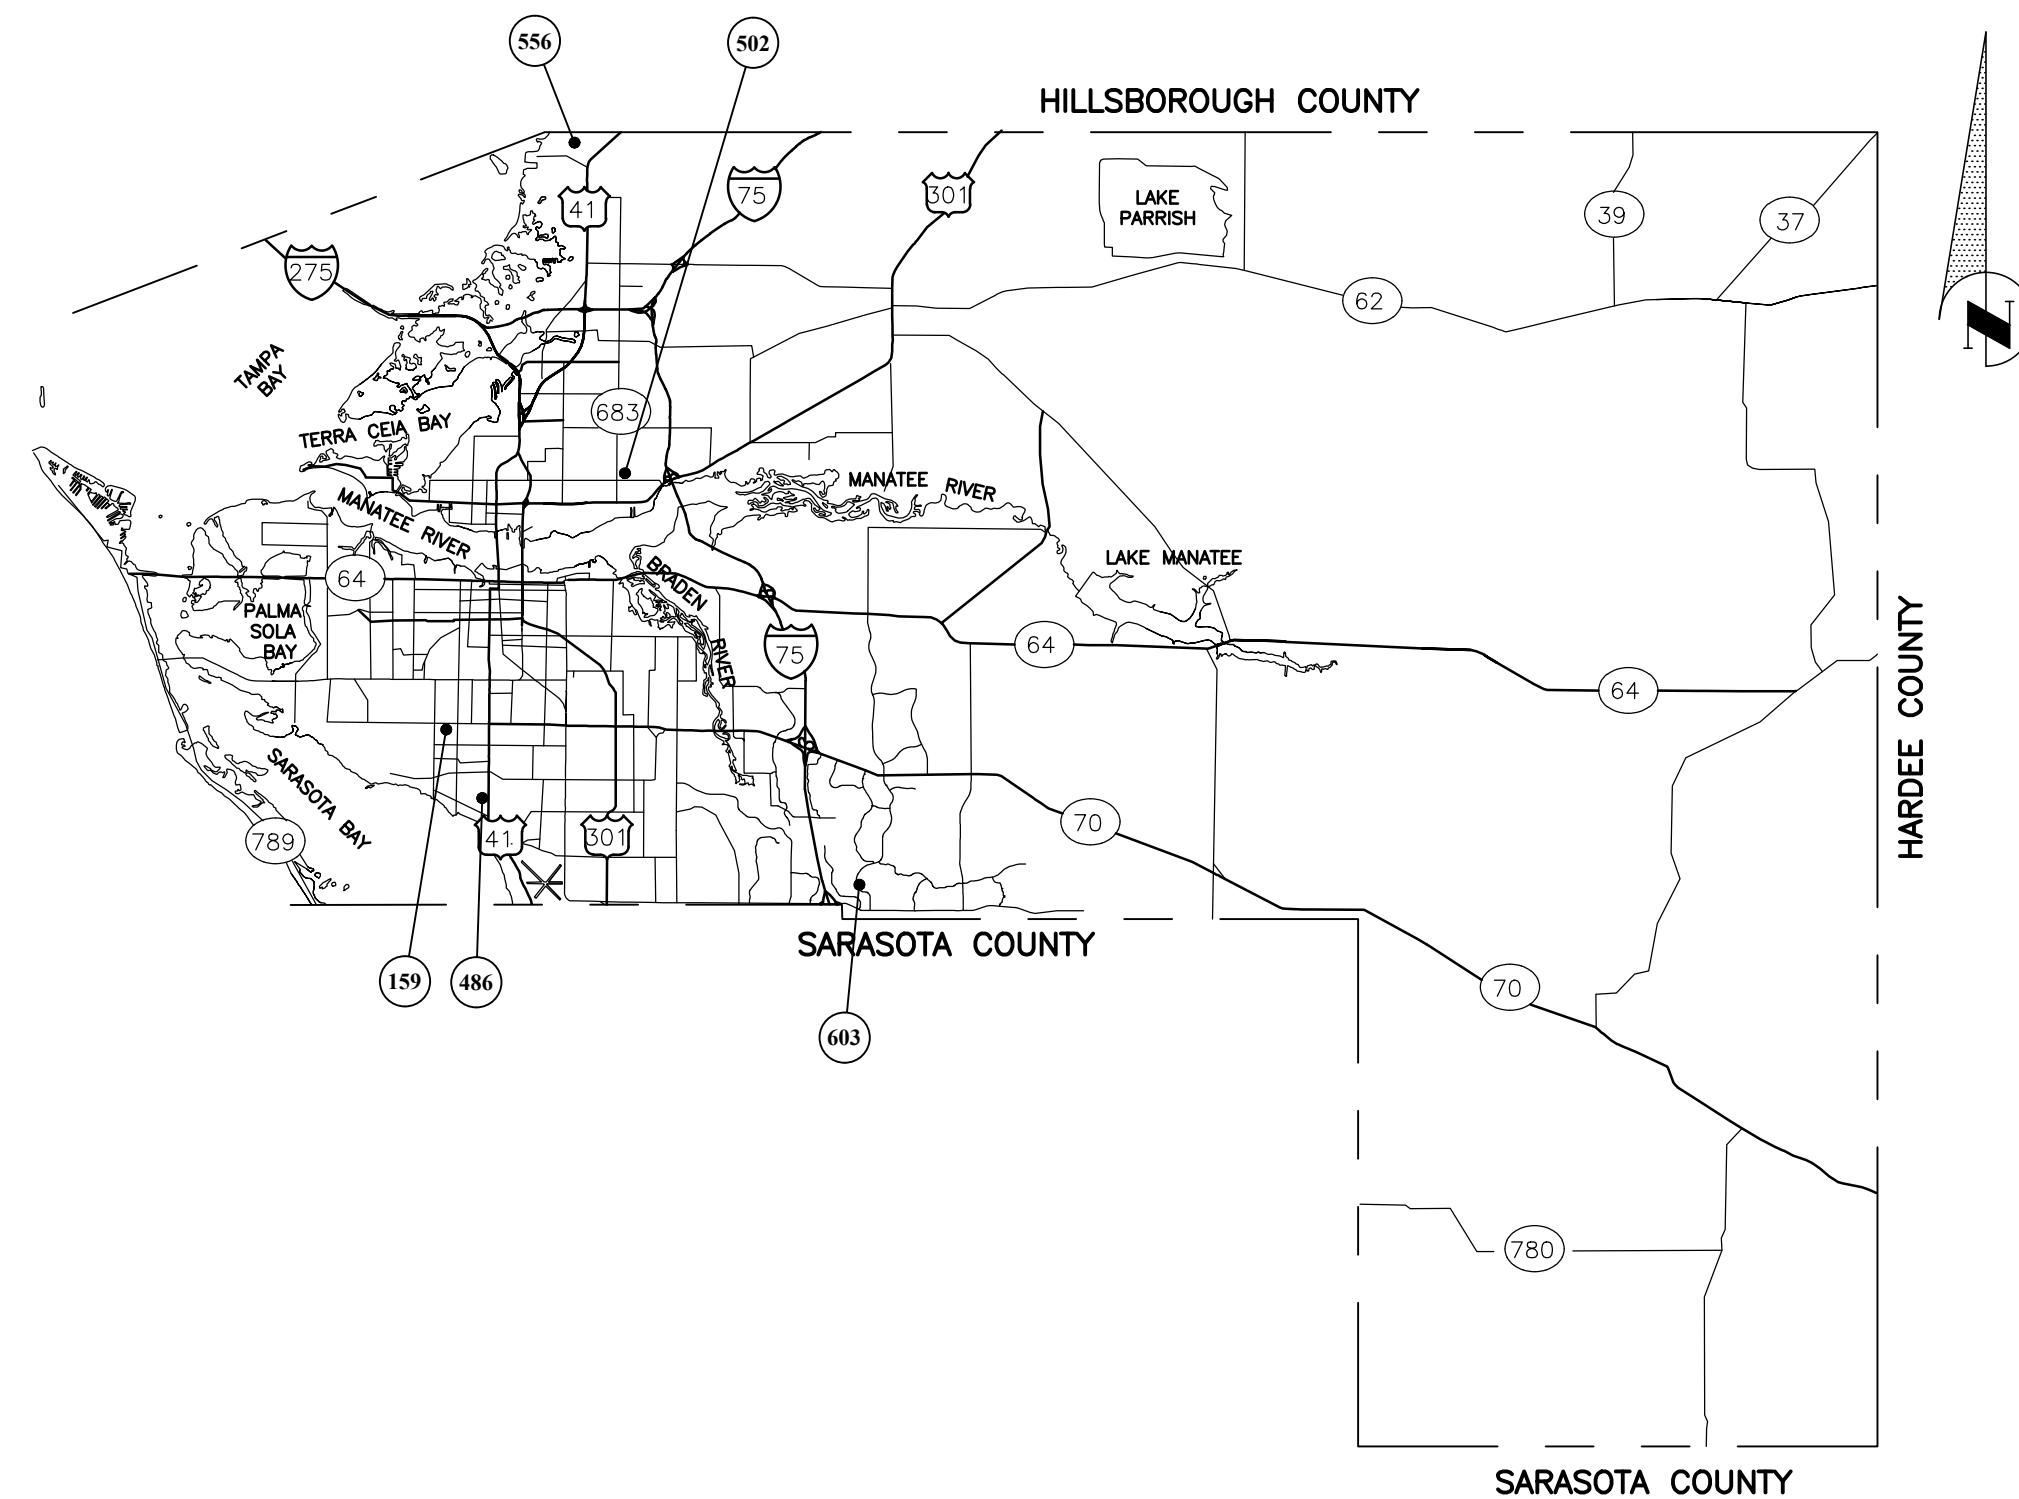

NO.	INDEX OF SHEETS
01	COVER
02	NOTES
03	VICINITY MAPS
04	WINN DIXIE PLAZA, RTU 159
05	18-AC, RTU 486
06	TIDE VUE 2, RTU 502
07	PORT MANATEE STOCKADE, RTU 556
08	LAKWOOD RANCH REPUMP, RTU 603
09	DETAILS1
10	DETAILS2
11	DETAILS3
12	EROSION CONTROL DETAILS

**PROJECT DESCRIPTION**

REHABILITATE SEWAGE LIFT STATIONS (AND/OR MANHOLES) TO REDUCE RISK TO PUBLIC HEALTH AND ENVIRONMENTAL POLLUTION. THE WORK SHALL CONSIST OF, BUT NOT LIMITED TO, UPGRADE OR FULL REPLACEMENT OF THE ELECTRICAL CONTROL EQUIPMENT, WET WELL CLEANING, THE REPLACEMENT OF DISCHARGE PIPING, FITTINGS, VALVES, SWING CHECK VALVES, GUIDE RAILS, PIPE BRACINGS, BASE ELLS, AND/OR MOUNTING PLATES. WET WELL LINER MAY NEED TO BE INSTALLED, REPAIRED OR REPLACED. SEE INDIVIDUAL PLAN SHEETS FOR SPECIFIC REHABILITATION AND INSTALLATIONS REQUIREMENTS FOR EACH LIFT STATION.



Know what's below  
Call before you dig

NO.	REVISION DESCRIPTION	BY	DATE
1	REV. TIDEVUE 2 ADDRESS IN TABLE	JSS	2/17/23

PROJECT #	402-0019707 / 5001301
SURVEY #	NA
SEC./TWN./RGE	VARIES
SCALE	N.T.S.

	BY	DATE
SURVEYED	NA	NA
DESIGNED	JSS	1/2022
DRAWN	JKW	1/2022
CHECKED	JSS	-

