



MANATEE COUNTY FLORIDA

FACSIMILE

December 19, 2008

TO: All Interested Bidders

SUBJECT: Invitation for Bid #09-0141DC Lift Stations Rehabilitation
Bayshore on the Lake, Mirror Lakes, Samoset 1

ADDENDUM #1

Bidders are hereby notified that this Addendum shall be acknowledged on the Bid Form signature pages and made a part of the above named bidding and contract documents.

The following items are issued to add to, modify, and clarify the bid and contract documents. These items shall have the same force and effect as the original bidding and contract documents, and cost involved shall be included in the bid prices. Bids to be submitted on the specified bid date, shall conform to the additions and revisions listed herein.

1. The enclosure for the Stand-by/Emergency Pump for Mirror Lakes Lift Station is required to be rated for 140mph wind loading.
2. A drawing sealed by an engineer will not be required for the foundation for the emergency pump. The County Engineer will review submittals for the foundation.
3. A 24- hour attendant will be required for the Samoset 1 bypass pumping.
4. Traffic Plans will be required. Whenever the contractor will be occupying the right-of-way, a traffic control plan shall be submitted for review and approval by the County.
5. There will not be a pay item for concrete patching prior to application of the liner. This work will be incidental to the contract. Surface preparation must be in accordance with the liner manufacturer's specifications and requirements.

Financial Management Department - Purchasing Division
1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205
PHONE: 941.749.3074 * FAX: 941.749.3034
www.mymanatee.org

6. In reference to the Jessica Lundsford Act, it is not anticipated that access to any school property will be required of any contractor's personnel, so background screening will not be required.
7. The contractor shall install devices, conductors, conduit, and make all connections for the flow meter, emergency pump, floats, transducer, and any other electrical work required by the contract. However, County personnel will connect remote sensor wiring to the existing panel for the emergency pump telemetry.
8. In reference to the use of concrete saw cutting instead of coring for the Samoset 1 piping thru the vault wall and wet well walls, saw cutting will be considered by the Engineer after the contract is awarded. The awarded contractor may submit information on proposed cutting equipment, methods, dimensions, and locations. Coring is required unless such submittal is approved by the Engineer.
9. After award, the contractor may request approval to perform night work from the Engineer for limited times to minimize the risk of spills and take advantage of low flow times.
10. A cast-in-place valve vault is not acceptable at Mirror Lakes station. The Contractor shall install a precast concrete vault as specified in the Manatee County Utility Standards and in accordance with the project specifications and plans.
11. What is the minimum clearance required from piping in the valve vault to the floor and vault lid? Manatee County Standard Plan US-20B indicates 18 inches minimum clearance from piping to the floor and the project plans Sheet 4 Elevation indicates 24" minimum from the piping to the vault lid. (Detail attached)
12. There is no water service to be connected at Mirror Lakes. The water service is hereby deleted from the scope of work. The work schedule on Sheet 4 under Proposed Mirror Lake Water Improvements is hereby revised to read "NO" and the words "UPGR. TO U-15 DET/DWG 6" shall be deleted. Bid Form item 26 is deleted.


If you have submitted a bid prior to receiving this addendum you may request in writing that your original, sealed bid be returned to your firm. All sealed bids received will be opened on the date stated.

Bids will be received at Manatee County Purchasing, 1112 Manatee Avenue West, Suite 803, Bradenton, Florida 34205 until **January 27, 2009 at 3:00 P.M.**


Sincerely,


R.C. "Rob" Cuthbert, C.P.M.
Purchasing Division Manager

/dcr
Attachment

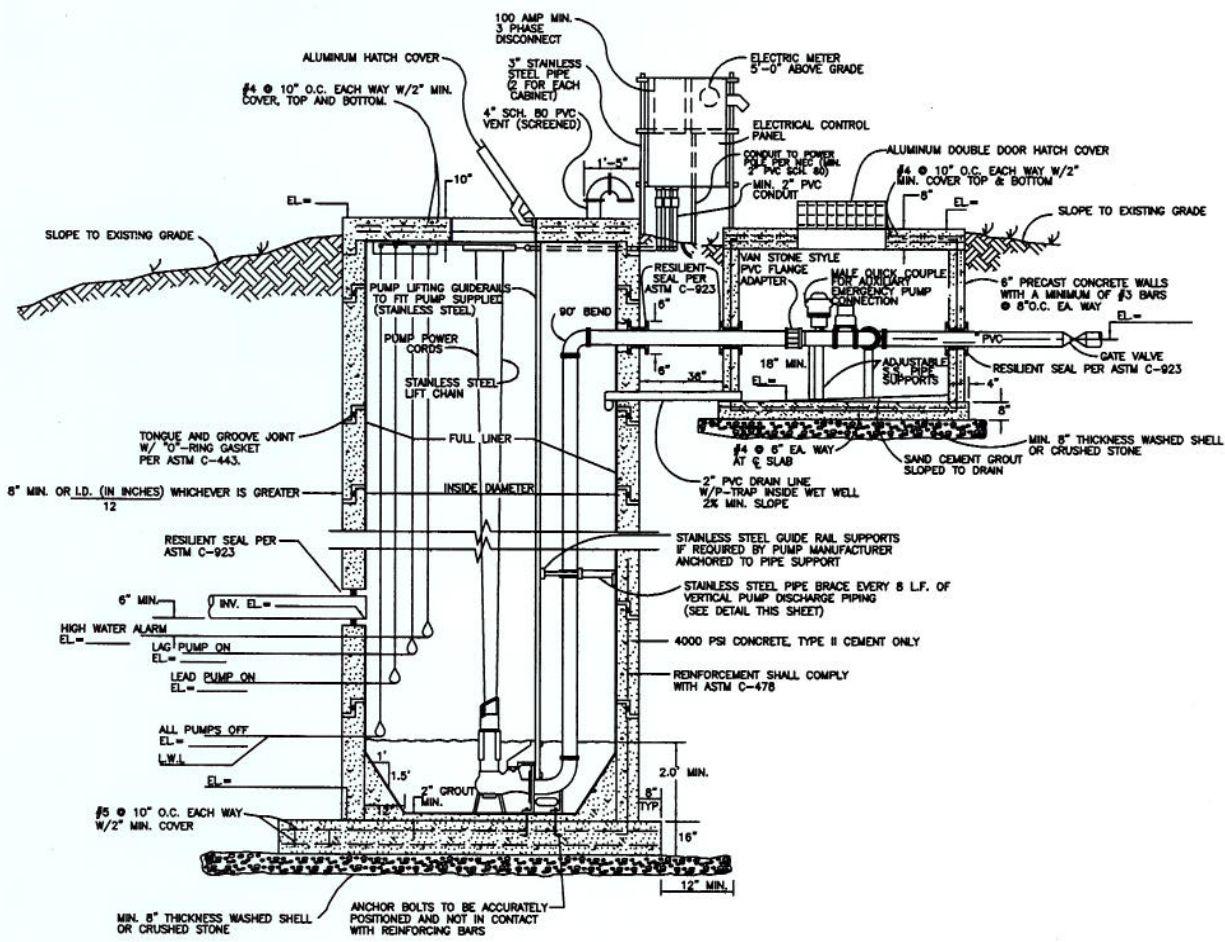

SECTION X-X
FOR PLAN VIEW
SEE SHEET US-20A

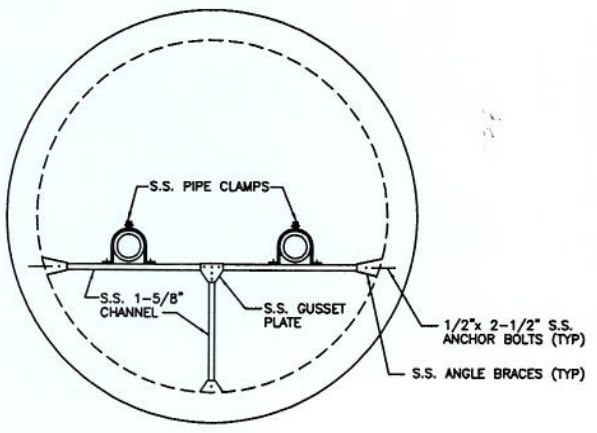

WET WELL PIPE BRACING DETAIL

PUMP DATA AND DESIGN CHARACTERISTICS	
NUMBER OF PUMPS	
DESIGN CAPACITY PER PUMP, G.P.M.	
TOTAL DYNAMIC HEAD, FT.	
MIN. EFF. AT DESIGN CAPACITY %	
HORSEPOWER PER PUMP, H.P.	
SHUT-OFF HEAD, FT.	
MAX. SIZE SOLIDS, IN.	
DISCHARGE SIZE, IN.	
PUMP MANUF. & MODEL NUMBER	
IMPELLER DIAMETER, IN.	
PUMP R.P.M.	
ELECT. SVC- VOLTAGE & PHASE	
FORCE MAIN- LENGTH, DIAMETER & MATERIAL	
FORCE MAIN DISCHARGE ELEV. & HIGHEST EL.	

MANATEE COUNTY PUBLIC WORKS DEPARTMENT		SEWAGE PUMP STATION WET WELL & VALVE VAULT		US-20B
REV. BY	DATE	MARCH 18, 1997 DATE OF APPROVAL		
R.T.H.	11/99			
		SECTIONAL VIEW DETAILS		