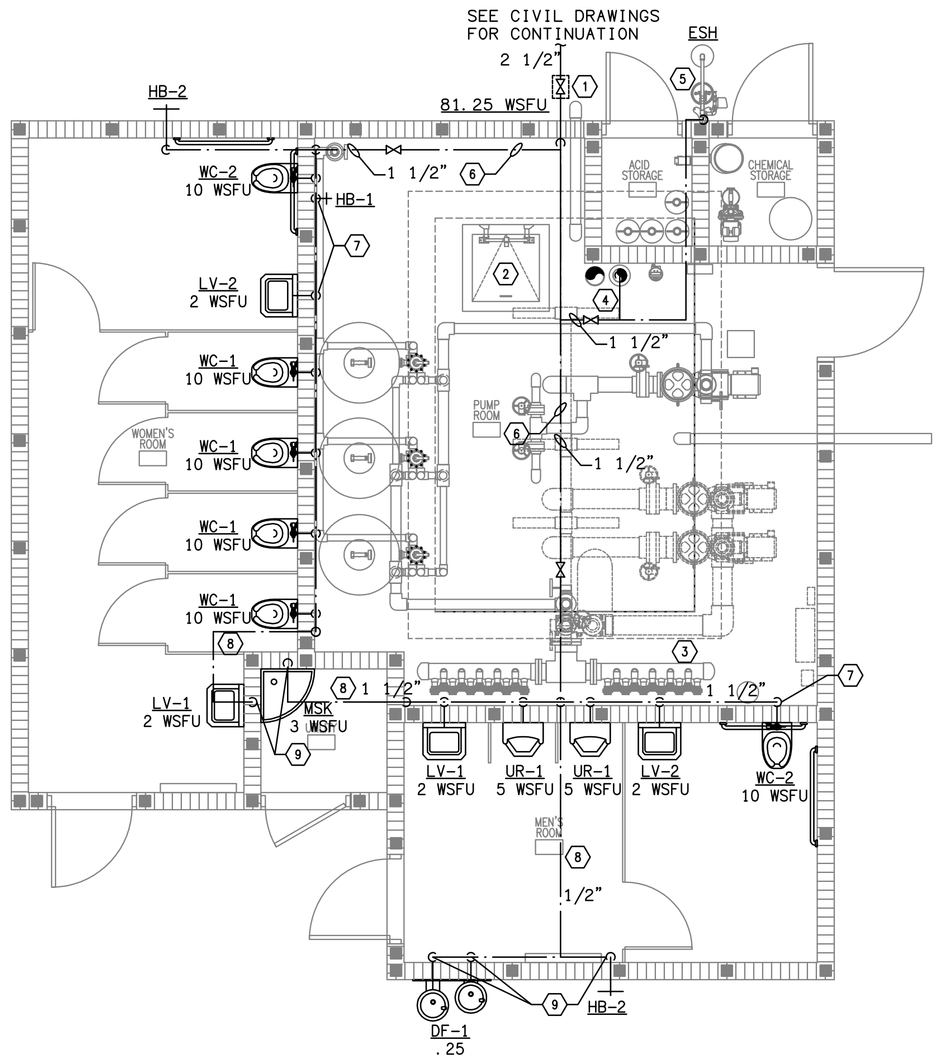

GENERAL NOTES:

1. COORDINATE ALL EQUIPMENT LOCATIONS TO PROVIDE SERVICE CLEARANCE REQUIRED BY THE MANUFACTURER.

2. ALL MECHANICAL EQUIPMENT AND ACCESSORIES PROVIDED FOR THE POOL CHEMICAL STORAGE AND THE POOL EQUIPMENT ROOM SHALL BE FIBERGLASS REINFORCED PLASTIC OR PVC. OTHER CHEMICAL RESISTANT MATERIALS SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL. SEE POOL LAYOUT DRAWINGS FOR DETAILS REGARDING CHEMICALS.

KEY NOTES:

1. BUILDING SHUT OFF VALVE IN CONCRETE BOX WITH LID.
2. TANK ACCESS HATCH AND LADDER.
3. WATER SUPLY TO PARK FEATURES. COORDINATE PIPING HEIGHT WITH PARK WATER FEATURE CONSULTANT.
4. 1 1/2" DOMESTIC WATER SERVICE. PROVIDE A VACUUM BREAKER HIGHEST POINT OF THE TANK FILL PIPING. SE PL4.01-8 FOR VALVE ASSEMBLY DETAIL.
5. EMERGENCY EYEWASH STATION WITH DRENCH SHOWER.
6. OFFSET EXPOSED BELOW CEILING (TYP.).
7. OFFSET EXPOSED ON WALL (TYP.).
8. OFFSET ABOVE CEILING (TYP.).
9. RUN THROUGH CONCRETE BLOCK.

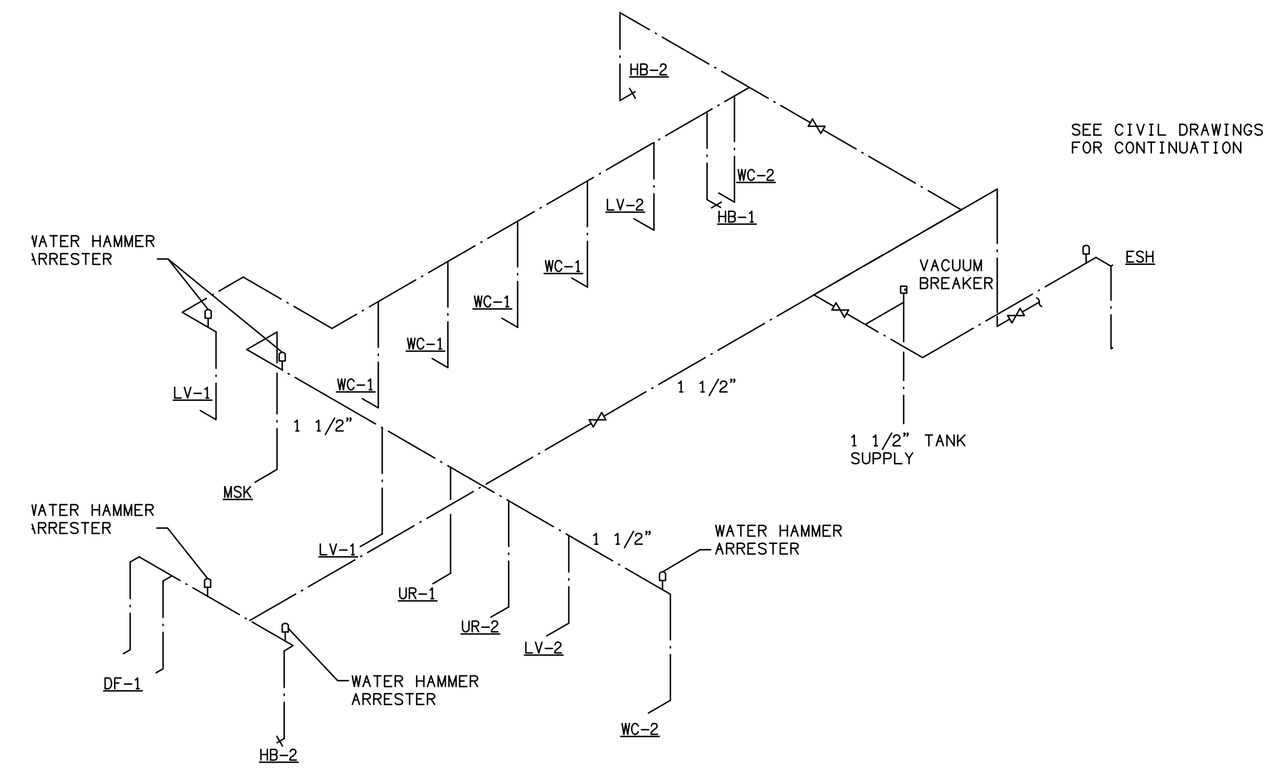

DOMESTIC WATER PIPING

SCALE: 1/4" = 1'-0"

1 DOMESTIC WATER PIPING RISER DIAGRAM

SCALE: NOT TO SCALE

CONSTRUCTION DOCUMENTS

MEP
GRAEF
1059 Maitland Center Commons Blvd., Suite 200
Maitland, FL 32751
407 / 659 0553
407 / 659 0609 fax
www.graef-usa.com
CERT # 4270

GRAEF PROJECT #2009-4110

CAD DWG FILE: PL01-P301-104110.DWG

8/26/2010 4:37 PM

UGARTE & ASSOCIATES, INC.
ARCHITECTS PLANNERS
434 9th AVENUE WEST
PALMETTO, FLORIDA 34221
PHONE (941)729-5691
FAX (941)729-5692
AA-C001654

DOMESTIC WATER PIPING

MANATEE COUNTY – LINCOLN SPLASH PARK

501 17TH STREET EAST PALMETTO, FL 34221

REVISIONS:

PROJECT NO: 10-4110
DATE: 08.27.2010
DRAWN BY: CF
CHK'D BY: MR

Baltu Yorkos
LIC. NO. 60308

SHEET
P301