



**INVITATION FOR BID
IFB #14-3048CD
FORCE MAIN 15D REHABILITATION**

Manatee County, a political subdivision of the State of Florida, (hereinafter "County") will receive sealed Bids from individuals, corporations, partnerships, and other legal entities organized under the laws of the State of Florida or authorized to conduct business in the State of Florida.

DEADLINE FOR CLARIFICATION REQUESTS: **3:00 PM on September 23, 2014**
(Reference Bid Article A.05)

TIME AND DATE DUE: **3:00 PM on October 2, 2014**

FOR INFORMATION CONTACT:
Chris Daley, CPPO, CPPB, Contract Specialist
(941) 749-3048, Fax (941) 749-3034
chris.daley@mymanatee.org
Manatee County Financial Management Department
Purchasing Division

AUTHORIZED FOR RELEASE: DKW

Table of Contents
IFB #14-3048CD

Section A Information to Bidders..... A-1-12

Section B Bid Summary B-1-2

Section C Basis of Award & Minimum Qualifications..... C-1

Section D General Terms and Conditions D-1-11

Section E General Conditions E-1-21

Section F Form of Contract..... F-1-8

Bid Form Bid Form 1-2

Form A Contractor’s Questionnaire 1-3

Form B Public Contracting & Environmental Crimes Certification 1-2

Form C The Florida Trench Safety Act 1

Form D ePayables Application..... 1

Attachment(s):

Plan Set (dated August 2014)..... 9 pages

Technical Specifications.....270 pages

Geotechnical Report9 pages

State Permits17 pages

Restraint Length Calculator2 pages

SECTION A
INFORMATION TO BIDDERS

A.01 OPENING LOCATION

Sealed Bids will be **publicly opened** at the **Manatee County Purchasing Division, 1112 Manatee Avenue West, Suite 803, Bradenton, Florida 34205** in the presence of County officials at the time and date stated, or soon thereafter. All Bidders or their representatives are invited to be present.

Any Bids received after the stated time and date will not be considered. It shall be the sole responsibility of the Bidder to have their Bid **delivered to the Manatee County Purchasing Division** for receipt on or before the stated time and date. Bidder shall be solely and strictly responsible for its timely delivery to the Purchasing Division. Bids delayed by mail, courier, or Bids delayed for any other reason, shall not be considered, shall not be opened at the public opening, and arrangements shall be made for their return at the Bidder's request and expense.

A.02 SEALED & MARKED

Bids shall be submitted in **triplicate, one original (marked Original) and two (2) copies (marked Copy)** of your **signed Bid** shall be submitted in one **sealed** package, clearly marked on the outside "**Sealed Bid #14-3048CD- Force Main 15D Rehabilitation**" along with your company name. For your convenience, a mailing label is provided with this Invitation for Bid package. Or, you may address the package as follows:

Address package to: Manatee County Purchasing Division
1112 Manatee Avenue West, Suite 803
Bradenton, Florida 34205
Sealed Bid # _____, Title _____

All blank spaces must be filled in as noted with amounts extended and totaled and no changes shall be made in the wording of the forms or in the items mentioned therein. In the event a change is made in your submittal, the Bidder shall write its initials by the change. Any Bid may be rejected which contains any omissions, alterations, irregularities of any kind, or which shall in any manner fail to conform to Bid requirements.

A Bid made by an individual, either in his/her own or proper person or under a trade or firm name, shall be executed under the individual's signature. If made by a partnership, the Bid shall be executed by two or more of the general partners. If made by a corporation, the Bid shall be executed by its President or other legally authorized corporate officer or agent.

A.03 SECURING OF DOCUMENTS

Invitation for Bids (IFB) and related documents are available on <http://www.mymanatee.org/purchasing> for download in a portable document format (.PDF) file by clicking on "Bids and Proposals" from the Purchasing Division's web page. You may view and print these files using Adobe Reader software. If necessary, you may download a free copy of Adobe Reader from the link provided on the "Bids and Proposals" page.

Additionally, Manatee County collaborates with the Manatee Chamber of Commerce by emailing solicitation opportunities to its members.

Manatee County may also use DemandStar to distribute Bids. On the DemandStar web site, <http://www.DemandStar.com>, click on the tab titled "My DemandStar" for more information regarding this service. Participation in the DemandStar system is not a requirement for doing business with Manatee County.

Complete copies of the IFB and all related documents are available for public inspection at the Manatee County Purchasing Division, 1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205, or by calling (941) 749-3014. Appointments are encouraged. Documents are available between the hours of 9:00 AM and 4:00 PM Monday through Friday, with the exception of holidays. A complete set of the IFB documents must be used in preparing Bids. County assumes no responsibility for errors and misinterpretations resulting from the use of incomplete sets of Bid Documents.

A.04 MODIFICATION OF IFB DOCUMENTS

If a Bidder wishes to recommend changes to the IFB documents, the Bidder shall furnish, in writing, data and information necessary to aid County in evaluating the request to modify the Specifications. County is not obligated to make any changes to the IFB documents. Unless an Addendum is issued, the IFB documents shall remain unaltered. **Bidders must fully comply with the IFB documents in their entirety.**

A.05 DEADLINE FOR CLARIFICATION REQUESTS

3:00 PM on September 23, 2014 shall be the deadline to submit all inquiries, suggestions, or requests concerning interpretation, clarification or additional information pertaining to this Invitation for Bid to the Manatee County Purchasing Division.

This deadline has been established to maintain fair treatment of all potential Bidders, while maintaining progression of the Project to promote economic stimulus.

A.06 CLARIFICATION & ADDENDA

Each Bidder shall examine all Invitation for Bid Documents and shall judge all matters relating to the adequacy and accuracy of such documents. Any inquiries, suggestions or requests concerning interpretation, clarification or additional information pertaining to this Invitation for Bid shall be made through the Manatee County Purchasing Division. County shall not be responsible for oral interpretations given by any County employee, representative, or others.

The issuance of a written Addendum is the only official method whereby interpretation, clarification or additional information can be given.

If any Addenda are issued to this Invitation for Bid, County will post the documents on the Purchasing Division's web page, which can be accessed at <http://www.mymanatee.org/purchasing>, and then by clicking on "Bids and Proposals". If the original solicitation was broadcast via DemandStar, the addenda will also be broadcast on the DemandStar distribution system to "Planholders" on this web service.

It shall be the **responsibility of each Bidder, prior to submitting their Bid**, to contact the Manatee County Purchasing Division (see contact information on the cover page) to **determine if any Addenda were issued** and to make such Addenda a part of their Bid.

A.07 LOBBYING

After the issuance of any Invitation for Bid prospective Bidders, or any agent, representative or person acting at the request of such Bidder shall not contact, communicate with or discuss any matter relating in any way to the Invitation for Bid with any officer, agent or employee of Manatee County other than the Purchasing Official or as directed in the Invitation for Bid, pursuant to the Manatee County Code. This prohibition includes the act of carbon copying officers, agents or employees of Manatee County on all correspondence, including email correspondence. This requirement begins with the issuance of an Invitation for Bid, and ends upon execution of Contract or when the invitation has been cancelled. Violators of this prohibition shall be subject to sanctions as provided in the Manatee County Code.

A.08 UNBALANCED BIDDING PROHIBITED

County recognizes that large and/or complex Projects will often result in a variety of methods, sources, and prices. However, where in the opinion of County such variation does not appear to be justified, given Bid requirements and industry and market conditions, the Bid will be presumed to be unbalanced. Examples of unbalanced Bids will include:

- a. Bids showing omissions, alterations of form, additions not specified, or required conditional or unauthorized alternate Bids.

A.08 UNBALANCED BIDDING PROHIBITED (Continued)

- b. Bids quoting prices that substantially deviate, either higher or lower, from those included in the Bids of competitive Bidders for the same line item unit costs.
- c. Bids where the unit costs offered are in excess of or below reasonable cost analysis values.

In the event County determines that a Bid is presumed unbalanced, it will request the opportunity to, and reserves the right to, review all source quotes, Bids, price lists, letters of intent, etc., which the Bidder obtained and upon which the Bidder relied upon to develop its Bid. County reserves the right to reject as non-responsive any presumptive unbalanced Bids where the Bidder is unable to demonstrate the validity and/or necessity of the unbalanced unit costs.

A.09 FRONT END LOADING OF BID PRICING PROHIBITED

Prices offered for performance and/or acquisition activities to occur early in the Project schedule, such as mobilization; clearing and grubbing; or maintenance of traffic; that are substantially higher than pricing of competitive Bidders within the same portion of the Project schedule, will be presumed to be front end loaded. Front end loaded Bids could reasonably appear to be an attempt to obtain unjustified early payments creating a risk of insufficient incentive for the Bidder to complete the Work or otherwise creating an appearance of an undercapitalized Bidder.

In the event County determines that a Bid is presumed to be front end loaded, it will request the opportunity to, and reserves the right to, review all source quotes, bids, price lists, letters of intent, etc., which the Bidder obtained and upon which the Bidder relied upon to develop the pricing or acquisition timing for these Bid items. County reserves the right to reject as non-responsive any presumptive front end loaded Bids where the Bidder is unable to demonstrate the validity and/or necessity of the front end loaded costs.

A.10 WITHDRAWAL OF OFFERS

Bidders may withdraw offers as follows:

- a. Mistakes discovered before the opening of a solicitation may be withdrawn by written notice from the Bidder submitting the Bid. This request must be received in the office designated for receipt of Bids in the solicitation document prior to the time set for delivery and opening of the Bids. A copy of the request shall be retained and the unopened Bid returned to that Bidder; or
- b. After the responses to a solicitation are opened or a selection has been determined, but before a Contract is signed, a Bidder alleging a material mistake of fact may be permitted to withdraw their Bid if:

A.10 WITHDRAWAL OF OFFERS (Continued)

1. the mistake is clearly evident in the solicitation document; or
2. Bidder submits evidence which clearly and convincingly demonstrates that a mistake was made. Request to withdraw a Bid must be in writing and approved by the Purchasing Official.

A.11 IRREVOCABLE OFFER

Any Bid may be withdrawn up until the time and date set for opening of the Bid. Any Bid not so withdrawn shall, upon opening, constitute an irrevocable offer for a period of ninety (90) days to sell to Manatee County the goods or services set forth in the attached IFB until one or more of the Bids have been duly accepted by County.

A.12 BID EXPENSES

All expenses for making Bids to County are to be borne by the Bidder.

A.13 RESERVED RIGHTS

County reserves the right to accept or reject any and/or all Bids, to waive irregularities and technicalities, and to request resubmission. Also, County reserves the right to accept all or any part of the Bid and to increase or decrease quantities to meet additional or reduced requirements of County. Any sole response received by the first submission date may or may not be rejected by County depending on available competition and current needs of County. For all items combined, the Bid of the lowest, responsive, responsible Bidder will be accepted, unless all Bids are rejected.

The lowest, responsible Bidder shall mean that Bidder who makes the lowest Bid to sell goods and/or services of a quality which meets or exceeds the quality of goods and/or services set forth in the IFB documents or otherwise required by County, and who is fit and capable to perform the Bid as made.

To be responsive, a Bidder shall submit a Bid which conforms in all material respects to the requirements set forth in the Invitation for Bid.

To be a responsible Bidder, the Bidder shall have the capability in all respects to perform fully the Bid requirements, and the tenacity, perseverance, experience, integrity, reliability, capacity, facilities, equipment, and credit which will assure good faith performance.

Also, County reserves the right to make such investigation as it deems necessary to determine the ability of any Bidder to furnish the service requested. Information County deems necessary to make this determination shall be provided by the Bidder. Such information may include, but shall not be limited to current financial statements, verification of availability of equipment and personnel, and past performance records.

A.14 APPLICABLE LAWS

Bidder must be authorized to transact business in the State of Florida. All applicable laws and regulations of the State of Florida and ordinances and regulations of Manatee County will apply to any resulting Contract. Any involvement with the Manatee County Purchasing Division shall be in accordance with the Manatee County Purchasing Ordinance as amended.

A.15 COLLUSION

By submitting a Bid to this Invitation for Bid, the Bidder certifies that it has not divulged, discussed or compared its Bid with any other Bidder, and has not colluded with any other Bidder or parties to this Bid whatsoever. Also, Bidder certifies, and in the case of a joint Bid each party thereto certifies as to their own organization, that in connection with this Bid:

- a. any prices and/or cost data submitted have been arrived at independently, without consultation, communication, or agreement, for the purpose of restricting competition, as to any matter relating to such prices and/or cost data, with any other Bidder or with any competitor;
- b. any prices and/or cost data quoted for this Bid have not been knowingly disclosed by the Bidder and will not knowingly be disclosed by the Bidder, prior to the scheduled opening, directly or indirectly to any other Bidder or to any competitor;
- c. no attempt has been made or will be made by the Bidder to induce any other person or firm to submit or not to submit a Bid for the purpose of restricting competition;
- d. the only person or persons interested in this Bid, principal or principals is/are named therein and that no person other than therein mentioned has any interest in this Bid or in the resulting Contract to be entered into; and
- e. no person or agency has been employed or retained to solicit or secure the resulting Contract upon an agreement or understanding or a commission, percentage, brokerage, or contingent fee except bona fide employees or established commercial agencies maintained by Bidder for purpose of doing business.

A.16 CODE OF ETHICS

With respect to this Bid, if any Bidder violates, directly or indirectly, the ethics provisions of the Manatee County Purchasing Ordinance and/or Florida criminal or civil laws related to public procurement, including but not limited to Florida Statutes, Chapter 112, Part III, Code of Ethics for Public Officers and Employees, such Bidder will be disqualified from eligibility to perform the Work described in this Invitation for Bid, and may also be disqualified from furnishing future goods or services to, and from submitting any future Bids to supply goods or services to, Manatee County.

A.16 CODE OF ETHICS (Continued)

By submitting a Bid, the Bidder represents to County that all statements made and materials submitted are truthful, with no relevant facts withheld. If a Bidder is determined to have been untruthful in their Bid or any related presentation, such Bidder will be disqualified from eligibility to perform the Work described in this Invitation for Bid, and may also be disqualified from furnishing future goods or services to, and from submitting any future Bids to supply goods or services to, Manatee County.

A.17 PUBLIC CONTRACTING AND ENVIRONMENTAL CRIMES

A person or affiliate who has been placed on the State's convicted vendor list following a conviction for a public entity crime, as that term is defined in Florida Statute § 287.133, may not submit a Bid to provide any goods or services to a public entity; may not submit a Bid with a public entity for the construction or repair of a public building or public work; may not submit Bids on leases of real property to a public entity; may not be awarded or perform Work as a Contractor, Supplier, Subcontractor, or Consultant under a Contract with any public entity; and may not transact business with any public entity in excess of the threshold amount provided in Florida Statutes § 287.017 for CATEGORY TWO for a period of thirty-six (36) months following the date of being placed on the convicted list.

In addition, the Manatee County Code prohibits the Award of any resulting Contract to any person or entity who/which has, within the past five (5) years, been convicted of, or admitted to in court or sworn to under oath, a public entity crime or of any environmental law that, in the reasonable opinion of the Purchasing Official, establishes reasonable grounds to believe the person or business entity will not conduct business in a responsible matter.

To ensure compliance with the foregoing, the Code requires all persons or entities desiring to contract with County to execute and file with the Purchasing Official an affidavit, executed under the pain and penalties of perjury, confirming that person, entity and any person(s) affiliated with the entity, does not have such a record and is therefore eligible to seek and be awarded business with County. In the case of a business entity other than a partnership or a corporation, such affidavit shall be executed by an authorized agent of the entity. In the case of a partnership, such affidavit shall be executed by the general partner(s). A Public Contracting and Environmental Crimes Certification form is included (reference Section 00491 of this document) for this purpose.

A.18 BID FORMS

Bids must be submitted on attached provided forms, although additional pages may be attached. **Bidders must fully complete all pages of the Bid Forms. Bid Forms must be executed by an authorized signatory who has the legal authority to make the Bid and bind the company. Bidders must fully comply with all requirements of this IFB in its entirety.** Failure to comply shall result in default of the resulting Contract, whereupon, the defaulting Contractor shall be required to pay for any and all re-procurement costs, damages, and attorney fees as incurred by County.

A.19 LEGAL NAME

Bids shall clearly indicate the legal name, address and telephone number of the Bidder on the Bid Form. Bid Forms shall be signed above the typed or printed name and title of the signer. The signer must have the authority to bind the Bidder to the submitted Bid.

When Bidder is a partnership, the Bid Form shall be signed in the name of the firm and by all partners required under the terms of the partnership agreement. When a corporation is a Bidder, the authorized corporate officers shall sign.

Bidders who are corporations or limited partnerships shall provide a certified copy of their permit to transact business in the State of Florida, preferably along with the Bid Form, or within forty-eight (48) hours after request by County.

When submitting a Bid as a joint venture, it must have filed paper documents with the Division of Profession's Construction Industry Licensing Board prior to submitting a Bid.

A.20 DISCOUNTS

Any and all discounts must be incorporated in the prices contained in the Bid and not shown separately. The prices as shown on the Bid Form shall be the prices used in determining Award.

A.21 TAXES

Manatee County is exempt from Federal Excise and State Sales Taxes. (F.E.T. Cert. No. 59-78-0089K; Florida Sales Tax Exempt Cert. No. 85-8012622206C-6); therefore, the Bidder is prohibited from delineating a separate line item in his Bid for any sales or service taxes. Nothing herein shall affect the Bidder's normal tax liability.

A.22 DESCRIPTIVE INFORMATION

Unless otherwise specifically provided in the IFB documents, all equipment, materials and articles provided shall be new and of the most suitable grade for the purpose intended. Unless otherwise specifically provided in the IFB documents, reference to any equipment, material, article or patented process, by trade name, brand name, make or catalog number, shall be regarded as establishing a standard of quality and shall not be construed as limiting competition.

A.23 AMERICANS WITH DISABILITIES ACT

County does not discriminate upon the basis of any individual's disability status. This non-discrimination policy involves every aspect of County's functions including one's access to, participation, employment, or treatment in its programs or activities. Anyone requiring **reasonable accommodation** for an Information Conference or Bid Opening should contact the person named on the cover page of this Bid document at least twenty-four (24) hours in advance of either activity.

A.24 EQUAL EMPLOYMENT OPPORTUNITY CLAUSE

In accordance with the provisions of Title VI of the Civil Rights Act of 1964 and Title 15, Part 8 of the Code of Federal Regulations, County hereby notifies all prospective Bidders that they will affirmatively ensure minority business enterprises will be afforded full opportunity to participate in response to this advertisement and will not be discriminated against on the grounds of race, color or national origin in consideration for Bid Award.

A.25 MBE/DBE

The State of Florida, Office of Supplier Diversity provides the certification process and the database for identifying certified MBE/DBE firms. This service may be directly accessed at: <http://www.osd.dms.state.fl.us/iframe.htm>

If you have any questions regarding this State service, please contact their office at (850) 487-0915.

A.26 MATHEMATICAL ERRORS

In the event of multiplication/extension error(s), the unit price shall prevail. In the event of addition error(s) the extension totals will prevail. All Bids shall be reviewed mathematically and corrected, if necessary, using these standards, prior to additional evaluation.

A.27 DISCLOSURE

Upon receipt, all inquiries and responses to inquiries related to this Invitation for Bid become "Public Records", and shall be subject to public disclosure consistent with Florida Statutes, Chapter 119.

Bids become subject to disclosure thirty (30) days after the opening or if a Notice of Intent to Award decision is made earlier than this time as provided by Florida Statutes § 119.071(1)(b). No announcement or review of the Bid shall be conducted at the public opening.

Based on the above, County will receive Bids at the time and date stated, and will make public at the opening the names of the business entities of all that submitted a Bid and any amount presented as a total offer without any verification of the mathematics or the completeness of the Bid.

A.27 DISCLOSURE (Continued)

If County rejects all Bids and concurrently notices its intent to reissue the solicitation, the rejected Bids are exempt from public disclosure until such time as County provides notice of an intended decision concerning the reissued solicitation or until County withdraws the reissued solicitation. A Bid is not exempt for longer than twelve (12) months after the initial notice rejecting all Bids.

Pursuant to Florida Statutes 119.0701, to the extent Successful Bidder is performing services on behalf of County, Successful Bidder must:

- a. Keep and maintain public records that ordinarily and necessarily would be required by County in order to perform the service;
- b. Provide the public with access to public records on the same terms and conditions that County would provide and at a cost that does not exceed the cost provided in Florida Statutes, Chapter 119, or as otherwise provided by law;
- c. Ensure that public records that are exempt or confidential and exempt from public records disclosure requirements are not disclosed except as authorized by law, and;
- d. Meet all requirements for retaining public records and transfer, at no cost, to County all public records in possession of Successful Bidder upon termination of the awarded Contract and/or PO and destroy any duplicate public records that are exempt or confidential from public records disclosure requirements. All records stored electronically must be provided to County in a format that is compatible with County's information technology systems.

A.28 LOCAL PREFERENCE

- a. Local business is defined as a business legally authorized to engage in the sale of the goods and/or services to be procured, and which certifies within its Bid that for at least six (6) months prior to the announcement of the solicitation of Bids it has maintained a physical place of business in Manatee, Desoto, Hardee, Hillsborough, Pinellas or Sarasota County with at least one full-time employee at that location.
- b. Local preference shall not apply to the following categories of Contracts:
 1. Purchases or Contracts which are funded, in whole or in part, by a governmental or other funding entity, where the terms and conditions of receipt of the funds prohibit the preference;

A.28 LOCAL PREFERENCE (Continued)

2. Any Bid announcement which specifically provides that the general local preference policies set forth in this section are suspended due to the unique nature of the goods or services sought, the existence of an emergency as found by either the County Commission or County Administrator, or where such suspension is, in the opinion of the County Attorney, required by law.
- c. To qualify for local preference under this section, **a local business must certify to County** by completing an “**Affidavit as to Local Business Form**”, which is available for download at www.mymanatee.org/vendor. Click on “Affidavit for Local Business” to access and print the form. Complete, notarize, and mail the notarized original to the following address: Manatee County Purchasing Division, 1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205.

It is the responsibility of the Bidder to ensure accuracy of the Affidavit as to Local Business and notify County of any changes affecting same. Bidder attests that it:

1. Has not within the five (5) years prior to the Bid announcement admitted guilt or been found guilty by any court or state or federal regulatory enforcement agency of violation of any criminal law, or a law or administrative regulation regarding fraud;
2. Is not currently subject to an unresolved citation or notice of violation of any Manatee County Code provision, except citations or notices which are the subject of a current legal appeal, as of the date of the Bid announcement;
3. Is not delinquent in the payment of any fines, liens, assessments, fees or taxes to any governmental unit or taxing authority within Manatee County, except any such sums which are the subject of a current legal appeal.

A.29 VENDOR REGISTRATION

All vendors are encouraged to register with Manatee County using the on-line “Vendor Registration” web page on www.mymanatee.org/purchasing.

Your cooperation in registering your business with Manatee County will enhance our opportunities to identify sources for goods and services, plus identify local businesses. This information is used for soliciting quotations up to \$250,000.00 and for competitive solicitations of larger purchases.

You will note that Manatee County collaborates with the Manatee Chamber of Commerce (www.manateechamber.com) by emailing solicitation opportunities to its members.

Our staff can assist you with your registration as needed. Our office hours are 8:00 A.M. to 5:00 P.M., Monday through Friday on regular business days. Please call (941) 749-3014 if you wish to have a Purchasing staff member assist you.

A.29 VENDOR REGISTRATION (Continued)

Quick steps to registration: www.mymanatee.org/purchasing

A link to Vendor Registration is listed on the Purchasing Division's web page under "Register as a Vendor".

Click on "Vendor Registration Form" for on-line input.

Thank you for reviewing this information and considering registering your business with Manatee County. Registration is not mandatory; however, by taking the time to register, you are helping County to provide timely notifications of Quotation, Bid and Proposal opportunities to your business.

A.30 ePAYABLES

Manatee County and Clerk of the Circuit Court have partnered to offer the ePayables program, which allows payments to be made to vendors via credit cards. The Clerk will issue a unique credit card number to each vendor; the card has a zero balance until payments have been authorized.

After goods are delivered or services rendered, vendors submit invoices to the remit to address on the purchase order according to the current process. When payments are authorized, an email notification is sent to the vendor. The email notification includes the invoice number(s), invoice date(s), and amount of payment. Once the vendor receives the email, the credit card has been authorized to be charged for the amount listed in the email. When the vendor charges the full amount authorized in the email, the card will return to a zero balance until the next payment is authorized.

There is no cost for vendors to participate in this program; however, there may be a charge by the company that processes your credit card transactions.

If you are interested in participating in this program, please complete Form D, ePayables Application and return the completed form via email to Ms. Lori Bryan, Supervisor at lori.bryan@manateeclerk.com.

NOTE: ANY OR ALL STATEMENTS CONTAINED IN THE FOLLOWING SECTIONS: MINIMUM QUALIFICATIONS & BASIS OF AWARD, GENERAL TERMS AND CONDITIONS, OR SPECIFICATIONS, WHICH VARY FROM THE INFORMATION TO BIDDERS, SHALL HAVE PRECEDENCE.

END OF SECTION A

SECTION B
BID SUMMARY

B.01 THE WORK

The Work included in this Bid consists of furnishing all labor, materials, equipment and incidentals required for the construction of approximately 550 linear feet of 20" PVC force main and one (1) precast doghouse manhole to establish a complete and fully functional system. A portion of the proposed force main will be installed by jack and bore underneath the existing intersection, and the project also includes the restoration of all pavement and concrete that will be disturbed due to construction of force main.

The Successful Bidder shall furnish all Shop Drawings, working drawings, labor, materials, equipment, tools, services and incidentals necessary to complete all Work required by these Specifications.

The successful Bidder shall perform the Work complete, in place and ready for continuous service and shall include any repairs, replacements, and/or restoration required as a result of damages caused prior to acceptance by County.

The Successful Bidder shall furnish and install all materials, equipment and labor which is reasonably and properly inferable and necessary for the proper completion of the Work, whether specifically indicated in the Bid Documents or not.

B.02 EXAMINATION OF BID DOCUMENTS AND SITE(S)

It is the responsibility of each Bidder before submitting a Bid, to (a) examine the Bid Documents thoroughly; (b) visit the site(s) to become familiar with local conditions that may affect cost, progress, performance, or furnishing of the Work; (c) consider federal, state, and local codes, laws, and regulations that may affect costs, progress, performance, or furnishing of the Work; (d) study and carefully correlate Bidder's observations with the Bid Documents; and (e) notify County of all conflicts, errors, or discrepancies in the Bid Documents.

Each Bidder may, at Bidder's own expense, make or obtain any additional examinations, investigations, explorations, tests and studies, and obtain any additional information and data which pertain to the physical conditions at or contiguous to the site(s) or otherwise which may affect cost, progress, performance or furnishing of the Work and which Bidder deems necessary to determine his Bid for performing and furnishing the Work in accordance with the time, price and other terms and conditions of the Bid Documents. County will provide each Bidder access to the site(s) to conduct such explorations and tests.

B.02 EXAMINATION OF BID DOCUMENTS AND SITE(s) (Continued)

Bidder shall fill all holes, clean up and restore the site(s) to its former condition upon completion of such explorations. The lands upon which the Work is to be performed, rights-of-way and easements for access thereto, and other lands designated for use by Contractor in performing the Work are identified in the Bid Documents.

All additional lands and access thereto required for temporary construction facilities or storage of materials and equipment are to be provided by Contractor. Easements for permanent structures or permanent changes in existing structures are to be obtained and paid for by County unless otherwise provided in the Bid Documents.

Inspection of the site(s) is **a requirement** to be considered for Award of this Bid. Prior to submitting a Bid, each Bidder shall examine the site(s) and all conditions thereon fully familiarizing themselves with the full scope of the Project. Failure to become familiar with site conditions will in no way relieve the Successful Bidder from the necessity of furnishing any materials or performing any Work that is required to complete the Project in accordance with the plans and Specifications. Bidder shall acknowledge inspection of the Project site(s) on his/her signed, submitted Bid Form.

END OF SECTION B

SECTION C
BASIS OF AWARD & MINIMUM QUALIFICATIONS

C.01 BASIS OF AWARD

Award shall be to the lowest, responsive, responsible Bidder meeting Specifications and having the lowest total offer for the requirements listed on the Bid Form for the Work as set forth in this Invitation for Bid. Bid prices shall include costs for furnishing all labor, equipment and/or materials for the completion of the Work in accordance with and in the manner set forth and described in the Bid Documents to County's satisfaction within the prescribed time.

Only one schedule for Completion of the Work shall be considered. Only one Award shall be made.

NOTE: Inspection of the site is a pre-requisite to be considered for Award of this Bid.

In evaluating Bids, County shall consider the qualifications of the Bidders; and if required, may also consider the qualifications of the Subcontractors, Suppliers, and other persons and organizations proposed. County may also consider the operating costs, maintenance requirements, performance data and guarantees of major items of materials and equipment proposed for incorporation in the Work.

Whenever two or more Bids are equal with respect to price, the Bid received from a local business shall be given preference in Award. Whenever two or more Bids which are equal with respect to price are received, and neither of these Bids are from a local business, the Award shall be determined by a chance drawing, coin toss, or similar tie-breaking method conducted by the Purchasing Division and open to the public.

C.02 MINIMUM QUALIFICATIONS OF BIDDERS

No person who is not certified or registered as a Underground Utility Contractor pursuant to Florida Statutes, Chapter 489 on the day the Bid is submitted, and who has continuously held that certification or registration for a period of at least three (3) consecutive years immediately prior to the day the Bid is submitted, may be qualified to bid on this Project. In the event that a Bidder is a business organization, including a partnership, corporation, business trust or other legal entity as set forth in Florida Statutes § 489.119(2), then the Bidder shall only be qualified to bid on this Project if: 1) the Bidder (the business organization) is on the day the Bid is submitted, and for at least three (3) consecutive years immediately prior to the day the Bid is submitted has been, in continuous existence, properly licensed and registered as required by Florida law; and 2) the Bidder, on the day the Bid is submitted, has a certified or registered Qualifying Agent, as required by Florida Statutes § 489.119, and that Qualifying Agent has been the same Qualifying Agent of the Bidder for a period of at least three (3) consecutive years immediately prior to the day the Bid is submitted.

END OF SECTION C

SECTION D
GENERAL TERMS & CONDITIONS

D.01 CONTRACT FORMS

The Contract resulting from the acceptance of a Bid shall be in the form of the Contract stated in this Bid (reference Section F of this document).

A written notice confirming Award or recommendation thereof will be forwarded to the Successful Bidder accompanied by the required number of unsigned counterparts of the Contract. Within ten (10) days thereafter, Successful Bidder shall sign and deliver the required number of counterparts of the Contract with any other required documents to County. (Note: Contract must be approved in accordance with Chapter 2-26 of the Manatee County Code, and the Administrative Standards and Procedures Manual approved by the County Administrator).

D.02 ASSIGNMENT OF CONTRACT

Contractor shall not assign, transfer, convey, sublet or otherwise dispose of the resulting Contract or of his right, title, or interest therein, or his power to execute such Contract, or to assign any monies due or to become due there under to any other person, firm or corporation unless first obtaining the written consent of County. The giving of such consent to a particular Subcontractor assignment shall not dispense with the necessity of such consent to any further or other assignment.

D.03 COMPLETION OF WORK

The Work will be completed and ready for final inspection within the specified calendar days from the date the Contract time commences to run. Only one Bid shall be considered based on **90 calendar days. Only one Award shall be made.**

D.04 LIQUIDATED DAMAGES

If the Contractor refuses or fails to prosecute the Work, or any separable part thereof, with such diligence as will hinder its completion within the time specified, County may seek damages. The actual damages for delay will be impossible to determine and in lieu thereof, the Contractor shall pay to County the sum of **\$1,074** as fixed, agreed, and liquidated damages for each calendar day of the delay until the Work is finally accepted by County and the Contractor and his Surety shall be liable for the amount thereof.

D.05 PAYMENT

Contractor may apply for partial payment on monthly estimates, based on the amount of the Work done or completed in compliance with the provisions of the resulting Contract. Contractor shall submit an application, on a standard pay application form provided or approved by County, of an approximate estimate of the proportionate value of the Work done, items and locations of the Work performed up to and including the last day of the period then ending.

D.05 PAYMENT (Continued)

County will then review said estimate and make any necessary revisions so that the estimate can receive approval for payment. If the Contractor and County do not agree on the approximate estimate of the proportionate value of the Work done for any pay period, the determination of County will be binding. The amount of said estimate after deducting any required Retainage and all previous payments shall be due and payable to the Contractor, twenty (20) business days if County is its own Engineer of Record (EOR) or twenty-five (25) business days if outside agent approval is required after the pay estimate has been approved by the agent for County.

In accordance with the Prompt Payment Act, Florida Statutes § 218.735(7), a Punch List shall be formulated.

Time allowed for development of Punch List:

- a. Awarded Contracts with an estimated cost of less than \$10 million will be within thirty (30) calendar days after reaching Substantial Completion.
- b. Awarded Contracts with a cost of \$10 million dollars or more will be within thirty (30) calendar days OR if extended by Contract, up to sixty (60) calendar days after reaching Substantial Completion.

The Final Completion date of the resulting Contract must be at least thirty (30) days after delivery of the list of items. If the list is not provided to the awarded Contractor by the agreed upon date, the Contract completion time must be extended by the number of days County exceeds the delivery date.

It is the Contractor's responsibility for the care of the materials. Any damage to or loss of said materials is the full responsibility of the Contractor. Any periodical pay estimate signed by the Contractor shall be final as to the Contractor for any or all Work covered by the periodical pay estimate.

Any requests for payment of materials stored on site must be accompanied with a paid receipt. The Contractor warrants and guarantees that title to all Work, materials and equipment covered by any Application for Payment, whether incorporated in the Project or not, will pass to County at the time of payment free and clear of all liens, claims, security interests and encumbrances (hereafter referred to as "Liens").

The Contractor agrees to furnish an affidavit stating that all laborers, material men, and Subcontractors have been paid on the Project for Work covered by the Application for Payment and that a partial or complete release of lien, as may be necessary, be properly executed by the material men, laborers, Subcontractors on the Project for Work covered by the Application for Payment, sufficient to secure County from any claim whatsoever arising out of the aforesaid Work. When the Contractor has completed the Work in compliance with the terms of the Contract Documents, he shall notify County in writing that the Project is ready for final inspection.

D.05 PAYMENT (Continued)

County will then advise the Contractor as to the arrangements for final inspection and what Work, if any, is required to prepare the Project or a portion thereof for final inspection. When County determines the Project or portion thereof is ready for final inspection, County shall perform same. Upon completion of final inspection, County will notify Contractor of all particulars in which this inspection reveals that the Work is incomplete or defective. Contractor shall immediately take such measures as are necessary to complete such Work or remedy such deficiencies. When all such errors have been corrected, a final re-inspection will be made.

The process will be repeated until, in the opinion of County, the Project has been completed in compliance with the terms of the Contract Documents.

When final acceptance has been made by County, County will make final payment of the resulting Contract amount, plus all approved additions, less approved deductions and previous payments made. The resulting Contract will be considered complete when all Work has been finished, the final inspection made, approved as-builts received, and the Project finally accepted in writing by County. The Contractor's responsibility shall then terminate except as otherwise stated.

D.06 CONTRACT CONTINGENCY WORK

This Bid item entails a monetary allowance which is used at County's discretion to handle unexpected conditions as required to satisfactorily complete the Project in accordance with the plans and Specifications. A Field Directive must be issued by an authorized County Representative to authorize use of Contract Contingency funds.

The percentage for Contract Contingency is listed on the Bid Form. Vendor shall enter the amount for Contract Contingency based on the percentage of their Total Base Bid. The total Contract Award will include the Contract Contingency funds.

Appropriate uses of Contract Contingency funds include increases to existing Bid item quantities that do not change the initial Scope of Work, which may be directed by staff; modification items not originally bid which were unforeseen yet necessary during the construction to provide a safe, complete Project and that do not change the initial Scope of Work; and unanticipated conflicts and/or design changes required during construction which are necessary to provide a safe, complete Project and that do not change the initial Scope of Work.

Inappropriate uses of Contract Contingency funds include anything that changes the initial Scope of Work, including the Contract Price and Contract Time, and adding Bid items not previously contemplated that change the initial Scope of Work.

D.07 RETAINAGE

A Retainage of 10% of the total Work in place shall be withheld until 50% complete. After 50% completion, the Retainage shall be reduced to 5% of the total Work in place until Final Completion and acceptance of the Work by County. Upon final acceptance, the remaining Retainage shall be included in the final payment.

D.08 PROGRESS REQUIREMENTS

All Work done under the resulting Contract shall be done with a minimum of inconvenience to the private property owners in the area. The Contractor shall coordinate his Work with private property owners such that existing utility services are maintained and they have access to their property at all times.

D.09 WARRANTY AND GUARANTEE PROVISIONS

All Work, materials, and equipment furnished as defined herein shall be guaranteed and warranted by the Contractor for a minimum period of three (3) years, unless otherwise specified, from final acceptance by County to be free from defects due either to faulty materials or equipment or faulty workmanship.

All materials, equipment, and workmanship furnished and installed by the Contractor is warranted and guaranteed by the Contractor to meet the required standards and to accomplish the purposes and functions of the Project as defined, detailed, and specified herein.

County shall, following discovery thereof, promptly give written notice to the Contractor of faulty materials, equipment, or workmanship within the period of the guarantee and the Contractor shall promptly replace any part of the faulty equipment, material, or workmanship at his own cost. These warranty and guarantee provisions create no limitations on County as to any claims or actions for breach of guaranty or breach of warranty that County might have against parties other than the Contractor, and do not constitute exclusive remedies of County against the Contractor.

D.10 MATERIALS AND WORKMANSHIP

All materials and apparatus required for this Work, except as specified otherwise, shall be new, of first class quality, and shall be furnished, delivered, connected and finished in every detail. Construction shall be prescribed by good industry practice and in accordance with manufacturer's recommendations for the type being installed.

Use skilled workman trained and experienced in the necessary trades and who are completely familiar with the specified requirements and the methods needed for proper performance of the Work of this section.

D.11 PROJECT CLOSE-OUT

Clean construction site and remove any and all excess materials. Correct any damages to property that may have occurred as a result of installation and/or delivery. Repair and patch all surfaces cut for installation. The Contractor shall remedy any deficiencies promptly should County determine any Work is incomplete or defective.

D.11 PROJECT CLOSE-OUT (Continued)

When County determines the Work is acceptable in accordance with this Invitation for Bid, the Contractor shall provide the close out submittals, including but not necessarily limited to the following:

- 1 set Certificate of Warranties
- 1 set Manufacturer's Product Literature (when applicable)
- 1 set Project Record Drawings
- 1 set Subcontractor Information (when applicable)

D.12 ROYALTIES AND PATENTS

The Contractor shall pay all royalties and license fees for equipment or processes in conjunction with the equipment and/or services being furnished. Contractor shall defend all suits or claims for infringement of any patent, trademark or copyright, and shall save County harmless from loss on account thereof, including costs and attorney's fees.

D.13 AUTHORIZED PRODUCT REPRESENTATION

The Bidder, by virtue of submitting the name and Specifications of a manufacturer's product, will be required to furnish the named manufacturer's product. Failure to perform accordingly may, in County's sole discretion, be deemed a Material Breach of the resulting Contract, and shall constitute grounds for County's immediate termination of the resulting Contract.

D.14 REGULATIONS

It shall be the responsibility of the Contractor to assure compliance with any OSHA, EPA and/or other federal or State of Florida rules, regulations or other requirements, as each may apply.

D.15 CANCELLATION

Any failure of the Contractor to furnish or perform the Work (including, but not limited to, commencement of the Work, failure to supply sufficient skilled workers or suitable materials or equipment) in accordance with the resulting Contract, County may order the stop of the Work, or any portion thereof, until the cause for such order has been eliminated. If the Contractor persistently fails to perform the Work in accordance with the resulting Contract, County reserves the right to terminate the resulting Contract and select the next qualified Bidder or re-advertise this procurement in part or in whole. County reserves the right to cancel all or any undelivered or unexecuted portion of the resulting Contract with or without cause.

D.16 INDEMNIFICATION

The Contractor covenants and agrees to indemnify and save harmless County, its agents and employees, from and against all claims, suits, actions, damages, causes of action, or judgments arising out of the terms of the resulting Contract for any personal injury, loss of life, or damage to the property sustained as a result of the performance or non-performance of services or delivery of goods; from and against any orders, judgments, or decrees, which may be entered against County, its agents or employees; and from and against all costs, attorney's fees, expenses and other liabilities incurred in the defense of any such claim, suit or action, and the investigation thereof. Nothing in the resulting Award, Contract or Purchase Order shall be deemed to affect the rights, privileges and immunities of County as set forth in Florida Statutes § 768.28.

D.17 SUBCONTRACTORS, SUPPLIERS AND OTHERS

The identity of Subcontractors, Suppliers, and other persons and organizations (including those who are to furnish the principal items of material and equipment) may be requested by County for each Bid item from any of the Bidders; and the Bidder shall respond within five (5) days after the date of such request. Such list shall be accompanied by an experience statement with pertinent information regarding similar projects and other evidence of qualification for each such Subcontractor, Supplier, persons or organization if requested by County. If County, after due investigation, has reasonable objection to any proposed Subcontractor, Supplier, other person or organization, County may, before the Notice of Intent to Award is given, request the apparent Successful Bidder to submit an acceptable substitute without an increase in Contract Price or Contract Time.

If apparent Successful Bidder declines to make any such substitution, County may Award the resulting Contract to the next lowest qualified Bidder that proposes to use acceptable Subcontractors, Suppliers, and other persons who County does not make written objection to. Contractor shall not be required to employ any Subcontractor, Supplier, other person or organization who Contractor has reasonable objection to.

Subcontractors shall be bound by the terms and conditions of the resulting Contract insofar as it applies to their work, but this shall not relieve the prime Contractor from the full responsibility to County for the proper completion of all Work to be executed under the resulting Contract.

The employment of unauthorized aliens by any Contractor is considered a violation of Section 274 (e) of the Immigration and Employment Act. If the Contractor knowingly employs unauthorized aliens, such violation shall be cause for unilateral cancellation of the resulting Contract.

A complete list of all Subcontractors proposed for any portion of the Work may be requested of any Bidder deemed necessary by County. Subcontracts shall be awarded only to those Subcontractors considered satisfactory by County.

D.18 MANUALS, SCHEMATICS, HANDBOOKS (IF APPLICABLE)

All manuals, schematics and handbooks shall be provided which are applicable to the equipment delivered. An operators manual, parts manual and technician manual must also be provided. Parts lists (manuals) must include OEM part numbers for items not manufactured by the Contractor. Contractor shall furnish two (2) copies of each.

D.19 INSURANCE

The Contractor will not commence Work under the resulting Contract until all insurance under this section and such insurance coverage as might be required by County has been obtained. The Contractor shall obtain, and submit to the Purchasing Division within ten (10) calendar days from the date of Notice of Intent to Award, at his expense, the following minimum amounts of insurance (inclusive of any amounts provided by an umbrella or excess policy):

a. Workers' Compensation/Employers' Liability

Part One - There shall be no maximum limit (other than as limited by the applicable statute) for liability imposed by Florida Workers' Compensation Act or any other coverage required by the resulting Contract Documents which are customarily insured under Part One of the standard Workers' Compensation Policy.

Part Two - The minimum amount of coverage required by the resulting Contract Documents which are customarily insured under Part Two of the standard Workers' Compensation Policy shall be:

(Each Accident)	<u>\$100,000</u>
(Disease-Policy Limit)	<u>\$500,000</u>
(Disease-Each Employee)	<u>\$100,000</u>

b. Commercial General Liability

The limits are to be applicable only to Work performed under the resulting Contract and shall be those that would be provided with the attachment of the Amendment of Limits of Insurance (Designated Project or Premises) endorsement (ISO Form CG 25 03) a Commercial General Liability Policy with the following minimum limits.

General Aggregate:

Products/Completed Operations Aggregate	<u>\$2,000,000</u>
Personal and Advertising Injury	<u>\$1,000,000</u>
Each Occurrence	<u>\$1,000,000</u>
Fire Damage (Any One Fire)	<u>\$Nil</u>
Medical Expense (Any One Person)	<u>\$Nil</u>

ADDITIONAL INSURED: Manatee County, a political subdivision of the State of Florida, shall be specifically named as additional insured on the Commercial General Liability Policy.

D.19 INSURANCE (Continued)

c. Business Auto Policy

Each Occurrence Bodily Injury and Property Damage Liability Combined	<u>\$300,000</u>
Annual Aggregate (if applicable)	<u>\$1,000,000</u>

ADDITIONAL INSURED: Manatee County, a political subdivision of the State of Florida, shall be specifically named as additional insured on the Business Auto Policy.

d. Property Insurance

If the resulting Contract includes construction of or additions to above ground buildings or structures, Contractor shall provide "**Builder's Risk**" insurance with the minimum amount of insurance to be 100% of the value of such addition(s), building(s), or structure(s).

e. Installation Floater

If the resulting Contract does not include construction of or additions to above ground building or structures, **but does involve** the installation of machinery or equipment, Contractor shall provide an "**Installation Floater**" with the minimum amount of insurance to be 100% of the value of such addition(s), building(s), or structure(s).

f. Certificates of Insurance and Copies of Policies

Certificates of Insurance in triplicate evidencing the insurance coverage specified herein shall be filed with the Purchasing Official before operations are begun. The required certificates of insurance shall name the types of policy, policy number, date of expiration, amount of coverage, companies affording coverage, and also shall refer specifically to the Bid number and title of the Project. All insurance policies required herein shall be issued by companies that are authorized to do business under the laws of the State of Florida and hold an A.M. Best rating of A- or better. Insurance, as specified herein, shall remain in force and effect for the duration of the Project including any warranty periods.

g. Complete Policies: The entire and complete insurance policies required herein shall be provided to County on request.

Nothing herein shall in any manner create any liability of County in connection with any claim against the Contractor for labor, services, or materials, or of Subcontractors; and nothing herein shall limit the liability of the Contractor or Contractor's Sureties to County or to any Workers, Suppliers, material men or employees in relation to the resulting Contract.

D.19 INSURANCE (Continued)

- h. By way of its submission of a Bid hereto, Bidder:
1. Represents that Bidder maintains, and will maintain during the term of any Contract arising from this solicitation, insurance coverage from responsible companies duly authorized to do business in the State of Florida and deemed acceptable to County, as set forth in this solicitation; and
 2. Agrees that, insurance should not be cancelled without thirty (30) days notice to County and must be endorsed to provide same. Failure of Bidder to obtain and maintain proper amounts of insurance at all times as called for herein shall constitute a Material Breach of the resulting Contract, which may result in immediate termination.
- i. Certification Requirements – In order for the certificate of insurance to be accepted it **must** comply with the following:
1. The certificate holder shall be:
**Manatee County Board of Commissioners,
A political subdivision of the State of Florida
P.O. Box 1000
Bradenton, FL 34206-1000
IFB# 14-3048CD, Force Main 15D Rehabilitation**
 2. Certificate shall be mailed to:
**Manatee County Purchasing Division
1112 Manatee Avenue West, Suite 803
Bradenton, FL 34205
Attn: Chris Daley, CPPO, CPPB, Contract Specialist**

D.20 BID BOND/CERTIFIED CHECK

By submitting a Bid to this Invitation for Bid, the Bidder agrees should the Bidder's Bid be accepted, **to execute the form of Contract and present the same to Manatee County for approval within ten (10) calendar days after Notice of Intent to Award.** The Bidder further agrees that failure to execute and deliver said form of Contract **within ten (10) calendar days** will result in damages to Manatee County and as guarantee of payment of same a Bid Bond/certified check shall be enclosed within the submitted sealed Bid in the amount of five (5%) percent of the total amount of the Bid. The Bidder further agrees that in case the Bidder fails to enter into a Contract, as prescribed by Manatee County, the Bid Bond/certified check accompanying the Bid shall be forfeited to Manatee County as agreed liquidated damages. If County enters into a Contract with a Bidder, or if County rejects any and/or all Bids, accompanying bond will be promptly returned.

D.21 PERFORMANCE AND PAYMENT BONDS

The Successful Bidder shall furnish Surety bonds using the Public Construction Bond form prescribed in Florida Statutes § 255.05, which is provided herein, as security for faithful performance of the Contract awarded as a result of this Bid and for the payment of all persons performing labor and/or furnishing material in connection therewith. Failure to provide the required bonds on the prescribed form may result in Successful Bidder being deemed nonresponsive. Bonds must be in the form prescribed in Florida Statutes § 255.05, and must not contain notice, demand or other terms and conditions, including informal pre-claim meetings, not provided for in Florida Statutes § 255.05.

Surety of such bonds shall be in an amount equal to 100% of the Contract Award issued by a duly authorized and nationally recognized Surety company, authorized to do business in the State of Florida, satisfactory to this County. Surety shall be rated as "A-" or better as to general policy holders rating and Class V or higher rating as to financial size category and the amount required shall not exceed 5% of the reported policy holders' surplus, all as reported in the most current Best Key Rating Guide, published by A.M. Best Company, Inc. of 75 Fulton Street, New York, New York, 10038. The attorney-in-fact who signs the bonds must file with the bonds, a certificate and effective dated copy of power-of-attorney. Performance and Payment Bonds shall be issued to Manatee County, a political subdivision of the State of Florida, within ten (10) calendar days after Notice of Intent to Award.

In addition, pursuant to Florida Statutes § 255.05(1)(b), prior to commencing Work, the Contractor shall be responsible and bear all costs associated to record the Performance and Payment Bond with the Manatee County Clerk of the Circuit Court. A certified copy of said recording shall be furnished to the Purchasing Division upon filing. Pursuant to Florida Statutes § 255.05(1)(b), County will make no payment to the Contractor until the Contractor has complied with this paragraph.

Furnishing Performance and Payment Bonds shall be requisite to execution of a Contract with County. Said Performance and Payment Bonds will remain in force for the duration of the Contract with the premiums paid by the Contractor. Failure of the Successful Bidder to execute such Contract and to supply the required bonds shall be just cause for cancellation of the Award. County may then contract with another acceptable Bidder or re-advertise this Invitation for Bid. If another Bidder is accepted, and notice given within ninety (90) days after the opening of the Bids, this acceptance shall bind the Bidder as though they were originally the Successful Bidder.

Failure of County at any time to require performance by the Contractor of any provisions set out in the resulting Contract will in no way affect the right of County, thereafter, to enforce those provisions.

When activity occurs within the resulting Contract that increases the amount of the Contract by either an approved Administrative Contract Adjustment (ACA) or an approved Change Order, a recorded Bond Rider shall be provided before the additional Work can proceed. All premiums shall be paid by the Contractor.

D.22 NO DAMAGES FOR DELAY

No claim for damages or any claim other than for an extension of time shall be made or asserted against County by reason of any delays. The Contractor shall not be entitled to an increase in the total Contract Price or payment or compensation of any kind from County or direct, indirect, consequential impact or other costs, expenses for damages, including but not limited to costs of acceleration or inefficiency arising because of delay, disruption, interference or hindrance from any cause whatsoever; provided, however, that this provision shall not preclude recovery or damages by the Contractor for hindrance or delays due solely to fraud, bad faith, or active interference on part of County or its agents. Otherwise, the Contractor shall only be entitled to extensions of the Contract Time as the sole and exclusive remedy for such resulting delay, in accordance with and to the extent specifically provided above.

D.23 NO INTEREST

Any monies not paid by County when claimed to be due to the Contractor under this Contract shall not be subject to interest including prejudgment interest. Any monies not paid by County when claimed to be due to the Contractor for damages awarded in the case of construction delays shall not be subject to prejudgment interest.

D.24 CONSTRUCTION OF CONTRACT

The resulting Contract and the rights and responsibilities hereunder shall not be construed more strongly against either party, regardless of the extent to which such party may have participated in the preparation hereof.

D.25 BE GREEN

All Contractors are encouraged to use as many **environmentally preferable** "green" products, materials, supplies, etc. as possible in order to promote a safe and healthy environment. **Environmentally preferable are products or services that have a reduced adverse effect on the environment.** Provide detail of your organization's initiative and its ability to meet the goal of environmental sustainability.

END OF SECTION D

SECTION E
GENERAL CONDITIONS

ARTICLE 1. DEFINITIONS

Whenever used in the Contract Documents, the following terms have the meaning indicated which are applicable to both the singular and plural thereof:

Addendum - Written or graphic instruments issued prior to the opening of Bids which clarify or change the Bid Documents.

Administrative Contract Adjustment (ACA) – A minor change to a Contract, which is less than 10% of the Contract Price or less than 20% of the Contract Time, and does not require Board approval. (Reference Resolution R-07-189)

Application for Payment - The form accepted by the Project Representative which is to be used by Contractor in requesting progress or final payments and which is to include such supporting documentation as is required by the Contract Documents.

Award - Acceptance of the Bid from the person, firm, or corporation which in the County's sole and absolute judgment will under all circumstances best serve the public interest. Award shall be made in accordance with Chapter 2-26 of the Manatee County Code.

Bid - The Offer of the Bidder submitted on the prescribed form setting forth the prices for the Work to be performed.

Bid Bond – An insurance agreement, accompanied by a monetary commitment, by which a third party (the Surety) accepts liability and guarantees that the Bidder will not withdraw the Bid.

Bidder - One who submits a Bid directly to the County, as distinct from a Sub-bidder, who submits a Bid to a Bidder.

Bid Documents - Consists of the Invitation for Bid, which includes but is not limited to the Bid Form, drawings, technical Specifications, terms and conditions, and the proposed Contract Documents (including all Addenda issued prior to receipt of Bids); and becomes a part of the resulting Contract.

Bid Summary – Specifications or scope of Work that specifically describes the Work to be done for this Project.

Bond Rider – A Bond Rider increases the Performance Bond coverage to ensure responsibility of the Contractor in executing the Work for the County in consideration of the increased value resulting from an approved change in the Contract amount.

Change Order - A document recommended by the Project Representative which is signed by Contractor and County and authorizes an addition, deletion, or revision in the Work or an adjustment in the Contract Price or the Contract Time, issued on or after the Effective Date of the Contract.

Compensable Delay - Any delay beyond the control and without the fault or negligence of the Contractor resulting from County-caused changes in the Work, differing site conditions, suspensions of the Work, or termination for convenience by County.

Contract - The written Contract between County and Contractor covering the Work to be performed; other Contract Documents are attached to the Contract and made a part thereof as provided therein.

Contract Contingency - A monetary allowance used at the County's discretion, which is part of the total sum of the Contract that allows for minor changes in the Contract that do not change the initial Scope of Work, including Contract Price and Contract Time.

Contract Documents - The Contract, Invitation for Bid in its entirety, Public Construction Bond Form and Insurance Certificate(s), Drawings/Plans, Addenda (which pertain to the Bid Documents), Contractor's Bid Form (including documentation accompanying the Bid and any post-Bid documentation submitted prior to the Notice of Award), and Reports, together with all written Change Orders and other documents amending, modifying or supplementing the Contract Documents issued on or after the Effective Date of the Contract.

Contract Price - The monies payable by County to Contractor under the Contract Documents as stated in the Contract.

Contract Time - The number of days or the date stated in the Notice to Proceed for the completion of the Work.

Contractor - The person, firm or corporation with whom County has entered into a Contract.

Days - All references to days are to be considered calendar days except as specified differently.

Defective - An adjective which when modifying the Work refers to work that is unsatisfactory, faulty or deficient, or does not conform to the Contract Documents, or does not meet the requirements of any inspection, reference standard, test or approval referred to in the Contract Documents, or has been damaged prior to Project Representative's recommendation of final payment (unless responsibility for the protection thereof has been assumed by County).

Drawings - The drawings which show the character and Scope of Work to be performed and which have been prepared or approved by Engineer and are referred to in the Bid and Contract Documents.

Effective Date of the Contract - The date indicated in the Contract on which it becomes effective (date of execution).

Engineer – Licensed professional who is responsible for the preparation, signing, dating, sealing and issuing of any engineering document(s) for any engineering service or Work.

Excusable Delay - Any delay beyond the control and without the negligence of the Contractor, the County, or any other Contractor caused by events or circumstances such as, but not limited to, acts of God or of the public enemy, fires, floods, freight embargoes, acts of government other than County or epidemics. Labor disputes and above average rainfall shall give rise only to Excusable Delays.

Field Directive - A written order issued by an authorized County Representative which approves changes in the Work, but does not involve a change in the initial Scope of Work, including the Contract Price and the Contract Time. A Field Directive must be issued by an authorized County Representative to authorize use of Contract Contingency funds.

Final Completion – The Work (including items defined on the Punch List) has been completed, accepted in writing by the County, approved as-builts have been received, and is ready for final payment.

Float or Slack Time - The time available in the progress schedule during which an unexpected activity can be completed without delaying Substantial Completion of the Work.

Inexcusable Delay - Any delay caused by events or circumstances within the control of the Contractor, such as inadequate crewing, slow submittals, etc., which might have been avoided by the exercise of care, prudence, foresight, or diligence on the part of the Contractor.

Information (Pre-Bid) Conference – A meeting held by the Purchasing Division with potential Bidders, prior to the opening of the solicitation, for the purpose of answering questions, clarifying ambiguities, and responding to general issues in order to establish a common basis for understanding all of the requirements of the solicitation; may result in the issuance of an Addendum.

Material Breach – A substantial failure in the performance of the Contract, as to give the affected party the right to remedies available in the Contract.

Non-prejudicial Delay - Any delay impacting a portion of the Work within the available total Float or Slack Time and not necessarily preventing completion of the Work within the Contract Time.

Notice of Award - The written notice to the Successful Bidder stating Award has been approved by the Board of County Commissioners; or by the Purchasing Official in accordance with Chapter 2-26 of the Manatee County Code.

Notice of Intent to Award - The written notice to the apparent Successful Bidder stating Award has been recommended with final Award to be authorized by the Purchasing Official or Board of County Commissioners, as appropriate.

Notice to Proceed - Written notice by County (after execution of Contract) to Contractor fixing the date on which the Contract Time will commence to run and on which Contractor shall start to perform (ten (10) days from date of such notice) Contractor's obligations under the Contract Documents.

Payment Bond – An instrument, issued by a Surety that guarantees that Subcontractors will be paid for labor expended on the Contract.

Performance Bond – An instrument executed subsequent to Award by the successful Contractor that protects the County from loss due to Contractor's inability to complete the Contract as agreed.

Preconstruction Conference - Prior to starting the Work, a meeting scheduled by County with Contractor to review the Work schedules, to establish procedures for handling Shop Drawings and other submissions, for processing periodical pay estimates, and such other matters as may be pertinent to the project.

Prejudicial Delay - Any excusable or Compensable Delay impacting the Work and exceeding the total float time available in the progress schedule, thus preventing completion of the Work within the Contract Time unless the Work is accelerated.

Pre-operation Testing - All field inspections, installation checks, water tests, performance tests and necessary corrections required of Contractor to demonstrate that individual components of the Work have been properly constructed and do operate in accordance with the Contract Documents for their intended purposes.

Project - The total construction of which the Work to be provided under the Contract Documents (may be the whole or a part as indicated elsewhere in the Contract Documents).

Project Representative - The authorized representative of Manatee County who is assigned to the project or any part thereof.

Punch List – A list of minor deficiencies or additional Work that does not prohibit achieving Substantial Completion yet must be completed before Final Completion of the Contract can be achieved.

Retainage – A certain percentage, identified in the solicitation document, is withheld from payment due to the Contractor until the Work is fully completed and accepted by County.

Schedule of Values – In the case of a total, lump sum Bid, unit prices shall be established for this Contract by the submission of a Schedule of Values. In the case of an itemized Bid, unit prices are the prices bid. The Contractor shall submit a Schedule of Values within ten (10) days of Notice to Proceed date. The schedule shall include quantities and prices of items equaling the Total Offer and will subdivide the Work into components in sufficient detail to serve as the basis for progress payments during construction. Such prices will include an appropriate amount of overhead and profit applicable to each item of Work. Upon request of the County, the Contractor shall support the values with data which will substantiate their correctness.

Shop Drawings - All drawings, diagrams, illustrations, schedules and other data which are specifically prepared by or for Contractor to illustrate some portion of the Work and all illustrations, brochures, standard schedules, performance charts, instructions, diagrams and other information prepared by a Supplier and submitted by Contractor to illustrate material or equipment for some portion of the Work.

Special Provisions: As required to define Work or procedures not covered in the standard Specifications, and as necessary to supplement or modify items in the standard Specifications.

Subcontractor - An individual or corporation having a direct contact with Contractor or with any other Subcontractor for the performance of a part of the Work at the site. Such person or firm has contractual relations with the Contractor, not with the County.

Substantial Completion - The stage in the progress of the Work (or a specified portion thereof) is sufficiently complete in accordance with the Contract Documents so the Work (or a specified portion thereof) can be utilized for the intended purpose.

Successful Bidder - The lowest, responsible and responsive Bidder to whom an Award is made.

Supplier - A manufacturer, fabricator, Supplier, distributor, material man or vendor.

Surety – A pledge or guarantee by an insurance company, bank, individual or corporation on behalf of the Bidder which protects against default or failure of the principal to satisfy the contractual obligations.

Underground Facilities - All pipelines, conduits, ducts, cables, wires, manholes, vaults, tanks, tunnels or other such facilities or attachments and any encasement containing such facilities which have been installed underground to furnish any of the following services or materials: electricity, gases, steam, liquid petroleum products, telephone or other communications, cable television, sewage and drainage removal, traffic or other control systems or water.

Unit Price Work - Work to be paid for on the basis of unit prices.

Work - The entire completed construction or the various separately identifiable parts thereof required to be furnished under the Contract Documents. Work is the result of performing services, furnishing labor and furnishing and incorporating materials and equipment into the construction, all as required by the Contract Documents.

Work Directive Change - A written directive to Contractor, issued on or after the Effective Date of the Contract and signed by County and recommended by Project Representative ordering an addition, deletion or revision in the Work, or responding to differing or unforeseen physical conditions under which the Work is to be performed or to emergencies. A Work Directive Change itself may not change the Contract Price or Contract Time; but is evidence that the parties expect that the change directed or documented by a Work Directive Change will be incorporated in a subsequently issued Change Order following negotiations by the parties as to its effect, if any, on the Contract Price or Contract Time.

Written Amendment - A Written Amendment of the Contract Documents, signed by County and Contractor on or after the Effective Date of the Contract and normally dealing with the non-engineering or non-technical rather than strictly Work related aspects of the Contract Documents.

ARTICLE 2. PRELIMINARY MATTERS

Computation of Time: When time is referred to in the Contract Documents by days, it will be computed to exclude the first and include the last day of such period. If the last day of any such period falls on a Saturday or Sunday or legal holiday, such day will be omitted from the computation.

- 2.1 The Contractor must submit a proposed schedule of the Work at the Preconstruction Conference. The purpose of this schedule is to enable the County to govern the Work, to protect the functions of the local government and its citizens and to aid in providing appropriate surveillance. The County shall have the right to reschedule Work provided such rescheduling is in accordance with the remainder of the terms of the Contract. The schedule shall show, as a minimum, the approximate dates on which each segment of the Work is expected to be started and finished, the proposed traffic flows during each month, the anticipated earnings by the Contractor for each month and the approximate number of crews and equipment to be used. The County, after necessary rescheduling and obtaining additional information for specific

purposes, shall review and approve the schedule. The Contractor shall also forward to the County, as soon as practicable after the first day of each month, a summary report of the progress of the various parts of the Work under the Contract, in fabrication and in the field, stating the existing status, estimated time of completion and cause of delay, if any. Together with the summary report, the Contractor shall submit any necessary revisions to the original schedule for the County's review and approval. In addition, more detailed schedules may be required by the County for daily traffic control.

- 2.2 A Notice to Proceed may be given at any time within thirty (30) days after the Effective Date of the Contract. The Contract Time will commence at the time specified in such notice. Contractor shall start to perform the Work on the date specified in the Notice to Proceed, but no Work shall be done at the site prior to the date on which the Contract Time commences to run.
- 2.3 If at any time the materials and appliances to be used appear to the County as insufficient or improper for securing the quality of Work required or the required rate of progress, the County may order the Contractor to increase his efficiency or to improve the character of his Work and the Contractor shall conform to such an order. The failure of the County to demand any increase of such efficiency of any improvement shall not release the County from its obligation to secure the quality of Work or the rate of progress necessary to complete the Work within the limits imposed by the Contract. The County may require the Contractor to remove from the Work such employees as the County deems incompetent, careless, insubordinate or otherwise objectionable, or whose continued employment on the Work is deemed to be contrary to the County's interest.
- 2.4 The County reserves the right to let other Contracts in connection with this Work. The Contractor shall afford other Contractors reasonable opportunity for the introduction and storage of their materials and execution of their Work, and promptly connect and coordinate the Work with theirs.

ARTICLE 3. CONTRACT DOCUMENTS: INTENT, AMENDING, RE-USE

- 3.1 The Contract Documents comprise the entire Contract between County and Contractor concerning the Work. The Contract Documents are complementary; what is called for by one is as binding as if called for by all. The Contract Documents will be construed in accordance with the laws and ordinances of the State of Florida and Manatee County.

Should a conflict exist within the Contract Documents, the precedence in order of authority is as follows: 1) Bid Summary, 2) Special Conditions, 3) General Conditions, and 4) Drawings.

Note: Computed dimensions shall govern over scaled dimensions.

- 3.2 It is the intent of the Contract Documents to describe a functionally complete project (or part thereof) to be constructed in accordance with the Contract Documents. Any work, materials or equipment that may reasonably be inferred from the Contract Documents as being required to produce the intended result will be supplied whether or not specifically called for in the Contract Documents. When words which have a well-known technical or trade meaning are used to describe Work, materials, or equipment, such words shall be interpreted in accordance with that meaning. Reference to standard Specifications, manuals or codes of any technical society, organization or association, or to the laws or regulations of any governmental authority, whether such reference be specific or by implication, shall mean the latest standard specification, manual, code or laws or regulations in effect at the time of opening of Bids, except as may be otherwise specifically stated. However, no provision of any referenced standard specification, manual or code (whether or not specifically incorporated by reference in the Contract Documents) shall be effective to change the duties and responsibilities of County, Contractor or Engineer, or any of their agents or employees from those set forth in the Contract Documents.
- 3.3 The Contract Documents may be amended to provide for additions, deletions and revisions in the Work or to modify the terms and conditions thereof in one or more of the following ways:
- 3.3.1 A Written Amendment
 - 3.3.2 A Change Order
 - 3.3.3 An Administrative Contract Adjustment (ACA)
 - 3.3.4 A Work Directive Change
- 3.4 In addition, the requirements of the Contract Documents may be supplemented and minor variations and deviations in the Work may be authorized in one or more of the following ways:
- 3.4.1 Contract Contingency Work – Field Directive
 - 3.4.2 Engineer's approval of a Shop Drawing or sample

ARTICLE 4. CONTRACTOR'S RESPONSIBILITIES

- 4.1 Contractor shall keep on the Work at all times during its progress a competent resident superintendent; who shall be the Contractor's representative at the site and shall have authority to act on behalf of Contractor. All communications given to the superintendent shall be as binding as if given to Contractor.
- 4.2 Contractor shall provide competent, suitable qualified personnel to survey and lay out the Work and perform construction as required by the Contract

Documents. Contractor shall at all times maintain good discipline and order at the site. Except in connection with the safety or protection of persons or the Work or property at the site or adjacent thereto and except as otherwise indicated in the Contract Documents, all Work at the site shall be performed during regular working hours and Contractor will not permit overtime Work or the performance of Work on Saturday, Sunday or legal holiday without County's written consent given after prior notice to Engineer (at least seventy-two (72) hours in advance).

- 4.2.1 Contractor shall pay for all additional engineering charges to the County for any overtime Work which may be authorized. Such additional engineering charges shall be a subsidiary obligation of Contractor and no extra payment shall be made by County on account of such overtime Work. At County's option, overtime costs may be deducted from Contractor's monthly payment request or Contractor's Retainage prior to release of final payment.
- 4.3 Unless otherwise specified, Contractor shall furnish and assume full responsibility for all bonds, insurance, materials, equipment, labor, transportation, construction equipment and machinery, tools, appliances, fuel, power, light, heat, telephone, water, sanitary facilities, temporary facilities and all other facilities and incidentals necessary for the furnishing, performance, testing, start-up and completion of the Work.
- 4.4 All materials and equipment shall be of good quality and new, except as otherwise provided in the Contract Documents. If required by Engineer, Contractor shall furnish satisfactory evidence (including reports of required tests) as to the kind and quality of materials and equipment. All materials and equipment shall be applied, installed, connected, erected, used, cleaned and conditioned in accordance with the instruction of the applicable Supplier except as otherwise provided in the Contract Documents.
- 4.5 Contractor shall be fully responsible to County for all acts and omissions of the Subcontractors, Suppliers and other persons and organizations performing or furnishing any of the Work under a direct or indirect Contract with Contractor just as Contractor is responsible for Contractor's own acts and omissions. Nothing in the Contract Documents shall create any contractual relationship between County or Engineer and any such Subcontractor, Supplier or other person or organization, nor shall it create any obligation on the part of County to pay or to see to the payment of any monies due any such Subcontractor, Supplier or other person or organization.
- 4.6 Permits: Unless otherwise provided, Contractor shall obtain and pay for all construction permits and licenses. County shall assist Contractor, when necessary, in obtaining such permits and licenses. Contractor shall pay all

governmental charges and inspection fees necessary for the prosecution of the Work.

- 4.7 During the progress of the Work, Contractor shall keep the premises free from accumulation of waste materials rubbish and other debris resulting from the Work. At the completion of the Work, Contractor shall remove all waste materials, rubbish, and debris from and about the premises as well as all tools, appliances, construction equipment and machinery and surplus materials and shall leave the site clean and ready for occupancy by County. Contractor shall restore to original conditions all property not designated for alteration by the Contract Documents.
- 4.8 Contractor shall not load nor permit any part of any structure to be loaded in any manner that will endanger the structure, nor shall Contractor subject any part of the Work or adjacent property to stresses or pressures that will endanger it.
- 4.9 Safety and Protection: Contractor shall comply with the Florida Department of Commerce Safety Regulations and any local safety regulations. Contractor shall be responsible for initiating, maintaining and supervising all safety precautions and programs in connection with the Work. Contractor shall take all necessary precautions for the safety of and shall provide the necessary protection to prevent damage, injury or loss to:
- 4.9.1 all employees on the Work and other persons and organizations who may be affected thereby;
- 4.9.2 all the Work and materials and equipment to be incorporated therein, whether in storage on or off the site; and
- 4.9.3 other property at the site or adjacent thereto, including trees, shrubs, lawns, walks, pavements, roadways, structures, utilities and Underground Facilities not designated for removal, relocation or replacement in the course of construction.
- 4.9.4 Contractor shall comply with all applicable laws and regulations of any public body having jurisdiction for the safety of persons or property or to protect them from damage, injury or loss; and shall erect and maintain all necessary safeguards for such safety and protection. Contractor shall provide and maintain all passageways, guard fences, lights and other facilities for the protection required by public authority or local conditions. Contractor shall provide reasonable maintenance of traffic way for the public and preservation of the County's business, taking into full consideration all local conditions. Contractor's duties and responsibilities for the safety and protection of the Work shall continue until such time as all the Work is completed.

- 4.10 Emergencies: In emergencies affecting the safety or protection of persons or the Work or property at the site or adjacent thereto, Contractor, without special instruction or authorization from Engineer or County, is obligated to act to prevent threatened damage, injury or loss. Contractor shall give County prompt written notice if Contractor believes that any significant changes in the Work or variations from the Contract Documents have been caused thereby. If County determines that a change in the Contract Documents is required because of the action taken in response to an emergency, a Work Directive Change or Change Order will be issued to document the consequences of the changes or variation.
- 4.11 For substitutes not included with the Bid, but submitted after the Effective Date of the Contract, Contractor shall make written application to Engineer for acceptance thereof, certifying that the proposed substitute will perform adequately the functions and achieve the results called for by the general design, be similar and of equal substance to that specified and be suited to the same use as that specified. The application will also contain an itemized estimate of all costs and delays or schedule impacts that will result directly or indirectly from review, acceptance and provisions of such substitute, including costs of redesign and claims of other Contractors affected by the resulting change, all of which will be considered by the Engineer in evaluating the proposed substitute. Engineer may require Contractor to furnish at Contractor's expense, additional data about the proposed substitute. In rendering a decision, County/Engineer and Contractor shall have access to any available Float or Slack Time in the construction schedule. In the event that substitute materials or equipment not included as part of the Bid, but proposed after the Effective Date of the Contract, are accepted and are less costly than the originally specified materials or equipment, then the net difference in cost shall be credited to the County and an appropriate Change Order executed.
- 4.11.1 If a specific means, method, sequence, technique or procedure of construction is indicated in or required by the Contract Documents, Contractor may furnish or utilize a substitute means, method, sequence, technique or procedure of construction acceptable to Engineer if Contractor submits sufficient information to allow Engineer to determine that the substitute proposed is equivalent to that indicated or required by the Contract Documents.
- 4.11.2 Engineer will be allowed a reasonable time within which to evaluate each proposed substitute. Engineer will be the sole judge of acceptability and no substitute will be ordered, installed or utilized without Engineer's prior written acceptance which will be evidenced by either a Change Order or an approved shop drawing. County may require Contractor to furnish at Contractor's expense a special performance guarantee or other Surety with respect to any substitute.

- 4.11.3 Contractor shall reimburse County for the charges of Engineer and Engineer's consultants for evaluating each proposed substitute submitted after the Effective Date of the Contract and all costs resulting from any delays in the Work while the substitute was undergoing review.
- 4.12 The Contractor shall furnish, free of charge, all labor, stakes, surveys, batter boards for structures, grade lines and other materials and supplies and shall set construction stakes and batter boards for establishing lines, position of structures, slopes and other controlling points necessary for the proper prosecution of the construction Work. Where rights-of-way, easements, property lines or any other conditions which make the lay-out of the project or parts of the project critical are involved, the Contractor will employ a competent surveyor who is registered in the State of Florida for lay-out and staking. These stakes and marks shall constitute the field control by and in accord with which the Contractor shall govern and execute the Work. The Contractor will be held responsible for the preservation of all stakes, marks and if for any reason any of the stakes or marks or batter boards become destroyed or disturbed, they will be immediately and accurately replaced by the Contractor.
- 4.13 The Contractor has, by careful examination, satisfied himself as to the nature and location of the Work and all other matters which can in any way affect the Work under this Contract, including, but not limited to details pertaining to boring, as shown on the drawings, are not guaranteed to be more than a general indication of the materials likely to be found adjacent to holes bored at the site of the Work, approximately at the locations indicated. The Contractor shall examine boring data, where available, and make his own interpretation of the subsoil investigations and other preliminary data, and shall base his Bid on his own opinion of the conditions likely to be encountered. In no event shall an extension of time be considered for any conditions that existed at the time of bidding, nor shall the Contractor receive extra compensation for completion of the project as intended by the drawings and in keeping with the Contact documents. No verbal agreement or conversation with any officer, agent or employee of the County, before or after the execution of this Contract, shall affect or modify any of the terms or obligations herein contained.
- 4.14 If the Contractor, in the course of the Work, finds that the drawings and/or Contract Documents cannot be followed, he shall immediately inform the County in writing, and the County shall promptly check the accuracy of the information. Any Work done after such discovery, until any necessary changes are authorized, will be done at the Contractor's risk.

ARTICLE 5. COUNTY'S RESPONSIBILITIES

- 5.1 County shall furnish the data required of County under the Contract Documents promptly and shall make payments to the Contractor within a reasonable time after the Work has been accepted by the County. Payment shall be made no more than twenty (20) business days if County is its own Engineer of Record or twenty-five (25) business days if outside agent approval is required after the pay estimate has been approved by the agent for the County. The form of all submittals, notices, Change Orders and other documents permitted or required to be used or transmitted under the Contract Documents shall be determined by the County/Engineer. Standard County forms shall be utilized.
- 5.2 The County shall provide the lands upon which the Work under this Contract is to be done, except that the Contractor shall provide all necessary additional land required for the erection of temporary construction facilities and storage of his materials, together with right of access to same.
- 5.3 The County shall have the right to take possession of and use any completed portions of the Work, although the time for completing the entire Work or such portions may not have expired, but such taking possession and use shall not be deemed an acceptance of any Work not completed in accordance with the Contract Documents.

ARTICLE 6. CHANGES IN THE WORK

- 6.1 Without invalidating the Contract and without notice to any Surety, County may, at any time, order additions, deletions or revisions in the Work. These will be authorized by a Written Amendment, a Change Order, or a Work Directive Change. Upon receipt of any such document, Contractor shall promptly proceed with the Work involved which will be performed under the applicable conditions of the Contract Documents (except as otherwise specifically provided).
- 6.2 Contractor shall not be entitled to an increase in the Contract Price or an extension of the Contract Time with respect to any Work performed that is not required by the Contract Documents as amended, modified and supplemented.
- 6.3 County and Contractor shall execute appropriate Change Orders, or Written Amendments, covering changes in the Work which are ordered by County, or which may be required because of acceptance of defective Work.
- 6.4 At any time Engineer may request a quotation from Contractor for a proposed change in the Work and within twenty-one (21) calendar days after receipt, Contractor shall submit a written and detailed proposal for an increase or decrease in the Contract Price or Contract Time for the proposed change. Engineer shall have twenty-one (21) calendar days after receipt of the detailed proposal to respond in writing. The proposal shall include an itemized estimate of all costs and time for performance that will result directly or indirectly from the proposed change. Unless otherwise directed, itemized estimates shall be in

sufficient detail to reasonably permit an analysis by Engineer of all material, labor, equipment, subcontracts, overhead costs and fees, and shall cover all Work involved in the change, whether such Work was deleted, added, changed or impacted. Notwithstanding the Request for Quotation, Contractor shall carry on the Work and maintain the progress schedule. Delays in the submittal of the written and detailed proposal will be considered non-prejudicial.

ARTICLE 7. CHANGE OF CONTRACT PRICE

- 7.1 The Contract Price constitutes the total compensation (subject to authorized adjustments) payable to Contractor for performing the Work. All duties, responsibilities and obligations assigned to or undertaken by Contractor shall be at his expense without change in the Contract Price.
- 7.2 The Contract Price may only be changed by Change Order or by a Written Amendment. Any claim for an increase or decrease in the Contract Price shall be based on written notice delivered by the party making the claim to the other party. Notice of the amount of the claim with supporting data shall be delivered within ten (10) days from the beginning of such occurrence and shall be accompanied by claimant's written statement that the amount claimed covers all known amounts (direct, indirect and consequential) to which the claimant is entitled as a result of the occurrence of said event.
- 7.3 The value of any Work covered by a Change Order or of any claim for an increase or decrease in the Contract Price shall be determined in one of the following ways, at the County's discretion:
- 7.3.1 Where the Work involved is covered by unit prices contained in the Contract Documents, cost will be determined by application of such unit prices to the quantities of the items involved.
- 7.3.2 By mutual acceptance of lump sum.
- 7.3.3 On the basis of the cost of the Work, plus a 15% Contractor's fee for overhead and profit. (Contractor shall submit an itemized cost breakdown together with supporting data.)
- 7.4 Either County or Contractor may make a claim for an adjustment in the Contract Price. The unit price of an item of Unit Price Work shall be subject to re-evaluation and adjustment under the following conditions:
- 7.4.1 If the total cost of a particular item of Unit Price Work amounts to 5% or more of the Contract Price and the variation in the quantity of the particular item of Unit Price Work performed by Contractor differs by more than 15% from the estimated quantity of such item indicated in the Contract; and

- 7.4.2 If there is no corresponding adjustment with respect to any other item of Work; and
- 7.4.3 If a Contractor believes that it has incurred additional expense as a result thereof; or
- 7.4.4 If County believes that the quantity variation entitles it to an adjustment in the unit price; or
- 7.4.5 If the parties are unable to agree as to the effect of any such variations in the quantity of Unit Price Work performed.

ARTICLE 8. CHANGE OF CONTRACT TIME

- 8.1 Contract Time may only be changed by a Change Order or a Written Amendment. Any claim for an extension or shortening of the Contract Time shall be based on written notice delivered by the party making the claim to the other party. Notice of the extent of the claim with supporting data shall be delivered within fifteen (15) days from detection or beginning of such occurrence and shall be accompanied by the claimant's written statement that the adjustment claimed is the entire adjustment to which the claimant has reason to believe it is entitled as a result of the occurrence of said event.
- 8.2 The Contract Time will be extended in an amount equal to time lost due to delays beyond the control of Contractor. Such delays shall include, but not be limited to, acts or neglect by County or others performing additional Work; or to fires, floods, epidemics, abnormal weather conditions or acts of God.
- 8.3 All time limits stated in the Contract Documents are of the essence.

ARTICLE 9. WARRANTY, TEST/INSPECTION, CORRECTION

- 9.1 Contractor warrants, for a minimum period of three (3) years or as otherwise stated herein, and guarantees to County that all Work will be in accordance with the Contract Documents and will not be defective; that County, representatives of County, and governmental agencies with jurisdictional interests will have access to the Work at reasonable time for their observation, inspecting and testing (Contractor shall give Engineer timely notice of readiness of the Work for all required approvals and shall assume full responsibility, including costs, in obtaining required tests, inspections, and approval certifications and/or acceptance, unless otherwise stated by County).
- 9.2 If any Work (including work of others) that is to be inspected, tested, or approved is covered without written concurrence of Engineer, it must, if requested by Engineer, be uncovered for observation. Such uncovering shall be at Contractor's expense unless Contractor has given Engineer timely notice of Contractor's intention to cover the same and Engineer has not acted with reasonable promptness in response to such notice. Neither observations by

Engineer nor inspections, tests, or approvals by others shall relieve Contractor from Contractor's obligations to perform the Work in accordance with the Contract Documents.

- 9.3 If the Work is defective, or Contractor fails to supply sufficient skilled workers, or suitable materials or equipment, or fails to furnish or perform the Work in such a way that the completed Work will conform to the Contract Documents, County may order Contractor to stop the Work, or any portion thereof and terminate payments to the Contractor until the cause for such order has been eliminated. Contractor shall bear all direct, indirect and consequential costs for satisfactory reconstruction or removal and replacement with non-defective Work, including, but not limited to fees and charges of engineers, architects, attorneys and other professionals and any additional expenses experienced by County due to delays to other Contractors performing additional Work and an appropriate deductive Change Order shall be issued. Contractor shall further bear the responsibility for maintaining schedule and shall not be entitled to an extension of the Contract Time and the recovery of delay damages due to correcting or removing defective Work.
- 9.3.1 If Contractor fails within seven (7) days after written notice to correct defective Work, or fails to perform the Work in accordance with the Contract Documents, or fails to comply with any other provision of the Contract Documents, County may correct and remedy any such deficiency to the extent necessary to complete corrective and remedial action. County may exclude Contractor from all or part of the site, take possession of all or part of the Work, Contractor's tools, construction equipment and machinery at the site or for which County has paid Contractor but which are stored elsewhere. All direct and indirect costs of County in exercising such rights and remedies will be charged against Contractor in an amount approved as to reasonableness by Engineer and a Change Order will be issued incorporating the necessary revisions.
- 9.3.2 If within three (3) years after the date of completion or such longer period of time as may be prescribed by laws or regulations or by the terms of any applicable special guarantee required by the Contract Documents, any Work is found to be defective, Contractor shall promptly, without cost to County and in accordance with County's written instructions, either correct such defective Work or if it has been rejected by County, remove it from the site and replace it with non-defective Work. If Contractor does not promptly comply with the terms of such instruction, County may have the defective Work corrected or removed and all direct, indirect and consequential costs of such removal and replacement will be paid by Contractor.

ARTICLE 10. SUSPENSION OR TERMINATION OF WORK

- 10.1 County reserves the right to suspend the Work, or any portion thereof, at any time without cause for a period not to exceed ninety (90) days by written notice to Contractor, which will fix the date on which Work will be resumed. Contractor shall be allowed an increase in the Contract Price or an extension of the Contract Time, or both, directly attributable to any suspension if Contractor makes an approved claim therefore.
- 10.1.1 If Work is suspended by County for a period that exceeds ninety (90) days; or if Work is suspended by an order of court or other public authority; or if County fails to pay Contractor, then Contractor may, upon seven (7) days written notice to County, terminate the Contract and recover payment for all Work executed.
- 10.1.2 In lieu of terminating the Contract, if the Engineer has failed to act on any Application for Payment or County has failed to make any payment as aforesaid, Contractor may, upon seven (7) days written notice to County, stop the Work until payment of all amounts then due have been received.
- 10.2 County reserves the right, after giving seven (7) days written notice, to terminate this Contract if:
- 10.2.1 Contractor persistently fails to perform the Work in accordance with the Contract Documents;
- 10.2.2 Contractor disregards laws or regulations of any public body having jurisdiction;
- 10.2.3 Contractor commences a voluntary case under any chapter of the Bankruptcy Code or any similar action by filing a petition under any other federal or state law relating to bankruptcy or insolvency;
- 10.2.4 Contractor has a petition filed against them under any chapter of the Bankruptcy Code or similar relief under any other federal or state law;
- 10.3 County may exclude Contractor from the site and take possession of the Work and of all Contractor's tools, construction equipment and machinery at the site and use same to the full extent they could be used (without liability to Contractor for trespass or conversion); incorporate in the Work all materials and equipment stored at the site or for which County has paid Contractor but which are stored elsewhere, and finish the Work as County may deem expedient.
- 10.3.1 Contractor shall not be entitled to receive any further payment beyond an amount equal to the value of material and equipment not incorporated in the Work, but delivered and suitably stored, less the aggregate of payments previously made.

- 10.3.2 If the direct, indirect and consequential costs of completing the Work exceed the unpaid balance of the Contract Price, Contractor shall pay the difference to County. Such costs incurred by County shall be verified by County and incorporated in a Change Order; but in finishing the Work, County shall not be required to obtain the lowest figure for the Work performed. Contractor's obligations to pay the difference between such costs and such unpaid balance shall survive termination of this Contract.
- 10.4 In the event sufficient budgeted funds are not available for a new fiscal year, County shall notify Contractor of such occurrence and Contract shall terminate on the last day of the current fiscal year without penalty or expense to County.
- 10.5 Failure of Contractor to comply with any of the provisions of this Contract shall be considered a Material Breach of Contract and shall be cause for immediate termination of Contract at the discretion of County.
- 10.6 In addition to all other legal remedies available to County, County reserves the right to terminate and obtain from another source, any commodities or services which have not been delivered within the Contract Time as stated in the Contract Documents.

ARTICLE 11. CONTRACT CLAIMS & DISPUTES

- 11.1 Except as otherwise provided herein, any dispute arising under this Contract shall be decided by the Purchasing Official in accordance with Section 2-26-63 of the Manatee County Code subject to an administrative hearing process provided in 2-26-64. The decision of the Board of County Commissioners in accordance with Section 2-26-64 of the Manatee County Code shall be the final and conclusive County decision subject to exclusive judicial review in the circuit court by a petition for certiorari.

ARTICLE 12. RESIDENT PROJECT REPRESENTATIVE - DUTIES, RESPONSIBILITIES

- 12.1 The Resident Project Representative is the Engineer's Agent, who will act as directed by and under the supervision of the Engineer, and who will confer with County regarding his actions. Resident Project Representative's dealing in matters pertaining to the on-site Work shall, in general, be only with the County and Contractor and dealings with Subcontractors shall only be through or with the full knowledge of Contractor.
- 12.2 Resident Project Representative will:
- 12.2.1 Review the progress schedule, schedule of shop drawing submissions and Schedule of Values prepared by Contractor and consult with County concerning their acceptability.

- 12.2.2 Attend Preconstruction Conferences. Arrange a schedule of progress meetings and other job conferences as required in consultation with County and notify those expected to attend in advance. Attend meetings and maintain and circulate copies of minutes thereof.
- 12.2.3 Serve as County's liaison with Contractor, working principally through Contractor's superintendent and assist him in understanding the intent of the Contract Documents. As requested by Contractor, assist in obtaining additional details or information when required at the job site for proper execution of the Work.
- 12.2.4 Receive and record date of receipt of Shop Drawings and samples, receive samples which are furnished at the site by Contractor and notify Engineer of their availability for examination.
- 12.2.5 Advise Engineer and Contractor or his superintendent immediately of the commencement of any Work requiring a shop drawing or sample submission if the submission has not been approved by the County.
- 12.2.6 Conduct on-site observations of the Work in progress to assist Engineer in determining if the Work is proceeding in accordance with the Contract Documents and that completed Work will conform to the Contract Documents.
- 12.2.7 Report to County whenever he or she believes that any Work is unsatisfactory, faulty or defective or does not conform to the Contract Documents, or does not meet the requirements of any inspections, tests or approvals required or if Work has been damaged prior to final payment; and advise Contractor when he believes Work should be corrected or rejected or should be uncovered of observation or requires special testing, inspection or approval.
- 12.2.8 Verify that tests, equipment and system start-ups and operating and maintenance instructions are conducted as required by the Contract Documents and in the presence of the required personnel, and that Contractor maintains adequate records thereof; observe, record and report to Engineer appropriate details relative to the test procedures and start-ups.
- 12.2.9 Accompany visiting inspectors representing public or other agencies having jurisdiction over the project; record the outcome of these inspections and report to County.
- 12.2.10 Transmit to Contractor, Engineer's clarifications and interpretations of the Contract Documents.

- 12.2.11 Consider and evaluate Contractor's suggestions or modifications in drawings or Contract Documents and report them with recommendations to County.
- 12.2.12 Maintain at the job site orderly files for correspondence, reports of job conferences, Shop Drawings and sample submissions, reproductions of original Contract Documents including all Addenda, Change Orders, field orders, additional drawings issued subsequent to the execution of the Contract, Engineer's clarifications and interpretations of the Contract Documents, progress reports and other project related documents.
- 12.2.13 Keep a diary or log book, recording hours on the job site, weather conditions, data relative to questions of extras or deductions; list of visiting officials and representatives or manufacturers, fabricators, Suppliers and distributors; daily activities, decisions, observations in general and specific observations in more detail as in the case of observing test procedures. Send copies to County.
- 12.2.14 Record names, addresses and telephone numbers of all Contractors, Subcontractors and major Suppliers of materials and equipment.
- 12.2.15 Furnish Engineer periodic reports as required of progress of the Work and Contractor's compliance with the approved progress schedule and schedule of shop drawing submissions.
- 12.2.16 Consult with Engineer in advance of scheduling major tests, inspections or start of important phases of the Work.
- 12.2.17 Report immediately the occurrence of any accident.
- 12.2.18 Review applications for payment with Contractor for compliance with the established procedure for their submission and forward them with recommendations to Engineer, noting particularly their relation to the Schedule of Values, Work completed and materials and equipment delivered at the site but not incorporated in the Work.
- 12.2.19 During the course of the Work, verify that certificates, maintenance and operations manuals and other data required to be assembled and furnished by Contractor are applicable to the items actually installed, and deliver this material to County for his review prior to final acceptance of the Work.
- 12.2.20 Before Engineer issues a certificate of Substantial Completion, submit to Contractor a list of observed items requiring completion or correction.

12.2.21 Conduct final inspection in the company of County and/or Engineer and Contractor and prepare a Punch List of items to be completed or corrected. Reference Florida Statutes § 218.735(7).

12.2.22 Verify that all items on final list have been completed or corrected and make recommendations to County concerning acceptance.

12.3 Except upon written instructions of Engineer, Resident Project Representative:

12.3.1 Shall not authorize any deviation from the Contract Documents or approve any substitute materials or equipment;

12.3.2 Shall not exceed limitations on Engineer's authority as set forth in the Contract Documents;

12.3.3 Shall not undertake any of the responsibilities of Contractor, Subcontractors or Contractor's superintendent, or expedite the Work;

12.3.4 Shall not advise on or issue directions relative to any aspect of the means, methods, techniques, sequences or procedures of construction unless such is specifically called for in the Contract Documents;

12.3.5 Shall not advise on or issue directions as to safety precautions and programs in connection with the Work;

12.3.6 Shall not authorize County to occupy the project in whole or in part; and

12.3.7 Shall not participate in specialized field or laboratory tests.

ARTICLE 13. APPRENTICES

13.1 If successful Contractor employs apprentices, he shall be governed and comply with the provisions of Fla.Stat. § 446.011.

NOTE: The form of all submittals, notices, Change Orders and other documents permitted or required to be used or transmitted under the Contract shall be determined by the County. Standard County forms shall be utilized.

END OF SECTION E

SECTION F
FORM OF CONTRACT
BETWEEN THE
COUNTY OF MANATEE, FLORIDA
AND CONTRACTOR AS IDENTIFIED BELOW
ON THE BASIS OF A STIPULATED UNIT COST CONTRACT PRICE

This CONTRACT is made and entered into by and between the COUNTY OF MANATEE, a political subdivision of the State of Florida, hereinafter referred to as "COUNTY" and **XXXXXXXXXX**, hereinafter referred to as "CONTRACTOR," duly authorized to transact business in the State of Florida, with offices located at **XXXXXXXXXX**.

ARTICLE 1. WORK

CONTRACTOR shall furnish all labor, materials, supplies, and other items required to complete the Work for **IFB #14-3048CD- Force Main 15D Rehabilitation** in strict accordance with Contract Documents and any duly authorized subsequent Addenda thereto, all of which are made a part hereof.

ARTICLE 2. COMPENSATION

As compensation to CONTRACTOR, COUNTY shall pay and CONTRACTOR will accept as full consideration for the performance of all Work required by **IFB #14-3048CD- Force Main 15D Rehabilitation**, subject to additions and deductions as provided therein, the sum of **\$ xxx.xx**" based on a completion time of **90** calendar days.

ARTICLE 3. LIQUIDATED DAMAGES

Time is of the essence in this CONTRACT. As of the date of this CONTRACT, the damages that will be suffered by COUNTY in the event of CONTRACTOR'S failure to timely complete the Work are impossible to determine. In lieu thereof, it is agreed that if CONTRACTOR fails to achieve Final Completion of the Work within **90** calendar days of issuance of the Notice to Proceed (accounting, however, for any extensions of time granted pursuant to approved Change Orders), CONTRACTOR shall pay to COUNTY, as liquidated damages (and not as a penalty), the sum of **\$1,074** per calendar day for each day beyond **90** days until CONTRACTOR achieves Final Completion. COUNTY

shall have the option of withholding said liquidated damages from any pay application(s) thereafter submitted by CONTRACTOR. Alternatively, CONTRACTOR shall immediately pay said sums to COUNTY upon COUNTY'S demand for same.

ARTICLE 4. ENGINEER

The COUNTY of MANATEE, Public Works Department, is responsible as COUNTY and Kimley-Horn and Associates as "ENGINEER," designed this Project and is responsible for technical/engineering reviews and decisions. The ENGINEER is a member of COUNTY'S Project Management team which is collectively responsible for ensuring the Work is completed in accordance with the Contract Documents.

All communications involving this Project will be addressed to: Brian Bates, PE, Project Manager, Public Works Department and to the Engineer of Record, Wayne E. White, PE, Kimley-Horn and Associates. All invoicing will be addressed to the attention of: Kent Bontrager, PE (address noted below) with invoice copies sent to Wayne E. White, PE, Kimley-Horn and Associates (address noted below).

Manatee County Public Works Dept.
IFB# 14-3048CD
Attention: Brian Bates, PE
Project Manager
1022 26th Avenue East
Bradenton, Florida 34208
Phone (941) 708-7450 ext. 7329

Kimley-Horn and Associates
IFB# 14-3048CD
Attn: Wayne E. White, PE
Project Manager
655 North Franklin Street, Suite 150
Tampa, Florida 33609
Phone (813) 620-1460

Where the terms ENGINEER and/or COUNTY are used in the Contract Documents, it shall mean COUNTY'S Project Management team.

ARTICLE 5. CONTRACTOR'S REPRESENTATIONS

In order to induce COUNTY to enter into this CONTRACT, CONTRACTOR makes the following representations:

- 5.1 CONTRACTOR has familiarized itself with the nature and extent of the Bid Documents, Work, site, locality and all local conditions and laws and regulations that in any manner may affect cost, progress, performance or furnishing of the Work.
- 5.2 CONTRACTOR has studied carefully all drawings of the physical conditions upon which CONTRACTOR is entitled to rely.
- 5.3 CONTRACTOR has obtained and carefully studied (or assumes responsibility for obtaining and carefully studying) all such examinations, investigations, explorations, tests, reports and studies which pertain to the physical conditions at or contiguous to the site or which otherwise may affect the cost, progress, performance or furnishing of the Work as CONTRACTOR considers necessary for the performance or furnishing of the Work at the Contract Price, within the Contract Time and in accordance with the other terms and conditions of the Bid Documents; and no additional examinations, investigations, explorations, tests, reports, studies or similar information or data are or will be required by CONTRACTOR for such purposes.
- 5.4 CONTRACTOR has reviewed and checked all information and data shown or indicated on the Bid Documents with respect to existing Underground Facilities at or contiguous to the site and assumes responsibility for the accurate location of said Underground Facilities. Any additional examinations, investigations, explorations, tests, reports, studies or similar information or data in respect of said Underground Facilities conducted by CONTRACTOR will be done at CONTRACTOR'S expense.

- 5.5 CONTRACTOR has correlated the results of all such observations, examinations, investigations, explorations, tests, reports and studies with the terms and conditions of the Bid.
- 5.6 CONTRACTOR has given COUNTY written notice of all conflicts, errors or discrepancies that have been discovered in the Bid Documents and the written resolution thereof by COUNTY is acceptable to CONTRACTOR.
- 5.7 CONTRACTOR shall schedule and perform the Work subject to COUNTY'S approval and shall hold COUNTY harmless from all liabilities incurred due to CONTRACTOR'S failure to coordinate with COUNTY.

ARTICLE 6. CONTRACT DOCUMENTS

The Contract Documents which comprise the entire CONTRACT between COUNTY and CONTRACTOR concerning the Work consist of the following:

- 6.1 This CONTRACT and Bid Document **14-3048CD**
- 6.2 Invitation for Bid # **14-3048CD** in its entirety
- 6.3 Public Construction Bond Form and Insurance Certificate(s)
- 6.4 Drawings/Plans (not attached)
- 6.5 Addendum number **xx** to **xx** inclusive
- 6.6 CONTRACTOR'S Bid Form
- 6.7 Reports
- 6.8 The following, which may be delivered or issued after the Effective Date of the CONTRACT and are not attached hereto: all written Change Orders and other documents amending, modifying, or supplementing the Contract Documents.

6.9 The documents listed in paragraphs above are attached to this CONTRACT (except as noted otherwise above). There are no Contract Documents other than those listed above in this Article 6.

ARTICLE 7. DISPUTE RESOLUTION

Disputes shall be resolved as follows: good faith negotiations by the designated agents of the parties and if not resolved by such designated agents, CONTRACTOR shall submit its claim, with the basis for the dispute, in writing to the Manatee County Purchasing Official for a determination and handling in accordance with the provisions of Chapter 2-26 of the Manatee County Code.

ARTICLE 8. NO WAIVER

8.1 The failure of CONTRACTOR or COUNTY to insist on the strict performance of the terms and conditions hereof shall not constitute or be construed as a waiver or relinquishment of either party's right to thereafter enforce the same in accordance with this CONTRACT in the event of a continuing or subsequent default on the part of CONTRACTOR or COUNTY.

8.2 Nothing herein shall be interpreted as a waiver of COUNTY of its rights, including the limitations of the limited waiver of sovereign immunity, as set forth in Florida Statute 768.28, or any other statute, and COUNTY expressly reserves these rights to the full extent allowed by law.

ARTICLE 9. NO THIRD-PARTY BENEFICIARIES

This CONTRACT is solely for the benefit of the parties hereto, and no right, privilege, or cause of action shall by reason hereof accrue upon, to, or for the benefit of any third party. Nothing in this CONTRACT is intended or shall be construed to confer upon or give any person, corporation, partnership, trust, private entity, agency, or any other governmental entity any right, privilege, remedy, or claim under or by reason of this CONTRACT or any provisions or conditions hereof.

ARTICLE 10. GOVERNING LAW, JURISDICTION AND VENUE

- 10.1 This CONTRACT and the construction and enforceability thereof shall be interpreted under the laws of the State of Florida.
- 10.2 CONTRACTOR consents and agrees that all legal proceedings related to the subject matter of this CONTRACT shall be governed by the laws of the State of Florida.
- 10.3 CONTRACTOR consents and agrees that jurisdiction for such proceedings shall lie exclusively with such court, and venue shall be in the Circuit Court of the Twelfth Judicial Circuit in and for Manatee County, Florida.
- 10.4 In the event of any litigation arising under the terms of this CONTRACT, each party shall be responsible for their own attorney's fees, including appellate fees, regardless of the outcome of the litigation.

ARTICLE 11. FORCE MAJEURE

Neither party shall be considered in default of performance of such obligations hereunder to the extent that performance of such obligations or any of them is delayed or prevented by Force Majeure. Force Majeure shall include, but not be limited to hostility, revolution, civil commotion, strike, epidemic, fire, flood, wind, earthquake, hurricane, or other disruptive event of nature, act of terrorism, explosion, lack of or failure of transportation or bridge/roadway facilities, any law, proclamation, regulation, ordinance or other act of government, or any act of God or any cause whether of the same or different nature, existing or future; provided that the cause, whether or not enumerated in this Article, is beyond the control and without the fault or negligence of the party seeking relief under this Article.

ARTICLE 12. MISCELLANEOUS

- 12.1 Terms used in this CONTRACT are defined in Article 1 of Section E, General Conditions.
- 12.2 No assignment by a party hereto of any rights under or interest in the Contract Documents will be binding on another party hereto without the written consent of the party sought to be bound; and specifically but without limitation, monies that may become due and monies that are due may not be assigned without such consent (except to the extent that the effect of this restriction may be limited by law); and unless specifically stated to the contrary in any written consent to an assignment, no assignment will release or discharge the assignee from any duty or responsibility under the Contract Documents.
- 12.3 COUNTY and CONTRACTOR each binds itself, its partners, successors, assigns and legal representatives to the other party hereto, its partners, successors, assigns and legal representatives in respect of all covenants, agreements, and obligations contained in the Contract Documents.
- 12.4 By accepting Award of this CONTRACT, CONTRACTOR, which shall include its directors, officers and employees, represents that it presently has no interest in and shall acquire no interest in any business or activity which would conflict in any manner with the performance of duties or services required hereunder.

CONTRACT
IFB # 14-3048CD

IN WITNESS WHEREOF, the parties hereto have caused this CONTRACT **14-3048CD** to be duly executed by their authorized representatives.

CONTRACTOR

By: _____

Print Name & Title of Signer

Date: _____

COUNTY OF MANATEE, FLORIDA

By: _____
Melissa M. Wendel, CPPO
Purchasing Official

Date: _____

BID FORM
(Submit in triplicate)

For: 14-3048CD- Force Main 15D Rehabilitation

Total Offer: _____
Based on a completion time of 90 calendar days

Only one schedule for Completion of the Work shall be considered. Only one Award shall be made.

We, the undersigned, hereby declare that we have carefully reviewed the Bid Documents and with full knowledge and understanding of the aforementioned herewith submit this Bid, meeting each and every specification, term, and condition contained in the Invitation for Bid package, in its entirety.

We understand that the Invitation for Bid package, in its entirety, including but not limited to, all Specifications, terms, and conditions shall be made a part of any resulting Contract between Manatee County and the Successful Bidder. Failure to comply shall result in Contract default, whereupon, the defaulting Contractor shall be required to pay for any and all re-procurement costs, damages, and attorney fees as incurred by County, and agrees to forfeit his/her Bid Bond.

Communications concerning this Bid shall be addressed as follows: **(Complete all fields)**

Bidder's Name: _____

Mailing Address: _____

Telephone: () _____ Fax: () _____

Email Address: _____

I, _____ attest that I have read, understand, and agree to the Local Preference policy of Manatee County.

I, _____ on [date(s)] _____ attest that I have visited the Project site(s) to familiarize myself with the full Scope of Work required for the Bid.

Acknowledge Addendum No.____ Dated: _____ Acknowledge Addendum No.____ Dated: _____
Acknowledge Addendum No.____ Dated: _____ Acknowledge Addendum No.____ Dated: _____
Acknowledge Addendum No.____ Dated: _____ Acknowledge Addendum No.____ Dated: _____

Authorized Signature(s): _____

Name and Title of Above Signer(s): _____

Date: _____

BID FORM

(Submit in Triplicate)

FORCE MAIN 15D REHABILITATION

Bid Based on Completion Time of 90 Calendar Days

ITEM NO.	DESCRIPTION	UNITS	QTY.	BID PRICE PER UNIT (\$)	TOTAL BID PRICE (\$)
1	Mobilization	LS	1	\$	\$
2	Maintenance of Traffic	LS	1	\$	\$
3	Erosion and Sediment Control	LS	1	\$	\$
4	20" PVC DR 21 Force Main	LF	340	\$	\$
5	20" Pipe Restraints	EA	26	\$	\$
6	Ductile Iron Fittings	EA	4	\$	\$
7	5" Sewer Service Lateral and Cleanouts	LF	40	\$	\$
8	Grout Fill Abandoned 16" Forcemain and Manhole	CY	30	\$	\$
9	Dog House Concrete Manhole	EA	1	\$	\$
10	Jack and Bore with 36" Steel Casing	LF	170	\$	\$
11	Core Manhole for Proposed Pipe Connection	EA	1	\$	\$
12	Concrete Driveway/ Sidewalk Restoration	SY	340	\$	\$
13	Pavement Repair and Road Restoration (Base & Resurface)	SY	100	\$	\$
14	Pavement Repair and Road Restoration (Mill & Resurface)	SY	250	\$	\$
15	Sodding	SY	50	\$	\$
16	Tree and Shrub Replacement	EA	4	\$	\$
17	Curb and Gutter Replacement	LF	40	\$	\$
TOTAL BASE BID - Based on Completion Time of 90 Calendar Days					\$
18	CONTRACT CONTINGENCY WORK (USED ONLY WITH COUNTY APPROVAL)		10% OF TOTAL BASE BID		\$
TOTAL OFFER with Contract Contingency - Based on Completion Time of 90 Calendar Days					\$

Bidder Name: _____

Authorized Signature: _____

MAILING LABEL

Cut along the outside border and affix this label to your sealed Bid envelope to identify it as a "Sealed Bid". Be sure to include the name of the company submitting the Bid and the Bid due date and time where requested.

MAILING LABEL TO AFFIX TO OUTSIDE OF SEALED BID PACKAGE:

SEALED BID - DO NOT OPEN

CONTRACTOR: _____

SEALED BID NO: 14-3048CD

BID TITLE: Force Main 15D Rehabilitation

DUE DATE/TIME: _____ @ _____

FORM A
CONTRACTOR'S QUESTIONNAIRE
(Submit in Triplicate)

The Bidder warrants the truth and accuracy of all statements and answers herein contained. (Attach additional pages if necessary.)

THIS QUESTIONNAIRE MUST BE COMPLETED AND SUBMITTED WITH YOUR BID

1. Contact Information:

License #: _____

License Issued to: _____

Date License Received (MM/DD/YR): _____

Company Name: _____

Physical Address: _____

City: _____ State of Incorporation: _____ Zip Code: _____

Phone Number: () _____ Fax Number: () _____

Email address: _____

2. Bidding as: an individual __; a partnership __; a corporation __; a joint venture __

3. If a partnership, list names and addresses of partners; if a corporation, list names of officers, directors, shareholders, and state of incorporation; if joint venture, list names and address of ventures' and the same if any venture are a corporation for each such corporation, partnership, or joint venture:

4. Bidder is authorized to do business in the State of Florida: Yes No

For how many years? _____

5. Your organization has been in business (under this firm's name) as a

Is this firm in bankruptcy? _____

BIDDER: _____

6. Attach a list of projects where this specific type of Work was performed.
7. Describe and give the date and County of the last three government or private work of similar scope you've completed which are similar in cost, type, size, and nature as this Project. Include contact name and phone number. Provide the budget, actual cost, size and summary of work for each project. Attach additional pages as necessary. (Note: If listing a Manatee County reference, contact person should not be directly associated with this Project.

8. Have you ever been assessed liquidated damages under a Contract during the past five (5) years? If so, state when, where (contact name, address and phone number) and why.

9. Have you ever failed to complete projects awarded to you? Or failed to complete projects within Contract Time? If so, state when, where (contact name, address, phone number) and why.

10. Have you ever been debarred or prohibited from providing a Bid to a governmental entity? If yes, name the entity and describe the circumstances:

BIDDER: _____

11. Will you subcontract any part of this Work? If so, describe which major portion(s):

12. If any, list (with Contract amount) MBE/DBE to be utilized:

13. What equipment do you own to accomplish this Work? (A listing may be attached)

14. What equipment will you purchase/rent for the Work? (Specify which)

15. List the following in connection with the Surety which is providing the bond(s):

Surety's Name: _____
Address: _____

Name, address, phone number and email of Surety's resident agent for service of process in Florida:

Agent's Name: _____
Address: _____

Phone: _____
Email: _____

BIDDER: _____

FORM B
PUBLIC CONTRACTING AND ENVIRONMENTAL CRIMES CERTIFICATION

**SWORN STATEMENT PURSUANT TO ARTICLE V,
MANATEE COUNTY PURCHASING ORDINANCE**

THIS FORM MUST BE SIGNED AND SWORN TO IN THE PRESENCE OF A NOTARY PUBLIC OR OTHER OFFICIAL AUTHORIZED TO ADMINISTER OATHS.

This sworn statement is submitted to the Manatee County Board of County Commissioners by

_____ [Print individual's name and title]

_____ for _____ [print name of entity submitting sworn statement]

whose business address is _____

and (if applicable) its Federal Employer Identification Number (FEIN) is _____. If the entity has no FEIN, include the Social Security Number of the individual signing this sworn statement:

I understand that no person or entity shall be awarded or receive a County Contract for public improvements, procurement of goods or services (including professional services) or a County lease, franchise, concession or management Contract, or shall receive a grant of County monies unless such person or entity has submitted a written certification to County that it has not:

- (1) been convicted of bribery or attempting to bribe a public officer or employee of Manatee County, the State of Florida, or any other public entity, including, but not limited to the Government of the United States, any state, or any local government authority in the United States, in that officer's or employee's official capacity; or
- (2) been convicted of an agreement or collusion among Bidders or prospective Bidders in restraint of freedom of competition, by agreement to bid a fixed price, or otherwise; or
- (3) been convicted of a violation of an environmental law that, in the sole opinion of County's Purchasing Official, reflects negatively upon the ability of the person or entity to conduct business in a responsible manner; or
- (4) made an admission of guilt of such conduct described in items (1), (2) or (3) above, which is a matter of record, but has not been prosecuted for such conduct, or has made an admission of guilt of such conduct, which is a matter of record, pursuant to formal prosecution. An admission of guilt shall be construed to include a plea of nolo contendere; or
- (5) where an officer, official, agent or employee of a business entity has been convicted of or has admitted guilt to any of the crimes set forth above on behalf of such an entity and pursuant to the direction or authorization of an official thereof (including the person committing the offense, if he is an official of the business entity), the business shall be chargeable with the conduct herein above set forth. A business entity shall be chargeable with the conduct of an affiliated entity, whether wholly owned, partially owned, or one which has common ownership or a common Board of Directors. For purposes of this Form, business entities are affiliated if, directly or indirectly, one business entity controls or has the power to control another business entity, or if an individual or group of individuals controls or has the power to control both entities. Indicia of control shall include, without limitation, interlocking management or ownership, identity of interests among family members, shared organization of a business entity following the ineligibility of a business entity under this Article, or using substantially the same management, ownership or principles as the ineligible entity.

(Continued)

Any person or entity who claims that this Article is inapplicable to him/her/it because a conviction or judgment has been reversed by a court of competent jurisdiction shall prove the same with documentation satisfactory to County's Purchasing Official. Upon presentation of such satisfactory proof, the person or entity shall be allowed to contract with County.

I UNDERSTAND THAT THE SUBMISSION OF THIS FORM TO THE CONTRACTING OFFICER FOR MANATEE COUNTY IS VALID THROUGH DECEMBER 31 OF THE CALENDAR YEAR IN WHICH IT IS FILED. I ALSO UNDERSTAND THAT ANY CONTRACT OR BUSINESS TRANSACTION SHALL PROVIDE FOR SUSPENSION OF PAYMENTS, OR TERMINATION, OR BOTH, IF THE CONTRACTING OFFICER OR COUNTY ADMINISTRATOR DETERMINES THAT **SUCH PERSON OR ENTITY HAS MADE FALSE CERTIFICATION.**

[Signature]

STATE OF FLORIDA
COUNTY OF _____

Sworn to and subscribed before me this ____ day of _____, 20____ by _____

Personally known _____ OR Produced identification _____
[Type of identification]

Notary Public Signature My commission expires _____

[Print, type or stamp Commissioned name of Notary Public]

Signatory Requirement - In the case of a business entity other than a partnership or a corporation, this affidavit shall be executed by an authorized agent of the entity. In the case of a partnership, this affidavit shall be executed by the general partner(s). In the case of a corporation, this affidavit shall be executed by the corporate president.

FORM C
SWORN STATEMENT
THE FLORIDA TRENCH SAFETY ACT

THIS FORM MUST BE SIGNED IN THE PRESENCE OF A NOTARY PUBLIC OR BY AN OFFICER AUTHORIZED TO ADMINISTER OATHS.

1. This Sworn Statement is submitted with IFB No. 14-3048CD
2. This Sworn Statement is submitted by _____ whose business address is _____ and, if applicable, its Federal Employer Identification Number (FEIN) is _____. If the entity has no FEIN, include the Social Security Number of _____ the individual signing this sworn statement _____.
3. Name of individual signing this Sworn Statement is: _____, Whose relationship to the above entity is: _____.
4. The Trench Safety Standards that will be in effect during the construction of this Project shall include, but are not limited to: Laws of Florida, Chapters 90-96, TRENCH SAFETY ACT, and OSHA RULES AND REGULATIONS 29 CFR 1926.650 Subpart P, effective October 1, 1990.
5. The undersigned assures that the entity will comply with the applicable Trench Safety Standards and agrees to indemnify and hold harmless County and Engineer, and any of their agents or employees from any claims arising from the failure to comply with said standard.

6. The undersigned has appropriated the following costs for compliance with the applicable standards:

<u>Trench Safety Measure (Description)</u>	<u>Units of Measure (LF, SY)</u>	<u>Unit Quantity</u>	<u>Unit Cost</u>	<u>Extended Cost</u>
a. _____	_____	_____	\$ _____	_____
b. _____	_____	_____	\$ _____	_____
c. _____	_____	_____	\$ _____	_____
d. _____	_____	_____	\$ _____	_____

7. The undersigned intends to comply with these standards by instituting the following procedures:

THE UNDERSIGNED, in submitting this Bid, represents that they have reviewed and considered all available geotechnical information and made such other investigations and tests as they may deem necessary to adequately design the trench safety system(s) to be utilized on this Project.

 (AUTHORIZED SIGNATURE / TITLE)

SWORN to and subscribed before me this _____ day of _____, 20_____.

(Impress official seal)

Notary Public, State of Florida: _____

My commission expires: _____



R. B. "Chips" Shore

CLERK OF THE CIRCUIT COURT AND COMPTROLLER OF MANATEE COUNTY

1115 Manatee Avenue West, Bradenton, Florida 34205 - Phone (941) 749-1800 – Fax (941) 741-4082
P.O. Box 25400, Bradenton, Florida 34206 - www.manateeclerk.com

E PAYABLES APPLICATION

Company
name _____

Contact
person _____

Phone
number _____

Email
Address _____

FINANCE USE ONLY

Open orders: YES or NO

PEID _____

CREATE DATE _____

CONFIRMED WITH _____

Name and phone number

IFAS _____

BANK _____

INITIALS _____

Return completed form to:
Via email to:
lori.bryan@manateeclerk.com
Via fax to: (941) 741-4011
Via mail:
PO Box 1000
Bradenton, Fl 34206

Revised: June 26, 2013

"Pride in Service with a Vision to the Future"

Clerk of the Circuit Court – Clerk of Board of County Commissioners – County Comptroller – Auditor and Recorder

CONTRACT DOCUMENTS
TECHNICAL SPECIFICATIONS

FOR



Manatee County
Force Main 15D Rehabilitation

PROJECT # 6022381

August 2014

PROJECT OWNER:

County of Manatee, Florida
c/o Manatee County Purchasing Division
1112 Manatee Avenue West
Bradenton, Florida 34205
(941) 748-4501

PREPARED BY:

Kimley-Horn and Associates
655 North Franklin Street, Suite 150
Tampa, Florida 33602
(813) 620-1460
CA# 00000696

Wayne E. White, P.E.
Wayne.White@Kimley-Horn.com
655 North Franklin Street, Suite 150
Tampa, Florida 33602
(813) 635-5545

INFRASTRUCTURE ENGINEERING STANDARD SPECIFICATIONS

DIVISION 1 GENERAL REQUIREMENT

01005	GENERAL REQUIREMENTS
01010	SUMMARY OF WORK
01015	CONTROL OF WORK
01030	SPECIAL PROJECT PROCEDURES
01045	CUTTING AND PATCHING
01050	FIELD ENGINEERING AND SURVEYING
01090	REFERENCE STANDARDS
01150	MEASUREMENT AND PAYMENT
01152	REQUESTS FOR PAYMENT
01153	CHANGE ORDER PROCEDURES
01200	PROJECT MEETINGS
01310	CONSTRUCTION SCHEDULE & PROJECT RESTRAINTS
01340	SHOP DRAWINGS, PROJECT DATA AND SAMPLES
01370	SCHEDULE OF VALUES
01380	CONSTRUCTION PHOTOGRAPHS
01410	TESTING AND TESTING LABORATORY SERVICES
01510	TEMPORARY AND PERMANENT UTILITIES
01570	TRAFFIC REGULATION
01580	PROJECT IDENTIFICATION AND SIGNS
01600	MATERIAL AND EQUIPMENT
01620	STORAGE AND PROTECTION
01700	CONTRACT CLOSEOUT
01710	CLEANING
01720	PROJECT RECORD DOCUMENTS
01730	OPERATING AND MAINTENANCE DATA
01740	WARRANTIES AND BONDS

DIVISION 2 SITE WORK

02064	MODIFICATIONS TO EXISTING STRUCTURES, PIPING AND EQUIPMENT
02100	SITE PREPARATION
02220	EXCAVATION, BACKFILL, FILL AND GRADING FOR STRUCTURES
02221	TRENCHING, BEDDING AND BACKFILL FOR PIPE
02223	EXCAVATION BELOW GRADE AND CRUSHED STONE OR SHELL REFILL
02260	FINISH GRADING
02276	TEMPORARY EROSION AND SEDIMENTATION CONTROL
02325	ROAD AND RAILROAD CROSSINGS
02480	LANDSCAPING
02485	SEEDING AND SODDING
02513	ASPHALT CONCRETE PAVING
02575	PAVEMENT REPAIR AND RESTORATION
02615	DUCTILE IRON PIPE AND FITTINGS
02617	INSTALLATION AND TESTING OF PRESSURE PIPE
02618	PIPELINE CLEANING
02622	POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS (AWWA SPECIFICATIONS C-900 & C-905)
02623	POLYVINYL CHLORIDE (PVC) PIPE (GRAVITY SEWER)
02640	VALVES AND APPURTENANCES

02720 SANITARY SEWER BYPASS PUMPING
02999 MISCELLANEOUS WORK AND CLEANUP

DIVISION 3 CONCRETE

03200 CONCRETE REINFORCEMENT
03300 CAST-IN-PLACE CONCRETE
03350 CONCRETE FINISHES
03410 PRECAST CONCRETE STRUCTURES

DIVISION 5 METALS

05500 MISCELLANEOUS METAL

DIVISION 9 PAINTING

09865 SURFACE PREPARATION AND SHOP PRIME PAINTING
09900 PAINTING

SECTION 01005

GENERAL REQUIREMENTS

PART 1 GENERAL

1.01 SCOPE AND INTENT

A. Description

The work to be done consists of the furnishing of all labor, materials and equipment, and the performance of all work included in this Contract.

B. Work Included

The Contractor shall furnish all labor, superintendence, materials, plant, power, light, heat, fuel, water, tools, appliances, equipment, supplies, shop drawings, working drawings and other means of construction necessary or proper for performing and completing the work. He shall obtain and pay for all required permits necessary for the work, other than those permits such as the DEP permit and railroad permit which may have already been obtained. He shall perform and complete the work in the manner best calculated to promote rapid construction consistent with safety of life and property and to the satisfaction of the County, and in strict accordance with the Contract Documents. The Contractor shall clean up the work and maintain it during and after construction, until accepted, and shall do all work and pay all incidental costs. He shall repair or restore all structures and property that may be damaged or disturbed during performance of the work.

The cost of incidental work described in these General Requirements, for which there are no specific Contract Items, shall be considered as part of the general cost of doing the work and shall be included in the prices for the various Contract Items. No additional payment will be made.

The Contractor shall be solely responsible for the adequacy of his workmanship, materials and equipment.

C. Public Utility Installations and Structures

Public utility installations and structures shall be understood to include all poles, tracks, pipes, wires, conduits, house service connections, vaults, manholes and all other appurtenances and facilities pertaining thereto.

The Contractor shall protect all installations and structures from damage during the work. Access across any buried public utility installation or structure shall be made only in such locations and by means approved by the County. All required protective devices and construction shall be provided by the Contractor at his expense. All existing public utilities damaged by the Contractor which are shown on the Plans or have been located in the field by the utility shall be repaired by the Contractor, at his expense, as approved by the County. No separate payment shall be made for such protection or repairs to public utility installations or structures.

Public utility installations or structures owned or controlled by the County or other governmental body, which are required by this contract to be removed, relocated, replaced or rebuilt by the Contractor not identified in any separate bid item shall be considered as a part of the general cost of doing the work and shall be included in the prices bid for the various contract items. No separate payment shall be made.

Where public utility installations or structures owned or controlled by the County or other governmental body are encountered during the course of the work, and are not indicated on the Plans or in the Specifications, and when, in the opinion of the County, removal, relocation, replacement or rebuilding is necessary to complete the work under this Contract, such work shall be accomplished by the utility having jurisdiction, or such work may be ordered, in writing by the County, for the contractor to accomplish. If such work is accomplished by the utility having jurisdiction, it will be carried out expeditiously and the Contractor shall give full cooperation to permit the utility to complete the removal, relocation, replacement or rebuilding as required. If such work is accomplished by the Contractor, it will be in accordance with the General and Supplemental General Conditions.

The Contractor shall give written notice to County and other governmental utility departments and other owners of public utilities of the location of his proposed construction operations, at least forty-eight hours in advance of breaking ground in any area or on any unit of the work. This can be accomplished by making the appropriate contact with the "Sunshine State One-Call of Florida, Inc. Call Center ("Call Sunshine") and per all requirements provided for in the Florida Underground Facilities Damage Prevention and Safety Act (Florida Statutes, Title XXXIII, Chapter 556).

The maintenance, repair, removal, relocation or rebuilding of public utility installations and structures, when accomplished by the Contractor as herein provided, shall be done by methods approved by the County.

1.02 PLANS AND SPECIFICATIONS

A. Plans

When obtaining data and information from the Plans, figures shall be used in preference to scaled dimensions, and large scale drawings in preference to small scale drawings.

B. Copies Furnished to Contractor

The Contractor shall furnish each of the subcontractors, manufacturers, and material men such copies of the Contract Documents as may be required for their work. Additional copies of the Plans and Specifications, when requested, may be furnished to the Contractor at cost of reproduction.

C. Supplementary Drawings

When, in the opinion of the County, it becomes necessary to explain more fully the work to be done or to illustrate the work further or to show any changes which may be required, drawings known as Supplementary Drawings, with specifications pertaining thereto, will be prepared by the County and five paper prints thereof will be given to the Contractor.

D. Contractor to Check Plans and Data

The Contractor shall verify all dimensions, quantities and details shown on the Plans, Supplementary Drawings, Schedules, Specifications or other data received from the County, and shall notify him of all errors, omissions, conflicts, and discrepancies found therein. Failure to discover or correct errors, conflicts or discrepancies shall not relieve the Contractor of full responsibility for unsatisfactory work, faulty construction or improper operation resulting therefrom nor from rectifying such conditions at his own expense. He will not be allowed to take advantage of any errors or omissions, as full instructions will be furnished by the County, should such errors or omissions be discovered. All schedules are given for the convenience of the County and the Contractor and are not guaranteed to be complete. The Contractor shall assume all responsibility for the making of estimates of the size, kind, and quality of materials and equipment included in work to be done under the Contract.

E. Specifications

The Technical Specifications consist of three parts: General, Products and Execution. The General Section contains General Requirements which govern the work. Products and Execution modify and supplement these by detailed requirements for the work and shall always govern whenever there appears to be a conflict.

F. Intent

All work called for in the Specifications applicable to this Contract, but not shown on the Plans in their present form, or vice versa, shall be of like effect as if shown or mentioned in both. Work not specified in either the Plans or in the Specifications, but involved in carrying out their intent or in the complete and proper execution of the work, is required and shall be performed by the Contractor as though it were specifically delineated or described.

The apparent silence of the Specifications as to any detail, or the apparent omission from them of a detailed description concerning any work to be done and materials to be furnished, shall be regarded as meaning that only the best general practice is to prevail and that only material and workmanship of the best quality is to be used, and interpretation of these Specifications shall be made upon that basis.

The inclusion of the Related Requirements (or work specified elsewhere) in the General part of the specifications is only for the convenience of the Contractor, and shall not be interpreted as a complete list of related Specification Sections.

1.03 MATERIALS AND EQUIPMENT

A. Manufacturer

All transactions with the manufacturers or subcontractors shall be through the Contractor, unless the Contractor shall request, in writing to the County, that the manufacturer or subcontractor deal directly with the County. Any such transactions shall not in any way release the Contractor from his full responsibility under this Contract.

Any two or more pieces or material or equipment of the same kind, type or classification, and being used for identical types of services, shall be made by the same manufacturer.

B. Delivery

The Contractor shall deliver materials in ample quantities to insure the most speedy and uninterrupted progress of the work so as to complete the work within the allotted time. The Contractor shall also coordinate deliveries in order to avoid delay in, or impediment of, the progress of the work of any related Contractor.

C. Tools and Accessories

The Contractor shall, unless otherwise stated in the Contract Documents, furnish with each type, kind or size of equipment, one complete set of suitably marked high grade special tools and appliances which may be needed to adjust, operate, maintain or repair the equipment. Such tools and appliances shall be furnished in approved painted steel cases, properly labeled and equipped with good grade cylinder locks and duplicate keys.

Spare parts shall be furnished as specified.

Each piece of equipment shall be provided with a substantial nameplate, securely fastened in place and clearly inscribed with the manufacturer's name, year of manufacture, serial number, weight and principal rating data.

D. Installation of Equipment.

The Contractor shall have on hand sufficient proper equipment and machinery of ample capacity to facilitate the work and to handle all emergencies normally encountered in work of this character.

Equipment shall be erected in a neat and workmanlike manner on the foundations at the locations and elevations shown on the Plans, unless directed otherwise by the County during installation. All equipment shall be correctly aligned, leveled and adjusted for satisfactory operation and shall be installed so that proper and necessary connections can be made readily between the various units.

The Contractor shall furnish, install and protect all necessary anchor and attachment bolts and all other appurtenances needed for the installation of the devices included in the equipment specified. Anchor bolts shall be as approved by the County and made of ample size and strength for the purpose intended. Substantial templates and working drawings for installation shall be furnished.

The Contractor shall furnish all materials and labor for, and shall properly bed in non-shrink grout, each piece of equipment on its supporting base that rests on masonry foundations.

Grout shall completely fill the space between the equipment base and the foundation. All metal surfaces coming in contact with concrete or grout shall receive a coat of coal tar epoxy equal to Koppers 300M or provide a 1/32-inch neophrene gasket between the metal surface and the concrete or grout.

E. Service of Manufacturer's Engineer

The Contract prices for equipment shall include the cost of furnishing (as required by equipment specifications sections) a competent and experienced engineer or

superintendent who shall represent the manufacturer and shall assist the Contractor, when required, to install, adjust, test and place in operation the equipment in conformity with the Contract Documents. After the equipment is placed in permanent operation by the County, such engineer or superintendent shall make all adjustments and tests required by the County to prove that such equipment is in proper and satisfactory operating condition, and shall instruct such personnel as may be designated by the County in the proper operation and maintenance of such equipment.

1.04 INSPECTION AND TESTING

A. General

Inspection and testing of materials will be performed by the County unless otherwise specified.

For tests specified to be made by the Contractor, the testing personnel shall make the necessary inspections and tests and the reports thereof shall be in such form as will facilitate checking to determine compliance with the Contract Documents. Three (3) copies of the reports shall be submitted and authoritative certification thereof must be furnished to the County as a prerequisite for the acceptance of any material or equipment.

If, in the making of any test of any material or equipment, it is ascertained by the County that the material or equipment does not comply with the Contract, the Contractor will be notified thereof and he will be directed to refrain from delivering said material or equipment, or to remove it promptly from the site or from the work and replace it with acceptable material, without cost to the County.

Tests of electrical and mechanical equipment and appliances shall be conducted in accordance with recognized test codes of the ANSI, ASME, or the IEEE, except as may otherwise be stated herein.

The Contractor shall be fully responsible for the proper operation of equipment during tests and instruction periods and shall neither have nor make any claim for damage which may occur to equipment prior to the time when the County formally takes over the operation thereof.

B. Costs

All inspection and testing of materials furnished under this Contract will be performed by the County or duly authorized inspection engineers or inspections bureaus without cost to the Contractor, unless otherwise expressly specified.

The cost of shop and field tests of equipment and of certain other tests specifically called for in the Contract Documents shall be borne by the Contractor and such costs shall be deemed to be included in the Contract price.

Materials and equipment submitted by the Contractor as the equivalent to those specifically named in the Contract may be tested by the County for compliance. The Contractor shall reimburse the County for the expenditures incurred in making such tests on materials and equipment which are rejected for non-compliance.

C. Inspections of Materials

The Contractor shall give notice in writing to the County, at least two weeks in advance of his intention to commence the manufacture or preparation of materials especially manufactured or prepared for use in or as part of the permanent construction. Such notice shall contain a request for inspection, the date of commencement and the expected date of completion of the manufacture or preparation of materials. Upon receipt of such notice, the County will arrange to have a representative present at such times during the manufacture as may be necessary to inspect the materials or he will notify the Contractor that the inspection will be made at a point other than the point of manufacture, or he will notify the Contractor that inspection will be waived. The Contractor must comply with these provisions before shipping any material. Such inspection shall not release the Contractor from the responsibility for furnishing materials meeting the requirements of the Contract Documents.

D. Certificate of Manufacture

When inspection is waived or when the County so requires, the Contractor shall furnish to him authoritative evidence in the form of Certificates of Manufacture that the materials to be used in the work have been manufactured and tested in conformity with the Contract Documents. These certificates shall be notarized and shall include copies of the results of physical tests and chemical analyses, where necessary, that have been made directly on the product or on similar products of the manufacturer.

E. Shop Tests of Operating Equipment

Each piece of equipment for which pressure, duty, capacity, rating, efficiency, performance, function or special requirements are specified shall be tested in the shop of the maker in a manner which shall conclusively prove that its characteristics comply fully with the requirements of the Contract Documents. No such equipment shall be shipped to the work until the County notifies the Contractor, in writing, that the results of such tests are acceptable.

The cost of shop tests and of furnishing manufacturer's preliminary and shop test data of operating equipment shall be borne by the Contractor.

F. Preliminary Field Tests

As soon as conditions permit, the Contractor shall furnish all labor, materials, and instruments and shall make preliminary field tests of equipment. If the preliminary field tests disclose any equipment furnished under this Contract which does not comply with the requirements of the Contract Documents, the Contractor shall, prior to the acceptance tests, make all changes, adjustments and replacements required. The furnishing Contractor shall assist in the preliminary field tests as applicable.

G. Final Field Tests

Upon completion of the work and prior to final payment, all equipment and piping installed under this Contract shall be subjected to acceptance tests as specified or required to prove compliance with the Contract Documents.

The Contractor shall furnish labor, fuel, energy, water and all other materials, equipment and instruments necessary for all acceptance tests, at no additional cost to the County. The Supplier shall assist in the final field tests as applicable.

H. Failure of Tests

Any defects in the materials and equipment or their failure to meet the tests, guarantees or requirements of the Contract Documents shall be promptly corrected by the Contractor. The decision of the County as to whether or not the Contractor has fulfilled his obligations under the Contract shall be final and conclusive. If the Contractor fails to make these corrections or if the improved materials and equipment, when tested, shall again fail to meet the guarantees of specified requirements, the County, notwithstanding its partial payment for work, and materials and equipment, may reject the materials and equipment and may order the Contractor to remove them from the site at his own expense.

In case the County rejects any materials and equipment, then the Contractor shall replace the rejected materials and equipment within a reasonable time. If he fails to do so, the County may, after the expiration of a period of thirty (30) calendar days after giving him notice in writing, proceed to replace such rejected materials and equipment, and the cost thereof shall be deducted from any compensation due or which may become due the Contractor under his Contract.

I. Final Inspection

During such final inspections, the work shall be clean and free from water. In no case will the final pay application be prepared until the Contractor has complied with all requirements set forth and the County has made his final inspection of the entire work and is satisfied that the entire work is properly and satisfactorily constructed in accordance with the requirements of the Contract Document.

1.05 TEMPORARY STRUCTURES

A. Temporary Fences

If, during the course of the work, it is necessary to remove or disturb any fence or part thereof, the Contractor shall, at his own expense, if so ordered by the County, provide a suitable temporary fence which shall be maintained until the permanent fence is replaced. The County shall be solely responsible for the determination of the necessity for providing a temporary fence and the type of temporary fence to be used.

1.06 TEMPORARY SERVICES

A. First Aid

The Contractor shall keep upon the site, at each location where work is in progress, a completely equipped first aid kit and shall provide ready access thereto at all times when people are employed on the work.

1.07 LINES AND GRADES

A. Grade

All work under this Contract shall be constructed in accordance with the lines and grades shown on the Plans, or as given by the County. The full responsibility for keeping alignment and grade shall rest upon the Contractor.

B. Safeguarding Marks

The Contractor shall safeguard all points, stakes, grade marks, monuments and bench marks made or established on the work, bear the cost of reestablishing them if disturbed, and bear the entire expense of rectifying work improperly installed due to not maintaining or protecting or removing without authorization such established points, stakes and marks.

The Contractor shall safeguard all existing and known property corners, monuments and marks adjacent to but not related to the work and, if required, shall bear the cost of reestablishing them if disturbed or destroyed.

C. Datum Plane

All elevations indicated or specified refer to the Mean Sea Level Datum of the NGVD 1929 Datum and/or NAVD 1988.

1.08 ADJACENT STRUCTURES AND LANDSCAPING

A. Responsibility

The Contractor shall also be entirely responsible and liable for all damage or injury as a result of his operations to all other adjacent public and private property, structures of any kind and appurtenances thereto met with during the progress of the work. The cost of protection, replacement in their original locations and conditions or payment of damages for injuries to such adjacent public and private property and structures affected by the work, whether or not shown on the Plans, and the removal, relocation and reconstruction of such items called for on the Plans or specified shall be included in the various Contract Items and no separate payments will be made therefore. Where such public and private property, structures of any kind and appurtenances thereto are not shown on the Plans and when, in the opinion of the County, additional work is deemed necessary to avoid interference with the work, payment therefore will be made as provided for in the General Conditions.

Contractor is expressly advised that the protection of buildings, structures, tunnels, tanks, pipelines, etc. and related work adjacent and in the vicinity of his operations, wherever they may be, is solely his responsibility. Conditional inspection of buildings or structures in the immediate vicinity of the project which may reasonably be expected to be affected by the Work shall be performed by and be the responsibility of the Contractor.

Contractor shall, before starting operations, make an examination of the interior and exterior of the adjacent structures, buildings, facilities, etc., and record by notes, measurements, photographs, etc., conditions which might be aggravated by open excavation and construction. Repairs or replacement of all conditions disturbed by the construction shall be made to the satisfaction of the County. This does not preclude conforming to the requirements of the insurance underwriters. Copies of surveys, photographs, reports, etc., shall be given to the County.

Prior to the beginning of any excavations, the Contractor shall advise the County of all buildings or structures on which he intends to perform work or which performance of the project work will affect.

B. Protection of Trees

1. All trees and shrubs shall be adequately protected by the Contractor with boxes and otherwise and in accordance with ordinances governing the protection of trees. No excavated materials shall be placed so as to injure such trees or shrubs. Trees or shrubs destroyed by negligence of the Contractor or his employees shall be replaced by him with new stock of similar size and age, at the proper season and at the sole expense of the Contractor.
2. Beneath trees or other surface structures, where possible, pipelines may be built in short tunnels, backfilled with excavated materials, except as otherwise specified, or the trees or structures carefully supported and protected from damage.
3. The County may order the Contractor, for the convenience of the County, to remove trees along the line or trench excavation. If so ordered, the County will obtain any permits required for removal of trees. Such tree removal ordered shall be paid for under the appropriate Contract Items.

C. Lawn Areas

Lawn areas shall be left in as good condition as before the starting of the work. Where sod is to be removed, it shall be carefully removed, and later replaced, or the area where sod has been removed shall be restored with new sod.

D. Restoration of Fences

Any fence, or part thereof, that is damaged or removed during the course of the work shall be replaced or repaired by the Contractor and shall be left in as good a condition as before the starting of the work. The manner in which the fence is repaired or replaced and the materials used in such work shall be subject to the approval of the County. The cost of all labor, materials, equipment, and work for the replacement or repair of any fence shall be deemed included in the appropriate Contract Item or items, or if no specific Item is provided therefore, as part of the overhead cost of the work, and no additional payment will be made therefore.

1.09 PROTECTION OF WORK AND PUBLIC

A. Barriers and Lights

During the prosecution of the work, the Contractor shall put up and maintain at all times such barriers and lights as will effectually prevent accidents. The Contractor shall provide suitable barricades, red lights, "danger" or "caution" or "street closed" signs and watchmen at all places where the work causes obstructions to the normal traffic or constitutes in any way a hazard to the public, in accordance with state and local requirements.

B. Smoke Prevention

A strict compliance with ordinances regulating the production and emission of smoke will be required. No open fires will be permitted.

C. Noise

The Contractor shall eliminate noise to as great an extent as practicable at all times. Air compressing plants shall be equipped with silencers and the exhaust of all engines or other power equipment shall be provided with mufflers. In the vicinity of hospitals and schools, special care shall be used to avoid noise or other nuisances. The Contractor shall strictly observe all local regulations and ordinances covering noise control.

D. Access to Public Services

Neither the materials excavated nor the materials or plant used in the construction of the work shall be so placed as to prevent free access to all fire hydrants, valves or manholes.

E. Dust prevention

The Contractor shall prevent dust nuisance from his operations or from traffic by keeping the roads and/or construction areas sprinkled with water at all times.

1.10 CUTTING AND PATCHING

The Contractor shall do all cutting, fitting or patching of his portion of the work that may be required to make the several parts thereof join and coordinate in a manner satisfactory to the County and in accordance with the Plans and Specifications. The work must be done by competent workmen skilled in the trade required by the restoration.

1.11 CLEANING

A. During Construction

During construction of the work, the Contractor shall, at all times, keep the site of the work and adjacent premises as free from material, debris and rubbish as is practicable and shall remove the same from any portion of the site if, in the opinion of the County, such material, debris, or rubbish constitutes a nuisance or is objectionable. The Contractor shall remove from the site all of his surplus materials and temporary structures when no further need therefore develops.

B. Final Cleaning

At the conclusion of the work, all equipment, tools, temporary structures and materials belonging to the Contractor shall be promptly taken away, and he shall remove and promptly dispose of all water, dirt, rubbish or any other foreign substances.

The Contractor shall thoroughly clean all equipment and materials installed by him and shall deliver such materials and equipment undamaged in a bright, clean, polished and new operating condition.

1.12 MISCELLANEOUS

A. Protection Against Siltation and Bank Erosion

1. The Contractor shall arrange his operations to minimize siltation and bank erosion on construction sites and on existing or proposed water courses and drainage ditches.
2. The Contractor, at his own expense, shall remove any siltation deposits and correct any erosion problems as directed by the County which results from his construction operations.

B. Protection of Wetland Areas

The Contractor shall properly dispose of all surplus material, including soil, in accordance with Local, State and Federal regulations. Under no circumstances shall surplus material be disposed of in wetland areas as defined by the Florida Department of Environmental Protection or Southwest Florida Water Management District.

C. Existing Facilities

The work shall be so conducted to maintain existing facilities in operation insofar as is possible. Requirements and schedules of operations for maintaining existing facilities in service during construction shall be as described in the Special Provisions.

D. Use of Chemicals

All chemicals used during project construction or furnished for project operation, whether herbicide, pesticide, disinfectant, polymer, reactant, or of other classification, must show approval of either EPA or USDA. Use of all such chemicals and disposal of residues shall be in strict conformance with instructions.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01010

SUMMARY OF WORK

PART 1 GENERAL

1.01 WORK COVERED BY CONTRACT DOCUMENTS/REQUIREMENTS INCLUDED

- A. The work included in this contract consists of the construction of approximately 550 linear feet (LF) of 20" PVC force main and one precast doghouse manhole to establish a complete and fully functional system. 165 LF of the proposed force main will be installed by jack and bore underneath the existing intersection. Project also includes the restoration of all pavement and concrete that will be disturbed due to construction of force main.
- B. The Contractor shall furnish all shop drawings, working drawings, labor, materials, equipment, tools, services and incidentals necessary to complete all work required by these Specifications and as shown on the Contract Drawings.
- C. The Contractor shall perform the work complete, in place and ready for continuous service and shall include any repairs, replacements, and/or restoration required as a result of damages caused prior to acceptance by the County.
- D. The Contractor shall furnish and install all materials, equipment and labor which is reasonably and properly inferable and necessary for the proper completion of the work, whether specifically indicated in the Contract Documents or not.

1.02 CONTRACTS

Construct all the Work under a single contract.

1.03 WORK SEQUENCE

- A. All work done under this Contract shall be done with a minimum of inconvenience to the users of the system or facility. The Contractor shall coordinate his work with private property owners such that existing utility services are maintained to all users to the maximum extent possible.
- B. The Contractor shall, if necessary and feasible, construct the work in stages to accommodate the County's use of the premises during the construction period; coordinate the construction schedule and operations with the County's Representative.
- C. The Contractor shall, where feasible, construct the Work in stages to provide for public convenience and not close off public use of any facility until completion of construction to provide alternative usage.

1.04 CONSTRUCTION AREAS

- A. The Contractor shall: Limit his use of the construction areas for work and for storage, to allow for:

1. Work by other Contractors.
2. County's Use.
3. Public Use.

- B. Coordinate use of work site under direction of County's Representative.
- C. Assume full responsibility for the protection and safekeeping of products under this Contract, stored on the site.
- D. Move any stored products under the Contractor's control, which interfere with operations of the County or separate contractor.
- E. Obtain and pay for the use of additional storage of work areas needed for Contractor operations.

1.05 COUNTY OCCUPANCY

- A. It is assumed that portions of the Work will be completed prior to completion of the entire Work. Upon completion of construction of each individual facility, including testing, if the County, at its sole discretion, desires to accept the individual facility, the Contractor will be issued a dated certificate of completion and acceptance for each individual facility. The County will assume ownership and begin operation of the individual facility on that date and the three-year guaranty period shall commence on that date. The County has the option of not accepting the entire work as a whole until it is completed, tested and approved by the County.

1.06 PARTIAL COUNTY OCCUPANCY

The Contractor shall schedule his operations for completion of portions of the Work, as designated, for the County's occupancy prior to substantial completion of the entire work.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01015

CONTROL OF WORK

PART 1 GENERAL

1.01 WORK PROGRESS

The Contractor shall furnish personnel and equipment which will be efficient, appropriate and adequately sized to secure a satisfactory quality of work and a rate of progress which will insure the completion of the work within the time stipulated in the Contract. If at any time such personnel appears to the County to be inefficient, inappropriate, or insufficient for securing the quality of work required for producing the rate of progress aforesaid, he may order the Contractor to increase the efficiency, change the character, or increase the personnel and equipment and the Contractor shall conform to such order. Failure of the County to give such order shall in no way relieve the Contractor of his obligations to secure the quality of the work and rate of progress required.

1.02 PRIVATE LAND

The Contractor shall not enter or occupy private land outside of easements, except by permission of the affected property owner.

1.03 WORK LOCATIONS

Work shall be located substantially as indicated on the drawings, but the County reserves the right to make such modifications in locations as may be found desirable to avoid interference with existing structures or for other reasons.

1.04 OPEN EXCAVATIONS

- A. All open excavations shall be adequately safeguarded by providing temporary barricades, caution signs, lights and other means to prevent accidents to persons and damage to property. The Contractor shall, at his own expense, provide suitable and safe bridges and other crossings for accommodating travel by pedestrians and workmen. Bridges provided for access to private property during construction shall be removed when no longer required. If the excavation becomes a hazard, or if it excessively restricts traffic at any point, the County may require special construction procedures such as limiting the length of open trench, prohibiting stacking excavated material in the street and requiring that the trench shall not remain open overnight.
- B. The Contractor shall take precautions to prevent injury to the public due to open trenches. All trenches, excavated material, equipment, or other obstacles which could be dangerous to the public shall be barricaded and well lighted at all times when construction is not in progress.

1.05 DISTRIBUTION SYSTEMS AND SERVICES

- A. The Contractor shall avoid interruptions to water, telephone, cable TV, sewer, gas, or other related utility services. He shall notify the County and the appropriate agency well in

advance of any requirement for dewatering, isolating, or relocating a section of a utility, so that necessary arrangements may be made.

- B. If it appears that utility service will be interrupted for an extended period, the County may order the Contractor to provide temporary service lines at the Contractor's expense. Inconvenience of the users shall be kept to the minimum, consistent with existing conditions. The safety and integrity of the systems are of prime importance in scheduling work.

1.06 PROTECTION AND RELOCATION OF EXISTING STRUCTURES AND UTILITIES

- A. The Contractor shall assume full responsibility for the protection of all buildings, structures and utilities, public or private, including poles, signs, services to building utilities, gas pipes, water pipes, hydrants, sewers, drains and electric and telephone cables and other similar facilities, whether or not they are shown on the Drawings. The Contractor shall carefully support and protect all such structures and utilities from injury of any kind. Any damage resulting from the Contractor's operation shall be repaired by the Contractor at his expense.
- B. The Contractor shall bear full responsibility for obtaining locations of all underground structures and utilities (including existing water services, drain lines and sewers). Services to buildings shall be maintained and all costs or charges resulting from damage thereto shall be paid by the Contractor.
- C. Protection and temporary removal and replacement of existing utilities and structures as described in this Section shall be a part of the work under the Contract and all costs in connection therewith shall be included in the unit prices established in the Bid.
- D. If, in the opinion of the County, permanent relocation of a utility owned by the County is required, he may direct the Contractor, in writing, to perform the work. Work so ordered will be paid for at the Contract unit prices, if applicable, or as extra work as classified in the General Conditions. If relocation of a privately owned utility is required, the County will notify the utility to perform the work as expeditiously as possible. The Contractor shall fully cooperate with the County and utility and shall have no claim for delay due to such relocation. The Contractor shall notify public utility companies in writing at least 48 hours (excluding Saturdays, Sundays and legal holidays) before excavating near their utilities.

1.07 TEST PITS

Test pits for the purpose of locating underground pipeline or structures in advance of the construction shall be excavated and backfilled by the Contractor immediately after the utility location and the surface shall be restored in a manner equal or better than the original condition. No separate payment will be made.

1.08 CARE AND PROTECTION OF PROPERTY

- A. The Contractor shall be responsible for the preservation of all public and private property and shall use every precaution necessary to prevent damage thereto. If any direct or indirect damage is done to public or private property by or on account of any act, omission, neglect, or misconduct in the execution of the work on the part of the Contractor,

such property shall be restored by the Contractor, at his expense, to a condition equal or better to that existing before the damage was done, or he shall make good the damage in another manner acceptable to the County.

- B. All sidewalks which are disturbed by the Contractor's operations shall be restored to their original or better condition by the use of similar or comparable materials. All curbing shall be restored in a condition equal to the original construction and in accordance with the best modern practice.
- C. Along the location of this work, all fences, walks, bushes, trees, shrubbery and other physical features shall be protected and restored in a thoroughly workmanlike manner unless otherwise shown on the drawings. Fences and other features removed by the Contractor shall be replaced in the location indicated by the County as soon as conditions permit. All grass areas beyond the limits of construction which have been damaged by the Contractor shall be regraded and sodded to equal or exceed original conditions.
- D. Trees close to the work which drawings do not specify to be removed, shall be boxed or otherwise protected against injury. The Contractor shall trim all branches that are liable to damage because of his operations, but in no case shall any tree be cut or removed without prior notification to the County. All injuries to bark, trunk, limbs and roots of trees shall be repaired by dressing, cutting and painting according to approved methods, using only approved tools and materials.
- E. The protection, removal and replacement of existing physical features along the line of work shall be a part of the work under the Contract and all costs in connection therewith shall be included in the unit and/or lump sum prices established under the items in the Bid.

1.09 MAINTENANCE OF TRAFFIC

- A. Open pits, trenches, unpaved streets, debris, or other obstructions due to construction that will prevent the normal flow of traffic during an extended construction stoppage, for any reason, shall be minimized. In the event an extended construction stoppage is found to be necessary, Contractor shall, at his own expense, provide normal traffic flow during extended construction stoppage. Extended stoppage will be defined by the County.
- B. All excavated material shall be placed so that vehicular and pedestrian traffic may be maintained at all times. If the Contractor's operations cause traffic hazards, he shall repair the road surface, provide temporary roadways, erect wheel guards or fences, or take other safety measures which are satisfactory to the County.
- C. Any changes to the traffic pattern require a Traffic Control Plan as detailed in section 01570 of this specification..

1.10 WATER FOR CONSTRUCTION PURPOSES

- A. In locations where public water supply is available, the Contractor may purchase water for all construction purposes.
- B. The Contractor shall be responsible for paying for all water tap fees incurred for the purpose of obtaining a potable water service or temporary use meter.

1.11 MAINTENANCE OF FLOW

The Contractor shall at his own cost, provide for the flow of sewers, drains and water courses interrupted during the progress of the work and shall immediately cart away and remove all offensive matter. The entire procedure of maintaining existing flow shall be fully discussed with the County well in advance of the interruption of any flow.

1.12 CLEANUP

During the course of the work, the Contractor shall keep the site of his operations in as clean and neat a condition as is possible. He shall dispose of all residue resulting from the construction work and at the conclusion of the work, he shall remove and haul away any surplus excavation, broken pavement, lumber, equipment, temporary structures and any other refuse remaining from the construction operations and shall leave the entire site of the work in a neat and orderly condition.

1.13 COOPERATION WITHIN THIS CONTRACT

- A. All firms or person authorized to perform any work under this Contract shall cooperate with the General Contractor and his subcontractors or trades and shall assist in incorporating the work of other trades where necessary or required.
- B. Cutting and patching, drilling and fitting shall be carried out where required by the trade or subcontractor having jurisdiction, unless otherwise indicated herein or directed by the County.

1.14 PROTECTION OF CONSTRUCTION AND EQUIPMENT

- A. All newly constructed work shall be carefully protected from injury in any way. No wheeling or walking or placing of heavy loads on it shall be allowed and all portions injured shall be reconstructed by the Contractor at his own expense.
- B. All structures shall be protected in a manner approved by the County. Should any of the floors or other parts of the structures become heaved, cracked, or otherwise damaged, all such damaged portions of the work shall be completely repaired and made good by the Contractor, at his own expense and to the satisfaction of the County. If, in the final inspection of the work, any defects, faults, or omissions are found, the Contractor shall cause the same to be repaired or removed and replaced by proper materials and workmanship without extra compensation for the materials and labor required. Further, the Contractor shall be fully responsible for the satisfactory maintenance and repair of the construction and other work undertaken herein, for at least the warranty period described in the Contract.
- C. Further, the Contractor shall take all necessary precautions to prevent damage to any structure due to water pressure during and after construction and until such structure is accepted and taken over by the County.

1.15 CONSTRUCTION WITHIN RIGHT-OF-WAY

Where pipe lines are installed within FDOT right-of-way, all excavation backfill and compaction for the purpose of reconstructing roadways and/or adjacent slopes contiguous thereto shall be in accordance with FDOT or Manatee County Standards and Specifications, whichever is applicable. Contractor shall satisfy the authorized representative of the FDOT with respect to proper safety procedures, construction methods, required permitting, etc., within the FDOT right-of-way.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01030

SPECIAL PROJECT PROCEDURES

PART 1 GENERAL

1.01 PERMITS

Upon notice of award, the Contractor shall immediately apply for all applicable permits not previously obtained by the County to do the work from the appropriate governmental agency or agencies. No work shall commence until all applicable permits have been obtained and copies delivered to the County. The costs for obtaining all permits shall be borne by the Contractor.

1.02 CONNECTIONS TO EXISTING SYSTEM

The Contractor shall perform all work necessary to locate, excavate and prepare for connections to the existing systems all as shown on the Drawings or where directed by the County. The cost for this work and for the actual connection shall be included in the price bid for the project and shall not result in any additional cost to the County. The termination point for each contract shall be as shown on the Contract Drawings.

1.03 RELOCATIONS

The Contractor shall be responsible for the coordination of the relocation of structures, including but not limited to light poles, power poles, signs, sign poles, fences, piping, conduits and drains that interfere with the positioning of the work as set out on the Drawings. No relocation of the items under this Contract shall be done without approval from the County.

1.04 EXISTING UNDERGROUND PIPING, STRUCTURES AND UTILITIES

- A. The attention of the Contractor is drawn to the fact that during excavation, the possibility exists of the Contractor encountering various utility lines not shown on the Drawings. The Contractor shall exercise extreme care before and during excavation to locate and flag these lines as to avoid damage to the existing lines.
- B. It is the responsibility of the Contractor to ensure that all utility or other poles, the stability of which may be endangered by the close proximity of excavation, are temporarily stayed in position while work proceeds in the vicinity of the pole and that the utility or other companies concerned be given reasonable advance notice.
- C. The existing utility locations are shown without express or implied representation, assurance, or guarantee that they are complete or correct or that they represent a true picture of underground piping to be encountered. The Contractor shall be responsible for notifying the various utility companies to locate their respective utilities in advance of construction in conformance with all requirements provided for in the Florida Underground Facilities Damage Prevention and Safety Act (Florida Statutes, Title XXXIII, Chapter 556).

- D. The existing piping and utilities that interfere with new construction shall be rerouted as shown, specified, or required. Before any piping and utilities not shown on the Drawings are disturbed, the Contractor shall notify the County and shall provide suggestions on how best to resolve the issue.
- E. The Contractor shall exercise care in any excavation to locate all existing piping and utilities. All utilities which do not interfere with complete work shall be carefully protected against damage. Any existing utilities damaged in any way by the Contractor shall be restored or replaced by the Contractor at his expense as directed by the County.
- F. It is intended that wherever existing utilities such as water, sewer, gas, telephone, electrical, or other service lines must be crossed, deflection of the pipe within recommended limits and cover shall be used to satisfactorily clear the obstruction unless otherwise indicated in the Drawings. However, when in the opinion of the County this procedure is not feasible, he may direct the use of fittings for a utilities crossing as detailed on the Drawings. No deflections will be allowed in gravity sanitary sewer lines or in existing storm sewer lines.

1.05 SUSPENSION OF WORK DUE TO WEATHER

Refer to FDOT Standards and Specifications Book, Section 8.

1.06 HURRICANE PREPAREDNESS PLAN

- A. Within 30 days of the date of Notice to Proceed, the Contractor shall submit to the County a Hurricane Preparedness Plan. The plan should outline the necessary measures which the Contractor proposes to perform at no additional cost to the County in case of a hurricane warning.
- B. In the event of inclement weather, or whenever County shall direct, Contractor shall insure that he and his Subcontractors shall carefully protect work and materials against damage or injury from the weather. If, in the opinion of the County, any portion of work or materials is damaged due to the failure on the part of the Contractor or Subcontractors to protect the work, such work and materials shall be removed and replaced at the expense of the Contractor.

1.07 POWER SUPPLY

Electricity as may be required for construction and permanent power supply shall be secured and purchased by the Contractor.

1.08 SALVAGE

Any existing equipment or material, including, but not limited to, valves, pipes, fittings, couplings, etc., which is removed or replaced as a result of construction under this project may be designated as salvage by the County and if so shall be protected for a reasonable time until picked up by the County. Any equipment or material not worthy of salvaging, as directed by the County, shall be disposed of by the Contractor at no additional cost.

1.09 DEWATERING

- A. The Contractor shall do all groundwater pumping necessary to prevent flotation of any part of the work during construction operations with his own equipment.
- B. The Contractor shall pump out water and wastewater which may seep or leak into the excavations for the duration of the Contract and with his own equipment. He shall dispose of this water in an appropriate manner.

1.10 ADDITIONAL PROVISIONS

- A. Before commencing work on any of the existing pipelines, structures or equipment, the Contractor shall notify the County, in writing, at least 10 calendar days in advance of the date he proposes to commence such work.
- B. The Contractor shall provide, at his own expense, all necessary temporary facilities for access to and for protection of, all existing facilities. The County's personnel must have ready access at all times to the existing facilities. The Contractor is responsible for all damage to existing structures, equipment and facilities caused by his construction operations and must repair all such damage when and as ordered by the County.

1.11 CONSTRUCTION CONDITIONS

The Contractor shall strictly adhere to the specific requirements of the governmental unit(s) and/or agency(ies) having jurisdiction over the work. Wherever there is a difference in the requirements of a jurisdictional body and these Specifications, the more stringent shall apply.

1.12 PUBLIC NUISANCE

- A. The Contractor shall not create a public nuisance including but not limited to encroachment on adjacent lands, flooding of adjacent lands, excessive noise or dust.
- B. Sound levels must meet Manatee County Ordinance #87-34, (which amends Ordinance 81-3, The Manatee County Noise Control Ordinance). Sound levels in excess of such ordinance are sufficient cause to have the work halted until equipment can be quieted to these levels. Work stoppage by the County for excessive noise shall not relieve the Contractor of the other portions of this specification.
- C. No extra charge may be made for time lost due to work stoppage resulting from the creation of a public nuisance.

1.13 WARRANTIES

- A. All material supplied under these Specifications shall be warranted by the Contractor and the manufacturers for a period of three (3) years. Warranty period shall commence on the date of County acceptance.

- B. The material shall be warranted to be free from defects in workmanship, design and materials. If any part of the system should fail during the warranty period, it shall be replaced at no expense to the County.
- C. The manufacturer's warranty period shall run concurrently with the Contractor's warranty or guarantee period. No exception to this provision shall be allowed. The Contractor shall be responsible for obtaining warranties from each of the respective suppliers or manufacturers for all the material specified under these contract specifications,
- D. In the event that the manufacturer is unwilling to provide a three-year warranty commencing at the time of County acceptance, the Contractor shall obtain from the manufacturer a four (4) year warranty starting at the time of equipment delivery to the job site. This four-year warranty shall not relieve the Contractor of the three-year warranty starting at the time of County acceptance of the equipment.

1.14 FUEL STORAGE & FILLING

- A. If the contractor is storing fuel on site, or doing his own fuel filling of portable equipment (other than hand-held equipment), he is responsible for any required response, clean-up or reporting required, at no additional cost to the county.
- B. The Contractor shall prepare and submit a fuel storage / spill abatement plan prior to start of construction if required.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01045

CUTTING AND PATCHING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall be responsible for all cutting, fitting and patching, including excavation and backfill, required to complete the work or to:
1. Make its several parts fit together properly.
 2. Uncover portions of the work to provide for installation of ill-timed work.
 3. Remove and replace defective work.
 4. Remove and replace work not conforming to requirements of Contract Documents.
 5. Provide penetrations of non-structural surfaces for installation of piping and electrical conduit.

PART 2 PRODUCTS

2.01 MATERIALS

Comply with specifications and standards for each specific product involved.

PART 3 EXECUTION

3.01 INSPECTION

- A. Inspect existing conditions of project, including elements subject to damage or to movement during cutting and patching.
- B. After uncovering work, inspect conditions affecting installation of products, or performance of work.
- C. Report unsatisfactory or questionable conditions to County. Do not proceed with work until County has provided further instructions.

3.02 PREPARATION

- A. Provide adequate temporary support as necessary to assure structural value to integrity of affected portion of work.
- B. Provide devices and methods to protect other portions of project from damage.
- C. Provide protection from elements for that portion of the project which may be exposed by cutting and patching work and maintain excavations free from water.

3.03 PERFORMANCE

- A. Execute cutting and demolition by methods which will prevent damage to other work and will provide proper surfaces to receive installation of repairs.
- B. Execute excavating and backfilling by methods which will prevent settlement or damage to other work.
- C. Fit and adjust products to provide a finished installation to comply with specified products, functions, tolerances and finishes.
- D. Restore work which has been cut or removed; install new products to provide completed work in accordance with the requirements of the Contract Documents.
- E. Replace surfaces airtight to pipes, sleeves, ducts, conduit and other penetrations through surfaces.
- F. Refinish entire surfaces as necessary to provide an even finish to match adjacent finishes.

END OF SECTION

SECTION 01050

FIELD ENGINEERING AND SURVEYING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall provide and pay for field surveying service required for the project.
- B. The Contractor shall furnish and set all necessary stakes to establish the lines and grades as shown on the Contract Drawings and layout each portion of the Work of the Contract.

1.02 QUALIFICATION OF SURVEYOR AND ENGINEER

All construction staking shall be conducted by or under the supervision of a Florida Registered Professional Surveyor and Mapper. The Contractor shall be responsible for the layout of all such lines and grades, which will be subject to verification by the County.

1.03 SURVEY REFERENCE POINTS

- A. Existing basic horizontal and vertical control points for the Project are designated on the Contract Drawings.
- B. Locate and protect all survey monumentation, property corners and project control points prior to starting work and preserve all permanent reference points during construction. All costs associated with the replacement of all survey monumentation, property corners and project control points shall be borne by the Contractor.

Make no changes or relocations without prior written notice to County.

Report to County when any reference point is lost or destroyed, or requires relocation because of necessary changes in grades or locations.

Require surveyor to replace project control points which may be lost or destroyed.

Establish replacements based on original survey control.

1.04 PROJECT SURVEY REQUIREMENTS

The Contractor shall establish temporary bench marks as needed, referenced to data established by survey control points.

1.05 RECORDS

The Contractor shall employ a Professional Engineer or Surveyor registered in the State of Florida to verify survey data and properly prepare record drawings per Section 01720.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01090

REFERENCE STANDARDS

PART 1 GENERAL

1.01 REQUIREMENTS

Abbreviations and acronyms used in Contract Documents to identify reference standards.

- A. Application: When a standard is specified by reference, comply with requirements and recommendations stated in that standard, except when requirements are modified by the Contract Documents, or applicable codes established stricter standards.
- B. Publication Date: The most recent publication in effect on the date of issue of Contract Documents, except when a specific publication date is specified.

1.03 ABBREVIATIONS, NAMES AND ADDRESSES OR ORGANIZATIONS

Obtain copies of reference standards direct from publication source, when needed for proper performance of work, or when required for submittal by Contract Documents.

AA Aluminum Association
818 Connecticut Avenue, N.W.
Washington, DC 20006

AASHTO American Association of State Highway and Transportation Officials
444 North Capital Street, N.W.
Washington, DC 20001

ACI American Concrete Institute
Box 19150
Reford Station
Detroit, MI 48219

AI Asphalt Institute
Asphalt Institute Building
College Park, MD 20740

AISC American Institute of Steel Construction
1221 Avenue of the Americas
New York, NY 10020

AISI American Iron and Steel Institute
1000 16th Street NW
Washington, DC 20036

ANSI American National Standards Institute
1430 Broadway
New York, NY 10018

ASHRAE	American Society of Heating, Refrigerating and Air Conditioning Engineers 1791 Tullie Circle, N.E. Atlanta, GA 30329
ASME	American Society of Mechanical Engineers 345 East 47th Street New York, NY 10017
ASTM	American Society for Testing and Materials 1916 Race Street Philadelphia, PA 19103
AWWA	American Water Works Association 6666 West Quincy Avenue Denver, CO 80235
AWS	American Welding Society 2501 N.W. 7th Street Miami, FL 33125
CRSI	Concrete Reinforcing Steel Institute 180 North LaSalle Street, Suite 2110 Chicago, IL 60601
FDEP	Florida Department of Environmental Protection 3900 Commonwealth Blvd. Tallahassee, Florida 32399
FDOT	Florida Department of Transportation Standards Specifications for Road and Bridge Construction Maps & Publication Sales - Mail Station 12 605 Suwannee St. Tallahassee, FL 32399-0450
FS	Federal Specification General Services Administration Specifications and Consumer Information Distribution Section (WFSIS) Washington Navy Yard, Bldg. 197 Washington, DC 20407
MCPW UTIL STD	Manatee County Utility Engineering 4410-B 66th St. W. Bradenton, FL 34210
MLSFA	Metal Lath/Steel Framing Association 221 North LaSalle Street Chicago, IL 60601
MMA	Monorail Manufacturer's Association

1326 Freeport Road
Pittsburgh, PA 15238

- NAAMM National Association of Architectural Metal Manufacturers
221 North LaSalle Street
Chicago, IL 60601
- NEMA National Electrical Manufacturer's Assoc.
2101 L Street N.W.
Washington, DC 20037
- OHSA Occupational Safety and Health Assoc.
5807 Breckenridge Pkwy., Suite A
Tampa, FL 33610-4249
- PCA Portland Cement Association
5420 Old Orchard Road
Skokie, IL 20076
- PCI Prestressed Concrete Institute
20 North Wacker Drive
Chicago, IL 60606
- SDI Steel Door Institute
712 Lakewood Center North
Cleveland, OH 44107
- SMACNA Sheet Metal and Air Conditioning Contractor's National Association
8224 Old Court House Road
Vienna, VA 22180
- SSPC Steel Structures Painting Council
402 24th Street, Suite 600
Pittsburgh, PA 15213
- SWFWMD Southwest Florida Water Management District
2379 Broad Street
Brooksville, FL 34604-6899
- UL Underwriter's Laboratories, Inc.
333 Pfingston Road
Northbrook, IL 60062

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01150

MEASUREMENT AND PAYMENT

PART 1 GENERAL

1.01 SCOPE

- A. The scope of this section of the Contract Documents is to further define the items included in each Bid Item in the Bid Form section of the Contract Documents. Payment will be made based on the specified items included in the description in this section for each bid item.
- B. All contract prices included in the Bid Form section will be full compensation for all shop drawings, working drawings, labor, materials, tools, equipment and incidentals necessary to complete the construction as shown on the Drawings and/or as specified in the Contract Documents to be performed under this Contract. Actual quantities of each item bid on a unit price basis will be determined upon completion of the construction in the manner set up for each item in this section of the Specifications. Payment for all items listed in the Bid Form will constitute full compensation for all work shown and/or specified to be performed under this Contract.

1.02 ESTIMATED QUANTITIES

The quantities shown are approximate and are given only as a basis of calculation upon which the award of the Contract is to be made. The County does not assume any responsibility for the final quantities, nor shall the Contractor claim misunderstanding because of such estimate of quantities. Final payment will be made only for satisfactorily completed quantity of each item.

1.03 WORK OUTSIDE AUTHORIZED LIMITS

No payment will be made for work constructed outside the authorized limits of work.

1.04 MEASUREMENT STANDARDS

Unless otherwise specified for the particular items involved, all measurements of distance shall be taken horizontally or vertically.

1.05 AREA MEASUREMENTS

In the measurement of items to be paid for on the basis of area of finished work, the lengths and/or widths to be used in the calculations shall be the final dimensions measured along the surface of the completed work within the neat lines shown or designated.

1.06 LUMP SUM ITEMS

Where payment for items is shown to be paid for on a lump sum basis, no separate payment will be made for any item of work required to complete the lump sum items. Lump sum contracts shall be complete, tested and fully operable prior to request for final payment. Contractor may be required to provide a break-down of the lump sum totals.

1.07

UNIT PRICE ITEM

Separate payment will be made for the items of work described herein and listed on the Bid Form. Any related work not specifically listed, but required for satisfactory completion of the work shall be considered to be included in the scope of the appropriate listed work items.

No separate payment will be made for the following items and the cost of such work shall be included in the applicable pay items of work. Final payments shall not be requested by the Contractor or made by the County until as-built (record) drawings have been submitted and approved by the County.

1. Shop Drawings, Working Drawings.
2. Clearing, grubbing and grading except as hereinafter specified.
3. Trench excavation, including necessary pavement removal and rock removal, except as otherwise specified.
4. Dewatering and disposal of surplus water.
5. Structural fill, backfill, and grading.
6. Replacement of unpaved roadways, and shrubbery plots.
7. Cleanup and miscellaneous work.
8. Foundation and borrow materials, except as hereinafter specified.
9. Testing and placing system in operation.
10. Any material and equipment required to be installed and utilized for the tests.
11. Pipe, structures, pavement replacement, asphalt and shell driveways and/or appurtenances included within the limits of lump sum work, unless otherwise shown.
12. Maintaining the existing quality of service during construction.
13. Maintaining or detouring of traffic.
14. Appurtenant work as required for a complete and operable system.
15. Seeding and hydro mulching.
16. As-built Record Drawings.

BID ITEM NO. 1- MOBILIZATION

Measurement and payment for this Bid Item shall include full compensation for the required 100 percent (100%) Performance Bond, 100 Percent (100%) Payment Bond, all required insurance for the project and the Contractor's mobilization and demobilization costs as shown in the Bid Form. Mobilization includes, but it not limited to: preparation and movement of personnel, equipment, supplies and incidentals such as safety and sanitary supplies/facilities.

Payment for mobilization shall not exceed 10 percent (10%) of the total Contract cost unless the Contractor can prove to the County that his actual mobilization cost exceeds 10 percent (10%).

Partial payments for this Bid Item will be made in accordance with the following schedule:

Percent of Original Contract Amount:	Percent Allowable Payment of Mobilization/Demobilization Bid Item Price:
5	25
10	35
25	45
50	50
75	75
100	100

These payments will be subject to the standard retainage provided in the Contract. Payment of the retainage will be made after completion of the work and demobilization.

BID ITEM NO. 2 - MAINTENANCE OF TRAFFIC

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the lump sum price bid for all maintenance of traffic, including coordination with the City of Bradenton and FDOT and all equipment and manpower necessary to comply with the FDOT Design Standards 600 Series.

Measurement for periodic payments of this lump sum bid item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor in accordance with the Contract Documents.

BID ITEM NO. 3 - EROSION AND SEDIMENT CONTROL

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the lump sum price bid for erosion and sediment control.

Measurement for periodic payments of this lump sum bid item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor in accordance with the Contract Documents.

BID ITEM NO. 4 - 20" PVC DR 21 FORCE MAIN

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price bid per the schedule of prices for furnishing and installing the listed diameter PVC force main (AWWA C-900, CL-150 or C-905, CL-235) pipe as shown on the Contract Drawings and listed on the Bid Form. Measurement and Payment shall be made for the actual length of the listed diameter pipe and installed and will represent full compensation for all labor, materials, excavation, including rock, dewatering, bedding, backfill, compaction, testing and equipment required to complete these Bid Items. No additional compensation shall be made for excavation below the bottom of the pipe, for rock removal or bedding and backfill material, or for repair of any trench settlement.

BID ITEM NO. 5 - 20" PIPE RESTRAINTS

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price bid

per each restraint required to restrain the piping required by the Contract Drawings. Measurement will be based on each complete restraint furnished and installed except where specifically included in another pay item. Payment shall represent full compensation for all labor, material, equipment, excavation, including rock, bedding, backfill, compaction, and testing required to complete this Bid Item. This Bid Item includes the installation of restraints (EBAA Iron or equal) used in restraining PVC and ductile iron pipe of the specified type acceptably furnished and installed as shown on the drawings or where directed by the Project Representative and in accordance with the pipe and restraint manufacturer's requirements. The work shall include, but is not limited to, all bolts, nuts, washers, gaskets, and all other related and necessary materials, work and equipment required or associated with this item.

BID ITEM NO. 6 - DUCTILE IRON FITTINGS

Payment for all work included in these Bid Items will be made at the applicable Contract unit price bid for furnishing and installing each listed ductile iron fitting (epoxy lined) as shown on the Contract Drawings and listed on the Bid Form. Payment will be made for each fitting installed and will represent full compensation for all labor, material, excavation, including rock, bedding, backfill, compaction, testing and equipment required to complete these Bid Items.

BID ITEM NO. 7 - 6" SEWER SERVICE LATERAL AND CLEANOUTS

Payment for work included under this Bid Item shall be made at the Contract unit price bid for each single or double sewer service lateral and connection at the main line sewer, 6-inch diameter service line to the location designated on the Contract Drawings or as alternately requested by the property owner, and including all bends, fittings, structures, concrete encasement, the vertical extension, cap and concrete pad at the surface, all as shown on the service connection detail on the Contract Drawings and all other appurtenances including all labor, equipment, and materials necessary to complete each service connection. The elevation depth below grade as shown in the service connection detail on the Contract Drawings for the lateral invert shall be maintained by the Contractor installing the sanitary sewer service line.

All service locations shown on the Contract Drawings are approximate and it shall be the responsibility of the Contractor to contact all homeowners and businesses for locating the owner's septic tank and determine, subject to approval by the County, the best locations and depth for each service lateral. Locations of all connections at the main line sewer and at the property line by station and offset method shall be recorded on the as-built drawings to be furnished to County by the Contractor.

Also included in payment shall be all excavation, including rock as necessary, bedding, backfill, compaction, testing, extensions and caps all as shown on the Contract Drawings, furnished and installed watertight, ready for approval by the County acceptance.

BID ITEM NO. 8 - GROUT FILL ABANDONED 16" FORCE MAIN AND MANHOLE

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the unit price bid per cubic yard of grout fill that is required for abandoned 16" force main, manhole, and 24" sewer main.

Measurement for the grout fill shall be per cubic yard as shown on the Contract Drawings or as ordered by the Engineer in writing.

BID ITEM NO. 9 - DOG HOUSE CONCRETE MANHOLE

Payment for work under this Bid Item shall be made at the Contract unit price bid for each manhole furnished and installed including frame and cover, construction of invert, all protective liners, drop connections, sealing of lift holes, rainwater protector, etc.

Measurement shall be for each manhole installed complete and accepted. Payment shall be made per unit price for the category of depth as determined by the proposed rim and invert. All stubs and plugs shown or called for on the Contract Drawings shall be included in the unit price bid for manholes. Excavation, including rock as necessary, bedding, backfill, dewatering, sheeting, testing and any and all other items necessary for a completed system in accordance with the Contract Documents shall be included. Payment shall represent full compensation for all labor, materials, equipment and incidental items necessary to complete each concrete manhole structure, ready for approval and service by the County.

BID ITEM NO. 10 - JACK AND BORE WITH 36" STEEL CASING

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the unit price bid per length foot of jack and boring including the jack and bore, 36" steel casing, 20" PVC DR 21 Piping, casing spacers, and end seals, as well as the cost to remove and replace existing traffic loop.

Measurement for the jack and bore shall be per length foot as shown on the Contract Drawings or as ordered by the Engineer in writing. Excavation, including rock as necessary, bedding, backfill, dewatering, sheeting, testing and any and all other items necessary for a completed system in accordance with the Contract Documents shall be included. Payment shall represent full compensation for all labor, materials, equipment and incidental items necessary to complete each concrete manhole structure, ready for approval and service by the County.

BID ITEM NO. 11 - CORE MANHOLE FOR PROPOSED PIPE CONNECTION

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the unit price bid for the modification of the manhole to allow for all pipe connections.

Measurement for the meter assembly's shall be per core required as shown on the Contract Drawings or as ordered by the Engineer in writing.

BID ITEM NO.12 - CONCRETE DRIVEWAY/SIDEWALK RESTORATION

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the unit price bid per length foot of concrete driveway/ sidewalk replacement. Maximum horizontal opening for cut is 8 feet.

Measurement for the concrete driveway/sidewalk repair shall be per length foot as shown on the Contract Drawings or as ordered by the Engineer in writing.

BID ITEM NO. 13 - PAVEMENT REPAIR AND ROAD RESTORATION (BASE & RESURFACE)

Payment for all work included under this Bid Item will be made at the Contract unit price bid per square yard of base, subbase and tonnage of asphalt for furnishing, installing and testing the road restoration pavement section within these Specifications and as listed on the Bid Form. Measurement will be based on the actual number of square yards of road restoration (base and resurfacing) installed, tested, complete and approved. The measurement will be from face of curb to face of curb or as specified, but not greater than the width of the existing roadway prior to construction. Payment will include complete restoration of the roadway section in accordance with the applicable details on the Contract Drawings, but not less than 1-1/2 inches of FDOT Type III asphaltic concrete, the necessary base, subbase or compacted suitable excavation material all in accordance with these Specifications. No payment for restoration of a private driveway within or outside the right-of-way shall be made under this Bid Item. Payment shall include all items and incidentals necessary to complete the road restoration in accordance with the requirements of Manatee County ready for approval and acceptance by the County.

BID ITEM NO. 14 - PAVEMENT REPAIR AND ROAD RESTORATION (MILL & RESURFACE)

Payment for all work included under this Bid Item will be made at the Contract unit price bid per square yard of base, subbase and tonnage of asphalt for furnishing, installing and testing the road restoration pavement section within these Specifications and as listed on the Bid Form. Measurement will be based on the actual number of square yards of road restoration (milling and resurfacing) installed, tested, complete and approved. The measurement will be from face of curb to face of curb or as specified, but not greater than the width of the existing roadway prior to construction. Payment will include complete restoration of the roadway section in accordance with the applicable details on the Contract Drawings, but not less than 1-1/2 inches of FDOT Type III asphaltic concrete, the necessary base, subbase or compacted suitable excavation material all in accordance with these Specifications. No payment for restoration of a private driveway within or outside the right-of-way shall be made under this Bid Item. Payment shall include all items and incidentals necessary to complete the road restoration in accordance with the requirements of Manatee County ready for approval and acceptance by the County.

BID ITEM NO. 15 - SODDING

Payment for all work included in these Bid Items will be made at the applicable Contract unit price bid per square yard for furnishing and installing sodding as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation for all labor, materials, necessary equipment, and incidentals necessary to complete the work, ready for approval and acceptance by the County.

BID ITEM NO. 16 - TREE AND SHRUB REPLACEMENT

Payment for all work included in these Bid Items will be made at the applicable Contract unit price bid per tree/shrub as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation for all labor, materials, necessary equipment, and incidentals necessary to complete the work, ready for approval and acceptance by the County.

BID ITEM NO. 17 - CURB AND GUTTER REPLACEMENT

Payment for all work included in this Bid Item will be made at the applicable Contract unit price bid per linear foot for removal of existing curbing and for furnishing and placing the Type F curb as shown on the Drawings and listed on the Bid Form. Measurement will be per actual number of linear feet of Type F curbing installed. Payment shall represent full compensation for removal of existing curb and all labor, material and equipment for compacting subgrade, forming, furnishing, placing the concrete, and finishing as specified and all incidentals necessary for completion of this Bid Item, ready for approval and acceptance by the County.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01152

REQUESTS FOR PAYMENT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Submit Applications for Payment to the Project Manager or as directed at the preconstruction meeting, in accordance with the schedule established by Conditions of the Contract and Agreement between County and Contractor.

1.02 FORMAT AND DATA REQUIRED

- A. Submit payment requests in the form provided by the County with itemized data typed in accordance with the Bid Form.
- B. Provide construction photographs in accordance with Contract Documents.

1.03 SUBSTANTIATING DATA FOR PROGRESS PAYMENTS

- A. When the County requires substantiating data, Contractor shall submit suitable information with a cover letter.
- B. Submit one copy of data and cover letter for each copy of application.

1.04 PREPARATION OF APPLICATION FOR FINAL PAYMENT

Fill in application form as specified for progress payments.

1.05 SUBMITTAL PROCEDURE

- A. Submit applications for payment at the times stipulated in the Agreement.
- B. Number: Three (3) copies of each application; all signed and certified by the Contractor.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01153

CHANGE ORDER PROCEDURES

PART 1 GENERAL

1.01 DEFINITION

- A. Change Order: Change in contract scope, price or time that must be approved and executed by the Project Representative before it becomes effective.
- B. Administrative Change Adjustment: Minor change order under 10% of project cost or 20% time, does not have to be Board approved.
- C. Field Order: Change to contract quantity that does not require a change of price or time extension.

1.02 REQUIREMENTS INCLUDED

- A. The Contractor shall promptly implement change order procedures:
 - 1. Provide full written data required to evaluate changes.
 - 2. Maintain detailed records of work done on a time-and-material/force account basis.
 - 3. Provide full documentation to County on request.
- B. The Contractor shall designate a member of the Contractor's organization who:
 - 1. Is authorized to accept changes to the Work.
 - 2. Is responsible for informing others in the Contractor's employ of the authorized changes into the Work.

1.03 PRELIMINARY PROCEDURES

- A. Project Manager may initiate changes by submitting a Request to Contractor. Request will include:
 - 1. Detailed description of the change, products, costs and location of the change in the Project.
 - 2. Supplementary or revised Drawings and Specifications.
 - 3. The projected time extension for making the change.
 - 4. A specified period of time during which the requested price will be considered valid.
 - 5. Such request is for information only and is not an instruction to execute the changes, nor to stop work in progress.
- B. Contractor may initiate changes by submitting a written notice to the Project Manager, containing:
 - 1. Description of the proposed changes.
 - 2. Statement of the reason for making the changes.

3. Statement of the effect on the Contract Sum and the Contract Time.
4. Statement of the effect on the work of separate contractors.
5. Documentation supporting any change in Contract Sum or Contract Time, as appropriate.

1.04 FIELD ORDER CHANGE

- A. In lieu of a Change Order, the Project Manager may issue a Field Order for the Contractor to proceed with additional work within the original intent of the Project.
- B. Field Order will describe changes in the work, with attachments of backup information to define details of the change.
- C. Contractor must sign and date the Field Order to indicate agreement with the terms therein.

1.05 DOCUMENTATION OF PROPOSALS AND CLAIMS

- A. Support each quotation for a lump sum proposal and for each unit price which has not previously been established, with sufficient substantiating data to allow the County to evaluate the quotation.
- B. On request, provide additional data to support time and cost computations:
 1. Labor required.
 2. Equipment required.
 3. Products required.
 - a. Recommended source of purchase and unit cost.
 - b. Quantities required.
 4. Taxes, insurance and bonds.
 5. Credit for work deleted from Contract, similarly documented.
 6. Overhead and profit.
 7. Justification for any change in Contract Time.
- C. Support each claim for additional costs and for work done on a time-and-material/force account basis, with documentation as required for a lump-sum proposal.
 1. Name of the County's authorized agent who ordered the work and date of the order.
 2. Date and time work was performed and by whom.
 3. Time record, summary of hours work and hourly rates paid.
 4. Receipts and invoices for:
 - a. Equipment used, listing dates and time of use.
 - b. Products used, listing of quantities.
 - c. Subcontracts.

1.06 PREPARATION OF CHANGE ORDERS

- A. Project Manager will prepare each Change Order.

- B. Change Order will describe changes in the Work, both additions and deletions, with attachments as necessary to define details of the change.
- C. Change Order will provide an accounting of the adjustment in the Contract Sum and in the Contract Time.

1.07 LUMP SUM/FIXED PRICE CHANGE ORDER

- A. Project Manager initiates the form, including a description of the changes involved and attachments based upon documents and proposals submitted by the Contractor, or requests from the County, or both.
- B. Once the form has been completed, all copies should be sent to Contractor for approval. After approval by Contractor, all copies should be sent to County for approval. The County will distribute executed copies after approval by the Board of County Commissioners.

1.08 UNIT PRICE CHANGE ORDER

- A. Contents of Change Orders will be based on, either:
 - 1. County's definition of the scope of the required changes.
 - 2. Contractor's Proposal for a change, as approved by the County.
 - 3. Survey of completed work.
- B. The amounts of the unit prices to be:
 - 1. Those stated in the Agreement.
 - 2. Those mutually agreed upon between County and Contractor.

1.09 TIME AND MATERIAL/FORCE ACCOUNT CHANGE ORDER/CONSTRUCTION CHANGE AUTHORIZATION

- A. At completion of the change, Contractor shall submit itemized accounting and supporting data as provided in the Article "Documentation of Proposals and Claims" of this Section.
- B. County will determine the allowable cost of such work, as provided in General Conditions and Supplementary Conditions.
- C. County will sign and date the Change Order to establish the change in Contract Sum and in Contract Time.
- D. County and Contractor will sign and date the Change Order to indicate their agreement therewith.

1.10 CORRELATION WITH CONTRACTOR'S SUBMITTALS

- A. Periodically revise Schedule of Values and Application for Payment forms to record each change as a separate item of work, and to record the adjusted Contract Sum.

- B. Periodically revise the Construction Schedule to reflect each change in Contract Time. Revise sub schedules to show changes for other items of work affected by the changes.
- C. Upon completion of work under a Change Order, enter pertinent changes in Record Documents.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01200

PROJECT MEETINGS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The County shall schedule the pre-construction meeting, periodic progress meetings and special meetings, if required, throughout progress of work.
- B. Representatives of contractors, subcontractors and suppliers attending meetings shall be qualified and authorized to act on behalf of the entity each represents.
- C. The Contractor shall attend meetings to ascertain that work is expedited consistent with Contract Documents and construction schedules.

1.02 PRE-CONSTRUCTION MEETING

- A. Attendance:
 - 1. County's Engineer.
 - 2. County's Project Manager
 - 3. Contractor.
 - 4. Resident Project Representative.
 - 5. Related Labor Contractor's Superintendent.
 - 6. Major Subcontractors.
 - 7. Major Suppliers.
 - 8. Others as appropriate.
- B. Suggested Agenda:
 - 1. Distribution and discussion of:
 - a. List of major subcontractors.
 - b. Projected Construction Schedules.
 - c. Coordination of Utilities
 - 2. Critical work sequencing.
 - 3. Project Coordination.
 - a. Designation of responsible personnel.
 - b. Emergency contact persons with phone numbers.
 - 4. Procedures and processing of:
 - a. Field decisions.
 - b. Submittals.
 - c. Change Orders.
 - d. Applications for Payment.
 - 5. Procedures for maintaining Record Documents.
 - 6. Use of premises:
 - a. Office, work and storage areas.
 - b. County's REQUIREMENTS.
 - 7. Temporary utilities.

8. Housekeeping procedures.
9. Liquidated damages.
10. Equal Opportunity Requirements.
11. Laboratory testing.
12. Project / Job meetings: Progress meeting, other special topics as needed.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01310

CONSTRUCTION SCHEDULE & PROJECT RESTRAINTS

PART 1 GENERAL

1.01 GENERAL

- A. Construction under this contract must be coordinated with the County and accomplished in a logical order to maintain utilization and flow through existing facilities and public properties and rights-of-way and to allow construction to be completed within the time allowed by Contract Documents and in the manner set forth in the Contract.

1.02 CONSTRUCTION SCHEDULING GENERAL PROVISIONS

- A. No work shall be done between 7:00 p.m. and 7:00 a.m. nor on weekends or legal holidays without written permission of the County. However, emergency work may be done without prior permission.
- B. Night work may be established by the Contractor as regular procedure with the written permission of the County. Such permission, however, may be revoked at any time by the County if the Contractor fails to maintain adequate equipment and supervision for the proper execution and control of the work at night.
- C. Due to potential health hazards and requirements of the State of Florida and the U.S. Environmental Protection Agency, existing facilities must be maintained in operation.
- D. The Contractor shall be fully responsible for providing all temporary piping, plumbing, electrical hook-ups, lighting, temporary structure, or other materials, equipment and systems required to maintain the existing facility's operations. All details of temporary piping and temporary construction are not necessarily shown on the Drawings or covered in the Specifications. However, this does not relieve the Contractor of the responsibility to insure that construction will not interrupt proper facility operations.
- E. The Contractor shall designate an authorized representative of his firm who shall be responsible for development and maintenance of the schedule and of progress and payment reports. This representative of the Contractor shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the commitments of the Contractor's schedule.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. The Contractor shall submit a critical path schedule as described herein.
- B. The planning, scheduling, management and execution of the work is the sole responsibility of the Contractor. The progress schedule requirement is established to allow County to review Contractor's planning, scheduling, management and execution of the work; to assist County in evaluating work progress and make progress payments and

to allow other contractors to cooperate and coordinate their activities with those of the Contractor.

2.02 FORM OF SCHEDULES

- A. Prepare schedules using the latest version of Microsoft Project, or other County approved software, in the form of a horizontal bar chart diagram. The diagram shall be time-scaled and sequenced by work areas. Horizontal time scale shall identify the first work day of each week.
- B. Activities shall be at least as detailed as the Schedule of Values. Activity durations shall be in whole working days. In addition, man-days shall be shown for each activity or tabulated in an accompanying report.
- C. Diagrams shall be neat and legible and submitted on sheets at least 8-1/2 inches by 11 inches suitable for reproduction. Scale and spacing shall allow space for notations and future revisions.

2.03 CONTENT OF SCHEDULES

- A. Each monthly schedule shall be based on data as of the last day of the current pay period.
- B. Description for each activity shall be brief, but convey the scope of work described.
- C. Activities shall identify all items of work that must be accomplished to achieve substantial completion, such as items pertaining to Contractor's installation and testing activities; items pertaining to the approval of regulatory agencies; contractor's time required for submittals, fabrication and deliveries; the time required by County to review all submittals as set forth in the Contract Documents; items of work required of County to support pre-operational, startup and final testing; time required for the relocation of utilities. Activities shall also identify interface milestones with the work of other contractors performing work under separate contracts with County.
- D. Schedules shall show the complete sequence of construction by activities. Dates for beginning and completion of each activity shall be indicated as well as projected percentage of completion for each activity as of the first day of each month.
- E. Submittal schedule for shop drawing review, product data, and samples shall show the date of Contractor submittal and the date approved submittals will be required by the County, consistent with the time frames established in the Specifications.
- F. For Contract change orders granting time extensions, the impact on the Contract date(s) shall equal the calendar-day total time extension specified for the applicable work in the Contract change orders.
- G. For actual delays, add activities prior to each delayed activity on the appropriate critical path(s). Data on the added activities of this type shall portray all steps leading to the delay and shall further include the following: separate activity identification, activity description indicating cause of the delay, activity duration consistent with whichever set of dates below applies, the actual start and finish dates of the delay or, if the delay is not finished,

the actual start date and estimated completion date.

- H. For potential delays, add an activity prior to each potentially delayed activity on the appropriate critical path(s). Data for added activities of this type shall include alternatives available to mitigate the delay including acceleration alternatives and further show the following: separate activity identification, activity description indicating cause of the potential delay and activity duration equal to zero work days.

2.04 SUPPORTING NARRATIVE

- A. Status and scheduling reports identified below shall contain a narrative to document the project status, to explain the basis of Contractor's determination of durations, describe the Contract conditions and restraints incorporated into the schedule and provide an analysis pertaining to potential problems and practical steps to mitigate them.
- B. The narrative shall specifically include:
 - 1. Actual completion dates for activities completed during the monthly report period and actual start dates for activities commenced during the monthly report period.
 - 2. Anticipated start dates for activities scheduled to commence during the following monthly report period.
 - 3. Changes in the duration of any activity and minor logic changes.
 - 4. The progress along the critical path in terms of days ahead or behind the Contract date.
 - 5. If the Monthly Status Report indicates an avoidable delay to the Contract completion date or interim completion dates as specified in the Agreement, Contractor shall identify the problem, cause and the activities affected and provide an explanation of the proposed corrective action to meet the milestone dates involved or to mitigate further delays.
 - 6. If the delay is thought to be unavoidable, the Contractor shall identify the problem, cause, duration, specific activities affected and restraints of each activity.
 - 7. The narrative shall also discuss all change order activities whether included or not in the revised/current schedule of legal status. Newly introduced change order work activities and the CPM path(s) that they affect, must be specifically identified. All change order work activities added to the schedule shall conform with the sequencing and Contract Time requirements of the applicable Change Order.
 - 8. Original Contract date(s) shall not be changed except by Contract change order. A revision need not be submitted when the foregoing situations arise unless required by County. Review of a report containing added activities will not be construed to be concurrence with the duration or restraints for such added activities; instead the corresponding data as ultimately incorporated into the applicable Contract change order shall govern.
 - 9. Should County require additional data, this information shall be supplied by Contractor within 10 calendar days.

2.05 SUBMITTALS

- A. Contractor shall submit estimated and preliminary progress schedules (as identified in the Terms and Conditions of the Contract and the General Conditions), monthly status

reports, a start-up schedule and an as-built schedule report all as specified herein.

- B. All schedules, including estimated and preliminary schedules, shall be in conformance with the Contract Documents.
- C. The finalized progress schedule discussed in the Contract Documents shall be the first monthly status report and as such shall be in conformance with all applicable specifications contained herein.
- D. Monthly Status Report submittals shall include a time-scaled (days after notice to proceed) diagram showing all contract activities and supporting narrative. The initial detailed schedule shall use the notice to proceed as the start date. The finalized schedule, if concurred with by County, shall be the work plan to be used by the contractor for planning, scheduling, managing and executing the work.
- E. The schedule diagram shall be formatted as above. The diagram shall include (1) all detailed activities included in the preliminary and estimated schedule submittals, (2) calendar days prior to substantial completion, (3) summary activities for the remaining days. The critical path activities shall be identified, including critical paths for interim dates, if possible.
- F. The Contractor shall submit progress schedules with each application for payment.

2.06 MONTHLY STATUS REPORTS

- A. Contractor shall submit detailed schedule status reports on a monthly basis with the Application for Payment. The first such status report shall be submitted with the first Application for Payment and include data as of the last day of the pay period. The Monthly Report shall include a "marked-up" copy of the latest detailed schedule of legal status and a supporting narrative including updated information as described above. The Monthly Report will be reviewed by County and Contractor at a monthly schedule meeting and Contractor will address County's comments on the subsequent monthly report. Monthly status reports shall be the basis for evaluating Contractor's progress.
- B. The "marked-up" diagram shall show, for the latest detailed schedule of legal status, percentages of completion for all activities, actual start and finish dates and remaining durations, as appropriate. Activities not previously included in the latest detailed schedule of legal status shall be added, except that contractual dates will not be changed except by change order. Review of a marked-up diagram by County will not be construed to constitute concurrence with the time frames, duration, or sequencing for such added activities; instead the corresponding data as ultimately incorporated into an appropriate change order shall govern.

2.07 STARTUP SCHEDULE

- A. At least 60 calendar days prior to the date of substantial completion, Contractor shall submit a time-scaled (days after notice to proceed) diagram detailing the work to take place in the period between 60 days prior to substantial completion, together with a supporting narrative. County shall have 10 calendar days after receipt of the submittal to respond. Upon receipt of County's comments, Contractor shall make the necessary

revisions and submit the revised schedule within 10 calendar days. The resubmittal, if concurred with by County, shall be the Work Plan to be used by Contractor for planning, managing, scheduling and executing the remaining work leading to substantial completion.

- B. The time-scaled diagram shall use the latest schedule of legal status for those activities completed ahead of the last 60 calendar days prior to substantial completion and detailed activities for the remaining 60-day period within the time frames outlined in the latest schedule of legal status.
- C. Contractor will be required to continue the requirement for monthly reports, as outlined above. In preparing this report, Contractor must assure that the schedule is consistent with the progress noted in the startup schedule.

2.08 REVISIONS

- A. All revised Schedule Submittals shall be made in the same form and detail as the initial submittal and shall be accompanied by an explanation of the reasons for such revisions, all of which shall be subject to review and concurrence by County. The revision shall incorporate all previously made changes to reflect current as-built conditions. Minor changes to the approved submittal may be approved at monthly meetings; a minor change is not considered a revision in the context of this paragraph.
- B. A revised schedule submittal shall be submitted for review when required by County.

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01340

SHOP DRAWINGS, PROJECT DATA AND SAMPLES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall submit to the County for review and approval: working drawings, shop drawings, test reports and data on materials and equipment (hereinafter in this section called data), and material samples (hereinafter in this section called samples) as are required for the proper control of work, including, but not limited to those working drawings, shop drawings, data and samples for materials and equipment specified elsewhere in the Specifications and in the Contract Drawings.
- B. The Contractor is to maintain an accurate updated submittal log and will bring this log to each scheduled progress meeting with the County. This log should include the following items:
 - 1. Submittal description and number assigned.
 - 2. Date to County.
 - 3. Date returned to Contractor (from County).
 - 4. Status of Submittal (No exceptions taken, returned for confirmation or resubmittal, rejected).
 - 5. Date of Resubmittal and Return (as applicable).
 - 6. Date material released (for fabrication).
 - 7. Projected date of fabrication.
 - 8. Projected date of delivery to site.
 - 9. Projected date and required lead time so that product installation does not delay contact.
 - 10. Status of O&M manuals submitted.

1.03 CONTRACTOR'S RESPONSIBILITY

- A. It is the duty of the Contractor to check all drawings, data and samples prepared by or for him before submitting them to the County for review. Each and every copy of the Drawings and data shall bear Contractor's stamp showing that they have been so checked. Shop drawings submitted to the County without the Contractor's stamp will be returned to the Contractor for conformance with this requirement. Shop drawings shall indicate any deviations in the submittal from requirements of the contract Documents.
- B. Determine and verify:
 - 1. Field measurements.
 - 2. Field construction criteria.
 - 3. Catalog numbers and similar data.
 - 4. Conformance with Specifications and indicate all variances from the Specifications.
- C. The Contractor shall furnish the County a schedule of Shop Drawing submittals fixing the respective dates for the submission of shop and working drawings, the beginning of

manufacture, testing and installation of materials, supplies and equipment. This schedule shall indicate those that are critical to the progress schedule.

- D. The Contractor shall not begin any of the work covered by a drawing, data, or a sample returned for correction until a revision or correction thereof has been reviewed and returned to him, by the County, with No Exceptions Taken or Approved As Noted.
- E. The Contractor shall submit to the County all drawings and schedules sufficiently in advance of construction requirements to provide no less than twenty-one (21) calendar days for checking and appropriate action from the time the County receives them.
- F. All material & product submittals, other than samples, may be transmitted electronically as a pdf file. All returns to the contractor will be as a pdf file only unless specifically requested otherwise.
- G. The Contractor shall be responsible for and bear all cost of damages which may result from the ordering of any material or from proceeding with any part of work prior to the completion of the review by County of the necessary Shop Drawings.

1.04 COUNTY'S REVIEW OF SHOP DRAWINGS AND WORKING DRAWINGS

- A. The County's review of drawings, data and samples submitted by the Contractor shall cover only general conformity to the Specifications, external connections and dimensions which affect the installation.
- B. The review of drawings and schedules shall be general and shall not be construed:
 - 1. As permitting any departure from the Contract requirements.
 - 2. As relieving the Contractor of responsibility for any errors, including details, dimensions and materials.
 - 3. As approving departures from details furnished by the County, except as otherwise provided herein.
- C. If the drawings or schedules as submitted describe variations and show a departure from the Contract requirements which the County finds to be in the interest of the County and to be so minor as not to involve a change in Contract Price or time for performance, the County may return the reviewed drawings without noting any exception.
- D. When reviewed by the County, each of the Shop and Working Drawings shall be identified as having received such review being so stamped and dated. Shop Drawings stamped "REJECTED" and with required corrections shown shall be returned to the Contractor for correction and resubmittal.
- E. Resubmittals will be handled in the same manner as first submittals. On resubmittals, the Contractor shall direct specific attention, in writing or on resubmitted Shop Drawings, to revisions other than the corrections requested by the County on previous submissions. The Contractor shall make any corrections required by the County.

- F. If the Contractor considers any correction indicated on the drawings to constitute a change to the Contract Drawings or Specifications, the Contractor shall give written notice thereof to the County.
- G. The County shall review a submittal/resubmittal a maximum of three (3) times after which cost of review shall be borne by the Contractor. The cost of engineering shall be equal to the County's actual payroll cost.
- H. When the Shop and Working Drawings have been completed to the satisfaction of the County, the Contractor shall carry out the construction in accordance therewith and shall make no further changes therein except upon written instructions from the County.
- I. No partial submittals shall be reviewed. Incomplete submittals shall be returned to the Contractor and shall be considered not approved until resubmitted.

1.05 SHOP DRAWINGS

- A. When used in the Contract Documents, the term "Shop Drawings" shall be considered to mean Contractor's plans for material and equipment which become an integral part of the Project. These drawings shall be complete and detailed. Shop Drawings shall consist of fabrication, drawings, setting drawings, schedule drawings, manufacturer's scale drawings and wiring and control diagrams. Cuts, catalogs, pamphlets, descriptive literature and performance and test data, shall be considered only as supportive to required Shop Drawings as defined above.
- B. Drawings and schedules shall be checked and coordinated with the work of all trades involved, before they are submitted for review by the County and shall bear the Contractor's stamp of approval and original signature as evidence of such checking and coordination. Drawings or schedules submitted without this stamp of approval and original signature shall be returned to the Contractor for resubmission.
- C. Each Shop Drawing shall have a blank area 3-1/2 inches by 3-1/2 inches, located adjacent to the title block. The title block shall display the following:
 - 1. Number and title of the drawing.
 - 2. Date of Drawing or revision.
 - 3. Name of project building or facility.
 - 4. Name of contractor and subcontractor submitting drawing.
 - 5. Clear identification of contents and location of the work.
 - 6. Specification title and number.
- D. If drawings show variations from Contract requirements because of standard shop practice or for other reasons, the Contractor shall describe such variations in his letter of transmittal. If acceptable, proper adjustment in the contract shall be implemented where appropriate. If the Contractor fails to describe such variations, he shall not be relieved of the responsibility of executing the work in accordance with the Contract, even though such drawings have been reviewed.
- E. Data on materials and equipment shall include, without limitation, materials and equipment lists, catalog sheets, cuts, performance curves, diagrams, materials of construction and

similar descriptive material. Materials and equipment lists shall give, for each item thereon, the name and location of the supplier or manufacturer, trade name, catalog reference, size, finish and all other pertinent data.

- F. For all mechanical and electrical equipment furnished, the Contractor shall provide a list including the equipment name and address and telephone number of the manufacturer's representative and service company so that service and/or spare parts can be readily obtained.
- G. All manufacturers or equipment suppliers who proposed to furnish equipment or products shall submit an installation list to the County along with the required shop drawings. The installation list shall include at least five installations where identical equipment has been installed and have been in operation for a period of at least one (1) year.
- H. Only the County will utilize the color "red" in marking shop drawing submittals.

1.06 WORKING DRAWINGS

- A. When used in the Contract Documents, the term "working drawings" shall be considered to mean the Contractor's fabrication and erection drawings for structures such as roof trusses, steelwork, precast concrete elements, bulkheads, support of open cut excavation, support of utilities, groundwater control systems, forming and false work; underpinning; and for such other work as may be required for construction of the project.
- B. Copies of working drawings as noted above, shall be submitted to the County where required by the Contract Documents or requested by the County and shall be submitted at least thirty (30) days (unless otherwise specified by the County) in advance of their being required for work.
- C. Working drawings shall be signed by a registered Professional Engineer, currently licensed to practice in the State of Florida and shall convey, or be accompanied by, calculation or other sufficient information to completely explain the structure, machine, or system described and its intended manner of use. Prior to commencing such work, working drawings must have been reviewed without specific exceptions by the County, which review will be for general conformance and will not relieve the Contractor in any way from his responsibility with regard to the fulfillment of the terms of the Contract. All risks of error are assumed by the Contractor; the County and Engineer shall not have responsibility therefor.

1.07 SAMPLES

- A. The Contractor shall furnish, for the review of the County, samples required by the Contract Documents or requested by the County. Samples shall be delivered to the County as specified or directed. The Contractor shall prepay all shipping charges on samples. Materials or equipment for which samples are required shall not be used in work until reviewed by the County.
- B. Samples shall be of sufficient size and quantity to clearly illustrate:

1. Functional characteristics of the product, with integrally related parts and attachment devices.
2. Full range of color, texture and pattern.
3. A minimum of two samples of each item shall be submitted.

C. Each sample shall have a label indicating:

1. Name of product.
2. Name of Contractor and Subcontractor.
3. Material or equipment represented.
4. Place of origin.
5. Name of Producer and Brand (if any).
6. Location in project.
(Samples of finished materials shall have additional markings that will identify them under the finished schedules.)
7. Reference specification paragraph.

D. The Contractor shall prepare a transmittal letter in triplicate for each shipment of samples containing the information required above. He shall enclose a copy of this letter with the shipment and send a copy of this letter to the County. Review of a sample shall be only for the characteristics or use named in such and shall not be construed to change or modify any Contract requirements.

E. Reviewed samples not destroyed in testing shall be sent to the County or stored at the site of the work. Reviewed samples of the hardware in good condition will be marked for identification and may be used in the work. Materials and equipment incorporated in work shall match the reviewed samples. If requested at the time of submission, samples which failed testing or were rejected shall be returned to the Contractor at his expense.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01370

SCHEDULE OF VALUES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall submit to the County a Schedule of Values allocated to the various portions of the work, within 10 days after date of Notice to Proceed.
- B. Upon request of the County, the Contractor shall support the values with data which will substantiate their correctness.
- C. The Schedule of Values shall be used only as the basis for the Contractor's Applications for Payment.

1.02 FORM AND CONTENT OF SCHEDULE OF VALUES

- A. Schedule of Values will be considered for approval by County upon Contractor's request. Identify schedule with:
 - 1. Title of Project and location.
 - 2. Project number.
 - 3. Name and address of Contractor.
 - 4. Contract designation.
 - 5. Date of submission.
- B. Schedule of Values shall list the installed value of the component parts of the work in sufficient detail to serve as a basis for computing values for progress payments during construction.
- C. Follow the table of contents for the Contract Document as the format for listing component items for structures:
 - 1. Identify each line item with the number and title of the respective major section of the specification.
 - 2. For each line item, list sub values of major products or operations under item.
- D. Follow the bid sheets included in this Contract Documents as the format for listing component items for pipe lines.
- E. The sum of all values listed in the schedule shall equal the total Contract sum.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01380

CONSTRUCTION PHOTOGRAPHS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall employ a competent photographer to take construction record photographs or perform video, recording including furnishing all labor, materials, equipment and incidentals necessary to obtain photographs and/or video recordings of all construction areas.
- B. Preconstruction record information shall consist of video recordings on digital video disks (DVD).
- C. Construction progress information shall consist of photographs and digital photographs on a recordable compact disc (CD-R).

1.02 QUALIFICATIONS

- A. All photography shall be done by a competent camera operator who is fully experienced and qualified with the specified equipment.
- B. For the video recording, the audio portion should be done by a person qualified and knowledgeable in the specifics of the Contract, who shall speak with clarity and diction so as to be easily understood.

1.03 PROJECT PHOTOGRAPHS

- A. Provide one print of each photograph with each pay application.
- B. Provide one recordable compact disc with digital photographs with each pay application.
- C. Negatives:
 - 1. All negatives shall remain the property of photographer.
 - 2. The Contractor shall require that photographer maintain negatives or protected digital files for a period of two years from date of substantial completion of the project.
 - 3. Photographer shall agree to furnish additional prints to County at commercial rates applicable at time of purchase. Photographer shall also agree to participate as required in any litigation requiring the photographer as an expert witness.
- D. The Contractor shall pay all costs associated with the required photography and prints. Any parties requiring additional photography or prints shall pay the photographer directly.
- E. All project photographs shall be a single weight, color image. All finishes shall be smooth surface and glossy and all prints shall be 8 inches x 10 inches.

- F. Each print shall have clearly marked on the back, the name of the project, the orientation of view, the date and time of exposure, name and address of the photographer and the photographers numbered identification of exposure.
- G. All project photographs shall be taken from locations to adequately illustrate conditions prior to construction, or conditions of construction and state of progress. The Contractor shall consult with the County at each period of photography for instructions concerning views required.

1.04 VIDEO RECORDINGS

- A. Video, recording shall be done along all routes that are scheduled for construction. Video, recording shall include full, recording of both sides of all streets and the entire width of easements plus 10 feet on each side on which construction is to be performed. All video recording shall be in full color.
- B. A complete view, in sufficient detail with audio description of the exact location shall be provided.
- C. The engineering plans shall be used as a reference for stationing in the audio portion of the recordings for easy location identification.
- D. Two complete sets of video recordings shall be delivered to the County on digital video disks (DVD) for the permanent and exclusive use of the County prior to the start of any construction on the project.
- E. All video recordings shall contain the name of the project, the date and time of the video, recording, the name and address of the photographer and any other identifying information required.
- F. Construction shall not start until preconstruction video recordings are completed, submitted and accepted by the County. In addition, no progress payments shall be made until the preconstruction video recordings are accepted by the County.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01410

TESTING AND TESTING LABORATORY SERVICES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. County shall employ and pay for the services of an independent testing laboratory to perform testing specifically indicated on the Contract Documents or called out in the Specifications. County may elect to have materials and equipment tested for conformity with the Contract Documents at any time.
1. Contractor shall cooperate fully with the laboratory to facilitate the execution of its required services.
 2. Employment of the laboratory shall in no way relieve the Contractor's obligations to perform the work of the Contract.

1.02 LIMITATIONS OF AUTHORITY OF TESTING LABORATORY

- A. Laboratory is not authorized to:
1. Release, revoke, alter or enlarge on requirements of Contract Documents.
 2. Approve or accept any portion of the Work.
 3. Perform any duties of the Contractor.

1.03 CONTRACTOR'S RESPONSIBILITIES

- A. Cooperate with laboratory personnel; provide access to Work and/or to Manufacturer's operations.
- B. Secure and deliver to the laboratory adequate quantities of representational samples of materials proposed to be used and which require testing.
- C. Provide to the laboratory the preliminary design mix proposed to be used for concrete, and other material mixes which require control by the testing laboratory.
- D. Materials and equipment used in the performance of work under this Contract are subject to inspection and testing at the point of manufacture or fabrication. Standard specifications for quality and workmanship are indicated in the Contract Documents. The County may require the Contractor to provide statements or certificates from the manufacturers and fabricators that the materials and equipment provided by them are manufactured or fabricated in full accordance with the standard specifications for quality and workmanship indicated in the Contract Documents. All costs of this testing and providing statements and certificates shall be a subsidiary obligation of the Contractor and no extra charge to the County shall be allowed on account of such testing and certification.
- E. Furnish incidental labor and facilities:
1. To provide access to work to be tested.

2. To obtain and handle samples at the project site or at the source of the product to be tested.
 3. To facilitate inspections and tests.
 4. For storage and curing of test samples.
- F. Notify laboratory sufficiently in advance of operations to allow for laboratory assignment of personnel and scheduling of tests.
1. When tests or inspections cannot be performed due to insufficient notice, Contractor shall reimburse County for laboratory personnel and travel expenses incurred due to Contractor's negligence.
- G. Employ and pay for the services of the same or a separate, equally qualified independent testing laboratory to perform additional inspections, sampling and testing required for the Contractor's convenience and as approved by the County.
- H. If the test results indicate the material or equipment complies with the Contract Documents, the County shall pay for the cost of the testing laboratory. If the tests and any subsequent retests indicate the materials and equipment fail to meet the requirements of the Contract Documents, the contractor shall pay for the laboratory costs directly to the testing firm or the total of such costs shall be deducted from any payments due the Contractor.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01510

TEMPORARY AND PERMANENT UTILITIES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

The Contractor shall be responsible for furnishing all requisite temporary utilities, i.e., power, water, sanitation, etc. The Contractor shall obtain and pay for all permits required as well as pay for all temporary usages. The Contractor shall remove all temporary facilities upon completion of work.

1.02 REQUIREMENTS OF REGULATORY AGENCIES

- A. Comply with National Electric Code.
- B. Comply with Federal, State and Local codes and regulations and with utility company requirements.
- C. Comply with County Health Department regulations.

PART 2 PRODUCTS

2.01 MATERIALS, GENERAL

Materials for temporary utilities may be "used". Materials for electrical utilities shall be adequate in capacity for the required usage, shall not create unsafe conditions and shall not violate requirements of applicable codes and standards.

2.02 TEMPORARY ELECTRICITY AND LIGHTING

Arrange with the applicable utility company for temporary power supply. Provide service required for temporary power and lighting and pay all costs for permits, service and for power used.

2.03 TEMPORARY WATER

- A. The Contractor shall arrange with Manatee County Utilities Customer Service office to provide water for construction purposes, i.e., meter, pay all costs for installation, maintenance and removal, and service charges for water used.
- B. The Contractor shall protect piping and fitting against freezing.

2.04 TEMPORARY SANITARY FACILITIES

- A. The Contractor shall provide sanitary facilities in compliance with all laws and regulations.
- B. The Contractor shall service, clean and maintain facilities and enclosures.

PART 3 EXECUTION

3.01 GENERAL

- A. The Contractor shall maintain and operate systems to assure continuous service.
- B. The Contractor shall modify and extend systems as work progress requires.

3.02 REMOVAL

- A. The Contractor shall completely remove temporary materials and equipment when their use is no longer required.
- B. The Contractor shall clean and repair damage caused by temporary installations or use of temporary facilities.

END OF SECTION

SECTION 01570

TRAFFIC REGULATION

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall be responsible for providing safe and expeditious movement of traffic through construction zones. A construction zone is defined as the immediate areas of actual construction and all abutting areas which are used by the Contractor and which interfere with the driving or walking public.
- B. The Contractor shall remove temporary equipment and facilities when no longer required, restore grounds to original or to specified conditions.

1.02 TRAFFIC CONTROL

- A. The necessary traffic control shall include, but not be limited to, such items as proper construction warning signs, signals, lighting devices, markings, barricades, channelization and hand signaling devices. The Contractor shall be responsible for installation and maintenance of all devices and detour routes and signage for the duration of the construction period. The Contractor shall utilize the appropriate traffic plan from the FDOT Maintenance of Traffic Standards, Series 600 of the FDOT Roadway & Traffic Design Standards, Latest Edition.
- B. Should there be the necessity to close any portion of a roadway carrying vehicles or pedestrians the Contractor shall submit a Traffic Control Plan (TCP) at least 5 days before a partial or full day closure, and at least 8 days before a multi-day closure. TCP shall be submitted, along with a copy of their accreditation, by a certified IMSA or ATSA Traffic Control Specialist.
 - 1. At no time will more than one (1) lane of a roadway be closed to vehicles and pedestrians without an approved road closure from the County Transportation Department. With any such closings, adequate provision shall be made for the safe expeditious movement of each.
 - 2. All traffic control signs must be in place and inspected at least 1 day in advance of the closure. Multi-day closures notification signs shall be in place at least 3 days in advance of the closure. All signs must be covered when no in effect, and checked twice a day by the Worksite Traffic Supervisor when they are in effect.
- C. The Contractor shall be responsible for removal, relocation, or replacement of any traffic control device in the construction area which exists as part of the normal preconstruction traffic control scheme. Any such actions shall be performed by the Contractor under the supervision and in accordance with the instructions of the applicable highway department unless otherwise specified.
- D. The Contractor will consult with the County immediately on any vehicular or pedestrian safety or efficiency problem incurred as a result of construction of the project.

- E. The Contractor shall provide ready access to businesses and homes in the project area during construction. The Contractor shall be responsible for coordinating this work with affected homeowners.
- F. When conditions require the temporary installation of signs, pavement markings and traffic barriers for the protection of workers and traffic, the entire array of such devices shall be depicted on working drawings for each separate stage of work. These drawings shall be submitted to the County for review and approval prior to commencement of work on the site.
- G. Precast concrete traffic barriers shall be placed adjacent to trenches and other excavations deeper than six inches below the adjacent pavement surface.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01580

PROJECT IDENTIFICATION AND SIGNS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Furnish, install and maintain County project identification signs.
- B. Remove signs on completion of construction.
- C. Allow no other signs to be displayed except for traffic control and safety.

1.02 PROJECT IDENTIFICATION SIGN (COUNTY)

- A. One painted sign, of not less than 32 square feet (3 square meters) area, with painted graphic content to include:
 - 1. Title of Project.
 - 2. Name of County.
 - 3. Names and titles of authorities as directed by County.
 - 4. Prime Contractor.
- B. Graphic design, style of lettering and colors: As approved by the County.
- C. Erect on the site at a lighted location of high public visibility, adjacent to main entrance to site, as approved by the County

1.03 INFORMATIONAL SIGNS

- A. Painted signs with painted lettering, or standard products.
 - 1. Size of signs and lettering: as required by regulatory agencies, or as appropriate to usage.
 - 2. Colors: as required by regulatory agencies, otherwise of uniform colors throughout project.
- B. Erect at appropriate locations to provide required information.

1.04 QUALITY ASSURANCE

- A. Sign Painter: Professional experience in type of work required.
- B. Finishes, Painting: Adequate to resist weathering and fading for scheduled construction period.


1.05 PUBLIC NOTIFICATION

- A. Door Hangers: The Contractor shall generate and distribute door hangers to all residents who will be impacted by project construction.
 - 1. Residents impacted include anyone who resides inside, or within 500 feet of project limits of construction.
- B. Door Hangers shall be distributed prior to start of construction of the project. Hangers shall be affixed to doors of residents via elastic bands or tape.

EXAMPLE:

PLEASE PARDON THE INCONVENIENCE WHILE THE ROADWAY IS BEING
RECONSTRUCTED IN YOUR NEIGHBORHOOD

This project consists of utility improvements and the reconstruction of ??? Boulevard from U.S. ??? to ??? Street West. The project is expected to begin in August, 200X and be completed in July 200X.

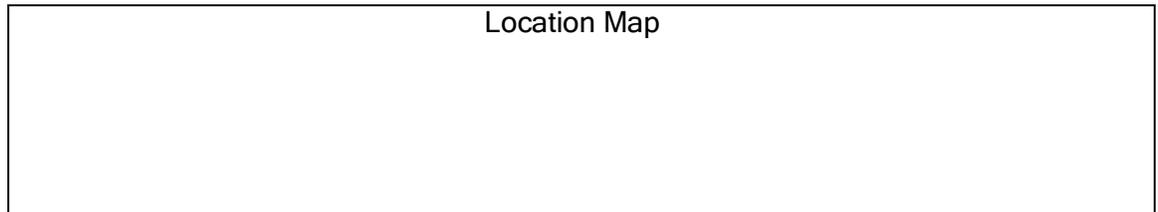

WE HOPE TO KEEP ANY INCONVENIENCE TO A MINIMUM. HOWEVER, IF YOU
HAVE ANY PROBLEMS, PLEASE CONTACT THE FOLLOWING:

- | | | |
|----|-------------------------------------------------------------------|------------------------------------------------------|
| A. | Contractor
Contractor Address
Contractor Phone (Site Phone) | Project Manager
PM Address
PM Phone No. & Ext. |
| B. | Project Inspector
Inspector Phone Number | |

AFTER HOURS EMERGENCY NUMBER - (941) 747-HELP
THANK YOU FOR YOUR UNDERSTANDING AND PATIENCE
MANATEE COUNTY GOVERNMENT - PROJECT MANAGEMENT DEPT.

PART 2 PRODUCTS

2.01 SIGN MATERIALS

- A. Structure and Framing: May be new or used, wood or metal, in sound condition structurally adequate to work and suitable for specified finish.
- B. Sign Surfaces: Exterior softwood plywood with medium density overlay, standard large sizes to minimize joints.

1. Thickness: As required by standards to span framing members, to provide even, smooth surface without waves or buckles.

C. Rough Hardware: Galvanized.

D. Paint: Exterior quality, as specified in the Contract Documents.

PART 3 EXECUTION

3.01 PROJECT IDENTIFICATION SIGN

A. Paint exposed surface or supports, framing and surface material; one coat of primer and one coat of exterior paint.

B. Paint graphics in styles, size and colors selected.

3.02 MAINTENANCE

The Contractor shall maintain signs and supports in a neat, clean condition; repair damages to structures, framing or sign.

3.03 REMOVAL

The Contractor shall remove signs, framing, supports and foundations at completion of project.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01590

COUNTY'S FIELD OFFICE

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Contractor shall furnish, install and maintain one temporary field office during the entire construction period for the sole use of the County.

1.02 OTHER REQUIREMENTS

- A. Prior to installation of the County's field office, the Contractor shall consult with the County on location, access and related facilities.
- B. All site use approvals shall be obtained by the Contractor.
- A. Upon completion of construction, the Contractor shall remove the field office and restore the site to its original condition.

1.03 REQUIREMENTS FOR FACILITIES

- A. Construction:
 - 1. The field office shall be structurally sound, weather tight, with floors raised aboveground.
 - 2. At Contractor's option, portable or mobile buildings may be used.
- B. Office for Field Engineer:
 - 1. A separate office for sole use of the County with secure entrance doors, key and lock shall be provided.
 - 2. Area: 250 sq. ft. minimum, with minimum dimension of 8 feet.
 - 3. Windows:
 - a. Minimum of three (3).
 - b. Operable sash and insect screens.
 - c. Locate field office to provide maximum view of construction areas.
 - 4. Furnishings:
 - a. Two standard size chairs and desks with three drawers each.
 - b. One drafting table: 39"x72"x36" high, with one equipment drawer.
 - c. One metal, double-door storage cabinet with lock and key.
 - d. One plan rack to hold a minimum of six sets of project drawings.
 - e. One standard four-drawer legal-size metal filing cabinet with lock and key.
 - f. Six linear feet of bookshelves.
 - g. One swivel arm chair.
 - h. Two straight chairs.
 - i. One drafting table stool.
 - j. One waste basket.
 - k. One tackboard, 36"x30".

- l. One fire extinguisher.
- m. One first aid kit.
- 5. Services:
 - a. Adequate lighting.
 - b. Exterior lighting at entrance door.
 - c. Automatic heating and mechanical cooling equipment to maintain comfort conditions.
 - d. Minimum of four 110 volt duplex electric convenience outlets, at least one on each wall.
 - e. Electric distribution panel: Two circuits minimum 110 volt, 60 hertz service.
 - f. Convenient access to drinking water and toilet facilities.
 - g. Telephone: One private direct line instrument.
 - h. Fax: combination fax/duplicator.

PART 2 PRODUCTS

2.01 MATERIALS, EQUIPMENT, FURNISHINGS

May be new or used, but must be serviceable, adequate for required purpose and must adhere to all applicable codes or regulations including the Manatee County Building Codes.

PART 3 EXECUTION

3.01 PREPARATION

Fill and grade site as necessary for temporary structure to provide positive surface drainage.

3.02 INSTALLATION

- A. Construct temporary field office on proper foundation and provide connections for all utility services.
 - 1. Secure portable or mobile building when used.
 - 2. Provide steps and landings at entrance doors.

END OF SECTION

SECTION 01600

MATERIAL AND EQUIPMENT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Material and equipment incorporated into the work:
1. Conform to applicable specifications and standards.
 2. Comply with size, make, type and quality specified, or as specifically approved in writing by the County.
 3. Manufactured and Fabricated Products:
 - a. Design, fabricate and assemble in accordance with the best engineering and shop practices.
 - b. Manufacture like parts of duplicate units to standard sizes and gages, to be interchangeable.
 - c. Two or more items of the same kind shall be identical and manufactured by the same manufacturer.
 - d. Products shall be suitable for service conditions.
 - e. Equipment capacities, sizes and dimensions shown or specified shall be adhered to unless variations are specifically approved in writing.
 4. Do not use material or equipment for any purpose other than that for which it is specified.
 5. All material and equipment incorporated into the project shall be new.

1.02 MANUFACTURER'S INSTRUCTIONS

- A. When Contract Documents require that installation of work shall comply with manufacturer's printed instructions, obtain and distribute copies of such instructions to parties involved in the installation, including two copies to County. Maintain one set of complete instructions at the job site during installation and until completion.
- B. Handle, install, connect, clean, condition and adjust products in strict accordance with such instructions and in conformity with specified requirements. Should job conditions or specified requirements conflict with manufacturer's instructions, consult with County prior to proceeding. Do not proceed with work without clear instructions.

1.03 TRANSPORTATION AND HANDLING

- A. Arrange deliveries of products in accordance with construction schedules, coordinate to avoid conflict with work and conditions at the site.
1. Deliver products in undamaged condition, in manufacturer's original containers or packaging, with identifying labels intact and legible.
 2. Immediately on delivery, inspect shipments to assure compliance with requirements of Contract Documents and approved submittals and that products are properly protected and undamaged.
- B. Provide equipment and personnel to handle products by methods to prevent soiling or damage to products or packaging.

1.04 SUBSTITUTIONS AND PRODUCT OPTIONS

Contractor's Options:

1. For products specified only by reference standard, select any product meeting that standard.
2. For products specified by naming one or more products or manufacturers and "or equal", Contractor must submit a request for substitutions of any product or manufacturer not specifically named in a timely manner so as not to adversely affect the construction schedule.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01620

STORAGE AND PROTECTION

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Provide secure storage and protection for products to be incorporated into the work and maintenance and protection for products after installation and until completion of Work.

1.02 STORAGE

A. Store products immediately on delivery and protect until installed in the Work, in accord with manufacturer's instructions, with seals and labels intact and legible.

B. Exterior Storage

1. Provide substantial platform, blocking or skids to support fabricated products above ground to prevent soiling or staining.
 - a. Cover products, subject to discoloration or deterioration from exposure to the elements, with impervious sheet coverings. Provide adequate ventilation to avoid condensation.
 - b. Prevent mixing of refuse or chemically injurious materials or liquids.

A. Arrange storage in manner to provide easy access for inspection.

1.03 MAINTENANCE OF STORAGE

A. Maintain periodic system of inspection of stored products on scheduled basis to assure that:

1. State of storage facilities is adequate to provide required conditions.
2. Required environmental conditions are maintained on continuing basis.
3. Surfaces of products exposed to elements are not adversely affected. Any weathering of products, coatings and finishes is not acceptable under requirements of these Contract Documents.

B. Mechanical and electrical equipment which requires servicing during long term storage shall have complete manufacturer's instructions for servicing accompanying each item, with notice of enclosed instructions shown on exterior of package.

1. Equipment shall not be shipped until approved by the County. The intent of this requirement is to reduce on-site storage time prior to installation and/or operation. Under no circumstances shall equipment be delivered to the site more than one month prior to installation without written authorization from the County.
2. All equipment having moving parts such as gears, electric motors, etc. and/or instruments shall be stored in a temperature and humidity controlled building approved by the County until such time as the equipment is to be installed.
3. All equipment shall be stored fully lubricated with oil, grease, etc. unless otherwise

instructed by the manufacturer.

4. Moving parts shall be rotated a minimum of once weekly to insure proper lubrication and to avoid metal-to-metal "welding". Upon installation of the equipment, the Contractor shall start the equipment, at least half load, once weekly for an adequate period of time to insure that the equipment does not deteriorate from lack of use.
5. Lubricants shall be changed upon completion of installation and as frequently as required, thereafter during the period between installation and acceptance.
6. Prior to acceptance of the equipment, the Contractor shall have the manufacturer inspect the equipment and certify that its condition has not been detrimentally affected by the long storage period. Such certifications by the manufacturer shall be deemed to mean that the equipment is judged by the manufacturer to be in a condition equal to that of equipment that has been shipped, installed, tested and accepted in a minimum time period. As such, the manufacturer will guaranty the equipment equally in both instances. If such a certification is not given, the equipment shall be judged to be defective. It shall be removed and replaced at the Contractor's expense.

1.04 PROTECTION AFTER INSTALLATION

- A. Provide protection of installed products to prevent damage from subsequent operations. Remove when no longer needed, prior to completion of work.
- B. Control traffic to prevent damage to equipment and surfaces.
- C. Provide coverings to protect finished surfaces from damage.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01700

CONTRACT CLOSEOUT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Comply with requirements stated in Conditions of the Contract and in Specifications for administrative procedures in closing out the work.

1.02 SUBSTANTIAL COMPLETION

- A. The Contractor shall submit the following items when the Contractor considers the work to be substantially complete:
 - 1. A written notice that the work, or designated portion thereof, is substantially complete.
 - 2. A list of items to be completed or corrected.
- B. Within a reasonable time after receipt of such notice, the County shall make an inspection to determine the status of completion.
- C. Project record documents and operations and maintenance manuals must be submitted before the project shall be considered substantially complete.
- D. If the County determines that the work is not substantially complete:
 - 1. The County shall notify the Contractor in writing, stating the reasons.
 - 2. The Contractor shall remedy the deficiencies in the work and send a second written notice of substantial completion to the County.
 - 3. The County shall reinspect the work.
- E. When the County finds that the work is substantially complete:
 - 1. The Engineer shall prepare and deliver to the County a tentative Certificate of Substantial Completion (Manatee County Project Management Form PMD-8) with a tentative list of the items to be completed or corrected before final payment.
 - 2. The Engineer shall consider any objections made by the County as provided in Conditions of the Contract. When the Engineer considers the work substantially complete, he will execute and deliver to the County a definite Certificate of Substantial Completion (Manatee County Project Management Form PMD-8) with a revised tentative list of items to be completed or corrected.

1.03 FINAL INSPECTION

- A. When the Contractor considered the work to be complete, he shall submit written certification stating that:
 - 1. The Contract Documents have been reviewed.
 - 2. The work has been inspected for compliance with Contract Documents.
 - 3. The work has been completed in accordance with Contract Documents.

4. The equipment and systems have been tested in the presence of the County's representative and are operational.
 5. The work is completed and ready for final inspection.
- B. The County shall make an inspection to verify the status of completion after receipt of such certification.
- C. If the County determines that the work is incomplete or defective:
1. The County shall promptly notify the Contractor in writing, listing the incomplete or defective work.
 2. The Contractor shall take immediate steps to remedy the stated deficiencies and send a second written certification to County that the work is complete.
 3. The County shall reinspect the work.
- D. Upon finding the work to be acceptable under the Contract Documents, the County shall request the Contractor to make closeout submittals.
- E. For each additional inspection beyond a total of three (3) inspections for substantial and final completion due to the incompleteness of the work, the Contractor shall reimburse the County's fees.

1.04 CONTRACTOR'S CLOSEOUT SUBMITTALS TO COUNTY

- A. Project Record Documents (prior to substantial completion).
- B. Operation and maintenance manuals (prior to substantial completion).
- C. Warranties and Bonds.
- D. Evidence of Payment and Release of Liens: In accordance with requirements of General and Supplementary Conditions.
- E. Certification letter from Florida Department of Transportation and Manatee County Department of Transportation, as applicable.
- F. Certificate of Insurance for Products and Completed Operations.
- G. Final Reconciliation, Warranty Period Declaration, and Contractor's Affidavit (Manatee County Project Management Form PMD-9).

1.05 FINAL ADJUSTMENT OF ACCOUNTS

- A. Submit a final statement of accounting to the County.
- B. Statement shall reflect all adjustments to the Contract Sum:
 1. The original Contract Sum.
 2. Additions and deductions resulting from:
 - a. Previous Change Orders
 - b. Unit Prices
 - c. Penalties and Bonuses

- d. Deductions for Liquidated Damages
- e. Other Adjustments
- 3. Total Contract Sum, as adjusted.
- 4. Previous payments.
- 5. Sum remaining due.

C. Project Management shall prepare a final Change Order, reflecting approved adjustments to the Contract Sum which were not previously made by Change Orders.

1.06 FINAL APPLICATION FOR PAYMENT

Contractor shall submit the final Application for Payment in accordance with procedures and requirements stated in the Conditions of the Contract.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01710

CLEANING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Execute cleaning during progress of the work and at completion of the work, as required by the General Conditions.

1.02 DISPOSAL REQUIREMENTS

Conduct cleaning and disposal operations to comply with all Federal, State and Local codes, ordinances, regulations and anti-pollution laws.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Use only those cleaning materials which will not create hazards to health or property and which will not damage surfaces.
- B. Use only those cleaning materials and methods recommended by manufacturer of the surface material to be cleaned.
- C. Use cleaning materials only on surfaces recommended by cleaning material manufacturer.

PART 3 EXECUTION

3.01 DURING CONSTRUCTION

- A. Execute periodic cleaning to keep the work, the site and adjacent properties free from accumulation of waste materials, rubbish and wind-blown debris, resulting from construction operations.
- B. Provide on-site containers for the collection of waste materials, debris and rubbish.
- C. Remove waste materials, debris and rubbish from the site periodically and dispose of at legal disposal areas away from the site.

3.02 DUST CONTROL

- A. Clean interior spaces prior to the start of finish painting and continue cleaning on an as-needed basis until painting is finished.
- B. Schedule operations so that dust and other contaminants resulting from cleaning process will not fall on wet or newly-coated surfaces.

3.03 FINAL CLEANING

- A. Employ skilled workmen for final cleaning.
- B. Broom clean exterior paved surfaces; rake clean other surfaces of the grounds.
- C. Prior to final completion or County occupancy, Contractor shall conduct an inspection of sight-exposed interior and exterior surfaces and all work areas to verify that the entire work is clean.

END OF SECTION

SECTION 01720

PROJECT RECORD DOCUMENTS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

A. Contractor shall maintain at the site for the County one record copy of:

1. Drawings.
2. Specifications.
3. Addenda.
4. Change Orders and other modifications to the Contract.
5. County's field orders or written instructions.
6. Approved shop drawings, working drawings and samples.
7. Field test records.
8. Construction photographs.

1.02 MAINTENANCE OF DOCUMENTS AND SAMPLES

A. Store documents and samples in Contractor's field office apart from documents used for construction.

1. Provide files and racks for storage of documents.
2. Provide locked cabinet or secure storage space for storage of samples.

B. File documents and samples in accordance with CSI format.

C. Maintain documents in a clean, dry, legible, condition and in good order. Do not use record documents for construction purposes.

D. Make documents and samples available at all times for inspection by the County.

1.03 MARKING DEVICES

A. Provide felt tip marking pens for recording information in the color code designated by the County.

1.04 RECORDING

A. Label each document "PROJECT RECORD" in neat large printed letters.

B. Record information concurrently with construction progress.

C. Do not conceal any work until required information is recorded.

D. Drawings; Legibly mark to record actual construction:

1. All underground piping with elevations and dimensions. Changes to piping

location. Horizontal and vertical locations of underground utilities and appurtenances, referenced to permanent surface improvements. Actual installed pipe material, class, etc. Locations of drainage ditches, swales, water lines and force mains shall be shown every 200 feet (measured along the centerline) or alternate lot lines, whichever is closer. Dimensions at these locations shall indicate distance from centerline of right-of-way to the facility.

2. Field changes of dimension and detail.
3. Changes made by Field Order or by Change Order.
4. Details not on original contract drawings.
5. Equipment and piping relocations.
6. Locations of all valves, fire hydrants, manholes, water and sewer services, water and force main fittings, underdrain cleanouts, catch basins, junction boxes and any other structures located in the right-of-way or easement, shall be located by elevation and by station and offset based on intersection P.I.'s and centerline of right-of-way. For facilities located on private roads, the dimensioning shall be from centerline of paving or another readily visible baseline.
7. Elevations shall be provided for all manhole rim and inverts; junction box rim and inverts; catch basin rim and inverts; and baffle, weir and invert elevations in control structures. Elevations shall also be provided at the PVI's and at every other lot line or 200 feet, whichever is less, of drainage swales and ditches. Bench marks and elevation datum shall be indicated.
8. Slopes for pipes and ditches shall be recalculated, based on actual field measured distances, elevations, pipe sizes, and type shown. Cross section of drainage ditches and swales shall be verified.
9. Centerline of roads shall be tied to right-of-way lines. Elevation of roadway centerline shall be given at PVI's and at all intersections.
10. Record drawings shall show bearings and distances for all right-of-way and easement lines, and property corners.
11. Sidewalks, fences and walls, if installed at the time of initial record drawing submittal, shall be located every 200 feet or alternate lot lines, whichever is closer. Dimensions shall include distance from the right-of-way line and the back of curb and lot line or easement line.
12. Sanitary sewer mainline wyes shall be located from the downstream manhole. These dimensions shall be provided by on-site inspections or televising of the sewer following installation.
13. Elevations shall be provided on the top of operating nuts for all water and force main valves.
14. Allowable tolerance shall be ± 6.0 inches for horizontal dimensions. Vertical dimensions such as the difference in elevations between manhole inverts shall have an allowable tolerance of $\pm 1/8$ inch per 50 feet (or part thereof) of horizontal distance up to a maximum tolerance of ± 2 inch.
15. Properly prepared record drawings on mylar, together with two copies, shall be certified by a design professional (Engineer and/or Surveyor registered in the State of Florida), employed by the Contractor, and submitted to the County.

E. Specifications and Addenda; Legibly mark each Section to record:

1. Manufacturer, trade name, catalog number and supplier of each product and item of equipment actually installed.
2. Changes made by field order or by change order.

- F. Shop Drawings (after final review and approval):
 - 1. Five sets of record drawings for each process equipment, piping, electrical system and instrumentation system.

1.05 SUBMITTAL

- A. Prior to substantial completion and prior to starting the bacteria testing of water lines, deliver signed and sealed Record Documents and Record Drawings to the County. These will be reviewed and verified by the inspector. If there are any required changes or additions, these shall be completed and the entire signed and sealed set resubmitted prior to final pay application.
- B. The Contractor shall employ a Professional Engineer or Surveyor registered in the State of Florida to verify survey data and properly prepare record drawings. Record drawings shall be certified by the professional(s) (Engineer or Surveyor licensed in Florida), as stipulated by the Land Development Ordinance and submitted on signed and sealed paper drawings, signed and dated mylar drawings together with an AutoCAD version on a recordable compact disk (CD).
- C. The CD shall contain media in AutoCad Version 2004 or later, or in any other CAD program compatible with AutoCad in DWG or DXF form. All fonts, line types, shape files or other pertinent information used in the drawing and not normally included in AutoCad shall be included on the media with a text file or attached noted as to its relevance and use.
- D. Accompany submittal with transmittal letter, containing:
 - 1. Date.
 - 2. Project title and number.
 - 3. Contractor's name and address.
 - 4. Title and number of each Record Document.
 - 5. Signature of Contractor or his authorized representative.

Note: The data required to properly prepare these record drawings shall be obtained at the site, at no cost to the County by the responsible design professional or his/her duly appointed representative. The appointed representative shall be a qualified employee of the responsible design professional or a qualified inspector retained by the responsible design professional on a project-by-project basis.

PART 2 STANDARDS

2.01 MINIMUM RECORD DRAWING STANDARDS FOR ALL RECORD DRAWINGS SUBMITTED TO MANATEE COUNTY

- A. Record drawings shall be submitted to at least the level of detail in the contract documents. It is anticipated that the original contract documents shall serve as at least a background for all record information. Original drawings in CAD format may be requested of the County.

B. Drawings shall meet the criteria of paragraph 1.04 D above.

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01730

OPERATING AND MAINTENANCE DATA

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Compile product data and related information appropriate for County's maintenance and operation of products furnished under Contract.

Prepare operating and maintenance data as specified in this and as referenced in other pertinent sections of Specifications.

- B. Instruct County's personnel in maintenance of products and equipment and systems.
- C. Provide three (3) sets of operating and maintenance manuals for each piece of equipment provided within this Contract.

1.02 FORM OF SUBMITTALS

- A. Prepare data in form of an instructional manual for use by County's personnel.

- B. Format:

1. Size: 8-1/2 inch x 11 inch
2. Paper: 20 pound minimum, white, for typed pages
3. Text: Manufacturer's printed data or neatly typewritten
4. Drawings:
 - a. Provide reinforced punched binder tab, bind in with text.
 - b. Fold larger drawings to size of text pages.
5. Provide fly-leaf for each separate product or each piece of operating equipment.
 - a. Provide typed description of product and major component parts of equipment.
 - b. Provide indexed tabs.
6. Cover: Identify each volume with typed or printed title "OPERATING AND MAINTENANCE INSTRUCTIONS". List:
 - a. Title of Project.
 - b. Identity of separate structures as applicable.
 - c. Identity of general subject matter covered in the manual.

- C. Binders:

1. Commercial quality three-ring binders with durable and cleanable plastic covers.
2. Maximum ring size: 1 inch.
3. When multiple binders are used, correlate the data into related consistent groupings.

1.03 MANUAL FOR EQUIPMENT AND SYSTEMS

- A. Submit three copies of complete manual in final form.
- B. Content for each unit of equipment and system, as appropriate:
1. Description of unit and component parts.
 - a. Function, normal operating characteristics and limiting conditions.
 - b. Performance curves, engineering data and tests.
 - c. Complete nomenclature and commercial number of replaceable parts.
 2. Operating Procedures:
 - a. Start-up, break-in, routine and normal operating instructions.
 - b. Regulation, control, stopping, shut-down and emergency instructions.
 - c. Summer and winter operating instructions.
 - d. Special operating instructions.
 3. Maintenance Procedures:
 - a. Routine operations.
 - b. Guide to "trouble-shooting".
 - c. Disassembly, repair and reassembly.
 - d. Alignment, adjusting and checking.
 4. Servicing and lubricating schedule.
 - a. List of lubricants required.
 5. Manufacturer's printed operating and maintenance instructions.
 6. Description of sequence of operation by control manufacturer.
 7. Original manufacturer's parts list, illustrations, assembly drawings and diagrams required for maintenance.
 - a. List of predicted parts subject to wear.
 - b. Items recommended to be stocked as spare parts.
 8. As installed control diagrams by controls manufacturer.
 9. Each contractor's coordination drawings.
 - a. As installed color coded piping diagrams.
 10. Charts of valve tag numbers, with location and function of each valve.
 11. List of original manufacturer's spare parts, manufacturer's current prices and recommended quantities to be maintained in storage.
 12. Other data as required under pertinent sections of specifications.
- C. Content, for each electric and electronic system, as appropriate:
1. Description of system and component parts.
 - a. Function, normal operating characteristics and limiting conditions.
 - b. Performance curves, engineering data and tests.
 - c. Complete nomenclature and commercial number of replaceable parts.
 2. Circuit directories of panelboards.
 - a. Electrical service.
 - b. Controls.
 - c. Communications.
 3. As-installed color coded wiring diagrams.
 4. Operating procedures:
 - a. Routine and normal operating instructions.
 - b. Sequences required.
 - c. Special operating instructions.
 5. Maintenance procedures:

- a. Routine operations.
 - b. Guide to "trouble-shooting".
 - c. Disassembly, repair and reassembly.
 - d. Adjustment and checking.
- 6. Manufacturer's printed operating and maintenance instructions.
 - 7. List of original manufacture's spare parts, manufacturer's current prices and recommended quantities to be maintained in storage.
 - 8. Prepare and include additional data when the need for such data becomes apparent during instruction of County's personnel.

D. Prepare and include additional data when the need for such data becomes apparent during instruction on County's personnel.

E. Additional requirements for operating and maintenance data: Respective sections of Specifications.

1.04 SUBMITTAL SCHEDULE

A. Submit one copy of completed data in final form fifteen days prior to substantial completion.

1. Copy will be returned after substantial completion, with comments (if any).

B. Submit two copies of approved data in final form. Final acceptance will not be provided until the completed manual is received and approved.

1.05 INSTRUCTION OF COUNTY'S PERSONNEL

A. Prior to final inspection or acceptance, fully instruct County's designated operating and maintenance personnel in operation, adjustment and maintenance of products, equipment and systems.

B. Operating and maintenance manual shall constitute the basis of instruction.

1. Review contents of manual with personnel in full detail to explain all aspects of operations and maintenance.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 01740

WARRANTIES AND BONDS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Compile specified warranties and bonds.
- B. Compile specified service and maintenance contracts.
- C. Co-execute submittals when so specified.
- D. Review submittals to verify compliance with Contract Documents.
- E. Submit to County for review and transmittal.

1.02 SUBMITTAL REQUIREMENTS

- A. Assemble warranties, bonds and service and maintenance contracts, executed by each of the respective manufacturers, suppliers and subcontractors.
- B. Number of original signed copies required: Two each.
- C. Table of Contents: Neatly typed, in orderly sequence. Provide complete information for each item.
 - 1. Product or work item.
 - 2. Firm, with name of principal, address and telephone number.
 - 3. Scope.
 - 4. Date of beginning of warranty, bond or service and maintenance contract.
 - 5. Duration of warranty, bond or service maintenance contract.
 - 6. Provide information for County's personnel:
 - a. Proper procedure in case of failure.
 - b. Instances which might affect the validity of warranty or bond.
 - 7. Contractor, name of responsible principal, address and telephone number.

1.03 FORM OF SUBMITTALS

- A. Prepare in duplicate packets.
- B. Format:
 - 1. Size 8-1/2 inch x 11 inch punched sheets for standard 3-ring binder. Fold larger sheets to fit into binders.
 - 2. Cover: Identify each packet with typed or printed title "WARRANTIES AND BONDS". List:
 - a. Title of Project.
 - b. Name of Contractor.

- C. Binders: Commercial quality, three-ring, with durable and cleanable plastic covers.

1.04 TIME OF SUBMITTALS

- A. Make submittals within ten days after date of substantial completion and prior to final request for payment.
- B. For items of work, where acceptance is delayed materially beyond date of substantial completion, provide updated submittal within ten days after acceptance, listing date of acceptance as start of warranty period.

1.05 SUBMITTALS REQUIRED

- A. Submit warranties, bonds, service and maintenance contracts as specified in respective sections of Specifications.
- B. Approval by the County of all documents required under this section is a pre-requisite to requesting a final inspection and final payment

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

DIVISION 2 SITE WORK

SECTION 02064

MODIFICATIONS TO EXISTING STRUCTURES, PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish all labor, materials, equipment and incidentals required to modify, alter and/or convert existing structures as shown or specified and as required for the installation of piping, mechanical equipment and appurtenances. Existing piping and equipment shall be removed and dismantled as necessary for the performance of facility alterations in accordance with the requirements herein specified.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION

3.01 GENERAL

- A. The Contractor shall cut, repair, reuse, excavate, demolish or otherwise remove parts of the existing structures or appurtenances, as indicated on the Contract Drawings, herein specified, or necessary to permit completion of the work under this Contract. The Contractor shall dispose of surplus materials resulting from the above work in an approved manner. The work shall include all necessary cutting and bending of reinforcing steel, structural steel, or miscellaneous metal work found embedded in the existing structures.
- B. The Contractor shall dismantle and remove all existing equipment, piping, and other appurtenances required for the completion of the work. Where called for or required, the contractor shall cut existing pipelines for the purpose of making connections thereto. Anchor bolts for equipment and structural steel removed shall be cut off one inch below the concrete surface. Surface shall be finished as specified in the Contract Documents.
- C. At the time that a new connection is made to an existing pipeline, additional new piping, extending to and including a new valve, shall be installed. Pipe anchorage, if required, is part of the installation shall also be installed as directed by the County.
- D. No existing structure, equipment, or appurtenance shall be shifted, cut, removed, or otherwise altered except with the express approval of and to the extent approved by the County.
- E. When removing materials or portions of existing utility pipelines and/or structures or when making openings in walls and partitions, the Contractor shall take all precautions and use all necessary barriers and other protective devices so as not to damage the structures beyond the limits necessary for the new work, and not to damage the structures or contents by falling or flying debris. Unless otherwise permitted, line drilling will be required in cutting existing concrete.

- F. Materials and equipment removed in the course of making alterations and additions shall remain the property of the County, except that items not salvageable, as determined by the County, shall become the property of the Contractor to be disposed of by him off the work site at his own place of disposal. Operating equipment shall be thoroughly cleaned, lubricated, and greased for protection during prolonged storage.
- G. All alterations to existing utility pipes and structures shall be done at such time and in such manner as to comply with the approved time schedule. So far as possible before any part of the work is started, all tools, equipment, and materials shall be assembled and made ready so that the work can be completed without delay.
- H. All workmanship and new materials involved in constructing the alterations shall conform to the General Specifications for the classes of work insofar as such specifications are applicable.
- I. All cutting of existing concrete or other material to provide suitable bonding to new work shall be done in a manner to meet the requirements of the respective section of these Specifications covering the new work. When not covered, the work shall be carried on in the manner and to the extent directed by the Resident Project Representative.
- J. Surfaces of seals visible in the completed work shall be made to match as nearly as possible the adjacent surfaces.
- K. Non-shrink grout shall be used for setting wall castings, sleeves, leveling pump bases, doweling anchors into existing concrete and elsewhere as shown.
- L. Where necessary or required for the purpose of making connections, the Contractor shall cut existing pipelines in a manner to provide an approved joint. Where required, he shall use flanges, or provide Dresser Couplings, all as required.
- M. The Contractor shall provide flumes, hoses, piping and other related items to divert or provide suitable plugs, bulkheads, or other means to hold back the flow of water or other liquids, all as required in the performance of the work under this Contract.
- N. Care shall be taken not to damage any part of existing buildings or foundations or outside structures.

3.02 CONNECTING TO EXISTING PIPING AND EQUIPMENT

The Contractor shall verify exact location, material, alignment, joint, etc. of existing piping and equipment prior to making the connections called out in the Drawings. The verifications shall be performed with adequate time to correct any potential alignment or other problems prior to the actual time of connection. A Manatee County representative must be present for all tie-ins for a visual inspection.

3.03 REMOVAL AND ABANDONMENT OF ASBESTOS CEMENT PIPE AND APPURTENANCES

- A. All work associated with the removal or abandonment of existing asbestos cement pipe and appurtenances shall be performed by a licensed asbestos abatement contractor or

subcontractor registered in the State of Florida. After removal of the facilities, all trenches shall be backfilled in accordance with the Contract Documents. The cost of disposing of the removed materials shall be borne by the Contractor.

- B. The asbestos abatement contractor or subcontractor shall contact the appropriate regulatory agencies prior to removal or abandonment of any asbestos material and shall obtain all required permits and licenses and issue all required notices. The Contractor shall be responsible for all fees associated with permits, licenses and notices to the governing regulatory agencies. An asbestos manifest form must accompany each and every shipment of such pipe or pipe material waste to the Manatee County Lena Road Landfill. Prior to each shipment, a minimum of 24 hours notice to the Landfill field office (Phone #748-5543) is required.
- C. All work associated with removal or abandonment of asbestos cement pipe and appurtenances shall be performed in accordance with the standards listed below and all other applicable local, State, or Federal standards.
 - 1. Florida Administrative Code, Chapter 62-257, "Asbestos Program".
 - 2. National Emission Standards Hazardous Air Pollution (NESHAP), 40 CFR, Part 61, Subpart M, latest revision.
 - 3. Occupational Safety and Health Act, 29 CFR, 1910.1001 - Asbestos.
 - 4. Title 40 CFR, Part 763, Asbestos.
 - 5. Florida Statute Title XXXII, Chapter 469, Asbestos Abatement.

3.04 IN-PLACE GROUTING OF EXISTING PIPE

- A. Where water and wastewater utility pipes are to be abandoned in place, they shall be filled with a sand/cement grout as specified herein. When such pipes are constructed with asbestos cement materials, the abandonment activities shall be performed by a licensed asbestos abatement contractor as specified in these Specifications.
- B. Grout shall be injected within the pipe sections indicated on the Drawings. The ends of these sections shall be capped and/or plugged. The grouting program shall consist of pumping sand-cement grout with suitable chemical additives at pressures necessary to fill the pipe sections shown on the Drawings to prevent the potential for future collapse.
- C. The pump used for grouting should be a continuous flow, positive displacement model with a pugmill type mixing vat having a minimum shaft speed of 60 rpm and incorporated as an integral part of the equipment. Alternate equipment may be used subject to the approval of the County. The rate of pumping shall not exceed six (6) cubic feet per minute. The pumping pressures shall be in the range of 100 to 150 psi.
- D. The Contractor shall provide standpipes and/or additional means of visual inspection as required by the County to determine if adequate grout material has filled the entire pipe section(s). The Contractor shall make necessary provisions for the County's representative to monitor all grouting operations.
- E. All pipe to be abandoned shall be capped or plugged with a fitting or material that will prevent soil or other material from entering the pipe. All caps and plugs shall be subject to approval by the County.

END OF SECTION

SECTION 02100

SITE PREPARATION

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. This Section covers clearing, grubbing and stripping of the project site and/or along the pipeline route.
- B. The Contractor shall clear and grub all of the area within the limits of construction or as required, which includes, but is not limited to utility easements. The width of the area to be cleared shall be reviewed by the County prior to the beginning of any clearing.
- C. The Contractor's attention is directed to any Soil Erosion and Sediment Control Ordinances in force in Manatee County. The Contractor shall comply with all applicable sections of these ordinances.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION

3.01 CLEARING

The surface of the ground, for the area to be cleared and grubbed shall be completely cleared of all timber, brush, stumps, roots, grass, weeds, rubbish and all other objectionable obstructions resting on or protruding through the surface of the ground. However, trees shall be preserved as hereinafter specified unless otherwise designated by the County. Clearing operations shall be conducted so as to prevent damage to existing structures and installations and to those under construction, so as to provide for the safety of employees and others. Soil erosion control devices such as hay bales and silt fences shall be installed to satisfy all Federal, State and County requirements.

3.02 GRUBBING

Grubbing shall consist of the complete removal of all stumps, roots larger than 1-1/2 inches in diameter, matted roots, brush, timber, logs and any other organic or metallic debris not suitable for foundation purposes, resting on, under or protruding through the surface of the ground to a depth of 18 inches below the subgrade. All depressions excavated below the original ground surface for or by the removal of such objects, shall be refilled with suitable materials and compacted to a density conforming to the surrounding ground surface.

3.03 STRIPPING

In areas so designated, topsoil shall be stockpiled. Topsoil so stockpiled shall be protected until it is placed as specified. The County shall have the option to receive all excess topsoil materials. The Contractor shall pay all equipment and labor cost to deliver excess top soil material to a remote site chosen by the County within a five mile radius of

the construction site. Should County not choose to receive any or all excess topsoil materials, the Contractor shall dispose of said material at no additional cost to County.

3.04 DISPOSAL OF CLEARED AND GRUBBED MATERIAL

The Contractor shall dispose of all material and debris from the clearing and grubbing operation by hauling such material and debris off site. The cost of disposal (including hauling) of cleared and grubbed material and debris shall be considered a subsidiary obligation of the Contractor; the cost of which shall be included in the prices bid for the various classes of work.

3.05 PRESERVATION OF TREES

Those trees which are not designated for removal by the County shall be carefully protected from damage. The Contractor shall erect such barricades, guards and enclosures as may be considered necessary by him for the protection of the trees during all construction operation.

3.06 PRESERVATION OF DEVELOPED PRIVATE PROPERTY

- A. The Contractor shall exercise extreme care to avoid unnecessary disturbance of developed private property adjacent to proposed project site. Trees, shrubbery, gardens, lawns and other landscaping, which are not designated by the County to be removed, shall be replaced and replanted to restore the construction easement to the condition existing prior to construction.
- B. All soil preservation procedures and replanting operations shall be under the supervision of a nursery representative experienced in such operations.
- C. Improvements to the land such as fences, walls, outbuildings and other structures which of necessity must be removed, shall be replaced with equal quality materials and workmanship.
- D. The Contractor shall clean up the construction site across developed private property directly after construction is completed upon approval of the County.

3.07 PRESERVATION OF PUBLIC PROPERTY

The appropriate paragraphs of these Specifications shall apply to the preservation and restoration of public lands, parks, rights-of-way, easements and all other damaged areas. This includes, but is not limited to the trimming of trees damaged by contractor's equipment.

END OF SECTION

SECTION 02220

EXCAVATION, BACKFILL, FILL AND GRADING FOR STRUCTURES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Structural excavation shall consist of the removal of material for the construction of foundations for structures and other excavation designated on the drawings or in these specifications.
- B. Structural excavation and backfill shall consist of furnishing material, if necessary and placing and compacting backfill material around structures to the lines and grades designated on the drawings, as specified or directed by the County.
- C. Structural excavation and backfill shall include the furnishing of all materials, equipment and other facilities which may be necessary to perform the excavations, place and compact the backfill, install sheeting and bracing, and carry out any necessary dewatering. It shall also include the wasting or disposal of surplus excavated material in a manner and in locations approved by the County.
- D. The Contractor is responsible for the protection of every tree which is scheduled to remain in the project area. This includes trees which may or may not be shown on the plans. Every tree shall be adequately protected in place at no additional cost to the County. This includes, but is not limited to, protecting the root systems and adjusting grades as necessary for tree/root protection.

1.02 QUALITY ASSURANCE

- A. Testing Agency:
 - 1. In place soil compaction tests shall be performed by a qualified testing laboratory.
 - 2. Compaction tests shall be taken every 500 feet, except in the road crossings or road shoulders. Tests are to be taken according to current FDOT Standards.
- B. Reference Standards:
 - 1. American Society for Testing and Materials (ASTM):
 - a. ASTM D1557, Moisture-Density Relations of Soils Using 10-lb. (4.5-kg) Rammer and 18-in. (457-mm) Drop.

1.03 JOB CONDITIONS

- A. The Contractor shall provide, operate and maintain all necessary pumps, discharge lines, well points, etc., in sufficient number and capacity to keep all

excavation, bases, pits, etc., free from seepage, standing or running water at all times throughout the period of construction.

- B. The Contractor shall assume all responsibility for the security of the excavation required, employing bracing, lining or other accepted means necessary to accomplish same.
- C. Excavated areas shall be cleared of all debris, water, slush, muck, clay and soft or loose earth and shall be conditioned to the entire satisfaction of the County.
- D. All excavated material unsuitable for use or which will not be used shall be disposed of in a manner consistent with State and County regulation.
- E. All unsuitable organic materials, roots, logs, etc., found during excavation shall be removed by the Contractor and the trench shall be refilled with suitable material.

PART 2 PRODUCTS

2.01 MATERIAL FOR CONTROLLED FILL

- A. Composition: Only approved material free from organic matter and lumps of clay, shall be used for backfill. Excavated earth free from debris or organic material may be used for backfilling foundations or fill.
- B. Crushed stone and shell shall meet or exceed current FDOT Standards.

2.02 UNSUITABLE MATERIAL

Unsuitable material shall be defined as highly organic soil per ASTM D2487 Group PT. This includes, but is not limited to, such items as topsoil, roots, vegetable matter, trash, debris, and clays that cannot be dried sufficiently to obtain specified compaction.

PART 3 EXECUTION

3.01 INSPECTION

- A. The Contractor shall verify that work preceding the affected work of this Section has been satisfactorily completed.
- B. Conditions adversely affecting the work of this Section shall be corrected to the satisfaction of the County.

3.02 REMOVAL OF UNSUITABLE MATERIALS

- A. The Contractor shall remove unsuitable material from within the limits of the Work.

- B. Materials meeting requirements for controlled fill shall be stockpiled as necessary and in such a manner satisfactory to the County.
- C. All material excavated shall be placed so as to minimize interference with public travel and to permit proper access for inspection of the work.

3.03 EXCAVATION

- A. When concrete or shell subbase footing is to rest on an excavated surface, care shall be taken not to disturb the natural soil. Final removal and replacement of the foundation material and subbase compaction to grade shall not be made until just before the concrete or masonry is placed.
- B. When any structural excavation is completed, the Contractor shall notify the County who will make an inspection of the excavation. No concrete or masonry shall be placed until the excavation has been approved by the County.
- C. The elevations of the footing bottom and the base slab as shown on the Drawings, shall be considered as approximate and the County may order in writing, such changes in dimensions or elevations of the footings and slab base as necessary to secure satisfactory foundations.
- D. All excavation shall be made within an area bounded by lines five feet outside and parallel to the exterior walls of the structure to allow for correct forming, shoring and inspection of foundation work. Pouring of concrete against earth side walls shall not be permitted.
- E. If the ground is excavated below the grade called for by the Drawings or becomes unstable due to the Contractor's carelessness or operations, the ground shall be excavated to undisturbed native soil before continuing concreting operations.
- F. If in the opinion of the County, the material at or below the normal grade of the bottom of the trench is unsuitable for pipe or structure foundation, it shall be removed to the depth directed by the County and if so directed, replaced by crushed stone or washed shell.

3.04 STRUCTURAL BACKFILL

- A. Structural backfill shall not be placed until the footings or other portions of the structure or facility have been inspected by the County and approved for backfilling.
- B. A minimum of 1-1/2" layer of lean concrete shall be placed as a working mat for the concrete base slabs and footings if required by the County.
- C. Fill shall be placed in uniform layers not more than 12" thick and compacted to a minimum of 98 percent of the maximum density determined by ASTM D1557, Method A or C, or as directed by the County. The Contractor shall securely tamp the backfill with pneumatic rammer around all wall foundations. The method of compaction shall be satisfactory to the County.

- D. Compaction of structural backfill by ponding and jetting may be permitted when, as determined by the County: the backfill material is of such character that it will be self-draining when compacted; foundation materials will not soften or be otherwise damaged by the applied water; no damage from hydrostatic pressure will result to the structure. Ponding and jetting within two feet below finished subgrade shall not be permitted in roadway areas. At the discretion of the County, ponding and jetting may be permitted with compaction layers not to exceed four feet.
- E. Surplus material not used on-site shall be removed and disposed of off-site by the Contractor. In no case shall surplus material be deposited on adjacent lands. Fill used for grading shall be placed in layers not to exceed 12 inches in thickness and shall be compacted to a density equal or greater to that of the surrounding natural ground.

3.05 BACKFILLING AROUND STRUCTURES

- A. Common fill and structural fill are specified for use as backfill against the exterior walls of the structures. Fill shall be placed in layers having a maximum thickness of eight (8) inches in loose state and shall be compacted sufficiently to prevent settlement. If compaction is by rolling or ramming, material shall be wetted down as required. Where material can be suitably compacted by jetting or puddling, the Contractor may use one of these methods. No boulders shall be allowed to roll down the slopes and hit the walls.
- B. Backfilling shall be carried up evenly on all walls of an individual structure simultaneously. A variation of two (2) feet in elevation will be the maximum allowable. No backfill shall be allowed against walls until the walls and their supporting slabs, if applicable, have attained sufficient strength. Backfilling shall be subjected to approval by the County.
- C. In locations where pipes pass through building walls, the Contractor shall take the following precautions to consolidate the refill up to an elevation of at least one foot above the bottom of the pipes:
 - 1. Place structural fill in such areas for a distance of not less than three feet either side of the center line of the pipe in level layers not exceeding 6-inches in depth.
 - 2. Wet each layer to the extent directed and thoroughly compact each layer with a power tamper to the satisfaction of the County.
 - 3. Structural fill shall be of the quality specified under Part 2 of this Section.
- D. The surface of filled areas shall be graded to smooth true lines, strictly conforming to grades indicated on the grading plan. No soft spots or uncompacted areas shall be allowed in the work.
- E. Temporary bracing shall be provided as required during construction of all structures to protect partially completed structures against all construction loads,

hydraulic pressure and earth pressure. The bracing shall be capable of resisting all loads applied to the walls as a result of backfilling.

3.06

FIELD QUALITY CONTROL

- A. The density of soil in place shall be a minimum of 95 percent in accordance with ASTM test 1557-70T, Method A or C.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02221

TRENCHING, BEDDING AND BACKFILL FOR PIPE

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals necessary to perform all excavation, backfill, fill, grading, trench protection or other related work required to complete the piping work shown on the Drawings and specified herein. The work shall include, but not be limited to: vaults; duct conduit; pipe; roadways and paving; backfilling; required fill or borrow operations; grading; disposal of surplus and unsuitable materials; and all related work such as sheeting, bracing and dewatering.
- B. Prior to commencing work, the Contractor shall examine the site and review test borings if available, or undertake his own subsurface investigations and take into consideration all conditions that may affect his work.
- C. The Contractor is responsible for the protection of every tree which is scheduled to remain in the project area. This includes trees which may or may not be shown on the plans. Every tree shall be adequately protected in place at no additional cost to the County. This includes, but is not limited to protecting the root systems and adjusting grades as necessary for tree/root protection.

1.02 PROTECTION

- A. Sheeting and Bracing in Excavations:
 - 1. In connection with construction of underground structures, the Contractor shall properly construct and maintain cofferdams. These shall consist of: sheeting and bracing as required to support the sides of excavations, to prevent any movement which could in any way diminish the width of the excavation below that necessary for proper construction and to protect adjacent structures, existing yard pipe and/or foundation material from disturbance, undermining, or other damage. Care shall be taken to prevent voids outside of the sheeting, but if voids are formed, they shall be immediately filled and rammed.
 - 2. Trench sheeting for pipes: no sheeting is to be withdrawn if driven below, mid-diameter of any pipe and no wood sheeting shall be cut off at a level lower than one foot above the top of any pipe unless otherwise directed by the County. During the progress of the work, the County may direct the Contractor in writing to leave additional wood sheeting in place. If steel sheeting is used for trench sheeting, removal shall be as specified above, unless written approval is given for an alternate method of removal.
 - 3. All sheeting and bracing not left in place shall be carefully removed in such a manner as not to endanger the construction or other structures, utilities, existing piping, or property. Unless otherwise approved or indicated on the Drawings or in the Specification, all sheeting and bracing shall be removed after completion of the piping or structure, care being taken not to disturb or otherwise injure the pipeline or finished masonry. All voids left or caused by withdrawal of sheeting shall be

immediately refilled with sand by ramming with tools specifically made for that purpose, by watering, or as may otherwise be directed.

4. The Contractor shall construct, to the extent he deems it desirable for his method of operation, the cofferdams and sheeting outside the neat lines of the pipeline trench or foundation unless otherwise indicated on the Drawings or directed by the County. Sheeting shall be plumb and securely braced and tied in position. Sheeting, bracing and cofferdams shall be adequate to withstand all pressures to which the pipeline or structure will be subjected. Pumping, bracing and other work within the cofferdam shall be done in a manner to avoid disturbing any construction of the pipeline or the enclosed masonry. Any movement or bulging which may occur shall be corrected by the Contractor at his own expense so as to provide the necessary clearances and dimensions.
5. Drawings of the cofferdams and design computations shall be submitted to the County and approved prior to any construction. However, approval of these drawings shall not relieve the Contractor of the responsibility for the cofferdams. The drawings and computations shall be prepared and stamped by a Registered Professional Engineer in the State of Florida and shall be in sufficient detail to disclose the method of operation for each of the various stages of construction, if required, for the completion of the pipeline and substructures.

B. Dewatering, Drainage and Flotation

1. The Contractor shall construct and place all pipelines, concrete work, structural fill, bedding rock and limerock base course, in-the-dry. In addition, the Contractor shall make the final 24" of excavation for this work in-the-dry and not until the water level is a minimum of 6" below proposed bottom of excavation.
2. The Contractor shall, at all times during construction, provide and maintain proper equipment and facilities to remove promptly and dispose of properly all water entering excavation and keep such excavations dry so as to obtain a satisfactory undisturbed subgrade foundation condition until the fill, structure, or pipes to be built thereon have been completed to such extent that they will not be floated or otherwise damaged by allowing water levels to return to natural elevations.
3. Dewatering shall at all times be conducted in such a manner as to preserve the natural undisturbed bearing capacity of the subgrade soils at proposed bottom of excavation.
4. Wellpoints may be required for dewatering the soil prior to final excavation for deeper in-ground structures or piping and for maintaining the lowered groundwater level until construction has been completed to avoid the structure, pipeline, or fill from becoming floated or otherwise damaged. Wellpoints shall be surrounded by suitable filter sand and no fines shall be removed by pumping. Pumping from wellpoints shall be continuous and standby pumps shall be provided.
5. The Contractor shall furnish all materials and equipment to perform all work required to install and maintain the proposed drainage systems for handling groundwater and surface water encountered during construction of structures, pipelines and compacted fills.
6. Where required, the Contractor shall provide a minimum of two operating groundwater observation wells at each structure to determine the water level during construction of the pipeline or structure. Locations of the observation wells shall be at structures and along pipelines as approved by the County prior to their installation. The observation wells shall be extended to 6 inches above finished

grade, capped with screw-on caps protected by 24" x 24" wide concrete base and left in place at the completion of this Project.

7. Prior to excavation, the Contractor shall submit his proposed method of dewatering and maintaining dry conditions to the County for approval. Such approval shall not relieve the Contractor of the responsibility for the satisfactory performance of the system. The Contractor shall be responsible for correcting any disturbance of natural bearing soils for damage to pipeline or structures caused by an inadequate dewatering system or by interruption of the continuous operation of the system as specified.
8. As part of his request for approval of a dewatering system, the Contractor shall demonstrate the adequacy of the proposed system and wellpoint filter sand by means of a test installation. Discharge water shall be clear, with no visible soil particles in a one quart sample. Discharge water shall not flow directly into wetlands or Waters of the State as defined by FDEP and SWFWMD.
9. During backfilling and construction, water levels shall be measured in observation wells located as directed by the County.
10. Continuous pumping will be required as long as water levels are required to be below natural levels.

PART 2 PRODUCTS

2.01 MATERIALS

A. General

1. Materials for use as fill and backfill shall be described below. For each material, the Contractor shall notify the County of the source of the material and shall furnish the County, for approval, a representative sample weighing approximately 50 pounds, at least ten calendar days prior to the date of anticipated use of such material.
2. Additional materials shall be furnished as required from off-site sources and hauled to the site.

B. Structural Fill

1. Structural fill in trenches shall be used below spread footing foundations, slab-on-grade floors and other structures as backfill within three feet of the below grade portions of structures.
2. Structural fill material shall be a minimum of 60 percent clean sand, free of organic, deleterious and/or compressible material. Minimum acceptable density shall be 98 percent of the maximum density as determined by AASHTO T-180. Rock in excess of 2-1/2" in diameter shall not be used in the fill material. If the moisture content is improper for attaining the specified density, either water shall be added or material shall be permitted to dry until the proper moisture content for compaction is reached.

C. Common Fill

1. Common fill material shall be free from organic matter, muck or marl and rock exceeding 2-1/2" in diameter. Common fill shall not contain broken concrete,

masonry, rubble or other similar materials. Existing soil may be used to adjust grades over the site with the exception of the construction area.

2. Material falling within the above specification, encountered during the excavation, may be stored in segregated stockpiles for reuse. All material which, in the opinion of the County, is not suitable for reuse shall be spoiled as specified herein for disposal of unsuitable materials by the Contractor.

D. Crushed Stone

1. Crushed stone may be used for pipe bedding, manhole bases, as a drainage layer below structures with underdrains and at other locations indicated on the Drawings.
2. Crushed stone shall be size No. 57 with gradation as noted in Table 1 of Section 901 of Florida Department of Transportation, Construction of Roads and Bridges.

PART 3 EXECUTION

3.01 TRENCH EXCAVATION AND BACKFILLING

- A. Excavation for all trenches required for the installation of pipes and electrical ducts shall be made to the depths indicated on the Drawings and in such manner and to such widths as will give suitable room for laying the pipe or installing the ducts within the trenches.
- B. Rock shall be removed to a minimum 6" clearance around the bottom and sides of all the pipe or ducts being laid.
- C. Where pipes or ducts are to be laid in limerock bedding or encased in concrete, the trench may be excavated by machinery to or just below the designated subgrade provided that the material remaining in the bottom of the trench is no more than slightly disturbed.
- D. Where the pipes or ducts are to be laid directly on the trench bottom, the lower part of the trenches shall not be excavated to grade by machinery. The last of the material being excavated manually, shall be done in such a manner that will give a flat bottom true to grade so that pipe or duct can be evenly supported on undisturbed material. Bell holes shall be made as required.
- E. Backfilling over pipes shall begin as soon as practicable after the pipe has been laid, jointed and inspected and the trench filled with suitable compacted material to the mid-diameter of the pipe.
- F. Backfilling over ducts shall begin not less than three days after placing concrete encasement.
- G. All backfilling shall be prosecuted expeditiously and as detailed on the Drawings.
- H. Any space remaining between the pipe and sides of the trench shall be packed full by hand shovel with selected earth, free from stones having a diameter greater than 2" and thoroughly compacted with a tamper as fast as placed, up to a level of one foot above the top of the pipe.

- I. The filling shall be carried up evenly on both sides with at least one man tamping for each man shoveling material into the trench.
- J. The remainder of the trench above the compacted backfill, as just described above, shall be filled and thoroughly compacted by rolling, ramming, or puddling, as the County may direct, sufficiently to prevent subsequent settling.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02223

EXCAVATION BELOW GRADE AND CRUSHED STONE OR SHELL REFILL

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. If in the opinion of the County, the material at or below the normal grade of the bottom of the trench is unsuitable for pipe or structure foundation, it shall be removed to the depth directed by the County and replaced by crushed stone or washed shell.

PART 2 PRODUCTS (NOT USED)

PART 3 MATERIALS

3.01 EXCAVATION AND DRAINAGE

- A. Whatever the nature of unstable material encountered or the groundwater conditions, trench stabilization shall be complete and effective.
- B. Should the Contractor excavate below the grade shown on the Contract drawings because of negligence or for his own convenience; due to failure in properly dewatering the trench; disturbs the subgrade before dewatering is sufficiently complete; he shall be directed by the County to excavate below grade. The work of excavating below grade and furnishing and placing the approved refill material shall be performed at the Contractor's expense.

3.02 REFILL

- A. Should the material at the level of trench bottom consist of fine sand, sand and silt or soft earth, the subgrade material shall be removed as directed by the County and the excavation shall be refilled with crushed stone or washed shell.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02260

FINISH GRADING

PART 1 GENERAL

1.01 WORK INCLUDED

- A. The Contractor shall finish grade sub-soil.
- B. The Contractor shall cut out areas to receive stabilizing base course materials for paving and sidewalks.
- C. The Contractor shall place, finish grade and compact top soil.

1.02 PROTECTION

The Contractor shall prevent damage to existing fencing, trees, landscaping, natural features, bench marks, pavement and utility lines. Damage shall be corrected at no cost to the County.

PART 2 PRODUCTS

- A. Topsoil: Shall be friable loam free from subsoil, roots, grass, excessive amount of weeds or other organics, stones, and foreign matter; acidity range (pH) of 5.5 to 7.5; containing a minimum of 4 percent and a maximum of 25 percent organic matter. The Contractor may use topsoil stockpiles on site if they conform to these requirements.

PART 3 EXECUTION

3.01 SUB-SOIL PREPARATION

- A. The Contractor shall rough grade sub-soil systematically to allow for a maximum amount of natural settlement and compaction. Uneven areas and low spots shall be eliminated. Debris, roots, branches or other organics, stones, and sub-soil shall be removed by the Contractor and disposed of in a manner consistent with the latest Manatee County Standards as well as any affected regulatory agency. Should contaminated soil be found, the Contractor shall notify the County.
- B. The Contractor shall cut out areas to sub-grade elevation to stabilize base material for paving and sidewalks.
- C. The Contractor shall bring sub-soil to required profiles and contour grades gradually; and blend slopes into level areas.
- D. The Contractor shall slope the structure grade a minimum of two (2) inches in ten (10) feet unless indicated otherwise on the Drawings.
- E. The Contractor shall cultivate sub-grade to a depth of 3 inches where the topsoil is to be placed. He shall repeat cultivation in areas where equipment use has compacted sub-soil.

- F. The Contractor shall not make grade changes which causes water to flow onto adjacent lands.

3.02 PLACING TOPSOIL

- A. The Contractor shall place topsoil in areas where seeding, sodding and planting is to be performed. He shall place from the following minimum depths, up to finished grade elevations:
 - 1. 6 inches for seeded areas
 - 2. 4-1/2 inches for sodded areas
 - 3. 24 inches for shrub beds
 - 4. 18 inches for flower beds
- B. The Contractor shall use topsoil in a dry state as determined by the County. He shall place the material during dry weather.
- C. The Contractor shall use fine grade topsoil eliminating rough and low areas to ensure positive drainage. He shall maintain levels, profiles and contours of the sub-grades.
- D. The Contractor shall remove stone, roots, grass, weeds, debris, and other organics or foreign material while spreading the material.
- E. The Contractor shall manually spread topsoil around trees, plants and structures to prevent damage which may be caused by grading equipment.
- F. The Contractor shall lightly compact and place the topsoil.

3.03 SURPLUS MATERIAL

- A. The Contractor shall remove surplus sub-soil and topsoil from site at his expense.
- B. The Contractor shall leave stockpile areas and entire job site clean and raked, ready for landscaping operations.

END OF SECTION

SECTION 02276

TEMPORARY EROSION AND SEDIMENTATION CONTROL

PART 1 GENERAL

1.01 DESCRIPTION

- A. The work specified in this Section consists of the design, provision, maintenance and removal of temporary erosion and sedimentation controls as necessary.
- B. Temporary erosion controls include, but are not limited to: grassing, mulching, netting, watering, and the reseeding of on-site surfaces and spoil and borrow area surfaces, interceptor ditches at ends of berms and other such work at those locations which will ensure that erosion during construction will be either eliminated or maintained within acceptable limits as established by the County.
- C. Temporary sedimentation controls include, but are not limited to: silt dams, traps, barriers, and appurtenances at the foot of sloped surfaces which shall ensure that sedimentation pollution will be either eliminated or maintained within acceptable limits as established by the County.
- D. The Contractor is responsible for providing effective temporary erosion and sediment control measures during construction or until final controls become effective.

1.02 REFERENCE DOCUMENTS

- A. Florida Building Code.
- B. FDEP/COE Dredge and Fill Regulations and/or Permit as applicable.
- C. SWFWMD Permit Regulations and/or Permit as applicable.
- D. Florida Stormwater, Erosion and Sedimentation Control Inspector's Manual.

PART 2 PRODUCTS

2.01 EROSION CONTROL

- A. Netting - fabricated of material acceptable to the County.
- B. Seed and sod.

2.02 SEDIMENTATION CONTROL

- A. Bales - clean, seed free cereal hay type.
- B. Netting - fabricated of material acceptable to the County.
- C. Filter stone - crushed stone conforming to Florida Dept of Transportation specifications.

- D. Concrete block - hollow, non-load-bearing type.
- E. Concrete - exterior grade not less than one inch thick.

PART 3 EXECUTION

3.01 EROSION CONTROL

- A. Minimum procedures for grassing shall be:
 - 1. Scarify slopes to a depth of not less than six inches and remove large clods, rock, stumps, roots larger than 1/2 inch in diameter and debris.
 - 2. Sow seed within twenty-four (24) hours after the ground is scarified with either mechanical seed drills or rotary hand seeders.
 - 3. Apply mulch loosely and to a thickness of between 3/4-inch and 1-1/2 inches.
 - 4. Apply netting over mulched areas on sloped surfaces.
 - 5. Roll and water seeded areas in a manner which will encourage sprouting of seeds and growing of grass. Reseed areas which exhibit unsatisfactory growth. Backfill and seed eroded areas.

3.02 SEDIMENTATION CONTROL

- A. The Contractor shall install and maintain silt dams, traps, barriers, and appurtenances as shown on the approved descriptions and working drawings. Deteriorated hay bales and dislodged filter stone shall be replaced by the Contractor at his expense.

3.03 PERFORMANCE

- A. The Contractor, at his own expense, shall immediately take whatever steps are necessary to correct any deficiencies of the temporary erosion and sediment control measures employed if they fail to produce results or do not comply with the requirements of the State of Florida or any other federal, governmental or regulatory agency.

END OF SECTION

SECTION 02325

ROAD AND RAILROAD CROSSINGS

PART 1 GENERAL

1.01 SCOPE OF WORK

The Contractor shall furnish all labor, equipment, materials and incidentals required to install road or railroad crossings as shown on the Drawings and as specified herein.

1.02 OPERATIONS ON MANATEE COUNTY OR STATE OF FLORIDA PROPERTY

- A. All work affecting Manatee County, Florida Department of Transportation, any other governmental agency's right-of-way or facilities, or railroad right-of-way shall be carried out to the full satisfaction of the applicable Department's authorized representative. The Contractor shall be responsible to meet any and all requirements of the Department of Transportation, railroad, or other agency pertaining to the specific project and shall conduct all his work accordingly.
- B. Prior to the start of the jacking operation, a detailed jacking plan shall be submitted to the County for review and approval. No work shall be permitted until the submittals are accepted. A Bore Path Report shall be submitted with in three (3) days of completion of the bore.
- C. Prior to construction, a minimum of three working days written notice prior to start of the actual work shall be given to the County and to the Florida Department of Transportation or other applicable agency.
- D. The Contractor shall install, maintain and leave in place any sheeting, underpinning, cribbing and other related items (other than that required for the jacking pits) to support any structures or facility on the right-of-way owned by either Manatee County, Florida Dept. of Transportation or other governmental agency or railroad entity. The Contractor, at his expense, may be directed by the Department of Transportation, other applicable agency, or the County, to leave sheeting in place.
- E. The Contractor shall perform all necessary soil test borings to determine actual soil conditions and shall utilize the results of said borings to determine the procedures required for each jack and bore operation, including, but not limited to, the presence of rock and necessary dewatering requirements.
- F. No wires, equipment, or other appurtenances shall be permitted to be placed across or pass across State property without the express written permission of the Department of Transportation's authorized representative.
- G. All equipment used by the Contractor on State property may be inspected by the State and shall not be used if it is deemed unsatisfactory by an authorized State representative. State highways shall be kept free of obstructions at all times.
- H. No blasting shall be permitted under or adjacent to any State highways.

- I. The Contractor shall be responsible for all damages arising from his negligence or failure to comply with any State or Manatee County regulations or requirements or deviations from the Contract Documents.
- J. All State highway crossings shall be performed and completed in a manner fully satisfactory to the Department of Transportation and Manatee County.
- K. Traffic control requirements and procedures are detailed in Section 01570 of this specification.

1.03 SHOP DRAWINGS

The Contractor shall furnish working drawings showing all fabrication and construction details for the jacked crossings.

1.04 SUBMITTALS

- A. Contractor shall submit a Jacking Plan that includes the following:
 - 1. Site layout plan for entry and exit pit locations, drawn to scale, depicting the position of all required equipment, access points, existing facilities to remain in place, existing traffic lanes to be maintained in operation, office trailers and storage sites.
 - 2. Qualification information on jack/bore contractor.
 - 3. Manufacturer's information on equipment to be used.
 - 4. Methods and materials for retaining walls for jacking and receiving pits.
- B. Bore Report that details final alignment, dimensions, and record documentation.

PART 2 PRODUCTS

2.01 MATERIALS

Sleeve, carrier pipe, skids, insulation, bulkheads, etc. shall be per contract plans.

PART 3 EXECUTION

3.01 JACKING SLEEVE

- A. The Contractor shall provide all labor, material, equipment and appurtenances required for jacking the sleeves beneath the roadway or railroad tracks. The steel sleeve shall be welded steel pipe and jacked in one continuous operation at the locations shown on the drawings. Once the operation starts, jacking shall not be discontinued. Proper alignment and elevation of the sleeves shall be consistently maintained throughout the jacking operation.
- B. The Contractor shall shore the jacking pits with sheeting or such other materials as required. Sheeting shall be driven to a sufficient depth below the invert of the steel sleeve to resist any pressure developed by the soil outside the jacking pit. Sheeting shall

terminate not less than 3-feet, 6-inches above existing grade.

- C. The sections of steel sleeve shall be field welded in accordance with the applicable portions of AWWA C-206 for field welded water pipe joints. Steel sleeve shall receive one coat of Tnemec 46H-413 Hi-Build Tnemec-tar applied in accordance with manufacturer's recommendation.
- D. At the completion of the jacking operations, the Contractor shall be required to leave all sheeting in place. The top of the sheeting shall be cut off 36-inches below finished grade.
- E. The Contractor shall be responsible for preventing voids outside the steel sleeves. Should they occur, the Contractor may be directed to fill them with grout in a method approved by the County. The Contractor shall exercise care in the sleeve removal to prevent voids.
- F. The Contractor shall be responsible for furnishing, installing and removing the thrust block or restraint which was employed in driving the sleeve forward. No additional payment for the jacking restraint shall be made other than the unit price for this item. The entire jacking operation shall be discussed and accepted by the County prior to commencing jack and bore operation. After completion, the backup structures shall be removed in part or whole to permit construction of the pipeline in the sleeve.

3.02 INSTALLING PIPE IN SLEEVE

- A. The Contractor shall install the pipe in full conformity with the Contract Documents. The pipe shall be installed to the lines and grades required within the sleeve and placed to the approval of the County. The pipe shall be braced to the side and the top of the sleeve to prevent flotation or motion.
- B. A bulkhead shall be placed at the ends of the sleeve to keep the surrounding soil and material from migrating into the voids in the sleeve..

3.03 TESTING

The pipe shall be tested as provided in the Contract Document.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02480

LANDSCAPING

PART 1 GENERAL

1.10 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment, and incidentals required to install trees, ground cover, and shrubs, to place accessory planting materials, to maintain and guarantee all planted areas. All work shall be in strict accordance with sound nursery practice and shall include maintenance and watering of all of the work of this Contract until final completion and acceptance by the County.
- B. The landscaping shall be performed by a contractor or subcontractor who specializes in landscaping and who is fully familiar and experienced in projects of this type and scope. The landscaping contractor or subcontractor shall be subject to the approval of the County.
- C. The Contractor shall provide all landscaping complete and ready for use as specified in the Contract Documents and as shown on the Drawings.

1.02 SUBMITTALS

- A. The Contractor shall submit to the County for review and approval, shop drawings and complete written maintenance instructions for each type of plant furnished under this Contract.
- B. The Contractor shall submit representative samples of any or all of required accessory planting materials as requested by the County.

1.03 OBSTRUCTIONS BELOW GROUND

- A. The County may change the location of plant material if underground construction, utilities or obstructions are encountered in excavation of planting areas or pits.
- B. The Contractor shall make such changes without additional compensation from the County.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Plant species and size shall conform to those indicated in the Plant List and in plan locations shown on the Drawings. Nomenclature shall conform to the Florida Department of Agriculture: "Grades and Standards for Nursery Plants". The designated authority for identification of plants shall be in conformance with FDOT Standard Specification Section 580-2.1.1 Plants.
- B. Plants shall be sound, healthy, vigorous, free from plant diseases, insects, pests, or their

eggs and shall have healthy normal root systems. Plants shall be nursery grown stock, freshly dug. No heeled in, cold storage, or collected stock shall be accepted.

C. Shape and Form

1. Plant material shall be symmetrical, typical for the variety and species, and shall conform to the measurements specified in the Plant List.
2. Plants used where symmetry is required shall be matched as nearly as possible.
3. Plants shall not be pruned prior to delivery except as authorized by the County.
4. All plants shall have been transplanted or root pruned at least once in the past three years.
5. Unless otherwise noted, street trees shall be free of branches up to six feet, with the single leader well branched, and with straight trunks.
6. Shrubs shall have been transplanted twice, have fully developed root systems, be heavily canned with foliage to base, fulfill dimensions required, and be typical of species.
7. Ground covers shall have sturdy fibrous root systems and shall be heavily leafed.

D. Measurement: The height and/or width of trees shall be measured from the ground or across the normal spread of branches with the plants in their normal position. This measurement shall not include the immediate terminal growth.

E. Substitutions in plant species or size shall be made only with the written approval of the County.

F. Ground cover plants shall be planted in beds of four inches of approved topsoil. The beds shall be thoroughly disked into the soil. The compacted and settled finished surface shall be set to the required grade. Plants shall be spaced as described in the Contract Documents or shown on the Contract Drawings, or otherwise directed by the County in accordance with the best practices of the trade.

G. Planting Soil

1. Soil for backfilling around plants and planting beds shall be a good grade of garden loam as approved by the County. Soil shall be free of heavy clay, coarse sand, stones, lumps, sticks, or other foreign material. The soil shall not be delivered or used in a muddy condition.
2. The soil shall be taken from ground that has never been stripped. There shall be a slight acid reaction to the soil with no excess of calcium or carbonate. The soil shall be free from excess weeds or other objectionable material.
3. Soil for trees and shrubs shall be delivered in a loose, friable condition. All trees shall average approximately one cubic yard per tree, except Sabal Palmetto, which shall be planted with clean sand. There shall be a minimum of 4-inches of planting soil in ground cover areas and 1/8 cubic yard per shrub or vine.
4. No marl shall be allowed in ground cover planting beds.

H. Before plants are backfilled with planting soil, fertilizer tablets, Agriform 20-10-5 or equal, shall be placed in each pit. The Contractor shall provide three tablets for each tree and one for each shrub or vine.

- I. Tree Staking: All tree staking and bracing shall be included herein in accordance with sound nursery practice and shall be in accordance with the Contract Documents. The Contractor shall furnish all materials required for staking and bracing as approved.
- J. Landscaping stones shall be inert and nonleaching. The Contractor shall provide physical samples for approval prior to installation. Crushed limerock shall not be acceptable.

PART 3 EXECUTION

3.01 PLANTING PROCEDURES

- A. Plant Locations: All plants shall be located as shown on the Drawings, to dimensions if shown, to scale if not dimensioned. Large areas or beds shall be scaled and the plants spaced evenly. Approval by the County is required before any plants may be installed.
- B. Tree Pits: Pits for trees shall be at least two feet greater in diameter than the specified diameter of the ball. Pits shall be of sufficient depth to allow a 12-inch layer of planting soil under the ball when it is set to grade. Bottom of pit shall be loosened prior to backfilling.
- C. Digging and Handling
 - 1. Plants shall be handled at all times so that roots or balls are adequately protected from sun or drying winds. Tops or roots of plant allowed to dry out will be rejected.
 - 2. Balled and burlapped plants shall be moved with firm, natural balls of soil, not less than one foot diameter of ball to every one inch caliper of trunk, and a depth of not less than 2/3 of ball diameter. No plant shall be accepted when the ball of earth surrounding its roots has been cracked or broken. All trees, except palms, shall be dug with ball and burlapped. Root pruning shall have been done at minimum of four weeks before planting at the job.
 - 3. Bare root plants shall be dug with spread of root and of sufficient depth to insure full recovery of plant.
- D. Cabbage Palms (Sable Palmetto):
 - 1. Cabbage Palms shall be taken from moist black sand areas. Only a minimum of fronds shall be removed from the crown to facilitate moving and handling. Clear trunk or overall height shall be as specified after the minimum of fronds have been removed.
 - 2. Cabbage Palms buds shall be tied to a suitable support with a burlap strip, to be left in place until the tree is well established in its new location.
 - 3. Cabbage Palms shall be planted in sand, thoroughly washed in during planting operations, and with a dished or saucer depression left at the soil line for future waterings. Palms with marred or burned trunks will be accepted at the discretion of the County only.
 - 4. Trees moved by winch or crane shall be thoroughly protected from chain marks, girdling or bark slippage by means of burlap, wood battens, or other approved method.
- E. When balled or burlapped plants are set, planting soil shall be carefully tamped under and around the base of the balls to prevent voids. All burlap, rope, wires, etc., shall be

removed from the sides and tops of balls, but no burlap shall be pulled from underneath. Roots of bare rooted plants shall be properly spread out and planting soil carefully worked in among them.

- F. All plants shall be set straight or plumb, in locations shown on the Drawings. Except as otherwise specified, plants shall be planted in pits which shall be set at such level that, after settlement, they bear the same relation to the finished grade or the surrounding ground as they bore to the grade of the soil from which they are taken.
- G. Pruning shall be carefully done by experienced plantsmen. Prune immediately upon acceptance by the County, including any broken branches, thinning small branches and tipping back main branches (except main leaders).
- H. Excess soil and debris shall be disposed of off the project site unless ordered stockpiled by the County.

3.02 NORMAL MAINTENANCE OF PLANT MATERIALS

- A. Plant material maintenance shall begin when planting operations start and shall extend until final acceptance of work.
- B. Maintain all plant materials under this Contract to the satisfaction of the County. Maintenance shall include necessary watering, cultivation, weeding, pruning, spraying, tightening and repair to guy wires, removal of dead material, resetting, and other work required to conform with referenced standards and accepted nursery standards as approved.
- C. Plant materials which are in a tilted or in a leaning position shall be properly righted.
- D. After final acceptance by the County and until one calendar year after acceptance of all plantings, the landscaping contractor or subcontractor shall make monthly inspections of materials and report in writing to the County the conditions of the plants and the necessary requirements to keep the plants in a healthy growing condition.

3.03 TREE AND PLANT PROTECTION

- A. The Contractor shall remove all trees (if any) within the limit of landscaping shown on the detail sheet except those designated to be salvaged (if any). Prior to removal of said trees, the Contractor shall obtain a tree removal permit, if required. All other trees in the vicinity of the work shall be protected against damage by the Contractor until all work under the Contract has been completed.
- B. Consult with the County, and remove agreed-on roots and branches which interfere with construction. Employ qualified tree surgeon to remove, and to treat cuts.
- C. Provide temporary barriers to a height of six feet around each group of trees and plants.
- D. Protect root zones of trees and plants
 - 1. Do not allow vehicular traffic or parking.

2. Do not store materials or products.
 3. Prevent dumping or refuse or chemically injurious materials or liquids.
 4. Prevent puddling or continuous running water.
- E. Carefully supervise excavating, grading, and filling, and subsequent construction operations, to prevent damage.
 - F. In case of inadvertent damage to any tree or plant by the Contractor or any of his subcontractors or employees, the Contractor shall provide replacement of each such damaged tree or plant with a new one of acceptable type, size and quality.
 - G. Completely remove barricades, including foundations, when construction has progressed to the point that they are no longer needed, and when approved by the County.
 - H. Clean and repair damage caused by installation, fill and grade the areas of the site to required elevations and slopes, and clean the area.

3.04 GUARANTEE

The life and satisfactory condition of all plant material planted shall be guaranteed by the Contractor for a minimum of one calendar year. Guarantee shall include complete replacement with material of the same kind and size as in the original work if not in a healthy condition, as determined by the County, at the end of the guarantee period.

3.05 REPLACEMENT

- A. At the end of the guarantee period, any plant required under this Contract that is dead or not in satisfactory growth as determined by the County, shall be removed. Plants replaced shall be guaranteed for 90 days after date of replacement.
- B. Replacement of plants necessary during guarantee period shall be the responsibility of the Contractor, except for possible replacements of plants resulting from removal, vandalism, acts of neglect on the part of others, or acts of God.
- C. All replacements shall be plants of the same kind and size as specified in the Drawings. They shall be furnished and planted as herein specified. The cost shall be the responsibility of the Contractor.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02485

SEEDING AND SODDING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials and equipment necessary to satisfactorily return all construction areas to their original conditions or better.
- B. Work shall include furnishing and placing seed or sod, fertilizing, planting, watering and maintenance until acceptance by County.

1.02 RELATED WORK NOT INCLUDED

Excavation, filling and grading required to establish elevation shown on the Drawings are included under other sections of these Specifications.

1.03 QUALITY ASSURANCE

- A. It is the intent of this Specification that the Contractor is obliged to deliver a satisfactory stand of grass as specified. If necessary, the Contractor shall repeat any or all of the work, including grading, fertilizing, watering and seeding or sodding at no additional cost to the County until a satisfactory stand is obtained. For purposes of grassing, a satisfactory stand of grass is herein defined as a full lawn cover over areas to be sodded or seeded, with grass free of weeds, alive and growing, leaving no bare spots larger than 3/4 square yard within a radius of 8 feet.
- B. All previously grassed areas where pipelines are laid shall be sodded. All sodding and grassing shall be installed in accordance with these Specifications or as directed by the County.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Fertilizer: The fertilizer shall be of the slow-release type meeting the following minimum requirements: 12 percent nitrogen, 8 percent phosphorus, 8 percent potassium; 40 percent other available materials derived from organic sources. At least 50 percent of the phosphoric acid shall be from normal super phosphate or an equivalent source which will provide a minimum of two units of sulfur. The amount of sulfur shall be indicated on the quantitative analysis card attached to each bag or other container. Fertilizer shall be uniform in composition, dry and free flowing delivered to sites in original unopened containers bearing manufacturer's statement or guarantee.
- B. Seeding/Grassing: The Contractor shall grass all unpaved areas disturbed during construction which do not require sod. All grassing shall be completed in conformance with FDOT Specifications, Sections 570 and 981. The grassed areas shall be mulched and fertilized in accordance with FDOT Specifications, except that no additional payment

will be made for mulching, fertilizing and/or watering.

- C. Sodding: Sod shall be provided as required on the construction drawings or at locations as directed by the County in accordance with Florida Department of Transportation, Specifications Section 575 and 981. The Contractor shall furnish bahia grass sod or match existing sod. Placement and watering requirements shall be in accordance with FDOT Specifications Section 575, except that no additional payment will be made for placement and/or watering. This cost shall be included in the Contract price bid for sodding.
- D. Topsoil: Topsoil stockpiled during excavation may be used as necessary. If additional topsoil is required to replace topsoil removed during construction, it shall be obtained off site at no additional cost to the County. Topsoil shall be fertile, natural surface soil, capable of producing all trees, plants and grassing specified herein.
- E. Water: It is the Contractor's responsibility to supply all water to the site, as required during seeding and sodding operations and through the maintenance period and until the work is accepted. The Contractor shall make whatever arrangements that may be necessary to ensure an adequate supply of water to meet the needs for his work. He shall also furnish all necessary hose, equipment, attachments and accessories for the adequate irrigation of lawns and planted areas as may be required. Water shall be suitable for irrigation and free from ingredients harmful to plant life.

PART 3 EXECUTION

3.01 INSTALLATION

- A. When the trench backfill has stabilized sufficiently, the Contractor shall commence work on lawns and grassed areas, including fine grading as necessary and as directed by the County.
- B. Finish Grading: Areas to be seeded or sodded shall be finish graded, raked, and debris removed. Soft spots and uneven grades shall be eliminated. The County shall approve the finish grade of all areas to be seeded or sodded prior to seed or sod application.
- C. Protection: Seeded and sodded areas shall be protected against traffic or other use by placing warning signs or erecting barricades as necessary. Any areas damaged prior to acceptance by the County shall be repaired by the Contractor as directed by the County.

3.02 CLEANUP

Soil or similar materials spilled onto paved areas shall be removed promptly, keeping those areas as clean as possible at all times. Upon completion of seeding and sodding operations, all excess soil, stones and debris remaining shall be removed from the construction areas.

3.03 LANDSCAPE MAINTENANCE

- A. Any existing landscape items damaged or altered during construction by the Contractor shall be restored or replaced as directed by the County.

- B. Maintain landscape work for a period of 90 days immediately following complete installation of work or until County accepts project. Watering, weeding, cultivating, restoration of grade, mowing and trimming, protection from insects and diseases, fertilizing and similar operations as needed to ensure normal growth and good health for live plant material shall be included at no additional cost to the County.

3.04 REPAIRS TO LAWN AREAS DISTURBED BY CONTRACTOR'S OPERATORS

Lawn areas planted under this Contract and all lawn areas damaged by the Contractor's operation shall be repaired at once by proper soil preparation, fertilizing and sodding, in accordance with these Specifications.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02513

ASPHALT CONCRETE PAVING

PART 1 GENERAL

1.01 SCOPE OF WORK

The Contractor shall furnish all labor, materials and equipment necessary to complete all milling asphalt pavement and asphalt concrete paving (including restoration of driveways) as called out on the Contract Documents or as shown on the Drawings.

1.02 QUALITY ASSURANCE

- A. Qualifications of Asphalt Concrete Producer: The only materials permitted shall be furnished by a bulk asphalt concrete producer exclusively engaged in the production of hot-mix, hot-laid asphalt concrete.
- B. Qualification of Testing Agency: The County may employ a commercial testing laboratory to conduct tests and evaluations of asphalt concrete materials and design. The Contractor shall:
 - 1. Provide asphalt concrete testing and inspection service acceptable to County.
 - 2. Include sampling and testing asphalt concrete materials proposed, and tests and calculations for asphalt concrete mixtures.
 - 3. Provide field testing facilities for quality control testing during paving operations.
- C. Requirements of Regulatory Agencies: The Contractor shall comply with the applicable requirements of:
 - 1. Manatee County Utility Operations Department
 - 2. Manatee County Transportation Department
 - 3. State of Florida Dept. of Transportation

1.03 PAVING QUALITY REQUIREMENTS

- A. General: In addition to other specified conditions, the Contractor shall comply with the following minimum requirements:
 - 1. In-place asphalt concrete course shall be tested for compliance with requirements for density, thickness and surface smoothness.
 - 2. Final surface shall be provided of uniform texture, conforming to required grades and cross sections.
 - 3. A minimum of four inch diameter pavement specimens for each completed course shall be taken from locations as directed by the County.
 - 4. Holes from test specimens shall be repaved as specified for patching defective work.
- B. Density:

1. When subjected to 50 blows of standard Marshall hammer on each side of an in place material specimen, densities shall be comparable to a laboratory specimen of same asphalt concrete mixture.
 2. The minimum acceptable density of in-place course material shall be 98% of the recorded laboratory specimen density.
- C. Thickness: In-place compacted thicknesses shall not be acceptable if less than the minimum thicknesses shown on the Drawings.
- D. Surface Smoothness:
1. Finished surface of each asphalt concrete course shall be tested for smoothness, using a 10 ft. straightedge applied parallel to and at right angles to centerline of paved areas.
 2. Surface areas shall be checked at intervals directed by County.
 3. Surfaces shall not be acceptable if they exceed the following:
 - a. Base Course: 1/4 in. in 10 ft.
 - b. Surface Course: 3/16 in. in 10 ft.
 - c. Crowned Surfaces:
 - (1) Test crowned surfaces with a crown template, centered and at right angles to the crown.
 - (2) Surfaces will not be acceptable if varying more than 1/4 in. from the template.

1.04 SUBMITTALS

- A. Samples: The Contractor may be required to provide samples of materials for laboratory testing and job-mix design.
- B. Test Reports: The Contractor shall submit laboratory reports for following materials tests:
1. Coarse and fine aggregates from each material source and each required grading:
 - a. Sieve Analysis: ASTM C 136 (AASHTO T 27).
 - b. Unit Weight of Slag: ASTM C29 (AASHTO T 19).
 - c. Soundness: ASTM C 88 (AASHTO T 104) for surface course aggregates only.
 - d. Sand Equivalent: ASTM D 2419 (AASHTO T 176).
 - e. Abrasion of Coarse Aggregate: ASTM C131 (AASHTO T 96), for surface course aggregates only.
 2. Asphalt cement for each penetration grade:
 - a. Penetration: ASTM D5 (AASHTO T49).
 - b. Viscosity (Kinematic): ASTM D2170 (AASHTO T 201).
 - c. Flash Point: ASTM D92 (AASHTO T 48).
 - d. Ductility: ASTM D 113 (AASHTO T 51).
 - e. Solubility: ASTM D 4 (AASHTO T 44).
 - f. Specific Gravity: ASTM D 70 (AASHTO T 43).
 3. Job-mix design mixtures for each material or grade:
 - a. Bulk Specific Gravity for Coarse Aggregate: ASTM C 117(AASHTO T 85).
 - b. Bulk Specific Gravity for Fine Aggregate: ASTM C 128(AASHTO T 84).
 4. Uncompacted asphalt concrete mix: Maximum Specific Gravity: ASTM D 2041

- (AASHO T 209).
5. Compacted asphalt concrete mix:
 - a. Bulk Density: ASTM D 1188 (AASHO T 166).
 - b. Marshall Stability and Flow: ASTM D 1559.
 6. Density and voids analysis:
 - a. Provide each series of asphalt concrete mixture test specimens, in accordance with A.I. MS-2 "Mix Design Methods for Asphalt Concrete".
 - b. Use Marshall method of mix design unless otherwise directed or acceptable to the County.
 - c. Report the quantity of absorbed asphalt cement in pounds of dry aggregate, percent air voids, and percent voids in mineral aggregate.
 7. Sampling and testing of asphalt concrete mixtures for quality control during paving operations:
 - a. Uncompacted asphalt concrete mix.
 - (1) Asphalt Cement Content: ASTM D 2172 (AASHO T 164).
 - (2) Penetration of Recovered Asphalt Cement: ASTM D 5(AASHO T 49).
 - (3) Ductibility of Recovered Asphalt Cement: ASTM D 113(AASHO T 51).
 - b. Compacted asphalt concrete mix:
 - (1) Bulk Density: ASTM D 1188 (AASHO T 166).
 - Marshall Stability and Flow: ASTM D1559).
 - c. Perform at least one test for each day's paving.
 8. Asphalt plant inspection: ASTM D 290.
 9. Additional testing:
 - a. Retesting shall be required if previous tests indicate insufficient values, or if directed by the County.
 - b. Testing shall continue until specified values have been attained.
 10. Asphalt concrete materials which do not comply with specified requirements shall not be permitted in the work.

1.05 JOB CONDITIONS

- A. Weather Limitations:
 1. Apply bituminous prime and tack coats only when the ambient temperature in the shade is 50 degrees F. and when the temperature has not been below 35 degrees F. for 12 hours immediately prior to application.
 2. Do not apply when the base surface is wet or contains an excess of moisture which would prevent uniform distribution and the required penetration.
 3. Construct asphalt concrete surface course only when atmospheric temperature is above 40 degrees F., when the underlying base is dry, and when weather is not rainy.
 4. Base course may be placed when air temperature is not below 30 degrees F. and rising, when acceptable to the County.
- B. Grade Control: Establish and maintain the required lines and grades, including crown and cross-slope, for each course during construction operations.
- C. Traffic Control: Maintain vehicular and pedestrian traffic during paving operations, as

required for other construction activities.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Soil Cement or Shell Base Course: as specified in FDOT Section 270, "Material for Base and Stabilized Base", and as called for in the Contract Documents.
- B. Aggregate for Asphalt Concrete, General:
 - 1. Sound, angular crushed stone, crushed gravel, or crushed slag: ASTM D 692.
 - 2. Sand, stone, or slag screening: ASTM D 1073.
 - 3. Provide aggregate in gradations for various courses to comply with local highway standards.
- C. Surface Course Aggregates:
 - 1. Provide natural sand, unless sand prepared from stone, slag, or gravel or combinations are required to suit local conditions.
- D. Asphalt Cement: Comply with ASTM D 946 for 85-100 penetration grade.
- E. Prime Coat:
 - 1. Cut-back liquid asphalt.
 - 2. Medium-Curing type: ASTM D 2027, Grade MC-70.

2.02 ASPHALT-AGGREGATE MIXTURES

- A. Job-mix criteria:
 - 1. Provide job-mix formulas for each required asphalt-aggregate mixture.
 - 2. Establish a single percentage of aggregate passing each required sieve size, a single percentage of asphalt cement to be added to aggregate, and a single temperature at which asphalt concrete is to be produced.
 - 3. Comply with the mix requirements of local governing highway standards.
 - 4. Maintain material quantities within allowable tolerances of the governing standards.

2.03 TRAFFIC AND PARKING MARKING MATERIALS

- A. Traffic lane marking paint with chlorinated rubber base.
- B. Factory mixed, quick drying and non bleeding, FS TT-P-115C, Type III.
- C. Color: Driving Lane Dividers - White
No Parking Zone - Yellow
Parking Dividers - White

PART 3 EXECUTION

3.01 SURFACE PREPARATION

A. Subbase Preparation:

1. The Contractor shall remove from the area all organic substance encountered to a depth of six or eight inches (6" or 8"), or to such depth and width as directed by the County. The entire area shall be plowed and dragged prior to placing a stabilizing additive, if required to meet minimum bearing value.
2. Subbase shall be compacted to a minimum density of 98 percent of the maximum as determined by the Modified Proctor Density AASHTO T180, and shall have a minimum bearing value of 40 pounds per square inch as determined by the Florida Bearing Test.

B. Base Course:

1. Check subgrade for conformity with elevations and section immediately before placing base material.
2. Place base material in compacted layers not more than 6 inches thick, unless continuing tests indicate the required results are being obtained with thicker layers.
3. In no case will more than 8-inches of compacted base be placed in one lift.
4. Spread, shape, and compact all base material deposited on the subgrade during the same day.
5. Compact base course material to be not less than 95% of maximum density: ASTM D 1557, Method D (98 percent maximum density: AASHTO T-180).
6. Test density of compacted base course: ASTM D 2167.
7. Conduct one test for each 250 sq. yds. of in-place material, but in no case not less than one daily for each layer.

C. Loose and Foreign Material:

1. Remove loose and foreign material from compacted subbase surface immediately before application of paving.
2. Use power brooms or blowers, and brooming as required.
3. Do not displace subbase material.

D. Prime Coat:

1. Uniformly apply at rate of 0.20 to 0.5 gal. per sq. yd. over compacted and cleaned subbase surface.
2. Apply enough material to penetrate and seal, but not flood the surface.
3. Allow to cure and dry as long as required to attain penetration and evaporation of volatile, and in no case less than 24 hours unless otherwise acceptable to the County.
4. Blot excess asphalt with just enough sand to prevent pick-up under traffic.
5. Remove loose sand before paving.

E. Tack Coat:

1. Dilute material with equal parts of water and apply to contact surfaces of previously constructed asphalt concrete or portland cement concrete and similar surfaces.
2. Apply at rate of 0.05 to 0.15 gal. per sq. yd. of surface.
3. Apply tack coat by brush to contact surfaces of structures projecting into or abutting asphalt concrete pavement.
4. Allow surfaces to dry until material is at condition of tackiness to receive pavement.

3.02 MANHOLE FRAME / VALVE BOX ADJUSTMENTS (IF APPLICABLE)

A. Placing Manhole frames:

1. Surround manhole frames set to elevation with a ring of compacted asphalt concrete base prior to paving.
2. Place asphalt concrete mixture up to 1 in. below top of frame, slope to grade, and compact by hand tamping.

B. Adjust manhole frames to proper position to meet paving.

C. If permanent covers are not in place, provide temporary covers over openings until completion of rolling operations.

D. Set cover manhole frames to grade, flush with surface of adjacent pavement.

3.03 PREPARING THE MIXTURE

A. Comply with ASTM D 995 for material storage, control, and mixing, and for plant equipment and operation.

B. Stockpiles:

1. Keep each component of the various-sized combined aggregates in separate stockpiles.
2. Maintain stockpiles so that separate aggregate sizes shall not be intermixed.

C. Heating:

1. Heat the asphalt cement at the mixing plant to viscosity at which it can be uniformly distributed throughout mixture
2. Use lowest possible temperature to suit temperature-viscosity characteristics of asphalt.
3. Do not exceed 350 degrees F. (176.6 degrees C.).

D. Aggregate:

1. Heat-dry aggregates to reduce moisture content to not more than 2.0%.
2. Deliver dry aggregate to mixer at recommended temperature to suit penetration grade and viscosity characteristics of asphalt cement, ambient temperature, and workability of mixture.
3. Accurately weigh or measure dry aggregates and weigh or meter asphalt cement to comply with job-mix formula requirements.

- E. Mix aggregate and asphalt cement to achieve 90-95% of coated particles for base mixtures and 85-90% of coated particles for surface mixture, when tested in accordance with ASTM D 2489.
- F. Transporting:
 - 1. Transport asphalt concrete mixtures from mixing site in trucks having tight, clean compartments.
 - 2. Coat hauling compartments with a lime-water mixture to prevent asphalt concrete mixture from sticking.
 - 3. Elevate and drain compartment of excess solution before loading mix.
 - 4. Provide covers over asphalt concrete mixture when transporting to protect from weather and to prevent loss of heat.
 - 5. During periods of cold weather or for long-distance deliveries, provide insulation around entire truck bed surfaces.

3.04 EQUIPMENT

- A. Provide size and quantity of equipment to complete the work specified within project time schedule.
- B. Bituminous Pavers: Self-propelled that spread hot asphalt concrete mixtures without tearing, shoving or gouging surfaces, and control pavement edges to true lines without use of stationary forms.
- C. Rolling Equipment:
 - 1. Self-propelled, steel-wheeled and pneumatic-tired rollers that can reverse direction without backlash.
 - 2. Other type rollers may be used if acceptable to the County.
- D. Hand Tools: Provide rakes, lutes, shovels, tampers, smoothing irons, pavement cutters, portable heaters, and other miscellaneous small tools to complete the work specified.

3.05 PLACING THE MIX

- A. Place asphalt concrete mixture on prepared surface, spread and strike-off using paving machine.
- B. Spread mixture at a minimum temperature of 225 degrees F. (107.2 degrees C.).
- C. Inaccessible and small areas may be placed by hand.
- D. Place each course at thickness so that when compacted, it will conform to the indicated grade, cross-section, finish thickness, and density indicated.
- E. Paver Placing:
 - 1. Unless otherwise directed, begin placing along centerline of areas to be paved on crowned section, and at high side of sections on one-way slope, and in direction of

traffic flow.

2. After first strip has been placed and rolled, place succeeding strips and extend rolling to overlap previous strips.
3. Complete base courses for a section before placing surface courses.
4. Place mixture in continuous operation as practicable.

F. Hand Placing:

1. Spread, tamp, and finish mixture using hand tools in areas where machine spreading is not possible, as acceptable to County.
2. Place mixture at a rate that will insure handling and compaction before mixture becomes cooler than acceptable working temperature.

G. Joints:

1. Carefully make joints between old and new pavements, or between successive days' work, to ensure a continuous bond between adjoining work.
2. Construct joints to have same texture, density and smoothness as adjacent sections of asphalt concrete course.
3. Clean contact surfaces free of sand, dirt, or other objectionable material and apply tack coat.
4. Offset transverse joints in succeeding courses not less than 24 inches.
5. Cut back edge of previously placed course to expose an even, vertical surface for full course thickness.
6. Offset longitudinal joints in succeeding courses not less than 6 inches.
7. When the edges of longitudinal joints are irregular, honeycombed, or inadequately compacted, cut back unsatisfactory sections to expose an even, vertical surface for full course thickness.

3.06 COMPACTING THE MIX

- A. Provide sufficient rollers to obtain the required pavement density.
- B. Begin rolling operations as soon after placing when the mixture will bear weight of roller without excessive displacement.
- C. Do not permit heavy equipment, including rollers to stand on finished surface before it has thoroughly cooled or set.
- D. Compact mixture with hot hand tampers or vibrating plate compactors in areas inaccessible to rollers.
- E. Start rolling longitudinally at extreme lower side of sections and proceed toward center of pavement. Roll to slightly different lengths on alternate roller runs.
- F. Do not roll centers of sections first under any circumstances.
- G. Breakdown Rolling:
 1. Accomplish breakdown or initial rolling immediately following rolling of transverse

and longitudinal joints and outside edge.

2. Operate rollers as close as possible to paver without causing pavement displacement.
3. Check crown, grade, and smoothness after breakdown rolling.
4. Repair displaced areas by loosening at once with lutes or rakes and filling, if required, with hot loose material before continuing rolling.

A. Second Rolling:

1. Follow breakdown rolling as soon as possible, while mixture is hot and in condition for compaction.
2. Continue second rolling until mixture has been thoroughly compacted.

I. Finish Rolling:

1. Perform finish rolling while mixture is still warm enough for removal of roller marks.
2. Continue rolling until roller marks are eliminated and course has attained specified density.

J. Patching:

1. Remove and replace defective areas.
2. Cut-out and fill with fresh, hot asphalt concrete.
3. Compact by rolling to specified surface density and smoothness.
4. Remove deficient areas for full depth of course.
5. Cut sides perpendicular and parallel to direction of traffic with edges vertical.
6. Apply tack coat to exposed surfaces before placing new asphalt concrete mixture.

3.07 MARKING ASPHALT CONCRETE PAVEMENT

A. Cleaning:

1. Sweep surface with power broom supplemented by hand brooms to remove loose material and dirt.
2. Do not begin marking asphalt concrete pavement until acceptable to the County.

B. Apply paint with mechanical equipment.

1. Provide uniform straight edges.
2. Not less than two separate coats in accordance with manufacturer's recommended rates.

3.08 CLEANING AND PROTECTION

A. Cleaning: After completion of paving operations, clean surfaces of excess or spilled asphalt materials to the satisfaction of the County.

B. Protection:

1. After final rolling, do not permit vehicular traffic on asphalt concrete pavement until

- it has cooled and hardened, and in no case sooner than 6 hours.
2. Provide barricades and warning devices as required to protect pavement.
 3. Cover openings of structures in the area of paving until permanent coverings are placed (if applicable).

END OF SECTION

SECTION 02575

PAVEMENT REPAIR AND RESTORATION

PART 1 GENERAL

1.01 SCOPE OF WORK

The Contractor shall furnish all labor, materials, equipment, obtain County or State right-of-way permits and incidentals required and remove and replace pavements over trenches excavated for installation of water or sewer lines and appurtenances as shown on the Contract Drawings.

1.02 GENERAL

- A. The Contractor shall take before and after photographs.
- B. The Contractor shall repair in a manner satisfactory to the County or State, all damage done to existing structures, pavement, driveways, paved areas, curbs and gutters, sidewalks, shrubbery, grass, trees, utility poles, utility pipe lines, conduits, drains, catch basin, flagstones, or stabilized areas or driveways and including all obstructions not specifically named herein, which results from this Project.
- C. The Contractor shall keep the surface of the backfilled area of excavation in a safe traffic bearing condition and firm and level with the remaining pavement until the pavement is restored in the manner specified herein. All surface irregularities that are dangerous or obstructive to traffic are to be removed. The repair shall conform to applicable requirements of Manatee County Transportation Department requirements for pavement repair and as described herein, including all base, subbase and asphalt replacement.
- D. All materials and workmanship shall meet or exceed the County requirements and as called for in the Contract Documents and nothing herein shall be construed as to relieve the Contractor from this responsibility.
- E. All street, road and highway repair shall be made in accordance with the FDOT and County details indicated on the Drawings and in accordance with the applicable requirements and approval of affected County and State agencies.

PART 2 PRODUCTS

2.01 PAVEMENT SECTION

- A. Asphaltic concrete shall consist of asphalt cement, coarse aggregate, fine aggregate and mineral filler conforming to FDOT Type S-III Asphalt. Pavement replacement thickness shall match that removed but in no case shall be less than 1-1/2" compacted thickness. All asphalt concrete pavement shall be furnished, installed and tested in accordance with FDOT Specifications for Road and Bridge Construction.
- B. Asphalt or crushed concrete or approved equal base material shall be furnished and installed under all pavement sections restored under this Contract. Asphalt base shall

have a minimum 6" compacted thickness, meet requirements for FDOT ABC III (Minimum Marshall Stability of 1000) and be furnished, installed and tested in accordance with the requirements of the FDOT Standards. Crushed concrete base shall be 10" minimum compacted thickness. Crushed concrete aggregate material shall have a minimum LBR of 140 compacted to 99% T-180 AASHTO density. Asphalt base and crushed concrete base are acceptable. Other bases shall be submitted for approval.

- C. Prime and tack will be required and applied in accordance with Section 300 - FDOT Specifications: Prime and Tack Coat for Base Courses.

PART 3 EXECUTION

3.01 CUTTING PAVEMENT

- A. The Contractor shall saw cut in straight lines and remove pavement as necessary to install the new pipelines and appurtenances and for making connections to existing pipelines.
- B. Prior to pavement removal, the Contractor shall mark the pavement for cuts nearly paralleling pipe lines and existing street lines. Asphalt pavement shall be cut along the markings with a rotary saw or other suitable tool. Concrete pavement shall be scored to a depth of approximately two (2) inches below the surface of the concrete along the marked cuts. Scoring shall be done by use of a rotary saw, after which the pavement may be broken below the scoring with a jackhammer or other suitable equipment.
- C. The Contractor shall not machine pull the pavement until it is completely broken and separated along the marked cuts.
- D. The pavement adjacent to pipe line trenches shall neither be disturbed or damaged. If the adjacent pavement is disturbed or damaged, irrespective of cause, the Contractor shall remove and replace the pavement. In addition, the base and sub-base shall be restored in accordance with these Specifications, Florida Dept. of Transportation Standard Specifications and as directed by the County.

3.02 PAVEMENT REPAIR AND REPLACEMENT

- A. The Contractor shall repair, to meet or exceed original surface material, all existing concrete or asphaltic pavement, driveways, or sidewalks cut or damaged by construction under this Contract. He shall match the original grade unless otherwise specified or shown on the Drawings. Materials and construction procedures for base course and pavement repair shall conform to those of the Florida Dept. of Transportation.
- B. The Contractor's repair shall include the preparation of the subbase and base, place and maintain the roadway surface, any special requirements whether specifically called for or implied and all work necessary for a satisfactory completion of this work. Stabilized roads and drives shall be finished to match the existing grade. Dirt roads and drives shall have the required depth of backfill material as shown on the Contract Drawings.
- C. The width of all asphaltic concrete repairs shall extend the full width and length of the excavation or to the limits of any damaged section. The edge of the pavement to be left in place shall be cut to a true edge with a saw or other approved method so as to provide a

clean edge to abut the repair. The line of the repair shall be reasonably uniform with no unnecessary irregularities.

3.03 MISCELLANEOUS RESTORATION

Sidewalks or driveways cut or damaged by construction shall be restored in full sections or blocks to a minimum thickness of four inches. Concrete curb or curb and gutter shall be restored to the existing height and cross section in full sections or lengths between joints. RCP pipe shall be repaired or installed in accordance with manufacturer's specifications. Grassed yards, shoulders and parkways shall be restored to match the existing sections with grass sod of a type matching the existing grass.

3.04 SPECIAL REQUIREMENTS

The restoration of all surfaces, as described herein, disturbed by the installation of pipelines shall be completed as soon as is reasonable and practical. The complete and final restoration of both paved and shell stabilized roads within a reasonable time frame is of paramount importance. To this end, the Contractor shall, as part of his work schedule, complete the restoration of any area of road within five weeks after removing the original surface. Successful leak testing shall be performed prior to restoring any area of road. All restoration and replacement or repairs are the responsibility of the Contractor.

3.05 CLEANUP

After all repair and restoration or paving has been completed, all excess asphalt, dirt and other debris shall be removed from the roadways. All existing storm sewers and inlets shall be checked and cleaned of any construction debris.

3.06 MAINTENANCE OR REPAIR

All wearing surfaces shall be maintained by the Contractor in good order suitable for traffic prior to completion and acceptance of the work.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02615

DUCTILE IRON PIPE AND FITTINGS

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required to install ductile iron pipe and restrained joint ductile iron pipe and cast iron or ductile iron restrained joint fittings, complete, as shown on the Drawings and specified in these Standards.
- B. Fittings are noted on the drawings for the Contractor's convenience and do not relieve him from laying and jointing different or additional items where required.
- C. The Contractor shall furnish all labor, materials, equipment and incidentals required to install push-on joint or restrained joint ductile iron pipe, complete as shown on the Drawings and Specifications.
- D. Newly installed pipe shall be kept clean and free of all foreign matter. All DI pipe installed underground shall be poly wrapped unless noted otherwise on the plans.

1.02 SUBMITTALS

- A. The Contractor shall submit to the County, within ten days after receipt of Notice to Proceed, a list of materials to be furnished, the names of the suppliers and the appropriate shop drawings for all ductile iron pipe and fittings.
- B. The Contractor shall submit the pipe manufacturer's certification of compliance with the applicable sections of the Specifications.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Ductile iron pipe shall conform to ANSI/AWWA C150/A21.50 and ANSI/AWWA C151/A21.51. Thickness of pipe shall be Class 50 or pressure Class 350. All pipe not buried shall be Class 53. All ductile iron pipe shall be clearly marked on the outside of the barrel to readily identify it from cast iron.
- B. Unrestrained joint pipe shall be supplied in lengths not to exceed 21 feet. Unless otherwise called for in the Contract Documents, unrestrained joint pipe shall be either the rubber-ring type push-on joint or standard mechanical joint pipe as manufactured by the American Cast Iron Pipe Company, U.S. Pipe and Foundry Company, or approved equal.
- C. All fittings shall be pressure rated for 350 psi and meet the requirement of AWWA C110 or AWWA C153 except flanged fittings shall be rated for 250 psi. Rubber gaskets shall conform to ANSI A21.11 for mechanical and push-on type joints for diameters up to 14" diameter. Gaskets for 16" diameter and larger pipe shall be EPDM (Ethylene-Propylene

Dine Monomer) such as the "Fastite Gasket" of American Ductile Iron Pipe Co., or approved equal.

- D. Water Mains: All ductile iron pipe and fittings shall have a standard thickness cement lining on the inside in accordance with AWWA/ANSI C104/A21.4 and a coal tar enamel coating on the outside. The coal tar enamel shall be in accordance with ANSI A21.4. All interior linings shall be EPA/NSF approved.
- E. Force Main: All ductile iron pipe and fittings shall have a factory applied fusion bonded epoxy or epoxy and polyethylene lining on the inside in accordance with manufacturer's specifications and a coal tar enamel coating on the outside. The coal tar enamel shall be in accordance with ANSI A21.4. The interior lining is to be based on manufacturer's recommendation for long-term exposure to raw sewage. It shall have a minimum ten year warranty covering failure of the lining and bond failure between liner and pipe.
- F. Restrained joints shall be provided at all horizontal and vertical bends and fittings, at casings under roads and railroads and at other locations shown on the Contract Drawings. Restrained joint pipe fittings shall be designed and rated for the following pressures: 350 psi for pipe sizes up to and including 24" diameter; 250 psi for pipe sizes 30" diameter and above.

2.02 IDENTIFICATION

- A. Each length of pipe and each fitting shall be marked with the name of the manufacturer, size and class and shall be clearly identified as ductile iron pipe. All gaskets shall be marked with the name of the manufacturer, size and proper insertion direction.
- B. Pipe shall be poly wrapped blue for potable water mains, purple for reclaimed water mains and green for sewage force mains. All potable water pipe shall be NSF certified and copies of lab certification shall be submitted to the County.
- C. All above ground potable water mains and appurtenances shall be painted safety blue.

END OF SECTION

SECTION 02617

INSTALLATION AND TESTING OF PRESSURE PIPE

PART 1 GENERAL

1.01 INSTALLING PIPE AND FITTINGS

- A. The Contractor shall install all pipe in accordance with the recommendations of the pipe manufacturer and as specified herein.
- B. The Contractor shall take care in handling, storage and installation of pipe and fittings to prevent injury to the pipe or coatings. All pipe and fittings shall be examined before installation and pipe which is deemed to be defective by the County shall not be installed.
- C. The Contractor shall thoroughly clean and keep thoroughly clean, all pipe and fittings prior to during and after installation.
- D. The Contractor shall lay the pipe to the lines and grades shown on the Contract Drawings with bedding and backfill as shown on the Drawings or called out in the Contract Documents. Blocking under the pipe shall not be permitted except through casing sleeves.
- E. The Contractor shall keep the open ends of all pipe closed with a tightly fitting plug when installation is not in progress or the potential exists for dirt or debris to enter the pipe.
- F. The pipe or accessories shall not be dropped into the trench under any circumstances.
- G. The Contractor shall construct all water mains pursuant to the provisions of "Recommended Standards for Water Works", Part 8, incorporated by reference in Rule 17-555.330(3), F.A.C.
- H. As a marker for the Surveyor, a PVC pipe marker or 2" x 4" marker shall be inserted by the Contractor on the top of pipe for potable water mains, reclaimed water mains and sanitary force mains at intervals no greater than 200 feet apart and at locations where there is a substantial grade change. The pipe markers shall indicate the pipe diameter and shall be labeled PWM in "safety" blue, RWM in purple, and FM in green, for potable water mains, reclaimed water mains and sanitary force mains, respectively. As a marker for the Surveyor, a PVC pipe marker or 2" x 4" marker shall be inserted by the Contractor on the top of all pipe fittings (other than sanitary sewer service wyes, potable water saddles and reclaimed water saddles). The markers for fittings shall indicate the type of fitting and shall be labeled PWF in "safety" blue, RWF in purple, and FMF in green, for potable water fittings, reclaimed water fittings, and sanitary force main fittings, respectively. The Contractor is responsible for making the aforementioned markers available to the Surveyor. The Contractor shall field locate the mains and fittings when markers are not made available to the Surveyor.
- I. A PVC pipe marker or 2" x 4" marker shall be inserted by the Contractor at the beginning and end of each horizontal directional drill (HDD). The HDD Contractor shall provide a certified report and bore log indicating the horizontal and vertical location every 25 linear

feet or less along the pipe.

- J. A 2" PVC pipe marker with a painted end cap shall be inserted by the Contractor at the ROW line indicating each individual new service location or stub out. The marker shall be a 6 foot length of PVC pipe inserted 2 feet into the ground and shall be painted "safety" blue for potable water, purple for reclaimed water, and green for sewer.

1.02 PROCEDURE FOR TESTING WATER LINES, FORCE MAINS AND RECLAIMED WATER LINES

- A. A 48-hour notice is needed prior to testing. A letter stating the reasons testing should be scheduled ahead of other jobs must accompany all emergency testing requests.
- B. County and Contractor must be present for all testing, except for testing tapping valves and sleeves.
- C. All pressure pipe lines shall remain undisturbed for 24 hours to develop complete strength at all joints. All pipe lines shall be subjected to a hydrostatic pressure test for two (2) hours at full working pressure, but not less than 180 psi for water/reclaimed (150 psi for force main). Maximum length of pipe to be tested at one time is 2,600 feet. If line is longer than 2,600 feet and cannot be sectioned in 2,600 feet (max.) lengths, the allowable leakage will be figured at 2,600 feet.
- D. Allowable leakage shall be determined by AWWA C600 table for hydrostatic tests. Leakage shall be defined as the quantity of water that must be supplied into the newly laid pipe, or any valved section thereof; to maintain the test pressure after the air in the pipe line has been expelled and the pipe has been filled with water.
- E. All digging on the job site in the right-of-way must be completed before any testing of water or sewer. Any digging or boring across water or sewer lines after they have been tested may result in a retest of the lines at the County's request.
- F. If any revisions or changes are made after initial testing, lines will be re-tested at the County's request.
- G. Disconnect water supply during test.
- H. All force mains will be tested from the valves in the valve vault at the lift station to the point of connection whether it be against a valve on another force main or into a manhole.
- I. All services to be aboveground during test. The services should be the correct length so they will be one (1) foot inside right-of-way line.
- J. All fire hydrant gate valves to be open during test.
- K. All visible leaks are to be repaired, regardless of the amount of leakage.
- L. Check gauge pressure periodically during test. If test pressure drops to 175 psi for water/reclaimed lines or to 145 psi for force mains during test, the line must be repumped back to 180 psi for water/reclaimed (150 psi force mains) and the amount of leakage

measured. The test will continue on with the remaining time left. At the end of the test, the line must be repumped again back to 180 psi (150 psi for force main) and the amount of leakage measured and added to any previous leakage determined earlier in the test.

- M. After the line passes the test, the pressure will be blown off from the opposite end of line from the gauge location. Fire hydrants, services and end-of-line blow offs will be opened to demonstrate they were on line during the test.
- N. At end of test, the test gauge must return to zero. The pressure gauge must read 0 psi to a maximum of 300 psi in 5 psi increments.
- O. The section of line being tested must be identified on the charge sheet. The length and size of pipe, the exact area being tested and the valves being tested against, must be identified. Use Station numbers if available.
- P. A punch list must be made at the end of all tests.
- Q. A copy of the charge sheet will be given to the County and the Contractor at the end of the test.

1.03 INSPECTION/TESTING PROCEDURE COVERING BORED PIPE LINES OR CASING AND CONDUITS INSTALLED ACROSS PREVIOUSLY TESTED AND/OR COUNTY ACCEPTED WATER AND SEWER PIPE WITHIN DEVELOPMENT PROJECTS UNDER ACTIVE CONSTRUCTION

- A. Prior to testing water and sewer lines, every effort will be made to install sleeves for underground utilities that will cross these water and sewer lines or services.
- B. Where it has not been possible to pre-install sleeves prior to testing and bores or conduits are required, it is the responsibility of the utility company and/or their Contractor performing the work to provide Manatee County Utility Operations Department or the Engineer of Record with accurate horizontal and vertical as-built information of the sleeves, bores and conduits installed by said utility company. This applies to all bores and conduits crossing water and sewer lines.
- C. Procedures to be followed for installation of conduits, pipe lines and bores that will cross, or be closer than 5'-0" horizontally and 18 inches vertically to, previously tested water and sewer lines that are still under the ownership of the developer/contractor.
 - 1. Notify the County and obtain the best as-built information available. Allow sufficient time for the County to field locate the existing pipe lines.
 - 2. Submit drawings of proposed location to the County and Manatee County Utility Operations Dept. Utility Locations Section for review.
 - 3. Obtain a County Right-of-Way Use Permit if the work area is within a dedicated area of right-of-way.
 - 4. Perform installation in the presence of a County representative. Call (941) 792-8811, ext. 5061 or ext. 5069 with at least two (2) working days notice.
 - 5. Submit two (2) copies of as-built information to the County to incorporate into the record drawings to be submitted to the County.
 - 6. Failure to follow steps 2) thru 5) will result in additional charges for retesting the

previously tested water and sewer lines.

- D. Procedures to be followed for installation of conduits, pipe lines and bores crossing or closer than 5'-0" horizontally and 18 inches vertically to previously tested water and sewer lines that have been previously accepted by Manatee County:
1. Obtain record drawing information from the County.
 2. If roadway has been dedicated to Manatee County, obtain Right-of-Way Use Permit and copy the Project Management Department Locations Section with proposed location drawing.
 3. Follow procedures in "Sunshine State One-Call", paying special attention to the requirements of Section VII.
- E. Should water or sewer lines be damaged during the bore pipe line or casing installation, the cost of any repairs and retesting will be paid for by the utility company that installed the bore. The actual clearance between a bored casing crossing a water or sewer pipe should not be less than 18 inches.

1.04 DETECTION

- A. Direct buried pipe shall have 3" detectable metallic tape of the proper color placed directly above the pipe and 12" below finished grade or 6" detectable tape between 12" and 24" below finished grade.
- B. Direct buried or horizontal directional drilled non-metallic pipe shall also have tracer wire installed along the pipe alignment. The tracer wire to be used shall be a solid, 10 gauge, high strength, copper clad steel wire with a polyethylene jacket of appropriate color manufactured by Copperhead Industries or Manatee County approved equal.

END OF SECTION

SECTION 02618

PIPELINE CLEANING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required to clean all new lines 4" and larger, and existing pipelines as specified in this specification and as indicated on the Drawings.
- B. This work shall include the furnishing and installation of all pig launching and retrieval devices and the appropriate pigs for the cleaning procedure, and all necessary excavations, shutdowns, fittings and valves required.

1.02 RELATED WORK

- A. The contractor is responsible for all necessary supply water.
- B. The contractor is responsible for all necessary bypass pumping.
- C. The contractor is responsible for the proper disposal of any materials removed from the pipe lines as a result of the cleaning procedure.

1.03 SUBMITTALS

- A. The Contractor shall submit prior to construction, a cleaning plan, Shop Drawings, and layout diagram for approval to the County.
- B. The Contractor shall submit to the County a list of materials to be furnished, and the names of suppliers.

1.04 QUALIFICATIONS

- A. The Contractor performing this work shall be fully qualified, experienced and equipped to complete this work expeditiously and in a satisfactory manner.
- B. The Contractor shall also be capable of providing crews as needed to complete this work without undue delay.
- C. The County reserves the right to approve or disapprove the Contractor, based on the submitted qualifications.

PART 2 PRODUCTS

2.01 GENERAL

- A. The contractor shall be responsible for furnishing pigs in sufficient numbers and sizes, of appropriate densities, coatings and configurations to properly clean the piping systems.

- B. All pigs used for the cleaning of sewer or reclaimed water lines shall not be used in the cleaning of potable water lines.

2.02 MATERIALS

- A. The pig launching and retrieval equipment shall be of the latest design and construction and shall include the means to maintain constant monitoring of the in-line flows and pressures of the system being cleaned and the constant location of the cleaning pigs in the system. Launching and retrieval systems shall be fabricated, designed and manufactured according to ANSI standards and capable of withstanding working pressures of 150 psi. Launching and receiving devices shall be sized one diameter larger than the system to which it will be attached with a minimum length of 2.5 times the diameter.
- B. The contractor shall have available for immediate use an electronic pig detector for use in the system being cleaned to provide a means of tracking the passage of the pig in the system to locate areas of potential or suspected blockage and other disparities in the system.
- C. The pig shall be constructed of elastomer polyurethane with an open cell construction and a density equal to or suitable for use in the piping system being cleaned. Pig configuration shall consist of a parabolic nose with a concave base and coated with a resilient surface material that will maintain a peripheral seal and will effectively clean the piping system without over abrading the interior pipe wall. Pig characteristics shall include the ability to navigate through 90 degree bends, 180 degree turns, bi-directional fittings, full port valves, reduce its cross sectional area and return to its original design configuration and be propelled by hydraulic pressure.

PART 3 EXECUTION

3.01 PIPELINE CLEANING

- A. The cleaning of the pipe line shall be done by the controlled and pressurized passage of a polyurethane pig of varying dimensions, coatings and densities as determined by the County through the piping system.
- B. A series of pigs shall be entered into the system at a point as near to the beginning as is logistically and mechanically feasible.
- C. A launching assembly shall be used as the entrance point for the pig. This assembly shall allow for the following:
 - 1. The entering of pigs into the system by providing the means to induce flow from an external source, independent of the flows and pressures immediately available from the system, on the back of the pig to develop sufficient pressure to force the pig through the system.
 - 2. A means to control and regulate the flow.
 - 3. A means to monitor the flows and pressures.
 - 4. A means to connect and disconnect from the system without any disruption to the

operation of the system.

- D. The pig shall be removed or discharged from the system at a point as near to the end as is logistically and mechanically feasible.
- E. The contractor shall be responsible for the retrieval of the pig at the discharge point. This may include setting a trap that will not disrupt normal flow and operations but will capture the pig and any debris. A retrieval assembly may also be used but said assembly shall be able to connect and disconnect from the system without any disruption to the operation of the system.
- F. Alternative launching and retrieval methods shall be done with the prior approval of the County.
- G. Any pig that cannot progress through the piping system shall be located by the contractor and removed by excavation of the pipe in order to remove the blockage. All pipe repairs shall be the responsibility of the contractor and shall be performed with as little disruption to the system as possible.
- H. Any increase in pressure that cannot be accounted for, i.e. fittings or valves or additional cleaning runs, shall be investigated, per the Engineers' approval, by locating the pig at the beginning of the increased pressure and excavating to determine the cause of the pressure increase. All pipe repairs shall be the responsibility of the contractor and shall be performed with as little disruption to the system as possible.
- I. Final flushing of the cleansed lines shall be performed after the last successful run of the pig as determined by the County. The contractor shall be responsible for all applicable flushing and disinfection requirements for potable water lines.

3.02 ACCEPTANCE

- A. The contractor shall maintain and provide a report at the end of the cleaning procedure containing the following:
 - 1. The pressures in the pipe during the pigging procedure.
 - 2. Any inline problems encountered during the procedure including all excavations with detailed locations, reason for the excavation and any corrective measures taken to the pipeline.
 - 3. A record of the pigs used, their sizes, styles and other pertinent information regarding what materials were used during the cleaning.
 - 4. An analysis of the condition of the pipeline before and after the cleaning procedure.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02622

POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS (AWWA SPECIFICATIONS C-900 & C-905)

PART 1 GENERAL

1.01 SCOPE OF WORK

The Contractor shall furnish all labor, materials, equipment and incidentals required to install the plastic piping, fittings and appurtenances complete and ready for use as specified in the Contract Documents and these Standards.

1.02 DESCRIPTION OF SYSTEM

The Contractor shall install the piping in the locations as shown on the Drawings.

1.03 QUALIFICATIONS

All plastic pipe, fittings and appurtenances shall be furnished by a single manufacturer who is fully experienced, reputable, qualified and specializes in the manufacture of the items to be furnished. The pipe and fittings shall be designed, constructed and installed in accordance with the best practices and methods and shall comply with these Specifications.

1.04 SUBMITTALS

- A. The Contractor shall submit shop drawings to the County including, but not limited to, dimensions and technical specifications for all piping.
- B. The Contractor shall submit to the County, samples of all materials specified herein.
- C. The Contractor shall submit and shall comply with pipe manufacturer's recommendation for handling, storing and installing pipe and fittings.
- D. The Contractor shall submit pipe manufacturer's certification of compliance with these Specifications.

1.05 TOOLS

The Contractor shall supply special tools, solvents, lubricants, and caulking compounds required for proper installation.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Pressure Class-Rated Polyvinyl Chloride (PVC) Pipe
 - 1. Pressure class-rated PVC pipe and accessories four to twelve inches (4"-12") in

diameter, shall meet the requirements of AWWA Specification C-900 "Polyvinyl Chloride (PVC) Pressure Pipe". Pipe shall be Class 150, meeting requirements of Dimension Ratio (DR) 18 and shall have the dimension of ductile iron outside diameters. Each length of pipe shall be hydrotested to four (4) times its class pressure by the manufacturer in accordance with AWWA C-900.

2. PVC pipe 14" through 36" shall meet the requirements of AWWA Standard C-905, Polyvinyl Chloride (PVC) Water Transmission Pipe. Pipe 14" thru 24" for potable and reclaim water shall meet the requirements for dimension ratio (DR) 18. Each length of pipe shall be tested at twice the pressure rating (PR 235 psi) for a minimum dwell of 5 seconds in accordance with AWWA C-905. Fourteen inch (14") thru 36" PVC pipe for sewer force mains shall meet AWWA C-905 requirements for dimension ratio (DR) 21. Each length of pipe shall be tested at twice the pressure rating (PR 200 psi) for a minimum dwell of five seconds in accordance with AWWA C-905.

Pipe shall be listed by Underwriters Laboratories. Provisions shall be made for expansion and contraction at each joint with an elastomeric ring, and shall have an integral thickened bell as part of each joint. PVC Class pipe shall be installed as recommended by the manufacturer. Pipe shall be furnished in nominal lengths of approximately 20 feet, unless otherwise directed by the County. Pipe and accessories shall bear the NSF mark indicating pipe size, manufacturer's names, AWWA and/or ASTM Specification number, working pressure, and production code.

3. Gaskets for 16" diameter and larger pipe used for potable water pipe shall be EPDM (Ethylene-Propylene Dine Monomer).
4. PVC pipe 3" and less in diameter may be constructed using pipe conforming to ASTM D2241 with push-on joints. Pipe shall be 200 psi pipe-SDR 21 unless otherwise specified by the County. This PVC pipe shall not be used for working pressures greater than 125 psi.
5. Pipe shall be blue for potable water mains, green for sewage force mains and purple for reclaimed water mains. All potable water pipe shall be NSF certified and copies of lab certification shall be submitted to the County.
6. Where colored pipe is unavailable, white PVC color coded spiral wrapped pipe shall be installed.

B. Joints

1. The PVC joints for pipe shall be of the push-on type unless otherwise directed by the County so that the pipe and fittings may be connected on the job without the use of solvent cement or any special equipment. The push-on joint shall be a single resilient gasket joint designed to be assembled by the positioning of a continuous, molded resilient ring gasket in an annular recess in the pipe or fitting socket and the forcing of the plain end of the entering pipe into the socket, thereby compressing the gasket radially to the pipe to form a positive seal. The gasket and annular recess shall be designed and shaped so that the gasket is locked in place against displacement as the joint is assembled.

The resilient ring joint shall be designed for thermal expansion or contraction with a total temperature change of at least 75 degrees F in each joint per length of pipe. The bell shall consist of an integral wall section with a solid cross section elastomeric ring which shall meet requirements of ASTM F-477. The thickened bell section shall be designed to be at least as strong as the pipe wall. Lubricant furnished for lubricating joints shall be nontoxic, shall not support the growth of bacteria, shall have no deteriorating effects on the gasket or pipe material, and shall not impart color, taste, or odor to the water. Gaskets shall be suitable for use with potable water, reclaimed water or sanitary sewer as applicable.

2. Restrained joints shall be provided at all horizontal and vertical bends and fittings, at casings under roads and railroads and at other locations shown on the Contract Drawings. PVC joints for pipe shall be restrained by the following methods: thrust blocks, restraining glands such as Certa-Lok Restraining Joint Municipal Water Pipe by the Certain Teed Corporation of Valley Forge, PA, or approved equal. All Grip, Star Grip by Star Products, MJR by Tyler Pipe, Tyler, Texas. Restrained joint PVC pipe shall be installed in strict accordance with the manufacturer's recommendation.

C. Fittings

1. All fittings for class-rated PVC pipe shall be ductile iron with mechanical joints and shall conform to the specifications for ductile iron fittings, unless otherwise directed. Class 200, C-900 PVC fittings are allowable for sewage force main applications up to and including 12" diameter only. DR ratio shall be the same as the pipe.
2. The manufacturer of the pipe shall supply all polyvinyl chloride accessories as well as any adapters and/or specials required to perform the work as shown on the Drawings and specified herein. Standard double bell couplings will not be accepted where the pipe will slip completely through the coupling.

PART 3 EXECUTION

3.01 INSTALLATION

The Contractor shall install the plastic pipe in strict accordance with the manufacturer's technical data and printed instructions. Direct bury pipe shall have 3" detectable metallic tape of the proper color placed directly above the pipe 12" below finished grade or 6" detectable tape between 12" and 24" below grade.

3.02 INSPECTION AND TESTING

All pipe lines shall remain undisturbed for 24 hours to develop complete strength at all joints. All pipe lines shall be subjected to a hydrostatic pressure test for two (2) hours at full working pressure, but not less than 180 psi for water/reclaimed (150 psi for force main). All visible leaks shall be repaired and retested for approval by the County. Prior to testing, the pipe lines shall be supported in a manner approved by the County to prevent movement during tests.

END OF SECTION

SECTION 02623

POLYVINYL CHLORIDE (PVC) PIPE (GRAVITY SEWER)

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, equipment, materials, pipe and incidentals and shall construct gravity sewers, complete, as shown on the drawings and as herein specified.
- B. The work shall include furnishing, laying and testing gravity sewer pipe.

1.02 SUBMITTALS DURING CONSTRUCTION

- A. The Contractor shall submit prior to construction, Shop Drawings, Working Drawings and Samples for approval to the County.
- B. The Contractor shall submit to the County not less than fourteen (14) calendar days after the date of the Notice to Proceed, a list of materials to be furnished, the names of suppliers and an expected schedule of delivery of materials to the site.
- C. The Contractor shall furnish in duplicate to the County sworn certificates that all tests and inspections required by the Specifications under which the pipe is manufactured have been satisfied.
- D. The pipe manufacturer shall inspect all pipe joints for out-of-roundness and pipe ends for squareness. The Contractor shall furnish to the County, a manufacturer's Notarized Affidavit stating all pipe meets the requirements of ASTM, ASCE, ANSI, the Contract Documents, as well as all applicable standards regarding the joint design with respect to square ends and out-of-round joint surfaces.

1.03 INSPECTION AND TESTS

- A. All pipe and accessories installed under this Contract shall be inspected and tested as required by the Standard Specifications to which the material is manufactured. The pipe shall be tested at the place of manufacture or taken to an independent laboratory by the manufacturer.
- B. Each length of pipe shall be subject to inspection and approval at the factory, point of delivery and site of work. Sample of pipe to be tested shall be selected at random by the County or the testing laboratory and shall be delivered by the Contractor to the testing laboratory approved by the County.
- C. When the specimens tested conform to applicable standards, all pipe represented by such specimens shall be considered acceptable based on the test parameters measured. Copies of test reports shall be submitted to the County prior to the pipe installation. Acceptable pipe shall be stamped with an appropriate monogram under the supervision of the testing laboratory.

- D. All pipe test specimens failing to meet the applicable standards shall be rejected. The Contractor may provide two additional test specimens from the same shipment or delivery for each failed specimen. The pipe shall be acceptable if both of these additional specimens meet the requirements of the applicable standards.
- E. Pipe which has been deemed unacceptable by the County shall be removed from the work site by the Contractor and shall be replaced with acceptable pipe.

PART 2 MATERIALS

2.01 GENERAL

- A. The sizes of gravity sewer pipe shall be shown on the Drawings.
- B. Each length of pipe shall bear the name or trademark of the manufacturer, the location of the manufacturing plant and the class or strength classification of the pipe. The markings shall be plainly visible on the pipe barrel.

2.02 POLYVINYL CHLORIDE (PVC) GRAVITY SEWER PIPE

- A. PVC pipe, sizes 6" through 12", for use in non-pressure gravity sewer mains and laterals shall have an SDR of 26 and conform to ASTM D-3034. PVC pipe shall be made of PVC plastic, homogenous throughout and free from visible cracks, holes, foreign inclusions or other injurious defects. The pipe shall be uniform in color, density and other physical properties.
- B. PVC pipe sizes over 12" shall be approved by Manatee County.
- C. All pipe shall be in compliance with the above standard and be clearly marked as follows at intervals of 5 feet or less:
 - 1. Manufacturer's name or trademark.
 - 2. Nominal pipe size.
 - 3. PVC cell classification (eg. 12454-B).
 - 4. The legend "Type PSM SDR-26 PVC Sewer Pipe" and the designation ASTM D-3034.
- D. In addition to the above mentioned requirements, all PVC sanitary sewer pipe shall be color coded green to conform with Manatee County Standards.
- E. PVC sewer fittings shall conform to the requirements of ASTM D-3034 and shall have an SDR of 26. Six inch PVC fittings for sewer laterals shall be SDR 26. Fittings shall be molded in one piece with elastomeric joints and minimum socket depths as measured in accordance with ASTM D-3034. Fittings not currently available in molded form may be fabricated in accordance with ASTM D-3034 with manufacturer's standard pipe bells and gaskets. Gasket shall have a minimum cross sectional area of 0.20 sq. in. and conform to ASTM F-477 specification.

2.03 JOINTING PVC PIPE

- A. The PVC joints shall be of the push-on type so that the pipe and fittings may be connected on the job without the use of solvent cement or any special equipment. The push-on joint shall be a single rubber gasket conforming to ASTM F-477, designed to be assembled by the positioning of a continuous molded rubber ring gasket in an annular recess in the pipe of fitting socket and the forcing of the plain end of the entering pipe into the socket, thereby compressing the gasket radially to the pipe to form a positive seal. The gasket and annular recess shall be designed and shaped so that the gasket is locked in place against displacement as the joint is assembled. The rubber ring joint shall be designed for thermal expansion or contraction with a total temperature change of at least 75 degrees F in each joint per length of pipe. The bell shall consist of an integral wall section with a solid cross-section elastomeric ring which shall meet requirements of ASTM F-477. The thickened bell section shall be designed to be at least as strong as the pipe wall. Lubricant furnished for lubricating joints shall be nontoxic, shall not support the growth of bacteria, and shall have no deteriorating effects on the gasket or pipe material.
- B. Wyes and riser fittings shall be gasketed connections. If female adapters SDR 26 or 35 are unavailable, solvent welds shall be acceptable upon approval by the County.
- C. Rubber doughnuts are not to be used.

2.04 JOINTS FOR DISSIMILAR PIPE

Joints between pipe of different materials shall be made using mechanical joint connections. Metal piping shall not be threaded into plastic fittings, valves, or couplings, nor shall plastic piping be threaded into metal valves, fittings, or couplings.

2.05 PIPE BEDDING AND PIPE COVER MATERIALS

- A. Pipe bedding and cover material shall be as specified in the Contract Documents.
- B. Pipe bedding and cover material for polyethylene coated ductile iron pipe fittings shall be well graded sand.

PART 3 EXECUTION

3.01 PIPE DISTRIBUTION

The Contractor shall not distribute material on the job faster than it can be used to good advantage. He shall unload pipe which cannot be physically lifted by workers from the trucks, by a forklift, or other approved means. He shall not drop pipe of any size from the bed of the truck to the ground. He shall not distribute more than one week supply of material in advance of laying, unless otherwise approved by the County.

3.02 PIPE PREPARATION AND HANDLING

- A. The Contractor shall inspect all pipe and fittings prior to lowering them into trench. Cracked, broken, or otherwise defective materials are not acceptable and shall not be used. The Contractor shall clean the ends of the pipe thoroughly. He shall remove foreign matter and dirt from inside of pipe and keep the pipe clean during and after laying.

- B. The Contractor shall use proper implements, tools and facilities for the safe and proper protection of the work. He shall lower the pipe into the trench in a manner to avoid any physical damage to the pipe, remove all damaged pipe from the job site and under no circumstances shall the pipe be dropped or dumped into trenches.

3.03 LINE AND GRADE

- A. The Contractor shall not deviate more than 1/2-inch for line and 1/4-inch for grade from the line design and design grade established by the County provided that such variation does not result in a level or a reverse sloping invert. He shall measure the grade at the pipe invert and not at the top of the pipe. The Contractor shall furnish, set and control the line and grade by laser beam method. Other methods of controlling line and grade may be submitted to the County for approval if using the laser beam method proves to be impractical because of other conditions.
- B. The Contractor shall use the laser beam method of maintaining line and grade. The Contractor shall submit evidence to the County that a qualified operator shall handle the equipment during the course of construction. A "Caution-Laser Light" placard shall be displayed in a conspicuous place. When "in the pipe" method is used, grade boards shall be installed for the first 50 feet of pipe. The Contractor shall check the line and grade at any additional points at which offset stakes have been placed and when requested by the County. A fan shall be provided to circulate the air if bending of the beam due to air temperature variations becomes apparent with "in the pipe" units. However excessive air velocity shall not be permitted to cause pulsating or vibrating of the beam. If, in the opinion of the County, the beam cannot be accurately controlled, this method of setting line and grade shall be discontinued. When the above ground method is used, the set-up shall be checked with the three grade boards including one set at the upstream manhole. If the laser has a gradient indicator, two boards may be used to check the set-up. The grade board at the up-stream manhole shall be retained to check into as pipe laying progresses.

3.04 PREPARATION OF TRENCH

- A. The Contractor shall provide pipe bedding material under all the pipe for the full trench width. The minimum depth of bedding material below the pipe barrel shall be as follows

Minimum Depth of

<u>Pipe Size</u>	<u>Bedding Under Pipe Barrel</u>
15" & Smaller	4 inches
18" to 36"	6 inches
42" & Large	9 inches

- B. The depth of pipe bedding material under the pipe bell shall not be less than three inches under normal trench conditions.
- C. The Contractor shall hand-grade bedding to proper grade ahead of the pipe laying operation. The bedding shall provide a firm, unyielding support along the entire pipe length.

- D. Should the Contractor excavate the trench below the required depth for pipe bedding material placement without direction from the County, the Contractor shall fill the excess depth with pipe bedding material as specified herein to the proper subgrade.
- E. The Contractor shall excavate bell holes at each joint to permit proper assembly and inspection of the entire joint.

3.05 DEWATERING

The Contractor shall prevent water from entering the trench during excavation and pipe laying operations to properly grade the bottom of the trench and allow for proper compaction of the backfill. Pipe shall not be laid in water.

3.06 LAYING AND JOINTING PIPE AND FITTINGS

- A. The Contractor shall lay pipe upgrade with spigot ends pointing in direction of flow. After a section of pipe has been lowered into the prepared trench, he shall clean the end of the pipe to be joined, the inside of the joint and, if applicable, the rubber ring immediately prior to joining the pipe. The Contractor shall assemble the joint in accordance with the recommendations of the manufacturer of the type of joint used. He shall provide all special tools and appliances required for the jointing assembly.
- B. The Contractor shall lay all pipe uniformly to line and grade so that the finished sewer shall present a uniform bore. Variations from line and grade in excess of the tolerances specified under LINE AND GRADE are not acceptable and the work shall be rejected.
- C. The Contractor shall check the pipe for alignment and grade after the joint has been made. The pipe bedding shall form a continuous and uniform bearing and support for the pipe barrel between joints. Sufficient pressure shall be applied to the joint to assure that the joint is "home" as defined in the standard installation instructions provided by the pipe manufacturer. The Contractor shall place sufficient pipe cover material to secure the pipe from movement prior to installing the next joint to assure proper pipe alignment and joint makeup.
- D. Pipe 21" and smaller intended to be in straight alignment shall be laid so that the inside joint space does not exceed 3/8" in width. If interior joints on 24" and larger pipe laid either in straight alignment or on a curve are greater than 3/8", the Contractor shall thoroughly clean the joint surfaces and fill and seal the entire joint with premixed mortar conforming to ASTM C-387 only after the trench has been backfilled, unless otherwise approved by the County. Trowel smooth on the inside surface. Water shall not be allowed to rise in or around, or pass over any joint before it has substantially set.
- E. When the Contractor lays pipe within a movable trench shield, he shall take all necessary precautions to prevent pipe joints from pulling apart when moving the shield ahead.
- F. The Contractor shall prevent excavated or other foreign material from getting into the pipe during the laying operation. He shall close and lock the open end of the last laid section of pipe to prevent entry of foreign material or creep of the gasketed joints when laying operations cease, at the close of the day's work, or whenever the workers are absent from the job.

- G. The Contractor shall plug or close off the pipes which are stubbed off with temporary plugs.
- H. The Contractor shall take all necessary precautions to prevent the "uplift" or floating of the line prior to the completion of the backfilling operation.
- I. The Contractor shall make connections of non-reinforced pipe to manholes or concrete structures, so that a standard pipe joint is located at a minimum of 18" outside the edge of structure.
- J. When field cutting and/or machining the pipe is necessary, the Contractor shall use only tools and methods recommended by the pipe manufacturer and approved by the County.
- K. Service lateral shall be constructed by the Contractor as shown on the standard sewer details and located approximately as shown on the Contract Drawings.

3.07 LAYING PLASTIC PIPE

- A. Polyvinyl chloride (PVC) pipe shall be installed by the Contractor in accordance with the instructions of the manufacturer, as shown on the Drawings and as called out in the Contract Documents.
- B. The Contractor shall lay the pipe, bedding and backfill to lines and grade shown on the Drawings and called out in the Contract Documents. Blocking under the pipe will not be permitted.
- C. The Contractor shall install a green metallic tape as shown in these Standards below finish grade along the entire pipeline PVC sewer main pipe route.
- D. The Contractor shall use care in the handling, storage and installation of pipe. Storage of pipe on the job site shall be done in accordance with the pipe manufacturer's recommendation.

3.08 BACKFILL IN THE PIPE ZONE

- A. The pipe zone shall be considered to include the full width of the excavated trench from the bottom of the trench to a point above the top outside surface of the barrel of the pipe.
- B. The Contractor shall pay particular attention to the area of the pipe zone from the flow line to the springline of the pipe to insure that firm support is obtained to prevent any lateral movement of the pipe during the final backfilling of the pipe zone.
- C. The Contractor shall take care to insure that the pipe does not rest directly on the bell or pipe joint, but is uniformly supported on the barrel throughout its entire length.
- D. After the pipe is laid by the Contractor to line and grade, he shall place and carefully compact pipe bedding material for the full width of the trench to the springline of the pipe. He shall place the material around the pipe in 6-inch layers and thoroughly hand tamp with

approved tamping sticks supplemented by "walking in" and slicing with a shovel to assure that all voids are filled.

- E. The Contractor shall backfill and carefully compact the area above the pipe springline with pipe cover material to a point 12" above the top outside surface of the pipe barrel. Pipe bedding material may, at the Contractor's option, be substituted for pipe cover material.

3.09 EXCESS TRENCH WIDTH

- A. Normal trench widths shall be as shown on the Drawings. If the normal trench width below the top of the pipe is exceeded for any reason, the Contractor shall furnish an adequate support for the pipe. The County may determine that the pipe being used is strong enough for the actual trench width or the Contractor may furnish a stronger pipe or a concrete cradle for approval.
- B. Concrete thickness under the pipe shall be one-third of the nominal diameter of the pipe, but not less than four inches. Concrete block or brick may be used for adjusting and maintaining proper grade and elevation of pipe. After the pipe is laid to line and grade, the Contractor shall place 3,000 psi concrete under the pipe for the full width of the trench to form a cradle of the required length and thickness with the concrete brought up to a level equal to 1/4 of the inside pipe diameter below the springline of the pipe. Start and terminate the concrete cradle at the face of a pipe bell or collar. Do not encase pipe joints at the ends of the concrete cradle.
- C. After the concrete has taken initial set, the Contractor shall place cover material over the concrete cradle and up to a level 12" above the pipe barrel and for the full width of the trench. Cover material shall be placed by hand or by equally careful means.

3.10 CONNECTING DISSIMILAR PIPE MATERIALS

The Contractor shall use the following method to connect dissimilar pipe materials. Use concrete closure collars only when approved by the County and then only to make connections between dissimilar pipe when standard rubber gasketed joints or flexible couplings are impracticable. Before the closure collars are poured, wash the pipe to remove all loose material and soil from the surface on which the concrete will be placed. Wet nonmetallic pipe thoroughly prior to pouring the collars. Wrap and securely fasten a light gauge of sheet metal or building-felt around the pipe to insure that no concrete shall enter the line. Place reinforcement as shown on the plans. Make entire collar in one pour using 3,000 psi concrete and extend a minimum 12" on each side of the joint. The minimum thickness around the outside diameter of the pipe shall be 6". No collar shall be poured in water. After the collars are poured and have taken their initial set, cure by covering with well-moistened earth.

3.11 PIPE BULKHEADS

- A. Connections for future sewers shall be bulkheaded by the Contractor in the following manner:
 - 1. All wyes and bell-and-spigot pipe sewers 18" in diameter or smaller shall be bulkheaded with caps or disc stoppers with factory-fabricated resilient joints. The

disk or cap shall be banded or otherwise secured to withstand all test pressures without leakage.

2. Connections 21" and 24" in diameter shall be bulkheaded with a four-inch brick wall, using clay brick or concrete brick. The wall shall be capable of withstanding all test pressures without leakage.
3. Connections 27" in diameter and larger shall be bulkheaded with an eight-inch wall, using clay brick or concrete brick. The wall shall be capable of withstanding all test pressures without leakage.

3.12 AIR TEST FOR GRAVITY SEWERS - GENERAL

- A. Gravity sewers shall be required to pass the low pressure air test described herein.
- B. Air loss rates may be measured by the County. These tests shall be performed by the Contractor under the observation of the County Inspector.
- C. The groundwater height above the installed pipe shall be determined by attaching a transparent plastic tube to a pipe nipple in the manhole and using the plastic tube as a manometer. A test hole may be dug directly above the sewer main for visual inspection.
- D. The ends of branches, laterals, tees, wyes and stubs included in a test section shall be plugged to prevent air leakage. All plugs shall be secured to prevent blowout due to internal pressure. A test section is defined as the length of sewer between manholes.
- E. The Contractor shall repair all visible leaks in manholes and pipe, even if the leakage test requirements are met.

3.13 LAMP TEST FOR GRAVITY SEWER MAINS

- A. Prior to testing, the Contractor shall prepare the lines for testing. All lines shall be thoroughly cleaned.
- B. The Contractor shall furnish all equipment necessary for testing including, but not limited to, ladders, a lamping light and a vehicle to use as power source.
- C. Gravity lines shall be lamped from both the upstream and downstream ends between the manholes.
- D. A minimum image of 75% shall be acceptable.
- E. Failure to meet the 75% image requirement shall result in the Contractor having to video tape the line at his own expense. The County or his representative shall be present while the line is video taped. The tape shall be submitted to Manatee County for evaluation.
- F. The Contractor shall relay or otherwise correct any line deemed unacceptable by the County. This work shall be done entirely at the Contractor's expense.
- G. Grouting of sewer lines or re-rounding machines are not approved corrective measures.

- H. Sewer lines shall be re-lamped and may be required by Manatee County to be video taped again.

3.14 FINAL SEWER CLEANING

- A. Prior to final acceptance and final manhole-to-manhole inspection of the sewer system by the County, the Contractor shall flush and clean all parts of the system, remove all accumulated construction debris, rocks, gravel, sand, silt and other foreign material from the sewer system at or near the closest downstream manhole.
- B. During the final manhole-to-manhole inspection of the sewer system, the County may require the Contractor to reflush and clean any section or portion of the line if any foreign matter is still present in the system.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02640

VALVES AND APPURTENANCES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required and install complete and ready for operation all valves and appurtenances as shown on the Drawings and as specified herein.
- B. All valves and appurtenances shall be of the size shown on the Drawings and, to the extent possible, all equipment of the same type on the Project shall be from one manufacturer.
- C. All valves and appurtenances shall have the name of the manufacturer and the working pressure for which they are designed cast in raised letters upon some appropriate part of the body.
- D. All valves shall have a factory applied, fusion bonded epoxy coating on interior and exterior unless noted otherwise in the plans or this specification.
- E. The equipment shall include, but not be limited to, the following:
 - 1. Gate valves (Sec. 2.01)
 - 2. Pressure Sustaining and Check Valves (Sec. 2.02)
 - 3. Ball Valves for PVC Pipe (Sec. 2.03)
 - 4. Butterfly Valves (Sec. 2.04)
 - 5. Plug Valves (Sec. 2.05)
 - 6. Valve Actuators (Sec. 2.06)
 - 7. Air Release Valves (Sec. 2.07)
 - 8. Valves Boxes (Sec. 2.08)
 - 9. Corporation Cocks (Sec. 2.09)
 - 10. Flange Adapter Couplings (Sec. 2.10)
 - 11. Flexible Couplings (Sec. 2.11)
 - 12. Hose Bibs (Sec. 2.12)
 - 13. Slow Closing Air and Vacuum Valves (Sec. 2.13)
 - 14. Surge Anticipator Valve (Sec. 2.14)
 - 15. Check Valves (Sec. 2.15)
 - 16. Hydrants (Sec. 2.16)
 - 17. Restraining Clamps (Sec. 2.17)
 - 18. Tapping Sleeves and Tapping Valves (Sec. 2.18)
 - 19. Single Acting Altitude Valves (Sec. 2.19)

1.02 DESCRIPTION OF SYSTEMS

All of the equipment and materials specified herein are intended to be standard for use in controlling the flow of potable water, reclaim water, wastewater, etc., depending on the applications.

1.03 QUALIFICATIONS

All of the types of valves and appurtenances shall be products of well established reputable firms who are fully experienced and qualified in the manufacture of the particular equipment to be furnished. The equipment shall be designed, constructed and installed in accordance with the best practices and methods and shall comply with these Specifications as applicable. Valves shall be as covered under mechanical devices in Section 8 of ANSI/NSF Standard 61.

1.04 SUBMITTALS

- A. Submit to the County within 30 days after execution of the contract a list of materials to be furnished, the names of the suppliers and the date of delivery of materials to the site.
- B. Complete shop drawings of all valves and appurtenances shall be submitted to the County for approval in accordance with the Specifications.

1.05 TOOLS

Special tools, if required for normal operation and maintenance shall be supplied with the equipment.

PART 2 PRODUCTS

2.01 GATE VALVES

- A. All buried valves shall have cast or ductile iron three (3) piece valve bodies.
- B. Where indicated on the drawings or necessary due to locations, size, or inaccessibility, chain wheel operators shall be furnished with the valves. Such operators shall be designed with adequate strength for the valves with which they are supplied and provide for easy operation of the valve. Chains for valve operators shall be galvanized.
- C. Where required, gate valves shall be provided with a box cast in a concrete slab and a box cover. Length of box shall include slab thickness. Box cover opening shall be for valve stem and nut. Valve wrenches and extension stems shall be provided by the manufacturer to actuate the valves. The floor box and cover shall be equal to those manufactured by Rodney Hunt Machine Company, Orange, Massachusetts, Clow, DeZurik or approved equal.
- D. Gate valves with 3"-20" diameters shall be resilient seated, manufactured to meet or exceed the requirements of AWWA C509 or C515 and UL/FM of latest revision and in accordance with the following specifications. Valves shall have an unobstructed waterway equal to or greater than the full nominal diameter of the valve.
- E. Wrench nut shall be provided for operating the valve.
- F. Valves shall be suitable for an operating pressure of 200 psi and shall be tested in accordance with AWWA C509 or C515. Mueller, Kennedy, M&H, and Clow are acceptable valves.

- G. All bonnet bolts, nuts and studs shall be stainless steel.

2.02 PRESSURE SUSTAINING AND CHECK VALVE

- A. Pressure sustaining and check valve shall be pilot operated diaphragm actuated valve with cast iron body, bronze trim, and 125-pound flanged ends. The valve shall be hydraulically operated, diaphragm type globe valve. The main valve shall have a single removable seat and a resilient disc, of rectangular cross section, surrounded on three and a half sides. The stainless steel stem shall be fully guided at both ends by a bearing in the valve cover, and an integral bearing in the valve seat. It shall be sleeved at both ends with delrin. No external packing glands are permitted and there shall be no pistons operating the main valve or any controls. The valve shall be equipped with isolation cocks to service the pilot system while permitting flow if necessary. Main valve and all pilot controls shall be manufactured in the United States of America. Valve shall be single chamber type, with seat cut to 5 degrees taper.
- B. Valve shall maintain a minimum (adjustable) upstream pressure to a preset (adjustable) maximum. The pilot system shall consist of two direct acting, adjustable, spring loaded diaphragm valves.
- C. Valve shall be cast iron (ASTM A48) with main valve trim of brass (QQB-B-626) and bronze (ASTM B61). The pilot control valves shall be cast brass (ASTM B62) with 303 stainless steel trim. All ferrous surfaces inside and outside shall have a 2-part epoxy coating. Valve shall be similar in all respects to CLA-VAL Company, Model 692G-01ABKG, as manufactured by CLA-VAL Company, Winter Park, Florida, or similar pressure sustaining and check valve as manufactured by Golden Alderson; or approved equal.

2.03 BALL VALVES FOR PVC PIPE

- A. Ball valves for PVC pipe shall be of PVC Type 1 with union, socket, threaded or flanged ends as required. Ball valves shall be full port, full flow, all plastic construction, 150 psi rated with teflon seat seals and T-handles. PVC ball valves shall be as manufactured by Celanese Piping Systems, Inc., Wallace and Tiernan, Inc., Plastiline, Inc., or approved equal.
- B. All valves shall be mounted in such a position that valve position indicators are plainly visible when standing on the floor.

2.04 BUTTERFLY VALVES

- A. Butterfly valves shall conform to the AWWA Standard Specifications for Rubber Seated Butterfly Valves, Designated C504, except as hereinafter specified. Valves, except as specified hereinafter, shall be Class 150A or B, except that valves furnished downstream of the high service pumps shall be Class 250 and equal to those manufactured by Henry Pratt Company, DeZurik, Mueller, or approved equal. M&H/Kennedy/Clow are not generally approved equals. Ductile iron conforming to ASTM A536, Grade 65-45-12 shall be provided for all Class 250 valves. All valves shall be leak tested at 200 psi.
- B. The face-to-face dimensions of flanged end valves shall be in accordance with Table 1 of above mentioned AWWA Specification for short-body valve. Adequate two-way thrust

bearings shall be provided. Flange drilling shall be in accordance with ANSI B16.1.

- C. Valve seats shall be an EPDM elastomer. Valve seats 24 inches and larger shall be field adjustable and replaceable without dismounting operator disc or shaft and without removing the valve from the line. All retaining segments and adjusting devices shall be of corrosion resistant material with stainless Nylock screws and be capable of the 1/8-inch adjustment. Valves 20 inches and smaller shall have bonded or mechanically restrained seats as outlined in AWWA C 504. Where the EPDM seat is mounted on the valve body, the mating edge of the valve disc shall be 18-8 stainless steel or Nickel-Chrome, 80-20%. Where the EPDM seat is mounted on the valve disc, the valve body shall be fitted with an 18-8 stainless steel seat offset from the shaft, mechanically restrained and covering 360 degrees of the peripheral opening or seating surface.
- D. The valve body shall be constructed of ductile iron or close grain cast iron per ASTM A126, Class B with integrally cast hubs for shaft bearing housings of the through boss-type. Butterfly valves of the "wafer" or "spool" type will not be accepted.
- E. The valve shaft shall be turned, ground, and polished constructed of 18-8, ASTM A-276, Type 304 stainless steel and designed for both torsional and shearing stresses when the valve is operated under its greatest dynamic or seating torque. Shaft shall be of either a one piece unit extending full size through the valve disc and valve bearing or it may be of a stub shaft design. Shaft bearings shall be teflon or nylon, self-lubricated type.
- F. All valves shall be subject to hydrostatic and leakage tests at the point of manufacture. The hydrostatic test for Class 250 valves shall be performed with an internal hydrostatic pressure equal to 500 psi applied to the inside of the valve body of each valve for a period of five minutes. During the hydrostatic test, there shall be no leakage through the metal, the end joints or the valve shaft seal. The leakage test for the Class 250 valves shall be performed at a differential pressure of 230 psi and against both sides of the valve. No adjustment of the valve disc shall be necessary after pressure test for normal operation of valve. The Class 150 valves shall be tested in conformance with AWWA C-504.
- G. In general, the butterfly valve operators shall conform to the requirements of Section 3.8 of the AWWA Standard Specifications for Rubber Seated Butterfly Valves, Designation C504, insofar as applicable, and as herein specified.
- H. Gearing for the operators shall be totally enclosed in a gear case in accordance with paragraph 3.8.3 of the above mentioned AWWA Standard Specification.
- I. Operators shall be capable of seating and unseating the disc against the full design pressure of velocity, as specified for each class, into a dry system downstream and shall transmit a minimum torque to the valve. Operators shall be rigidly attached to the valve body.
- J. The manufacturer shall certify that the required tests on the various materials and on the completed valves have been satisfactory and that the valves conform with all requirements of this Specification and the AWWA standard.
- K. Where indicated on the Drawings, extension stems, floor stands, couplings, stem guides, and floor boxes as required shall be furnished and installed.

2.05 PLUG VALVES

- A. All plug valves shall be eccentric plug valves capable of sustaining 150 psi in either direction without leaking.

Exception: Single direction plug valves may be used if it is clearly demonstrated they will never be required to resist pressure in both directions either in service or during pipe line testing.

- B. Plug valves shall be tested in accordance with current AWWA Standard C-504-80 Section 5. Each valve shall be performance tested in accordance with paragraph 5.2 and shall be given a leakage test and hydrostatic test as described in paragraphs 5.3 and 5.4. Plug valves shall be Kennedy or Dezurik.
- C. Plug valves shall be of the non-lubricated eccentric type with resilient faced plugs and shall be furnished with end connections as shown on the Plans. Flanged valves shall be faced and drilled to the ANSI 150 lb. standard. Mechanical joint ends shall be to the AWWA Standard C111-72. Bell ends shall be to the AWWA Standard C100-55 Class B. Screwed ends shall be to the NPT standard.
- D. Plug valve bodies shall be of ASTM A126 Class B Semi-steel, 31,000 psi tensile strength minimum in compliance with AWWA Standard C507-73, Section 5.1 and AWWA Standard C504-70 Section 6.4. Port areas for valves 20-inches and smaller shall be 80 percent of full pipe area. Valves 24 inch and larger shall have a minimum port area between 80 and 100 percent of full nominal pipe area. All exposed nuts, bolts, springs, washers, etc. shall be zinc or cadmium plated. Resilient plug facings shall be of Hycar or Neoprene.
- E. Plug valves shall be furnished with permanently lubricated stainless steel or oil-impregnated bronze upper and lower plug stem bushings. These bearings shall comply with current AWWA Standards.

2.06 VALVE ACTUATORS

- A. General

1. All valve actuators shall conform to Section 3.8 of the AWWA Standard Specification and shall be either manual or motor operated.
2. Actuators shall be capable of seating and unseating the disc against the full design pressure and velocity, as specified for each class, into a dry system downstream, and shall transmit a minimum torque to the valve. Actuators shall be rigidly attached to the valve body.
3. Butterfly valve actuators shall conform to the requirements of Section 3.8 of the AWWA Standard specifications for Rubber Seated Butterfly Valves, Designated C504, insofar as applicable and as herein specified.

- B. Manual Actuators

1. Manual actuators shall have permanently lubricated, totally enclosed gearing with handwheel and gear ratio sized on the basis of actual line pressure and velocities. Actuators shall be equipped with handwheel, position indicator, and mechanical stop-limiting locking devices to prevent over travel of the disc in the open and

closed positions. They shall turn counter-clockwise to open valves. Manual actuators shall be of the traveling nut, self-locking type and shall be designed to hold the valve in any intermediate position between fully open and fully closed without creeping or fluttering. Actuators shall be fully enclosed and designed to produce the specified torque with a maximum pull of 80 pounds on the handwheel or chainwheel. Actuator components shall withstand an input of 450 foot pounds for 30" and smaller and 300 foot pounds for larger than 30" size valves at extreme actuator positions without damage. Valves located above grade shall have handwheel and position indicator, and valves located below grade shall be equipped with a two inch (2") square AWWA operating nut located at ground level and cast iron extension type valve box. Valve actuators shall conform to AWWA C504, latest revision.

C. Motor Actuators (Modulating)

1. The motor actuated valve controller shall include the motor, actuator unit gearing, limit switch gearing, limit switches, position transmitter which shall transmit a 4-20 mA DC signal, control power transformer, electronic controller which will position the valve based on a remote 4-20 milliamp signal, torque switches, bored and keywayed drive sleeve for non-rising stem valves, declutch lever and auxiliary handwheel as a self-contained unit.
2. The motor shall be specifically designed for valve actuator service using 480 volt, 60 Hertz, three phase power as shown, on the electrical drawings. The motor shall be sized to provide an output torque and shall be the totally enclosed, non-ventilated type. The power gearing shall consist of helical gears fabricated from heat treated alloy steel forming the first stage of reduction. The second reduction stage shall be a single stage worm gear. The worm shall be of alloy steel with carburized threads hardened and ground for high efficiency. The worm gear shall be of high tensile strength bronze with hobbled teeth. All power gearing shall be grease lubricated. Ball or roller bearings shall be used throughout. Preference will be given to units having a minimum number of gears and moving parts. Spur gear reduction shall be provided as required.
3. Limit switches and gearing shall be an integral part of the valve control. The limit switch gearing shall be made of bronze and shall be grease lubricated, intermittent type and totally enclosed to prevent dirt and foreign matter from entering the gear train. Limit switches shall be of the adjustable type capable of being adjusted to trip at any point between fully opened valve and fully closed valve.
4. The speed of the actuator shall be the responsibility of the system supplier with regard to hydraulic requirements and response compatibility with other components within the control loop. Each valve controller shall be provided with a minimum of two rotor type gear limit switches, one for opening and one for closing. The rotor type gear limit switch shall have two normally open and two normally closed contacts per rotor. Gear limit switches must be geared to the driving mechanism and in step at all times whether in motor or manual operation. Provision shall be made for two additional rotors as described above, each to have two normally open and two normally closed contacts. Each valve controller shall be equipped with a double torque switch. The torque switch shall be adjustable and will be responsive to load encountered in either direction of travel. It shall operate during the complete cycle without auxiliary relays or devices to protect the valve, should excessive load be met by obstructions in either direction of travel. The torque switch shall be provided with double-pole contacts.

5. A permanently mounted handwheel shall be provided for manual operation. The handwheel shall not rotate during electric operations, but must be responsive to manual operation at all times except when being electrically operated. The motor shall not rotate during hand operation nor shall a fused motor prevent manual operation. When in manual operating position, the unit will remain in this position until motor is energized at which time the valve operator will automatically return to electric operation and shall remain in motor position until handwheel operation is desired. This movement from motor operation to handwheel operation shall be accomplished by a positive declutching lever which will disengage the motor and motor gearing mechanically, but not electrically. Hand operation must be reasonably fast. It shall be impossible to place the unit in manual operation when the motor is running. The gear limit switches and torque switches shall be housed in a single easily accessible compartment integral with the power compartment of the valve control. All wiring shall be accessible through this compartment. Stepping motor drives will not be acceptable.
6. The motor with its control module must be capable of continuously modulating over its entire range without interruption by heat protection devices. The system, including the operator and control module must be able to function, without override protection of any kind, down to zero dead zone.
7. All units shall have strip heaters in both the motor and limit switch compartments.
8. The actuator shall be equipped with open-stop-close push buttons, an auto-manual selector switch, and indicating lights, all mounted on the actuator or on a separate locally mounted power control station.
9. The electronics for the electric operator shall be protected against temporary submergence.
10. Actuators shall be Limitorque L120 with Modutronic Control System containing a position transmitter with a 4-20MA output signal or equal.

D. Motor Actuators (Open-Close)

1. The electronic motor-driven valve actuator shall include the motor, actuator gearing, limit switch gearing, limit switches, torque switches, fully machined drive sleeve, declutch lever, and auxiliary handwheel as a self-contained unit.
2. The motor shall be specifically designed for valve actuator service and shall be of high torque totally enclosed, nonventilated construction, with motor leads brought into the limit switch compartment without having external piping or conduit box.
 - (a) The motor shall be of sufficient size to open or close the valve against maximum differential pressure when voltage to motor terminals is 10% above or below nominal voltage.
 - (b) The motor shall be prelubricated and all bearings shall be of the anti-friction type.
3. The power gearing shall consist of helical gears fabricated from heat treated steel and worm gearing. The worm shall be carburized and hardened alloy steel with the threads ground after heat treating. The worm gear shall be of alloy bronze accurately cut with a hobbing machine. All power gearing shall be grease lubricated. Ball or roller bearings shall be used throughout.
4. Limit switches and gearing shall be an integral part of the valve actuator. The switches shall be of the adjustable rotor type capable of being adjusted to trip at any point between fully opened valve and fully closed valve. Each valve controller shall be provided with a minimum of two rotor type gear limit switches, one for opening and one for closing (influent valves require additional contacts to allow

stopping at an intermediate position). The rotor type gear limit switch shall have two normally open and two normally closed contacts per toro. Additional switches shall be provided if shown on the control and/or instrumentation diagrams. Limit switches shall be geared to the driving mechanism and in step at all times whether in motor or manual operation. Each valve actuator shall be equipped with a double torque switch. The torque switch shall be adjustable and will be responsive to load encountered in either direction of travel. It shall operate during the complete cycle without auxiliary relays or devices to protect the valve should excessive load be met by obstructions in either direction of travel. Travel and thrusts shall be independent of wear in valve disc or seat rings.

5. A permanently mounted handwheel shall be provided for manual operation. The handwheel shall not rotate during electric operation except when being electrically operated. The motor shall not rotate during hand operation, nor shall a fused motor prevent manual operation. When in manual operating position, the unit will remain in this position until motor is energized at which time the valve actuator will automatically return to electric operation and shall remain in motor position until handwheel operation is desired. Movement from motor operation to handwheel operation shall be accomplished by a positive declutching lever which will disengage the motor and motor gearing mechanically, but not electrically. Hand operation must be reasonably fast. It shall be impossible to place the unit in manual operation when the motor is running.
6. Valve actuators shall be equipped with an integral reversing controller and three phase overload relays, Open-Stop-Close push buttons, local-remote-manual selector switch, control circuit transformer, three-phase thermal overload relays and two pilot lights in a NEMA 4X enclosure. In addition to the above, a close coupled air circuit breaker or disconnect switch shall be mounted and wired to the valve input power terminals for the purpose of disconnecting all underground phase conductors.
7. The valve actuator shall be capable of being controlled locally or remotely via a selector switch integral with the actuator. In addition, an auxiliary dry contact shall be provided for remote position feedback.
8. Valve A.C. motors shall be designed for operation on a 480 volt, 3-phase service. Valve control circuit shall operate from a fuse protected 120 volt power supply.
9. Motor operators shall be as manufactured by Limatorque Corporation, Type L120 or approved equal.

2.07 AIR RELEASE VALVES

The air release valves for use in water or force mains shall be installed as shown on the Drawings. The valves shall have a cast iron body cover and baffle, stainless steel float, bronze water diffuser, Buna-N or Viton seat, and stainless steel trim. The fittings shall be threaded. The air release valves shall be Model 200A or 400A as manufactured by APCO Valve and Primer Corporation, Schaumburg, Illinois; or approved equal.

2.08 VALVE BOXES

- A. Buried valves shall have cast-iron three piece valve boxes or HDPE adjustable valve boxes. Cast iron valve boxes shall be provided with suitable heavy bonnets and shall extend to such elevation at or slightly above the finished grade surface as directed by the County. The barrel shall be two-piece, screw type, having a 5-1/4 inch shaft. The upper section shall have a flange at the bottom with sufficient bearing area to prevent settling

and shall be complete with cast iron covers. Covers shall have WATER, SEWER, or RECLAIM, as applicable, cast into the top. Lids will be painted "safety" blue for potable, purple for reclaimed, and green for sanitary sewer.

- B. All valves shall have actuating nuts extended to within four (4) feet of the top of the valve box. All valve extensions will have a centering guide plate two (2) inches maximum below the actuating nut. The valve extension shall be fastened to the existing nut with a set screw. Valve boxes shall be provided with a concrete base and a valve nameplate engraved with lettering 1/8-inch deep as shown on the Drawings.
- C. HDPE adjustable valve boxes shall be one complete assembled unit composed of the valve box and extension stem. All moving parts of the extension stem shall be enclosed in a housing to prevent contact with the soil. Valve box assembly shall be adjustable to accommodate variable trench depths.
- D. The entire assembly shall be made of heavy wall high density polyethylene. All exterior components shall be joined with stainless steel screws. The valve box top section shall be adaptable to fit inside a valve box upper section.
- E. The stem assembly shall be of a telescoping design that allows for variable adjustment length. The stem material shall be of plated steel square tubing. The stem assembly shall have a built-in device that keeps the stem assembly from disengaging at its fully extended length. The extension stem must be torque tested to 1000 foot pounds. Covers shall have WATER, SEWER or RECLAIMED clearly and permanently impressed into the top surface.

2.09 CORPORATION COCKS

Corporation cocks for connections to cast-iron, ductile iron or steel piping shall be all brass or bronze suitable for 180 psi operating pressure and similar to Mueller Co. H-10046 or approved equal by Clow Corp., and shall be of sizes required and/or noted on the Drawings.

2.10 FLANGE ADAPTER COUPLINGS

Flange adapter couplings shall be of the size and pressure rating required for each installation and shall be suitable for use on either cast iron or ductile iron pipe. They shall be similar or approved equal to Dresser Company, Style 128. All couplings shall have a sufficient number of factory installed anchor studs to meet or exceed a minimum test pressure rating of 230 psi minimum.

2.11 FLEXIBLE COUPLINGS

Flexible couplings shall be either the split type or the sleeve type as shown on the Drawings.

1. Split type coupling shall be used with all interior piping and with exterior pipings noted on the Drawings. The couplings shall be mechanical type for radius groove piping. The couplings shall mechanically engage and lock grooved pipe ends in a positive couple and allow for angular deflection and contracting and expansion.
2. Couplings shall consist of malleable iron, ASTM Specification A47, Grade 32510 housing clamps in two or more parts, a single chlorinated butyl composition sealing

gasket with a "C" shaped cross-section and internal sealing lips projecting diagonally inward, and two or more oval track head type bolts with hexagonal heavy nuts conforming to ASTM Specification A 183 and A194 to assemble the housing clamps. Bolts and nuts shall be hot dipped galvanized after fabrication.

3. Victaulic type couplings and fittings may be used in lieu of flanged joints. Pipes shall be radius grooved as specified for use with the Victaulic couplings. Flanged adapter connections at fittings, valves, and equipment shall be Victaulic Vic Flange Style 741, equal by Gustin-Bacon Group, Division of Certain-Teed Products, Kansas City, Kansas, or approved equal.
4. Sleeve type couplings shall be used with all buried piping. The couplings shall be of steel and shall be Dresser Style 38 or 40, as shown on the Drawings, or equal. The coupling shall be provided with hot dipped galvanized steel bolts and nuts unless indicated otherwise.
5. All couplings shall be furnished with the pipe stop removed.
6. Couplings shall be provided with gaskets of a composition suitable for exposure to the liquid within the pipe.
7. If the Contractor decides to use victaulic couplings in lieu of flanged joints, he shall be responsible for supplying supports for the joints.

2.12 HOSE BIBS

Hose bibs shall be 3/4" or 1" brass, polished chromium plated brass, with vacuum breaker as noted on the drawings.

2.13 SLOW CLOSING AIR AND VACUUM VALVES

- A. The Contractor shall furnish and install slow closing air and vacuum valves as shown on the Drawings which shall have two (2) independent valves bolted together. The air and vacuum valve shall have all stainless steel float, guided on both ends with stainless shafts. The air and vacuum valve seat shall be Buna-N to insure drop tight closure. The Buna-N seat shall be fastened to the cover stainless shoulder screws in a manner to prevent distortion of the seat. The float shall be guided at both ends with stainless steel bushings.
- B. The valve cover shall have a male lip designed to fit into the body register for accurate alignment of the float into the Buna-N seat. The valve cover shall have 250-pound class flanged outlet connection.
- C. The surge check valve shall be bolted to the inlet of the air and vacuum valve and consist of a body, seat, disc, and compression spring. A surge check unit shall operate on the interphase between the kinetic energy and relative velocity flows of air and water, so that after air passes through, and water rushes into the surge check, the disc starts to close, reducing the rate of flow of water into the air valve by means of throttling orifices in the disc to prevent water hammer in the air valves. The surge check orifices must be adjustable type for regulation in the field to suit operating conditions. Valve shall be rated for 250-pound class working pressure.
- D. The complete slow closing air and vacuum valve with air release valve shall have been flow tested in the field, substantiated with test data to show reduction of surge pressure in the valve. Flow test data shall be submitted with initial shop drawings for approval.
- E. Valve exterior to be painted Red Oxide, Phenolic TT-P86, Primer or approved equal for

high resistance to corrosion.

- F. All materials of construction shall be certified in writing to conform to ASTM specifications as follows:

Air Valve Cover, Body, and Surge Check Body	Cast Iron	ASTM A48, Class 30
Float	Stainless Steel	ASTM A240
Surge Check Seat and Disc	Stainless Steel	ASTM A582
Air Valve Seat	Buna-N	
Spring	Stainless Steel	T302

2.14 SURGE ANTICIPATOR VALVES

- A. Surge anticipator valves shall be furnished for the pumping systems as shown on the Drawings. The valve shall be hydraulically operated, pilot controlled, and diaphragm or piston actuated. The main valve shall be cast iron conforming to ASTM A48 with bronze trim conforming to ASTM B61 and flanged ends conforming to ANSI B161.1. The main valve shall be globe type with a single removable seat and a resilient disc.
- B. The diaphragm actuated valve shall have a stainless steel stem guided at both ends by a bearing in the valve cover and an integral bearing surface in the seat. No external packing glands shall be permitted. The valve shall be fully serviceable without removing it from the line. The pilot system shall be of noncorrosive construction and provided with isolation cocks.
- C. The piston actuated valve shall operate on the differential piston principle. The valve piston shall be guided on its outside diameter. The valve shall be able to operate in any position and shall be fully serviceable without removing it from the line. The pilot system shall be provided with isolation cocks, and be of noncorrosive materials of construction.
- D. The valve shall be designed specifically to minimize the effects of water hammer, resulting from power failure at the pumping station, or from normal stopping and starting of pumping operators. The valve shall open hydraulically on a down surge, or low pressure wave created when the pump stops, remain open during the low pressure cycle in order to be open when the high pressure wave returns. The high pressure pilot shall be adjustable over a 20 to 200 psi range and the low pressure pilot shall be adjustable over a 15 to 75 psi range. The valve shall be the 250 Class.

2.15 CHECK VALVES

- A. Check valves for cast iron and ductile iron pipe lines shall be swing type and shall meet the material requirements of AWWA Specification C508. The valves shall be iron body, bronze mounted, single disc, 175 psi working water pressure and nonshock. Valves shall

be as manufactured by Mueller, Clow, Kennedy, or M&H. Valves 8" and larger shall be air cushioned to reduce valve slam.

- B. When there is no flow through the line, the disc shall hang lightly against its seat in practically a vertical position. When open, the disc shall swing clear of the waterway.
- C. Check valves shall have bronze seat and body rings, extended bronze hinge pins and bronze nuts on the bolts of bolted covers. The interior and exterior of the valve body shall have a factory applied fusion bonded or 10 mil 2 part epoxy coating (Protecto 401 or approved equal).
- D. Valves shall be so constructed that disc and body seat may easily be removed and replaced without removing the valve from the line. Valves shall be fitted with an extended hinge arm with outside lever and weight. Weights provided and approved by the County shall be installed.

2.16 HYDRANTS

Hydrants shall be AVK Series 2780 Barrel (nostalgic style with stainless steel bolts) American Darling B-84-B or Mueller Super Centurian 250, or approved equal and shall conform to the "Standard Specification for Fire Hydrants for Ordinary Water Works Service", AWWA C502, and UL/FM certified, and shall in addition meet the specific requirements and exceptions which follow:

1. Hydrants shall be according to manufacturer's standard pattern and of standard size, and shall have one 4-1/2" steamer nozzle and two 2-1/2" hose nozzles.
2. Hydrant inlet connections shall have mechanical joints for 6" ductile-iron pipe.
3. Hydrant valve opening shall have an area at least equal to that area of a 5-1/4" minimum diameter circle and be obstructed only by the valve rod. Each hydrant shall be able to deliver 500 gallons minimum through its two 2-1/2" hose nozzles when opened together with a loss of not more than 2 psi in the hydrants.
4. Each hydrant shall be designed for installation in a trench that will provide 5-ft. cover.
5. Hydrants shall be hydrostatically tested as specified in AWWA C502.
6. Hydrants shall be rated at 200 psi.
7. All nozzle threads shall be American National Standard.
8. Each nozzle cap shall be provided with a Buna N rubber washer.
9. Hydrants shall be so arranged that the direction of outlets may be turned 90 degrees without interference with the drip mechanism and without the mechanism obstructing the discharge from any outlet.
10. Hydrants must be capable of being extended without removing any operating parts.
11. Hydrants shall have bronze-to-bronze seatings as per AWWA C502-85.
12. Hydrant main valve closure shall be of the compression type opening against the pressure and closing with the pressure. The resilient seat material shall meet the requirements of AWWA C-509 and shall preferably be EPDM Elastomer.
13. Internal and below ground iron parts (bonnet, nozzle section and base) shall have a fusion bonded epoxy coating per AWWA C550. Aboveground external hydrant parts (cap, bonnet and nozzle section) shall be either epoxy coated together with a UV resistant polyester coating or have two shop coats of paint per AWWA C502. The lower stand pipe or barrel shall be protected with asphaltic coatings per

AWWA C502.

14. Exterior nuts, bolts and washer shall be stainless steel. Bronze nuts may be used below grade.
15. All internal operating parts shall be removable without requiring excavation.

2.17 RESTRAINING CLAMPS

Restraining clamp assemblies as detailed in the drawings for use at hydrant connections to water mains, or at fittings where shown on the Drawings, shall be as manufactured by American Cast Iron Pipe, Star Pipe Products, U.S. Pipe; or approved equal.

2.18 TAPPING SLEEVES AND GATE VALVES

- A. Tapping valves shall meet the requirement of AWWA C500. The valves shall be flanged, shall be mechanical joint outlet with nonrising stem, designed for vertical burial and shall open left or counterclockwise. Stuffing boxes shall be the "O-ring" type. Operating nut shall be AWWA Standard 2" square for valves 2" and up. The valves shall be provided with an overload seat to permit the use of full size cutters. Gaskets shall cover the entire area of flange surfaces and shall be supplied with EPDM wedges up to 30" diameter.
- B. Tapping sleeves and saddles shall seal to the pipe by the use of a confined "O" ring gasket, and shall be able to withstand a pressure test of 180 psi for one hour with no leakage in accordance with AWWA C110, latest edition. A stainless steel 3/4" NPT test plug shall be provided for pressure testing. All bolts joining the two halves shall be stainless steel and shall be included with the sleeve or saddle. Sleeves and saddles shall be protected from corrosion by being fusion applied epoxy coated, or be made of 18-8 Type 304 stainless steel. Saddle straps shall be 18-8 Type 304 stainless steel.

2.19 SINGLE ACTING ALTITUDE VALVES

- A. Function
 1. The altitude control valve shall be of the single acting type, closing off tightly when the water reaches the maximum predetermined level in the tank to prevent overflow; and opening to permit replenishing of the tank supply when the water level drops approximately 6" to 12" below the maximum level.
 2. A hand operated valve in the power water line to the top of the piston shall permit adjustment of the speed of valve closing. The tank water level control shall be by means of a diaphragm operated, spring loaded, three way pilot which directs power water to or from the top of the main valve piston. The three way pilot shall be of bronze construction. The diaphragm surface exposed to the tank head shall be not less than 57 sq. inches. It shall be possible to adjust the spring above the diaphragm for water level control approximately 20% above or below the factory setting.
- B. Description
 1. The main valve shall operate on the differential piston principle such that the area on the underside of the piston is no less than the pipe area on the upper surface of the piston is of a greater area than the underside of the piston.
 2. The valve piston shall be guided on its outside diameter by long stroke stationary

Vee ports which shall be downstream of the seating surface to minimize the consequences of throttling. Throttling shall be done by the valve Vee ports and not the valve seating surfaces.

3. The valve shall be capable of operating in any position and shall incorporate only one flanged cover at the valve top from which all internal parts shall be accessible. There shall be no stems, stem guides, or spokes within the waterway. There shall be no springs to assist the valve operation.

C. Construction

1. The valve body shall be of cast iron ASTM A-126 with flanges conforming to the latest ANSI Standards. The valve shall be extra heavy construction throughout. The valve interior trim shall be bronze B-62 as well as the main valve operation.
2. The valve seals shall be easily renewable while no diaphragm shall be permitted within the main valve body.
3. All controls and piping shall be of non-corrosive construction.
4. A visual valve position indicator shall be provided for observing the valve piston position at any time.

D. Figure Number

The valves shall be the 20" Globe type (Fig. 3200-D) as manufactured by GA Industries of Mars, Pennsylvania, or approved equal.

PART 3 EXECUTION

3.01 INSTALLATION

- A. All valves and appurtenances shall be installed in the location shown, true to alignment and rigidly supported. Any damage occurring to the above items before they are installed shall be repaired to the satisfaction of the County.
- B. After installation, all valves and appurtenances shall be tested at least two hours at the working pressure corresponding to the class of pipe, unless a different test pressure is specified. If any joint proves to be defective, it shall be repaired to the satisfaction of the County.
- C. Install all floor boxes, brackets, extension rods, guides, the various types of operators and appurtenances as shown on the Drawings that are in masonry floors or walls, and install concrete inserts for hangers and supports as soon as forms are erected and before concrete is poured. Before setting these items, the Contractor shall check all plans and figures which have a direct bearing on their location and he shall be responsible for the proper location of these valves and appurtenances during the construction of the structures.
- D. Pipe for use with flexible couplings shall have plain ends as specified in the respective pipe sections.
- E. Flanged joints shall be made with high strength, low alloy Corten bolts, nuts and washers. Mechanical joints shall be made with mild corrosion resistant alloy steel bolts and nuts. All exposed bolts shall be painted the same color as the pipe. All buried bolts and nuts shall

be heavily coated with two (2) coats of bituminous paint comparable to Inertol No. 66 Special Heavy.

- F. Prior to assembly of split couplings, the grooves as well as other parts shall be thoroughly cleaned. The ends of the pipes and outside of the gaskets shall be moderately coated with petroleum jelly, cup grease, soft soap or graphite paste, and the gasket shall be slipped over one pipe end. After the other pipe has been brought to the correct position, the gasket shall be centered properly over the pipe ends with the lips against the pipes. The housing sections then shall be placed. After the bolts have been inserted, the nuts shall be tightened until the housing sections are firmly in contact, metal-to-metal, without excessive bolt tension.
- G. Prior to the installation of sleeve-type couplings, the pipe ends shall be cleaned thoroughly for a distance of 8". Soapy water may be used as a gasket lubricant. A follower and gasket, in that order, shall be slipped over each pipe to a distance of about 6" from the end.
- H. Valve boxes with concrete bases shall be installed as shown on the Drawings. Mechanical joints shall be made in the standard manner. Valve stems shall be vertical in all cases. Place cast iron box over each stem with base bearing on compacted fill and the top flush with final grade. Boxes shall have sufficient bracing to maintain alignment during backfilling. Knobs on cover shall be parallel to pipe. Remove any sand or undesirable fill from valve box.

3.02 HYDRANTS

- A. Hydrants shall be set at the locations designated by the County and/or as shown on the Drawings and shall be bedded on a firm foundation. A drainage pit on crushed stone as shown on the Drawings shall be filled with gravel or crushed stone and satisfactorily compacted. During backfilling, additional gravel or crushed stone shall be brought up around and 6" over the drain port. Each hydrant shall be set in true vertical alignment and shall be properly braced. Concrete thrust blocks shall be placed between the back of the hydrant inlet and undisturbed soil at the end of the trench. Minimum bearing area shall be as shown on the plans. Felt paper shall be placed around the hydrant elbow prior to placing concrete. CARE MUST BE TAKEN TO INSURE THAT CONCRETE DOES NOT PLUG THE DRAIN PORTS. Concrete used for backing shall be as specified herein.
- B. When installations are made under pressure, the flow of water through the existing main shall be maintained at all times. The diameter of the tap shall be a minimum of 2" less than the inside diameter of the branch line.
- C. The entire operation shall be conducted by workmen thoroughly experienced in the installation of tapping sleeves and valves, and under the supervision of qualified personnel furnished by the manufacturer. The tapping machine shall be furnished by the Contractor if tap is larger than 12" in diameter.
- D. The Contractor shall determine the locations of the existing main to be tapped to confirm the fact that the proposed position for the tapping sleeve will be satisfactory and no interference will be encountered such as the occurrence of existing utilities or of a joint or fitting at the location proposed for the connection. No tap will be made closer than 30" from a pipe joint.

- E. Tapping valves shall be set in vertical position and be supplied with a 2" square operating nut for valves 2" and larger. The valve shall be provided with an oversized seat to permit the use of full sized cutters.
- F. Tapping sleeves and valves with boxes shall be set vertically or horizontally as indicated on the Drawings and shall be squarely centered on the main to be tapped. Adequate support shall be provided under the sleeve and valve during the tapping operation. Sleeves shall be no closer than 30" from water main joints. Thrust blocks shall be provided behind all tapping sleeves. Proper tamping of supporting earth around and under the valve and sleeve is mandatory. After completing the tap, the valve shall be flushed to ensure that the valve seat is clean.

3.03 SHOP PAINTING

Ferrous surfaces of valves and appurtenances shall receive a coating of rust-inhibitive primer. All pipe connection openings shall be capped to prevent the entry of foreign matter prior to installation.

3.04 FIELD PAINTING

All metal valves and appurtenances specified herein and exposed to view shall be painted.

All above ground potable water main valves shall be painted safety blue.

3.05 INSPECTION AND TESTING

Completed pipe shall be subjected to hydrostatic pressure test for two hours at 180 psi. All leaks shall be repaired and lines retested as approved by the County. Prior to testing, the pipelines shall be supported in an approved manner to prevent movement during tests.

END OF SECTION

SECTION 02720

SANITARY SEWER BYPASS PUMPING

PART 1 GENERAL

1.01 SCOPE

The Contractor shall furnish all labor, materials, equipment and incidentals required to maintain existing and anticipated flows within the affected portion of the collection system throughout the construction period.

1.02 PUBLIC IMPACTS

The contractor shall not create a public nuisance due to excessive noise or dust, nor impact the public with flooding of adjacent lands, discharge of raw sewage, or release of other potential hazards, nor shall he encroach on or limit access to adjacent lands. No extra charge may be made for increased costs to the contractor due to any of the above.

1.03 SUBMITTALS

- A. The Contractor shall, within 30 days of the date of the Notice to Proceed, submit to the Project Manager a detailed Pumping Plan for each site by-pass pumping will be needed. The Pumping Plan shall address all measures and systems to prevent a sanitary sewer overflow (SSO) as defined by the EPA. The Plan shall include as a minimum:
1. Working drawings and sketches showing work location, pump location, piping layout & routing. Show all proposed encroachment and access impacts on adjacent properties or facilities.
 2. Pump, control, alarm and pipe specifications or catalog cuts. Detailed sketch of controls and alarm system.
 3. Power requirements and details on methods to provide by-pass power or fueling.
 4. Calculation and determination of response times to prevent an SSO after a high water alarm. If anticipated peak flows are 750 G.P.M. or greater, an operator is required on site at all times pump is in service. If the anticipated peak flows are less than 750 G.P.M. an operator may not be required to be on site at all times; show operator on-site schedule.
 5. Procedures to be taken in case of power, pump, or piping failures; including contact names and numbers for emergency notifications.
 6. Frequency and specific responsibility for monitoring pump operation, fuel levels, pump maintenance and entire length of piping.

PART 2 PRODUCTS

2.01 EQUIPMENT

- A. Pumps:
1. By-pass pumping system shall consist of at least a primary pump and a backup

pump. Each pump shall have a minimum pumping capacity of 150% of the anticipated peak flows. If a lift station by-pass, 150% of the lift station capacity (G.P.M. & T.D.H) for the lift station being by-passed.

2. Pumps shall be low noise or sound attenuated. The noise level at any operating condition, in any direction, shall not exceed 70dBA at a distance of twenty three (23) feet (7 meters) from the pump and/or power source.

B. Controls:

The by-pass pump system shall be equipped with automatic controls and an alarm system. The automatic controls will automatically start the backup pump in the event of a high water condition or failure of the primary pump. The alarm system will immediately notify the Contractor of a pump failure or high water condition.

C. Pipe:

Pipe shall be of adequate size and capacity to match the pumps. Pipe type and materials will depend on the particulars of the site conditions, and shall be detailed in the Pumping Plan. Contractor will provide all connections.

PART 3 EXECUTION

3.01 SITE CONDITIONS

Site conditions will vary by site. Contractor is responsible to determine and address requirements such as traffic control, excavation, connections & fittings, impacts on access to adjacent properties, routing and support of by-pass piping, etc., in the Pumping Plan.

3.02 ON-SITE MONITORING

- A. All by-pass operations where the anticipated flow rates are 750 G.P.M or greater shall require an employee on-site at all times (full-time on-site monitoring attended by personnel experienced with the pumps and controls, with demonstrated ability to monitor, turn on & off, and switch between pumps while the by-pass pump system is in service.
- B. By-pass operations where the anticipated flow rates are less than 750 G.P.M may not require an employee on-site at all times while the by-pass pump system is in operation. The Contractor shall have personnel experienced with the pumps and controls on site within the calculated response time to prevent an SSO after a high water alarm.
- C. During by-pass operations, the Contractor shall have posted on site with the permit, a copy of the approved Plan and the name and 24 hour contact number of the primary response person, the job site superintendent, and the construction company owner.

3.03 OPERATIONS

- A. The Contractor is responsible for securing and providing power, fuel, site security, traffic control and all other supplies, materials and permits required for the by-pass pumping.
- B. Contractor shall demonstrate automatic pump switching and alarm system to the

satisfaction of: the County inspector, Project Manager, or Lift Stations Superintendent prior to beginning by-pass pumping. Satisfactory demonstration shall be documented by the inspector's, PM's or Lift Station Superintendent's dated signature on the posted copy of the approved Pumping Plan.

3.04 DAMAGE RESTORATION & REMEDIATION

- A. The Contractor shall be responsible for any pre-pump notifications, all restoration of pre-pump conditions and any damage caused by by-pass operations.
- B. Should there be an SSO caused by or as a direct result of the by-pass pumping, the contractor is responsible for all immediate & long term response, notifications, clean up, mitigation, etc. Copies of all written response plans, notifications, documentation, mitigation plans, etc., shall be submitted to the County Project Manager.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 02999

MISCELLANEOUS WORK AND CLEANUP

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. This Section includes items and operations which are not specified in detail as separate items, but may be sufficiently described as to the kind and extent of work involved. The Contractor shall furnish all labor, materials, equipment and incidentals necessary to complete all work under this Section.
- B. The work of this Section may include, but is not limited to the following:
1. Restoration of roads, sidewalks, driveways, curbing and gutters, fences, guardrails, lawns, shrubbery and any other existing items damaged or destroyed.
 2. Crossing utilities.
 3. Relocation of existing water, reclaim water, or sewer lines less than four inches diameter, water and sanitary sewer services, low pressure gas lines, telephone lines, electric lines, cable TV lines as shown on the Contract Drawings.
 4. Restoring easements (servitudes) and rights-of-way.
 5. Clean up.
 6. Incidental work (project photographs, testing, shop drawings, traffic control, record drawings, etc.).
 7. Excavation and Embankment - As defined in the Florida Department of Transportation Standard Specifications for Road and Bridge Construction (1991 Edition or latest revision).
 8. Stormwater and erosion control devices.

1.02 SUBMITTAL OF LUMP SUM BREAKDOWN

Contractor shall submit to the County, a breakdown of the lump sum bid for Miscellaneous Work and Cleanup Item in the Proposal within 10 days after date of Notice to Proceed.

1.03 WORK SPECIFIED UNDER OTHER SECTIONS

All work shall be completed in a workmanlike manner by competent workmen in full compliance with all applicable sections of the Contract Documents.

PART 2 PRODUCTS

2.01 MATERIALS

Materials required for this Section shall equal or exceed materials that are to be restored. The Contractor may remove and replace or reuse existing materials with the exception of paving.

PART 3 EXECUTION

3.01 RESTORING OF SIDEWALKS, ROADS, CURBING, FENCES AND GUARDRAILS

- A. The Contractor shall protect existing sidewalks & curbing. If necessary, sidewalks & curbing shall be removed from joint to joint and replaced after backfilling. Curbing damaged during construction because of the Contractor's negligence or convenience, shall be replaced with sidewalks & curbing of equal quality and dimension at no cost to the County.
- B. At the locations necessary for the Contractor to remove, store and replace existing fences and guardrails during construction, the sections removed shall be only at the direction of the County. If any section of fence is damaged due to the Contractor's negligence, it shall be replaced at no cost to the County with fencing equal to or better than that damaged and the work shall be satisfactory to the County.
- C. Guardrails in the vicinity of the work shall be protected from damage by the Contractor. Damaged guardrails shall be replaced in a condition equal to those existing
- D. Road crossings shall be restored in accordance with the Contract Documents and current FDOT Standards. Compensation for road restoration shall be included under the Road Restoration Bid Item if specified or under Miscellaneous Cleanup if it is not specified.

3.02 CROSSING UTILITIES

This item shall include any extra work required in crossing culverts, water courses, drains, water mains and other utilities, including all sheeting and bracing, extra excavation and backfill, or any other work required or implied for the proposed crossing, whether or not shown on the Drawings.

3.03 RELOCATIONS OF EXISTING GAS LINES, TELEPHONE LINES, ELECTRIC LINES AND CABLE TV LINES

The Contractor shall notify the proper utility involved when relocation of these utility lines is required. The Contractor shall coordinate all relocation work by the utility so that construction shall not be hindered.

3.04 RESTORING THE EASEMENTS AND RIGHTS-OF-WAY

The Contractor shall be responsible for all damage to private property due to his operations. He shall protect from injury all walls, fences, cultivated shrubbery, pavement, underground facilities, including water, sewer and reclaimed water lines and services, or other utilities which may be encountered along the easement. If removal and replacement is required, it shall be done in a workmanlike manner, at his expense, so that the replacement are equivalent to that which existed prior to construction.

3.05**STORMWATER AND EROSION CONTROL DEVICES**

The Contractor shall be responsible for, provide, and install all stormwater and erosion control devices necessary to insure satisfactory compliance with the Florida Department of Environmental Protection Stormwater, Erosion, and Sedimentation Control Inspector's Manual.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

DIVISION 3 CONCRETE

SECTION 03200

CONCRETE REINFORCEMENT

PART 1 GENERAL

1.01 WORK INCLUDED

- A. Reinforcing steel bars and welded steel wire fabric for cast-in-place concrete, complete with tie wire.
- B. Support chairs, bolsters, bar supports and spacers, for reinforcing.

1.02 QUALITY ASSURANCE

Perform concrete reinforcing work in accordance with ACI 318 unless specified otherwise in this Section.

1.03 REFERENCES

- A. ACI 318 - Building Code Requirements for Reinforced Concrete.
- B. ASTM A185 - Welded Steel Wire Fabric for Concrete Reinforcement.
- C. ASTM A615 - Deformed and Plain Billet Steel Bars for Concrete Reinforcement.
- D. CRSI 63 - Recommended practice for placing reinforcing bars.
- E. CRSI 65 - Recommended practice for placing bar supports, specifications and nomenclature.
- F. ACI 315 - American Concrete Institute - Manual of Standard Practice.

1.04 SHOP DRAWINGS

- A. Submit shop drawings in accordance with Contract Documents.
- B. Indicate bar sizes, spacings, locations and quantities of reinforcing steel and wire fabric, bending and cutting schedules and supporting and spacing devices.
- C. Manufacturer's Literature: Manufacturer's specifications and installation instructions for splice devices.

PART 2 PRODUCTS

2.01 REINFORCING

- A. Reinforcing steel: Grade 60, Minimum Yield Strength 60,000 psi, deformed billet steel bars, ASTM A615; plain finish.
- B. Welded steel wire fabric: Deformed wire, ASTM A497; smooth wire ASTM A185 in flat sheets; plain finish.

2.02 ACCESSORY MATERIALS

- A. Tie wire: Minimum 16 gauge annealed type, or patented system accepted by County.
- B. Chairs, bolsters, bar supports, spacers: Sized and shaped for strength and support of reinforcing during construction conditions.
- C. Special chairs, bolsters, bar supports, spacers (where adjacent to architectural concrete surfaces): Stainless steel type sized and shaped as required.

2.03 FABRICATION

- A. Fabricate concrete reinforcing in accordance with ACI 315.
- B. Locate reinforcing splices, not indicated on Drawings, at points of minimum stress. Location of splices shall be reviewed by County.
- C. Where indicated, weld reinforcing bars in accordance with AWS D12.1.

PART 3 EXECUTION

3.01 PLACEMENT

- A. Reinforcing shall be supported and secured against displacement. Do not deviate from true alignment.
- B. Before placing concrete, ensure reinforcing is clean, free of loose scale, dirt, or other foreign coatings which would reduce bond to concrete.

3.02 QUALITY ASSURANCE

- A. Acceptable Manufacturers: Regularly engaged in manufacture of steel bar and welded wire fabric reinforcing.
- B. Installer Qualifications: Three years experience in installation of steel bar and welded wire fabric reinforcing.
- C. Allowable Tolerances:
 - 1. Fabrication:
 - a. Sheared length: +1 in.
 - b. Depth of truss bars: +0, -1/2 in.
 - c. Stirrups, ties and spirals: $\pm 1/4$ in.
 - d. All other bends: ± 1 in.

2. Placement:
 - a. Concrete cover to form surfaces: $\pm 1/4$ in.
 - b. Minimum spacing between bars: 1 in.
 - c. Top bars in slabs and beams:
 - (1) Members 8 in. deep or less: $\pm 1/4$ in.
 - (2) Members more than 8 in.: $\pm 1/2$ in.
 - d. Crosswise of members: Spaced evenly within 2 in. of stated separation.
 - e. Lengthwise of members: Plus or minus 2 in.
3. Maximum bar movement to avoid interference with other reinforcing steel, conduits, or embedded items: 1 bar diameter.

3.04 PRODUCT DELIVERY, STORAGE AND HANDLING

- A. Deliver reinforcement to project site in bundles marked with metal tags indicating bar size and length.
- B. Handle and store materials to prevent contamination.

3.05 INSTALLATION

- A. Placement:
 1. Bar Supports: CRSI 65.
 2. Reinforcing Bars: CRSI 63.
- B. Steel Adjustment:
 1. Move within allowable tolerances to avoid interference with other reinforcing steel, conduits, or embedded items.
 2. Do not move bars beyond allowable tolerances without concurrence of County.
 3. Do not heat, bend, or cut bars without concurrence of County.
- C. Splices:
 1. Lap splices: Tie securely with wire to prevent displacement of splices during placement of concrete.
 2. Splice devices: Install in accordance with manufacturer's written instructions.
 3. Do not splice bars without concurrency of County, except at locations shown on Drawings.
- D. Wire Fabric:
 1. Install in longest practicable length.
 2. Lap adjoining pieces one full mesh minimum, and lay splices with 16 gauge wire.
 3. Do not make end laps midway between supporting beams, or directly over beams of continuous structures.
 4. Offset end laps in adjacent widths to prevent continuous laps.
- E. Cleaning: Remove dirt, grease, oil, loose mill scale, excessive rust, and foreign matter that will reduce bond with concrete.

- F. Protection During Concreting: Keep reinforcing steel in proper position during concrete placement.

END OF SECTION

SECTION 03300

CAST-IN-PLACE CONCRETE

PART 1 GENERAL

1.01 WORK INCLUDED

Poured-in-place concrete slabs, thrust blocks, pile caps and pipe support cradles.

1.02 QUALITY ASSURANCE

Perform cast-in-place concrete work in accordance with ACI 318, unless specified otherwise in this Section.

1.03 TESTING LABORATORY SERVICES

- A. Inspection and testing will be performed by the testing laboratory currently under contract to Manatee County in accordance with the Contract Documents.
- B. Provide free access to work and cooperate with appointed firm.
- C. Submit proposed mix design of each class of concrete to inspection and testing firm for review prior to commencement of work.
- D. Tests of cement and aggregates may be performed to ensure conformance with requirements stated herein.
- E. Three concrete test cylinders will be taken for every 100 cu. yds. or part thereof of each class of concrete placed each day. Smaller pours shall have cylinders taken as directed by the County.
- F. One slump test will be taken for each set of test cylinders taken.

1.04 REFERENCES

- A. ASTM C33 - Concrete Aggregates
- B. ASTM C150 - Portland Cement
- C. ACI 318 - Building Code Requirements for Reinforced Concrete
- D. ASTM C260 - Air Entraining Admixtures for Concrete
- E. ASTM C94 - Ready-Mixed Concrete
- F. ACI 304 - Recommended Practice for Measuring, Mixing, Transporting and Placing Concrete
- G. ACI 305 - Recommended Practice for Hot Weather Concreting

PART 2 PRODUCTS

2.01 CONCRETE MATERIALS

- A. Cement: Moderate-Type II, High early strength-Type III, Portland type, ASTM C150.
- B. Fine and Coarse Aggregates: ASTM C33.
- C. Water: Clean and free from injurious amounts of oil, alkali, organic matter, or other deleterious material.

2.02 ADMIXTURES

- A. Air Entrainment: ASTM C260.
- B. Chemical: ASTM C494 Type A - water reducing admixture.

2.03 ACCEPTABLE MANUFACTURERS

Acceptable Products:

- 1. Pozzolith
- 2. WRDA

2.04 ACCESSORIES

Non-shrink grout: Premixed compound consisting of non-metallic aggregate, cement, water reducing and plasticizing agents; capable of developing minimum compressive strength of 2400 psi in 2 days and 7000 psi in 28 days.

2.05 CONCRETE MIXES

- A. Mix concrete in accordance with ASTM C94.
- B. Provide concrete of following strength:
 - 1. Required concrete strengths as determined by 28 day cylinders shall be as shown on the Drawings, but shall not be less than 3000 psi.
 - 2. Select proportions for normal weight concrete in accordance with ACI 301 3.8 Method 1, Method 2, or Method 3. Add air entraining agent to concrete to entrain air as indicated in ACI 301 Table 3.4.1.
 - 3. All mixes shall be in accordance with FDOT Specifications.
- C. Use set-retarding admixtures during hot weather only when accepted by County.
- D. Add air entraining agent to concrete mix for concrete work exposed to exterior.

2.06 FORMS

- A. Forms shall be used for all concrete masonry, including footings. Form shall be so constructed and placed that the resulting concrete will be of the shape, lines, dimensions, appearance and to the elevations indicated on the Drawings.
- B. Forms shall be made of wood, metal, or other approved material. Wood forms shall be constructed of sound lumber or plywood of suitable dimensions, free from knotholes and loose knots; where used for expose surfaces, boards shall be dressed and matched. Plywood shall be sanded smooth and fitted with tight joints between panels. Metal forms shall be of an approved type for the class of work involved and of the thickness and design required for rigid construction.
- C. Edges of all form panels in contact with concrete shall be flush within 1/32-inch and forms for plane surfaces shall be such that the concrete will be plane within 1/16-inch in four feet. Forms shall be tight to prevent the passage of mortar and water and grout.
- D. Forms for walls shall have removable panels at the bottom for cleaning, inspection and scrubbing-in of bonding paste. Forms for walls of considerable height shall be arranged with tremies and hoppers for placing concrete in a manner that will prevent segregation and accumulation of hardened concrete on the forms or reinforcement above the fresh concrete.
- E. Molding or bevels shall be placed to produce a 3/4-inch chamfer on all exposed projecting corners, unless otherwise shown on the Drawings. Similar chamfer strips shall be provided at horizontal and vertical extremities of all wall placements to produce "clean" separation between successive placements as called for on the Plans.
- F. Forms shall be sufficiently rigid to withstand vibration, to prevent displacement or sagging between supports and constructed so the concrete will not be damaged by their removal. The Contractor shall be entirely responsible for their adequacy.
- G. Forms, including new pre-oiled forms, shall be oiled before reinforcement is placed, with an approved nonstaining oil or liquid form coating having a non-paraffin base.
- H. Before form material is re-used, all surfaces in contact with concrete shall be thoroughly cleaned, all damaged places repaired, all projecting nails withdrawn, all protrusions smoothed and in the case of wood forms pre-oiled.
- I. Form ties encased in concrete shall be designed so that after removal of the projecting part, no metal shall be within 1-inch of the face of the concrete. That part of the tie to be removed shall be at least 1/2-inch diameter or be provided with a wood or metal cone at least 1/2-inch in diameter and 1-inch long. Form ties in concrete exposed to view shall be the cone-washer type equal to the Richmond "Tyscru". Throughbolts or common wire shall not be used for form ties.

PART 3 EXECUTION

3.01 PLACING CONCRETE

- A. Place concrete in accordance with ACI 304.
- B. Notify County minimum 24 hours prior to commencement of concreting operations.
- C. Verify anchors, seats, plates and other items to be cast into concrete are placed, held securely and will not cause hardship in placing concrete. Rectify same and proceed with work.
- D. Maintain records of poured concrete items. Record date, location of pour, quantity, air temperature and test samples taken.
- E. Ensure reinforcement, inserts, embedded parts, formed expansion and contraction joints are not disturbed during concrete placement.
- F. Prepare previously placed concrete by cleaning with steel brush and applying bonding agent. Apply bonding agent in accordance with manufacturer's recommendations.
- G. Pour concrete continuously between predetermined construction and control joints. Do not break or interrupt successive pours such that cold joints occur.
- H. In locations where new concrete is dowelled to existing work, drill holes in existing concrete, insert steel dowels and pack solidly with non-shrink grout.
- I. Excessive honeycomb or embedded debris in concrete is not acceptable. Notify County upon discovery.
- J. Conform to ACI 305 when concreting during hot weather.

3.02 SCREEDING

Screed surfaces level, maintaining flatness within a maximum deviation of 1/8" in 10 feet.

3.03 PATCHING

Allow County to inspect concrete surfaces immediately upon removal of forms. Patch imperfections as directed. All patching procedures shall be submitted to and approved by the County prior to use.

3.04 DEFECTIVE CONCRETE

- A. Modify or replace concrete not conforming to required lines, details and elevations.
- B. Repair or replace concrete not properly placed resulting in excessive honeycomb and other defects. Do not patch, fill, touch-up, repair, or replace exposed architectural concrete except upon express direction of County for each individual area.

3.05 CONCRETE FINISHING

Provide concrete surfaces to be left exposed, columns, beams and joists with smooth rubbed finish.

3.06 CURING AND PROTECTION

Beginning immediately after placement, protect concrete from premature drying, excessively hot or cold temperatures and mechanical injury. Maintain concrete with minimal moisture loss at relatively constant temperature for a period of 7 days or until concrete strengths reaches 75% of the 28 day design strength.

Protection against moisture loss may be obtained with spray on curing compounds or plastic sheets. Protection against heat or cold may be obtained with insulated curing blankets or forms.

3.07 CONCRETE DRIVEWAY RESTORATION

Concrete driveways shall be restored with 6 inches of 3,000 psi concrete with W2.5 X W2.5, 6X6 wire mesh. Place ½ inch expansion joint between back of curb and new concrete. Area beneath restoration shall be mechanically tamped prior to placing concrete.

3.08 CONCRETE SIDEWALK RESTORATION

Concrete sidewalks across driveways shall be restored with 6 inches of 3,000 psi concrete with W2.5 X W2.5, 6X6 wire mesh. Place ½ inch expansion joint between back of curb and new concrete. Area beneath restoration shall be mechanically tamped prior to placing concrete.

Concrete sidewalks outside of driveways shall be restored with 4 inches of 3,000 psi concrete per FDOT Design Standards, Sections 522 & 310

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 03350

CONCRETE FINISHES

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish all labor, materials, equipment and incidentals required to finish cast-in-place concrete surfaces as specified herein.

1.02 SUBMITTALS

Submit to the County as provided in the Contract Documents, the proposed chemical hardener manufacturer's surface preparation and application procedures.

1.03 SCHEDULE OF FINISHES

- A. Concrete for the Project shall be finished in the various specified manners either to remain as natural concrete or to receive an additional applied finish or material under another Section.
- B. The base concrete for the following conditions shall be finished as noted and as further specified herein:
 - 1. Exterior, exposed concrete slabs and stairs - broomed finish.
 - 2. Interior, exposed concrete slabs - steel trowel finish.
 - 3. Concrete on which process liquids flow or in contact with sludge - steel trowel finish.
 - 4. Concrete where not exposed in the finished work and not scheduled to receive an additional applied finish or material - off-form finish.
 - 5. Provide concrete surfaces to be left exposed such as walls, columns, beams and joists with smooth rubbed finish.

1.04 RESPONSIBILITY FOR CHANGING FINISHES

- A. The surface finishes specified for concrete to receive additional applied finishes or materials are the finishes required for the proper application of the actual products specified under other Sections. Where different products are approved for use, it shall be the Contractor's responsibility to determine if changes in finishes are required and to provide the proper finishes to receive these products.
- B. Changes in finishes made to accommodate product different from those specified shall be performed at no additional cost to the County. Submit the proposed new finishes and their construction methods to the County for approval.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Portland cement and component materials required for finishing the concrete surfaces shall be as specified in the Contract Documents.
- B. Hardener shall be Lapidolith as manufactured by Sonneborn Building Products or approved equal. Hardener shall be used on all floors, stair treads and platforms.

PART 3 EXECUTION

3.01 FORMED SURFACES

- A. Forms shall not be stripped before the concrete has attained a strength of at least 50 percent of the ultimate design strength. This is equivalent to approximately five "100 day-degrees" of moist curing.
- B. Care shall be exercised to prevent damaging edges or obliterating the lines of chamfers, rustications, or corners when removing the forms or doing any work adjacent thereto.
- C. Clean all exposed concrete surfaces and adjoining work stained by leakage of concrete, to the satisfaction of the County.
- D. Off-form finish. Fins and other projections shall be removed as approved. Tie cone holes and other minor defects shall be filled with non-shrink grout specified under the Contract Documents.

3.02 FLOORS AND SLABS

- A. Floors and slabs shall be screeded to the established grades and shall be level with a tolerance of 1/8-inch when checked with a 10 foot straight edge, except where drains occur, in which case floors shall be pitched to drains as indicated. Failure to meet either of above shall be cause for removal, grinding, or other correction as approved by the County.
- B. Following screeding as specified above, power steel trowel as follows:
 - 1. Immediately after final screeding, a dry cement/sand shake in the proportion of 2-sacks of portland cement to 350-pounds of coarse natural concrete sand shall be sprinkled evenly over the surface at the rate of approximately 500 pounds per 1,000 square feet of floor. Neat, dry cement shall not be sprinkled on the surface. This shake shall be thoroughly floated into the surface with an approved disc type power compacting machine weighing at least 200 pounds if a 20-inch disc is used or 300 pounds if a 24-inch disc is used (such as a "Kelly Float" as manufactured by the Weisner-Rapp Corporation of Buffalo, New York). A mechanical blade-type float or trowel is not acceptable for this work.
NOTE: This operation (application of the cement/sand shake) may be eliminated at the discretion of the County if the base slab concrete exhibits adequate fattiness and homogeneity.
 - 2. In lieu of power steel troweling, small areas as defined by the County shall be compacted by hand steel troweling with the dry cement/sand shake as ordered.
 - 3. The floor or slab shall be compacted to a smooth surface and the floating operation continued until sufficient mortar is brought to the surface to fill all voids. The surfaces shall be tested with a straight edge to detect high and low spots which

- shall be eliminated.
4. Compaction shall be continued only until thorough densification is achieved and a small amount of mortar is brought to the surface. Excessive floating shall be avoided.
- C. After Paragraph 3.02 A and B procedures are accomplished, floors and slabs for particular conditions shall be completed as scheduled in one of the following finishes:
1. Wood float finish. Hand wood float, maintaining the surface tolerance to provide a grained, nonslip finish as approved.
 2. Broomed finish. Hand wood float maintaining the surface tolerance and then broom with a stiff bristle broom in the direction of drainage to provide a nonslip finish as approved.
 3. Steel trowel finish. Hand steel trowel to a perfectly smooth, hard even finish free from high or low spots or other defects as approved.
- D. Floors, stair treads and platforms shall be given a floor hardener. Application shall be according to manufacturer's instructions.

3.03 APPROVAL OF FINISHES

- A. All concrete surfaces will be inspected during the finishing process by the County.
- B. Surfaces which, in the opinion of the County, are unsatisfactory shall be refinished or reworked until approved by the County.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 03410

PRECAST CONCRETE STRUCTURES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all materials, labor and equipment and construct valve vaults, meter vaults, concrete pipe and accessory items, consisting of precast sections as shown on the Drawings and as specified herein.
- B. The forms, dimensions, concrete and construction methods shall be approved by the County in advance of construction.
- C. These Specifications are intended to give a general description of what is required, but do not purport to cover all of the structural design details which will vary in accordance with the requirements of the plans. It is, however, intended to cover the furnishing, shop testing, delivery and complete installation of all precast structures whether specifically mentioned in these Specifications or not.
- D. The supplier of the precast items shall coordinate his work with that of the Contractor to insure that the units will be delivered and installed in the excavation provided by the Contractor, in accordance with the Contractor's construction schedule.
- E. The Contractor will ensure coordination of the precast structures fabrication with the supplier to achieve the proper structural top slab openings, spacings and related dimensions for the selected equipment frames and covers. The top slabs, frames, covers, and subsurface structures outside of roadways shall be capable of live load of 300 pounds per square foot unless noted otherwise.
- F. All interior surfaces of valve vaults and meter vaults shall be painted with two coats of coal tar epoxy paint dry film thickness of 8 mils each coat, as approved by the County.

1.02 SUBMITTALS

- A. Submit to the County in accordance with the Contract Documents, shop drawings showing details of construction, reinforcing, and joints.
- B. Shop Drawings
 - 1. Content
 - a. Dimensions and finishes.
 - b. Estimated camber.
 - c. Reinforcing and connection details.
 - d. Lifting and erection inserts.
 - e. Other items cast into members.
 - 2. Show location of unit by same identification mark placed on member.
 - 3. Include design calculations.

- C. Manufacturer's Literature: Manufacturer's recommended installation instructions.
- D. Manufacturer's certificates of material conformance with Specifications.
- E. Test Reports: Reports of tests on concrete. A minimum of three compression test cylinders will be required for each pour.

1.03 INSPECTION

- A. The quality of all materials, the process of manufacture and the finished sections shall be subject to inspection and approval by the County, or other representatives of the County. Such inspection may be made at the place of manufacture, or at the site after delivery, or at both places and the sections shall be subject to rejection at any time due to failure to meet any of the Specification requirements; even though sample sections may have been accepted as satisfactory at the place of manufacture. Sections rejected after delivery to the project site shall be marked for identification and shall be removed from the project site at once. All sections which have been damaged after delivery will be rejected and if already installed, shall be acceptably repaired, if permitted, or removed and replaced entirely at the Contractor's expense.
- B. At the time of inspection, the sections will be carefully examined for compliance with the applicable ASTM designation and these Specifications and with the approved manufacturer's drawings.
 - 1. All sections shall be inspected for general appearance, dimension, "scratch-strength", blisters, cracks, roughness, soundness, etc. The surface shall be dense and close-textured.
 - 2. All sections shall meet the manufacturing tolerance requirements of ASTM C-478 or the following casting tolerances, whichever are more severe:

Wall Thickness	$\pm 3/8"$
Inside Diameter	$\pm 3/8"$
Outside Diameter	$\pm 1/2"$
Height or Length	$\pm 3/8"$
- C. Imperfections may be repaired, subject to the approval of the County, after demonstration by the manufacturer that strong and permanent repairs result. Repairs shall be carefully inspected before final approval. Cement mortar used for repairs shall have a minimum compressive strength of 4,000 psi at the end of 7 days and 5,000 psi at the end of 28 days, when tested in 3-inch by 6-inch cylinders stored in the standard manner. Epoxy mortar may be utilized for repairs subject to the approval of the County.

PART 2 PRODUCTS

2.01 PRECAST CONCRETE SECTIONS

- A. Joints between precast concrete sections shall be set by plastic shims and filled with non-metallic non-shrink grout as specified in the Contract Documents and shown on the Drawings.

- B. The top slab sections shall be fitted with water tight hatches as specified in the Construction Drawings. The frames and covers will be sized for the openings shown on the Contract Drawings.
- C. The various precast sections shall have the inside dimensions and minimum thickness of concrete as indicated on the Drawings. All precast and cast-in-place concrete members shall conform to the Building Code Requirements for Reinforced Concrete ACI 318 and applicable ASTM Standards.
- D. Fillets shall be provided and installed in the wet wells as shown on the Drawings. They shall be constructed using concrete fill and shall conform to the Contract Documents.
- E. Precast structures shall be constructed to the dimensions as shown on the Drawings and as specified in these Specifications. Flow channels, inverts, and benches in manholes shall be precast, not constructed after installation. Provide a true curve of the largest radius possible for changes in direction of sewer and entering branch or branches.
- F. Type II cement shall be used, typically at a compressive strength of 4,000 psi, except as otherwise approved.
- G. The date of manufacture and the name or trademark of the manufacturer shall be clearly marked on the inside of each precast section.
- H. Sections shall be cured by an approved method and shall not be shipped until at least seven (7) days after having been fabricated.
- I. Each precast section manufactured in accordance with the Drawings shall be clearly marked to indicate the intended installation location. The Contractor shall be responsible for the installation of the correct precast sections in their designated locations.
- J. Wet wells, and manholes receiving flow from lift stations shall be precast with a cast in place PVC protective liner.
 - 1. The prefabricated wetwell or manhole liner shall be a non-load bearing component installed and adequately anchored inside a new precast concrete wetwell or manhole riser during the concrete casting process at the concrete precaster's manufacturing facility. The liner must be fully supported during the casting process.
 - 2. The liners shall be resistant to the chemical environment normally found in the gravity wastewater transmission systems to which they will be exposed.
 - 3. The liner shall have a warranty against defect in material and workmanship for a period of three years.
 - 4. After assembly and installation, in the field, all internal seams are to be sealed by bonding or welding per the manufacturer's standard method and details.
 - 5. Any repairs or other modifications to the liner, such as patching or sealing PVC sleeves used for pipe penetrations of the structure, shall sealed by bonding or welding per the PVC liner manufacturer's standard methods and details.

PART 3 EXECUTION

3.01 INSTALLATION

- A. The Contractor shall be responsible for handling ground water to provide firm, dry subgrade for the structure, shall prevent water rising on new poured-in-place concrete or grouted joint sections within 24 hours after placing and shall guard against flotation or other damage resulting from ground water or flooding.
- B. A minimum of an 8-inch shell base compacted layer of washed shell or crushed stone shall be placed as a foundation for the wet well base slabs and valve and/or meter vault pits.
- C. Backfill materials around the wet well and above the pipe bedding shall be select material as specified in the Contract Documents.
- D. Precast bases, conforming to all requirements of ASTM C478 and above listed requirements for precast sections, may be used.
- E. The structure shall not be set into the excavation until the installation procedure and excavation have been approved by the County.
- F. The base may be cast-in-place concrete placed on a thoroughly compacted crushed rock subbase. The tops of the cast-in-place bases shall be shaped to mate with the precast barrel section and shall be adjusted in grade so that the top slab section is at the approximately correct elevation.
- G. Precast concrete structure sections shall be set so as to be vertical and with sections in true alignment with a 1/4-inch maximum tolerance to be allowed. The outside and inside joint shall be filled with a non-shrink grout and finished flush with the adjoining surfaces. Allow joints to set for 24 hours before backfilling. Backfilling shall be done in a careful manner, bringing the fill up evenly on all sides. The Contractor shall install the precast sections in a manner that will result in a watertight joint. Leaking joints are not acceptable.
- H. Holes in the concrete sections required for handling or other purposes shall be plugged with a non-shrink grout or by grout in combination with concrete plugs.
- I. Where holes must be cut in the precast sections to accommodate pipes, cutting shall be done prior to setting them in place to prevent any subsequent jarring which may loosen the mortar joints.
- J. Frames and hatches specified and furnished shall be cast in the cover slab prior to setting. Normal installation shall include 6" to 12" of concrete grade rings between the top of the cone section and the cover plate ring slab.

ASTM A48-74, or most recent revision, Specification for Gray Iron Castings, Class 30 or Grade 60-45-10 Ductile Iron meeting the requirements of ASTM A536-72, or most recent revision, Specification for Ductile Iron Castings. Cast in a true symmetrical pattern of tough, dense and even grained iron, free from warping, scales, lumps, blisters, sandholes, or any defects of any kind. Provide indented pattern lids with lettering as shown on the

Drawings. Machine or grind frames and lids at touching surfaces to provide firm seats and prevent rocking. Remove and replace any set not matching perfectly. All frames and covers shall be designed to withstand an HS20-44 wheel loading as defined by AASHTO specifications.

- K. Manhole inserts: Watertight manhole inserts shall be required for all sanitary sewer manholes installed. Inserts shall be as manufactured by FRW Industries, Conroe, Texas, or approved equal. Inserts shall be complete with a self-cleaning relief valve. Relief valves shall operate on a pressure differential of 1/2 psi. Neoprene gaskets shall be installed under the insert lip to insure a leakproof seal.
- L. Penetrations and connections into precast or existing structures shall be accomplished by rotary core boring.
- M. Cast in place liners shall be repaired, fitted around penetrations, sealed at joints, etc. in accordance with the manufacturer's recommendations for that liner. As a general rule, repairs, sleeves and patches shall be welded in place, glues and sealants shall not be used unless approved by the manufacturer.

3.04 TESTING

- A. After constructed to its finished height and before being backfilled, each manhole shall be tested for water tightness.
 - 1. Plug pipe lines and perform vacuum test. Observing all recommended safety measures induce a backpressure of 5.0 p.s.i. equivalent to 10" Hg (mercury). The manhole assembly is considered satisfactory if the vacuum loss is less than 1" Hg for the length of time listed in the following table:

Time of Test in Seconds			
Depth Feet	Manhole Diameter in Feet		
	4	5	6
4	10	13	16
8	20	26	32
12	30	39	48
16	40	52	64
20	50	65	80
24	60	78	96
T	5	6.5	8

Note: Add "T" seconds for each additional 2'- of depth.

- B. Failure to pass this test requires the Contractor to correct the problems and retest. The

Contractor will replace leaking gaskets and/or concrete sections and retest the completed manhole. No manhole will be accepted without successfully passing this test.

END OF SECTION

DIVISION 4 MASONRY

SECTION 04220

MASONRY

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, materials, equipment and incidentals required to construct all masonry work as shown on the Drawings and specified herein.
- B. The work under this Section includes, but is not necessarily limited to the following:
 - 1. Concrete masonry units (CMU), including decorative masonry block.
 - 2. Reinforced CMU lintels.
 - 3. Masonry reinforcing, ties and anchors.
 - 4. Grouting required throughout the project.

1.02 SAMPLES

- A. Submit two samples each of concrete masonry units.
- B. Submit two samples of decorative, masonry block.
- C. Before commencing with the laying of any architectural masonry, construct on the site, where directed by the County, a sample 6 x 4 foot wall panel showing type and tooling of mortar and bond, for the County's approval. This sample wall shall remain in place for the duration of the masonry work. Remove sample panel at the completion of the work as directed by the County.

1.03 PROTECTION OF MATERIALS

- A. All perishable materials for the work of this Section shall be delivered, stored and handled so as to preclude damage of any nature. Manufactured materials, such as cement and lime, shall be delivered and stored in their original container, plainly marked with identification of material and maker. Materials in broken containers or in packages showing water marks or other evidence of damage, shall not be used and shall be removed from the site.

All masonry shall be shipped stacked with hap or straw protection or other suitable protective device, and shall be similarly stacked off the ground on the site. In addition, all masonry stored on the site shall be protected from the weather and staining with the use of tarpaulins or other covering approved by the County.

1.04 COLD WEATHER CONSTRUCTION

Masonry construction in cold weather shall conform to the applicable requirements of "Construction and Protection Recommendations for Cold Weather Masonry Construction" of the Technical Notes on Brick and Tile Construction by the Brick Institute of America.

PART 2 PRODUCTS

2.01 MATERIALS - MASONRY

A. Concrete Masonry Units:

1. Standard and light weight concrete masonry units (CMU) shall conform to ASTM C-90, Grade N, Type I, two cell hollow, load bearing units of 8" x 16" nominal face size and bed dimension as shown on the Drawings. Masonry prism strength f'm shall be as shown on the drawings, but not less than 1250 psi.
2. CMU shall be free from substances that will cause staining for at least 18 hours and then air cured in covered storage for not less than 28 days before delivery. Units shall have a maximum linear drying shrinkage of 0.25 percent (ASTM C-426) and have a moisture content at time of delivery not exceeding 30 percent of total absorption.
3. CMU noted as fire-rated on the Drawings shall conform to Underwriters Laboratories, Inc., Standard for Concrete Masonry Units UL618, and shall have two (2) hour fire resistant rating.
4. All split rib CMU shall have 7-1/2 equally spaced 3/4-inch deep x 3/4-inch wide bevels. The projected face shall have a rough texture. Units shall be laid in horizontal stack bond.
5. Units shall be obtained from one manufacturer to insure even color and texture.
6. Provide special units required by the Drawings, including solid, corner, pilaster, lintels, and jamb units.
7. Decorative masonry block units shall be similar in quality to Number 1210, DeMaco Concrete Products, Sarasota, FL, or equal. Design pattern to be as shown on the Drawings.

- B. Acoustic concrete masonry units shall be Soundblox, Type R by the Proudfoot Company or equal. Units shall be fabricated on standard block machines using manufacturer's special molds; shall have a closed top and ends and slotted exposed face; shall have a noise reduction coefficient range (NRC) of 0.50 - 0.60 for Type R; and shall comply with ASTM-C90 for load bearing masonry units. Color of the Soundblox and mortar shall match interior color which will be submitted to the County. The Soundblox installation shall be laid in horizontal stackbond with flush joints.

2.02 REINFORCING, TIES, ANCHORS AND MISCELLANEOUS

- A. Reinforcing shall be welded wire units prefabricated in straight lengths of not less than 10 feet with matching corner and tee units fabricated from cold-drawn steel wire complying with ASTM-A82, with deformed continuous side rods and plain cross-rods, crimped for cavity wall construction, if required, and a unit width of 1-1/2 inches to 2 inches less than thickness of wall or partition. Reinforcement for decorative masonry block shall be 2 inches wide. Reinforcement shall be placed at every third course (24" o.c.).
- B. Single width reinforcement shall be truss type, fabricated with single pair of galvanized 9 gauge side rods and continuous 9 gauge cross-rods spaced not more than 16 inches on center.
- C. Galvanized dove-tailed anchor slots with anchors at 24 inches on center shall be furnished for anchorage to concrete framework or walls.

- D. Approved 16-gauge corrugated non-ferrous metal ties manufactured for use with the anchor slots provided shall be spaced at a maximum of 8 inches o.c. vertically and 30 inches o.c. horizontally.
- E. The Contractor shall provide and install miscellaneous anchors and attachment members, required both for the anchorage of his own work and that of other trades requiring attachment to masonry, which are not specifically provided under separate sections.
- F. Control joints shall be factory extruded preformed rubber gaskets conforming to ASTM D-2000 2AA-205 and shall be as manufactured by Dur-O-Wal, Hohmann and Bernard, Inc., AA Wire Products or equal. Control joints shall be installed as shown on the Drawings.
- G. Weep holes shall be 1/4-inch O.D. by 4 inches long, clear plastic tubing that will not stain brickwork, by Hohmann and Barnard, Inc. or equal.
- H. Cleaning compound shall be mild, non-caustic detergent solution such as 801 Super Real Clean by Superior Manufacturing Co., or 600 Sureclean by Process Solvent Co., Inc., or equal.

2.03 MORTAR MATERIALS

- A. Portland cement shall conform to ASTM C150 Type II. Masonry cements to be used when specifically approved for colored mortar.
- B. Lime for masonry mortar shall be hydrated, conforming to ASTM C207, Type S.
- C. Sand shall be clean, durable particles, free from injurious amounts of organic matter. The sand shall conform to the limits of ASTM C144. Sand for grout shall conform to ASTM C144 or C33 as required.
- D. Water shall be free from injurious amounts of oils, acids, alkalis or organic matter, and shall be clean and fresh.
- E. Mortar proportions shall conform to ASTM C270, Type M, or as otherwise approved by the County. Ingredients shall be accurately measured by volume in boxes especially constructed for the purpose by the Contractor. Measurement by shovel will not be allowed.
- F. Grout for setting bearing plates, machinery, or any other equipment shall be mixed as recommended by the manufacturer to give the necessary consistency for placing and to give a minimum compressive strength (ASTM C-109) of 5000 psi at 7 days.
- G. All other grout shall be 1 part Portland cement and 1 part sand with a maximum aggregate size of 3/8 inch pea rock and a minimum comprehensive strength of 3000 psi in 28 days.
- H. Non-shrink non-metallic grout shall be 5 star grout as manufactured by the U.S. Grout Corp., or equal and be used in strict accordance with the manufacturer's instructions for the use intended.

2.04 FACE BRICK

Non-load bearing burned clay or shale. Size, color and texture to match existing and as approved by the County.

PART 3 EXECUTION

3.01 MORTAR

- A. Mortar shall be machine mixed in an approved type of mixer in which the quantity of water can be accurately and uniformly controlled. The mixing time shall not be less than five minutes, approximately two minutes of which shall be for mixing the dry materials and not less than three minutes for continuing the mixing after the water has been added. Where hydrated lime is used for mortar requiring a lime content, the Contractor will have the options of using the dry-mix method or first converting the hydrated lime into a putty.
- B. All CMU shall be laid in a full bed of mortar, applied to shells only. Butter the vertical joint of unit already set in the wall and all contact faces of the unit to be set. Each unit shall be placed and shoved against the unit previously laid so as to produce a well-compacted vertical mortar joint for the full shell thickness. Units shall set with all cells in a vertical position. The moisture content of the units when laid shall not exceed 35 percent of the total absorption as determined by laboratory test. Decorative masonry units shall be laid in a full bed of mortar on all four sides.
- C. All masonry units shall be laid in stretcher (running) bond unless otherwise shown. Tool dense and neat.
- D. Sizes shall be specified and called for on the Drawings, and where "Soaps" and "Splits" are used, the space between these members and the backup material shall be slushed full of mortar.
- E. Joints of all masonry shall be tooled in accordance with the following:
 - 1. Wait until unit mortar is thumbprint hard before tooling joint. This may require as much as three hours in the shade and one hour in the sun in the summertime.
 - 2. The required personnel of the Contractor shall be kept on the job after hours, if necessary, to properly tool joints.
 - 3. Both vertical and horizontal joints shall be maintained uniform in spacing.
 - 4. Joints for CMU shall be 3/8 inch.
 - 5. Joints for structural block shall be 1/4 inch.
- F. Install all frames required to be set in masonry, set masonry tightly against frames, build in all frame anchors, and fill frames solid with mortar.
- G. Control joints shall be installed at the intersection of masonry walls with structural concrete and elsewhere as detailed on the Drawings. Joints shall be raked out to a depth of 3/4 inch for the full height of the wall suitable for caulking. The maximum length, horizontally, between vertical control joints shall be 40 ft., but joints shall be located only as directed or shown. Joints shall be equal in width to the standard mortar joint.
- H. All masonry slots, chases, or openings required for the proper installations of the work of

other Section shall be constructed as indicated on the Drawings or in accordance with information furnished before the work is started at the point affected. No chase shall cut into any wall constructed of hollow units after it is built, except as directed and approved by the County.

- I. Surfaces shall be brushed as work progresses and maintained as clean as it is practicable. Unfinished work shall be raked back where possible, and toothed only where absolutely necessary. Before leaving fresh or unfinished work, walls shall be fully covered and protected against rain and wind and before continuing work previously laid shall be swept clean. To tops of walls or other unfinished work shall be protected against all damage by frost or the elements by means or waterproof paper, tarpaulins, boards or other means approved by the County.
- J. The Contractor shall build-in all miscellaneous items to be set in masonry for which placement is not specifically provided under separate Divisions, including reglets, lintels, ties, electrical panel boxes, sleeves, vents, grilles, anchors, grounds, and exterior electric conduits and fixtures, and shall cooperate with other trades whose work is to be coordinated with the work under this Section.
- K. All anchorage, attachment, and bonding devices shall be set so as to prevent slippage and shall be completely covered with mortar or grout.
- L. All ties and reinforcing for masonry shall be furnished and installed by the Contractor.
- M. Loose steel lintels shall be as shown on drawings and installed under this Section.
- N. Loose lintels shall be set in full bed or mortar and supported by solid or mortar filled hollow concrete blocks as detailed on the Drawings.
- O. Bed and grout all steel, for equipment and machinery, and items coming in contact with masonry where grouting is required, including door bucks and frames set in masonry. The Contractor shall install all anchor bolts, base plates, and seats in masonry walls, and build-in all items required for the completion of the building as they apply to masonry.

3.03 REINFORCED MASONRY

- A. Provide vertical reinforcing in filled cores of masonry units of size, spacing and locations as indicated on the Drawings and specified herein. Unless otherwise shown on the Drawings, vertical reinforcing at all exterior infill walls shall be No. 4 bars as specified in the Contract Documents and shall be placed 8'-0" on center, and vertical reinforcing at all exterior free standing walls shall be No. 5 bars placed at each corner, each opening and not greater than 8'-0" centers along straight runs.
- B. All cores containing reinforcing shall be filled, full height, with 3/8" pump mix concrete f'c = 2,500 psi with a slump of not less than 6 inches nor more than 8 inches.

3.04 CLEANING

- A. All holes in exposed masonry shall be pointed, and defective joints shall be cut out and repointed with mortar of same color as that of the original and adjoining work.

- B. Exposed masonry shall be protected against staining by wall coverings, and excess mortar shall be wiped off the surface as the work progressed.
- C. All masonry shall be cleaned with approved detergent solution in accordance with manufacturer's printed directions. No acid or metal scrapers shall be used on masonry.
- D. Before applying any cleaning agent to the entire wall, it shall be applied to a sample wall area of approximately 20 square feet in a location approved by the County. No further cleaning work may proceed until the sample area has been approved by the County, after which time the same cleaning materials and method shall be used on the remaining wall area.

3.05

WALL FLASHING

- A. Fabric wall flashing shall be installed above and below all openings in exterior masonry, at intersection of floors with exterior walls, and elsewhere as shown or noted on the Drawings. It shall be furnished and installed as shown on the Drawings.

END OF SECTION

DIVISION 5 METALS

SECTION 05500

MISCELLANEOUS METAL

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, equipment and incidentals required and install covers, grates, frames and other miscellaneous metals as shown on the Drawings and specified herein. The miscellaneous metal items include but are not limited to the following:
1. All metal frames, ladders, stairs, stair rails, floor opening frames including gratings and supports.
 2. Prefabricated access hatches and frames.
 3. Anchors and anchor bolts except those specified to be furnished with all equipment.
 4. Railings, posts and supports both interior and exterior.
 5. Cast iron frames, covers, grates, drain leaders and drains.
 6. Bridge crane track supports.
 7. Stair nosings, steel plates, overhead steel door frames, angle frames, plates and channels.
 8. Exterior H.V.A.C. hoods.
 9. Pump guide rail system.

1.02 COORDINATION

- A. The work in this Section shall be completely coordinated with the work of other Sections. Verify at the site both the dimensions and work of other trades adjoining items of work in this Section before fabrication and installation of items herein specified.
- B. Furnish to the pertinent trades all items included under this Section that are to be built into the work of other Sections.

1.03 SHOP DRAWINGS AND SAMPLES

- A. Detail drawings, as provided for in the Contract Documents, showing sizes of members, method of assembly, anchorage, and connection to other members shall be submitted to the County for approval before fabrication.
- B. Samples shall be submitted at the request of the County for concurrent review with Shop Drawings.

1.04 FIELD MEASUREMENTS

- A. Field measurements shall be taken at the site to verify or supplement indicated dimensions and to insure proper fitting of all items.

1.05 REFERENCED SPECIFICATIONS

A. Unless otherwise specified, materials shall conform to the following:

Structural Steel	ASTM A36
Welded & Seamless Steel Pipe	ASTM A53
Gray Iron Castings	ASTM A48, Class 30
Galvanizing, general	ASTM A123
Galvanizing, hardware	ASTM A153
Galvanizing, assemblies	ASTM A386
Aluminum (Extruded Shapes)	6061-T6 (Alum. alloy)
Aluminum (Extruded Pipe)	6061-T6 (Alum. alloy)
Aluminum Bar Structural	6061-T6 (Alum. alloy)
Bolts and Nuts	ASTM, A307
Stainless Steel Bolts, Fasteners	AISI, Type 316
Stainless Steel Plate and Sheet, Wire	AISI, Type 316
Welding Rods for Steel	AWS Spec. for Arc Welding

PART 2 PRODUCTS

2.01 ANCHORS, BOLTS AND FASTENING DEVICES

- A. Anchors, bolts, etc., shall be furnished as necessary for installation of the work of this Section.
- B. Compound masonry anchors shall be of the type shown or required and shall be equal to Star Slug in compounded masonry anchors manufactured by Star Expansion Industries, equal by Phillips Drill Co., Rawlplug, or equal. Anchors shall be minimum "two unit" type.
- C. The bolts used to attach the various members to the anchors shall be the sizes shown or required. Stainless steel shall be attached to concrete or masonry by means of stainless steel machine bolts and iron or steel shall be attached with steel machine bolts unless otherwise specifically noted.
- D. For structural purposes, unless otherwise noted, expansion bolts shall be Wej-it "Ankr-Tite", Phillips Drill Co. "Wedge Anchors", or Hilti "Kwik-Bolt". When length of bolt is not called for on the Drawings, the length of bolt provided shall be sufficient to place the wedge portion of the bolt a minimum of 1-inch behind the reinforcing steel within the concrete. Material shall be as noted on the Drawings. If not listed, all materials shall be stainless steel.

2.02 ALUMINUM ITEMS

- A. Aluminum gratings shall be of serrated I-Bar Aluminum Alloy 6061-T6, fabricated to the depths and thicknesses shown on the Drawings and shall be Reliance Steel Products Company, I-Lok Type 7/8 R4 Aluminum Grating; IKG Industries, "Galok" Aluminum I-Bar Grating Type S194-I, or equal. All openings 2 inches and greater in diameter shall be banded with a bar of the same depth and thickness as the main bearing bars of the grating, or furnished with continuous cross bridges. Each cut bar shall be welded to the band if banding is utilized. The ends of all grating sections shall be likewise banded.

Clamps and bolts used for attaching grating to supporting members shall be stainless steel. All grating shall be clamped unless noted otherwise. Clamps shall be as recommended by the manufacturer.

- B. Stair treads shall be as specified above for grating and shall have abrasive nonslip nosing.
- C. Aluminum nosing at concrete stairs shall be an extrusion of 4-inch minimum width with abrasive filled and shall be Wooster Products, Inc., Alumogrit Treads, Type 116; equal by Barry Pattern and Foundry Co.; Andco; or equal. Embedded anchors shall be furnished with a minimum of three anchors per tread.
- D. Aluminum ladders shall be fabricated to the dimensions and details and installed as shown on the Drawings. Treads to be of cast aluminum by Dixie Metals, Inc. of Fort Lauderdale, Florida or equal.
- E. Aluminum Handrails, Mechanically Fastened Type:
 - 1. All aluminum mechanically fastened type pipe handrails and guardrails shall be clear anodized aluminum finish and installed as specified herein and indicated on the Drawings. Handrails shall be made of nominal 1-1/2 inches inside diameter pipe (Schedule 40) fabricated or seamless 6063-T6 alloy. The supplier of the handrail system shall supply all necessary fittings, rackets, transition, corner and connector pieces, toeboards, protective gaskets, etc., for a complete job at the locations, indicated on the Drawings. All mounting hardware including bolts, studs, nuts, etc., shall be stainless steel Type 316. Bends shall be smooth and accurate to the details shown. Railings shall be the "Rigid Rail System" as manufactured by Reynolds Aluminum of Reynolds Metal Company as Reynolds II pipe railing system or the "Connectorail System" as manufactured by Julius Blum & Co., Inc., Carlstadt, New Jersey. The handrail systems shall comply with all OSHA and D Section 1208.2 of the Standard Building Code.
 - 2. Spacing of posts where posts are required shall be as noted on shop drawings, but in all cases, shall be uniform and shall not exceed the requirements of OSHA and Section 1208.2 of the Standard Building Code. Shorter spacing may be used where required to maintain the maximum spacing. The fabricator of the aluminum handrail and guardrail system shall be responsible for the design and preparation of shop drawings and design calculations (signed and sealed by Florida Registered Engineer) to meet OSHA requirements and Section 1208.2 of Standard Building Code.
 - 3. All railings shall be erected in line and plumb. Field splicing and expansion compensation shall be accomplished using internal splice sleeves. Make provisions for removable railing sections as detailed and where shown on the Drawings.
 - 4. Where handrail or guardrail posts are set in concrete as per the manufacturer's requirements the posts shall be set into aluminum sheeves cast in the concrete and firmly cemented with 1651 epoxy resin by E-Bond Epoxies, Oakland Park, Florida, Moulded Reinforced Plastics, Inc., Fort Lauderdale, Florida or equal. Collars shall be placed on the posts and fastened in place, as shown and as detailed on approved shop drawings.
 - 5. Where handrail is supported from structural members, it shall be done by the use of approved sockets, flanges, brackets, or other approved means which will

- provide neat and substantial support for the pipe railing.
6. All railing shall be properly protected by paper, or by an approved coating or by both against scratching, splashes or mortar, paint, or other defacements during transportation and erection and until adjacent work by other trades has been completed.
- F. Toeboards: Contractor shall furnish and install aluminum toeboards conforming to latest OSHA requirements on all railings and other locations where indicated on the Drawings.
1. Toeboards shall consist of an extruded 6063-T6 aluminum shape bolted by means of a pipe clamp to the railing posts without requiring any drilling or welding of the toeboard to the railing posts as manufactured by Reynolds Aluminum, Julies Blum & Company, Thompson Fabricating Company or equal. Toeboards shall have pitched top and tear drop bottom to prevent accumulation of dirt, or other material.
 2. All fastening hardware shall be Type 316 stainless steel.
- G. Kickplates, if required, shall be fabricated and installed as shown on the Drawings.
- H. Aluminum safety gate shall be fabricated of extruded aluminum.
- I. Prefabricated checkerplate aluminum floor hatches shall be Type "JD", or "KD" as manufactured by Bilco Co., Babcock-Davis Associates, Inc.; Type "AM" Inland-Ryerson Construction Products Co., Milcor Division; or equal, sized as shown. Hatches with either dimension over 3 feet-6 inches shall be double leaf type. Hatches shall be designed for a live load of 300 pounds per square foot. Hatches shall be watertight.
- J. Ship ladders shall be of all aluminum construction as detailed. Treads shall have abrasive nosing as manufactured by Reliance Steel Products Co., IKG Industries, or equal.
- K. Checkplate aluminum cover plates shall be fabricated to the details shown and installed at the locations shown.
- L. Structural aluminum angle and channel door frames shall be provided as shown on the Drawings and shall be anodized. Frames shall be fabricated with not less than three anchors on each jamb.
- M. Miscellaneous aluminum shapes and plates shall be fabricated as shown. Angle frames for hatches, beams, grates, etc., shall be furnished complete with welded strap anchors attached. Furnish all miscellaneous aluminum shown, but not otherwise detailed. Structural shapes and extruded items shall conform to the detail dimensions on the Plans within the tolerances published by the American Aluminum Association.

2.03

STEEL ITEMS

- A. Sleeves shall be steel or cast iron pipe in walls and floors with end joints as shown on the Drawings. All pipe sleeves shall have center anchor around circumference as shown.
- B. Miscellaneous steel pipe for sleeves and lifting attachments and other uses as required shall be Schedule 40 pipe fabricated according to the details as shown on the Drawings.

- C. Miscellaneous steel shall be fabricated and installed in accordance with the Drawings and shall include: beams, angles, support brackets, closure angles in roof at edge of T-beams; base plates to support ends of T-beams; door frames; splice plates, anchor bolts; lintels and any other miscellaneous steel called for on the Drawings and not otherwise specified.

2.04 CAST IRON ITEMS

- A. Outside pipe clean-out frames and covers shall be heavy duty, R-6013-R-6099 series as manufactured by Neenah Foundry Co., or equal. All outside pipe clean-outs shall be 6-inch diameter.
- B. Frames and covers for valve vaults and manholes shall be of a good quality, strong, tough even grained cast iron except as otherwise specified below. Castings shall be as manufactured by the U. S. Foundry, Neenah Foundry, Mechanics Iron Foundry, or equal. Covers to have letters "WATER", "SEWER" or "DRAIN", as applicable, embossed on top.

PART 3 EXECUTION

3.01 FABRICATION

- A. All miscellaneous metal work shall be formed true to detail, with clean, straight, sharply defined profiles and smooth surfaces of uniform color and texture and free from defects impairing strength or durability.
- B. Connections and accessories shall be of sufficient strength to safely withstand stresses and strains to which they will be subjected. Steel accessories and connection to steel or cast iron shall be steel, unless otherwise specified. Threaded connections shall be made so that the threads are concealed by fitting.
- C. Welded joints shall be rigid and continuously welded or spot welded as specified or shown. The face of welds shall be dressed flush and smooth. Exposed joints shall be close fitting and jointed where least conspicuous.
- D. Welding of parts shall be in accordance with the Standard Code of Arc and Gas Welding in Building Construction of the AWS and shall only be done where shown, specified, or permitted by the County. All welding shall be done only by welders certified as to their ability to perform welding in accordance with the requirements of the AWS Code. Component parts of built-up members to be welded shall be adequately supported and clamped or held by other adequate means to hold the parts in proper relation for welding.
- E. Welding of aluminum work shall be on the unexposed side as much as possible in order to prevent pitting or discoloration.
- F. All aluminum finish exposed surfaces, except as specified below, shall have manufacturer's standard mill finish. Aluminum handrails shall be given an anodic oxide treatment in accordance with the Aluminum Association Specification AA-C22-A41. A coating of methacrylate lacquer shall be applied to all aluminum shipment from the factory.
- G. Castings shall be of good quality, strong, tough, even-grained, smooth, free from scale,

lumps, blisters, sand holes, and defects of any kind which render them unfit for the service for which they are intended. Castings shall be thoroughly cleaned and will be subjected to a hammer inspection in the field by the County. All finished surfaces shown on the Drawings and/or specified shall be machined to a true plane surface and shall be true and seat at all points without rocking. Allowances shall be made in the patterns so that the thickness specified or shown shall not be reduced in obtaining finished surfaces. Castings will not be acceptable if the actual weight is less than 95 percent of the theoretical weight computed from the dimensions shown. The Contractor shall provide facilities for weighing castings in the presence of the County showing true weights, certified by the supplier.

- H. All steel finish work shall be thoroughly cleaned, in accordance with the Contract Documents, of all loose mill scale, rust, and foreign matter before shipment and shall be given one shop coat of primer compatible with finish coats specified in Painting Section after fabrication but before shipping. Paint shall be applied to dry surfaces and shall be thoroughly and evenly spread and well worked into joints and other open spaces. Abrasions in the field shall be touched up with primer immediately after erection. Final painting is specified in the Contract Documents.
- I. Galvanizing, where required, shall be the hot-dip zinc process after fabrication. Following all manufacturing operations, all items to be galvanized shall be thoroughly cleaned, pickled, fluxed, and completely immersed in a bath of molten zinc. The resulting coating shall be adherent and shall be the normal coating to be obtained by immersing the items in a bath of molten zinc and allowing them to remain in the bath until their temperature becomes the same as the bath. Coating shall be not less than 2 oz. per sq. ft. of surface.

3.02 INSTALLATION

- A. Install all furnished items imbedded in concrete or other masonry. Items to be attached to concrete or masonry after such work is completed shall be installed in accordance with the details shown. Fastening to wood plugs in masonry will not be permitted. All dimensions shall be verified at the site before fabrication is started.
- B. All steel surfaces to come in contact with exposed concrete or masonry shall receive a protective coating of an approved heavy bitumastic troweling mastic applied in accordance with the manufacturer's instructions prior to installation or provide a 1/32-inch neophrene gasket between the steel surface and the concrete or masonry.
- C. Where aluminum is embedded in concrete, apply a heavy coat of approved bitumastic troweling mastic in accordance with the manufacturer's instructions prior to installation.
- D. Where aluminum contacts masonry or concrete, provide a 1/32-inch neophrene gasket between the aluminum and the concrete or masonry.
- E. Where aluminum contacts a dissimilar metal, apply a heavy brush coat of zinc-chromate primer and provide a 1/32-inch neophrene gasket between the aluminum and the dissimilar metal.

Where aluminum contacts wood, apply two coats of aluminum metal and masonry paint to the wood.

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

SECTION 09865

SURFACE PREPARATION AND SHOP PRIME PAINTING

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish all labor, materials, equipment and incidentals required for the surface preparation and application of shop primers on ferrous metals, excluding stainless steels, as specified herein.

1.02 SUBMITTALS

- A. Submit to the County for approval, as provided in the Contract Drawings for shop drawings, manufacturer's specifications and data on the proposed primers and detailed surface preparation, application procedures and dry mil thickness.
- B. Submit representative physical samples of the proposed primers, if required by the County.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Submerged Services: Shop primer for ferrous metals which will be subject to splash action or which are specified to be considered submerged service shall be sprayed with one coat of Koppers 654 epoxy Primer or Koppers Inertol Primer 621-FDA, dry film thickness 3.5 to 4.5 mils by Koppers Co., Inc., or equal.
- B. Nonsubmerged Services: Shop primer for ferrous metals other than those covered by paragraph 2.01 A shall be sprayed with one coat of Koppers Pug Primer, dry film thickness 3.0 to 4.0 mils by Koppers Co., Inc. or equal.
- C. Nonprimed Surfaces: Gears, bearing surfaces, and other similar surfaces obviously not to be painted shall be given a heavy shop coat of grease or other suitable rust-resistant coating. This coating shall be maintained as necessary to prevent corrosion during all periods of storage and erection and shall be satisfactory to the County up to the time of the final acceptance.
- D. Compatibility of Coating Systems: Shop priming shall be done with primers that are guaranteed by the manufacturer to be compatible with their corresponding primers and finish coats specified in the Contract Documents for use in the field and which are recommended for use together.

PART 3 EXECUTION

3.01 APPLICATION

- A. Surface Preparation and Priming:

1. Non submerged components scheduled for priming, as defined above, shall be sandblasted clean in accordance with SSPC-SP-6, Commercial Grade, immediately prior to priming. Submerged components scheduled for priming, as defined above, shall be sandblasted clean in accordance with SSPC-SP-10. Near White, immediately prior to priming.
2. Surfaces shall be dry and free of dust, oil, grease, dirt, rust, loose mill scale and other foreign material before priming.
3. Shop prime in accordance with approved paint manufacturer's recommendations.
4. Priming shall follow sandblasting before any evidence of corrosion has occurred and within 24 hours.

END OF SECTION

SECTION 09900

PAINTING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, tools, materials, equipment, scaffolding or other structures and incidentals necessary to complete this Contract in its entirety.
- B. The work includes painting and finishing of all new interior and exterior exposed items above and below grade and surfaces, such as structural steel, miscellaneous metals, ceilings, walls, floors, doors, frames, transoms, roof fans, construction signs, guardrails, posts, fittings, valves, tanks, equipment and all other work obviously required to be painted unless otherwise specified herein or on the Drawings. The omission of minor items in the Schedule of Work shall not relieve the Contractor of his obligation to include such items where they come within the general intent of the Specification as stated herein.
- C. The following items shall not be painted:
 - 1. Any code-requiring labels, such as Underwriter's Laboratories and Factory Mutual, or any equipment identification, performance rating, name or nomenclature plates.
 - 2. Any moving parts of operating units, mechanical and electrical parts, such as valve and damper operators, linkages, sinkages, sensing devices, motor and fan shafts, unless otherwise indicated.
 - 3. Aluminum handrails (except where in contact with concrete) walkways, windows, louvers and grating unless otherwise specified herein.
 - 4. Signs and nameplates.
 - 5. Finish hardware.
 - 6. Chain link fence.
 - 7. Piping buried in the ground or embedded in concrete.
 - 8. Concealed surfaces of pipe or crawl space.
 - 9. Nonferrous metals, unless specifically noted otherwise.
 - 10. Electrical switchgear and motor control centers.
 - 11. Stainless steel angles, tubes, pipe, etc.
 - 12. Products with polished chrome, aluminum, nickel or stainless steel finish.
 - 13. Plastic switch plates and receptacle plates.
 - 14. Flexible couplings, lubricated bearing surfaces, insulation and metal and plastic pipe interior.
 - 15. Sprinkler heads.
 - 16. Lifting chain on cranes and hoists
 - 17. Electrical cable, festooned conductor system, cables, collector pole brackets, etc.
- D. All work shall be done in strict accordance with this Specification, the Design Drawings and the painting package, including manufacturer's printed instructions.
- E. The Contractor will obtain, at its own expense, all permits, licenses and inspections and shall comply with all laws, codes, ordinances, rules and regulations promulgated by authorities having jurisdiction which may bear on the Work. This compliance will include

Federal Public Law 91-596 more commonly known as the "Occupational Safety and Health Act of 1970".

1.02 DEFINITIONS

- A. Field Painting is the painting of new or rebuilt items at the job site. Field painting shall be the responsibility of the Contractor.
- B. Shop Painting is the painting of new or rebuilt items in the shop prior to delivery to the jobsite.
- C. Abbreviations The abbreviations and definitions listed below, when used in this specification, shall have the following meanings:
 - 1. SSPC - Steel Structures Painting Council
 - 2. Exterior - Outside, exposed to weather
 - 3. Interior Dry - Inside, concealed or protected from weather
 - 4. Interior Wet - Inside, subject to immersion services
 - 5. ASTM - American Society of Test Materials
 - 6. NACE - National Association of Corrosion Engineers
 - 7. NSF - National Sanitation Foundation
 - 8. AWWA - American Water Works Association
- D. Dry Film Thickness shall be in Mils.

1.03 RESOLUTION OF CONFLICTS

- A. It shall be the responsibility of the Contractor to arrange a meeting prior to the start of painting, or flooring installation between the Contractor, the Paint Manufacturer, whose products are to be used, and the County. All aspects of surface preparation, application and coating systems as covered by this Specification will be reviewed at this meeting.
- B. Clarification shall be requested promptly from the County when instructions are lacking, conflicts occur in the Specifications, or the procedure seems improper or inappropriate for any reason.
- C. Copies of all manufacturer's instructions and recommendations shall be furnished to the County by the Painting Contractor.
- D. It shall be the responsibility of the Coating Manufacturer to have their factory representative meet in person with the Contractor and County a minimum of three times during the job as a consultant on surface preparation, mil thickness of coating and proper application of coating unless meeting is determined to be unnecessary by the County.

1.04 SUBMITTALS

- A. Contractor shall submit catalog data and cut sheets for the painting system being used if not the TNEMEC materials specified.
- B. Samples as detailed in 3.01 B shall be submitted regardless of system being used,

showing each color to be used.

- C. Hazardous Material Disposal documentation shall be submitted if applicable.

PART 2 PRODUCTS

2.01 EQUIPMENT

- A. Effective oil and water separators shall be used in all compressed air lines serving spray painting and sandblasting operations to remove oil or moisture from the air before it is used. Separators shall be placed as far as practicable from the compressor.
- B. All equipment for application of the paint and the completion of the work shall be furnished by the Contractor in first-class condition and shall comply with recommendations of the paint manufacturer.
- C. Contractor will provide free of charge to the County a "Nordson-Mikrotest" or "Positest" dry film thickness gauge for ferrous metal and an OG232 "Tooke" gauge or equal for non-ferrous and cementitious surface, to be used to inspect coatings by the County and Contractor. The gauges may be used by the Contractor and returned each day to the County. County will return gauges to Contractor at completion of job.

2.02 MATERIALS

- A. All materials specified herein are manufactured by the TNEMEC Company, Inc., North Kansas City, Missouri. These products are specified to establish standards of quality and are approved for use on this Project.
- B. Equivalent materials of other manufacturers may be substituted on approval of the County. Requests for substitution shall include manufacturer's literature for each product giving the name, generic type, descriptive information and evidence of satisfactory past performance and an independent laboratory certification that their product meets the performance criteria of the specified materials.
- C. Abrasion - Fed. Test Method Std. No. 141, Method 6192, CS-17 Wheel, 1,000 grams load.
- D. Adhesion - Elcometer Adhesion Tester.
- E. Exterior Exposure - Exposed at 45 degrees facing the ocean (South Florida Marine Exposure)
- F. Hardness - ASTM D3363-74
- G. Humidity - ASTM D2247-68
- H. Salt Spray (Fog) - ASTM B117-73
- I. Substitutions which decrease the total film thickness, change the generic type of coating, or fail to meet the performance criteria of the specified materials shall not be approved. Prime and finish coats of all surfaces shall be furnished by the same manufacturer.

- J. All coatings to be shop applied must meet the requirements for volatile organic compounds (VOC) of not more than 3.5 lbs/gallon after thinning.
- K. Colors, where not specified, shall be as selected by the County or their Representative.
- L. All coatings in contact with potable water need to be NSF Certified in accordance with ANSI/NSF Standard 61.
- M. All above ground potable water mains and appurtenances shall be painted safety blue.

PART 3 EXECUTION

3.01 INSPECTION OF SURFACES

- A. Before application of the prime coat and each succeeding coat, all surfaces to be coated shall be subject to inspection by the County. Any defects or deficiencies shall be corrected by the Contractor before application of any subsequent coating.
- B. Samples of surface preparation and of painting systems shall be furnished by the Contractor to be used as a standard throughout the job, unless omitted by the County.
- C. When any appreciable time has elapsed between coatings, previously coated areas shall be carefully inspected by the County, and where, in his opinion, surfaces are damaged or contaminated, they shall be cleaned and recoated at the Contractor's expense. Recoating times of manufacturer's printed instructions shall be adhered to.
- D. Coating thickness shall be determined by the use of a properly calibrated "Nordson-Mikrotest" "Positest" Coating Thickness Gauge (or equal) for ferrous metal or an OG232 "Tooke" Paint Inspection gauge (or equal) for non-ferrous and cementitious surfaces. Please note that use of the "Tooke" gauge is classified as a destructive test.

3.02 SURFACE PREPARATION

The surface shall be cleaned as specified for the paint system being used. All cleaning shall be as outlined in the Steel Structures Painting Council's Surface Preparation Specification, unless otherwise noted. If surfaces are subject to contamination, other than mill scale or normal atmospheric rusting, the surfaces shall be pressure washed, and acid or caustic pH residues neutralized, in addition to the specified surface preparation.

3.03 STANDARDS FOR SURFACE PREPARATION

- A. Chemical and/or Solvent Cleaning: Remove all grease, oil, salt, acid, alkali, dirt, dust, wax, fat, foreign matter and contaminates, etc. by one of the following methods: steam cleaning, alkaline cleaning, or volatile solvent cleaning.
- B. Hand Tool Cleaning: Removal of loose rust, loose mill scale and loose paint to a clean sound substrate by hand chipping, scraping, sanding and wire brushing.
- C. Power Tool Cleaning: Removal of loose rust, loose mill scale and loose paint to a clean

sound substrate by power tool chipping, descaling, sanding, wire brushing and grinding.

- D. Flame Cleaning: Dehydrating and removal of rust, loose mill scale and some light mill scale by use of flame, followed by wire brushing.
- E. White Metal Blast Cleaning: Complete removal of all mill scale, rust, rust scale, previous coating, etc., leaving the surface a uniform gray-white color.
- F. Commercial Grade Blast Cleaning: Complete removal of all dirt, rust scale, mill scale, foreign matter and previous coating, etc., leaving only shadows and/or streaks caused by rust stain and mill scale oxides. At least 66% of each square inch of surface area is to be free of all visible residues, except slight discoloration.
- G. Brush-Off Blast Cleaning: Removal of rust scale, loose mill scale, loose rust and loose coatings, leaving tightly-bonded mill scale, rust and previous coatings. On concrete surfaces, brush-off blast cleaning shall remove all laitance, form oils and solid contaminants. Blasting should be performed sufficiently close to the surface so as to open up surface voids, bugholes, air pockets and other subsurface irregularities, but so as not to expose underlying aggregate.
- H. Pickling: Complete removal of rust and mill scale by acid pickling, duplex pickling or electrolytic pickling (may reduce the resistance of the surface to corrosion, if not to be primed immediately).
- I. Near-White Blast Cleaning: Removal of all rust scale, mill scale, previous coating, etc., leaving only light stains from rust, mill scale and small specks of previous coating. At least 95% of each square inch of surface area is to be free of all visible residues and the remainder shall be limited to slight discoloration.
- J. Power Tool Cleaning to Bare Metal: Complete removal of rust, rust scale, mill scale, foreign matter and previous coatings, etc., to a standard as specified on a Commercial Grade Blast Cleaning (SSPC-SP-6, NACE-3) by means of power tools that will provide the proper degree of cleaning and surface profile.
- K. Visual standards "Pictorial Surface Preparation Standards for Painting Steel Surfaces", and the National Association of Corrosion Engineer, "Blasting Cleaning Visual Standards" TM-01-70 and TM-01-75 shall be considered as standards for proper surface preparation.
- L. Oil, grease, soil, dust, etc., deposited on the surface preparation that has been completed shall be removed prior to painting according to Solvent Cleaning under this Specification.
- M. Weld flux, weld spatter and excessive rust scale shall be removed by Power Tool Cleaning as per these Specifications.
- N. All weld seams, sharp protrusions and edges shall be ground smooth prior to surface preparation or application of any coatings.
- O. All areas requiring field welding shall be masked off prior to shop coating, unless waived by the County.

- P. All areas which require field touch-up after erection, such as welds, burnbacks, and mechanically damaged areas, shall be cleaned by thorough Power Tool as specified in these Specifications.
- Q. Touch-up systems will be same as original specification except that approved manufacturer's organic zinc-rich shall be used in lieu of inorganic zinc where this system was originally used. Also strict adherence to manufacturer's complete touch-up recommendations shall be followed. Any questions relative to compatibility of products shall be brought to the County's attention; otherwise, Contractor assumes full responsibility.

3.03 PRETREATMENTS

When specified, the surface shall be pretreated in accordance with the specified pretreatment prior to application of the prime coat of paint.

3.04 STORAGE

Materials shall be delivered to the job site in the original packages with seals unbroken and with legible unmutated labels attached. Packages shall not be opened until they are inspected by the County and required for use. All painting materials shall be stored in a clean, dry, well-ventilated place, protected from sparks, flame, direct rays of the sun or from excessive heat. Paint susceptible to damage from low temperatures shall be kept in a heated storage space when necessary. The Contractor shall be solely responsible for the protection of the materials stored by himself at the job site. Empty coating cans shall be required to be neatly stacked in an area designated by the County and removed from the job site on a schedule determined by the County. County may request a notarized statement from Contractor detailing all materials used on the Project.

3.05 PREPARATION OF MATERIALS

- A. Mechanical mixers, capable of thoroughly mixing the pigment and vehicle together, shall mix the paint prior to use where required by manufacturer's instructions; thorough hand mixing will be allowed for small amounts up to one gallon. Pressure pots shall be equipped with mechanical mixers to keep the pigment in suspension, when required by manufacturer's instructions. Otherwise, intermittent hand mixing shall be done to assure that no separation occurs. All mixing shall be done in accordance with SSPC Vol. 1, Chapter 4, "Practical Aspects, Use and Application of Paints" and/or with manufacturer's recommendations.
- B. Catalysts or thinners shall be as recommended by the manufacturer and shall be added or discarded strictly in accordance with the manufacturer's instruction.

3.06 APPLICATION

- A. Paint shall be applied only on thoroughly dry surfaces and during periods of favorable weather, unless otherwise allowed by the paint manufacturer. Except as provided below, painting shall not be permitted when the atmospheric temperature is below 50 deg F, or

when freshly painted surfaces may be damaged by rain, fog, dust, or condensation, and/or when it can be anticipated that these conditions will prevail during the drying period.

- B. No coatings shall be applied unless surface temperature is a minimum of 5deg above dew point; temperature must be maintained during curing.
- C. See coating schedule for actual coating systems to be used on this project.

3.07 DEW POINT CALCULATION CHART

DEW POINT CALCULATION CHART

Ambient Air Temperature - Fahrenheit

Relative Humidity	20	30	40	50	60	70	80	90	100	110	120
90%	18	28	37	47	57	67	77	87	97	107	117
85%	17	26	36	45	55	65	76	84	95	104	113
80%	16	25	34	44	54	63	73	82	93	102	110
75%	15	24	33	42	52	62	71	80	91	100	108
70%	13	22	31	40	50	60	68	78	88	96	105
65%	12	20	29	38	47	57	66	76	85	93	103
60%	11	20	27	36	45	55	64	73	83	92	101
55%	9	17	25	34	43	53	61	70	80	89	98
50%	6	15	23	31	40	50	59	67	77	86	94
45%	4	13	21	29	37	47	56	64	73	82	91
40%	1	11	18	26	35	43	52	61	69	78	87
35%	-2	8	16	23	31	40	48	57	65	74	83

SURFACE TEMPERATURE AT WHICH CONDENSATION OCCURS

Dew Point

Temperature at which moisture will condense on surface. No coatings should be applied unless surface temperature is a minimum of 5deg above this point. Temperature must be maintained during curing.

Example

If air temperature is 70 deg F and relative humidity is 65%, the dew point is 57 deg F. No coating should be applied unless surface temperature is 62 deg F minimum.

- A. No coating shall be applied unless the relative humidity is below 85%.
- B. Suitable enclosures to permit painting during inclement weather may be used if provisions are made to control atmospheric conditions artificially inside the enclosure, within limits suitable for painting throughout the painting operations.
- C. Field painting in the immediate vicinity of, or on, energized electrical and rotating equipment, and equipment and/or pipes in service shall not be performed without the approval of the County.
- D. Extreme care shall be exercised in the painting of all operable equipment, such as valves, electric motors, etc., so that the proper functioning of the equipment will not be affected.
- E. The Contractor's scaffolding shall be erected, maintained and dismantled without damage to structures, machinery, equipment or pipe. Drop cloths shall be used where required to protect buildings and equipment. All surfaces required to be clear for visual observation shall be cleaned immediately after paint application.
- F. Painting shall not be performed on insulated pipe within three (3) feet of insulation operations or on insulation whose covering and surface coat have not had time to set and dry. Painting shall not be performed on uninsulated pipe within one (1) foot of any type of connection until the connection has been made, except as directed by the County.
- G. The prime coat shall be applied immediately following surface preparation and in no case later than the same working day. All paint shall be applied by brushing, paint mitt and roller, conventional spraying, or airless spraying, using equipment approved by the paint manufacturer.
- H. Each coat of paint shall be recoated as per manufacturer's instructions. Paint shall be considered recoatable when an additional coat can be applied without any detrimental film irregularities such as lifting or loss of adhesion.
- I. Surfaces that will be inaccessible after assembly shall receive either the full specified paint system or three shop coats of the specified primer before assembly.
- J. Finish colors shall be in accordance with the COLOR SCHEDULE and shall be factory mixed (i.e., there shall be no tinting by the Contractor, unless authorized by the County).
- K. All edges and weld seams in immersion service shall receive a "stripe coat" (applied by brush) of the 2nd coat prior to application of the full 2nd coat.
- L. All open seams in the roof area of tanks shall be filled after application of the topcoat with a flexible caulking such as Sika Flex 1A.

3.08

WORKMANSHIP

- A. The Contractor must show proof that all employees associated with this Project shall have been employed by the Contractor for a period not less than six (6) months.

- B. Painting shall be performed by experienced painters in accordance with the recommendations of the paint manufacturer. All paint shall be uniformly applied without sags, runs, spots, or other blemishes. Work which shows carelessness, lack of skill, or is defective in the opinion of the County, shall be corrected at the expense of the Contractor.
- C. The Contractor shall provide the names of at least three other projects of similar size and scope that they have successfully completed under their current company name.

3.09 APPLICATION OF PAINT

A. By Brush and/or Rollers

1. Top quality, properly styled brushes and rollers shall be used. Rollers with a baked phenol core shall be utilized.
2. The brushing or rolling shall be done so that a smooth coat as nearly uniform in thickness as possible is obtained. Brush or roller strokes shall be made to smooth the film without leaving deep or detrimental marks.
3. Surfaces not accessible to brushes or rollers may be painted by spray, by dauber or sheepskins, and paint mitt.
4. It may require two coats to achieve the specified dry film thickness if application is by brush and roller.

B. Air, Airless or Hot Spray

1. The equipment used shall be suitable for the intended purpose, shall be capable of properly atomizing the paint to be applied and shall be equipped with suitable pressure regulators and gauges.
2. Paint shall be applied in a uniform layer, with a 50% overlap pattern. All runs and sags should be brushed out immediately or the paint shall be removed and the surface resprayed.
3. High build coatings should be applied by a cross-hatch method of spray application to ensure proper film thickness of the coating.
4. Areas inaccessible to spray shall be brushed; if also inaccessible to brush, daubs or sheepskins shall be used, as authorized by the manufacturer.
5. Special care shall be taken with thinners and paint temperatures so that paint of the correct formula reaches the receiving surface.
6. Nozzles, tips, etc., shall be of sizes and designs as recommended by the manufacturer of the paint being sprayed.
7. The first coat on concrete surfaces in immersion service should be sprayed and back rolled.

3.10 PROTECTION AND CLEANUP

- A. It shall be the responsibility of the Contractor to protect at all times, in areas where painting is being done, floors, materials of other crafts, equipment, vehicles, fixtures, and finished surfaces adjacent to paint work. Cover all electric plates, surface hardware, nameplates, gauge glasses, etc., before start of painting work.
- B. At the option of the County during the course of this project, the Contractor will contain all spent abrasives, old paint chips, paint overspray and debris by means suitable to the

County, including, but not limited to, full shrouding of the area.

- C. If shrouding is required, the Contractor must provide a complete design of the intended shroud or cover. Care must be taken not to modify or damage the structure during the use of the shroud. If damage should occur, the Contractor is held responsible for all repairs.
- D. At completion of the work, remove all paint where spilled, splashed, spattered, sprayed or smeared on all surfaces, including glass, light fixtures, hardware, equipment, painted and unpainted surfaces.
- E. After completion of all painting, the Contractor shall remove from job site all painting equipment, surplus materials and debris resulting from this work.
- F. The Contractor is responsible for the removal and proper disposal of all hazardous materials from the job site in accordance with Local, State and Federal requirements as outlined by the Environmental Protection Agency.
- G. A notarized statement shall be presented to the County that all hazardous materials have been disposed of properly including, but not limited to: name of disposal company, disposal site, listing of hazardous materials, weights of all materials, cost per pound and EPA registration number.

3.11 TOUCH-UP MATERIALS

The Contractor shall provide at the end of the Project at least one (1) gallon of each generic topcoat in each color as specified by the County for future touch-up. Two gallons may be required for (2) component materials.

3.12 ON-SITE INSPECTION

During the course of this Project, the County will reserve the option of incorporating the services of a qualified inspection service. The inspection service will be responsible for assuring the proper execution of this Specification by the successful Contractor.

3.13 STEEL - STRUCTURAL, TANKS, PIPES AND EQUIPMENT

A. EXTERIOR EXPOSURE (NON-IMMERSION)

1. System No. 73-1: Epoxy/High Build Urethane

This system is highly resistant to abrasion, wet conditions, corrosive fumes and chemical contact. Provides 3-4 times the color and gloss retention of conventional paints. Second coat to be same color or close to finish color. Specify Series 74 Endura-Shield for gloss finish.

Surface Preparation: SSPC-SP6 Commercial Blast Cleaning

Shop Coat: 66-1211 Epoxoline Primer 3.0 - 4.0

2nd Coat: 66-Color Hi-Build Epoxoline	2.0 - 3.0		
3rd Coat: 73-Endura-Shield III	<u>2.0 - 3.0</u>		
		Dry Film Thickness	7.0 - 10.0
		Minimum	8.0 Mils

2. System No. 73-2: High Build Urethane for Marginally Cleaned Surfaces or Topcoating Existing System

This system can be used over factory finish paint or cover non-sandblasted steel and offer the high performance of a urethane coating. Specify Series 74 Endura-Shield for gloss finish.

Surface Preparation: SSPC-SP6 Commercial Blast Cleaning or SSPC-SP3 Power Tool Cleaning

Shop Coat: Manufacturer Standard Primer (or existing coating)	1.5 - 2.0		
2nd Coat: 135 Chembuild	3.0 - 5.0		
3rd Coat: 73-Color Endura-Shield	<u>2.0 - 3.0</u>		
		Dry Film Thickness	6.5 - 10.0
		Minimum	7.5 Mils

3. System No. 82-1: Silicone Alkyd Enamel - Gloss

Coating system for outstanding color and gloss retention and weatherability. This system will provide better performance than alkyd enamel, but not as good as a urethane. Series 82 includes a minimum of 30% silicone resin and conforms to SSPC-Paint 21-78, Type 1.

Surface Preparation: SSPC-SP6 Commercial Blast Cleaning

Shop Coat: 37H-77 Chem Prime	2.0 - 3.5		
2nd Coat: 23-Color Enduratone	2.0 - 3.0		
3rd Coat: 82-Color Silicone Alkyd Enamel	<u>1.0 - 2.0</u>		
		Dry Film Thickness	5.0 - 8.5
		Minimum	6.0 Mils

4. System 90-97: Zinc/Epoxy/Urethane

This system offers the added corrosion protection of a zinc rich primer. Series 90-97 Tneme-Zinc is an organic zinc-rich primer that can be used for field touch up of a zinc primer or for touch up of galvanized surfaces that are damaged.

Surface Preparation: SSPC-SP6 Commercial Blast Cleaning

Shop Coat: 90-97 Tneme-Zinc	2.5 - 3.5		
2nd Coat: 66-Color Hi-Build Epoxoline	2.0 - 3.0		
3rd Coat: 73 Endurashield III	<u>2.0 - 3.0</u>		
		Dry Film Thickness	6.5 - 9.5

Minimum 8.0 Mils

B. INTERIOR EXPOSURE (NON-IMMERSION)

1. System No. 69.1: High Solids Epoxy

This coating will provide maximum protection. It offers chemical and corrosion resistance for long-term protection against salt spray, moisture, corrosive fumes, and chemical attack. Series 69 is a polyamidoamine cured epoxy. Primer coat must be touched-up before second coat is applied.

Surface Preparation: SSPC-SP6 Commercial Blast Cleaning

Shop Coat: 69-1211 Epoxoline Primer II	3.0 - 5.0		
2nd Coat:			
69-Color Hi-Build Expoxoline II	<u>4.0 - 6.0</u>		
		Dry Film Thickness	7.0 - 11.0
		Minimum	9.0 Mils

2. System No.66-2: High Build Epoxy

This system will provide chemical and corrosion resistance against abrasion, moisture, corrosion fumes, chemical contact and immersion in non-potable water. Primer coat must be touched-up before second coat is applied. Substitute Series 161 for low temperature cure or quick recoats.

Surface Preparation: SSPC-SP6 Commercial Blast Cleaning

Shop Coat: 69-1211 Epoxoline Primer	3.0 - 5.0		
2nd Coat: 69-Color Hi-Build Expoxoline	<u>4.0 - 6.0</u>		
		Dry Film Thickness	7.0 - 11.0
		Minimum	9.0 Mils

3. System No. 66-6: High Build Epoxy (Over OEM Finishes)

This system is to be used over standard manufacturer's primer to offer a high performance epoxy finish. Excellent for areas of rust not able to be completely cleaned.

Surface Preparation: Spot SSPC-SP6 Commercial Blast Cleaning or SSPC- SP11 Power Tool Cleaning to Bare Metal

Shop Coat: Manufacturer's Standard (or existing coating)	1.0 - 2.0		
2nd Coat: 50-330 Poly-Ura-Prime	2.0 - 3.0		
3rd Coat: 66-Color Hi-Build Expoxoline	<u>2.0 - 4.0</u>		
		Dry Film Thickness	5.0 - 9.0
		Minimum	7.0 Mils

C. IMMERSION

1. System No. 69-2: High Solids Epoxy (Non-Potable Water)

This system provides maximum protection in immersion service. Scarify the surface before topcoating if the Series 69 has been exterior-exposed for 90 days or longer. If primer coat is damaged, it must be touched-up before second coat is applied.

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning

Shop Coat:

69-1211 Hi-Build Epoxoline II 3.0 - 5.0

2nd Coat:

69-Color Hi-Build Expoxoline II 6.0 - 8.0

Dry Film Thickness 9.0 - 13.0
Minimum 11.0 Mils

2. System No. 66-2: High Solids Epoxy (Non-Potable Water)

This system will provide chemical and corrosion resistance for protection against abrasion, moisture, corrosive fumes, chemical contact and immersion. Primer coat must be touched-up before second coat is applied. Scarify the surface before topcoating if the Series 66 has been exterior-exposed for 60 days or longer. Substitute Series 161 for low temperature cure or quick recoats.

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning

Shop Coat: 66-1211 Epoxoline Primer 3.0 - 5.0

2nd Coat: 66-Color Hi-Build Expoxoline 3.0 - 5.0

3rd Coat: 66-Color Hi-Build Expoxoline 3.0 - 5.0

Dry Film Thickness 9.0 - 15.0
Minimum 11.0 Mils

3. System No. 20-1: Epoxy-Polyamide (Potable Water)

This system meets American Water Works Association AWWA D 102 Inside Paint System Number 1. Series 20 meets the new requirements of approval for potable water use as established by the National Sanitation Foundation Standard 61. Substitute Series FC20 for low temperature cure or quick recoats.

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning

Shop Coat:

20-WH02 Pota-Pox (Tank White) 3.0 - 5.0

2nd Coat: 20-1255 Pota-Pox (Beige) 4.0 - 6.0

3rd Coat: 20-WH02 Pota-Pox (Tank White) 4.0 - 6.0

Dry Film Thickness 11.0 - 17.0
Minimum 12.0 Mils

4. System No. 140: High Solids Epoxy (Potable Water)

Series 140 meets the new requirements of approval for potable water use as established by the National Sanitation Foundation Standard 61.

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning

Shop Coat: 140-1255 Pota-Pox II (Beige)	6.0 - 8.0		
2nd Coat:			
140-WH02 Pota-Pox II (Tank White)	<u>6.0 - 8.0</u>		
		Dry Film Thickness	12.0 - 16.0
		Minimum	14.0 Mils

5. System No. 46-30: Coal Tar-Epoxy (Non-Potable Water Only)

May be applied in a two-coat application. Review critical recoat time if utilized.

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning*

One Coat: 46H-413 Hi-Build Tneme Tar
Minimum Dry Film Thickness 14.0 - 20.0

*SSPC-SP-6 Commercial Blast Cleaning may be used for non-immersion service.

6. System No. 46-26: Coal Tar Epoxy (Non-Potable Water Only)

Must be recoated within four days at 75deg F. Higher temperature will shorten recoat time.

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning*

1st Coat: 46-413 Tneme Tar	8.0 - 10.0		
2nd Coat: 46-413 Tneme Tar	<u>8.0 - 10.0</u>		
		Dry Film Thickness	16.0 - 20.0
		Minimum	16.0 Mils

*SSPC-6 Commercial Blast Cleaning may be used for non-immersion service.

3.14 OVERHEAD METAL DECKING, JOIST

A. INTERIOR EXPOSURE

System No. 15-1: Uni-Bond

This system should be used on ceiling areas where a one-coat system is desired. Can be applied over steel, galvanized and aluminum decking, joist, beams, conduits and concrete.

Surface Preparation: Surfaces must be dry, clean and free of oil, grease and other contaminates. Allow concrete to cure 28 days.

Coating: 15-Color Uni-Bond

Dry Film Thickness 2.5 - 3.5

B. EXTERIOR EXPOSURE

System No. 135-1: Chembuild

This system can be applied over a wide variety of coatings and factory finishes. It can also be applied direct to galvanized aluminum decking, joists, conduits and tight rust.

Surface Preparation: Pressure clean to remove all dirt, oil, grease, chemicals and foreign contaminants. Remove loose paint and all rust by hand and power tool cleaning (SSPC-SP 2 & 3)

Coating: 135-Color Chembuild

Dry Film Thickness 3.0 - 5.0

3.15 MILL COATED STEEL PIPE

A. EXTERIOR/INTERIOR EXPOSURE (NON-IMMERSION)

System No. 66-3: Epoxy-Polyamide

This system can be applied directly to mill coated steel pipe without sandblasting for use in non-immersion. There may be some bleed through with the 1st coat. Do not apply over glossy varnish type mill coatings.

Surface Preparation: Surface shall be clean and dry.

1st Coat: 66-1211 Epoxoline Primer	3.0 - 4.0
2nd Coat: 66-Color Hi-Build Epoxoline	4.0 - 6.0
3rd Coat: (If required)	<u>(4.0 - 6.0)</u>

Dry Film Thickness	11.0 - 16.0
Minimum	11.0 Mils

3.16 GALVANIZED STEEL - PIPE AND MISCELLANEOUS FABRICATIONS

A. EXTERIOR / (NON-IMMERSION)

System No. 73-1: Epoxy/High Build Urethane

Series 66 has excellent adhesion to galvanized steel. This system is highly resistant to abrasion, wet conditions, corrosive fumes and chemical contact. Provides 3-4 times the color and gloss retention of conventional paints. First coat to be same color as or close to the finish color. Specify Series 74 Endura-Shield for gloss finish.

Surface Preparation: SSPC-SP1 Solvent Cleaning

1st Coat: 66-Color Hi-Build Epoxoline	2.0 - 4.0
2nd Coat: 73-Color Endura-Shield	<u>2.0 - 4.0</u>

Dry Film Thickness 4.0 - 8.0
Minimum 5.0 Mils

B. INTERIOR EXPOSURE (NON IMMERSION) AND ALUMINUM IN CONTACT WITH CONCRETE

System No. 66-6: Polyamide Epoxy

Surface Preparation: SSPC-SP1 Solvent Cleaning

1st Coat: 66-Color Hi-Build Epoxoline 2.0 - 4.0

2nd Coat: 66-Color Hi-Build Epoxoline 2.0 - 4.0

Dry Film Thickness 4.0 - 8.0
Minimum 5.0 Mils

C. IMMERSION (POTABLE WATER)

System No. 20-1: Epoxy-Polyamide (Potable Water)

Series 20 meets the new requirements of approval for potable water use as established by the National Sanitation Foundation Standard 61. Substitute Series FC20 for low temperature cure of quick recoat.

Surface Preparation: SSPC-SP 7 Brush Off Blast Cleaning

1st Coat: 20-1255 Pota-Pox Primer 3.0 - 5.0

2nd Coat: 20-WH02 Pota-Pox Finish 4.0 - 6.0

Dry Film Thickness 7.0 - 11.0
Minimum 9.0 Mils

3.17 CHAIN-LINK FENCES

A. GALVANIZED STEEL & NON-FERROUS METAL

System No. 22-1: Oil-Cementitious

Surface Preparation: Surface shall be clean and dry

One Coat: 22-Color Galv-Gard

Dry Film Thickness 3.0 - 4.0

3.18 CONCRETE

A. EXTERIOR - ABOVE GRADE

1. System No. 52-1 Modified Epoxy - Sand Texture

Series 52 is a high build, decorative sand texture finish that hides minor surface irregularities and gives long-term protection against weather, driving rain,

ultraviolet exposure, alternate freezing and thawing. Series 52 will actually become part of the concrete. Available in Series 55, Tneme-Crete smooth finish. For porous substrates, a second coat of Series 52 is required. Substitute Series 180 or 181 W.B. Tneme-Crete when specified over existing acrylic or latex coatings.

Surface Preparation: Surface shall be clean and dry.

One Coat: 52-Color Tneme-Crete

Dry Film Thickness 8.0 - 10.0

2. System No. 6-1: Acrylic Emulsion Low Sheen

If semi-gloss finish is desired, use Series 7 Tneme-Cryl SG as the second coat.

Surface Preparation: Surface must be clean and dry.

1st Coat: 6-Color Tneme-Cryl

2.0 - 3.0

2nd Coat: 6-Color Tneme-Cryl

2.0 - 3.0

Dry Film Thickness 4.0 - 6.0

Minimum 5.0 Mils

3. System No. 156-1: Modified Acrylic Elastomer

If texture is needed, use 157 Enviro-Crete TX (medium texture) or 159 Enviro-Crete XTX (coarse texture). For application over previously applied coatings, use TNEMEC Series 151 Elasto-Grip at 1.0 - 2.5 mils DFT prior to the application of Series 156 Enviro-Crete.

Surface Preparation: Surface must be clean and dry.

1st Coat: 156-Color Enviro-Crete

4.0 - 8.0

2nd Coat: 156-Color Enviro-Crete

4.0 - 8.0

Dry Film Thickness 8.0 - 16.0

Minimum 10.0 Mils

B. EXTERIOR - BELOW GRADE

1. System No. 46-61: Coal Tar Pitch Solution

Surface Preparation: Surface must be clean and dry, Level all protrusions.

1st Coat: 46-465 H.B. Tnemecol

8.0 - 12.0

2nd Coat: 46-465 H.B. Tnemecol

8.0 - 12.0

Dry Film Thickness 16.0 - 24.0

Minimum 16.0 Mils

2. System No. 46-31: Coal Tar-Epoxy

Surface Preparation: Surface shall be clean and dry.

One Coat: 46H-413 Hi-Build Tneme-Tar

Dry Film Thickness 14.0 - 20.0

3. System No. 100-1: Crystalline Waterproofing

This system can be applied to concrete that is still wet or has not developed final cure. It can be used where wet surface conditions exist or where there is the potential for water intrusion due to hydrostatic pressure. Application shall be per Xypex specification manual.

Surface Preparation: Surface to be clean and roughened by Brush Blasting or Acid Etching.

1st Coat: XYPEX Concentrate at 1.5 lbs/SY

2nd Coat: XYPEX Modified at 1.5 lbs/SY

C. EXTERIOR/INTERIOR EXPOSURE (NON-IMMERSION)

1. System No. 6-1: Acrylic Emulsion, Low Sheen (Interior/Exterior)

This system will provide a decorative coating with good exterior durability, color retention, and a high vapor transmission rate. For Semi-Gloss finish, use 7-Color Tneme-Cryl S/G.

Surface Preparation: Surface shall be clean and dry. Allow concrete to cure for 28 days.

1st Coat: 6-Color Tneme-Cryl

2.0 - 3.0

2nd Coat: 6-Color Tneme-Cryl

2.0 - 3.0

Dry Film Thickness 4.0 - 6.0

Minimum 5.0 Mils

2. System No. 66-4: Epoxy-Polyamide (Interior/Exterior)

Series 66 provides excellent protection from abrasion, moisture, corrosive fumes and chemical contact. For exterior exposures, topcoat with Series 73, or 74 Endura-Tone for gloss and color retention.

Surface Preparation: Surfaces shall be clean and dry. Allow concrete to cure for 28 days. SSPC-SP-7 Brush-Off Blast Clean.

1st Coat: 66-Color Hi-Build Epoxoline 3.0 - 5.0

2nd Coat: 66-Color Hi-Build Epoxoline 4.0 - 6.0

Dry Film Thickness 7.0 - 11.0

Minimum 9.0 Mils

3. System No. 83-1: High Solids Catalyzed Epoxy (Interior)

Surface Preparation: Surface shall be clean and dry. Allow concrete to cure for 28 days. SSPC-SP-7 Brush Off Blast Clean. Concrete block surfaces: Allow to cure 28 days. Level fins, protrusions and mortar splatter.

1st Coat: 83-Color Ceramlon II	6.0 - 10.0		
2nd Coat: 83-Color Ceramlon II	<u>6.0 - 10.0</u>		
		Dry Film Thickness	12.0 - 20.0
		Minimum	14.0 Mils

D. IMMERSION - POTABLE & NON-POTABLE WATER

1. System No. 66-4: Epoxy Polyamide (Non-Potable Water)

Surface irregularities and bug holes should be filled to a smooth uniform appearance as required with TNEMEC Series 63-1500 Filler and Surfacer.

Surface Preparation: SSPC-SP-7 Brush-Off Blast Cleaning

1st Coat: 66-Color Hi-Build Epoxoline	4.0 - 6.0		
2nd Coat: 66-Color Hi-Build Epoxoline	<u>4.0 - 6.0</u>		
		Dry Film Thickness	8.0 -12.0
		Minimum	10.0 Mils

2. System No. 104-5: High Solids Epoxy (Non-Potable Water)

Surface irregularities and bug holes should be filled to a smooth uniform appearance as required with TNEMEC Series 63-1500 Filler and Surfacer.

Surface Preparation: SSPC-SP-7 Brush-Off Blast Cleaning

1st Coat: 104-1255 H.S. Epoxy Primer	6.0 - 10.0		
2nd Coat: 104 Color H.S. Epoxy	<u>6.0 - 10.0</u>		
		Dry Film Thickness	12.0 - 20.0
		Minimum	14.0 Mils

3. System No. 46-31: Coal Tar-Epoxy (Non-Potable Water)

May be applied in a two-coat application. Review critical recoat time is utilized. Surface irregularities and bugholes should be filled to a smooth uniform appearance as required with TNEMEC Series 63-1500 Filler and Surfacer.

Surface Preparation: Brush-Off Blast Cleaning

One Coat: 46H-413 Hi-Build Tneme-Tar		Dry Film Thickness	14.0-20.0
--------------------------------------	--	--------------------	-----------

4. System No. 45-27: Coal Tar Epoxy (Non-Potable Only)

Must be recoated within four days at 75deg F. Higher temperature will shorten

recoat time.

Surface Preparation: Brush-Off Blast Cleaning

1st Coat: 46-413 Tneme Tar	8.0 - 10.0		
2nd Coat: 46-413 Tneme Tar	<u>8.0 - 10.0</u>		
		Dry Film Thickness	16.0 - 20.0
		Minimum	16.0 Mils

5. System No. 20-2 Epoxy-Polyamide (Potable Water)

This system meets American Water Works Association AWWA D 102 Inside System No. 1. Series 20 meets the new requirements of approval for potable water use as established by the National Sanitation Foundation Standard 61. Surface irregularities and bug holes should be filled to a smooth uniform appearance as required with TNEMEC Series 63-1500 Filler and Surfacer. (NSF Standard 61 approved). Substitute Series FC20 for low temperature cure or quick recoats.

Surface Preparation: SSPC-SP10 Near White Blast Cleaning

1st Coat: 20-1255 Pota-Pox	4.0 - 6.0		
2nd Coat: 20-WH02 Pota-Pox Finish	<u>4.0 - 6.0</u>		
		Dry Film Thickness	8.0 - 12.0
		Minimum	10.0 Mils

6. System No. 139-2: Epoxy-Polyamine (Potable Water)

Series 139 meets the new requirements of approval for potable water use as established by the National Sanitation Foundation Standard 61. Surface irregularities and bug holes should be filled to a smooth uniform appearance as required with TNEMEC Series 63-1500 Filler and Surfacer. (NSF Standard 61 approved.)

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning

1st Coat: 139-1255 Pota-Pox II	6.0 - 8.0		
2nd Coat: 139-WH02 Pota-Pox II	<u>6.0 - 8.0</u>		
		Dry Film Thickness	12.0 - 16.0
		Minimum	14.0 Mils

E. INTERIOR EXPOSURE (NON-IMMERSION)

1. System No. 104-3: High Solids Epoxy

This system will produce a slick, tile-like finish that has excellent chemical and water resistance. Surface will be easy to clean.

Surface Preparation: Surface to be clean and dry.

1st Coat: 104-Color H.S. Epoxy	6.0 - 8.0		
2nd Coat: 104-Color H.S. Epoxy	<u>6.0 - 8.0</u>		
		Dry Film Thickness	12.0 - 16.0
		Minimum	14.0 Mils

2. System No. 113-1: Acrylic-Epoxy Semi-Gloss

This system will provide high performance and can be applied directly over existing coatings without lifting. Can be used when low odor is required during application. Specify Series 114 Tneme-Tuffcoat for Gloss Finish.

Surface Preparation: Surface must be clean and dry.

One Coat: 113-Color Tneme-Tuffcoat		Dry Film Thickness	4.0 - 6.0
------------------------------------	--	--------------------	-----------

3.19 CONCRETE FLOORS

A. EPOXY FLOOR COATINGS

1. System No. 67-1: Epoxy-Polyamide

This system will provide a durable, long-wearing coating that bonds tightly to concrete and stands up under heavy foot traffic, frequent cleaning and spillage of water, oil, grease, or chemical.

Surface Preparation: Acid Etch or Brush-Off Blast Cleaning

1st Coat: 67-Color Tnema-Tread	2.0 - 3.0		
2nd Coat: 67-Color Tnema-Tread	<u>2.0 - 3.0</u>		
		Dry Film Thickness	4.0 - 6.0
		Minimum	5.0 Mils

2. System No. S67-1: Epoxy-Polyamide (Non-Skid)

This system will provide the same protection and durability as System 67-1 with the addition of a non-skid finish.

Surface Preparation: Acid Etch or Brush-Off Blast Cleaning

1st Coat: S67-Color Tneme-Tread	2.0 - 3.0		
2nd Coat: 67-Color Tneme-Tread	<u>2.0 - 3.0</u>		
		Dry Film Thickness	4.0 - 6.0
		Minimum	5.0 Mils

3. System No. 73-12: Epoxy/Urethane

This system will provide maximum protection against chemical splash and spillage, wet conditions and abrasion. Specify Series 70 Endura-Shield for Gloss finish. First coat must be thinned 20% prior to application. For non-skid finish, specify

Series S67 Tneme-Tread for the first and second coat.

Surface Preparation: Acid Etch or Brush-Off Blast Cleaning

1st Coat: 67-Color Tneme-Tread	2.0 - 3.0		
2nd Coat: 67-Color Tneme-Tread	2.0 - 3.0		
3rd Coat: 71-Color Endura-Shield	<u>1.5 - 2.5</u>		
		Dry Film Thickness	5.5 - 8.5
		Minimum	6.5 Mils

4. System No. 281-1: High Build Polyamine-Epoxy Floor

Please refer to manufacturer's Installation Guide and Technical Data for proper installation.

Surface Preparation: Abrasive blast cleaning (refer to Installation Guide of manufacturer).

1st Coat: 201 Epoxoprime	6.0 - 8.0		
2nd Coat: 281 Tneme-Glaze	<u>6.0 - 8.0</u>		
		Dry Film Thickness	12.0 - 16.0
		Minimum	14.0 Mils

5. System No. 221/281: Functional Flooring (Non-Slip)

Please refer to manufacturer's Installation Guide and Technical Data for proper installation.

Surface Preparation: Abrasive blast cleaning (refer to Installation Guide of manufacturer).

1st Coat: 201 Epoxoprime	6.0 - 8.0		
2nd Coat: 221 Lami-Tread (2 cts. @ 1/16" ea.)	1/8"		
3rd Coat: 281 Tneme-Glaze	<u>8.0 - 12.0</u>		
		Minimum Dry Film Thickness	1/4"+

3.20 POROUS MASONRY

A. EXTERIOR/INTERIOR EXPOSURE

1. System No. 52-2: Modified Epoxy - Sand Texture

First coat of Tneme-Crete will act as a filler coat while the second coat will completely seal and finish. Long-term life and high performance. Available in Series 55 Tneme-Crete smooth finish.

Surface Preparation: Surface shall be clean and dry.

1st Coat: 52-Color Tneme-Crete 60 - 80 SF

2nd Coat: 52-Color Tneme-Crete Per Gal/Per Coat

2. System No. 6-2: Acrylic Emulsion, Low Sheen

This system will fill the block and provide a sealed surface. For Semi-Gloss Finish, use 7-Color Tneme-Cryl S/G.

Surface Preparation: Surface shall be clean and dry.

1st Coat: 54-562 Modified Epoxy Masonry Filler

		80 SF Gal	
2nd Coat: 6-Color Tneme-Cryl	2.0 - 3.0		
3rd Coat: 6-Color Tneme-Cryl	<u>2.0 - 3.0</u>		
			*4.0 - 6.0

*Total Dry Film Thickness of Topcoats Only.

3. System No. 66-15: Epoxy-Polyamide (Interior)

Block Filler is a modified epoxy designed for high moisture.

Surface Preparation: Surface shall be clean and dry.

1st Coat: 54-660 Epoxy Masonry Filler 100 SF/Gal

2nd Coat: 66-Color Hi-Build Epoxoline 4.0 - 6.0

3rd Coat: 66-Color Hi-Build Epoxoline 4.0 - 6.0

*8.0 - 12.0

*Total Dry Film Thickness of Topcoats Only.

4. System No. 104-6: High Solids Epoxy (Interior Only)

This system will produce a film thickness of 16 mils. The surface will be tile-like for easy cleaning and will provide protection against chemical attack, corrosive fumes, high humidity and wash down. Backfold first coat to fill porosity.

Surface Preparation: Surface to be clean and dry.

1st Coat: 104-Color H.S. Epoxy 6.0 - 10.0

2nd Coat: 104-Color H.S. Epoxy 6.0 - 10.0

Dry Film Thickness	12.0 - 20.0
Minimum	14.0 Mils

5. System No. 113-1: Acrylic-Epoxy Semi-Gloss (Interior Only)

Series 113 Tneme-Tufcoat has very low odor and can be used when painting in occupied areas. Specify Series 114 Tneme-Tufcoat for a gloss finish.

Surface Preparation: Surface must be clean and dry.

1st Coat: 130 Envirofill	100 SF/Gal	
2nd Coat: 113-Color Tnema-Tufcoat*	<u>4.0 - 6.0</u>	**4.0 - 6.0

* Two coats may be required if applied by roller
 ** Total Dry Film Thickness of Topcoats Only

6. System No. 156-1: Modified Acrylic Elastomer

If texture is needed, use 157 Enviro-Crete TX (medium texture of 159 Enviro-Crete XTX - coarse texture). For application over previously applied coatings, use TNEMEC 151 Elasto-Grip at 1.0 - 2.5 mils DFT.

Surface Preparation: Surfaces must be clean and dry.

1st Coat: 130 Envirofill	100 SF/Gal	
2nd Coat: 156-Color Enviro-Crete	4.0 - 8.0	
3rd Coat: 156-Color Enviro-Crete	<u>4.0 - 8.0</u>	
	Dry Film Thickness	8.0 - 16.0
	Minimum	10.0 Mils
		(For 2nd & 3rd Coats)

3.21 GYPSUM WALLBOARD

A. INTERIOR EXPOSURE

1. System No. 111-5: Acrylic-Epoxy

Surface Preparation: Surface must be clean and dry.

1st Coat: 51-792 PVA Sealer	1.0 - 2.0	
2nd Coat: 113 H.B. Tnemetufcoat*	<u>4.0 - 5.0</u>	
	Dry Film Thickness	5.0 - 7.0
	Minimum	6.0 Mils

*Two coats may be required if application is by brush and roller.

2. System No. 66-22: Hi-Build Epoxoline

Surface Preparation: Surface must be clean and dry.

1st Coat: 51-792 PVA Sealer	1.0 - 2.0	
2nd Coat: 66-Color Hi-Build Epoxoline*	<u>4.0 - 6.0</u>	
	Dry Film Thickness	5.0 - 8.0
	Minimum	5.0 Mils

*Two coats may be required if applied by roller

3. System No. 6-1: Acrylic Emulsion, Low Sheen (Interior/Exterior Exposure)

This system is designed for mild use areas like office walls, laboratory ceilings, stairwells, etc. For Semi-Gloss finish, use 7-color Tneme-Cryl S/G.

Surface Preparation: Surface must be dry and clean.

1st Coat: 6-Color Tneme-Cryl	2.0 - 3.0		
2nd Coat: 6-Color Tneme-Cryl	<u>2.0 - 3.0</u>		
	Dry Film Thickness	4.0 - 6.0	
	Minimum	5.0 Mils	

3.22 WOOD

A. EXTERIOR/INTERIOR EXPOSURE

1. System No. 23-4: Alkyd Semi-Gloss

Specify Series 2H Hi-Build Tneme-Gloss for High Gloss finish.

Surface Preparation: Surface shall be clean and dry.

1st Coat: 36-603 Undercoater	2.5 - 3.5		
2nd Coat: 23 Enduratone	1.5 - 3.5		
3rd Coat: 23 Enduratone	<u>1.5 - 3.5</u>		
	Dry Film Thickness	5.5 - 10.5	
	Minimum	6.0 Mils	

2. System No. 6-5: Acrylic Latex

Substitute Series 7 if semi gloss finish is desired.

Surface Preparation: Surface shall be clean and dry.

1st Coat: 36-603 Undercoater	2.0 - 3.5		
2nd Coat: 6-Color Tneme-Cryl	2.0 - 3.0		
3rd Coat: 6-Color Tneme-Cryl	<u>2.0 - 3.0</u>		
	Dry Film Thickness	6.0 - 9.5	
	Minimum	7.5 Mils	

3.23 PVC PIPE

A. EXTERIOR OR INTERIOR

System No. 66-23: Epoxy-Polyamide

Optional topcoat of Series 73/74 Endura-Shield would give long-term color and gloss retention for exterior exposure.

Surface Preparation: Surface shall be clean and dry.

One Coat: 66-Color Hi-Build Epoxoline

Dry Film Thickness 4.0 - 6.0

3.24 INSULATED PIPE

A. INTERIOR EXPOSURE

System No. 6-1: Acrylic Emulsion, Low Sheen

For semi-gloss finish, use 7-Color Tneme-Cryl S/G.

Surface Preparation: Surface shall be clean and dry.

1st Coat: 6-Color Tneme-Cryl	2.0 - 3.0		
2nd Coat: 6-Color Tneme-Cryl	<u>2.0 - 3.0</u>		
		Dry Film Thickness	4.0 - 6.0
		Minimum	5.0 Mils

3.25 HIGH HEAT COATING

A. EXTERIOR/INTERIOR EXPOSURE

1. System No. 39-2: Silicone Aluminum (1200deg F Maximum)

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning - 1.0 Mil Surface Profile

1st Coat: 39-1261 Silicone Aluminum	1.0 - 1.5		
2nd Coat: 39-1261 Silicone Aluminum	<u>1.0 - 1.5</u>		
		Dry Film Thickness	2.0 - 3.0
		Minimum	2.0 Mils

2. System No. 39-4: Silicone Aluminum (600deg F Maximum)

Surface Preparation: SSPC-SP10 Near-White Blast Cleaning - 1.0 Mil Surface Profile

1st Coat: 39-661 Silicone Aluminum	1.0 - 1.5		
2nd Coat: 39-661 Silicone Aluminum	<u>1.0 - 1.5</u>		
		Dry Film Thickness	2.0 - 3.0
		Minimum	2.0 Mils

3.26 SURFACES EXPOSED TO H₂S/H₂SO₄ (SEVERE EXPOSURE/IMMERSION)

A. CEMENTITIOUS SURFACES

System No. 120-1: Vinester

Surface Preparation: Abrasive blast clean to remove all laitance, fines and contamination.

1st Coat: 120-5002 Vinester	6.0 - 10.0*		
2nd Coat: 120-5003 Vinester F&S	As Required**		
3rd Coat: 120-5002 Vinester	12.0 - 18.0		
4th Coat: 120-5001 Vinester	<u>12.0 - 18.0</u>		
	Dry Film Thickness	30.0 - 46.0	
	Minimum	36.0 Mils+	

*First coat is to be applied by roller application or spray applied followed by backrolling.

**All surface voids, cracks, pinholes and other defects must be filled flush with the adjacent surfaces by putty knife, trowel, float, squeegee, or other suitable method.

B. FERROUS METAL SURFACES

System No. 120-2: Vinyl Ester

Surface Preparation: SSPC-SP-5 White Metal Blast Cleaning (3.0 Mil Profile)

1st Coat: 120-5002 Vinester	12.0 - 18.0		
2nd Coat: 120-5001 Vinester	<u>12.0 - 18.0</u>		
	Dry Film Thickness	24.0 - 36.0	
	Minimum	30.0 Mils	

3.27 EXTERIOR OF PRESTRESSED CONCRETE TANKS

A. System No. 156-1: New Tanks

Surface Preparation: Surface to be clean and dry.

1st Coat: 156-Color Envirocrete	4.0 - 6.0		
2nd Coat: 156-Color Envirocrete	<u>4.0 - 6.0</u>		
	Dry Film Thickness	8.0 - 12.0	
	Minimum	10.0 Mils	

B. System No. 156-2: Existing Tanks (Previously Painted)

Major cracks (wider than 1/64") can be repaired with TNEMEC Series 152 Tneme-Tape per instructions.

Surface Preparation: Remove all dirt, oil, grease, chalk, and loose paint per high pressure water blast (min. 3500 psi).

1st Coat: 151 Elasto-Grip	1.0 - 2.5		
Stripe Coat: Stripe all hairline cracks with a brushed coat of Series 156 Envirocrete	3.0 - 5.0		
Topcoat: 156-Envirocrete	<u>4.0 - 6.0</u>		
	Dry Film Thickness (Cracks)	8.0 - 13.5	
	Dry Film Thickness (Other)	5.0 - 8.5	

3.28 SECONDARY CONTAINMENT AREAS

A. System No. 66-4: Epoxy Polyamide

This system will provide excellent resistance to most chemicals including petrochemicals.

Surface Preparation: Surfaces shall be clean and dry. Allow new concrete to cure for 28 days. Abrasive Blast Clean per SSPC-SP7 (Brush Off Blast)

Primer: 66-Color Hi-Build Epoxoline	4.0 - 6.0		
Topcoat: 66-Color Hi-Build Epoxoline	<u>4.0 - 6.0</u>		
		Dry Film Thickness	8.0 - 12.0
		Minimum	10.0 Mils

B. System No. 61-1: Amine Epoxy

This system offers superior chemical resistance to a wide range of chemicals. Use TNESEC Series 63-1500 between coats as a filler and surfacer wherever it is required.

Surface Preparation: Surfaces shall be clean and dry. Allow new concrete to cure for 28 days. Abrasive Blast Clean per SSPC-SP7 (Brush Off Blast).

Primer: 61-5002 Tneme-Liner (Beige)	8.0 - 12.0		
Topcoat: 61-5001 Tneme-Liner (Gray)	<u>8.0 - 12.0</u>		
		Dry Film Thickness	16.0 - 24.0

C. System 262-1: Flexible Polyurethane

Multiple passes may be required to achieve recommended film thickness. See Elasto-Shield application guide for additional instructions. This product is only available in black.

Surface Preparation: Surfaces shall be clean and dry. Allow new concrete to cure for 28 days. Abrasive Blast Clean per SSPC-SP7 (Brush Off Blast)

Coating: 262 Elasto Shield (Black)			
		Minimum Dry Film Thickness	50.0

3.29 CLEAR WATER REPELLENT FOR CONCRETE, MASONRY AND BRICK

A. Silane Sealer (Min. 20% Solids)

Surface Preparation: Allow new concrete to cure 28 days. Clean surfaces to be sealed by abrasive blasting or waterblasting.

COATING: BRICK, CONCRETE
HULS Chem-Trete BSM 20....75-200 SF/GAL

SPLIT FACED OR POROUS MASONRY
HULS Chemtrete PB.....35-100 SF/GAL

3.30 MANHOLES, WET WELLS AND LIFT STATIONS

A. System No. 120-1: Vinester

Surface Preparation: Abrasive blast clean to remove all laitance, fines and contamination.

1st Coat: 120-5002 Vinester	6.0 - 10.0*	
2nd Coat: 120-5003 Vinester F&S	As Required**	
3rd Coat: 120-5002 Vinester	12.0 - 18.0	
4th Coat: 120-5001 Vinester	<u>12.0 - 18.0</u>	
	Dry Film Thickness	30.0 - 46.0
	Minimum	36.0 Mils+

*First coat to be applied by roller application or spray applied followed by backrolling.

**All surface voids, cracks, pinholes and other defects must be filled flush with the adjacent surfaces by putty knife, trowel, float, squeegee, or other suitable method.

B. System No. 100-1: Crystalline Waterproofing

This system can be applied to concrete that is still wet or has not developed final cure. It can be used where wet surface conditions exist or where there is the potential for water intrusion due to hydrostatic pressure.

Surface Preparation: Surface to be clean and roughened by Brush Blasting or Acid Etching.

1st Coat: XYPEX Concentrate @ 1.5 lbs./SY
2nd Coat: XYPEX Modified @ 1.5 lbs./SY

3.31 CANAL PIPE CROSSINGS

A. System 90-97: Zinc/Epoxy/Urethane for New Pipe or Pipe Requiring Removal of Existing Coatings

Surface Preparation: SSPC-SP6 Commercial Blast Cleaning

Primer: 90-97 Tneme-Zinc	2.5 - 3.5	
2nd Coat: 66-Color Hi-Build Epoxoline	2.0 - 3.0	
3rd Coat: 74-Color Endurashield	<u>2.0 - 3.0</u>	
	Dry Film Thickness	6.5 - 9.5
	Minimum	8.0 Mils

B. System No. 135-2: High Build, High Gloss Urethane for Marginally Cleaned Surfaces or Topcoating Over Existing Systems

Surface Preparation: High Pressure Water Blast (min. 3500 psi) or Solvent Clean (SSPC-SP1) and Spot Hand and Power Tool Clean (SSPC-SP 2 & 3) or Brush Blast (SSPC-SP7). Existing coatings must be clean, dry and tightly adhering prior to application of coatings.

1st Coat: 135-Color Chembuild	3.0 - 4.0
2nd Coat: 74-Color Endurashield	<u>2.0 - 3.0</u>
	Minimum Dry Film Thickness 5.0

C. Ductile Iron Pipe (Above grade)

A test patch is always recommended to insure proper adhesion to existing coatings without lifting of existing coatings.

Surface Preparation: Clean and dry. (Do not solvent clean.)

1st Coat: TNEMEC Series 66*	3.0 - 5.0
2nd Coat: TNEMEC Series 66	<u>3.0 - 5.0</u>
	Minimum Dry Film Thickness 6.0 - 10.0

*Allow the black asphaltic coating to "bleed" through the first coat. After the first coat is cured, apply second coat.

3.32 PROJECT DESIGNER SYSTEMS REFERENCE GUIDE

A. STEEL

EXTERIOR (NON-IMMERSION)

- A.1 System No. 73-1: Epoxy/High Build Urethane
- A.2 System No. 73-2: High Build Urethane
- A.3 System No. 2H-3: Alkyd Gloss
- A.4 System 90-97: Zinc/Epoxy/Urethane

INTERIOR EXPOSURE (NON-IMMERSION)

- B.1 System No. 69-1: High Solids Epoxy
- B.2 System No. 66-2: High Build Epoxy
- B.3 System No. 66-6: High Build Epoxy

IMMERSION

- C.1 System No. 69-2: High Solids Epoxy (Non-Potable)
- C.2 System No. 66-2: High Build Epoxy (Non-Potable)
- C.3 System No. 20-1: Epoxy-Polyamide (Potable)
- C.4 System No. 140: High Solids Epoxy (Potable Water)
- C.5 System No. 46-30: High Build Coat Tar Epoxy (Non-Potable Only)
- C.6 System No. 46-26: Coal Tar Epoxy (Non Potable Water Only)

B. OVERHEAD METAL DECKING, JOIST (INTERIOR EXPOSURE)

System No. 15-1: Uni-Bond

C. OVERHEAD METAL DECKING, JOINT (EXTERIOR EXPOSURE)

System No. 135-1: Chembuild

D. MILL COATED STEEL PIPE

System No. 66-3: Epoxy Polyamide

E. GALVANIZED STEEL-PIPE AND MISCELLANEOUS FABRICATORS

System No. 73-1: Epoxy/High Build Urethane

F. GALVANIZED STEEL-INTERIOR EXPOSURE (NON-IMMERSION) AND ALUMINUM IN CONTACT WITH CONCRETE

System No. 66-6: Polyamide Epoxy

G. GALVANIZED STEEL - IMMERSION (POTABLE WATER)

System No. 20-1: Epoxy Polyamide (Potable Water)

H. CHAIN LINK FENCES

System No. 22-1: Oil-Cementitious

I. CONCRETE

EXTERIOR-ABOVE GRADE

A.1 System No. 52-1: Modified Epoxy-Sand Texture

A.2 System No. 6-1: Acrylic Emulsion Low Sheen

A.3 System No. 156-1: Modified Acrylic Elastomer

EXTERIOR-BELOW GRADE

B.1 System No. 46-61: Coal Tar Pitch Solution

B.2 System No. 46-31: Coal Tar Epoxy

B.3 System No. 100-1: Crystalline Waterproofing

EXTERIOR/INTERIOR EXPOSURE (NON-IMMERSION)

C.1 System No. 6-1: Acrylic Emulsion Low Sheen

C.2 System No. 66-4: Epoxy-Polyamide

C.3 System No. 83-1: High Solids Catalyzed Epoxy

IMMERSION (POTABLE & NON-POTABLE)

D.1 System No. 66-4: Epoxy-Polyamide (Non-Potable)

D.2 System No. 104-5: High Solids Epoxy (Non-Potable)

D.3 System No. 46-31: High Build Coal Tar Epoxy (Non-Potable Only)

D.4 System No. 46-27: Coal Tar Epoxy (Non Potable Only)

- D.5 System No. 20-2: Epoxy Polyamide (Potable)
- D.6 System No. 139-2: Epoxy Polyamide (Potable)

INTERIOR EXPOSURE (NON-IMMERSION)

- E.1 System No. 104-3: High Solids Epoxy
- E.2 System No. 113-1: Acrylic Epoxy Semi-Gloss

J. CONCRETE FLOORS

- A.1 System No. 67-1: Epoxy-Polyamide
- A.2 System No. S67-1: Epoxy-Polyamide (Non-Skid)
- A.3 System No. 73-12: Epoxy/Urethane
- A.4 System No. 281-1: High Build Polyamide-Epoxy Flooring
- A.5 System No. 221/281: Functional Flooring (Non-Slip)

K. POROUS MASONRY - EXTERIOR/INTERIOR EXPOSURE

- A.1 System No. 52-2: Modified Epoxy-Sand Texture
- A.2 System No. 6-2: Acrylic Emulsion, Low Sheen
- A.3 System No. 66-15: Epoxy-Polyamide (Interior)
- A.4 System No. 104-6: High Solids Epoxy (Interior Only)
- A.5 System No. 113-1: Acrylic Epoxy Semi-Gloss (Interior Only)
- A.6 System No. 156-1: Modified Acrylic Elastomer

L. GYPSUM WALLBOARD

- A.1 System No. 111-5: Acrylic Epoxy
- A.2 System No. 66-22: Hi-Build Epoxoline
- A.3 System No. 6-1: Acrylic Emulsion, Low Sheen

M. WOOD EXTERIOR/INTERIOR EXPOSURE

- A.1 System No. 23-4: Alkyd Semi-Gloss
- A.2 System No. 6-5: Acrylic Latex

N. PVC PIPE EXTERIOR/INTERIOR EXPOSURE

- A.1 System No. 66-23: Epoxy-Polyamide

O. INSULATED PIPE-INTERIOR EXPOSURE

- A.1 System No. 6-1: Acrylic Emulsion, Low Sheen

P. HIGH HEAT SURFACES-FERROUS METAL

- A.1 System No. 39-2: Silicone Aluminum (1200deg F Maximum)
- A.2 System No. 39-4: Silicone Aluminum (600deg F Maximum)

Q. SURFACES EXPOSED TO H₂S/H₂SO₄ (SEVERE EXPOSURE/IMMERSION)

A.1 System No. 120-1: Vinester

R. EXTERIOR OF PRESTRESSED CONCRETE TANKS

A. System 156-1: New Tanks

B. System 156-2: System 156-2 Existing Tanks (Previously Painted)

S. SECONDARY CONTAINMENT AREAS

A. System No. 64-4: Epoxy Polyamide

B. System No. 61-1: Amine Epoxy

C. System No. 262-1: Flexible Polyurethane

T. CLEAR WATER REPELLENT FOR CONCRETE, MASONRY AND BRICK

A. Silane Sealer (Min. 20% Solids)

U. MANHOLES, WET WELLS & LIFT STATIONS

A. System No. 120-1: Vinester

B. System No. 100-1: Crystalline Waterproofing

V. CANAL PIPE CROSSINGS

A. System No. 90-97: Zinc/Epoxy/Urethane

B. System No. 135-2: High Build/High Gloss Urethane

C. Ductile Iron Pipe Above Grade: Series 66 High Build Epoxy

3.33 COATING SCHEDULE - TO BE DEVELOPED BY PROJECT AS NEEDED

END OF SECTION

[THIS PAGE INTENTIONALLY LEFT BLANK]

**SUBSURFACE SOIL EXPLORATION FOR
PROPOSED FORCE MAIN 15D REPLACEMENT,
59TH STREET WEST AT MANATEE AVE. WEST,
BRADENTON,
MANATEE COUNTY, FLORIDA**



Ardaman & Associates, Inc.

OFFICES

FLORIDA

Orlando, 8008 S. Orange Avenue, Orlando, Florida 32809, Phone (407) 855-3860

Bartow, 1525 Centennial Drive, Bartow, Florida 33830, Phone (863) 533-0858

Cocoa, 1300 N. Cocoa Boulevard, Cocoa, Florida 32922, Phone (321) 632-2503

Fort Myers, 9970 Bavaria Road, Fort Myers, Florida 33913, Phone (239) 768-6600

Miami, 2608 W. 84th Street, Hialeah, Florida, 33016, Phone (305) 825-2683

Port St. Lucie, 460 NW Concourse Place, Unit #1, Port St. Lucie, Florida 34986-2248, Phone (772) 878-0072

Sarasota, 78 Sarasota Center Boulevard, Sarasota, Florida 34240, Phone (941) 922-3526

Tallahassee, 3175 West Tharpe Street, Tallahassee, Florida 32303, Phone (850) 576-6131

Tampa, 3925 Coconut Palm Drive, Suite 115, Tampa, Florida 33619, Phone (813) 620-3389

West Palm Beach, 2511 Westgate Avenue, Suite 10, West Palm Beach, Florida 33409, Phone (561) 687-8200

LOUISIANA

Alexandria, 3609 MacLee Drive, Alexandria, Louisiana 71302, Phone (318) 443-2888

Baton Rouge, 316 Highlandia Drive, Baton Rouge, Louisiana 70810, Phone (225) 752-4790

Monroe, 1122 Hayes Street, Monroe, Louisiana 71292, Phone (318) 387-4103

New Orleans, 1305 Distributors Row, Suite 1, Jefferson, Louisiana 70123, Phone (504) 835-2593

Shreveport, 7222 Greenwood Road, Shreveport, Louisiana 71119, Phone (318) 636-3723


MEMBERS:

A.S.F.E.

American Concrete Institute

American Society for Testing and Materials

Florida Institute of Consulting Engineers



Ardaman & Associates, Inc.

Geotechnical, Environmental and
Materials Consultants

August 13, 2014
File No. 14-7135

TO: Kimley Horn & Associates, Inc.
655 N. Franklin Street, Suite 150
Tampa, FL 33602

Attention: Wayne White

SUBJECT: Subsurface Soil Exploration for Proposed Force Main 15D Replacement,
59th Street West at Manatee Avenue West, Bradenton, Manatee County, Florida

Dear Wayne:

As requested, our firm has completed a subsurface soil exploration program at the site referenced above. The purpose of this program was to assess subsurface soil conditions at the proposed underground pipeline replacement.

This report documents our findings and conclusions. It has been prepared for the exclusive use of Kimley Horn & Associates, Inc. for specific application to the subject project, in accordance with generally-accepted geotechnical engineering practices.

SCOPE

The scope of our services has included the following items:

1. Conducting two (2) Standard Penetration Test borings to determine the nature and condition of the subsurface soils.
2. Reviewing each soil sample obtained in our field testing program by a geotechnical engineer in the laboratory for further investigation, classification and assignment of laboratory tests, if required.
3. Preparing this report to document the results of our field testing program.

SITE LOCATION

The subject site is located within Section 29, Township 34 South, Range 17 East, in Manatee County, Florida. The site is at the intersection of 59th Street West and Manatee Avenue West. The borings were performed at the requested locations, as shown on the attached Figure 1.

FIELD EXPLORATION PROGRAM

Our field exploration program consisted of conducting two (2) Standard Penetration Test borings at the locations shown on the attached Figure 1. These borings were performed to determine the nature and condition of the subsurface soils to a depth of 20 feet below the existing ground surface. Test boring depths, location and number were determined by Kimley-Horn. The equipment and procedures used in the borings are described in the Appendix of this report.

Test borings were located in the field utilizing an aerial photograph of the site and visual reckoning to available landmarks. The locations should be considered accurate only to the degree implied by the method used. Should more accurate locations be required, a registered land surveyor should be retained.

GENERAL SUBSURFACE CONDITIONS

The general subsurface conditions encountered during the field exploration program are depicted on the graphic soil profiles (boring logs) on Figure 1 of this report. Soil stratification is based on examination of recovered soil samples and interpretation of field boring logs. The stratification lines represent the approximate boundaries between the soil types, while the actual transitions may be gradual.

On the date of our field exploration program, the groundwater table was encountered at a depth of approximately four to six feet below the existing ground surface. The groundwater table is anticipated to fluctuate due to seasonal rainfall variations and other factors.

LABORATORY TESTING PROGRAM

Representative soil samples obtained during our field sampling operation were packaged and transferred to our office and, thereafter, examined by a geotechnical engineer to obtain more accurate descriptions of the existing soil strata. The soil descriptions shown on the soil profiles are based on a visual classification procedure in general accordance with the Unified Soil Classification System (ASTM D-2487 or D-2488).



ANALYSIS AND RECOMMENDATIONS

We understand that the subject pipeline will be installed by horizontal directional drilling (HDD) or jack and bore methods. The soils encountered within a depth of 20 feet consisted primarily of loose to medium dense fine sand (SP) to fine sand with silt (SP-SN). Although it was not within our scope of work to recommend drilling depths or other details of the installation, we see no geotechnical reason why installation by these methods would not be technically feasible.

GENERAL COMMENTS

The analysis and recommendations submitted in this report are based upon the data obtained from two (2) test borings performed at the locations indicated on the attached Figure 1. This report does not reflect any variations which may occur between the borings. While the borings are representative of the subsurface conditions at their respective locations and within their respective vertical reaches, local variations characteristic of the subsurface materials of the region are anticipated and may be encountered. The nature and extent of variations may not become evident until during the course of a ground improvement program, if such a program is undertaken. If variations then appear evident, it will be necessary to reevaluate the recommendations of this report, after performing on-site observations during the construction period and noting the characteristics of any variations. The boring logs and related information are based upon the driller's logs and visual examination of selected samples in the laboratory. The delineation between soil types shown on the logs is approximate, and the description represents our interpretation of the subsurface conditions at the designated boring location on the particular date drilled.


The groundwater table depths shown on the boring logs represent the groundwater surfaces encountered on the dates shown. Fluctuation of the groundwater table should be anticipated throughout the year.




It has been a pleasure to be of assistance to you with this project. Please contact us when we may be of further service to you, or should you have any questions concerning this report.

Very truly yours,

ARDAMAN & ASSOCIATES, INC.
Certificate of Authorization No. 5950


8/13/14
Jerry H. Kuehn, P.E.
Senior Project Engineer
Fl. License No. 35557

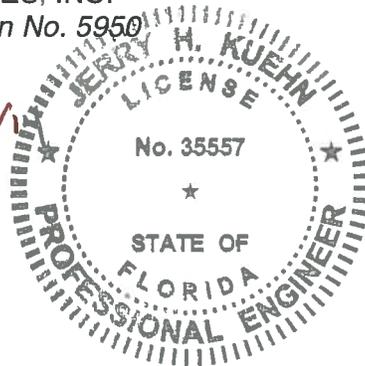


Gary H. Schmidt, P.E.
Vice President
Fl. License No. 12305

JHK/GHS:ly



APPENDIX

SOIL BORING, SAMPLING AND TESTING METHODS

Standard Penetration Test

The Standard Penetration Test (SPT) is a widely accepted method of in situ testing of foundation soils (ASTM D-1586). A 2-foot long, 2-inch O.D. split-barrel sampler attached to the end of a string of drilling rods is driven 18 inches into the ground by successive blows of a 140-pound hammer freely dropping 30 inches. The number of blows needed for each 6 inches of penetration is recorded. The sum of the blows required for penetration of the second and third 6-inch increments of penetration constitutes the test result or N-value. After the test, the sampler is extracted from the ground and opened to allow visual examination and classification of the retained soil sample. The N-value has been empirically correlated with various soil properties allowing a conservative estimate of the behavior of soils under load. The following tables relate N-values to a qualitative description of soil density and, for cohesive soils, an approximate unconfined compressive strength (Q_u):

Cohesionless Soils:	<u>N-Value</u>	<u>Description</u>
	0 to 4	Very loose
	4 to 10	Loose
	10 to 30	Medium dense
	30 to 50	Dense
	Above 50	Very dense

Cohesive Soils:	<u>N-Value</u>	<u>Description</u>	<u>Q_u (ton/ft²)</u>
	0 to 2	Very soft	Below 0.25
	2 to 4	Soft	0.25 to 0.50
	4 to 8	Medium stiff	0.50 to 1.0
	8 to 15	Stiff	1.0 to 2.0
	15 to 30	Very stiff	2.0 to 4.0
	Above 30	Hard	Above 4.0

The tests are usually performed at 5-foot intervals. However, more frequent or continuous testing is done by our firm through depths where a more accurate definition of the soils is required. The test holes are advanced to the test elevations by rotary drilling with a cutting bit, using circulating fluid to remove the cuttings and hold the fine grains in suspension. The circulating fluid, which is a bentonitic drilling mud, is also used to keep the hole open below the water table by maintaining an excess hydrostatic pressure inside the hole. In some soil deposits, particularly highly pervious ones, NX-size flush-coupled casing must be driven to just above the testing depth to keep the hole open and/or prevent the loss of circulating fluid.

Representative split-spoon samples from each sampling interval and from every different stratum are brought to our laboratory in air-tight jars for further evaluation and testing, if necessary. After thorough examination and testing of the samples, the samples are discarded unless prior arrangements have been made. After completion of a test boring, the hole is kept open until a steady state groundwater level is recorded. The hole is then sealed, if necessary, and backfilled.

Laboratory Test Methods

Soil samples returned to our laboratory are examined by a geotechnical engineer or geotechnician to obtain more accurate descriptions of the soil strata. Laboratory testing is performed on selected samples as deemed necessary to aid in soil classification and to further define engineering properties of the soils. The test results are presented on the soil boring logs at the depths at which the respective sample was recovered, except that grain size distributions or selected other test results may be presented on separate tables, figures or plates as described in this report. The soil descriptions shown on the logs are based upon a visual-manual classification procedure in general accordance with the Unified Soil Classification System (ASTM D-2488-84) and standard practice. Following is a list of abbreviations which may be used on the boring logs or elsewhere in this report.

-200	- Fines Content (percent passing the No. 200 sieve); ASTM D1140
DD	- Dry Density of Undisturbed Sample; ASTM D2937
Gs	- Specific Gravity of Soil; ASTM D854
k	- Hydraulic Conductivity (Coefficient of Permeability)
LL	- Liquid Limit; ASTM D423
OC	- Organic Content; ASTM D2974
pH	- pH of Soil; ASTM D2976
PI	- Plasticity Index (LL-PL); ASTM D424
PL	- Plastic Limit; ASTM D424
Qp	- Unconfined Compressive Strength by Pocket Penetrometer;
Qu	- Unconfined Compressive Strength; ASTM D2166 (soil), D7012 (rock)
SL	- Shrinkage Limit; ASTM D427
ST	- Splitting Tensile Strength; ASTM D3967 (rock)
USCS	- Unified Soil Classification System; ASTM D2487, D2488
w	- Water (Moisture) Content; ASTM D2216

Soil Classifications

The soil descriptions presented on the soil boring logs are based upon the Unified Soil Classification System (USCS), which is the generally accepted method (ASTM D-2487 and D-2488) for classifying soils for engineering purposes. The following modifiers are the most commonly used in the descriptions.

For Sands:	<u>Modifier</u>	<u>Fines, Sand or Gravel Content*</u>
	"with silt" or "with clay"	5% to 12% fines
	"silty" or "clayey"	12% to 50% fines
	"with gravel" or "with shell"	15% to 50% gravel or shell


For Silts or Clays:	<u>Modifier</u>	<u>Fines, Sand or Gravel Content*</u>
	"with sand"	15% to 30% sand and gravel; and % sand > % gravel
	"sandy"	30% to 50% sand and gravel; and % sand > % gravel
	"with gravel"	15% to 30% sand and gravel; and % sand < % gravel
	"gravelly"	30% to 50% sand and gravel; and % sand < % gravel

* May be determined by laboratory testing or estimated by visual/manual procedures.
Fines content is the combined silt and clay content, or the percent passing the No. 200 sieve.

Other soil classification standards may be used, depending on the project requirements. The AASHTO classification system is commonly used for highway design purposes and the USDA soil textural classifications are commonly used for septic (on-site sewage disposal) system design purposes.

BOR # 1
 DATE 8/8/2014
 DRILLER DPMO
 HAMMER Auto
 RIG CME-45

BOR # 2
 DATE 8/8/2014
 DRILLER DPMO
 HAMMER Auto
 RIG CME-45

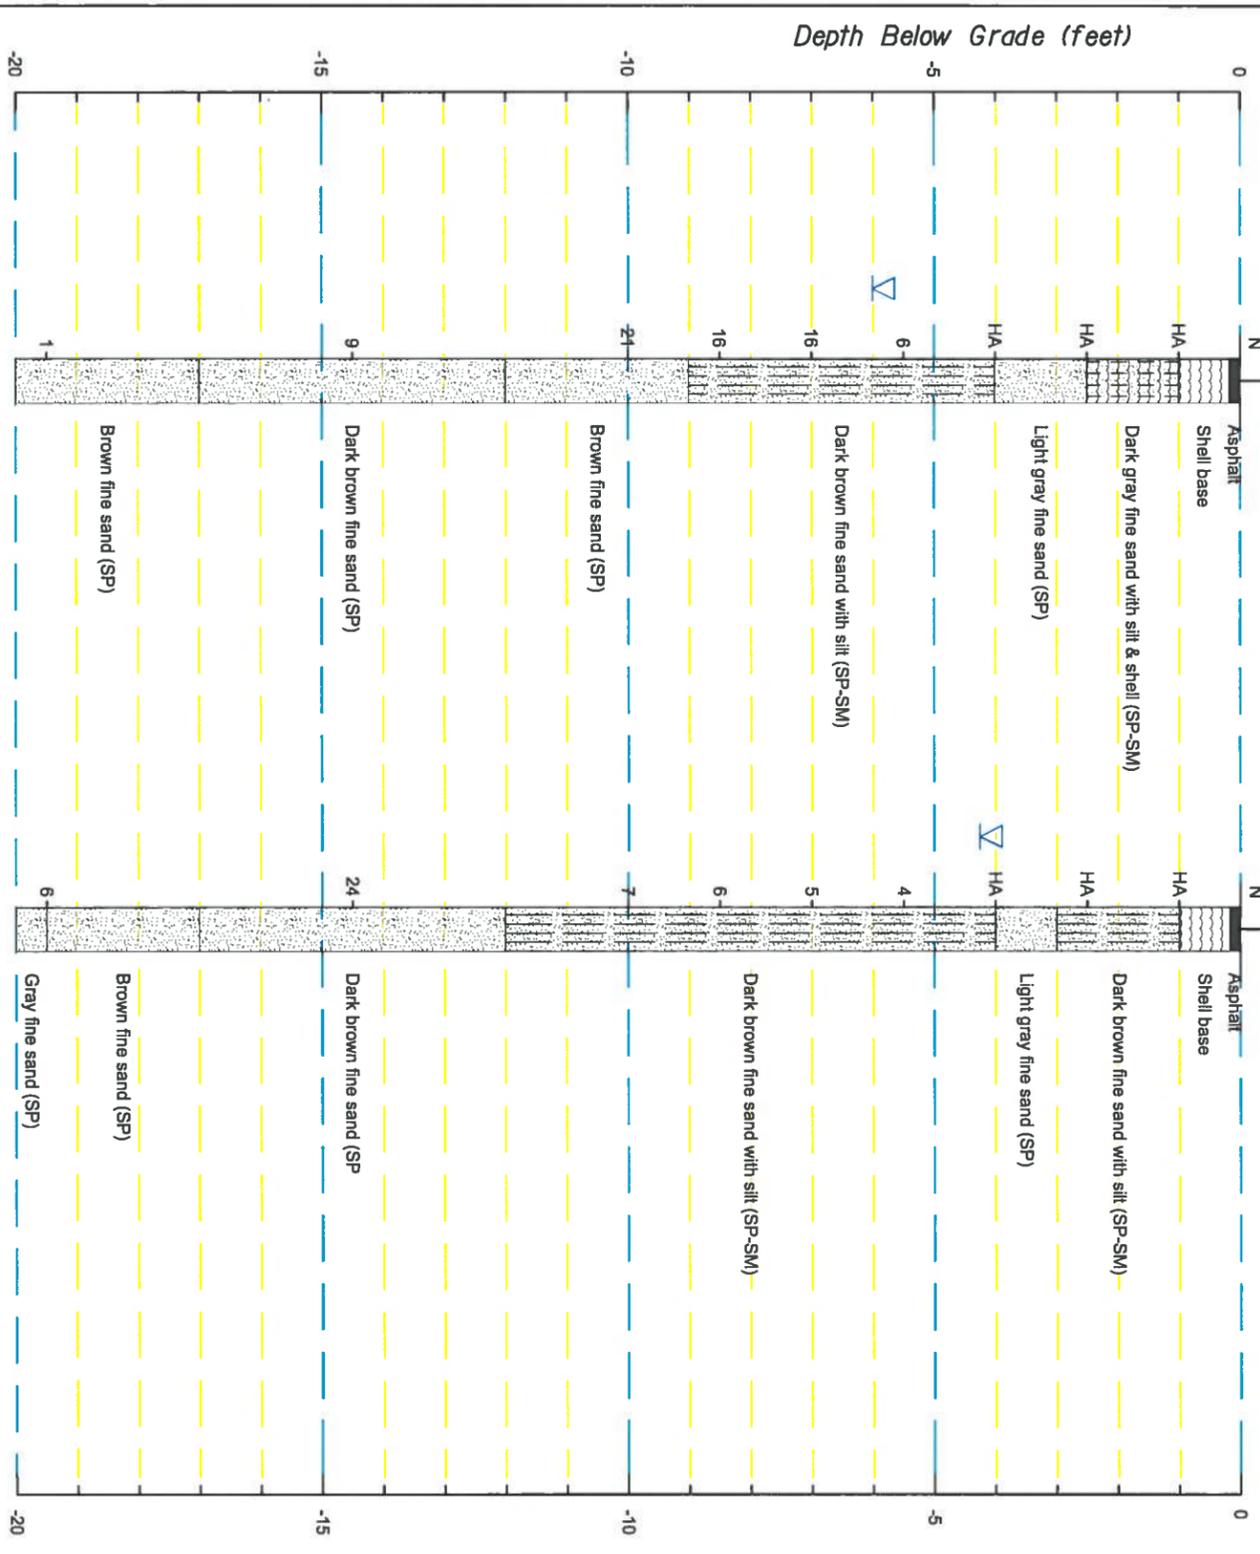

SCALE: 1"=100'

Base PDF Image By: Kimley-Horn
 TEST BORING LOCATIONS

LEGEND

▽ GROUNDWATER LEVEL MEASURED ON DATE DRILLED

N SPT N-VALUE IN BLOWS PER FOOT (UNLESS OTHERWISE NOTED)

SPT N VALUES CONVERTED TO EQUIVALENT SAFETY HAMMER

HA HAND AUGER

GRANULAR MATERIALS- RELATIVE DENSITY	SPT (BLOWS/FOOT)
VERY LOOSE	LESS THAN 4
LOOSE	4-10
MEDIUM DENSE	10-30
DENSE	30-50
VERY DENSE	GREATER THAN 50

SILTS AND CLAYS CONSISTENCY	SPT (BLOWS/FOOT)
VERY SOFT	LESS THAN 4
SOFT	2-4
MEDIUM STIFF	4-15
VERY STIFF	15-30
HARD	GREATER THAN 30

Ardaman & Associates, Inc.
 Geotechnical, Environmental and
 Materials Consultants

Test Locations/Soil Boring Logs
 Force Main 15D Replacement
 59th St. W. at Manatee Ave. W.
 Bradenton, Manatee County, Florida

DRAWN BY: KGS
 CHECKED BY: [Signature]
 DATE: 8/12/14
 FILE NO.: 14-7135
 APPROVED BY: [Signature]
 PLOTTED: 1

PERMIT VOID UNLESS DOT OPERATIONS CENTER IS NOTIFIED 48 HRS IN ADVANCE OF STARTING WORK
PHONE (901) 359-7300
VERIFICATION NO. _____

Soil All Portions of Disturbed Right-Of-Way.


ALL CONTRACTORS AND SUBCONTRACTORS SHALL BE RESPONSIBLE FOR COMPLIANCE WITH PERMITTED MOT PLAN

RULE 14-46

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION

710-010-85
 UTILITIES
 OGC - 08/10

UTILITY PERMIT

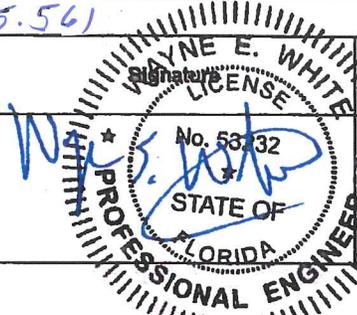PERMIT NO.: <u>2014-H-194-114</u>		SECTION NO.: <u>13150</u>		STATE ROAD <u>64</u>	COUNTY <u>Manatee</u>
FDOT construction is proposed or underway.			<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	Financial Project ID:
Is this work related to an approved Utility Work Schedule?			<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	If yes, Document Number:
PERMITTEE:	<u>Manatee County</u>				
ADDRESS:	<u>1022 26th Avenue East</u>		TELEPHONE NUMBER: <u>(941) 708 - 7450</u>		
CITY/STATE/ZIP:	<u>Bradenton, FL, 34208</u>				
The above PERMITTEE requests permission from the State of Florida Department of Transportation, hereinafter called the FDOT, to construct, operate and maintain the following: <u>Approximately 550 LF of 20" PVC Force Main located at located at the intersection of 59th Street West and Manatee Ave. The force main will cross SR 64 W by jack and bore in 36" steel casing. The project also include the installation of a doghouse manhole.</u>					
FROM:	<u>M.P. 5.561</u>		TO:	<u>M.P. 5.561</u>	
Submitted for the PERMITTEE by: Name and Company (Typed or Printed Legibly)	Contact Information Address/Telephone/E-Mail (if applicable)			Signature	Date
<u>Wayne White, P.E. Kimley-Horn and Associates, Inc.</u>	<u>655 North Franklin Street Suite 150 Tampa, FL 33602 813-635-5545 wayne.white@kimley-horn.com</u>				<u>7/30/2014</u>

- The Permittee declares that prior to filing this application, the location of all existing utilities that it owns or has an interest in, both aerial and underground, are accurately shown on the plans and a letter of notification was mailed on 5/13/2014 to the following utilities known to be involved or potentially impacted in the area of the proposed installation:
TECO, Brighthouse Networks, Florida Power and Light, Verizon Wireless, Manatee County Utility and Transportation
- The local Maintenance or Resident Engineer, hereafter referred to as the FDOT Engineer, shall be notified a minimum of forty eight (48) hours in advance prior to starting work and again immediately upon completion of work. The FDOT's Engineer is Ed Giddens ALBERT ROSENSTEIN P.E. located at 1840 61st Street, Telephone Number 941-465-0737 359-7300.
The Permittee's employee responsible for MOT is To Be Determined
Telephone Number To Be Determine (This name may be provided at the time of the forty eight (48) hour advance-notice prior to starting work).
- All work, materials, and equipment shall be subject to inspection and approval by the FDOT Engineer.
- All plans and installations shall conform to the requirements of the FDOT's UAM in effect as of the date this permit is approved by FDOT, and shall be made a part of this permit. This provision shall not limit the authority of the FDOT under Paragraph 8 of this Permit.
- This Permittee shall commence actual construction in good faith within 60 days after issuance of permit, and shall be completed within 365 days after the permitted work has begun. If the beginning date is more than sixty (60) days from the date of permit approval, the Permittee must review the permit with the FDOT Engineer to make sure no changes have occurred to the Transportation Facility that would affect the permitted construction.
- The construction and maintenance of such utility shall not interfere with the property and rights of a prior Permittee.
- It is expressly stipulated that this permit is a license for permissive use only and that the placing of utilities upon public property pursuant to this permit shall not operate to create or vest any property right in said holder, except as provided in executed subordination and Railroad Utility Agreements.
- Pursuant to Section 337.403, Florida Statutes, any utility placed upon, under, over, or along any public road or publicly owned rail corridor that is found by FDOT to be unreasonably interfering in any way with the convenient, safe, or continuous use, or maintenance, improvement, extension, or expansion, of such public road or publicly owned rail corridor shall, upon thirty (30) days written notice to the utility or its agent by FDOT, be removed or relocated by such utility at its own expense except as provided in Section 337.403(1), Florida Statutes, and except for reimbursement rights set forth in previously executed subordination and Railroad Utility Agreements, and shall apply to all successors and assigns for the permitted facility.
- It is agreed that in the event the relocation of said utilities are scheduled to be done simultaneously with the FDOT's construction work, the Permittee will coordinate with the FDOT before proceeding and shall cooperate with the FDOT's contractor to arrange the sequence of work so as not to delay the work of the FDOT's contractor, defend any legal claims of the FDOT's contractor due to delays caused by the Permittee's failure to comply with the approved schedule, and shall comply with all provisions of the law and the FDOT's current UAM. The Permittee shall not be responsible for delay beyond its control.
- In the case of non-compliance with the FDOT's requirements in effect as of the date this permit is approved, this permit is void and the facility will have to be brought into compliance or removed from the R/W at no cost to the FDOT, except for reimbursement rights set forth in previously executed subordination and Railroad Utility Agreements. This provision shall not limit the authority of the FDOT under Paragraph 8 of this Permit.
- It is understood and agreed that the rights and privileges herein set out are granted only to the extent of the State's right, title and interest in the land to be entered upon and used by the Permittee, and the Permittee will, at all times, and to the extent permitted by law, assume all risk of and indemnify, defend, and save harmless the State of Florida and the FDOT from and against any and all loss, damage, cost or expense arising in any manner on account of the exercise or attempted exercises by said Permittee of the aforesaid rights and privileges.
- During construction, all safety regulations of the FDOT shall be observed and the Permittee must take measures, including placing and the display of safety devices that may be necessary in order to safely conduct the public through the project area in accordance with the Federal MUTCD, as amended by the UAM.
- Should the Permittee be desirous of keeping its utilities in place and out of service, the Permittee, by execution of this permit acknowledges its present and continuing ownership of its utilities located between 330 59th Street W and 5905 Manatee Ave West within the FDOT's R/W as set forth above. Whenever the Permittee removes its facilities, it shall be at the Permittee's sole cost and expense. The Permittee, at its sole expense, shall promptly remove said out of service utilities whenever the FDOT determines said removal is in the public interest.
- In the event contaminated soil is encountered by the Permittee or anyone within the permitted construction limits, the Permittee shall immediately cease work and notify the FDOT. The FDOT shall notify the Permittee of any suspension or revocation of the permit to allow contamination assessment and remediation.



NOTE: ALL ABOVE GROUND APPOINTMENTS ARE TO BE LOCATED AT R/W LINE.


UTILITY PERMIT

Said suspension or revocation shall remain in effect until otherwise notified by FDOT

- 15. For any excavation, construction, maintenance, or support activities performed by or on behalf of the FDOT, within its R/W, the Permittee may be required by the FDOT or its agents to perform the following activities with respect to a Permittee's facilities: physically expose or direct exposure of underground facilities, provide any necessary support to facilities and/or cover, de-energize or alter aerial facilities as deemed necessary for protection and safety.
- 16. Pursuant to Section 337.401(2), Florida Statutes, the permit shall require the permit holder to be responsible for damage resulting from the issuance of the permit. The FDOT may initiate injunctive proceedings as provided in s. 120.69 to enforce provisions of this subsection or any rule or order issued or entered into pursuant thereto.
- 17. Pursuant to Section 337.402, Florida Statutes, when any public road or publicly owned rail corridor is damaged or impaired in any way because of the installation, inspection, or repair of a utility located on such road or publicly owned rail corridor, the owner of the utility shall, at his or her own expense, restore the road or publicly owned rail corridor to its original condition before such damage. If the owner fails to make such restoration, the authority is authorized to do so and charge the cost thereof against the owner under the provisions of s.337.404.
- 18. The Permittee shall comply with all provisions of Chapter 556, Florida Statutes, Underground Facilities Damage Prevention and Safety Act.
- 19. Special FDOT instructions: _____

It is understood and agreed that commencement by the Permittee is acknowledgment and acceptance of the binding nature of all the above listed permit conditions and special instructions.

- 20. By receipt of this permit, the Permittee acknowledges responsibility to comply with Section 119.07, Florida Statutes.
- 21. By the below signature, the Permittee hereby represents that no change to the FDOT's standard Utility Permit form, as incorporated by reference into Rule 14-46.001, for this Utility Permit has been made which has not been previously called to the attention of the FDOT (and signified to by checking the appropriate box below) by a separate attached written document showing all changes and the written and dated approval of the FDOT Engineer. Are there attachments reflecting change/s to the standard form? NO YES If Yes, _____ pages are attached.

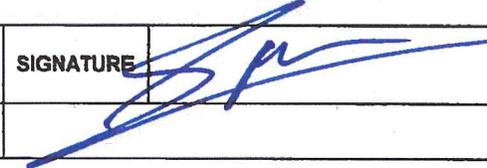PERMITTEE	Sia Mollanazar, P.E. Deputy Director Manatee County Engineering Services Division	SIGNATURE		DATE:	8-1-14
	Name & Title of Authorized Permittee or Agent (Typed or Printed Legibly)				
APPROVED BY:				ISSUE DATE:	8/18/14
	District Maintenance Engineer or Designee				

UTILITY PERMIT FINAL INSPECTION CERTIFICATION

DATE:	
DATE WORK STARTED:	
DATE WORK COMPLETED:	
INSPECTED BY:	
	(Permittee or Agent)
CHANGE APPROVED BY:	DATE:
District Maintenance Engineer or Designee	

I the undersigned Permittee do hereby CERTIFY that the utility construction approved by the above numbered permit was inspected and installed in accordance with the approved plans made a part of this permit and in accordance with the FDOT's current UAM. All plan changes have been approved by the FDOT's Engineer and are attached to this permit. I also certify that the work area has been left in as good or better condition than when the work was begun.

PERMITTEE:	SIGNATURE:	DATE:
Name & Title of Authorized Permittee or Agent (Typed or Printed Legibly)		

CC: District Permit Office
Permittee

Kimley»»Horn

TRANSMITTAL

Date:	08/04/14	Project Name / Number:	148400004, Force Main 15D Rehab.		
Name:	Mr. Ed Giddens, State of Florida Permits Manager			Phone:	941-465-0737
Company Name:	Department of Transportation, Sarasota Operations				
Address:	1840 61 st Street				
City:	Sarasota	State:	FL	Zip	34243

We are sending you via FedEx Courier Hand Delivery Street Mail **the following items:**

Shop Drawings Prints/Plans Specifications Change Orders Samples CD/DVD

<u>Item #</u>	<u># of Copies</u>	<u>Item Description</u>
1		
1	4	Utility Permits Signed and Sealed
2	4	Utility Plans Signed and Sealed

- For Your Use
 Returned for Corrections
 Corrected Prints
 For Your Review & Comment
 As Requested
 Approved as Noted
 Copies for Distribution
 Approved as Submitted
 Return
 Submit
 Resubmit
 Copies for Approval

Remarks:	

Copy To:	File	Sender:	Jordan Walker
-----------------	------	----------------	---------------

813-635-5552

FLORIDA DEPARTMENT OF TRANSPORTATION
Stormwater Pollution Control Reminder

• *Stormwater Management*

Contact your local municipality and/or the Southwest Florida Management District.
Bartow (863) 534-1448

Venice (Sarasota) (941) 278-7396

Fort Myers (Sarasota) (941) 278-7396

- Fort Myers is also part of South Florida Water Management District (800) 432-2045.

• *Used Oil recycling*

Contact the Florida Department of Environmental Protection at (813) 744-6100 or your local automotive parts store.

• *Hazardous Waste Disposal*

Contact the Florida Department of Environmental Protection at (813) 744-6100.

• *Spill Reporting*

State Warning Point (800) 320-0519

Federal Response Center (800) 424-8802

• *Pesticides & Fertilizers*

Contact your Local County Agricultural Extension Service.

Charlotte (941) 764-4340

Collier (239) 353-4244

Desoto (863) 993-4846

Glades (863) 946-0244

Hardee (863) 773-2164

Hendry (863) 674-4094

Highlands (863) 402-6540

Lee (239) 461-7500

Manatee (941) 722-4524


Okeechobee (863) 763-6469


Polk (863) 519-8677

Sarasota (941) 316-1000

LET'S WORK TOGETHER TO KEEP OUR ENVIRONMENT CLEAN...

AND INVEST IN FLORIDA'S FUTURE



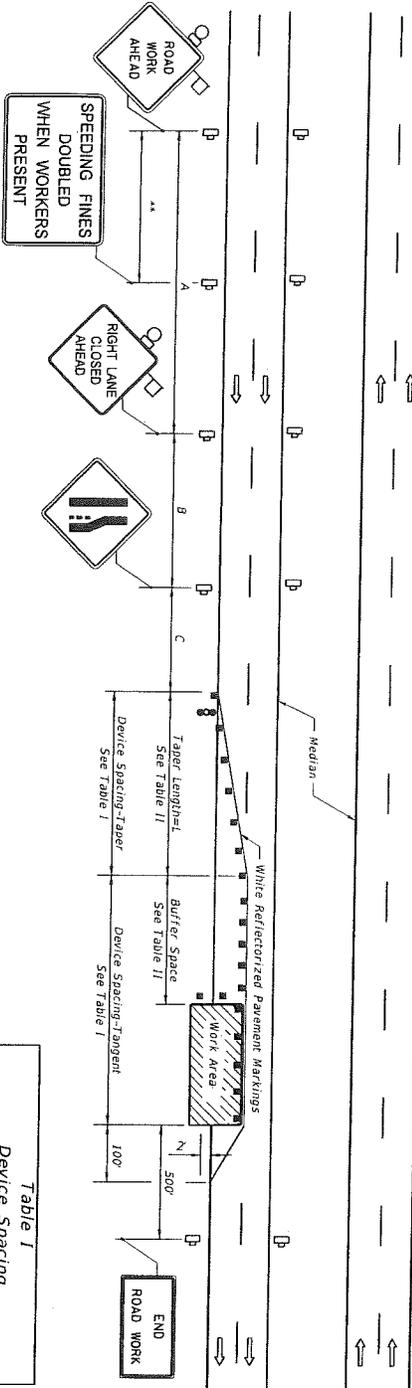

GENERAL NOTES

1. Work operations shall be confined to one traffic lane, leaving the adjacent lane open to traffic.
2. On undivided highways the median signs as shown are to be omitted.
3. When work is performed in the median lane on divided highways, the channelizing device plan is inverted and left lane closed and lane ends signs substituted for the right lane closed and lane end signs.

The same applies to undivided highways with the following exceptions:

- a. Work shall be confined within one median lane.
- b. Additional barricades, cones, or drums shall be placed along the centerline abutting the work area and across the trailing end of the work area.

When work on undivided highways occurs across the centerline so as to encroach on both median lanes, the inverted plan is applied to the approach of both roadways.

4. Signs and traffic control devices are to be modified in accordance with INTERMITTENT WORK STOPPAGE details (Sheet 2 of 2) when no work is being performed and the highway is open to traffic.
5. The two channelizing devices directly in front of the work area may be omitted provided vehicles in the work area have high-intensity rotating, flashing, oscillating, or strobe lights operating.
6. When paved shoulders having a width of 8 ft. or more are closed, channelizing devices shall be used to close the shoulder in advance of the merging taper to direct vehicular traffic to remain within the travel way. See Index No. 612 for shoulder taper formulas.
7. When a side road intersects the highway within the TTC zone, additional TTC devices shall be placed in accordance with other applicable TTC indexes.
8. This TCZ plan does not apply when work is being performed in the middle lane(s) of a six or more lane highway. See Index No. 614.
9. For general TCZ requirements and additional information, refer to Index No. 600.

Table I

Speed (mph)	Device Spacing		
	Max. Distance Between Devices (ft.)	Cones or Tubular Markers	Type I or Type II Barricades or Vertical Panels or Drums
25	25	50	25
30 to 45	25	50	30
50 to 70	25	50	50

DURATION NOTES

1. Temporary white edgeline may be omitted for work operations less than 3 consecutive calendar days.
2. For work operations up to approximately 15 minutes, signs, channelizing devices, arrow board, and buffer space may be omitted if all of the following conditions are met:
 - a. Speed limit is 45 mph or less.
 - b. No sign obstructions to vehicles approaching the work area for a distance equal to the buffer space and the taper length combined.
 - c. Volume and complexity of the roadway has been considered.
 - d. The closed lane is occupied by a class 5 or larger, medium duty trucks with a minimum gross weight vehicle rating (GWVR) of 16,001 lb with high-intensity, rotating, flashing, oscillating, or strobe lights mounted above the cab height and operating.
3. For work operations up to 60 minutes, arrow board and buffer space may be omitted if conditions a, b, and c in DURATION NOTE 2 are met, and vehicles in the work area have high-intensity, rotating, flashing, oscillating, or strobe lights operating.

CONDITIONS

WHERE ANY VEHICLE, EQUIPMENT, WORKERS OR THEIR ACTIVITIES ENCRUCH ON THE LANE ADJACENT TO EITHER SHOULDER AND THE AREA 2' OUTSIDE THE EDGE OF TRAVEL WAY.

Table II

Buffer Space and Taper Length	Speed (mph)	Taper Length (Lateral Transition)	
		Disc. (ft.)	L (ft.)
25	155	125	L = W ² / 60
	200	180	
30	250	245	L = W ² / 60
	305	320	
45	360	540	L = W ² / 60
	425	600	
50	495	660	L = W ² / 60
	570	720	
60	645	780	L = W ² / 60
	720	840	

When Buffer Space cannot be attained due to geometric constraints, the greatest attainable length shall be used, but not less than 200 ft.

For lateral transitions other than 12°, use Where:

- L = Length of taper in feet
- W = Width of lateral transition in feet
- S = Posted speed limit (mph)

DISTANCE BETWEEN SIGNS

Speed	Spacing (ft.)		
	A	B	C
40 mph or less	200	200	300
45 mph	350	350	350
50 mph	500	500	500
55 mph or greater	2000	1500	1000

* The ROAD WORK 1 MILE sign may be used as an alternate to the ROAD WORK AHEAD sign and the RIGHT LANE CLOSED 1/2 MILE sign may be used as an alternate to the RIGHT LANE CLOSED AHEAD sign.

** 500' beyond the ROAD WORK AHEAD sign or midway between signs whichever is less.

SYMBOLS

- Work Area
- Sign With 18" x 18" (M/R)
- Orange Flag And Type B Light
- Channelizing Device (See Index No. 600)
- Work Zone Sign
- Advance Warning Arrow Board

LAST REVISION 07/01/09	DESCRIPTION:	FDOT 2014 DESIGN STANDARDS	MULTILANE, WORK WITHIN TRAVEL WAY MEDIAN OR OUTSIDE LANE	INDEX NO. 613	SHEET NO. 1 of 2
---------------------------	--------------	----------------------------	----------------------------------------------------------	------------------	---------------------

LAST REVISION 07/01/05

DESCRIPTION:

FDOT 2014 DESIGN STANDARDS




MULTILANE, WORK WITHIN TRAVEL WAY MEDIAN OR OUTSIDE LANE

INDEX NO. 613


SHEET NO. 2 OF 2

INTERMITTENT WORK STOPPAGE - LANE REOPENED TO TRAFFIC


UNEVEN PAVEMENT

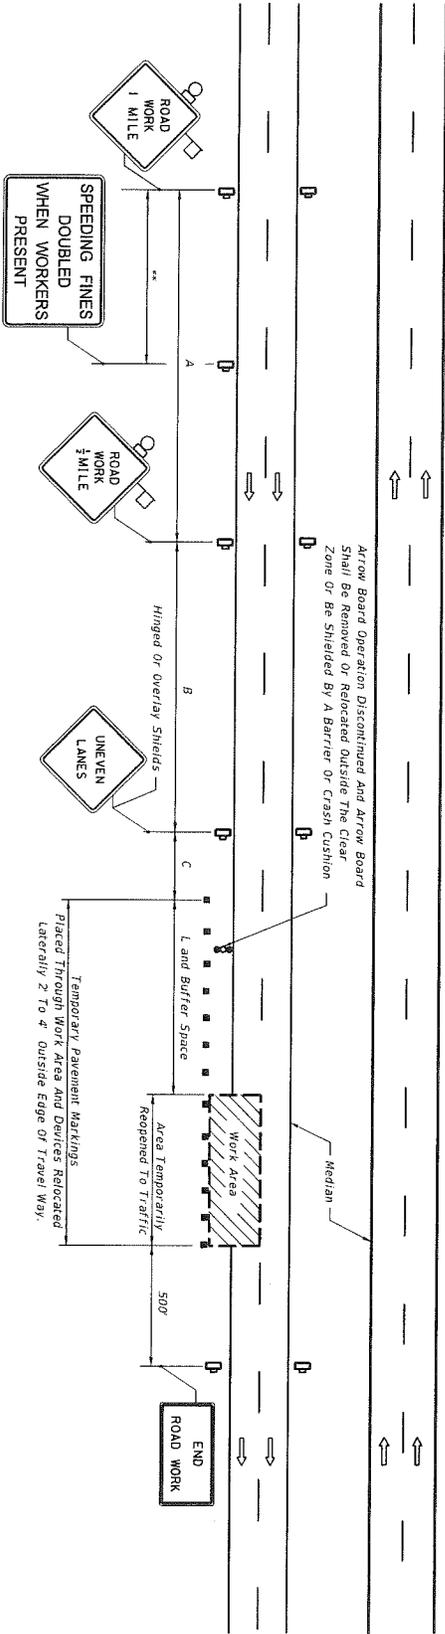

EVEN PAVEMENT

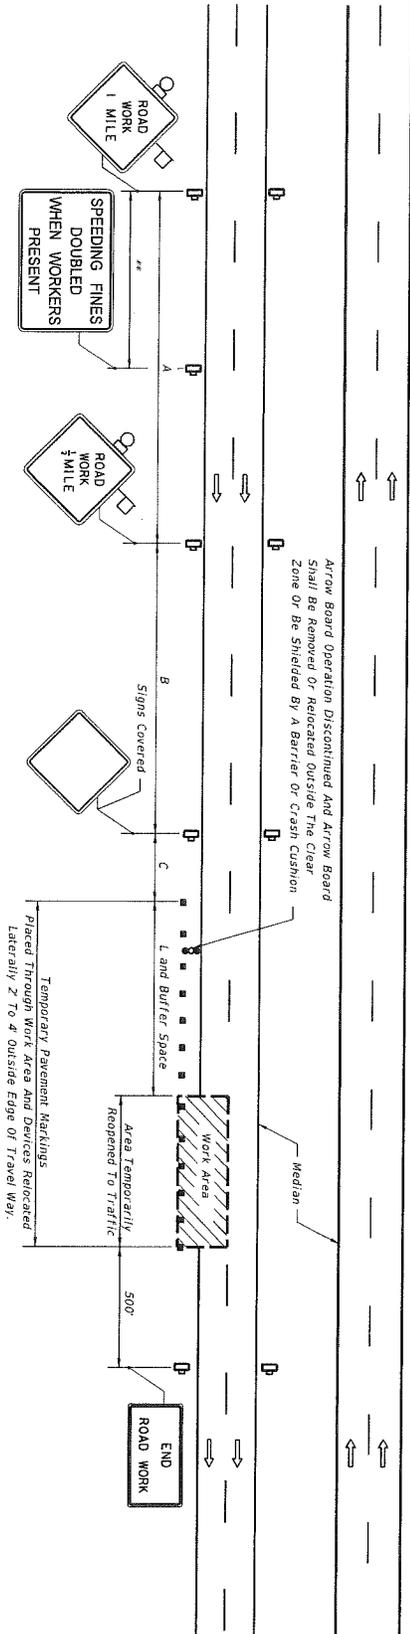

EXISTING POSTED SPEED	PROPOSED WORK ZONE SPEED	REMARKS
MPH 65	MPH 55	The Proposed Work Zone Speeds are recommended speeds for the traffic control plan detailed below; however, where the Engineer deems other speeds are appropriate, the applicable speeds are to be shown on the plans.
MPH 55	MPH 45	
MPH 45	MPH 35	

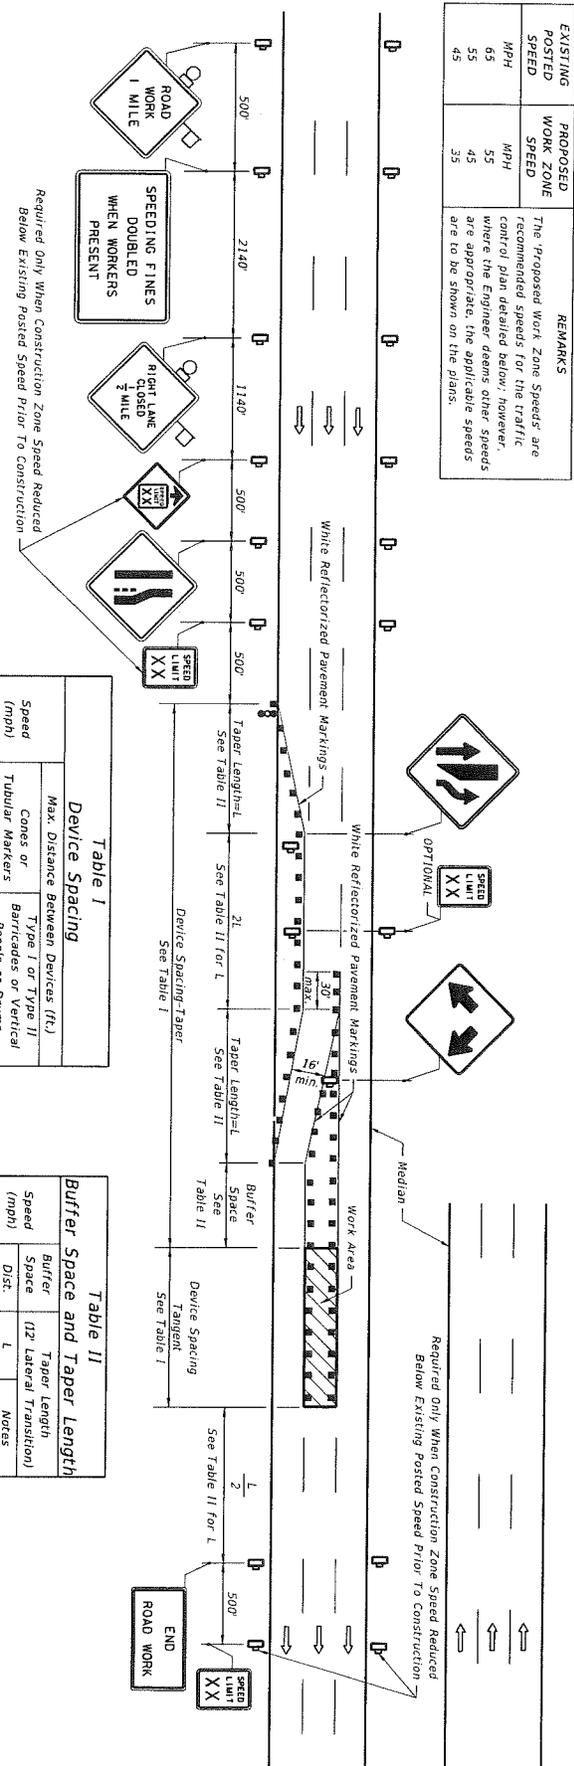

Required Only When Construction Zone Speed Reduced Below Existing Posted Speed Prior To Construction

Required Only When Construction Zone Speed Reduced Below Existing Posted Speed Prior To Construction

Table I
Device Spacing

Speed (mph)	Max. Distance between Devices (ft.)	
	Cones or Tubular Markers	Type I or Type II Barricades or Vertical Panels or Drums
25	25	25
30 to 45	25	50
50 to 70	25	50

Table II
Buffer Space and Taper Length

Speed (mph)	Buffer Space (ft.)	Taper Length (ft.)	Notes
25	155	125	
30	200	180	L = W/5
35	250	245	
40	305	320	L = 60
45	360	540	
50	425	600	L = W/5
55	495	680	
60	570	720	L = W/5
65	645	780	
70	730	840	

- CONDITION NOTES**
- The RIGHT LANE CLOSED and lane reduction signs are to be removed or fully covered when no work is being performed and the center lane is opened to traffic.
 - For work performed in the median or outside lane, refer to Index No. 613.
 - When the lane closure exceeds a continuous 24 hour period, all existing pavement markings within the realignment which conflict with the revised traffic pattern are to be removed and removable pavement marking used for marking new edge lines and centerline.

GENERAL NOTES

- When a side road intersects the highway within the TTC zone, additional TTC devices shall be placed in accordance with other applicable TTC indexes.
- For general TTC requirements and additional information, refer to Index No. 600.


DURATION NOTES

- Temporary pavement markings may be omitted for work operations less than 3 days.

- SYMBOLS**
- Work Area
 - Sign With 18" x 18" (Min.) Orange Flag And Type B Light
 - Channelizing Device (See Index No. 600)
 - Work Zone Sign
 - Advance Warning Arrow Board
 - Lane Identification + Direction of Traffic

LAST REVISION 07/01/07	DESCRIPTION: FDOT 2014 DESIGN STANDARDS	MULTILANE, WORK WITHIN TRAVEL WAY, CENTER LANE	INDEX NO. 614	SHEET NO. 1 of 2
---------------------------	--------------------------------------------	------------------------------------------------	------------------	---------------------

CONDITIONS
WHERE ANY VEHICLE, EQUIPMENT, WORKERS OR THEIR ACTIVITIES ENROACH ON ANY PORTION OF A CENTER LANE OF A MULTILANE HIGHWAY, AND TWO DRIVING LANES ARE MAINTAINED ON THE TRAVEL WAY.

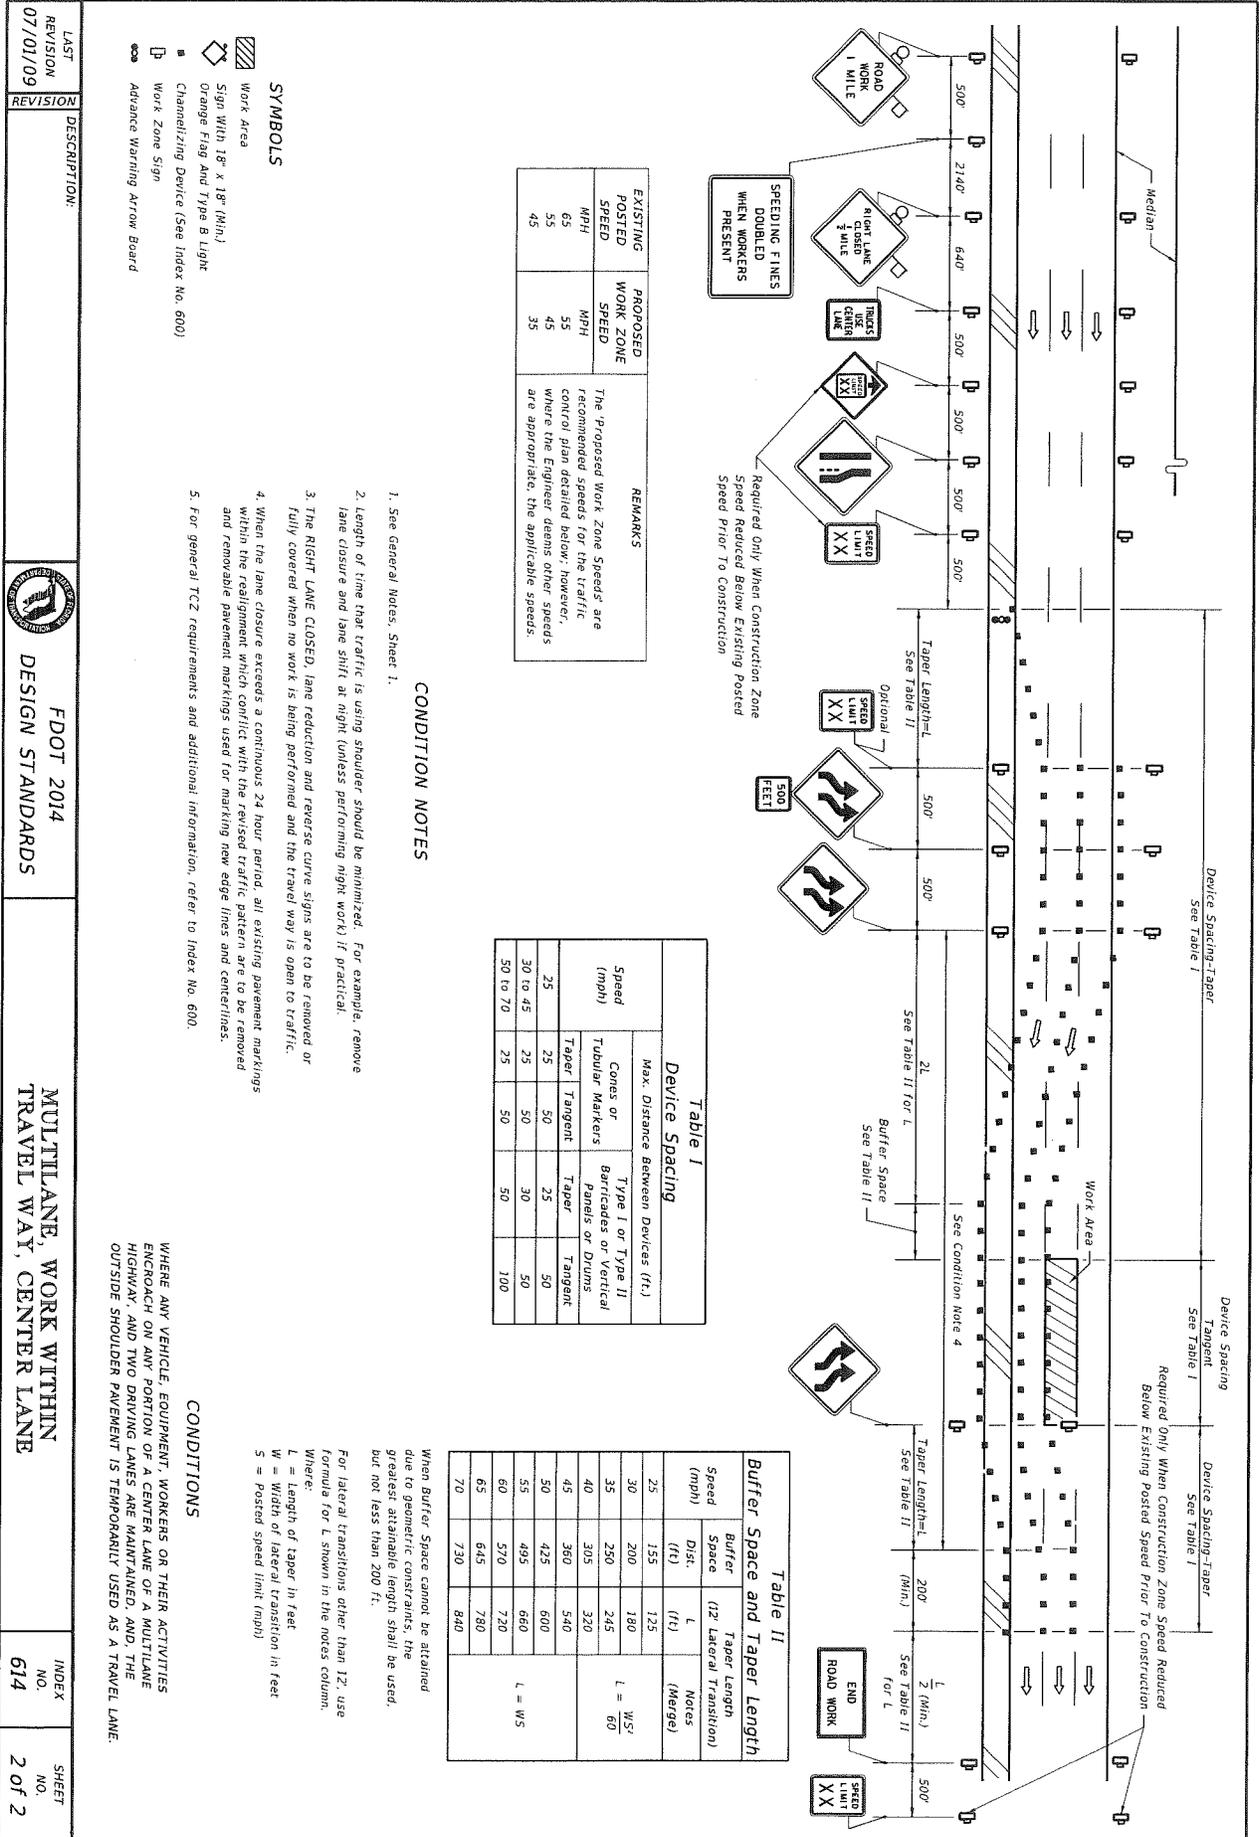

EXISTING POSTED SPEED	PROPOSED WORK ZONE SPEED	REMARKS
MPH 65	MPH 55	The Proposed Work Zone Speeds are recommended speeds for the traffic control plan detailed below; however, where the Engineer deems other speeds are appropriate, the applicable speeds are appropriate.
MPH 55	MPH 45	
MPH 45	MPH 35	

CONDITION NOTES

1. See General Notes, Sheet 1.
2. Length of time that traffic is using shoulder should be minimized. For example, remove lane closure and lane shift at night (unless performing night work) if practical.
3. The RIGHT LANE CLOSED lane reduction and reverse curve signs are to be removed or fully covered when no work is being performed and the travel way is open to traffic.
4. When the lane closure exceeds a continuous 24 hour period, all existing pavement markings within the realignment which conflict with the revised traffic pattern are to be removed and removable pavement markings used for marking new edge lines and centerlines.
5. For general TCZ requirements and additional information, refer to Index No. 600.

Table I
Device Spacing

Speed (mph)	Max. Distance between Devices (ft.)	
	Cones or Tubular Markers	Type I or Type II Barricades or Vertical Panels or Drums
25	25	50
30 to 45	25	50
50 to 70	25	50

Table II
Buffer Space and Taper Length

Speed (mph)	Buffer Space (ft)	Taper Length (ft)	Notes
25	155	125	L = WS/60
30	200	180	
35	250	245	
40	305	320	
45	360	540	
50	425	600	L = WS
55	495	660	
60	570	720	
65	645	780	
70	730	840	

When Buffer Space cannot be attained due to geometric constraints, the greatest attainable length shall be used, but not less than 200 ft.

For lateral transitions other than 12', use formula for L shown in the notes column.

Where:
L = Length of taper in feet
W = Width of lateral transition in feet
S = Posted speed (mph)

CONDITIONS

WHERE ANY VEHICLE, EQUIPMENT, WORKERS OR THEIR ACTIVITIES ENCRUSH OR ANY PORTION OF A CENTER LANE OF A MULTILANE HIGHWAY, AND TWO DRIVING LANES ARE MAINTAINED, AND THE OUTSIDE SHOULDER PAVEMENT IS TEMPORARILY USED AS A TRAVEL LANE.

LAST REVISION 07/01/09	DESCRIPTION: FDOT 2014 DESIGN STANDARDS	MULTILANE, WORK WITHIN TRAVEL WAY, CENTER LANE	INDEX NO. 614	SHEET NO. 2 of 2
---------------------------	--------------------------------------------	------------------------------------------------	------------------	---------------------



GENERAL NOTES

1. Work operations shall be confined to either one lane, or lane combinations as follows:
 - a. Outside travel lane;
 - b. Outside auxiliary lane;
 - c. Outside travel lane and adjoining auxiliary lane;
 - d. Inside travel lane Δ;
 - e. Inside auxiliary lane Δ;
 - f. Inside travel lane and adjoining auxiliary lane Δ
 Δ See Sheet 3
- If the work area is confined to an auxiliary lane the work area shall be barricaded and the **RIGHT (LEFT) LANE CLOSED AHEAD** signs replaced by **ROAD WORK AHEAD** signs, and the merge symbol signs eliminated.
2. When vehicles in a parking zone block the line of sight to TCZ signs, the signs shall be post mounted and located in accordance with Index No. 17302.
3. If the work space extends across a crosswalk, the crosswalk should be closed using the information in Index No. 660.
4. Signs are required on the median side for divided highways.
5. The two channelizing devices directly in front and directly at the end of the work area may be omitted provided vehicles in the work area have high-intensity rotating, flashing, oscillating, or strobe lights operating.
6. For general TCZ requirements and additional information, refer to Index No. 600.

DURATION NOTES

1. For work operations up to approximately 15 minutes, signs channelizing devices, and arrow board may be omitted if all of the following conditions are met:
 - a. Speed limit is 45 mph or less;
 - b. No sight obstructions to vehicles approaching the work area for a distance equal to twice the taper length;
 - c. Volume and complexity of the roadway has been considered;
 - d. The closed lane is occupied by a class 5 or larger, medium duty truck(s) with a minimum gross weight vehicle rating (GVWR) of 16,001 lb with high-intensity, rotating, flashing, oscillating, or strobe lights mounted above the cab height and operating.
2. For work operations up to 60 minutes, the arrow board may be omitted if conditions a, b, and c in DURATION NOTE 1 are met, and vehicles in the work area have high-intensity, rotating, flashing, oscillating, or strobe lights operating.

SYMBOLS

-  Work Area
-  Sign with 18' x 18' (Min.) Orange Flag And Type B Light
-  Work Zone Sign
-  Advance Warning Arrow Board
-  Type III Barricade
-  Channelizing Device (See Index No. 600)
-  Lane Identification + Direction of Traffic

LAST REVISION 07/01/09	DESCRIPTION:	 <p>FDOT 2014 DESIGN STANDARDS</p>	<p>MULTILANE WORK NEAR INTERSECTION MEDIAN OR OUTSIDE LANE</p>	INDEX NO. 616	SHEET NO. 1 OF 3
---------------------------	--------------	-------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------	------------------	---------------------

LAST REVISION
07/01/09

DESCRIPTION:

FDOT 2014
DESIGN STANDARDS


MULTILANE WORK NEAR INTERSECTION
MEDIAN OR OUTSIDE LANE

INDEX NO.
616

SHEET NO.
2 of 3

- The normal procedure is to close on the near side of the intersection any lane that is not carried through the intersection. However, when this results in the closure of a right lane having significant right turning movements, then the right lane may be restricted to right turns only as shown in this detail.
- For intersection approaches reduced to a single lane, left turning movements may be prohibited to maintain capacity for through vehicular traffic.

RIGHT LANE CLOSED ON FAR SIDE OF INTERSECTION WITH SIGNIFICANT RIGHT TURNING MOVEMENTS

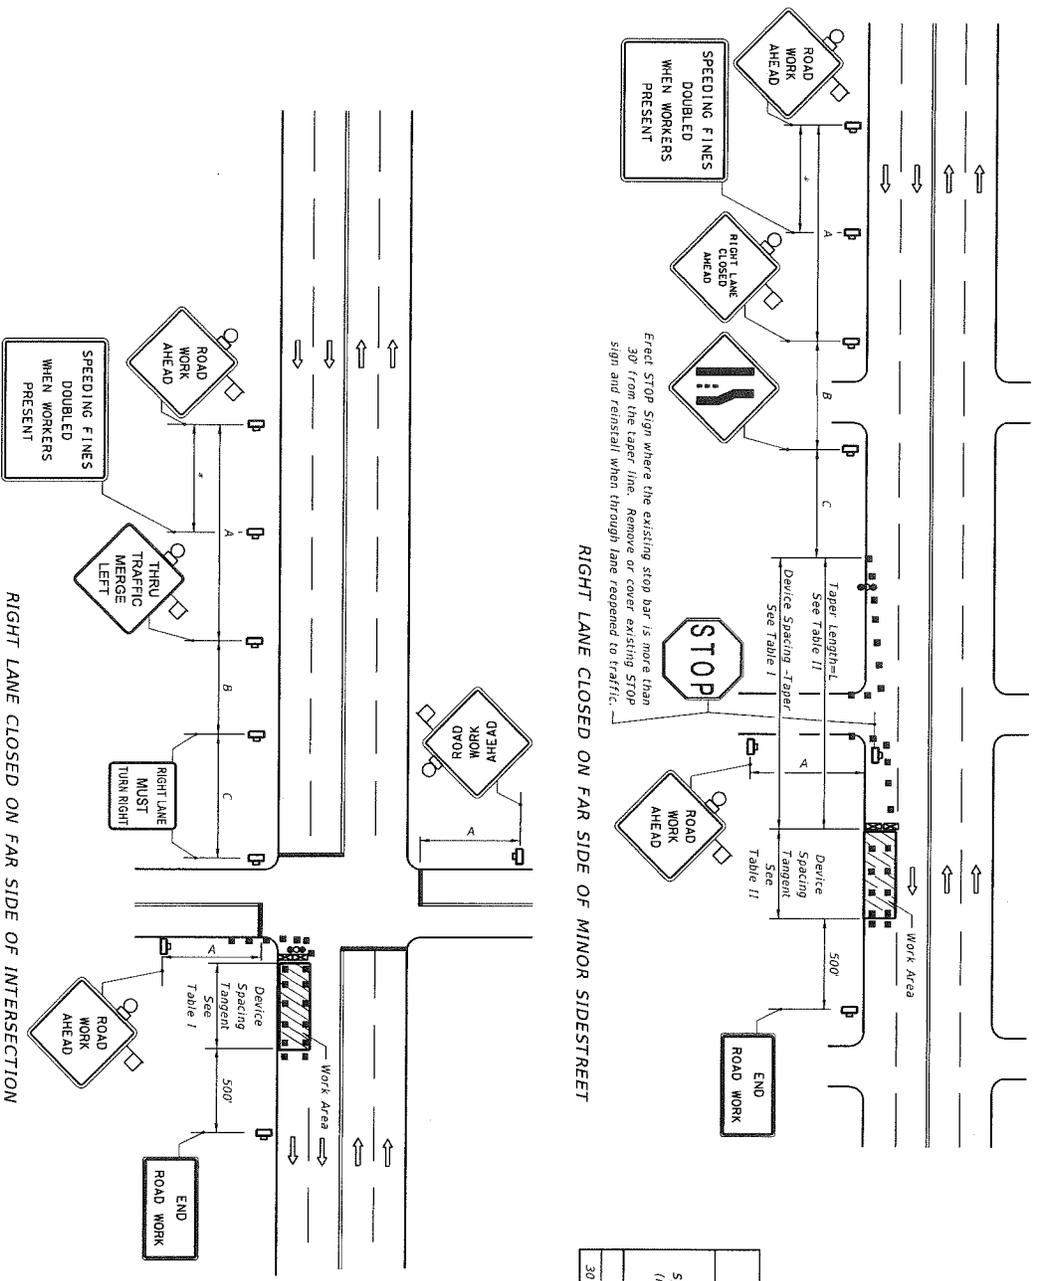

DISTANCE BETWEEN SIGNS

Speed	Spacing (ft.)		
	A	B	C
40 mph or less	200	200	200
45 mph	350	350	350

* 500' beyond the ROAD WORK AHEAD sign or midway between signs whichever is less.

**Table I
Device Spacing**

Speed (mph)	Max. Distance Between Devices (ft.)	
	Cones or Tubular Markers	Type I or Type II Barricades or Vertical Panels or Drums
25	25	25
30 to 45	25	30


**Table II
Taper Length - Merge (12' Lateral Transition)**

Speed (mph)	L (ft.)	Notes (Merge)
25	125	
30	180	$L = WS^2$
35	245	$L = 60$
40	320	
45	540	$L=WS$

For lateral transitions other than 12', use formula for L shown in the notes column. Where:
L = Length of taper in feet
W = Width of lateral transition in feet
S = Posted speed limit (mph)

Erect STOP sign where the existing stop bar is more than 30' from the taper line. Remove or cover existing STOP sign and re-install when through lane reopened to traffic.

RIGHT LANE CLOSED ON FAR SIDE OF MINOR SIDESTREET

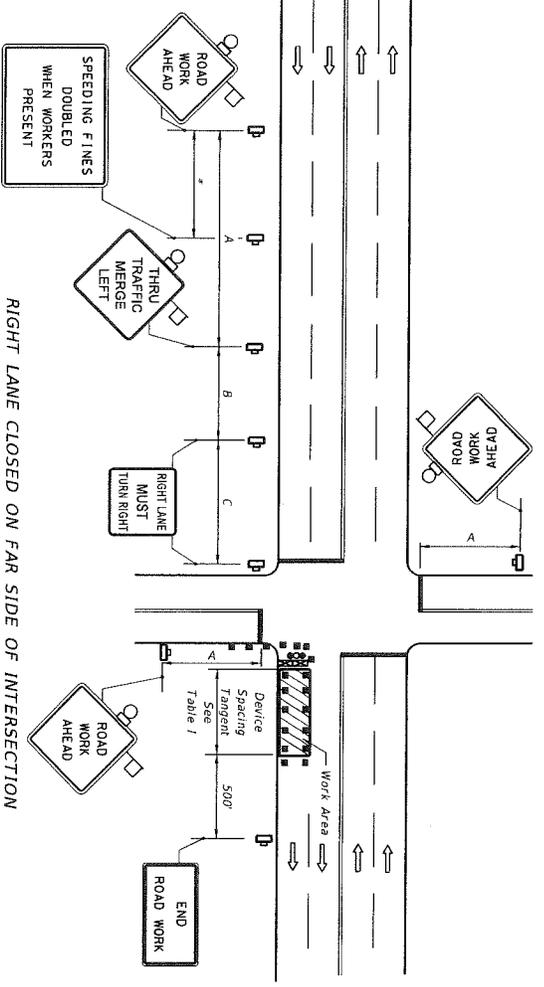


LAST REVISION	07/01/12
---------------	----------

DESCRIPTION:



MULTILANE, WORK NEAR INTERSECTION
MEDIAN OR OUTSIDE LANE

INDEX NO.	616	SHEET NO.	3 OF 3
-----------	-----	-----------	--------

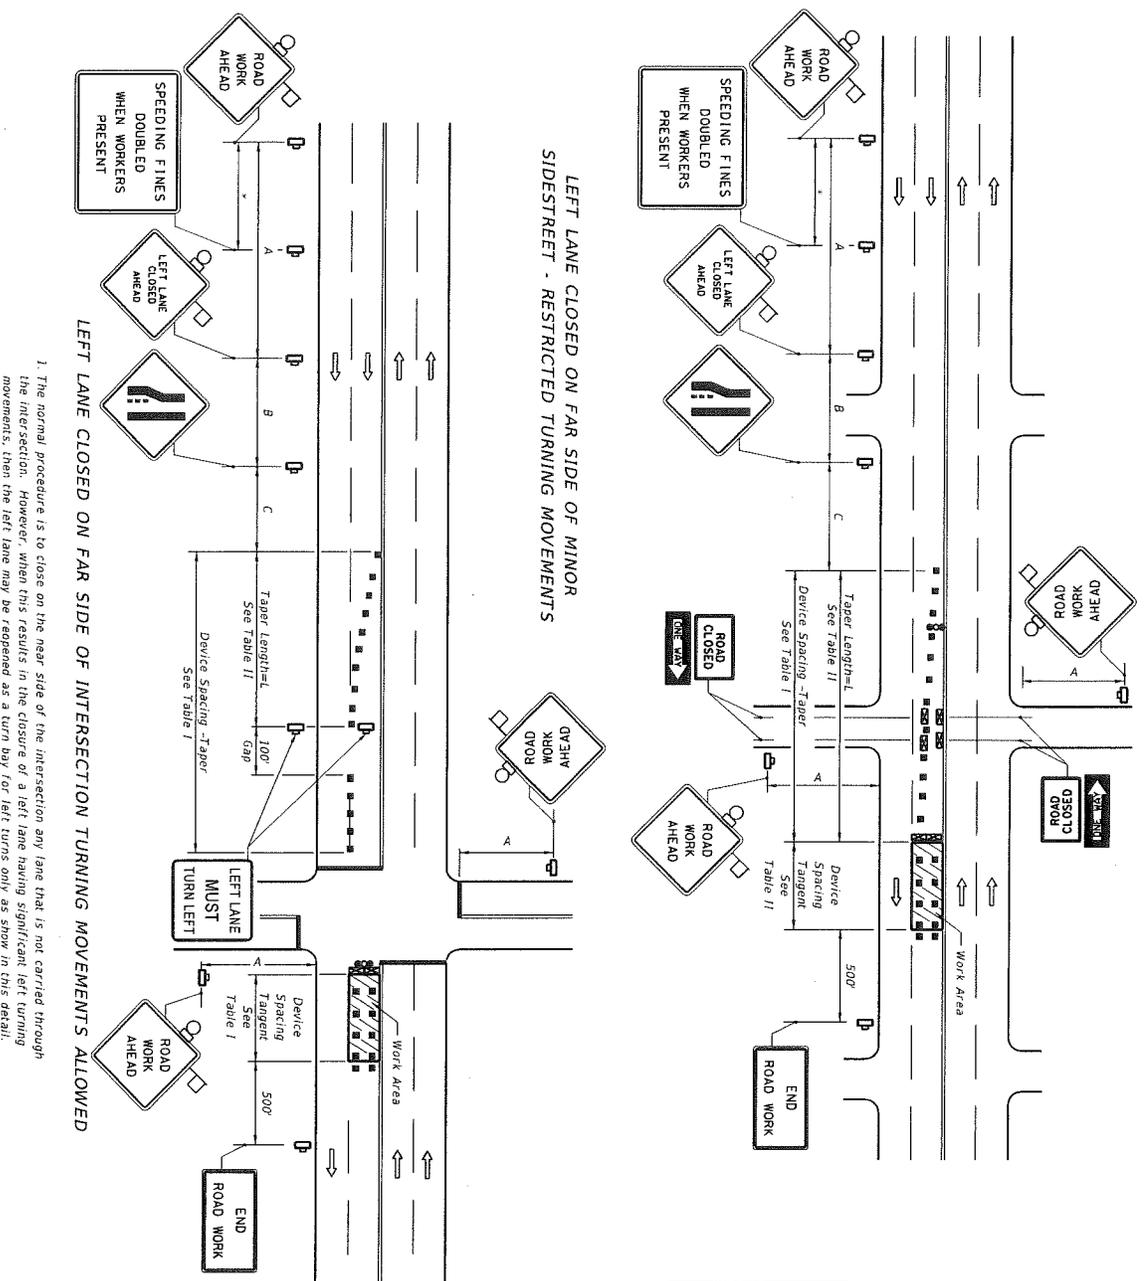

1. The normal procedure is to close on the near side of the intersection any lane that is not carried through the intersection. However, when this results in the closure of a left lane having significant left turning movements, then the left lane may be reopened as a turn bay for left turns only as show in this detail.

LEFT LANE CLOSED ON FAR SIDE OF INTERSECTION TURNING MOVEMENTS ALLOWED

LEFT LANE CLOSED ON FAR SIDE OF MINOR SIDESTREET - RESTRICTED TURNING MOVEMENTS

Table 11
Taper Length - Merge
(12' Lateral Transition)

Speed (mph)	L (ft.)	Notes
25	125	
30	180	L = WS ²
35	245	L = 60
40	320	
45	540	L = WS

For lateral transitions other than 12', use formula for L shown in the notes column. Where:
L = Length of Taper in feet
W = Width of Lateral Transition in feet
S = Posted speed limit (mph)



Table 1
Device Spacing

Speed (mph)	Max. Distance Between Devices (ft.)		
	Type I or Type II Cones or Tubular Markers	Type I or Type II Barricades or Vertical Panels or Drums	Tangent
25	25	50	25
30 to 45	25	50	30

DISTANCE BETWEEN SIGNS

Speed	Spacing (ft.)		
	A	B	C
40 mph or less	200	200	200
45 mph	350	350	350

* 500' beyond the ROAD WORK AHEAD sign or midway between signs whichever is less.

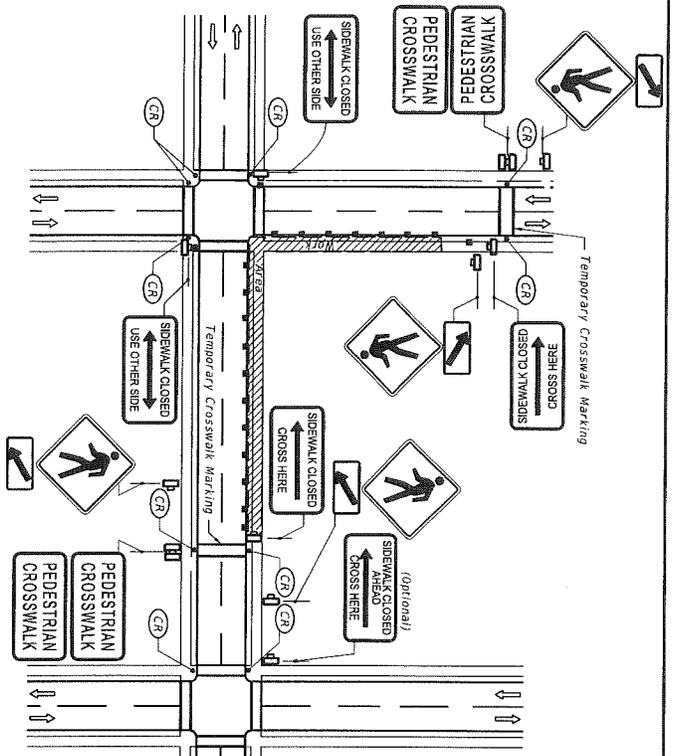

CORNER SIDEWALK CLOSURE WITH TEMPORARY CROSSWALKS

GENERAL NOTES

1. Only the signs controlling pedestrian flows are shown. Other work zone signs will be needed to control traffic on the streets.
2. For spacing of traffic control devices and general T-CZ requirements refer to Index No. 600. Maximum spacing between barricades, vertical panels, drums or tubular markers shall not be greater than 25'.
3. Street lighting should be considered.
4. For nighttime closures use Type A flashing warning lights on barricades supporting signs and closing sidewalks. Use Type C steady-burn lights on channelizing devices separating the work area from vehicular traffic.
5. Pedestrian traffic signal display controlling closed crosswalks shall be covered or deactivated.
6. Post Mounted Signs located near or adjacent to a sidewalk shall have a 7' minimum clearance from the bottom of sign to the sidewalk.
7. When construction activities involve sidewalks on both sides of the street, efforts should be made to stage the construction so that both sidewalks are not out of service at the same time.
8. In the event that sidewalks on both sides of the street are closed, pedestrians shall be guided around the construction zone.
9. Temporary walkways shall be a minimum of 4' wide with a maximum 0.02 cross slope and a maximum 0.05 running slope between ramps. Temporary walkways less than 5' in width shall provide for a 5' x 5' raising space at intervals not to exceed 200'. Temporary ramps shall meet the requirements for curb ramps specified in Index No. 304. Temporary walkway surfaces and ramps shall be stable, firm, slip resistant, and kept free of any obstructions and hazards such as holes, debris, mud, construction equipment, stored materials, etc.
10. Temporary ramps and temporary crosswalk markings shall be removed with reopening of the sidewalk, unless otherwise noted in the plans. All work and materials associated with constructing temporary curb ramps and temporary crosswalk markings, removal and disposal of temporary curb ramps and temporary crosswalk markings, and restoration to original condition shall be paid for as Maintenance of Traffic, Lump Sum.
11. A pedestrian longitudinal channelizing device shall be placed across the full width of the closed sidewalk.

CONDITIONS

WHERE ANY VEHICLE, EQUIPMENT WORKERS OR THEIR ACTIVITIES ENCOACH ON THE SIDEWALK FOR A PERIOD OF MORE THAN 60 MINUTES.

LAST REVISION 07/01/13	DESCRIPTION: Pedestrian Longitudinal Channelizing Device	INDEX NO. 660	SHEET NO. 1 OF 1
 FDOT 2014 DESIGN STANDARDS		PEDESTRIAN CONTROL FOR CLOSURE OF SIDEWALKS	

- SYMBOLS**
- Channelizing Device (See Index No. 600)
 - Work Area
 - Work Zone Sign
 - Required Locations For Either Temporary Or Permanent Curb Ramps.
 - Lane Identification + Direction of Traffic
 - Pedestrian Longitudinal Channelizing Device

PERMIT VOID UNLESS DOT SARASOTA OPERATIONS OFFICE NOTIFIED 48 HOURS IN ADVANCE OF STARTING WORK.
PHONE: (941) 359-7300

IF A LANE CLOSURE IS WITHIN THE PROJECT LIMITS, THE PERMITTEE MUST NOTIFY THE DEPARTMENT 7 DAYS PRIOR TO A LANE CLOSURE TO ALLOW THE DEPARTMENT TO INFORM THE MOTORING PUBLIC. FAILURE TO CALL MAY RESULT IN A DELAY TO BEGIN WORK.

IF NO CLOSURES ARE REQUIRED THE SARASOTA OPERATIONS OFFICE MUST BE NOTIFIED 48 HOURS IN ADVANCE OF STARTING WORK. FAILURE TO CALL MAY RESULT IN A DELAY TO BEGIN WORK.

LANE CLOSURES AND OTHER WORK MAY BE RESTRICTED BY THE FDOT DUE TO HEAVY TRAFFIC AND POTENTIAL BACKUPS CAUSED BY THIS CONSTRUCTION. NIGHT WORK MAY BE REQUIRED.

APPLICANT IS RESPONSIBLE FOR NOTIFYING OWNERS OF ALL EXISTING AERIAL AND BURIED UTILITIES OF PROPOSED DRIVEWAY AND RESOLVING ANY CONFLICTS BEFORE CONSTRUCTION BEGINS.

IN ACCORDANCE WITH FLORIDA STATUS 335.18 PERMITTEE SHALL BE REQUIRED TO BEAR THE COST OF FUTURE ACCESS MODIFICATIONS, TRAFFIC CONTROL DEVICES OR OTHER IMPROVEMENTS, WHEN DETERMINED BY THE FLORIDA DEPARTMENT OF TRANSPORTATION TO BE IN CONJUNCTION WITH ACCEPTED ENGINEERING PRACTICES.

ALL CONSTRUCTION AND/OR MAINTENANCE ON THE DEPARTMENT'S RIGHT-OF-WAY SHALL CONFORM TO THE FEDERAL MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) THE DEPARTMENT'S ROADWAY AND TRAFFIC DESIGN STANDARDS AND BRIDGE CONSTRUCTION.

PERMITTEE/CONTRACTOR MUST WAIT 30 DAYS TO ALLOW ASPHALT FRICTION COURSE TO CURE BEFORE PLACING THERMOPLASTIC STRIPING.

OUR REVIEW COMMENTS ARE NOT INCLUDED TO BE INCLUSIVE OF ALL ERRORS AND OMISSIONS. OUR COMMENTS ARE ALSO NOT INTENDED TO AFFECT THE SCOPE OF WORK OR TO BE CONTRARY TO FHWA POLICY, FDOT DESIGN CRITERIA OR SOUND ENGINEERING PRACTICE. THE CONSULTANT/ENGINEER IS SOLELY RESPONSIBLE FOR THE TECHNICAL ACCURACY, ENGINEERING JUDGEMENT, AND QUALITY OF HIS WORK.

ALL CONTRACTORS AND SUBCONTRACTORS SHALL BE RESPONSIBLE FOR COMPLIANCE WITH PERMITTED M.O.T. PLAN.

SOD ALL PORTIONS OF DISTURED RIGHT-OF-WAY.

NOTE: ALL ABOVE GROUND APPURTENANCES TO BE LOCATED AT RIGHT-OF-WAY LINE.

DENSITY REPORTS ARE TO BE SUBMITTED PRIOR TO PLACEMENT OF PAVEMENT.

"PRIOR TO EXCAVATING CONTACT THE CLERK OF THE CIRCUIT COURT FOR POSSIBLE GASOLINE CONFLICT."

THE APPLICANT SHALL NOT, DURING AND AFTER COMPLETION OF PERMITTED CONSTRUCTION, INTRODUCE ANY FORM OR METHOD OF SITE DRAINAGE DISCHARGE INTO THE DRAINAGE FACILITIES ON THE DEPARTMENT OF TRANSPORTATION RIGHT-OF-WAY OR EASEMENT. ANY DISCHARGE SHALL BE IN VIOLATION OF THIS PERMIT.

"PERMITTEE IS CAUTIONED THAT UTILITIES MAY BE LOCATED WITHIN THE CONSTRUCTION AREA."

IT IS THE RESPONSIBILITY OF THE PERMITTEE TO DETERMINE AND COMPLY WITH ALL COUNTY AND MUNICIPAL ORDINANCES THAT ARE RELATIVE TO THE CONSTRUCTION OR OTHER ACTIVITY DESCRIBED ON THIS PERMIT AND ARE MORE STRINGENT THAN DEPARTMENT OF TRANSPORTATION REQUIREMENTS.

N.P.D.E.S. REQUIRES THAT STORM WATER CONTROL MEASURES BE IMPLEMENTED ON ANY PROJECT ON PUBLIC TRANSPORTATION FACILITY RIGHTS-OF-WAY INCLUDING, BUT NOT LIMITED TO MEASURES DESCRIBED IN F.D.O.T. STANDARD DESIGN INDEX DRAWING NUMBERS 102, 103 AND 104.

"IF CONSTRUCTION, RECONSTRUCTION, REPAIR OR MAINTENANCE ACTIVITY NECESSITATES THE CLOSING OF ONE OR MORE TRAVEL LANES OF ANY ROAD ON THE STATE PRIMARY, COUNTY ROAD OR CITY STREET SYSTEM, FOR A PERIOD OF TIME EXCEEDING TWO HOURS, THE PARTY PERFORMING SUCH WORK WILL BE RESPONSIBLE TO GIVE NOTICE TO THE APPROPRIATE LOCAL LAW ENFORCEMENT AGENCY WHICH HAS JURISDICTION WHERE SUCH ROAD IS LOCATED PRIOR TO COMMENCING WORK ON THIS PROJECT"
335.15 F.S.91, 336.048 F.S.91





FLORIDA DEPARTMENT OF
ENVIRONMENTAL PROTECTION

Southwest District Office
13051 North Telecom Parkway
Temple Terrace, Florida 33637-0926

RICK SCOTT
GOVERNOR

CARLOS LOPEZ-CANTERA
LT. GOVERNOR

HERSCHEL T. VINYARD JR.
SECRETARY

July 9, 2014

Sia Mollanazar, P.E., Deputy Director, Engineering
Manatee County
1022 26th Avenue East
Bradenton, FL 34208
Sia.Mollanazar@mymanatee.org

Re: General Permit for Construction of a Domestic Wastewater Collection/Transmission System
Project: Force Main 15D Rehabilitation
Permit No.: CS41-0182063-153-DWC/CG
County: Manatee

Dear Mr. Mollanazar:

The Department has received your Notice of Intent to Use the General Permit to construct a domestic wastewater collection/transmission system. This project consists of 20-inch diameter force main pipe and 1 manhole. No additional flow will be generated by this project; treatment will be at the Manatee County Southwest Wastewater Treatment Facility. The Department received this Notice on July 7, 2014.

The Department has no objection to your use of a General Permit for the construction of a collection/ transmission system that has been designed in accordance with the standards and criteria set forth in Rule 62-604.400, Florida Administrative Code (FAC). In accordance with Rules 62-4.530(1) and 62-604.600(6)(a)1., FAC, construction of this project shall not begin until at least 30 days after the receipt date (referenced above) of Application Form 62-604.300(8)(a). All General Permits are subject to the general conditions of Rule 62-4.540, FAC, (attached), and Rules 62-604.600 and 62-604.700, FAC. The construction activity must conform to the description contained in your Notice of Intent to Use the General Permit. Any deviation will subject the permittee to enforcement action and possible penalties.

If you have any questions, you may contact Astrid Flores Thiebaud at (813) 470-5760 or via email at astrid.floresthiebaud@dep.state.fl.us

Sincerely,



Kelley M. Boatwright
Program Administrator
Permitting & Waste Cleanup Program
Southwest District

Attachments: General Conditions
Location of Public Water System Mains










cc: Wayne E. White, P.E., Kimley-Horn and Associates Inc., Wayne.White@Kimley-Horn.com
Andy Fischer, Manatee County Public Works Dept., andy.fischer@mymanatee.org

62-4.540 General Conditions for All General Permits

- (1) The terms, conditions, requirements, limitations, and restrictions set forth in this Part are "general permit conditions" and are binding upon the permittee. The conditions are enforceable under Chapter 403, F.S.
- (2) The general permit is valid only for the specific activity indicated. Any deviation from the specified activity and the conditions for undertaking that activity shall constitute a violation of the permit. The permittee is placed on notice that violation of the permit may result in suspension or revocation of the permittee's use of the general permit and may cause the Department to begin legal proceedings.
- (3) The general permit does not convey any vested rights or any exclusive privileges. It does not authorize any injury to public or private property nor any invasion of personal rights. It does not authorize any infringement of federal, state or local laws or regulations. It does not eliminate the necessity for obtaining any other federal, state or local permits that may be required, or allow the permittee to violate any more stringent standards established by federal or local law.
- (4) The general permit does not relieve the permittee from liability and penalties when the construction or operation of the permitted activity causes harm or injury to human health or welfare; causes harm or injury to animal, plant or aquatic life; or causes harm or injury to property. It does not allow the permittee to cause pollution in contravention of Florida Statutes and Department rules.
- (5) The general permit conveys no title to land or water, nor does it constitute State recognition or acknowledgment of title. It does not constitute authority for reclamation of submerged lands. Only the Board of Trustees of the Internal Improvement Trust Fund may express State opinion as to title.
- (6) No general permit shall authorize the use of state owned land without the prior consent of the Board of Trustees of the Internal Improvement Trust Fund pursuant to Section 253.77, F.S.
- (7) The general permit may be modified, suspended or revoked in accordance with Chapter 120, Florida Statutes, if the Secretary determines that there has been a violation of any of the terms or conditions of the permit, there has been a violation of state water quality standards or state air quality standards, or the permittee has submitted false, incomplete or inaccurate data or information.
- (8) The general permit shall not be transferred to a third party except pursuant to Fla. Admin. Code Rule 62-4.120.
- (9) The general permit authorizes construction and where applicable operation of the permitted facility.
- (10) The permittee agrees in using the general permit to make every reasonable effort to conduct the specific activity or construction authorized by the general permit in a manner that will minimize any adverse effects on adjacent property or on public use of the adjacent property, where applicable, and on the environment, including fish, wildlife, natural resources of the area, water quality or air quality.
- (11) The permittee agrees in using the general permit to allow a duly authorized representative of the Department access to the permitted facility or activity at reasonable times to inspect and test upon presentation of credentials or other documents as may be required by law to determine compliance with the permit and the Department rules.
- (12) The permittee agrees to maintain any permitted facility, or activity in good condition and in accordance with the plans submitted to the department under Rule 62-4.530(1).
- (13) A permittee's use of a general permit is limited to five years. However, the permittee may request continued use of the general permit by notifying the Department pursuant to Rule 62-4.530(1). However, the permittee shall give notice of continued use of a general permit thirty days before it expires.

Specific Authority 403.814(1) FS. Law Implemented 253.123, 253.124, 403.061, 403.087, 403.088, 403.702-403.73, 403.814, 403.851-403.864 FS. History - New 7-8-82, Formerly 17-5.54, Amended 8-31-88, Formerly 17-4.540.

LOCATION OF PUBLIC WATER SYSTEM MAINS IN ACCORDANCE WITH F.A.C. RULE 62-555.314

Other Pipe	Horizontal Separation	Crossings (1)	Joint Spacing @ Crossings (Full Joint Centered)
Storm Sewer, Stormwater Force Main, Reclaimed Water (2)			<p>Alternate 3 ft. minimum</p> 
Vacuum Sanitary Sewer			<p>Alternate 3 ft. minimum</p> 
Gravity or Pressure Sanitary Sewer, Sanitary Sewer Force Main, Reclaimed Water (4)			<p>Alternate 6 ft. minimum</p> 
On-Site Sewage Treatment & Disposal System	10 ft. minimum	---	---

(1) Water main should cross above other pipe. When water main must be below other pipe, the minimum separation is 12 inches.

(2) Reclaimed water regulated under Part III of Chapter 62-610, F.A.C.

(3) 3 ft. for gravity sanitary sewer where the bottom of the water main is laid at least 6 inches above the top of the gravity sanitary sewer.

(4) Reclaimed water not regulated under Part III of Chapter 62-610, F.A.C.

Disclaimer - This document is provided for your convenience only. Please refer to F.A.C. Rule 62-555.314 for additional construction requirements.

Walker, Jordan

From: Donald Brunner <Donald.Brunner@cityofbradenton.com>
Sent: Tuesday, July 08, 2014 3:02 PM
To: Walker, Jordan
Subject: RE: Force Main 15D Rehabilitation - Manatee County

Sounds good.

Donald Brunner

Electrical Division Superintendent

City of Bradenton Public Works
1411 9th St. W., Bradenton, FL 34205
Shop 941-708-6334
Cell 941-730-2094

From: Jordan.Walker@kimley-horn.com [Jordan.Walker@kimley-horn.com]
Sent: Tuesday, July 08, 2014 2:07 PM
To: Donald Brunner; Christopher Walters
Cc: Wayne.White@kimley-horn.com; Shelby.Hughes@kimley-horn.com
Subject: RE: Force Main 15D Rehabilitation - Manatee County

Hey Don,

Per our phone conversation, there is a traffic loop that starts around the location of the stop bar and goes approximately 20' north in the southbound turn lane where we are proposing the location of the jack and bore pit.

The plans will have a note to replace any traffic loops that will be in conflict and to coordinate signalization during construction with you.

Thanks,

Jordan Walker, E.I.
Kimley-Horn | 655 North Franklin St, Ste. 150, Tampa, FL 33602
Direct: 813-635-5552

From: Hughes, Shelby
Sent: Monday, July 07, 2014 4:44 PM
To: donald.brunner@cityofbradenton.com; chris.walters@cityofbradenton.com
Cc: Walker, Jordan; White, Wayne
Subject: Force Main 15D Rehabilitation - Manatee County

Good Afternoon,

I spoke with Chris last week regarding the Force Main 15D Rehabilitation in Manatee County. The intersection affected is 59th Street West and Manatee Ave. Please see the attached plans for the proposed project.

Do you know the location of the traffic loops within the intersection? Also, please provide any other comments necessary.

Please feel free to give me or Jordan Walker a call at 813-635-5552.

RESTRAINED LENGTH CALCUATIONS

RESTRAINT LENGTH CALCULATOR

Project Name: Force Main 15D Rehabilitation


<http://rlc.ebaa.com>

Project Notes:

Fitting Type	Pipe Material	Soil Type	Safety Factor	Trench Type	Depth of Bury	Test Pressure	Nominal Size	Bend Angle	Branch Size	Length Along Run	Reduced Size	Lowside Depth	Restraint Length	Restraint Length 2
Horizontal Bend	PVC	SP	1.5	3	3 ft.	150	20	45					28 ft.	

SITE NAME: Manatee County

SITE NOTES:

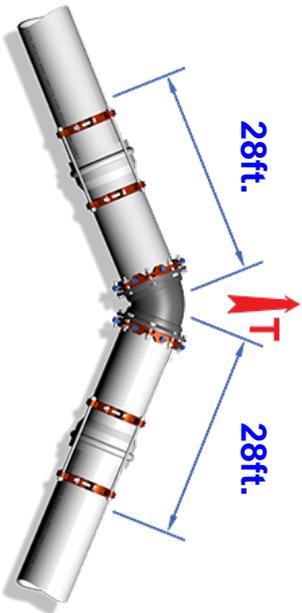

ALL JOINTS WITHIN THE CALCULATED LENGTH MUST BE RESTRAINED

Defined Variables	Soil Derived Variables	Calculations for Horizontal Bend
<p>H = 3 ft. Depth of Bury</p> <p>Sf = 1.5 Safety Factor</p> <p>P = 150 Internal Pressure</p> <p>θ = 45 Bend Angle</p> <p>Pipe Derived Variables</p> <p>A = 366.44 Cross Sec. Area of Pipe</p> <p>D = 1.80 Outside Pipe Diameter</p> <p>Wp = 32.58 Weight of Pipe</p> <p>Ww = 135.30 Weight of Water in Pipe</p>	<p>fc = 0.00 Cohesion Modifier Coefficient</p> <p>c = 0 Cohesion of Soil</p> <p>φp = 0.70 Friction Angle Modifier</p> <p>φ = 31 Internal Friction Angle of Soil</p> <p>γ = 110 Soil Density</p> <p>Kn = 0.60 Trench Compaction Modifier</p>	<p>Calculations for Horizontal Bend</p> <p>We = γ · D · H = 594,000 Normal Force Due to Soil</p> <p>W = 2We + Wp + Ww = 1355,880 Normal Force Acting on Pipeline</p> <p>Kp = $\tan^2((\pi/180) \cdot (45 + (\phi / 2))) = 3.124$ Rankin Passive Pressure Coeff.</p> <p>Hc = H + (D / 2) = 3,900 Depth From Surface to Pipe Center</p> <p>dh = $\gamma \cdot Hc \cdot Kp + 2c \cdot \sqrt{Kp} = 1340,196$ Horizontal Passive Soil Pressure</p> <p>Ap = $\pi \cdot (D / 2) = 2.827$ Area Based on Half of Circumference</p> <p>Rs = Kn · dh · D = 1447,412 Bearing Resistance of Pipelines</p> <p>Fs = $Ap \cdot fc \cdot c + W \cdot \tan((\pi/180) \cdot \phi) \cdot \phi = 539,570$ Frictional Resistance</p> <p>L = $(Sf \cdot P \cdot A \cdot \tan((\pi/180) \cdot (\phi / 2))) / (Fs + (Rs / 2)) = 27,034$ ft. Minimum Restrained Length</p>

RESTRAINED LENGTH CALCUATIONS

RESTRAINT LENGTH CALCULATOR

Project Name: Force Main 15D Rehabilitation


<http://rlc.ebaa.com>

Project Notes:

Fitting Type	Pipe Material	Soil Type	Safety Factor	Trench Type	Depth of Bury	Test Pressure	Nominal Size	Bend Angle	Branch Size	Length Along Run	Reduced Size	Lowside Depth	Restraint Length	Restraint Length 2
Dead End	PVC	SP	1.5	3	3 ft.	150	20						153 ft.	

SITE NAME: Manatee County

SITE NOTES:

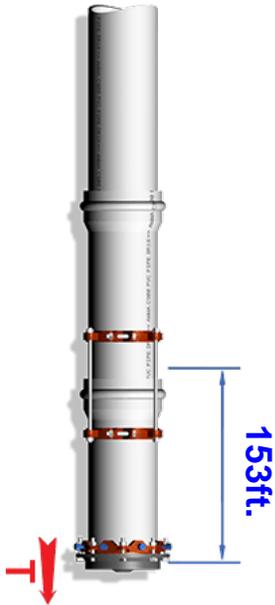

ALL JOINTS WITHIN THE CALCULATED LENGTH MUST BE RESTRAINED

Defined Variables	Soil Derived Variables	Calculations for Dead End
H = 3 ft. Depth of Bury	fc = 0.00 Cohesion Modifier Coefficient	$We = \gamma \cdot D \cdot H = 594,000$ Normal Force Due to Soil
Sf = 1.5 Safety Factor	c = 0 Cohesion of Soil	$W = 2We + Wp + Ww = 1355,880$ Normal Force Acting on Pipeline
P = 150 Internal Pressure	$\phi p = 0.70$ Friction Angle Modifier	$Apb = \pi \cdot D = 5,655$ Area Based on Full Pipe Circumference
Pipe Derived Variables	$\phi = 31$ Internal Friction Angle of Soil	$Fsb = Apb \cdot fc \cdot c + W \cdot \tan(\pi / 180) \phi \cdot \phi = 539,570$ Frictional Resistance
A = 366.44 Cross Sec. Area of Pipe	$\gamma = 110$ Soil Density	$L = SF \cdot P \cdot A / (Fsb) = 152,805$ ft. Minimum Restrained Length Dead End
D = 1.80 Outside Pipe Diameter		
Wp = 32.58 Weight of Pipe		
Ww = 135.30 Weight of Water in Pipe		