



- NOTES:
1. ALL THE NEW JUNCTION BOXES SHOULD BE NEMA 4X, SS.
 2. ALL COORDINATION, DESIGN AND INSTALLATION RELATED TO THE TANK SHOULD BE COORDINATED WITH CROM CORPORATION.
 3. **CONTRACTOR TO INTERCEPT EXISTING CONDUIT, INSTALL NEW CONDUIT IF NEEDED AND EXTEND TO NEW LOCATION OF VALVE. REPULL NEW WIRE.**
 4. BOND TERMINAL BOX TO GROUND SYSTEM. RUN #8 INSULATED COPPER WIRE TO GROUND ROD AT CONTROL PANEL. INSTALL IN RACEWAY TO CONTROL PANEL AND BOND TO GROUND ROD CONNECTION.
 5. CONDUITS TO PENETRATE THE HATCH AND BE CONNECTED TO CABLE BY VENDOR FOR THE MIXER MOTOR AND THE FLOAT.

PROPOSED PARTIAL ELECTRICAL SITE PLAN 1

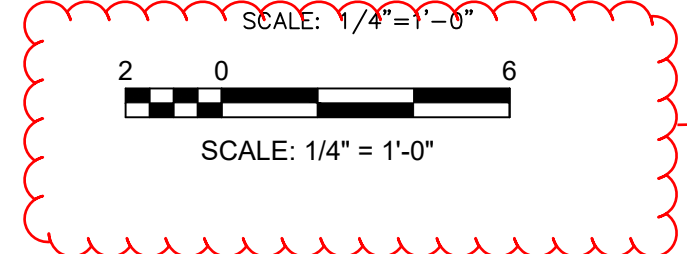

CHANGED SCALE

PROPOSED PARTIAL ELECTRICAL SITE PLAN 2

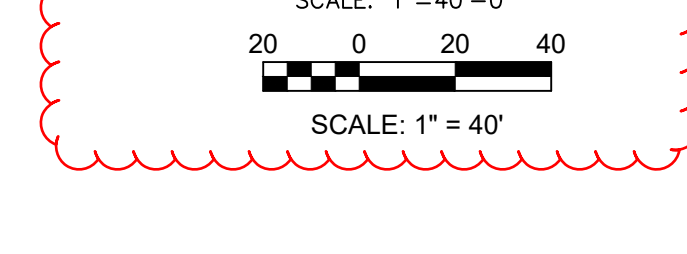

CHANGED SCALE
BAR SCALE
1/4"=1'0"

REV. NO.	DESCRIPTION	DATE
3	ADDENDUM CONTRACTOR QUESTIONS	
1	ADDENDUM - REMOVAL OF PROPOSED VALVES	11/14/2022
	REVISIONS	

SEAL

AUBREY A. HAUDRICOURT, P.E.
No. 66861

1365 Hamlet Avenue
Clearwater, Florida 33756-3331
Phone: (727) 442-7196, Fax: (727) 461-3827

CA Lic. No. 29598
www.mckimcreed.com

Manatee
County
FLORIDA

CORTEZ BOOSTER PUMP STATION UPGRADES

ELECTRICAL

PROPOSED PARTIAL ELECTRICAL SITE PLAN

PROJ. START DATE: MAR. 2020	SCALE
MCE PROJ. # 01024-0193	HORIZONTAL: E1.03
DRAWN JG	TBD
DESIGNED AAH	VERTICAL: TBD
CHECKED MAC	TBD
PROJ. MGR. BP	1
STATUS:	REVISION
	ISSUED FOR BID