


- NOTES:
1. ALL THE NEW JUNCTION BOXES SHOULD BE NEMA 4X, SS.
 2. INSTALL CONDUIT SUPPORT FROM VFD TO SCADA PANEL FOR SIGNAL WIRE.
 3. REUSE EXISTING CONDUIT WHERE POSSIBLE BUT PULL IN NEW WIRE, REUSE EXISTING CONDUIT SUPPORT WHERE POSSIBLE.

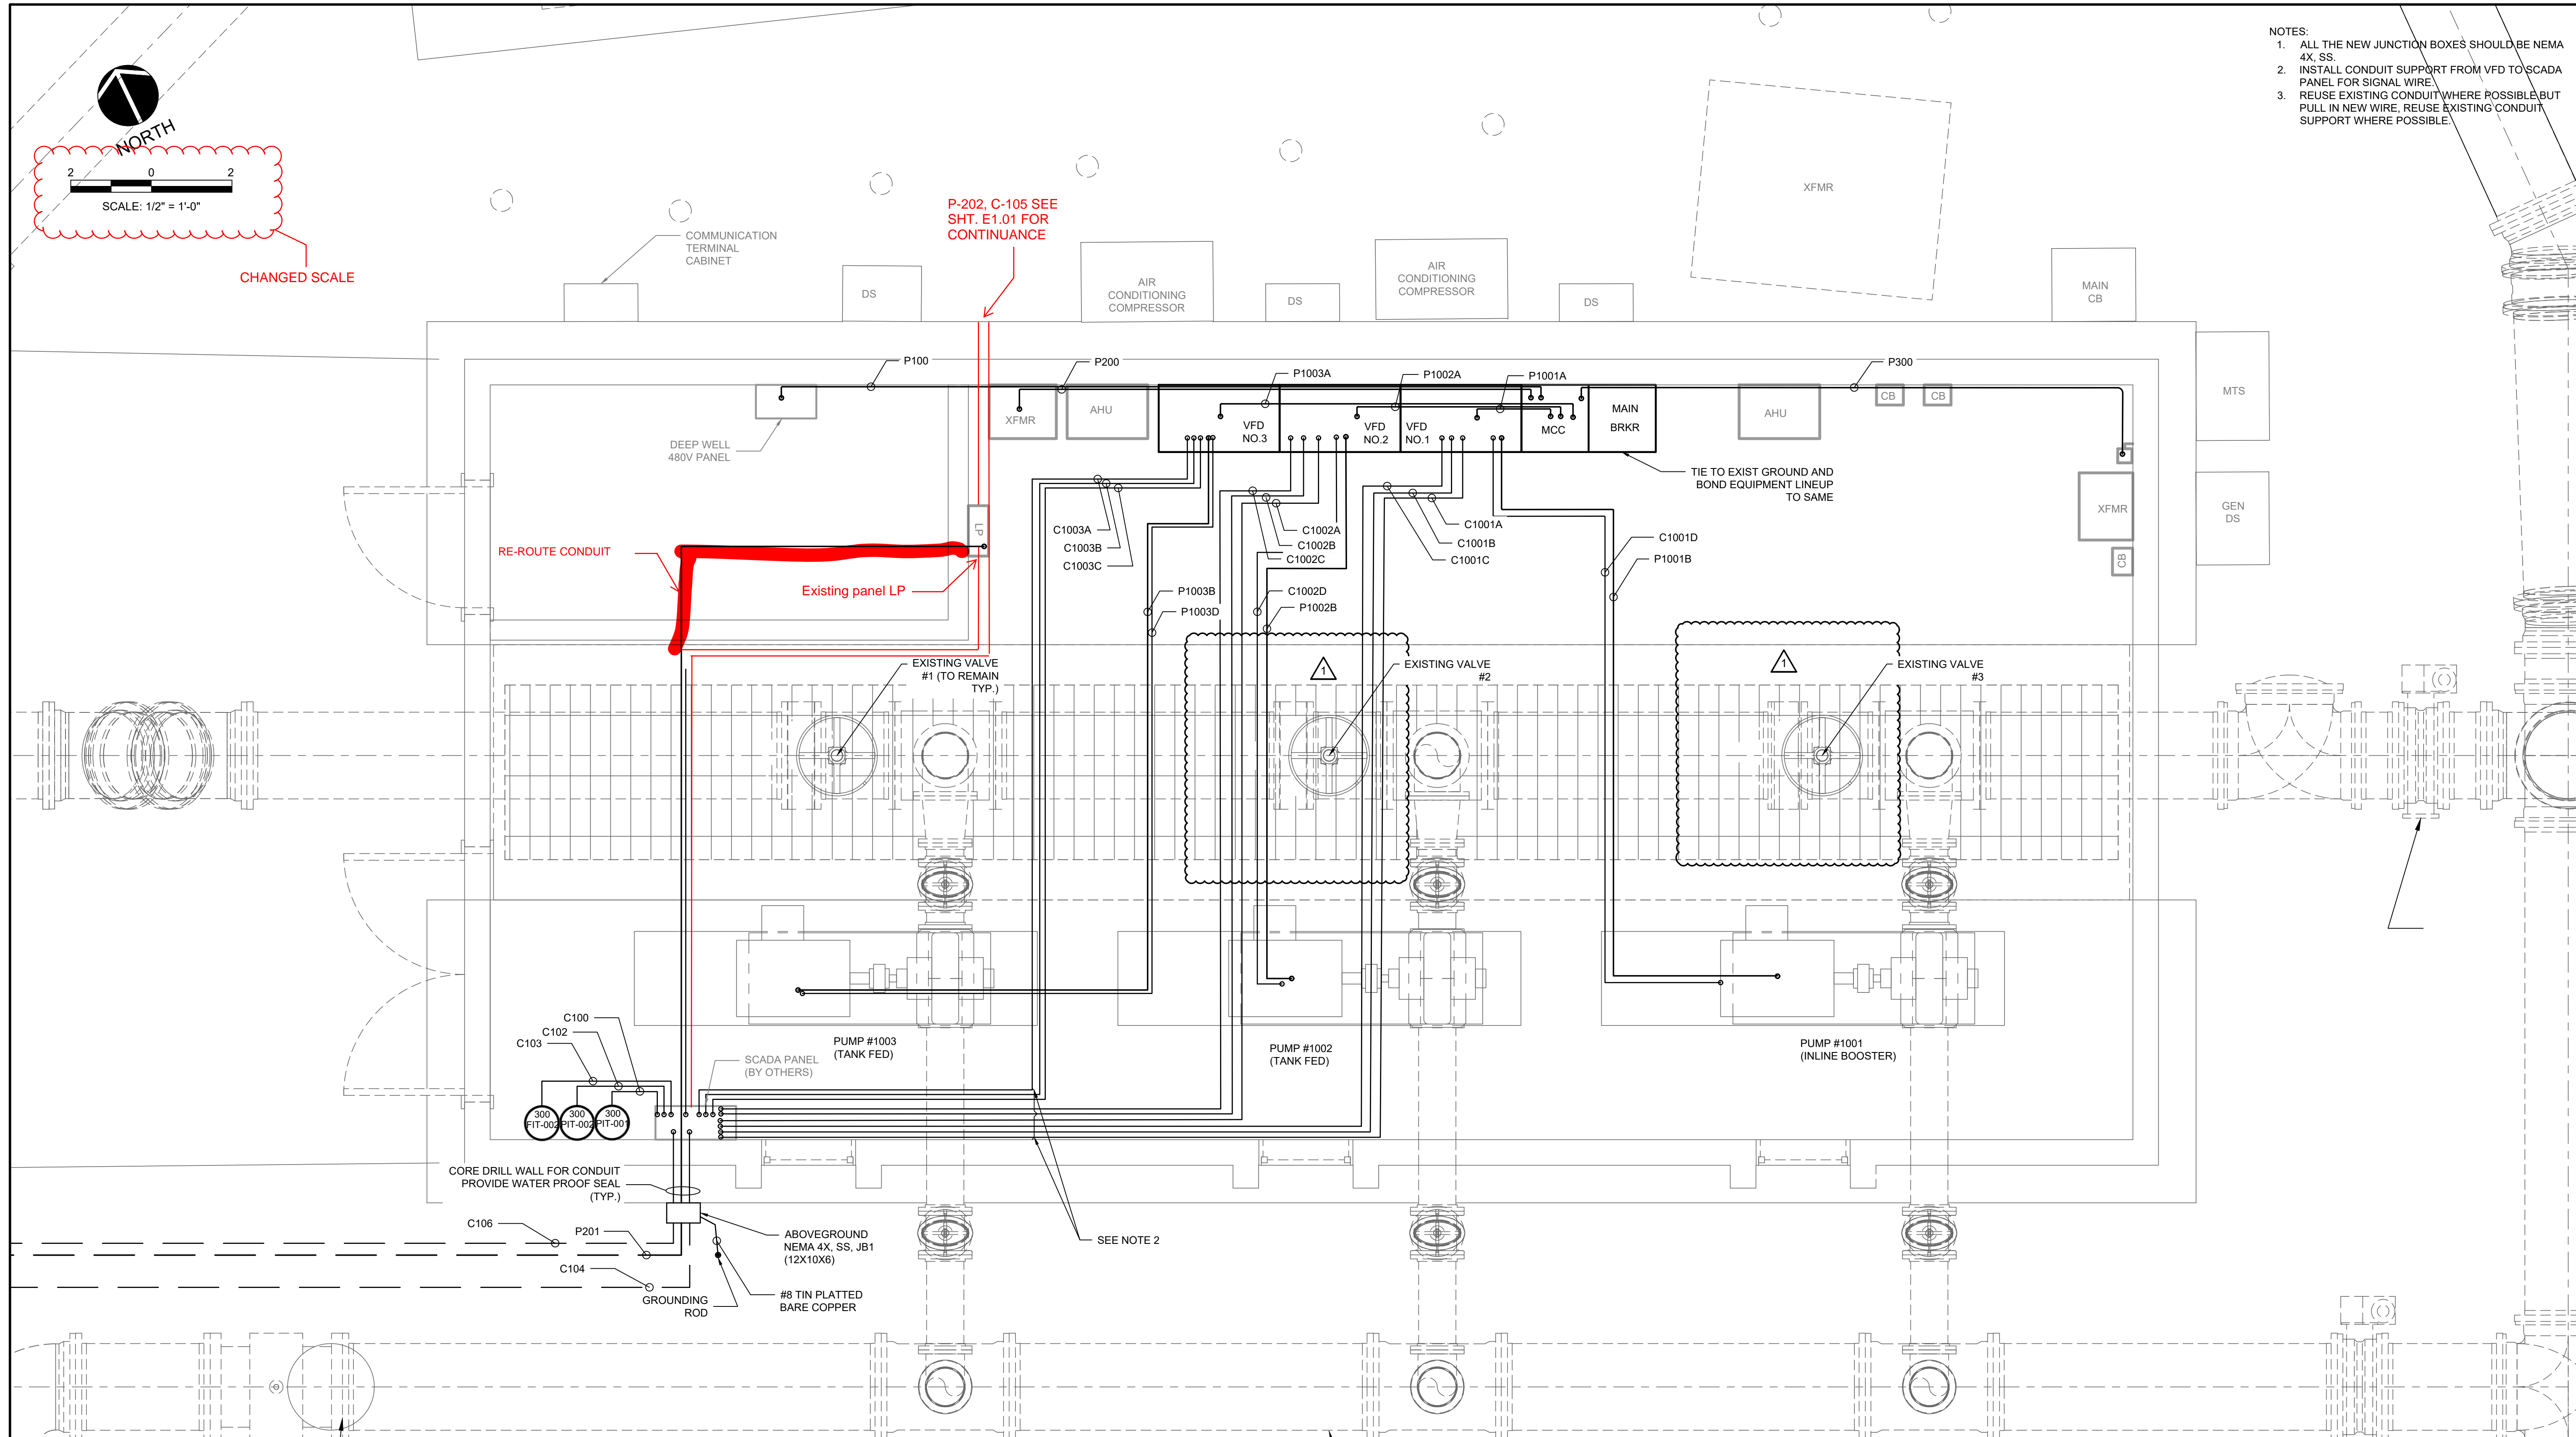


PROPOSED ELECTRICAL PUMP ROOM PLAN

SCALE CHANGED — SCALE: 1/2"=1'-0"

REV. NO.	DESCRIPTION	DATE
1	ADDENDUM - REMOVAL OF PROPOSED VALVES	11/14/2022
REVISIONS		

SEAL
AUBREY A. HAUDRICOURT, P.E.
No. 66861

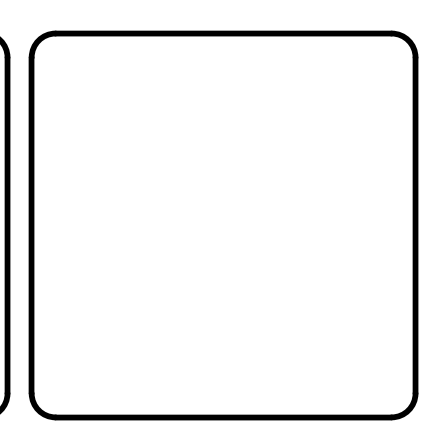

MCKIM & CREED
1365 Hamlet Avenue
Clearwater, Florida 33756-3331
Phone: (727) 442-7196, Fax: (727) 461-3827
CA Lic. No. 29588
www.mckimcreed.com



CORTEZ BOOSTER PUMP STATION UPGRADES
ELECTRICAL
PROPOSED ELECTRICAL BUILDING PLAN

PROJ. START DATE: MAR. 2020	SCALE	E1.02 DRAWING NUMBER 1 REVISION
MCE PROJ. # 01024-0193	HORIZONTAL: TBD	
DRAWN JG	VERTICAL: TBD	
DESIGNED AAH		
CHECKED MAC		
PROJ. MGR. BP		
STATUS: ISSUED FOR BID		