
CONTRACT DRAWINGS



# MLS TIDEVIEW 4 (RTU#533) EMERGENCY GENERATOR REPLACEMENT FOR

MANATEE COUNTY, FLORIDA COUNTY PROJECT NUMBER: 6060785

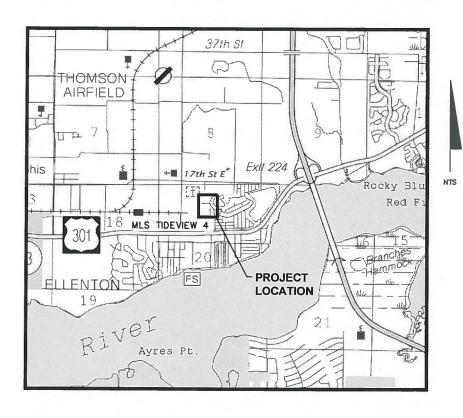

### **INDEX OF SHEETS**

SHEET NO	SHEET DESCRIPTION
G-1	COVER
G-2	GENERAL NOTES & SYMBOLOGY
C-1	SITE PLAN
C-2	SITE DEMOLITION PLAN
C-3	SITE LAYOUT
C-4	BUILDING DEMOLITION PLAN
C-5	SITE PHOTOS
C-6	DETAIL SHEET
E-1 TO E-7	ELECTRICAL SHEETS
S-1	STRUCTURAL SHEET



# UTILITY WARNING NOTE

ABOVE GROUND AND / OR UNDERGROUND UTILITIES MAY BE IN THE AREA OF THIS PROJECT - PROCEED WITH CAUTION - THE CONTRACTOR SHALL CALL SUNSHINE STATE "ONE CALL" AT 1-800-432-4770 AND THE UTILITY OWNERS IN ADVANCE OF BEGINNING WORK, IN ACCORDANCE WITH CHAPTER 556, FLORIDA STATUTES.

ATTENTION IS DIRECTED TO THE FACT THAT THESE PLANS MAY HAVE BEEN REDUCED IN SIZE BY REPRODUCTION. THIS MUST BE CONSIDERED WHEN OBTAINING SCALED DATA.

		REVISIONS
DATE	BY	DESCRIPTION
	1 1	
	1	





KELLY S. WEHNER, PE

60273 FL. LICENSE NO.

DATE: NOV

### GENERAL NOTES

- ALL WORKMANSHIP AND MATERIALS USED IN THE CONSTRUCTION OF THIS PROJECT SHALL BE NEW AND UNUSED AND CONFORM TO, OR EXCEED THE LATEST LOCAL JURISDICTION STANDARDS
- CONTACT SUNSHINE STATE ONE CALL FOR UTILITY LOCATES A MINIMUM OF 48-HOURS AND A MAXIMUM OF 5-DAYS PRIOR TO START OF CONSTRUCTION AT 1-800-432-4770.
- THE CONTRACTOR SHALL NOTIFY UTILITY OWNERS A MINIMUM OF 2-DAYS AND A MAXIMUM OF 5-DAYS PRIOR TO START OF CONSTRUCTION.

UTILITY OWNER		CONTACT NAME	CONTACT NUMBER
	BRIGHT HOUSE NETWORKS	TOM WRIGHT	(941) 345-1348 EXT 21348
	FLORIDA POWER AND LIGHT	TRACY STERN	(800) 868-9554
	VERIZON FLORIDA INC.	DAVID WYNNS	(813) 978-2164
	MANATEE COUNTY UTILITY OPERATIONS	KATHY McMAHON	(941) 792-8811 EXT 5075
	PEACE RIVER ELECTRIC COOPERATIVE	CLAY STANPHILL	(863) 781-0863

- IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CONTACT FPL/GTE FOR RESTRAINING OF POLES DURING CONSTRUCTION. ALL ASSOCIATED COSTS WILL BE AT CONTRACTOR'S EXPENSE
- THE CONTRACTOR'S ATTENTION IS DIRECTED TO THE FACT THAT ALL CONSTRUCTION ACTIVITIES SHALL CONFORM TO THE LOCAL NOISE ORDINANCE
- HOURS OF WORK SHALL BE: NON-FEDERAL HOLIDAYS, MONDAY FRIDAY 7AM 5PM. WORK OUTSIDE THESE HOURS MUST BE SCHEDULED 48 HOURS IN ADVANCE AND MAY BE SUBJECT TO REIMBURSEMENT FOR ADDITIONAL INSPECTION SERVICES.
- THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS PRIOR TO CONSTRUCTION. THESE MAY INCLUDE, BUT ARE NOT LIMITED TO:
  - UTILITY CONSTRUCTION PERMIT
  - R.O.W. USE PERMIT

LITH ITY OWNED

- EPA NPDES PERMIT
- DEWATERING PERMIT
- TREE REMOVAL PERMIT
- THESE DRAWINGS DO NOT INCLUDE NECESSARY COMPONENTS FOR CONSTRUCTION SAFETY AND THE CONTRACTOR IS SOLELY RESPONSIBLE FOR CONSTRUCTION SAFETY. SPECIAL PRECAUTIONS MAY BE REQUIRED IN THE VICINITY OF POWER LINES AND OTHER UTILITIES.
- THE CONTRACTOR SHALL FURNISH, ERECT AND MAINTAIN ALL NECESSARY TRAFFIC CONTROL AND SAFETY DEVICES, IN ACCORDANCE WITH THE US DEPARTMENT OF TRANSPORTATION, "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES" AND THE LATEST FLORIDA DEPARTMENT OF TRANSPORTATION "ROADWAY AND TRAFFIC DESIGN STANDARDS", LATEST EDITION AND CONTRACT SPECIFICATIONS.
- THE CONTRACTOR SHALL PROVIDE, ERECT AND MAINTAIN EFFECTIVE BARRICADES, DANGER SIGNALS. SIGNS AND PEDESTRIAN DETOURS IN ALL AREAS WHERE REQUIRED FOR THE PROTECTION OF THE WORK AND THE SAFETY OF THE PUBLIC.
- THE CONTRACTOR SHALL PROVIDE ACCESS FOR TRAFFIC AT ALL TIMES DURING CONSTRUCTION. CONSTRUCTION SHALL BE CONDUCTED IN SUCH A MANNER THAT RESIDENTS RETAIN ACCESS TO THEIR DRIVEWAYS AT ALL TIMES
- REFERENCES TO FDOT INDEXES REFER TO THE MOST RECENT EDITION OF THE FDOT "ROADWAY AND TRAFFIC DESIGN STANDARDS "
- IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CONTROL AND PREVENT EROSION AND THE TRANSPORTATION OF SEDIMENT TO SURFACE DRAINS AND OUTFALLS.
- THE CONTRACTOR SHALL TAKE ALL REASONABLE MEANS TO FLIMINATE THE TRANSPORT OF DUST FROM THE PROJECT SITE. SPECIAL MEASURES, SUCH AS PERIODICALLY APPLYING WATER TO THE WORK SITE TO PREVENT DUST SHALL BE INCORPORATED INTO THE CONTRACTORS WORK PLAN.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO MAKE A REVIEW OF THE SITE TO DETERMINE EXISTING CONDITIONS AND ANYTHING NOT SHOWN ON THESE PLANS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER AND SHALL NOT CONSTITUTE AN EXTRA UNLESS APPROVED BY THE ENGINEER.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRING OR REPLACING ANY DAMAGED ITEMS INCLUDING, BUT NOT LIMITED TO, DRIVEWAYS, IRRIGATION SYSTEMS, MAILBOXES, SIDEWALKS. STREET SIGNS, AND PRIVATE FENCES AS REQUIRED BY E.O.R./OTHER GOVERNING ENTITIES.
- ALL SECTION CORNERS OR PROPERTY CORNERS DISLOCATED OR DISTURBED BY THE CONSTRUCTION ACTIVITIES SHALL BE RESET BY A REGISTERED LAND SURVEYOR AT THE CONTRACTORS EXPENSE.
- ALL DISTURBED AREAS SHALL BE RESTORED TO THEIR ORIGINAL CONDITION OR BETTER UNLESS OTHERWISE NOTED. FINAL GRADE IS TO GENERALLY BE THE SAME AS EXISTING GRADE. RESTORE UNIFORMLY AND FOR PROPER DRAINAGE GRADE TOWARD ROADWAY
- THE CONTRACTOR IS RESPONSIBLE FOR THE DISPOSAL OF ALL CLEARED VEGETATION WITHIN FIVE (5) DAYS OF CLEARING AND GRUBBING WORK

- 20. ALL EXCESS SOIL RESULTING FROM CONSTRUCTION ACTIVITIES THAT IS NOT CLAIMED BY THE OWNER SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND PROPERLY DISPOSED OF BY THE
- 21. ALL VOIDS AFTER PLACEMENT OF SOD SHALL BE FILLED WITH PREPARED SOIL MIX. THE SOD SHALL BE ROLLED TO MEET THE PROPOSED GRADES. SOD PLACED ON SLOPES (3:1 OR STEEPER) SHALL BE
- 22. AREAS OF EXPOSED EARTH RESULTING FROM CONSTRUCTION SHALL BE SODDED IN KIND AS DIRECTED BY THE ENGINEER UNLESS OTHERWISE NOTED ON PLANS.
- LOCATIONS, ELEVATIONS AND DIMENSIONS OF EXISTING UTILITIES, STRUCTURES AND OTHER FEATURES ARE SHOWN ACCORDING TO THE BEST INFORMATION AVAILABLE AT THE TIME OF THE PREPARATION OF THESE PLANS, BUT DO NOT PURPORT TO BE ABSOLUTELY CORRECT. THE CONTRACTOR SHALL VERIFY THE LOCATION, ELEVATIONS AND DIMENSIONS OF ALL EXISTING UTILITIES, STRUCTURES AND OTHER FEATURES AFFECTING HIS WORK PRIOR TO CONSTRUCTION.
- 24. THE CONTRACTOR SHALL VERIFY IN THE FIELD THE LOCATION AND ELEVATION OF ALL EXISTING UTILITY CONNECTION POINTS PRIOR TO STARTING CONSTRUCTION AND SHALL IMMEDIATELY NOTIFY THE ENGINEER AND OWNER OF ANY DISCREPANCIES FOUND.
- THE CONTRACTOR'S ATTENTION IS CALLED TO THE FACT THAT THERE MAY BE SOME CONFLICTS. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LOCATE, PROTECT, AND REPLACE (IF DAMAGED) ANY AND ALL EXISTING UTILITIES ON THIS PROJECT AT THEIR OWN EXPENSE.
- THE CONSTRUCTION LIMITS INDICATED IN THESE PLANS ARE APPROXIMATE. ACTUAL LIMITS MAY BE SET IN THE FIELD AS DIRECTED BY THE ENGINEER.
- ALL POTABLE WATER, FIRE, IRRIGATION SYSTEM, SANITARY SYSTEM, STORM SYSTEM AND OTHER UTILITIES COMPONENTS SHALL BE PROTECTED AND SHALL REMAIN OPERATIONAL DURING CONSTRUCTION. THE CONTRACTOR SHALL IMMEDIATELY REPAIR ANY DAMAGE TO THESE SYSTEMS
- CONTRACTOR SHALL ENSURE THAT EXCAVATIONS ARE FREE OF DEBRIS PRIOR TO BACKFILLING.
- THE CONTRACTOR SHALL NOT ENTER OR OCCUPY ANY LAND OUTSIDE THE RIGHTS-OF-WAY OR PRIVATE PROPERTY WITHOUT THE WRITTEN CONSENT OF THE PROPERTY OWNER
- WHERE REFERENCED STANDARDS CONFLICT. THE MORE STRINGENT STANDARD SHALL APPLY
- CONTRACTOR SHALL SUPPORT AND PROTECT ALL EXISTING UTILITIES AS REQUIRED. THIS SHOULD

# ONAL

## SURVEYOR'S NOTES & SYMBOLOGY

NOTE: EXISTING FEATURES ARE SHOWN LIGHT—LINED AND DASHED

### LEGEND

	SITE BENCHMARK		l	CONCRETE MONUMENT	
X	WOOD UTILITY POLE	•		FOUND BOUNDARY MARKER	
	GRATE INLET	×¹¹	.A.2	SPOT ELEVATION (TYP)	
₩	LIGHT POLE	Ĵ		GUY WIRE	
$\bowtie$	WATER VALVE	Œ	) (	UTILITY MANHOLE	
·	FIRE HYDRANT	S	) .	SANITARY MANHOLE	
þ	SIGN	0	) /	FIBER OPTIC MARKER	
	UTILITY BOX	0	) /	RRIGATION HEAD	
0	STORM MANHOLE	P	) (	GEOTECH BORINGS AND PAVEMENT CO	DRES
284	`	33-/			
414	TREE	P	PB	PLAT BOOK	
Ĩ.		C	RB	OFFICIAL RECORDS BOOK	
X	PINE TREE	F	o G	PAGE	
X	PALM TREE	D	В	DEED BOOK	
evens.			1ES	MITERED END SECTION	
283	OAK TREE	"	vv	INVERT	
0	MAPLE TREE	Ε	L	ELEVATION	
$\sim$					

- 1. THE FOLLOWING NGS NAVD88 VERTICAL CONTROL MONUMENTS WERE RECOVERED AND UTILIZED FOR THE ELEVATIONS SHOWN HEREIN: MELROSE PARK PID: DO1578 FLEVATION 18 18 FFFT AND MIRAMAR PID: DO1579 ELEVATION 14.57 FEET.
- 2. THIS SURVEY IS REFERENCED TO A PROJECTION OF THE FLORIDA STATE PLANE COORDINATE SYSTEM (WEST ZONE NAD 1983/2011).

SURVEY PROVIDED BY:

Hvatt Survey Services, LB No.: 7203 Geographic Data Specialists

11007 8th Avenue East Bradenton, Florida 34212 Phone: (941) 748-4693 Fax: (941) 744-1643

# LINE WORK & SYMBOLOGY

 ASPHALT ROADWAY	 CHAIN LINK FENCE
 BACK OF CURB	BUILDING BOUNDARY
 SHELL DRIVEWAY	 TOP OF BANK
 CONCRETE DRIVEWAY	 WETLAND LINE
 RIGHT-OF-WAY/PROPERTY LINE	 GUARDRAIL
 PROPERTY LINE	 CONTOUR LINE AND ELEV

# EXISTING UTILITY LINE WORK SYMBOLOGY

NOTE: PIPES 12-INCHES AND LARGER SHOWN WITH DOUBLE LINES.

wmwm	WATER MAIN		BURIED ELECTRIC
FOC FOC	BURIED FIBER OPTIC	UGT UGT	BURIED TELEPHONE
—— GAS ——— GAS ———	GAS MAIN	fm fm	SANITARY FORCE MAIN
—— UGTV ——— UGTV ———	BURIED CABLE TV		RECLAIMED WATER MAIN
UNKUNK	UNKNOWN UTILITY	<b>€</b> TH1-1	TEST HOLE LOCATION

KELLY S. WEHNER, PE DATE LIC. NO.: 60273

DRAMN

Q.C.

APPROVED

DES

THE LEGEND LISTED REPRESENT A COMPREHENSIVE STANDARD GUIDE INTENDED FOR GENERAL USE. THEREFORE, NOT ALL OF THE SYMBOLS AND ABBREVIATIONS CONTAINED ON

THIS SHEET ARE NECESSARILY USED ON THIS PARTICULAR CONTRACT.

**GENERAL NOTES &** SYMBOLOGY

00193009.09 NOVEMBER 2016 SHEET NO

G-2

MANATEE COUNTY


BY DATE


**MLS TIDEVIEW 4 EMERGENCY GENERATOR** REPLACEMENT


Shaping the Future 380 PARK PLACE BLVD. STE 300, CLEA TEL: (727) 531-3505 (800) 861-8314

cardino com Certificate of Authorization No. 29915

DESCRIPTION

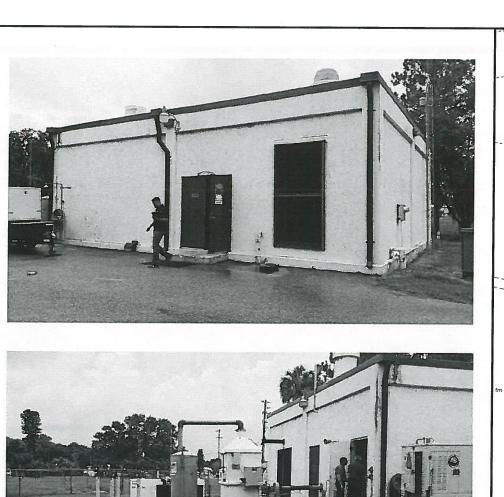


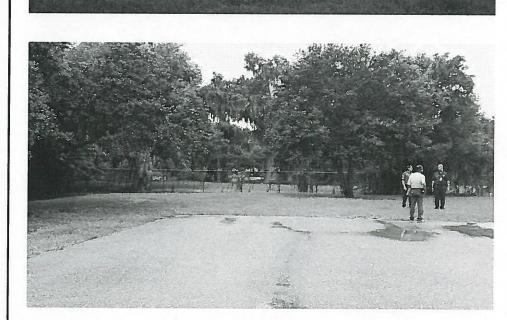


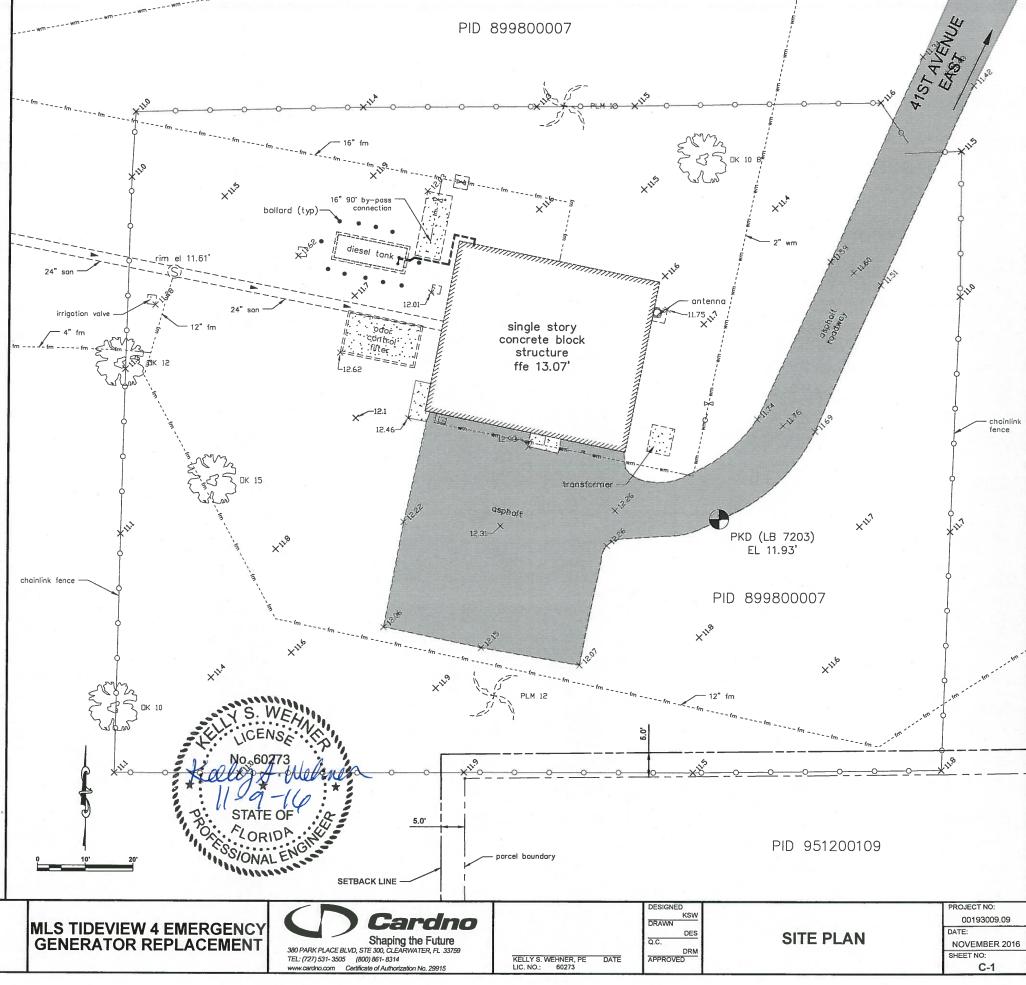


**MANATEE COUNTY** 

DESCRIPTION BY DATE

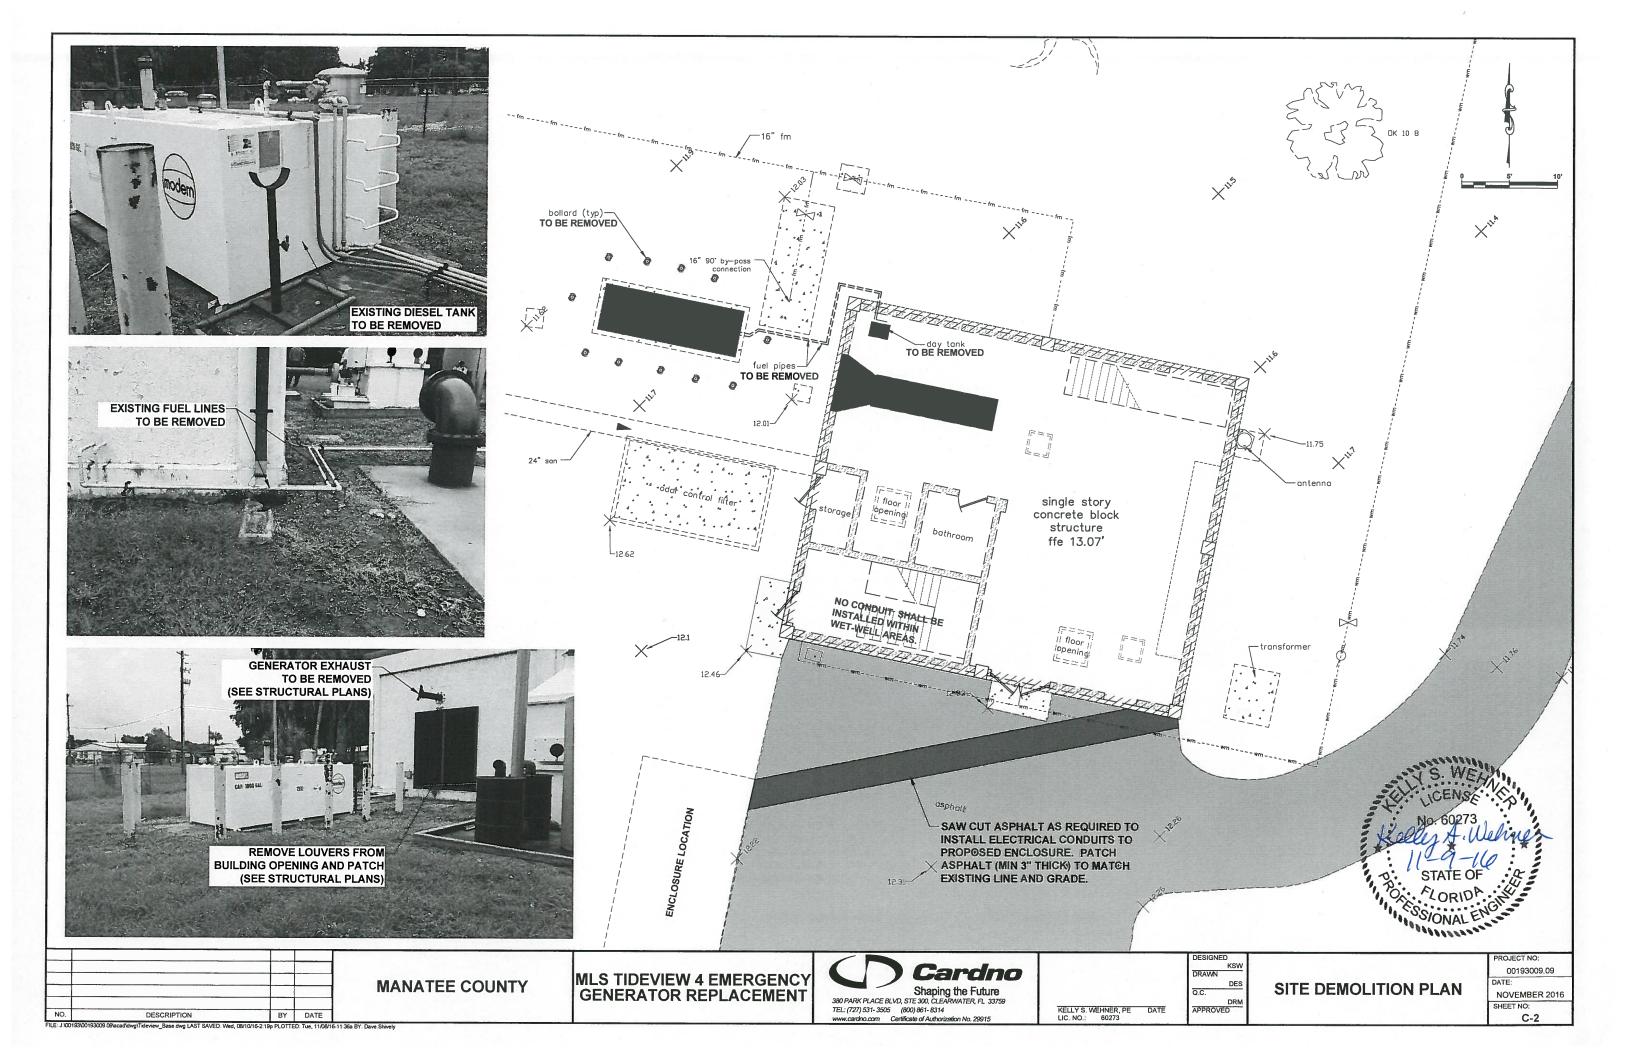

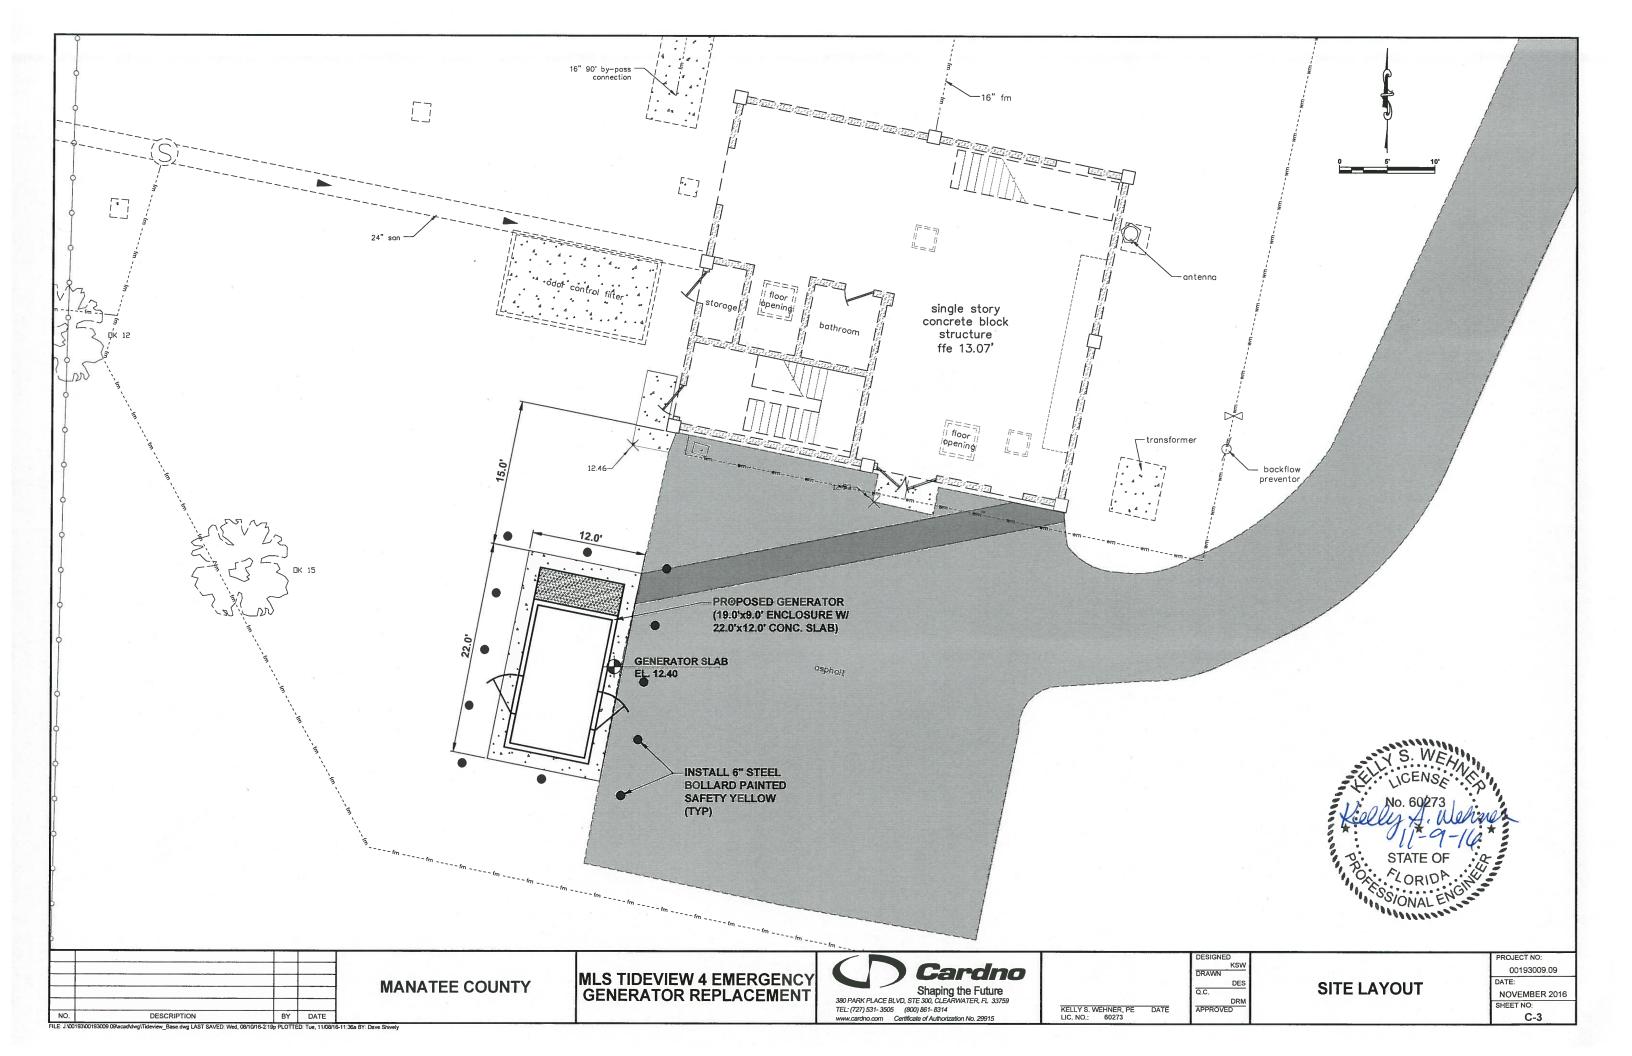







**EXISTING GENERATOR** (B) (TO BE REMOVED)




EXISTING DAY TANK
(TANK, FUEL LINES, VENT, ETC.)
(TO BE REMOVED)

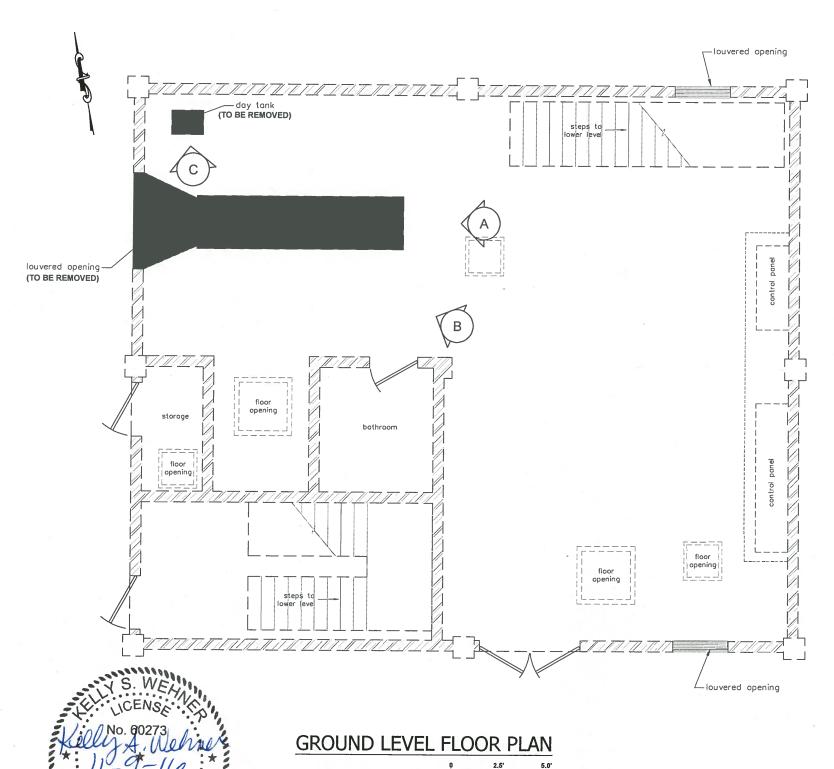



EXISTING GENERATOR EXHAUST DUCT (TO BE REMOVED)



EXISTING GENERATOR EXHAUST DUCT (TO BE REMOVED)



EXISTING GENERATOR RADIATOR AND DUCT (TO BE REMOVED)

NO. DESCRIPTION

**MANATEE COUNTY** 

SS/ONAL ENG

MLS TIDEVIEW 4 EMERGENCY **GENERATOR REPLACEMENT** 



TEL: (727) 531- 3505 (800) 861- 8314 www.cardno.com Certificate of Authorization No. 29915

DESIGNED KSW DRAWN **BUILDING DEMOLITION PLAN** 

PROJECT NO: 00193009.09 NOVEMBER 2016

C-4


Shaping the Future
380 PARK PLACE BLVD, STE 300, CLEARWATER, FL 33759

KELLY S. WEHNER, PE DATE LIC. NO.: 60273


DRM APPROVED



PROPOSED GENERATOR LOCATION (FACING NORTHWEST)

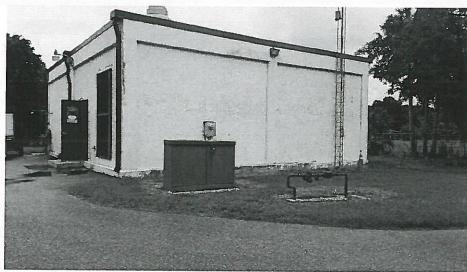

EXISTING BUILDING (FACING WEST)

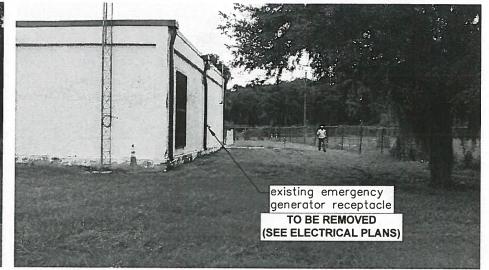


EXISTING BUILDING (FACING WEST)



SITE PHOTO (FACING SOUTHEAST)




SITE PHOTO (FACING SOUTHEAST)



EXISTING DIESEL TANK - TO BE REMOVED (FACING SOUTHWEST)



SITE PHOTO (FACING SOUTHEAST)




SITE PHOTO (FACING SOUTHEAST)



SITE PHOTO (FACING SOUTHEAST)




SITE PHOTO (FACING SOUTHEAST)

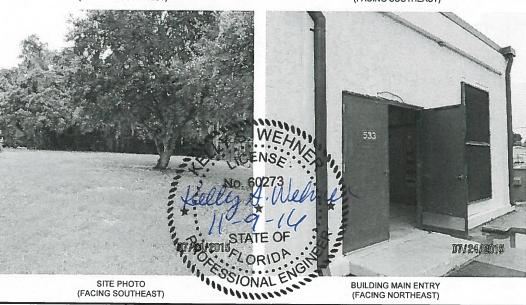

SITE PHOTO (FACING SOUTHEAST)

BUILDING MAIN ENTRY (FACING NORTHEAST)



EXISTING GENERATOR MUFFLER - TO BE REMOVED (FACING WEST)

**MANATEE COUNTY** 

MLS TIDEVIEW 4 EMERGENCY GENERATOR REPLACEMENT



Shaping the Future
380 PARK PLACE BLVD, STE 300, CLEARWATER, FL 33759
TEL: (727) 531-3505 (800) 861-8314
www.cardno.com Certificate of Authorization No. 29915

KELLYS. WEHNER, PE DATE LIC. NO.: 60273

SITE PHOTOS


00193009.09 NOVEMBER 2016

DESCRIPTION BY DATE
view\_Details dwg LAST SAVED. Wed, 08/10/16-12-13p PLOTTED: Tue, 11/08/16-11:36a BY: Dave Shreely

Q.C. DRM APPROVED


DRAWN

C-5

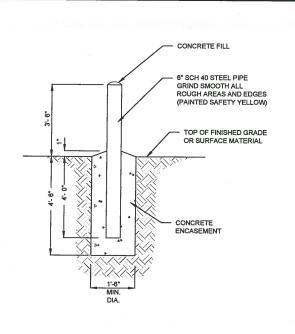

TYPICAL BOLLARD DETAIL


- SEE SITE LAYOUT SHEET FOR CONC. SLAB ELEVATION **EXISTING GROUND** SITE GRADING DETAIL NTS SSIONAL EN SS/ONAL EN

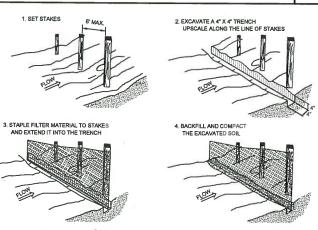


### SHEET FLOW INSTALLATION (PERSPECTIVE VIEW)

- 1. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CONTROL AND PREVENT EROSION AND THE TRANSPORTATION OF SEDIMENT TO SURFACE DRAINS AND OUTFALLS. (REFER TO CONSTRUCTION PLANS, DETAILS, SPECIFICATIONS, AND APPROVED PERMITS FOR DETAILS.)
- 2. DURING CONSTRUCTION THE CONTRACTOR SHALL PLACE GEOBALE BARRIERS AROUND SUCH STRUCTURES TO PREVENT EROSION AND THE MIGRATION OF SEDIMENT TO POINTS OUTSIDE THE CONSTRUCTION AREA. THE BARRIERS SHALL BE PLACED IN ACCORDANCE WITH THE REQUIREMENTS OF FDOT INDEX NO. 102 OR AS DIRECTED BY
- THE CONTRACTOR SHALL PROVIDE SILT BARRIERS AS DIRECTED BY THE ENGINEER TO CONTROL EROSION AND SEDIMENTATION FROM TAKING PLACE OUTSIDE THE LIMITS OF THE PROJECT. THE SILT BARRIERS SHALL BE PLACED IN ACCORDANCE WITH THE REQUIREMENTS OF FDOT INDEX NO. 102, 103 AND 104 OR AS DIRECTED BY THE OWNER.
- REQUIRED EROSION CONTROL MEASURES MUST REMAIN INTACT THROUGHOUT CONSTRUCTION, FAILURE TO INSTALL OR PROPERLY MAINTAIN REQUIRED EROSION CONTROL WILL RESULT IN ENFORCEMENT ACTION WHICH MAY INCLUDE CITATIONS AS PROVIDED BY APPLICABLE LOCAL ORDINANCE AND CHAPTERS 40D-4 AND 40D-40, F.A.C. INITIATION OF CIVIL PENALTY PROCEDURES PURSUANT TO SECTION 373.129, F.A.C. CAN RESULT IN A PENALTY NOT TO EXCEED \$10,000 PER OFFENSE WITH EACH DATE DURING WHICH SUCH VIOLATION OCCURS CONSTITUTING A SEPARATE OFFENSE.
- 5. ALL WORK PERFORMED SHALL COMPLY WITH THE REGULATIONS AND ORDINANCES OF THE VARIOUS GOVERNMENTAL AGENCIES HAVING JURISDICTION OVER THE WORK.




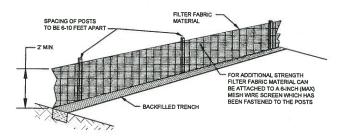

# ATTACHING TWO SILT FENCES ROTATE BOTH POSTS AT LEAST 180 DIRECTION TO CREATE A TIGHT SEAL WITH THE FABRIC MATERIAL DRIVE BOTH POSTS ABOUT 10 INCHES INTO THE




DRAINAGE INSTALLATION (FRONT ELEVATION)

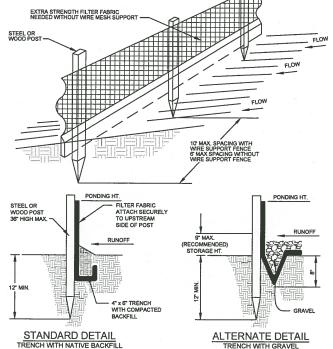

- INSPECT AND REPAIR FENCE AFTER EACH STORM EVENT AND REMOVE
- SEDIMENT WHEN NECESSARY.

  2. REMOVED SEDIMENT SHALL BE DEPOSITED TO AN AREA THAT WILL NOT CONTRIBUTE SEDIMENT OFF-SITE AND CAN BE PERMANENTLY STABILIZED.
- 3. SILT FENCE SHALL BE PLACED ON SLOPE CONTOURS TO MAXIMIZE PONDING

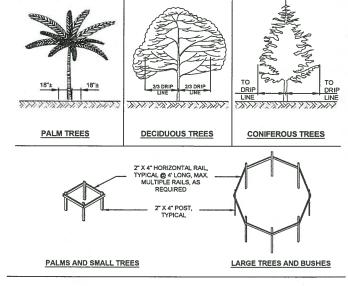

- NOTES:

  1. NO TRUCKS OR HEAVY EQUIPMENT ALLOWED WITHIN BARRIERS, ONLY HAND LABOR ALLOWED.

  2. NO CONSTRUCTION MATERIALS, SOILS DEPOSITS, OR SOLVENTS SHALL BE ALLOWED WITHIN

- 3. BARRIERS ARE TO BE IN PLACE PRIOR TO ANY CONSTRUCTION ACTIVITIES WITHIN TREE AREA.
  4. BARRIERS ARE TO STAY IN PLACE UNTIL ALL PAVING, CONSTRUCTION, AND HEAVY EQUIPMENT IS REMOVED FROM THE AREA.

## TREE PROTECTION BARRIERS DETAIL

NO. BY DATE

NOTES

**MANATEE COUNTY** 

**MLS TIDEVIEW 4** EMERGENCY GENERATOR REPLACEMENT



Shaping the Future 380 PARK PLACE BLVD, STE 300, CLEARWATER, FL 33759 TEL: (727) 531- 3505 (800) 861- 8314 www.cardno.com Certificate of Authorization No. 29915


KELLY S. WEHNER, PE DATE LIC. NO.: 60273

KSW DRAWN DES Q.C.

APPROVED

**DETAIL SHEET** 

00193009.09 NOVEMBER 2016 SHEET NO: C-6

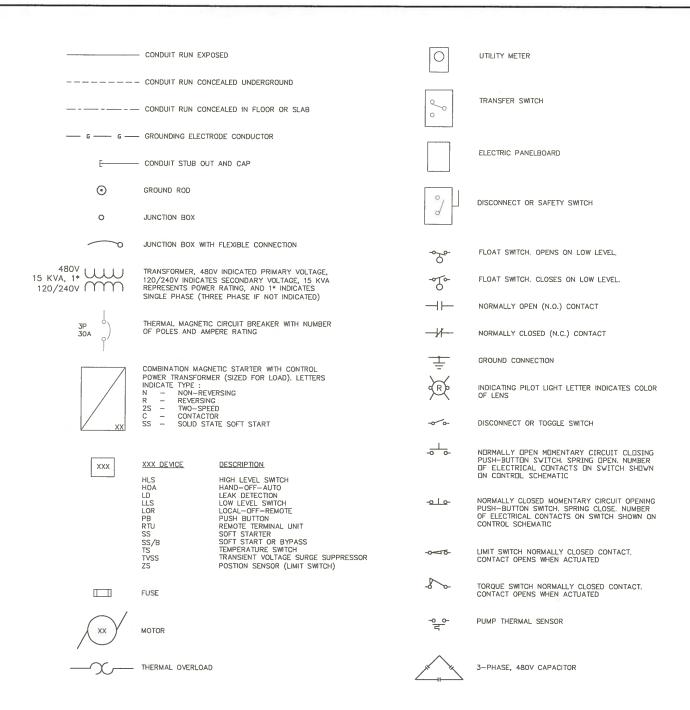

### ABBREVIATIONS: ABOVE FINISHED FLOOR AFG ATL ABOVE FINISHED GRADE ACROSS-THE-LINE CONDUIT CU EX ELEC EXP EXISTING ELECTRICAL EXPLOSION PROOF FU GFI GND HP HZ GROUND FAULT INTERRUPTER GROUNDING CONDUCTOR HORSEPOWER ISOLATED GROUND KILOVOLT AMPERES KILOWATTS KVA KW MAX MAXIMUM MINIMIM NOT APPLICABLE PHASE RECEPTACLE N/A RECP


RPM RTU

REVOLUTIONS PER MINUTE

SURGE PROTECTION DEVICE TYPICAL

REMOTE TERMINAL LINIT

WEATHERPROOF

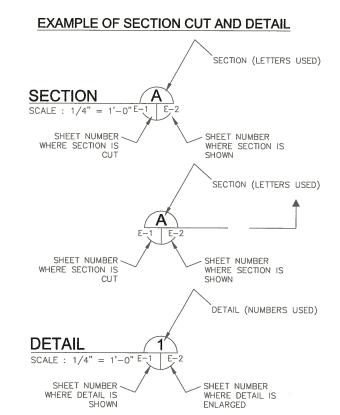

### GENERAL NOTES

THE WORK CONSIST OF FURNISHING ALL LABOR, MATERIALS, EQUIPMENT, AND TECHNICAL SUPERVISION TO INSTALL A NEW GENERATOR, TRANSFER SWITCH AND ASSOCIATED EQUIPMENT AS INDICATED AND SHOWN. THE WORK INCLUDES, BUT IS NOT LIMITED TO, THE FOLLOWING:

- CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR APPROVAL PRIOR TO PURCHASING EQUIPMENT OR COMMENCING CONSTRUCTION.
- 2. CONTROL CONDUCTORS SHALL BE STRANDED COPPER. 14 AWG MINIMUM. WITH THWN INSULATION LINESS OTHERWISE NOTED
- 3. ALL WIRING SHALL BE IDENTIFIED WITH NUMBERS AT ALL TERMINALS AND ON WIRING DIAGRAMS.
- 4. FIELD VERIFY ALL EQUIPMENT LOCATIONS AND CONNECTIONS PRIOR TO COMMENCING CONSTRUCTION.
- ALL NEW EQUIPMENT SHALL BE PERMANENTLY IDENTIFIED WITH A BLACK ON WHITE LAMACOID TAG ENGRAVED WITH MINIMUM 3/16 INCH LETTERING.
- ALL CIRCUITS SHALL HAVE A GROUNDING CONDUCTOR ROUTED INSIDE EACH CONDUIT WITH POWER CONDUCTORS.
- 7. ALL CONDUCTOR LENGTHS SHALL BE CONTINUOUS. NO SPLICES OR CONDUCTOR TERMINATIONS SHALL BE PERMITTED UNLESS SPECIFICALLY DESIGNATED IN THE DRAWINGS.
- ALL EXISTING INSTALLATIONS DENOTED ON THE DRAWINGS ARE FOR THE CONTRACTORS REFERENCE ONLY. ALL EXISTING INSTALLATIONS SHALL BE FIELD VERIFIED PRIOR TO SUBMITTING A BID AND PRIOR TO COMMENCING CONSTRUCTION,
- 9. CONDUITS SHALL BE RIGID HEAVY WALL ALUMINUM. FLEXIBLE CONDUITS SHALL BE NONMETALLIC LIQUID TIGHT.
- 10. MAKE MODIFICATIONS TO THE EXISTING MOTOR CONTROL CENTER AS SHOWN AND SPECIFIED.
- 11. PROVIDE AND INSTALL GENERATOR WITH WEATHER-PROOF, SOUND ATTENUATED FINCLOSURE AS SHOWN AND SPECIFIED
- 12. MAKE REQUIRED INTERCONNECTIONS BETWEEN MOTOR CONTROL CENTER COMPONENTS AND NEW GENERATOR AS SHOWN AND SPECIFIED.
- 13. PROVIDE AND INSTALL STAINLESS STEEL CHANNEL ERECTOR SYSTEMS TO MOUNT AND SUPPORT ENCLOSURES, BOXES, CONDUITS AND OTHER EQUIPMENT. ALL MOUNTING HARDWARE SHALL BE 316 SS.
- 14. ALL ELECTRICAL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE 2014 NATIONAL ELECTRICAL CODE (NEC).
- 15. AFTER COMPLETING THE EQUIPMENT INSTALLATION, THE SYSTEM SHALL BE TESTED TO SHOW FUNCTIONALITY.
- 16. TEST AND START-UP REPORTS FOR THE GENERATOR SYSTEM AND WIRE SHALL BE INCLUDED IN THE OPERATION AND MAINTENANCE (O&M) MANUALS PROVIDED UNDER THIS




**MANATEE COUNTY** DESCRIPTION BY DATE

3-2:29p PLOTTED; Wed, 10/26/16-2:42p BY; TDT201

**MLS TIDEVIEW 4 EMERGENCY GENERATOR REPLACEMENT** 






**ELECTRICAL LEGEND** AND ABBREVIATIONS

ROJECT NO 00193009.09 OCTOBER 2016 SHEET NO:

E-1

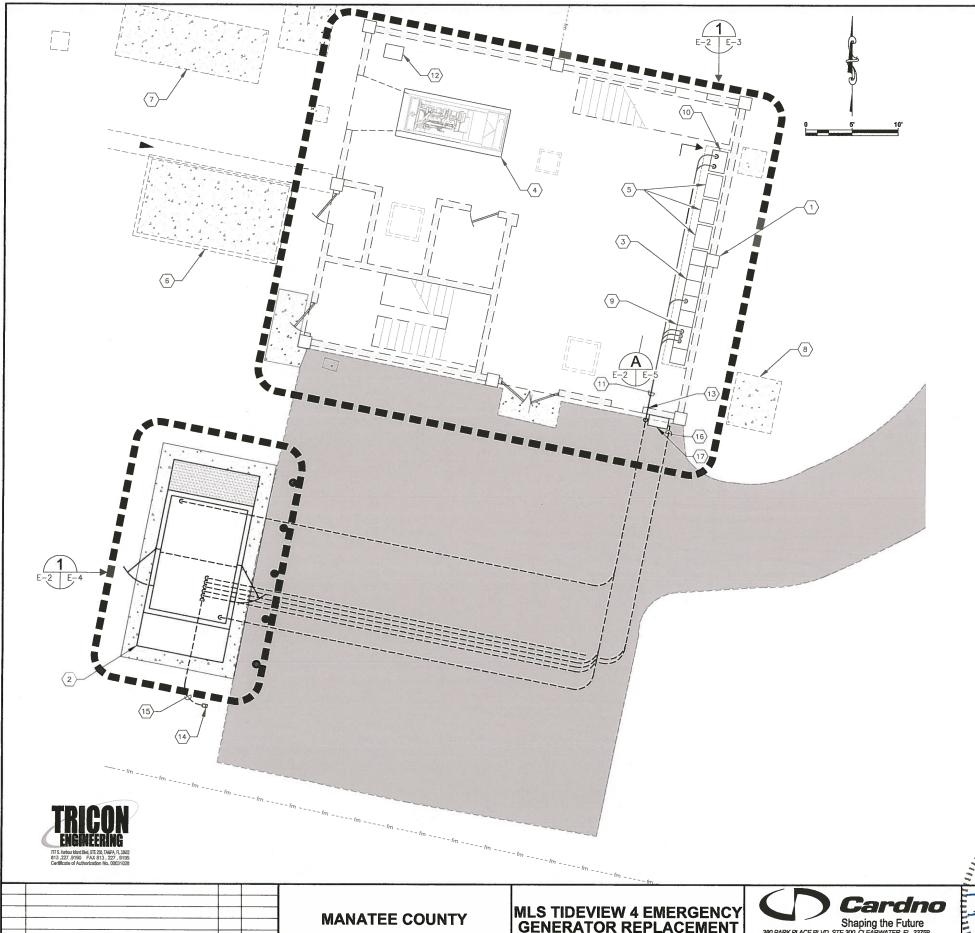

DESCRIPTION

BY DATE

### KEYED NOTES:

- EXISTING BUILDING FOR LIFT STATION TIDEVIEW 4. REFER TO SHEET E-3 FOR WORK REQUIRED WITHIN THE LIFT STATION BUILDING.
- 2 NEW 480V, 350 KW GENERATOR IN WEATHER-PROOF, SOUND ATTENUATED ENCLOSURE. REFER TO SHEET E-4 FOR GENERATOR DETAILS.
- EXISTING MOTOR CONTROL CENTER (MCC) FOR LIFT STATION TIDEVIEW 4. REFER TO SHEET E-5 FOR MCC ELEVATION AND WORK REQUIRED.
- 4 EXISTING GENERATOR SET TO BE REMOVED. REFER TO CIVIL/MECHANICAL SHEETS FOR DETAILS.
- 5) EXISTING VARIABLE FREQUENCY DRIVES (VFD'S) NO WORK REQUIRED.
- EXISTING ODOR CONTROL FILTER. NO WORK REQUIRED.
- $\overline{7}$  EXISTING DIESEL STORAGE TANK TO BE REMOVED. REFER TO CIVIL/MECHANICAL SHEETS FOR DETAILS.
- 8 EXISTING UTILITY TRANSFORMER. NO WORK REQUIRED.
- (9) EXISTING TRANSFER SWITCH FOR LIFT STATION TIDEVIEW 4. EXISTING TRANSFER SWITCH TO BE REPLACED. REFER TO SHEETS E-5 AND E-7 FOR WORK REQUIRED.
- (10) EXISTING PLC CONTROL CABINET FOR LIFT STATION TIDEVIEW 4. REFER TO SHEET E-5 FOR PLC CONTROL CABINET ELEVATION AND WORK REQUIRED.
- $\langle 11 \rangle$  CONTRACTOR TO PROVIDE AND INSTALL THE FOLLOWING :

PROVIDE AND INSTALL 8-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT. FIELD ROUTE CONDUIT FROM PLC CONTROL CABINET TO NEW GENERATOR FOR SCADA MONITORING OF GENERATOR. 2-#12 FOR GENERATOR RUNNING INDICATION, 2-#12 FOR GENERATOR FAIL INDICATION AND 4-#12 SPARE.

PROVIDE AND INSTALL 8-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT TO EXISTING PLC CONTROL CABINET FOR SCADA MONITORING OF BASE TANK. 2-#12 BASE TANK LEAK DETECTION ALARM, 2-#12 FOR BASE TANK FUEL HIGH LEVEL ALARM AND 2-#12 FOR BASE TANK FUEL HIGH LEVEL ALARM AND 2-#12 SPARE. CONTRACTOR SHALL COORDINATE/VERIFY CONNECTION LOCATION AND TYPE WITH ENCLOSURE MANUFACTURER.

PROVIDE AND INSTALL TWO (2) PARALLEL RUNS CONSISTING OF 3-350kcmil Thwn CU + 1-#1 Thwn CU GND IN 3" CONDUIT. FIELD ROUTE CONDUIT FROM NEW TRANSFER SWITCH TO NEW GENERATOR DOCKING STATION FOR 480V STANDBY POWER FEEDER CIRCUIT.

PROVIDE AND INSTALL 4-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT. FIELD ROUTE CONDUIT FROM NEW TRANSFER SWITCH TO NEW GENERATOR FOR GENERATOR START SIGNAL CONTRACTOR TO COORDINATE/VERIFY GENERATOR STARTER CONTROL REQUIREMENTS WITH GENERATOR AND TRANSFER SWITCH MANUFACTURERS.

PROVIDE AND INSTALL 3-#6 THWN CU + 1-#6 THWN CU NEUTRAL + 1-#10 THWN CU GND IN 1-1/4" CONDUIT. FIELD ROUTE CONDUIT FROM EXISTING MCC PANELBOARD (VIA NEW 3-POLE, 60A CIRCUIT BREAKER) TO NEW GENERATOR DISCONNECT SWITCH FOR 36, 120/208V ANCILLARY EQUIPMENT FEEDER CIRCUIT.

- (12) EXISTING DAY TANK TO BE REMOVED. REFER TO CIVIL/MECHANICAL SHEETS FOR DETAILS.
- CORE DRILL PENETRATION 1/4" LARGER THAN CONDUIT DIAMETER. FILL VOID WITH PAINTABLE SILICONE CHALK (BOTH SIDES OF WALL). PAINT WITH COLOR TO MATCH EXISTING WALL. TYPICAL FOR ALL EXTERIOR WALL PENETRATIONS.
- GENERATOR EMERGENCY SHUT DOWN PUSH BUTTON STATION. MAINTAINED 2 POSITION SWITCH WITH 1-5/8" DIA. OPERATOR, 1 N.O. & 1 N.C. CONTACT MOUNTED IN A NEMA 4X SS ENCLOSURE, 4'-6" ABOVE FINISHED GRADE. BREAK-GLASS OPERATORS ARE NOT AN ACCEPTABLE SUBSTITUTION. PROVIDE PHENDIC NAMEPLATE ABOVE PUSH BUTTON STATION. NAMEPLATE SHALL BE THREE-PLY PHENDLIC RED-WHITE-RED ENGRAVED THROUGH THE FIRST RED LAYER. LETTERING SHALL BE 1/2" MIN., EDGES OF NAMEPLATE SHALL BE BEVELED 45 DEG. NAMEPLATE SHALL READ AS FOLLOWS: "GENERATOR EMERGENCY SHUT DOWN". INSTALL EMERGENCY SHUT DOWN PUSH BUTTON STATION ON 4" X 4" X 7" CONCRETE POST.
- (15) PROVIDE AND INSTALL 2-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT. FIELD ROUTE CONDUIT FROM PUSH BUTTON STATION TO NEW GENERATOR FOR SHUT DOWN SIGNAL.
- \$\langle\$16\$ PROVIDE AND INSTALL NEW 480V, 3-POLE, 600A DOCKING STATION. TRYSTAR GDR064W-LLM-I. REFER ALSO TO SPECIFICATIONS.
- | 17 | PROVIDE AND INSTALL TWO (2) PARALLEL RUNS CONSISTING OF 3-350 kcmil THWN CU + 1-#1 THWN CU GND IN 3" CONDUIT. FIELD ROUTE CONDUIT FROM NEW GENERATOR DOCKING STATION TO NEW GENERATOR FOR 480V STANDBY POWER FEEDER CIRCUIT.

### **GENERAL NOTES:**

- THIS DRAWING SHOWS EXISTING CONDITIONS USING THE BEST AS—BUILT INFORMATION AVAILABLE AT THE TIME
  OF DESIGN, IT IS PROVIDED FOR REFERENCE ONLY. THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING
  INSTALLATIONS PRIOR TO SUBMITTING A BID AND PRIOR TO COMMENCING CONSTRUCTION.
- CONDUIT ROUTING SHOWN IS DIAGRAMMATICAL. CONTRACTOR SHALL FIELD ROUTE CONDUIT BASED ON EXISTING FIELD CONDITIONS. CONTRACTOR SHALL PROVIDE JUNCTION BOXES, PULL BOXES AND/OR CONDUIT LB FITTINGS AS REQUIRED TO MEET THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE.
- 3. CONTRACTOR TO CUT ASPHALT OR CONCRETE AS REQUIRED TO INSTALL CONDUIT. ASPHALT AND/OR CONCRETE SHALL BE REPAIRED/REPLACED TO MATCH EXISTING.

4. NOT ALL-CONDUCTORS SHOWN FOR CLARITY. REFER TO SHEETS E-3 AND E-4 FOR ADDITIONAL REQUIREMENTS.

THOUGHY THOMAS PE DATE TOT APPRIVED

THOUGHY THOMAS PE DATE TOT APPRIVED

TOT APPRIVED

TOT APPRIVED


TOT APPRIVED

**ELECTRICAL SITE PLAN** 

PROJECT NO: 00193009.09

OCTOBER 2016 SHEET NO: E-2

380 PARK PLACE BLVD, STE 300, CLEARWATER, FL 33759 TEL: (727) 531-3505 (800) 861-8314 www.cardno.com Certificate of Authorization No. 29915

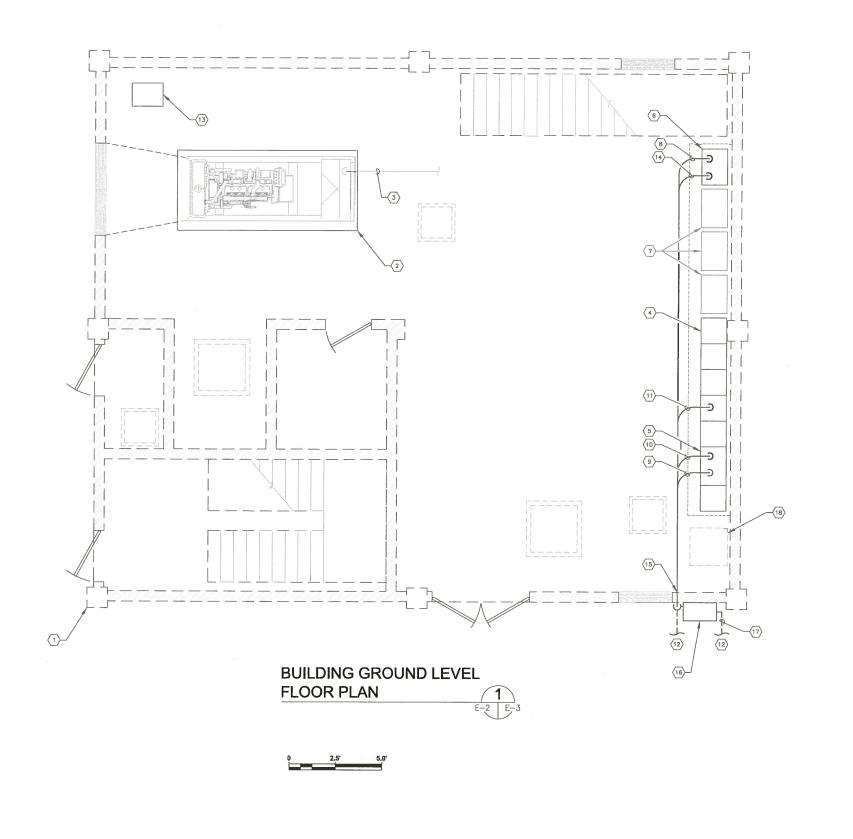

### KEYED NOTES:

- 1) EXISTING BUILDING FOR LIFT STATION TIDEVIEW 4.
- (2) EXISTING GENERATOR SET TO BE REMOVED. REFER TO CIVIL/MECHANICAL SHEETS FOR DETAILS.
- 3 EXISTING GENERATOR 480V FEEDER TO BE REMOVED. FEEDER CONDUCTORS ARE ROUTED TO EXISTING TRANSFER SWITCH VIA EXISTING MCC AND WIREWAY. CONTRACTOR SHALL REMOVE EXTIRE LENGTH OF CONDUCTORS AND CONDUT. CONTRACTOR SHALL ALSO REMOVE ALL ANCILLARY EQUIPMENT COMDUCTORS AND CONDUT (BATTERY CHARGER CIRCUIT, GENERATOR STARTER CIRCUIT, ETC., NOT SHOWN FOR CLARITY).
- EXISTING MOTOR CONTROL CENTER (MCC) FOR LIFT STATION TIDEVIEW 4. REFER TO SHEET E-5 FOR MCC ELEVATION AND WORK REQUIRED.
- 5 EXISTING TRANSFER SWITCH FOR LIFT STATION TIDEVIEW 4 TO BE REPLACED. REFER TO SHEETS E-5 AND E-7 FOR TRANSFER SWITCH ELEVATION AND WORK REQUIRED.
- 6 EXISTING PLC CONTROL CABINET. REFER TO SHEET E-5 FOR ELEVATION OF PLC CONTROL CABINET ELEVATION AND WORK REQUIRED.
- 7) EXISTING VARIABLE FREQUENCY DRIVE (VFD). TYPICAL OF THREE (3). NO WORK REQUIRED FOR ANY VFD.
- 8 PROVIDE AND INSTALL 8-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT, FIELD ROUTE CONDUIT FROM PLC CONTROL CABINET TO NEW GENERATOR FOR SCADA MONITORING OF GENERATOR. 2-#12 FOR GENERATOR RUNNING INDICATION, 2-#12 FOR GENERATOR FAIL INDICATION AND 4-#12 SPARE.
- PROVIDE AND INSTALL TWO (2) PARALLEL RUNS CONSISTING OF 3-350 kcmil THWN CU + 1-#1 THWN CU GND IN 3" CONDUIT. RELD ROUTE CONDUIT FROM NEW TRANSFER SWITCH TO NEW GENERATOR DOCKING STATION FOR 480V STANDEY POWER FEEDER CIRCUIT.
- PROVIDE AND INSTALL 4-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT. FIELD ROUTE CONDUIT FROM NEW TRANSFER SWITCH TO NEW GENERATOR FOR GENERATOR START SIGNAL. CONTRACTOR TO COORDINATE/VERIFY GENERATOR STARTER CONTROL REQUIREMENTS WITH GENERATOR AND TRANSFER SWITCH MARNUFACTURERS.
- PROVIDE AND INSTALL 3-#6 THWN CU + 1-#6 THWN CU NEUTRAL + 1-#10 THWN CU GND IN 1-1/4" CONDUIT. FIELD ROUTE CONDUIT FROM EXISTING MCC PANELBOARD (VIA NEW 3-POLE, 50A CIRCUIT BREAKER) TO NEW GENERATOR DISCONNECT SWITCH FOR 36, 120/20BV ANCILLARY EQUIPMENT FEEDER CIRCUIT.
- 12 FOR CONTINUATION OF CONDUITS TO GENERATOR REFER TO SHEET E-2.
- (13) EXISTING DAY TANK TO BE REMOVED. REFER TO CIVIL/MECHANICAL SHEETS FOR DETAILS.
- PROVIDE AND INSTALL 8-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT TO EXISTING PLC CONTROL CABINET FOR SCADA MONITORING OF BASE TANK. 2-#12 BASE TANK LEAK DETECTION ALARM, 2-#12 FOR BASE TANK FUEL HOW LEVEL ALARM, 2-#12 FOR BASE TANK FUEL HIGH LEVEL ALARM AND 2-#12 SPARE. CONTRACTOR SHALL COORDINATE/VERIFY CONNECTION LOCATION AND TYPE WITH ENCLOSURE MANUFACTURER.
- (15) CORE DRILL PENETRATION 1/4" LARGER THAN CONDUIT DIAMETER. FILL VOID WITH PAINTABLE SILICONE CHALK (BOTH SIDES OF WALL). PAINT WITH COLOR TO MATCH EXISTING WALL. TYPICAL FOR ALL EXTERIOR WALL PENETRATIONS.
- $\overbrace{\text{16}} \text{ PROVIDE AND INSTALL NEW 480V, 3-POLE, 600A DOCKING STATION. TRYSTAR GDR064W-LLM-I. REFER ALSO TO SPECIFICATIONS. } \\$
- (17) PROVIDE AND INSTALL TWO (2) PARALLEL RUNS CONSISTING OF 3-350 kernil Thwn CU + 1-#1 THWN CU ond in 3" conduit. Field route conduit from New Generator Docking Station to New Generator for 480V Standby Power Feeder Circuit.
- (18) EXISTING FAN EXHAUST DUCT RUNNING VERTICALLY ADJACENT TO EXISTING MOTOR CONTROL CENTER.

### GENERAL NOTES :

- THIS DRAWING SHOWS EXISTING CONDITIONS USING THE BEST AS—BUILT INFORMATION AVAILABLE AT THE TIME OF DESIGN. IT IS PROVIDED FOR REFERENCE ONLY. THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING INSTALLATIONS PRIOR TO SUBMITTING A BID AND PRIOR TO COMMENCING CONSTRUCTION.
- CONDUIT ROUTING SHOWN IS DIAGRAMMATICAL CONTRACTOR SHALL FIELD ROUTE CONDUIT BASED ON EXISTING FIELD CONDITIONS. CONTRACTOR SHALL PROVIDE JUNCTION BOXES, PULL BOXES AND/OR CONDUIT LB FITTING AS REQUIRED TO MEET THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE.

DESIGNED

TRICOR ENGINEERING 771 S. Natous Island Bird. STE 250, JAMPA. P. 330 813. 227. 9190 FAX 813. 227. 931 Certification of Authorization No. 000310

NO. DESCRIPTION BY DATE

**MANATEE COUNTY** 

MLS TIDEVIEW 4 EMERGENCY GENERATOR REPLACEMENT



BUILDING LAYOUT GROUND LEVEL PROJECT NO: 00193009.09 DATE: OCTOBER 2016

SHEET NO:

E-3


ANOTHY TIDINGS PE DATE.

A7079

A7079

A7079

A7079

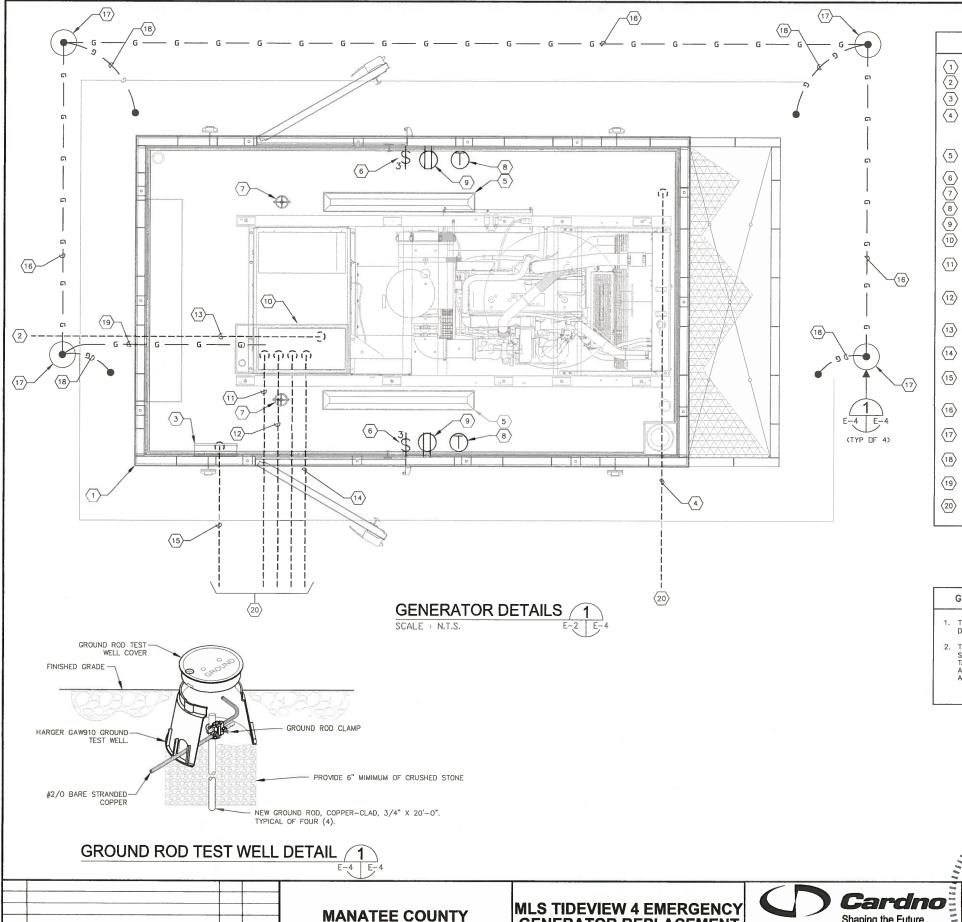

DESCRIPTION

BY DATE

### **KEYED NOTES:**

- 1 NEW 480V, 350 KW GENERATOR IN WEATHER-PROOF, SOUND ATTENUATED ENCLOSURE. REFER ALSO TO SPECIFICATIONS.
- FOR CONTINUATION OF CONDUIT REFER TO SHEET E-2.
- (3) 100 AMPERE, 120/208V, 3ø, MCB LOADCENTER PROVIDED AND INSTALLED AS PART OF THE ENCLOSURE PACKAGE.
- PROVIDE AND INSTALL 8-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT TO EXISTING PLC CONTROL CABINET FOR SCADA MONITORING OF BASE TANK. 2-#12 BASE TANK LEAK DETECTION ALARM, 2-#12 FOR BASE TANK FUEL LOW LEVEL ALARM, 2-#12 FOR BASE TANK FUEL HIGH LEVEL ALARM AND 2-#12 SPARE. CONTRACTOR SHALL COORDINATE/VERIFY CONNECTION LOCATION AND TYPE WITH ENCLOSURE MANUFACTURER.
- 4' LED LIGHT FIXTURE. COLUMBIA LXEM4-40ML-RA-E-U-SSL OR ENGINEER APPROVED EQUAL. PROVIDED AS PART OF THE ENCLOSURE PACKAGE.
- (6) 3-WAY SWITCHES PROVIDED AND INSTALLED AS PART OF THE ENCLOSURE PACKAGE.
- DC LIGHT FIXTURES PROVIDED AND INSTALLED AS PART OF THE ENCLOSURE PACKAGE.
- (8) 60 MINUTE TIMER SWITCHES FOR DC LIGHT FIXTURES PROVIDED AND INSTALLED AS PART OF THE ENCLOSURE PACKAGE.
- 20A, 125V DUPLEX GFCI RECEPTACLE PROVIDED AND INSTALLED AS PART OF THE ENCLOSURE PACKAGE.
- (10) STUBUP LOCATION FOR 480V FEEDER CIRCUIT, GENERATOR STARTER CIRCUIT, GENERATOR SHUT DOWN AND SCADA I/O.
- PROVIDE AND INSTALL 8-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT TO EXISTING PLC CONTROL CABINET FOR SCADA MONITORING OF GENERATOR. 2-#12 FOR GENERATOR RUNNING INDICATION, 2-#12 FOR GENERATOR FAIL INDICATION AND
- PROVIDE AND INSTALL 4-#12 THWN CU + 1-#12 THWN CU + 10 THY CU GND IN 3/4" CONDUIT TO EXISTING TRANSFER SWITCH FOR GENERATOR START SIGNAL. CONTRACTOR TO COORDINATE/VERIFY GENERATOR STARTER CONTROL REQUIREMENTS WITH GENERATOR AND TRANSFER SWITCH MANUFACTURERS.
- PROVIDE AND INSTALL 2-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT TO NEW EMERGENCY SHUT DOWN PUSH BUTTON STATION FOR SHUT DOWN SIGNAL.
- PROVIDE AND INSTALL TWO (2) PARALLEL RUNS CONSISTING OF 3-350 kcmil THWN CU + 1-#1 THWN CU GND IN 3" CONDUIT TO NEW GENERATOR DOCKING STATION SWITCH FOR 480V STANDBY POWER FEEDER CIRCUIT.
- (15) PROVIDE AND INSTALL 3-#6 THWN CU + 1-#6 THWN CU NEUTRAL + 1-#10 THWN CU GND IN 1-1/4" CONDUIT. FIELD ROUTE CONDUIT FROM EXISTING MCC PANELBOARD (VIA NEW 3-POLE, 60A CIRCUIT BREAKER) TO NEW GENERATOR DISCONNECT SWITCH FOR 30, 120/208V ANCILLARY EQUIPMENT FEEDER CIRCUIT.
- (16) CONTRACTOR TO PROVIDE AND INSTALL GROUND RING CONSISTING OF #2/O BARE STRANDED COPPER DIRECT BURIED IN SOIL A MINIMUM OF 24" BELOW GRAVEL BASE.
- (17) CONTRACTOR TO PROVIDE AND INSTALL NEW GROUND ROD, COPPER-CLAD, 3/4" X 20'-0" AND GROUND ROD TEST WELL. REFER ALSO TO GROUND ROD DETAIL ON THIS SHEET. TYPICAL OF FOUR (4).
- (18) CONTRACTOR TO PROVIDE AND INSTALL A #2/O AWG BARE COPPER CONDUCTOR BETWEEN THE GROUND ROD AND THE REINFORCING STEEL EMBEDDED IN THE GENERATOR CONCRETE PAD. PROVIDE EXOTHERMIC WELDS.
- $\stackrel{ ext{ }}{\text{ }}$  Contractor to provide and install #2/0 bare stranded copper grounding electrode conductor for generator frame. Provide exothermic weld to grounding grid.
- $\overline{20}$  for continuation of conduits to pump station tideview 4 building refer to sheet E-2.

### GENERAL NOTES :

- 1. THIS DRAWING SHOWS LAYOUTS AND DIMENSIONS BASED ON A PARTICULAR MANUFACTURER. THE CONTRACTOR SHALL COORDINATE DIMENSIONS, STUBUP LOCATIONS AND EQUIPMENT LOCATIONS WITH THE MANUFACTURER SUBMITTED/PROVIDED.
- 2. THE GENERATOR ENCLOSURE SHALL BE PROVIDED WITH A 120/208V, 3Ø, 50A MCB LOADCENTER, LED LIGHTING FIXTURES, 3-WAY SWITCHES, DC LIGHTING FIXTURES, 60 MINUTE TIMER SWITCHES FOR DC LIGHT FIXTURES, DUPLEX GFCI RECEPTACLES AND BASE TANK AS NOTED AND SPECIFIED. ALL EQUIPMENT PROVIDED BY THE SUPPLIER OF THE ENCLOSURE PACKAGE SHALL BE PROVIDED AND INSTALLED WITH ALL ASSOCIATED CONDUIT AND CONDUCTORS FOR POWER AND CONTROLS AS REQUIRED FOR A COMPLETE AND FUNCTIONING UNIT

THY THOMASSI DESIGNED DRAWN DIMOTHY THOMAS, PE DATE

SIONALEMI MINISTONALEMI


**GENERATOR DETAILS** 

PROJECT NO 00193009.09

> OCTOBER 2016 SHEET NO:

MLS TIDEVIEW 4 EMERGENCY **GENERATOR REPLACEMENT** 

Shaping the Future 380 PARK PLACE BLVD, STE 300, CLEARWATER, FL 33759 TEL: (727) 531-3505 (800) 861-8314

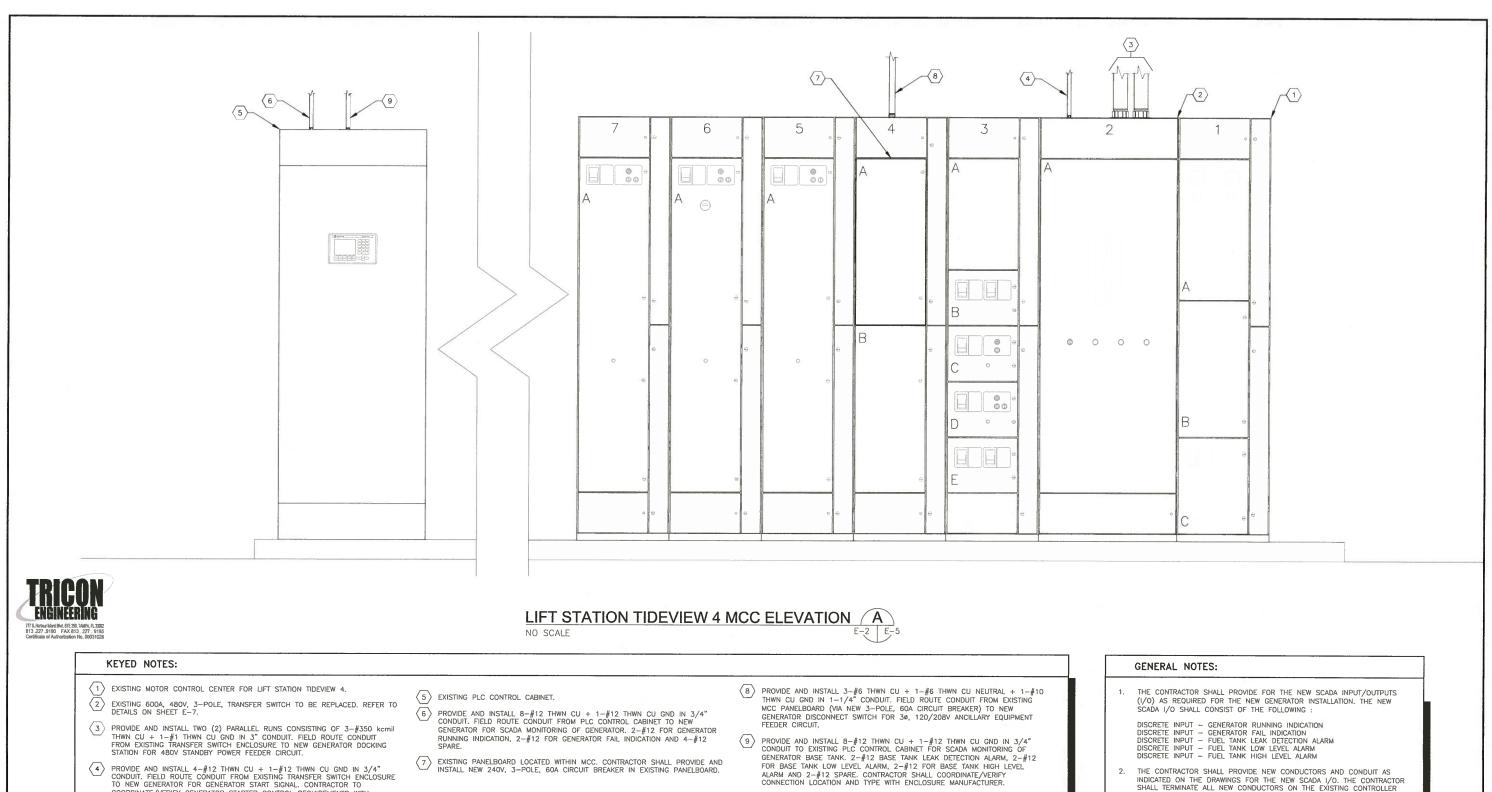

PROVIDE AND INSTALL 4-#12 THWN CU + 1-#12 THWN CU GND IN 3/4" CONDUIT. FIELD ROUTE CONDUIT FROM EXISTING TRANSFER SWITCH ENCLOSURE TO NEW GENERATOR FOR GENERATOR START SIGNAL. CONTRACTOR TO COORDINATE/VERIFY GENERATOR STARTER CONTROL REQUIREMENTS WITH GENERATOR AND TRANSFER SWITCH MANUFACTURER.

THE CONTRACTOR SHALL PROVIDE NEW CONDUCTORS AND CONDUIT AS INDICATED ON THE DRAWINGS FOR THE NEW SCADA I/O. THE CONTRACTOR SHALL TERMINATE ALL NEW CONDUCTORS ON THE EXISTING CONTROLLER AND PROVIDE FOR THE PROGRAMMING OF THE EXISTING CONTROLLER IN ORDER TO INTEGRATE THE NEW I/O INTO THE COUNTY'S EXISTING SCADA SYSTEM. THE CONTRACTOR SHALL COORDINATE THIS WORK WITH MANATEE COUNTY.

DESCRIPTION BY DATE

**MANATEE COUNTY** 

**MLS TIDEVIEW 4 EMERGENCY GENERATOR REPLACEMENT** 




DESTGNED
TIDT
DRAWAN
JLH
GOLD
TIDT
APPROVED THOTHY THOMAS PE DATE P. SONAL ENTE


**LIFT STATION TIDEVIEW 4** MCC ELEVATON

PROJECT NO: 00193009.09 OCTOBER 2016

E-5

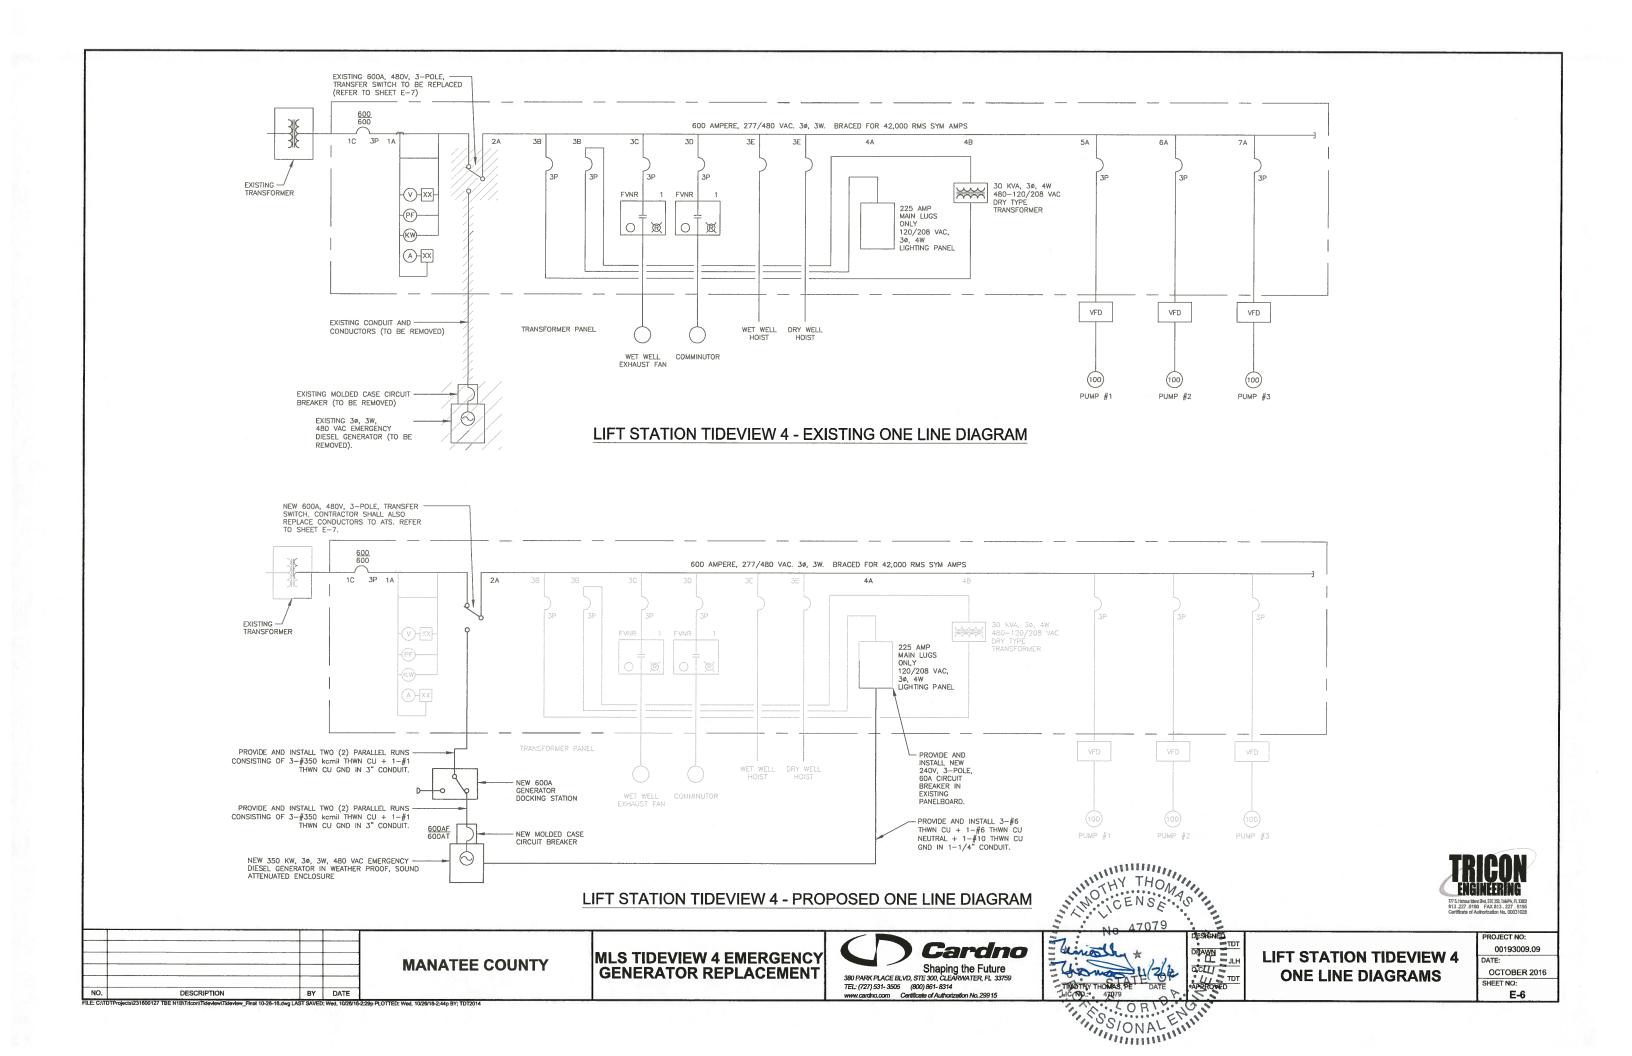



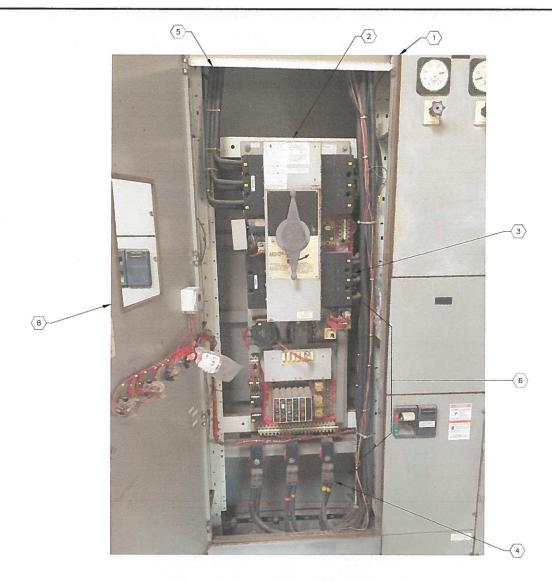


### **EXISTING ATS ENCLOSURE INTERIOR**

NO SCALE

### **KEYED NOTES:**

- EXISTING AUTOMATIC TRANSFER SWITCH (ATS) ENCLOSURE INTERIOR. ENCLOSURE SHALL REMAIN. THE CONTRACTOR SHALL MODIFY INTERIOR COMPONENTS ONLY.
- 2 CONTRACTOR TO REMOVE EXISTING TRANSFER SWITCH AND ALL ANCILLARY COMPONENTS.
- 3 EXISTING NORMAL POWER CONDUCTORS FROM EXISTING MAIN CIRCUIT BREAKER. CONTRACTOR SHALL REMOVE ALL EXISTING NORMAL POWER CONDUCTORS AND REPLACE WITH TWO (2) PARALLEL RUNS CONSISTING OF 3-#350 kcmil THWN CU + 1-#1 THWN CU GND.
- 4 EXISTING LOAD SIDE CONDUCTORS. LOAD SIDE CONDUCTORS CONTINUE TO MCC BUS. CONTRACTOR SHALL REMOVE ALL EXISTING LOAD SIDE CONDUCTORS AND REPLACE WITH TWO (2) PARALLEL RUNS CONSISTING OF 3-#350 kcmil THWN CU + 1-#1 THWN CU GND.
- (5) EXISTING EMERGENCY POWER CONDUCTORS FROM EXISTING GENERATOR. CONTRACTOR SHALL REMOVE ALL EXISTING EMERGENCY POWER CONDUCTORS AND REPLACE WITH TWO (2) PARALLEL RUNS CONSISTING OF 3-#350 kcmil THWN CU + 1-#1 THWN CU GDD. REFER ALSO TO SHEETS E-2, E-3 AND E-4 FOR EMERGENCY POWER CONDUCTOR ROUTING TO NEW GENERATOR DOCKING STATION.
- 6 CONTRACTOR TO REMOVE ANCILLARY COMPONENTS NOT REQUIRED FOR NEW ATS INSTALLATION.
- $\left\langle \overline{7} \right\rangle$  EXISTING ATS ENCLOSURE SHOWN WITH DOOR CLOSED.
- (8) CONTRACTOR TO PROVIDE AND INSTALL NEW DOOR FOR EXISTING ATS ENCLOSURE.
- CONTRACTOR SHALL PROVIDE AND INSTALL NEW DOOR-MOUNTED SWITCHES, PILOT LIGHTS, CONTROLLER DISPLAY AND KEYPAD. REFER ALSO TO SPECIFICATIONS.

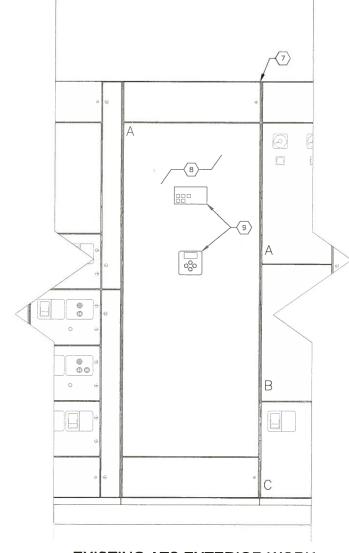

### **EXISTING ATS EXTERIOR WORK**

NO SCALE

### ATS GENERAL NOTES:

- WITH THE EXCEPTION OF THE ATS ENCLOSURE AND SUPPORTS, THE ENTIRE AUTOMATIC TRANSFER SWITCH SHALL BE REPLACED. THE REPLACEMENT SHALL INCLUDE NOT ONLY THE ATS, BUT THE CONTROL PANEL (AND USER INTERFACE), USER CONTROLS AND INDICATORS, WIRING HARNESSES, ETC.
- 2. THE CONTRACTOR SHALL PROVIDE LUGS AS REQUIRED TO ACCOMMODATE THE NEW CONDUCTORS TO BE INSTALLED.
- 3. THE CONTRACTOR SHALL CONNECT ALL EQUIPMENT GROUND CONDUCTORS (NOT SHOWN FOR CLARITY).

OTHY THOMAS

- CONTRACTOR TO REMOVE ALL EXISTING CONTROL CONDUCTORS FROM EXISTING GENERATOR (TO BE REMOVED) TO EXISTING ATS (TO BE REMOVED). REFER TO OTHER SHEETS FOR CONTROL WIRING REQUIRED BETWEEN NEW ATS AND NEW GENERATOR.
- 5. REFER TO SPECIFICATION SECTION 00800 FOR TEMPORARY POWER REQUIREMENTS.
- CONTRACTOR SHALL DUPLICATE ALL EXISTING CONDUCTOR ROUTES/SIZES/QUANTITIES. CONTRACTOR TO FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO ORDERING MATERIALS/EQUIPMENT OR COMMENCING CONSTRUCTION.

DESCRIPTION BY DATE

**MANATEE COUNTY** 

**MLS TIDEVIEW 4 EMERGENCY GENERATOR REPLACEMENT** 



DRAWN TIMOTEY THOMAS, PE ( DATE SOONAL ENTE

**LIFT STATION TIDEVIEW 4** ATS REPLACEMENT **DETAILS** 

ROJECT NO: 00193009.09

OCTOBER 2016 SHEET NO: E-7

### GENERAL STRUCTURAL NOTES

### DESIGN CRITERIA

### CODES:

2014 FLORIDA BUILDING CODE

REINFORCED CONCRETE: "BUILDING CODE REQUIREMENTS FOR STRUCTURAL

MASONRY: "BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES" (TMS 402-11/ACI 530-11/ASCE 5-11)

ALUMINUM: ALUMINUM DESIGN MANUAL: PART 1 — A SPECIFICATION FOR ALUMINUM STRUCTURES (ADM1-2010)

### DESIGN LIVE LOADS:

- PROCESS RELATED STRUCTURES

WALKWAYS, STAIRWAYS AND LANDINGS ELEVATED SLABS

### SUPERIMPOSED DEADLOADS:

_	ROOFS	AS	NOTED
_	FLOORS	AS	NOTED

### WIND LOADS:

- ULTIMATE DESIGN WIND SPEED, V<sub>ULT</sub> (3-SECOND GUST)
   NOMINAL DESIGN WIND SPEED, V<sub>ASD</sub>
- RISK CATEGORY EXPOSURE CATEGORY

- ENCLOSURE CAIEGORY
- ENCLOSURE CLASSIFICATION
- INTERNAL PRESSURE COEFFICIENT, GCpi
- DESIGN PRESSURES: PER ASCE 7-10

PARTIALLY ENCLOSED ±0.55

### FOUNDATIONS

- ALLOWABLE BEARING PRESSURE FOR MAT FOOTINGS OVER SUBSURFACE PREPARED AS PER DRAWINGS: 2500 PSF

### GENERAL CONDITIONS

ALL STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH THE MECHANICAL, CIVIL, ELECTRICAL, AND SHOP DRAWINGS AND SPECIFICATIONS.

THE CONTRACTOR SHALL REVIEW AND VERIFY DIMENSIONS SHOWN IN ALL PLANS AND REVIEW ALL FIELD CONDITIONS THAT MAY AFFECT THE INSTALLATION OF THE WORK SHOWN. SHOULD DISCREPANCIES APPEAR, THE CONTRACTOR SHALL NOTIFY THE ENGINEER IN WRITING TO OBTAIN ENGINEER'S CLARIFICATION BEFORE COMMENCING WITH THE WORK

FOR ALL ITEMS EMBEDDED IN OR PASSED THOUGH CONCRETE, THE CONTRACTOR SHALL INITIALLY REFER TO MECHANICAL, HEATING, AND VENTILATION DRAWINGS FOR TYPE, SIZE, LOCATION, AND SPECIAL INSTALLATION REQUIREMENTS FOR THESE ITEMS.

THE CONTRACTOR SHALL TAKE ANY AND ALL NECESSARY MEASURES TO PROTECT EXISTING STRUCTURES FROM DAMAGE WHEN WORKING IN AND AROUND EXISTING STRUCTURES PERFORMING WORK SUCH AS DEMOLITION, FOUNDATION EXCAVATION, AND OTHERS.

SIZE AND LOCATION OF EQUIPMENT PADS AND ANCHOR BOLTS SHALL BE PER EQUIPMENT MANUFACTURERS REQUIREMENTS.

ANY EQUIPMENT THAT MAY INDUCE VIBRATION TO THE STRUCTURE SHALL BE ADEQUATELY ISOLATED FROM THE STRUCTURES.

ADDITIONAL BETWEEN BUILDING

DIAMETER

DRAWING EACH FACE

ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE ON THE PROJECT, EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.

STANDARD DETAILS APPLY TO ALL SIMILAR SITUATIONS ON THE PROJECT EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.

REINFORCEMENT SHALL CONFORM TO ASTM A615, GRADE 60 REQUIREMENTS. WELDED WIRE FABRIC, ASTM A185. ALL ACCESSORIES SHALL BE IN CONFORMANCE WITH ACI 315 REQUIREMENTS. REINFORCING STEEL SHALL HAVE THE FOLLOWING CLEAR COVER UNLESS OTHERWISE NOTED:

- CONCRETE CAST AGAINST EARTH

- FORMED SURFACES

LAP SPLICES SHALL BE AS SHOWN ON THE DRAWINGS. FOR LAP SPLICES NOT SHOWN ON THE DRAWINGS, THE CONTRACTOR SHALL OBTAIN ENGINEERS APPROVAL.

THE CONTRACTOR SHALL PREPARE PLACING DRAWINGS AND SCHEDULES IN CONFORMANCE WITH ACI 315 REQUIREMENTS.

UNLESS OTHERWISE NOTED, THE MINIMUM REINFORCING FOR ALL CONCRETE WALLS AND SLABS SHALL BE AS FOLLOWS:

MINIMUM REINFORCING							
THICKNESS	6"	8*	10"	12"-16"	18"-22"	24"	
REINF. EACH WAY	#4AT12"	#5AT12"	#4AT12"	#5AT12"	#6AT12"	#7AT12"	
LOCATION	CENTER	CENTER	EF	EF	EF	EF	

- ALLOWABLE STEEL STRESS
- f'm = 1500 PSI fs = 24.000 PSI

SPECS

SS STD STL REINF TB T&B

UNO VERT WWF SJ

T/STRUCTURE TYP

### MATERIALS:

- BLOCK: CONFORM TO ASTM C90 LOAD BEARING, NORMAL WEIGHT TWO-CELL.
- MORTAR: CONFORM TO ASTM C270, TYPE S, MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS 1800 PSI. UTILIZE TYPE II CEMENT AND TYPE S LIME. MASONRY CEMENT WILL NOT BE CONSIDERED.
- GROUT: CONFORM TO C476, COURSE GROUT, MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS 2500 PSI
- STEEL: BOND BEAM AND FILLED CELL REINFORCEMENT AS NOTED ON DRAWINGS (ASTM A615, GRADE 60). DUR-O-WALL OR EQUAL JOINT REINFORCEMENT AT EVERY OTHER COURSE (16" O.C.).

- THE CONCRETE FOR FILLED CELLS SHALL BE RODDED OR PUDDLED DURING PLACEMENT TO INSURE COMPLETE FILLING TO THE BLOCK CORE.
- PROVIDE CLEAN OUT AND INSPECTION BLOCK OUT IN CELLS CONTAINING REINFORCEMENT FOR GROUT LIFTS EXCEEDING 5'-0"

**ABBREVIATIONS** 

EXPANSION JOINT ELEVATIONS EACH WAY

FOOTING HORIZONTAL HIGH POINT INSIDE DIAMETER

STRUCTURAL ABBREVIATIONS APPLY TO "S" SHEETS ONLY

MAT'L MAX

MISC

PROJ PSF PSI

ALL MATERIALS AND METHODS OF CONSTRUCTION SHALL BE IN ACCORDANCE WITH ACI 318 REQUIREMENTS (LATEST EDITION)

ALL CONCRETE SHALL BE AIR-ENTRAINED WITH 4000 PSI COMPRESSIVE STRENGTH AT 28 DAYS UNLESS OTHERWISE NOTED.

WATER REDUCING AGENT SHALL BE IN ACCORDANCE WITH ASTM C494

ALL CONCRETE SURFACES EXPOSED TO AIR, UNLESS OTHERWISE NOTED IN SPECIFICATIONS, SHALL BE TREATED WITH AN APPROPRIATE CURING COMPOUND AS SOON AS CEMENT FINISHING IS COMPLETED OR FORMS ARE REMOVED.

ALL EXPOSED CORNERS SHALL HAVE A MINIMUM CHAMFER OF  $\mbeding{3}\mbox{''}$  UNLESS OTHERWISE NOTED.

THE CONTRACTOR SHALL OBTAIN ENGINEER'S APPROVAL FOR THE LOCATIONS

MANUFACTURER

MASONRY OPENING

PRESSURE TREATED

ON CENTER POUNDS PER LINEAR FOOT

PROJECTION
POUNDS PER SQUARE FOOT
POUNDS PER SQUARE INCH

MISCELLANEOUS

NOT TO SCALE

MATERIAL MAXIMUM

MINIMUM

# "C" DRAWINGS FOR ADDITIONAL REMOVAL REMOVE GENERATOR AND LOUVER


REMOVE DAY TANK; SEE

GENERATOR LOUVER AND




<u>PLAN</u>



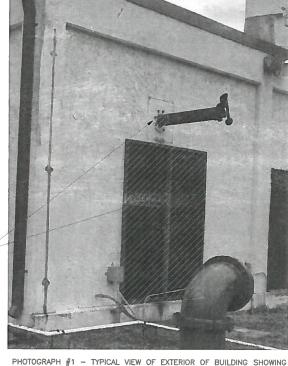

LOUVER AND EXHAUST MUFFLER.

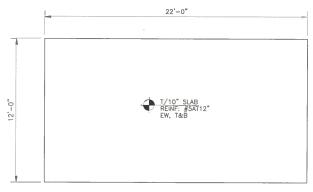

GENERATOR SLAB <u>PLAN</u>

- 1. GENERATOR SLAB TO BE PLACED OVER COMPACTED SUBGRADE AND GRANULAR FILL FILL SHALL BE CLEAN GRANULAR FILL FREE OF ANY ORGANICS AND DELETERIOUS MATERIAL. FILL SHALL BE COMPACTED IN MAXIMUM OF 8" LIFTS WITH PLATE COMPACTOR, TO 95 PERCENT OF MAXIMUM MODIFIED PROCTOR D-1557 DRY DENSITY.

  2. GENERATOR ANCHORAGE TO THE SLAB SHALL BE PER THE MANUFACTURER. ANCHOR BOLTS SHALL BE 316SS AND SHALL HAVE A MINIMUM EDGE SPACING OF 6" AND A MINIMUM EMBEDMENT OF 6".

±5'-4" \* SS 316 PLATE OVER EXHAUST PENETRATION ATTACHED TO MASONRY W/ 1"x3" TAPCONS; PROVIDE SEALANT ON ALL EDGES (FIELD VERIFY PLATE SIZE TO PROJECT A MINIMUM OF 3" PAST OPENING) 3'-4" TYP. URER E SPACING OF

PANEL ADHERED TO CMU INFILL WALL. PROVIDE \$\frac{1}{4}\text{"} TAPCON CONCRETE SCREWS AT 24\text{"} O.C. GRID PATTERN IN GROOVE OF PANEL ATTACHING PANEL TO CMU. PAINT HEAD OF TAPCON TO MATCH PANEL COLOR AND COATING FINISH TO BE CHOSEN BY OWNER. PANEL TO BE SIMILAR TO U—GROOVE ALUMINUM SOFFIT PANEL BY MASTIC HOME EXTERIORS, SEALANT AT ALL EDGES. PANEL ADHERED TO CMU INFILL

CMU INFILL WALL

DRILL & EPOXY #5 HORIZ. AT 4'-0" O.C. WITH 5" MIN. EMBED.

EXISTING CMU WALL

GROUT FILL VERT. CELL W/ (1)-#5, TYP. TWO CELLS

# ENGINEERING TECHNOLOGIES, INC.

AL, ALU, ALUM

LAKE MARY, FL 32746 PHONE: (407) 322-0500 FAX: (407) 322-0023 ET PROJECT No. - 15-161

DESCRIPTION

BY

DATE

MANATEE COUNTY

MLS TIDEVIEW 4 EMERGENCY **GENERATOR REPLACEMENT** 

SPECIFICATIONS STAINLESS STEEL

STEEL REINFORCEMENT

TIE BEAM TOP AND BOTTOM

TOP OF STRUCTURE

WELDED WIRE FABRIC

SAWCUT JOINT

UNLESS NOTED OTHERWISE

STANDARD



CLEARWATER 380 PARK PLACE BLVD, STE 300, CLEARWATER, FL 33759
TEL: (727) 531-3505 (800) 861-8314
www.cardno.com Certificate of Authorization No. 29915



STATE OF

\*

C

GENERAL NOTES. **DEMOLITION PLAN AND** WALL ELEVATION

**ELEVATION** 

1/2"=1'-0

PROPOSED ELEVATION

00193009.09 NOVEMBER 2016 SHEET NO:

S-1