

IFBC NO. 21-TA003713AJ
BRADENTON BEACH GRAVITY SEWER
REPLACEMENT
PROJECT NO. 6105280
NIGP 913-81
June 11, 2021

Manatee County BCC
Procurement Division
1112 Manatee Avenue West Ste 803
Bradenton, FL 34205
purchasing@mymanatee.org



ADVERTISEMENT

INVITATION FOR BID CONSTRUCTION, NO. 21-TA003713AJ

BRADENTON BEACH GRAVITY SEWER REPLACEMENT

Manatee County, a political subdivision of the State of Florida (hereinafter referred to as County), will receive sealed bids from individuals, corporations, partnerships, and other legal entities authorized to do business in the State of Florida, to provide Bradenton Beach Gravity Sewer Replacement, as specified in this Invitation for Bid Construction to include pipe bursting methodology, connection of serve laterals restroation of manholes, and pavement restoration.

DATE, TIME AND PLACE DUE:

The Due Date and Time for submission of Bids in response to this IFBC is **July 13, 2021 at 3:00 PM ET**. Bids must be delivered to the following location: Manatee County Administration Building, 1112 Manatee Ave. W., Suite 803, Bradenton, FL 34205 prior to the Due Date and Time.

SOLICITATION INFORMATION CONFERENCE:

A Non-mandatory Information Conference will be held at 11:00 AM on June 17, 2021 at Manatee County Administration Building, 1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205 or virtually at the Zoom Link below. Attendance to non- mandatory information conferences is not required but highly recommended.

Zoom® Meeting Link: <https://manateecounty.zoom.us/j/84437572522>

DEADLINE FOR QUESTIONS AND CLARIFICATION REQUESTS:

The deadline to submit all questions, inquiries, or requests concerning interpretation, clarification or additional information pertaining to this Invitation for Bid Construction to the Manatee County Procurement Division is June 24, 2021. Questions and inquiries should be submitted via email to the Designated Procurement Contact shown below.

Important: A prohibition of lobbying is in place. Review Section A.13 carefully to avoid violation and possible sanctions.

DESIGNATED PROCUREMENT CONTACT: Abby Jenkins, Senior Procurement Agent
(941) 749-3062, Fax (941) 749-3034
Email: abigail.jenkins@mymanatee.org
Manatee County Financial Management Department
Procurement Division

AUTHORIZED FOR RELEASE: _____

Table of Contents

Section A, Information to Bidders

Section B, Bid Forms to be completed and returned with Bid

- Appendix A, Minimum Qualifications
- Appendix B, Bidder's Questionnaire
- Appendix C, Environmental Crimes Certification
- Appendix D, Florida Trench Safety Act
- Appendix E, ePayables Application
- Appendix F, Scrutinized Company Certification
- Appendix G, Hold Harmless
- Appendix H, Insurance Statement
- Appendix I, Acknowledgement of Addenda
- Appendix J, Affidavit of No Conflict
- Appendix K, Bid Pricing Form

Section C, Bid Attachments

- Bid Attachment 1- Insurance and Bond Requirements
- Bid Attachment 2 - Technical Specifications
- Bid Attachment 3 - Plans/Drawings

Section D, Sample Construction Agreement with General Conditions of the Construction Agreement and Agreement Exhibits

SECTION A, INFORMATION FOR BIDDERS

To receive consideration, entities who submit a response to this Invitation for Bid Construction (Bidders) must meet the minimum qualification requirements and comply with the following instructions. Bid responses (Bids) will be accepted from single business entities, joint ventures, partnerships or corporations.

A.01 BID DUE DATE

The Due Date and Time for submission of Bids in response to this Invitation for Bid Construction (IFBC) is **July 13, 2021 at 3:00 PM ET**. Bids must be delivered to the following location: Manatee County Administration Building, 1112 Manatee Ave. W., Suite 803, Bradenton, FL 34205 and time stamped by a Procurement representative prior to the Due Date and Time.

Bids received after the Due Date and Time will not be considered. It will be the sole responsibility of the Bidder to deliver its Bid to the Manatee County Procurement Division for receipt on or before the Due Date and Time. If a Bid is sent by U.S. Mail, courier or other delivery services, the Bidder will be responsible for its timely delivery to the Procurement Division. Bids delayed in delivery will not be considered, will not be opened at the public opening, and arrangements will be made for their return at the Bidder's request and expense.

A.02 SOLICITATION INFORMATION CONFERENCE:

A Non-mandatory Information Conference will be held at 11:00AM on June 17, 2021 at the Manatee County Administration Building, 1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205 or attend via Zoom® at the link below. Attendance to non- mandatory information conferences is not required but highly recommended.

Zoom® Meeting Link: <https://manateecounty.zoom.us/j/84437572522>

Attendance to mandatory information conferences and/or site visits are required to meet the minimum qualification requirements of the IFBC. Attendance to non-mandatory information conferences is not required, but is strongly encouraged.

A.03 PUBLIC OPENING OF BIDS

Bids will be opened immediately following the Due Date and Time at the Manatee County Administration Building, Suite 803 in the presence of County officials. Bidders or their representatives may attend the Bid opening in person or virtually at the link below.

Zoom® Meeting Link: <https://manateecounty.zoom.us/j/81556375359>

Manatee County will make public at the opening the names of the business entities which submitted a Bid and the total bid price submitted. No review or analysis of the Bids will be conducted at the Bid opening.

A.04 SUBMISSION OF BIDS

The contents of the Bid sealed package must include:

- One (1) bound original clearly identifying Bidder and marked "ORIGINAL".
- One (1) electronic format copy clearly identifying Bidder.

Electronic format copy should be submitted on a Universal Serial Bus (USB) portable flash memory drive or compact disc (CD) in Microsoft Office® or Adobe Acrobat® portable document format (PDF) in one continuous file. Do not password protect or otherwise encrypt electronic Bid copies. Electronic copies must be searchable and contain an identical Bid to the original.

Submit the Bid package in a sealed container with the following information clearly marked on the outside of the package: IFBC NO. 21-TA003713AJ, Bradenton Beach Gravity Sewer Replacement, Bidder's name, and Bidder's address. Bids must be delivered to the Manatee County Procurement Division prior to the Due Date and Time at the following address:

Manatee County Procurement Division
1112 Manatee Ave. West, Ste. 803
Bradenton, FL 34205

A.05 DISTRIBUTION OF SOLICITATION DOCUMENTS

All documents issued pursuant to this IFBC are distributed electronically and available for download at no charge at www.mymanatee.org > *Bids and Proposals*. Documents may be viewed and downloaded for printing using Adobe Reader® software.

At its sole discretion, the County may utilize third-party providers to distribute proposals. Visit the third-party's website for more information regarding this service. Participation in the third-party system is not a requirement for doing business with Manatee County.

Additionally, the IFBC and all related documents are available for public inspection at the Manatee County Procurement Division, 1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205. Call (941) 749-3014 to schedule an appointment. Documents are available between the hours of 8:00 A.M. and 5:00 P.M., Monday through Friday, with the exception of County holidays.

As a courtesy, Manatee County notifies the Manatee County Chamber of Commerce and the Manatee County Black Chamber of Commerce of all active solicitations, who then distributes the information to its members.

A.06 EXAMINATION OF BID DOCUMENTS AND SITE(S)

It is the responsibility of each bidder before submitting a bid, to (a) examine the IFBC documents thoroughly; (b) visit the Project Site(s) to become familiar with local conditions that may affect cost, progress, performance, or furnishing of the Work; (c) consider federal, state, and local codes, laws, and regulations that may affect costs, progress, performance, or furnishing of the Work; (d) study and carefully correlate bidder's observations with the IFBC documents; and (e) notify County in writing of all conflicts, errors, or discrepancies in the IFBC documents.

Each bidder may, at bidder's own expense, make or obtain any additional examinations, investigations, explorations, tests and studies, and obtain any additional information and data which pertain to the physical conditions at or contiguous to the Project Site(s) or otherwise which may affect cost, progress, performance or furnishing of the Work and which bidder deems necessary to determine his bid for performing and furnishing the Work in accordance with the time, price and other terms and conditions of the IFBC documents. County will provide each bidder access to the site(s) to conduct such explorations and tests.

Bidder shall fill all holes, clean up and restore the Project Site(s) to its former condition upon completion of such explorations. The lands upon which the Work is to be performed, rights-of-way and easements for access thereto, and other lands designated for use by successful bidder in performing the Work are identified in the IFBC documents.

All additional lands and access thereto required for temporary construction facilities or storage of materials and equipment are to be provided by successful bidder. Easements for permanent structures or permanent changes in existing structures are to be obtained and paid for by County unless otherwise provided in the IFBC documents.

Inspection of the Project Site(s) is a requirement to be considered for award of this bid. Prior to submitting a bid, each bidder shall examine the Project Site(s) and all conditions thereon fully familiarizing themselves with the full scope of the Work. Failure to become familiar with Project Site conditions will in no way relieve the successful bidder from the necessity of furnishing any materials or performing any Work that is required to complete the Project in accordance with the Project Plans and Specifications. Bidder shall acknowledge inspection of the Project Site(s) on his/her signed, submitted Bid Form.

A.07 ADDENDA

Any interpretations, corrections or changes to this IFBC will be made by addenda. Addenda will be posted on the Procurement Division's web page of the County website at <http://www.mymanatee.org/purchasing> > *Bids and Proposals*. For those solicitations that are advertised on a third-party website, addenda will also be posted on the third-party's distribution system on the 'Planholders' link.

All addenda are a part of the IFBC and each Bidder will be bound by such addenda. It is the responsibility of each Bidder to read and comprehend all addenda issued. Failure of any Bidder to acknowledge an issued addendum in its Bid will not relieve the Bidder from any obligation contained therein.

A.08 BID FORMS

Bids must include the forms provided in this IFBC. If needed, additional pages may be attached to a form. Bidders must fully complete and execute all Bid Forms. Bid Forms must be executed by an authorized official of the company who has the legal authority to bind the company.

A.09 BID EXPENSES

All costs incurred by Bidder in responding to this IFBC will be the sole responsibility of the Bidder.

A.10 QUESTION AND CLARIFICATION PERIOD

Each Bidder shall examine all IFBC documents and will judge all matters relating to the adequacy and accuracy of such documents. Any questions or requests concerning interpretation, clarification or additional information pertaining to this IFBC, including the sample Agreement, shall be made in writing via email to the Manatee County Procurement Division to the Designated Procurement Contact or to purchasing@mymanatee.org. All questions received and responses given will be provided to potential bidders via an addendum to this IFBC.

Manatee County will not be responsible for oral interpretations given by other sources including County staff, representative, or others. The issuance of a written addendum by the Procurement Division is the only official method whereby interpretation, clarification or

additional information will be given.

A.11 FALSE OR MISLEADING STATEMENTS

Bids which contain false or misleading statements, or which provide references which do not support an attribute or condition claimed by the Bidder, may be rejected. If, in the opinion of the County, such information was intended to mislead the County in its evaluation of the Bid, and the attribute, condition or capability is a requirement of this IFBC. Such Bidder will be disqualified from consideration for this IFBC and may be disqualified from submitting a response on future solicitation opportunities with the County.

A.12 CONFIDENTIALITY OF SECURITY RELATED RECORDS

- a. Pursuant to Florida Statutes § 119.071(3), the following records (hereinafter referred to collectively as “the Confidential Security Records”) are confidential and exempt from the disclosure requirements of Florida Statutes § 119.07(1):
 - i. A Security System Plan or portion thereof for any property owned by or leased to County or any privately owned or leased property held by County.
 - ii. Building plans, blueprints, schematic drawings, and diagrams, including draft, preliminary, and final formats, which depict the internal layout and structural elements of a building, arena, stadium, water treatment facility, or other structure owned or operated by County.
 - iii. Building plans, blueprints, schematic drawings, and diagrams, including draft, preliminary, and final formats, which depict the internal layout or structural elements of an attractions and recreation facility, entertainment or resort complex, industrial complex, retail and service development, office development, or hotel or motel development in the possession of, submitted to County.
- b. Successful Bidder agrees that, as provided by Florida Statute, it shall not, as a result of a public records request, or for other reason disclose the contents of, or release or provide copies of the Confidential Security Records to any other party absent the express written authorization of County’s Property Management Director or to comply with a court order requiring such release or disclosure. To the extent successful Bidder receives a request for such records, it shall immediately contact the County’s designated Contract administrator who shall coordinate County’s response to the request.

A.13 LOBBYING

After the issuance of any IFBC, prospective bidders, bidders, or their agents, representatives or persons acting at the request of such bidder shall not contact, communicate with or discuss any matter relating to the IFBC with any officer, agent or employee of Manatee County other than the Procurement Official or the contact identified in this IFBC, pursuant to the Manatee County Code of Laws. This prohibition includes copying such persons on all written communication, including email correspondence. This requirement begins with the issuance of an IFBC and ends upon execution of the final Agreement or when the IFBC has been cancelled. Violators of this prohibition shall be subject to sanctions as provided in the Manatee County Code of Laws.

A.14 UNBALANCED BIDDING PROHIBITED

County recognizes that large and/or complex projects will often result in a variety of methods, sources, and prices. However, where in the opinion of the County such variation does not appear to be justified given bid requirements and industry and market conditions, the Bid will be presumed to be unbalanced. Examples of unbalanced Bids will include:

- a. Bids showing omissions, alterations of form, additions not specified, or required conditional or unauthorized alternate bids.
- b. Bids quoting prices that substantially deviate, either higher or lower, from those included in the Bids of competitive Bidders for the same line item unit costs.
- c. Bids where the unit costs offered are in excess of, or below reasonable cost analysis values.

In the event County determines that a Bid is presumed unbalanced, it will request the opportunity to and reserves the right to, review all source quotes, bids, price lists, letters of intent, and other supporting documentation which the Bidder obtained and upon which the Bidder relied upon to develop its Bid. County reserves the right to deem any presumptive unbalanced Bid where the Bidder is unable to demonstrate the validity and/or necessity of the unbalanced unit costs as non-responsive.

A.15 FRONT LOADING OF BID PRICING PROHIBITED

Prices offered for performance and/or acquisition activities which occur early in the Project Schedule, such as mobilization; clearing and grubbing; or maintenance of traffic; that are substantially higher than pricing of competitive bidders within the same portion of the Project Schedule, will be presumed to be front loaded. Front loaded bids could reasonably appear to be an attempt to obtain unjustified early payments creating a risk of insufficient incentive for the bidder to complete the Work or otherwise creating an appearance of an undercapitalized bidder.

In the event County determines that a bid is presumed to be front loaded, it will request the opportunity to, and reserves the right to, review all source quotes, bids, price lists, letters of intent, and other documents which the bidder obtained and upon which the bidder relied upon to develop the pricing or acquisition timing for these bid items. County reserves the right to reject as nonresponsive any presumptive front-loaded bids where the bidder is unable to demonstrate the validity and/or necessity of the front-loaded costs.

A.16 WITHDRAWAL OR REVISION OF BIDS

Bidders may withdraw Bids under the following circumstances:

- a. If Bidder discovers a mistake(s) prior to the Due Date and Time. Bidder may withdraw its Bid by submitting a written notice to the Procurement Division. The notice must be received in the Procurement Division prior to the Due Date and Time for receiving Bids. A copy of the request shall be retained, and the unopened Bid returned to the Bidder; or
- b. After the Bids are opened but before a contract is signed, Bidder alleges a material mistake of fact if:
 - 1. The mistake is clearly evident in the solicitation document; or
 - 2. Bidder submits evidence which clearly and convincingly demonstrates that a mistake was made in the Bid. Request to withdraw a Bid must be in writing and approved by the Procurement Official.

A.17 IRREVOCABLE OFFER

Any Bid may be withdrawn up until the Due Date and Time. Any Bid not so withdrawn shall, upon opening, constitute an irrevocable offer for a period of ninety (90) days to provide the goods or services set forth in this IFBC or until one or more of the Bids have been duly accepted by County, whichever occurs first.

A.18 RESERVED RIGHTS

County reserves the right to accept or reject any and/or all bids, to waive irregularities and minor technicalities, and to request resubmission. Also, County reserves the right to accept all or any part of the bid and to increase or decrease quantities to meet additional or reduced requirements of County. Any sole response received by the first submission date may or may not be rejected by County depending on available competition and current needs of County. For all items combined, the bid of the lowest, responsive, responsible bidder will be accepted, unless all bids are rejected.

The lowest, responsible bidder shall mean that Bidder who makes the lowest Bid to sell goods and/or services of a quality which meets or exceeds the quality of goods and/or services set forth in the IFBC documents or otherwise required by County.

To be responsive, a Bidder shall submit a Bid which conforms in all material respects to the requirements set forth in the IFBC.

To be a responsible bidder, the bidder shall have the capability in all respects to perform fully the bid requirements, and the tenacity, perseverance, experience, integrity, reliability, capacity, facilities, equipment, and credit which will assure good faith performance.

Also, County reserves the right to make such investigation as it deems necessary to determine the ability of any bidder to furnish the service requested. Information County deems necessary to make this determination shall be provided by the bidder. Such information may include, but shall not be limited to current financial statements, verification of availability of equipment and personnel, and past performance records.

A.19 APPLICABLE LAWS

Bidder must be authorized to transact business in the State of Florida. All applicable laws and regulations of the State of Florida and ordinances and regulations of Manatee County will apply to any resulting Agreement. Any involvement with the Manatee County Procurement Division shall be in accordance with the Manatee County Procurement Ordinance as amended.

A.20 COLLUSION

By submitting a bid in response to this IFBC, Bidder certifies that it has not divulged, discussed or compared its bid with any other bidder, and has not colluded with any other bidder or parties to this bid whatsoever. Further, Bidder, and in the case of a joint bid each party thereto, certifies as to their own organization, that in connection with this IFBC that:

- a. All prices and/or cost data submitted have been arrived at independently, without consultation, communication, or agreement, for the purpose of restricting competition, as to any matter relating to such prices and/or cost data, with any other bidder or with any competitor;
- b. All prices and/or cost data quoted for this bid have not been knowingly disclosed by the Bidder and will not knowingly be disclosed by the Bidder, prior to the scheduled opening, directly or indirectly to any other bidder or to any competitor;

- c. No attempt has been made, or will be made, by Bidder to induce any other person or firm to submit or not to submit a bid for the purpose of restricting competition;
- d. The only person or persons interested in this bid is/are named in Bidder's Bid and that no person other than those identified has any interest in the Bid or in the resulting Agreement to be entered into.
- e. No person or agency has been employed or retained to solicit or secure the resulting Agreement upon an agreement or understanding or a commission, percentage, brokerage, or contingent fee except bona fide employees or established commercial agencies maintained by Bidder for purpose of doing business.

A.21 CODE OF ETHICS

With respect to this and any bid, if a Bidder violates, directly or indirectly, the ethics provisions of the Manatee County Procurement Code and/or Florida criminal or civil laws related to public procurement, including but not limited to Florida Statutes Chapter 112, Part II, Code of Ethics for Public Officers and Employees, such Bidder will be ineligible for award to perform the work described in this IFBC, and may be disqualified from submitting on any future quote or bid requests to supply goods or services to Manatee County. By submitting a bid, the Bidder represents to County that all statements made, and materials submitted are truthful, with no relevant facts withheld.

A.22 PUBLIC CONTRACTING AND ENVIRONMENTAL CRIMES

A person or affiliate who has been placed on the convicted vendor list following a conviction for a public entity crime, as that term is defined in Section 287.133, Florida Statutes, may not submit a bid to provide any goods or services to a public entity; may not submit a bid with a public entity for the construction or repair of a public building or public work; may not submit bids on leases of real property to a public entity; may not be awarded or perform Work as a contractor, supplier, Subcontractor, or consultant under an agreement with any public entity; and may not transact business with any public entity in excess of the threshold amount provided in Section 287.017, Florida Statutes, for CATEGORY TWO for a period of thirty-six (36) months following the date of being placed on the convicted list.

In addition, the Manatee County Code of Laws prohibits the award of any bid to any person or entity who/which has, within the past five (5) years, been convicted of, or admitted to in court or sworn to under oath, a public entity crime or of any environmental law that, in the reasonable opinion of the Procurement Official, establishes reasonable grounds to believe the person or business entity will not conduct business in a responsible matter.

To ensure compliance with the foregoing, the Code requires all persons or entities desiring to do business with County to execute and file with the Purchasing Official an affidavit, executed under the pain and penalties of perjury, confirming that person, entity and any person(s) affiliated with the entity, does not have such a record and is therefore eligible to seek and be awarded business with County. In the case of a business entity other than a partnership or a corporation, such affidavit shall be executed by an authorized agent of the entity. In the case of a partnership, such affidavit shall be executed by the general partner(s). A Public Contracting and Environmental Crimes Certification form is attached herein for this purpose.

A.23 SCRUTINIZED COMPANIES

Florida Statutes § 287.135, as amended from time to time, may contain limitations on the part of a company to conduct business with the County. Submission of a response to this

solicitation shall be subject to all procedural requirements contained within that statute including the submission of any required certification of eligibility to contract with the County. It shall be the responsibility of the company responding to this solicitation to concurrently review the current version of the statute and ensure it is compliant. To the extent a certification is required, it shall be provided on the form located at Appendix F *Vendor Certification Regarding Scrutinized Companies Lists*.

A.24 AGREEMENT

The successful Bidder will be required to execute the Agreement, a sample of which is attached hereto and made a part hereof. The County will transmit the Agreement to the successful Bidder for execution. The successful Bidder agrees to deliver the required number of duly executed copies of the Agreement, with any other required documents, to the County within ten calendar days of receipt.

A.25 LEGAL NAME

Bidders shall clearly indicate the full legal name, including any d/b/a, address, email address, and telephone number on the Bid Form. Bid Forms shall be signed above the typed or printed name and title of the signer. The signer must be an official of the organization and have the authority to bind the bidder to the submitted bid.

When bidder is a partnership, the Bid Form shall be signed in the name of the firm and by all partners required under the terms of the partnership agreement. When a corporation is a bidder, the authorized corporate officers shall sign.

Bidders who are corporations or limited partnerships shall provide a certified copy of their permit to transact business in the State of Florida, preferably along with the Bid Form, or within forty-eight (48) hours after request by County.

When submitting a bid as a joint venture, it must have filed paper documents with the Division of Profession's Construction Industry Licensing Board prior to submitting a bid.

A.26 DISCOUNTS

All discounts must be incorporated in the prices contained in the bid and not shown separately. Unless otherwise specified in this IFBC, pricing must be all inclusive, including delivery costs. The prices indicated on the Pricing Form shall be the prices used in determining award.

A.27 TAXES

Manatee County is exempt from Federal Excise and State Sales Taxes. (F.E.T. Cert. No. 59-78-0089K; Florida Sales Tax Exempt Cert. No. 85-8012622206C-6). Therefore, the Bidder is prohibited from delineating a separate line item in its bid for any sales or service taxes.

The successful Bidder will be responsible for the payment of taxes of any kind, including but not limited to sales, consumer, use, and other similar taxes payable on account of the work performed and/or materials furnished under the award in accordance with all applicable laws and regulations.

A.28 QUALITY

Unless otherwise specifically provided in the IFBC documents, all goods provided shall be new, the latest make or model, of the best quality, of the highest grade of workmanship, and of the most suitable for the purpose intended.

Unless otherwise specifically provided in the IFBC documents, reference to any equipment, material, article or patented process, by trade name, brand name, make or catalog number, shall be regarded as establishing a standard of quality and shall not be construed as limiting competition.

A.29 AUTHORIZED PRODUCT REPRESENTATION

Bidder, by virtue of submitting the name and specifications of a manufacturer's product, will be required to furnish the named manufacturer's product. Failure to do so may, in the County's sole discretion, be deemed a material breach of the resulting agreement and shall constitute grounds for County's immediate termination of the resulting agreement.

A.30 ROYALTIES AND PATENTS

The successful Bidder shall pay all royalties and license fees for equipment or processes in conjunction with the equipment and/or services being furnished. Successful Bidder shall defend all suits or claims for infringement of any patent, trademark or copyright, and shall save County harmless from loss on account thereof, including costs and attorney's fees.

A.31 AMERICANS WITH DISABILITIES ACT

Manatee County does not discriminate upon the basis of any individual's disability status. This non-discrimination policy involves every aspect of County's functions including one's access to participation, employment, or treatment in its programs or activities. Anyone requiring reasonable accommodation for an information conference or bid opening should contact the person named on the cover page of this document at least twenty-four (24) hours in advance of either activity.

A.32 EQUAL EMPLOYMENT OPPORTUNITY

In accordance with Title VI of the Civil Rights Act of 1964, Title 15, Part 8 of the Code of Federal Regulations and the Civil Rights Act of 1992, Manatee County hereby notifies all Bidders that it will affirmatively ensure minority business enterprises are afforded full opportunity to participate in response to this IFBC and will not be discriminated against on the grounds of race, color, national origin, religion, sex, age, handicap, or marital status in consideration of award.

A.33 MINORITY AND/OR DISADVANTAGED BUSINESS ENTERPRISES

The State of Florida Office of Supplier Diversity provides the certification process and maintains the database of certified MBE/DBE firms. Additional information may be obtained at https://www.dms.myflorida.com/agency_administration/office_of_supplier_diversity_osd or by calling (850) 487-0915.

A.34 DELIVERY

Unless otherwise specified, all prices shall include all delivery cost (FOB Destination).

A.35 MATHEMATICAL ERRORS

- a. Bid pricing forms without imbedded mathematical formulas: In the event of multiplication/extension error(s), the unit price shall prevail. In the event of addition error(s) the extension totals will prevail. In the event the dollar amount for contract contingency is omitted, it will be added to the total price of the Bid.

- b. Bid pricing forms with imbedded mathematical formulas: Interactive bid pricing forms that contain mathematical formulas may be provided to automate lengthy and complex bid forms. In the event bid pricing forms with imbedded formulas are used and a multiplication/extension error(s) is discovered in the formula, the unit price entered by the Bidder shall prevail.
- c. Bidder shall assume the responsibility and accuracy of the information input in the bid pricing form and therefore shall verify that the calculations are correct before submitting its Bid.
- d. Regardless of the type of bid pricing form used, all Bids shall be reviewed mathematically by the County using these standards.

A.36 SUBCONTRACTORS

The successful bidder will obtain prior written approval from the County for any subcontractor(s) and the work each will perform. A subcontractor is defined as any entity performing work within the scope of the project who is not an employee of the successful Bidder.

Bidders subcontracting any portion of the work shall include a list of subcontractors along with their bid. The list shall include: name and address of subcontractor, type of work to be performed and the percent of the contract amount to be subcontracted.

A.37 E-Verify

Prior to the employment of any person under this contract, the successful Bidder shall utilize the U.S. Department of Homeland Security’s E-Verify system to verify the employment eligibility of (a) all persons employed during the contract term by the successful Bidder to perform employment duties within Florida and (b) all persons, including subcontractors, assigned by the successful Bidder to perform work pursuant to the contract with Manatee County. For more information on this process, please refer to United States Citizenship and Immigration Service site at: <http://www.uscis.gov/>.

Only those individuals determined eligible to work in the United States shall be employed under this contract.

By submission of a bid in response to this IFBC, the successful Bidder commits that all employees and subcontractors will undergo e-verification before placement on this contract.

The successful Bidder shall maintain sole responsibility for the actions of its employees and subcontractors. For the life of the contract, all employees and new employees brought in after contract award shall be verified under the same requirement stated above.

A.38 DISCLOSURE

Upon receipt, all inquiries and responses to inquiries related to this IFBC become “Public Records,” and shall be subject to public disclosure consistent with Florida Statutes, Chapter 119.

Bids become subject to disclosure thirty (30) days after the opening or if a notice of intent to award decision is made earlier than this time as provided by Florida Statutes § 119.071(1)(b). No announcement or review of the bids shall be conducted at the public opening.

Based on the above, County will receive bids at the time and date stated and will make public at the opening the names of the business entities of all that submitted a bid.

If County rejects all bids and concurrently notices its intent to reissue the solicitation, the rejected bids are exempt from public disclosure until such time as County provides notice of an intended decision concerning the reissued solicitation or until County withdraws the reissued solicitation. A bid is not exempt for longer than twelve (12) months after the initial notice rejecting all bids.

Pursuant to Florida Statutes 119.0701, to the extent successful Bidder is performing services on behalf of the County, successful Bidder must:

- a. Keep and maintain public records required by public agency to perform the service.
- b. Upon request from the public agency's custodian of public records, provide the public agency with a copy of the requested records or allow the records to be inspected or copied within a reasonable time at a cost that does not exceed the cost provided in Florida Statutes, Chapter 119, or as otherwise provided by law.
- c. Ensure that public records that are exempt or confidential and exempt from public records disclosure requirements are not disclosed except as authorized by law for the duration of the contract term and following completion of the contract if the successful Bidder does not transfer the records to the public agency.
- d. Upon completion of the contract, transfer, at no cost, to the public agency all public records in possession of contractor or keep and maintain public records required by the public agency to perform the service. If the successful Bidder transfers all public records to the public agency upon completion of the contract, the successful Bidder shall destroy any duplicate public records that are exempt or confidential and exempt from public records disclosure requirements. If the successful Bidder keeps and maintains public records upon completion of the contract, the successful Bidder shall meet all applicable requirements for retaining public records. All records stored electronically must be provided to the public agency, upon request from public agency's custodian of public records, in a format that is compatible with the information technology systems of the public agency.

IF THE SUCCESSFUL BIDDER HAS QUESTIONS REGARDING THE APPLICATION OF CHAPTER 119, FLORIDA STATUTES, TO THE SUCCESSFUL BIDDER'S DUTY TO PROVIDE PUBLIC RECORDS RELATING TO ANY RESULTING CONTRACT, CONTACT COUNTY'S CUSTODIAN OF PUBLIC RECORDS AT:

Phone: (941) 742-5845

Email: debbie.scaccianoce@mymanatee.org

Mail: Manatee County BCC

Attn: Records Manager

1112 Manatee Ave W.

Bradenton, FL 34205.

A.39 LOCAL PREFERENCE

Local business is defined as a business legally authorized to engage in the sale of the goods and/or services, and which certifies within its Bid that for at least six (6) full months prior to the advertisement of this IFBC it has maintained a physical place of business in Manatee, Desoto, Hardee, Hillsborough, Pinellas or Sarasota County with at least one full-time employee at that location.

Local preference shall not apply to the following categories of agreements:

- a. Purchases or agreements which are funded, in whole or in part, by a governmental or other funding entity, where the terms and conditions governing the funds prohibit the preference.
- b. Any bid announcement which specifically provides that local preference, as set forth in this section, is suspended due to the unique nature of the goods or services sought, the existence of an emergency as found by either the County Commission or County Administrator, or where such suspension is, in the opinion of the County Attorney, required by law.
- c. For a competitive solicitation for construction services in which fifty percent (50%) or more of the cost will be paid from state.
- d. To qualify for local preference under this section, **a local business must certify to County** by completing an **"Affidavit as to Local Business Form,"** which is available for download at www.mymanatee.org/vendor. Click on "Affidavit for Local Business" to access and print the form. Complete, notarize, and mail the notarized original to the following address: Manatee County Procurement Division, 1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205.
- e. It is the responsibility of the bidder to ensure accuracy of the Affidavit as to Local Business and notify County of any changes affecting same.

A.40 VENDOR REGISTRATION

Registering your business will provide Manatee County a sourcing opportunity to identify suppliers of needed goods and services and identify local businesses. To register as a supplier with the County go to www.mymanatee.org/vendor. For assistance with supplier registration, call the Procurement Division main number at (941) 749-3014. Office hours are Monday – Friday, 8:00 A.M. to 5:00 P.M., excluding County holidays.

A link to Vendor Registration is listed on the Procurement Division's web page at <http://www.mymanatee.org/home/government/departments/financial-management/purchasing.html>. Click on "Register as a Vendor", then "Vendor Registration Form". Registration is not mandatory to submit a Bid.

A.41 ENVIRONMENTAL SUSTAINABILITY

All bidders are encouraged to use as many environmentally preferable "green" products, materials, as supplies, as possible to promote a safe and healthy environment. Environmentally preferable are products or services that have a reduced adverse effect on the environment.

Bidder shall acknowledge in its Bid if Bidder has an environmental sustainability initiative. In addition, Bidder shall submit with its Bid a brief summary of Bidder's environmental sustainability initiative. This information will be used as a determining factor in the award decision when all other factors, including local preference, are otherwise equal.

A.42 ePAYABLES

Manatee County Board of County Commissioners and the Manatee County Clerk of the Circuit Court have partnered to offer the ePayables program, which allows payments to be made to vendors via credit cards.

The Clerk of the Circuit Court will issue a unique credit card number to vendor after goods are delivered or services rendered, vendors submit invoices to the remit to address on the purchase order. When payments are authorized, an email notification is sent to the vendor. The email notification includes the invoice number(s), invoice date(s), and amount of payment. There is no cost for vendors to participate in this program; however, there may be a charge by the company that processes your credit card transactions.

If Bidder is interested in participating in this program, complete the ePayables Application attached herein and return the completed form via email to tina.mancini@manateeclerk.com.

A.43 BASIS OF AWARD

County will not make award to a Bidder who is delinquent in payment of any taxes, fees, fines, contractual debts, judgments, or any other debts due and owed to the County, or is in default on any contractual or regulatory obligation to the County. By submitting this solicitation response, Bidder attests that it is not delinquent in payment of any such debts due and owed to the County, nor is it in default on any contractual or regulatory obligation to the County. In the event the Bidder's statement is discovered to be false, bidder will be subject to suspension and/or debarment and the County may terminate any award it has with bidder.

Award shall be to the lowest, responsive, responsible bidder(s) meeting specifications which includes delivery time requirements, qualification requirements, and having the lowest total offer for requirements listed on the Bid Form for the Work as set forth in this IFBC. Bid prices shall include costs for furnishing all labor, equipment and/or materials for the completion of the Work to the County's satisfaction, in accordance with and in the manner set forth and described in the IFBC documents and within the prescribed time.

Multiple schedules for completion of Work shall be considered. Two bids shall be submitted and considered, Bid 'A' based on 670 calendar days completion time and Bid 'B' based on 760 calendar days completion time. County, at its sole discretion, shall select either Bid 'A' or Bid 'B', whichever is in the best interest of the County. Only one (1) award will be made.

In evaluating Bids, County shall consider the qualifications of the Bidders; and if required, may also consider the qualifications of the subcontractors, suppliers, and other persons and organizations proposed. County may also consider the operating costs, maintenance requirements, performance data and guarantees of major items of materials and equipment proposed for incorporation in the Work.

Whenever two or more responsive, responsible bids which are equal with respect to price and all other evaluation factors are received, the bid from the local business shall be given preference in award.

Whenever two or more responsive, responsible bids which are equal with respect to price are received, and both or neither of these bids are from a local business, the award shall be determined by a chance drawing, coin toss, or similar tie-breaking method conducted by the Procurement Division and open to the public.

Bidder acknowledges that County has, or may hire, others to perform work similar to or the same as that which is within the scope of work of this IFBC. In the event that the successful Bidder cannot meet the delivery time or availability requirements of materials, the County, at its sole discretion can obtain the goods and services from other sources.

A.44 SCOPE OF WORK

The successful Bidder shall furnish and install all materials, equipment and labor which is reasonably inferable and necessary for the proper completion of the Work specified in this IFBC, whether specifically indicated in the IFBC or not.

The successful Bidder shall furnish all shop drawings, work drawings, labor, materials, equipment, tools, services and incidentals necessary to complete all Work required by these Specifications.

The successful Bidder shall perform the Work complete, in place and ready for continuous service and shall include any repairs, replacements, and / or restoration required as a result of damages caused prior to acceptance by the County.

The Scope of work consists of constructing approximately 4400 liner feet of 8-inch to 12-inch gravity sewer installed by open cut, 550 liner feet of 8-inch gravity sewer, installation of 23 proposed manholes, removing and reconnecting approximately 93 service laterals to the proposed sanitary sewer. Additionally, the project includes restoration of sidewalks, driveways, and pavement.

A.45 COMPLETION OF WORK

The Work will be completed and ready for final inspection within the specified calendar days from the date the Contract Time commences to run. Completion time shall be based on Bid 'A' for 670 calendar days or Bid 'B' based on 760 calendar days time at the County's sole discretion.

A.46 LIQUIDATED DAMAGES

If the successful Bidder fails to achieve substantial completion of the Work within the contract time and as otherwise required by the Agreement (to include not only the entire Work but any portion of the Work as set forth therein), the County shall be entitled to retain or recover from the successful Bidder, as liquidated damages and not as a penalty, the sum of \$730.00 per calendar day, commencing upon the first day following expiration of the contract time and continuing until the actual date of substantial completion.

Such liquidated damages are hereby agreed to be a reasonable estimate of damages the County will incur because of delayed completion of the Work. The County may deduct liquidated damages as described in this paragraph from any unpaid amounts then or thereafter due the successful bidder under this Agreement. Any liquidated damages not so deducted from any unpaid amounts due the successful bidder shall be payable to the County at the demand of the County, together with interest from the date of the demand at the maximum allowable rate.

A.47 CONTRACT CONTINGENCY WORK

Contract contingency is a monetary allowance used solely at County's discretion to handle unexpected conditions as required to satisfactorily complete the Work in accordance with the IFBC documents. A Field Directive must be issued by an authorized County representative to authorize use of contract contingency funds.

The percentage for contract contingency is listed on the Bid Form. Bidder shall enter the dollar amount for contract contingency based on the percentage of the total base bid. The total contract award will include contract contingency.

Appropriate uses of contract contingency include increases to existing bid item quantities that do not change the initial Scope of Work, which may be directed by County staff; modification items not originally bid which were unforeseen yet necessary during the Work to provide a safe, complete Project and that do not change the initial Scope of Work; and unanticipated conflicts and/or design changes required during construction which are necessary to provide a safe, complete Project and that do not change the initial Scope of Work.

Inappropriate uses of contract contingency include anything that changes the initial Scope of Work, including the Contract Sum and Contract Time, and adding bid items not previously contemplated that change the initial Scope of Work.

A.48 LICENSES AND PERMITS

The successful Bidder shall be solely responsible for obtaining all necessary license and permit fees, including, but not limited to, all license fees, permit fees, impact fees, or inspection fees, and responsible for the costs of such fees. Successful Bidder is solely responsible for ensuring all work complies with all Federal, State, local, and Manatee County ordinances, orders, codes, laws, rules, regulations, directives, and guidelines.

A.49 PROTEST

Any actual bidder, proposer, or contractor who is aggrieved in connection with the notice of intent to award of a contract with a value greater than \$250,000 where such grievance is asserted to be the result of a violation of the requirements of the Manatee County Procurement Code or any applicable provision of law by the officers, agents, or employees of the County, may file a protest to the Procurement Official.

Protest must be in writing and delivered via email at purchasing@mymanatee.org or by hand delivery to the Procurement Division at 1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205 by 5:00 p.m. on the fifth business day following the date of posting of the Notice of Intent to Award on the County website. There is no stay of the procurement process during a protest. The Procurement Official shall have the authority to settle and resolve a protest concerning the intended award of a contract.

For additional information regarding the County protest process, visit the Procurement Division webpage on the County website.

A.50 ACCESSIBILITY

The County is committed to making its documents and information technologies accessible to individuals with disabilities by meeting the requirements of Section 504 of the Rehabilitation Act and best practices (w3C WCAG 2). **For assistance with accessibility regarding this solicitation, contact the Manatee County Procurement Division via email at purchasing@mymanatee.org or by phone at 941-748-4501 X3014.**

Successful Bidder shall ensure all its electronic information, documents, applications, reports, and deliverables required under this Agreement are in a format that meets the requirements of Section 504 of the Rehabilitation Act and best practices (w3C WCAG 2).

Where not fully compliant with these requirements and best practices, Successful Bidder shall provide clear points of contact for each document and information technology to direct users in how to obtain alternate formats. Further, successful Bidder shall develop accommodation strategies for those non-compliant resources and implement strategies to resolve the discrepancies.

A.51 SOLICITATION SCHEDULE

The following schedule has been established for this Solicitation process. Refer to the County’s website (www.mymanatee.org > Business > *Bids & Proposals*) for meeting locations and updated information pertaining to any revisions to this schedule.

Scheduled Item	Scheduled Date
Non-Mandatory Information Conference	June 17, 2021 @ 11:00 AM, ET
Question and Clarification Deadline	June 24, 2021
Final Addendum Posted	July 6, 2021
Bid Response Due Date and Time	July 13, 2021, 3:00 PM, ET
Due Diligence Review Completed	July 2021
Projected Award	August 2021

NOTE: Any statements contained in the Scope of Work, Bid Summary, Construction Agreement, General Conditions of the Construction Agreement and/or Exhibits which vary from the information in Section A, Information for Bidders, shall have precedence over the Information for Bidders.

END OF SECTION A

SECTION B, BID FORMS

(To be completed and returned with Bid)

APPENDIX A, MINIMUM QUALIFICATIONS

APPENDIX A, MINIMUM QUALIFICATIONS

IFBC No. 21-TA003713AJ

Bidders must submit the information and documentation requested in this Attachment that confirms Bidder meets the following minimum qualification requirement(s):

1. Must have been registered with the State of Florida, Division of Corporations to do business in Florida.

No documentation is required. The County will verify registration.

2. Bidder, or its representative(s), has made an inspection of the construction site for work specified in this IFBC on or after the date of advertisement of this IFBC and prior to the Due Date and Time.

Bidder must submit a statement on company letterhead and signed by an authorized official of Bidder that Bidder, or its representative(s), has made an inspection of the construction site, listing the date of the inspection and the individuals, by name, who conducted the inspection.

3. Must have possessed a General Contractor license or Underground Utility Contractor Licenses issued by the Florida Department of Business and Professional Regulation for a period of at least three (3) consecutive years since June 1, 2018 License must be current and valid through the Due Date for submission of bids for this IFBC.

Provide a copy of Bidder's General Contractor license or Underground Utility Contractor Licenses issued by the Florida Department of Business and Professional Regulation and documentation confirming Bidder has been licensed and/or certified for the period of June1, 2018 through the date of submission of the Bid.

4. Bidder has provided gravity sewer rehabilitation for at least three (3) projects since June1, 2018 in which each project included the following components: (i) gravity sewer rehabilitation; (ii) connection of service laterals, bypass pumping; (iii) restoration of manholes, sidewalks and pavement. Project clients must be agreeable to responding to an inquiry by the County.

Provide the following information for the three (3) qualifying project references.

- a) Name of client
- b) Project name
- c) Location (City/State)
- d) Client contact name
- e) Contact phone
- f) Contact email
- g) Service dates (Start/End)

5. Bidder, on the day the bid is submitted, has a certified or registered Qualifying Agent, as required by Section 489.119, Florida Statutes, and that Qualifying Agent has been the same Qualifying Agent of Bidder for a period of at least two (2) consecutive years, since June 1, 2019.

Submit a copy of Bidder's Qualifying Agent's registration or certification along with supporting documentation confirming Qualifying Agent has been the Qualifying Agent for Bidder for two (2) years, since June 1 2019.

6. Bidder is not on the Florida Department of Management Services Suspended, Debarred, Convicted Vendor Lists.

No documentation is required. The County will verify.

7. If Bidder is submitting as a joint venture must file the required documents with the Florida Department of Business and Professional Regulation as required by Florida Statute Section 489.119, prior to the Due Date and Time.

If Bidder is not a joint venture, provide a statement to that effect. If Bidder is a joint venture, provide a copy of Bidder's approved filing with the Florida Department of Business and Professional Regulation.

8. Bidder has no reported conflict of interests in relation to this IFBC.

If no conflicts of interests are present, Bidder must submit a statement to that affect. Submit a fully completed copy of Appendix J. If applicable, on a separate page disclose the name of any officer, director or agent who is also an employee of the County. Disclose the name of any County employee who owns, directly or indirectly, any interest in the Bidder's firm or any of its branches.

END OF APPENDIX A

APPENDIX B, BIDDER'S QUESTIONNAIRE

Bidder must fully complete and return this form with its Bid. Bidder warrants the truth and accuracy of all statements and answers herein contained. (Attach additional pages if necessary.)

THIS QUESTIONNAIRE MUST BE COMPLETED AND SUBMITTED WITH YOUR BID

1. Contact Information:

FEIN #: _____
License #: _____
License Issued to: _____
Date License Issued (MM/DD/YR): _____
Company Name: _____
Physical Address: _____
City: _____ State of Incorporation: _____ Zip Code: _____
Phone Number: () _____ Fax Number: () _____
Email address: _____

2. Bidding as: an individual __; a partnership __; a corporation __; a joint venture __

3. If a partnership, list names and addresses of partners; if a corporation, list names of officers, directors, shareholders, and state of incorporation; if joint venture, list names and address of ventures' and the same if any venture are a corporation for each such corporation, partnership, or joint venture:

4. Bidder is authorized to do business in the State of Florida: Yes No

For how many years? _____

5. Your organization has been in business (under this firm's name) as a

Is this firm in bankruptcy? _____

6. Attach a list of projects where this specific type of Work was performed.

BIDDER: _____

7. Is this firm currently contemplating or in litigation? Provide summary details.

8. Have you ever been assessed liquidated damages under a contract during the past five (5) years? If so, state when, where (contact name, address and phone number) and why.

9. Have you ever failed to complete Work awarded to you? Or failed to complete projects within contract time? If so, state when, where (contact name, address, phone number) and why.

10. Have you ever been debarred or prohibited from providing a bid to a governmental entity? If yes, name the entity and describe the circumstances.

11. Will you subcontract any part of this Work? If so, describe which portion(s) and to whom.

12. If any part of work will be subcontracted, list MBE/DBE/WBE/VETERAN to be utilized. Include the estimated dollar amount of the portion of Work each will perform.

BIDDER: _____

13. What equipment do you own to accomplish this Work? (A listing may be attached)

14. What equipment will you purchase/rent for the Work? (Specify which)

15. If applicable to the Work for this IFBC, Drilling Supervisor Qualifications: Contractor shall provide a boring specialist who shall remain on the project site during the entirety of the directional boring operation. This includes, but is not limited to, drilling fluid preparation, seaming, boring and pulling. The boring specialist shall have a minimum of five (5) years' experience in supervising directional bores of similar nature, diameter, materials and lengths. (Reference: Specification Section 02619, Horizontal Directional Drilling).

Provide the contact information for a minimum of three (3) projects wherein the boring specialist has performed this type of work, diameter, materials and lengths.

Boring specialist's name: _____

Boring specialist's years of experience in supervising directional bores _____

Provide contact name, and contact number for projects:

16. If applicable to the Work for this IFBC, Pipe Fusion Qualifications: All boring and fusing equipment shall be certified for operation. The Contractor responsible for thermal butt fusing pipe and fittings shall have manufacturer certification for performing such work or a minimum of five (5) years of experience performing this type of work.

Thermal butt fusing pipe and fittings contractor or subcontractor's name: _____

Attach a copy of contractor's/subcontractor's manufacturer certification to this Questionnaire

OR

Provide contractor's/subcontractor's years of experience in thermal butt fusing pipe and fittings _____

If manufacturer certification is not provided, include contact name, and contact number for projects that confirms five years of experience:

BIDDER: _____

17. If applicable to the Work for this IFB, Pipe Bursting Qualifications: The Contractor shall be certified by the manufacturer of the pipe bursting system that they are fully trained licensed installer of the manufacturer's pipe bursting system. Contractor shall provide a letter to the County documenting this requirement. (Reference: Specification Section 02619A, Pipe Bursting (PB) of Existing Mains).

18. List the following regarding the surety which is providing the bond(s):

Surety's Name: _____

Address: _____

Name, address, phone number and email of surety's resident agent for service of process in Florida:

Agent's Name: _____

Address: _____

Phone: _____

Email: _____

19. Is Bidder a local business as defined in Section A.38, Local Preference?

Yes No

If yes, by signing below Bidder certifies that for at least six months prior to the advertisement date of this IFB it has maintained a physical place of business in Manatee, Desoto, Hardee, Hillsborough, Pinellas or Sarasota counties with at least one full-time employee at that location.

BIDDER: _____

BY: _____

PRINTED NAME: _____

TITLE/DATE: _____

PHYSICAL ADDRESS OF QUALIFYING LOCAL LOCATION: _____

NAME OF QUALIFYING EMPLOYEE AT LOCAL LOCATION: _____

BIDDER: _____

20. Confirm if Bidder has an environmental sustainability initiative as defined in Section A.41.

Yes No

If yes, submit a brief summary (2-3 paragraphs) of the environmental sustainability initiative.

BIDDER: _____

APPENDIX C, ENVIRONMENTAL CRIMES CERTIFICATION

SWORN STATEMENT PURSUANT TO ARTICLE V, MANATEE COUNTY PROCUREMENT CODE

Bidder must fully complete and return this form with its Bid. This form must be signed and sworn to in the presence of a notary public or other official authorized to administer oaths.

This sworn statement is submitted to the Manatee County Board of County Commissioners by

_____ [Print individual's name and title]

for _____ [Print name of entity submitting sworn statement]

whose business address is _____

and (if applicable) its Federal Employer Identification Number (FEIN) is _____. If the entity has no FEIN, include the Social Security Number of the individual signing this sworn statement: _____.

I understand that no person or entity shall be awarded or receive an Owner’s Agreement for public improvements, procurement of goods or services (including professional services) or an Owner’s lease, franchise, concession or management agreement, or shall receive a grant of Owner’s monies unless such person or entity has submitted a written certification to Owner that it has not:

(1) been convicted of bribery or attempting to bribe a public officer or employee of Manatee County, the State of Florida, or any other public entity, including, but not limited to the Government of the United States, any state, or any local government authority in the United States, in that officer's or employee's official capacity; or

(2) been convicted of an agreement or collusion among bidders or prospective bidders in restraint of freedom of competition, by agreement to bid a fixed price, or otherwise; or

(3) been convicted of a violation of an environmental law that, in the sole opinion of Owner’s Purchasing Official, reflects negatively upon the ability of the person or entity to conduct business in a responsible manner; or

(4) made an admission of guilt of such conduct described in items (1), (2) or (3) above, which is a matter of record, but has not been prosecuted for such conduct, or has made an admission of guilt of such conduct, which is a matter of record, pursuant to formal prosecution. An admission of guilt shall be construed to include a plea of nolo contendere; or

(5) where an officer, official, agent or employee of a business entity has been convicted of or has admitted guilt to any of the crimes set forth above on behalf of such an entity and pursuant to the direction or authorization of an official thereof (including the person committing the offense, if he is an official of the business entity), the business shall be chargeable with the conduct herein above set forth. A business entity shall be chargeable with the conduct of an affiliated entity, whether wholly owned, partially owned, or one which has common ownership or a common Board of Directors. For purposes of this Form, business entities are affiliated if, directly or indirectly, one business entity controls or has the power to control another business entity, or if an individual or group of individuals controls or has the power to control both entities. Indicia of control shall include, without limitation, interlocking management or ownership, identity of interests among family members, shared organization of a business entity following the ineligibility of a business entity under this

Article, or using substantially the same management, ownership or principles as the ineligible entity.

(Continued)

Any person or entity who claims that this Article is inapplicable to him/her/it because a conviction or judgment has been reversed by a court of competent jurisdiction shall prove the same with documentation satisfactory to Owner’s Purchasing Official. Upon presentation of such satisfactory proof, the person or entity shall be allowed to contract with Owner.

I UNDERSTAND THAT THE SUBMISSION OF THIS FORM TO THE CONTRACTING OFFICER FOR MANATEE COUNTY IS VALID THROUGH DECEMBER 31 OF THE CALENDAR YEAR IN WHICH IT IS FILED. I ALSO UNDERSTAND THAT ANY AGREEMENT OR BUSINESS TRANSACTION SHALL PROVIDE FOR SUSPENSION OF PAYMENTS, OR TERMINATION, OR BOTH, IF THE CONTRACTING OFFICER OR COUNTY ADMINISTRATOR DETERMINES THAT **SUCH** PERSON OR ENTITY HAS MADE FALSE CERTIFICATION.

[Signature]

STATE OF _____
COUNTY OF _____

Sworn to and subscribed before me this ____ day of _____, 20____ by _____

Who is personally known / has produced _____ as identification
[Type of identification]

My commission expires _____

Notary Public Signature

[Print, type or stamp Commissioned name of Notary Public]

Signatory Requirement - In the case of a business entity other than a partnership or a corporation, this affidavit shall be executed by an authorized agent of the entity. In the case of a partnership, this affidavit shall be executed by the general partner(s). In the case of a corporation, this affidavit shall be executed by the corporate president.

APPENDIX D, FLORIDA TRENCH SAFETY ACT

Bidder must fully complete and return this form with its Bid. This form must be signed in the presence of a notary public or by an officer authorized to administer oaths.

1. This Sworn Statement is submitted with **IFBC NO. 21-TA003713AJ**
2. This Sworn Statement is submitted by _____ whose business address is _____ and, if applicable, its Federal Employer Identification Number (FEIN) is _____. If the entity has no FEIN, include the Social Security Number of the individual signing this sworn statement _____.
3. Name of individual signing this Sworn Statement is: _____
Whose relationship to the above entity is: _____.
4. The Trench Safety Standards that will be in effect during the construction of this project shall include, but are not limited to: Laws of Florida, Chapters 90-96, TRENCH SAFETY ACT, and OSHA RULES AND REGULATIONS 29 CFR 1926.650 Subpart P, effective October 1, 1990.
5. The undersigned assures that the entity will comply with the applicable Trench Safety Standards and agrees to indemnify and hold harmless the County and Engineer of Record, and any of their agents or employees from any claims arising from the failure to comply with said standard.

6. The undersigned has appropriated the following costs for compliance with the applicable standards:

Trench Safety Measure (Description)	Units of MeasureUnit (LF, SY)	Quantity	Unit Cost	Extended Cost
a. _____	_____	_____	\$ _____	_____
b. _____	_____	_____	\$ _____	_____
c. _____	_____	_____	\$ _____	_____
d. _____	_____	_____	\$ _____	_____

7. The undersigned intends to comply with these standards by instituting the following procedures:

THE UNDERSIGNED, in submitting this bid, represents that they have reviewed and considered all available geotechnical information and made such other investigations and tests as they may deem necessary to adequately design the trench safety system(s) to be utilized on this project.

(Authorized signature / Title)

SWORN to and subscribed before me this _____ day of _____, 20____.
(Impress official seal)

Notary Public, State of _____: _____

My commission expires: _____



Angelina M. Colonnese

CLERK OF THE CIRCUIT COURT AND COMPTROLLER OF MANATEE COUNTY

1115 Manatee Avenue West, Bradenton, Florida 34205 - Phone (941) 749-1800 Fax (941) 741-4082, P.O. Box 25400, Bradenton, Florida 34206 - www.manateeclerk.com

Bidder must fully complete and return this form with its Bid.

APPENDIX E: ePAYABLES APPLICATION

Company name _____

Contact person _____

Phone number _____

Email Address _____

FINANCE USE ONLY

Open orders: YES or NO

PEID _____

CREATE DATE _____

CONFIRMED WITH

Name and phone number

IFAS _____

BANK _____

INITIALS _____

Return completed form Via email to:

tina.mancini@manateeclerk.com

Via fax to: (941) 741-4011

Via mail:

PO Box 1000

Bradenton, FL 34206

Revised: September 30, 2015

“Pride in Service with a Vision to the Future”

Clerk of the Circuit Court – Clerk of Board of County Commissioners – County Comptroller – Auditor and Recorder

APPENDIX F, SCRUTINIZED COMPANY CERTIFICATION

This certification is required pursuant to Florida State Statute Section 287.135.

As of July 1, 2011, a company that, at the time of bidding or submitting a proposal for a new contract or renewal of an existing contract, is on the Scrutinized Companies with Activities in Sudan List or the Scrutinized Companies with Activities in the Iran Petroleum Energy Sector List is ineligible for, and may not bid on, submit a proposal for, or enter into or renew a contract with an agency or local governmental entity for goods or services of \$1 million or more.

Bidder must fully complete and return this form with its Bid.

Company _____ FID or EIN No. _____

Address _____

City _____ State _____ Zip _____

I, _____, as a representative of _____
certify and affirm that this company is not on the Scrutinized Companies with Activities in Sudan List or the Scrutinized Companies with Activities in the Iran Petroleum Energy Sector List.

Signature

Title

Printed Name

Date

APPENDIX G
MANATEE COUNTY, A POLITICAL SUBDIVISION OF THE STATE OF FLORIDA
INDEMNITY AND HOLD HARMLESS
 IFBC No. 21-TA003713AJ

Bidder must fully complete and return this form with its Bid.

Bidder shall defend, indemnify and hold harmless the County and all of the County’s officers, agents, employees, and volunteers from and against all claims, liability, loss and expense, including reasonable costs, collection expenses, attorneys’ fees, and court costs which may arise because of the negligence (whether active or passive), misconduct, or other fault, in whole or in part (whether joint, concurrent, or contributing), of Respondent, its officers, employees, representatives and agents in performance or non-performance of its obligations under the Contract/Agreement. Bidder recognizes the broad nature of this indemnification and hold harmless clause, as well as the provision of a legal defense to the County when necessary, and voluntarily makes this covenant and expressly acknowledges the receipt of such good and valuable consideration provided by the County in support of these indemnification, legal defense and hold harmless contractual obligations in accordance with the laws of the State of Florida. This clause shall survive the termination of this Contract/Agreement. Compliance with any insurance requirements required elsewhere within this Contract/Agreement shall not relieve Bidder of its liability and obligation to defend, hold harmless and indemnify the County as set forth in this article of the Contract/Agreement.

Nothing herein shall be construed to extend the County’s liability beyond that provided in section 768.28, Florida Statutes.

PROJECT NUMBER AND/OR NAME	
INSURANCE AGENT	
RESPONDENT SIGNATURE	DATE

Acknowledgement:

STATE OF _____ COUNTY OF _____

The foregoing instrument was acknowledged before me this ____ day of _____,

20____ by _____ [FULL LEGAL NAME], who is

personally known to me / has produced _____ as
 identification.

Notary Signature _____

Print Name _____

APPENDIX H, INSURANCE STATEMENT

Bidder must fully complete and return this form with its Bid.

THE UNDERSIGNED has read and understands the insurance requirements of this IFBC applicable to any contract resulting from this solicitation and shall provide the insurances required by this Appendix within ten (10) days from the date of Notice of Intent to Award.

Bidder Name: _____ Date: _____

Signature
(Authorized
Official): _____

Printed Name/Title: _____

Insurance Agency: _____

Agent Name: _____ Agent Phone: _____

APPENDIX I, ACKNOWLEDGMENT OF ADDENDA

The undersigned acknowledges receipt of the following addenda:

Addendum No. _____	Date Received:
Addendum No. _____	Date Received:
Addendum No. _____	Date Received:
Addendum No. _____	Date Received:
Addendum No. _____	Date Received:
Addendum No. _____	Date Received:
Addendum No. _____	Date Received:
Addendum No. _____	Date Received:
Addendum No. _____	Date Received:
Addendum No. _____	Date Received:

Print or type Bidder's information below:

_____	_____
Name of Bidder	Telephone Number
_____	_____
Street Address	City/State/Zip

Email Address	
_____	_____
Print Name & Title of Authorized Officer	Signature of Authorized Official Date

APPENDIX J, AFFIDAVIT OF NO CONFLICT

COUNTY OF _____
STATE OF _____

BEFORE ME, the undersigned authority, this ____ day of _____, 20____ personally appeared, _____, a principal with full authority to bind _____ (hereinafter the "Affiant"), who being first duly sworn, deposes and says:

(a) is not currently engaged or will not become engaged in any obligations, undertakings or contracts that will require the Affiant to maintain an adversarial role against the County or that will impair or influence the advice, recommendations or quality of work provided to the County; and

(b) has provided full disclosure of all potentially conflicting contractual relationships and full disclosure of contractual relationships deemed to raise a question of conflict(s); and

(c) has provided full disclosure of prior work history and qualifications that may be deemed to raise possible question of conflict(s).

Affiant makes this affidavit for the purpose of inducing Manatee County, a political subdivision of the State of Florida, to enter into an Agreement for Bradenton Beach Gravity Sewer Replacement.

If applicable, on a separate page Bidder shall disclose the name of any officer, director or agent of Bidder who is also an employee of the County and the name of any County employee who owns, directly or indirectly, any interest in the Bidder's firm or any of its branches. If no conflicts of interest are present, submit a statement to that affect.

Signature

Print Name

SUBSCRIBED to and sworn before me this ____ day of _____, 20__.

[Notary Seal]

Notary Public

My commission expires: _____

Notary Signature

Print Name

Personally known OR produced identification. Type of identification produced _____
_____.

APPENDIX K, BID PRICING FORM

IFBC No. 21-TA003713AJ Bradenton Beach Gravity Sewer Replacement

Total Bid Price/Offer for Bid "A": \$ _____ Complete. Based on a completion time of 670 calendar days.

Total Bid Price/Offer for Bid "B": \$ _____ Complete. Based on a completion time of 760 calendar days.

We, the undersigned, hereby declare that we have carefully reviewed the IFBC Documents in their entirety and with full knowledge and understanding of the Bid information and all its requirements, submit this Bid, which is complete in meeting each specification, term, and condition contained therein.

As Bidder, we understand that the IFBC documents, including but not limited to, all specifications, terms, and conditions shall be made a part of any resulting Agreement between County and the successful Bidder. Failure by successful Bidder to comply with such specifications, terms and conditions shall result in Agreement default, whereupon, the defaulting successful Bidder shall be required to pay for all re-procurement costs, damages, and attorney fees as incurred by County, and agrees to forfeit its bid bond.

Authorized Signature(s): _____

**Name and Title of Above
Signer(s):** _____

Date: _____

APPENDIX K BID FORM BRADENTON BEACH GRAVITY REPLACEMENT Bid "A" BASED ON 670 CALENDAR DAY FOR COMPLETION Bidder must provide a prices for each line item for their bid to be considered responsive.					
ITEM	DESCRIPTION	QUANTITY	UNIT PRICE	AMOUNT	
I. MISCELLANEOUS					
1	Mobilization (10%)	1	LS		
2	Maintenance of Traffic	1	LS		
3	Erosion and Sediment Control	1	LS		
4	Clearing and Grubbing	1	LS		
5	Preconstruction Video	1	LS		
6	Project Signs	1	LS		
7	Record Drawings	1	LS		
MISCELLANEOUS SUBTOTAL					
II. PROPOSED IMPROVEMENTS					
8	12" PVC SDR 26 Sanitary Sewer Main (Open Cut)	190	LF		
9	8" PVC SDR 26 Sanitary Sewer Main (Open Cut)	2050	LF		
10	10" PVC C900 DR 25 Sanitary Sewer Main (Open Cut)	1000	LF		
11	8" PVC C900 DR 25 Sanitary Sewer Main (Open Cut)	975	LF		
12	8" PVC C900 DR 18 Certalok (Close Tolerance HDD)	550	LF		
13	Cap and Replace Service Lateral (Right of Way) - 8-inch x 6-inch SDR 26 WYE	70	EA		
14	Cap and Replace Service Lateral (Right of Way) - 8-inch x 6-inch PVC C900 WYE (6" Branch to fit SDR 26 Service)	16	EA		
15	Cap and Replace Service Lateral (Right of Way) - 12-inch x 6-inch PVC SDR 26 WYE	7	EA		
16	Construct and Connect Service Lateral (Private Property)	34	EA		
17	Construct Service Lateral (Private Property)	70	LF		
18	Cut In Manhole	1	EA		
19	Precast Polymer Concrete Manhole	2	EA		
20	Standard Precast Concrete Manhole	14	EA		
21	Precast Polymer Concrete Drop Manhole	6	EA		
22	Connection to Existing 4" Force Main, Manhole Tie In, Below Grade Air Release Valve, Fittings, and Associated Appurtenances	1	LS		
23	Connection to Existing Lift Station Wet Well	1	EA		
24	Connection to Existing Manhole	3	EA		
25	Demolish Existing Manhole Cone, Ring, and Cover and Fill Abandoned Manhole with Compacted Soil	25	EA		
26	Pavement Full Depth Road Restoration	5000	SY		
27	Sidewalk & Concrete Driveway Restoration	400	SY		
28	Brick Driveway Restoration	120	SY		
29	Sodding	900	SY		
30	Shell Driveway Restoration	5000	SY		
31	Mailbox Removal and Replacement	20	EA		

Bidder Name:

Bidder Signature:

APPENDIX K BID FORM BRADENTON BEACH GRAVITY REPLACEMENT Bid "A" BASED ON 670 CALENDAR DAY FOR COMPLETION Bidder must provide a prices for each line item for their bid to be considered responsive.					
ITEM	DESCRIPTION	QUANTITY		UNIT PRICE	AMOUNT
32	Grout Fill and Abandon Existing Sanitary Sewer & 4" Force Main	100	CY		
33	Modify Existing Sanitary Service Lateral	13	EA		
34	Relocate Existing Water Main Service Lateral	3	EA		
35	Removal and Replacement of Unsuitable Material, Including Limerock, Brick, Concrete, Mucky Sand	950	CY		
36	FDOT Pavement Repair and Restoration: Mill and Resurfacing	300	SY		
37	Bypass Pumping	1	LS		
PROPOSED IMPROVEMENTS SUBTOTAL					
SUBTOTAL					
38	Contract Contingency 10% of Subtotal (Used with County Approval Only)	1	LS	10%	
TOTAL BID "A" PRICE INCLUDING TOTAL CONSTRUCTION COSTS BASED ON 670 CALENDAR DAY COMPLETION					

Bidder Name:

Bidder Signature:

APPENDIX K BID FORM BRADENTON BEACH GRAVITY REPLACEMENT Bid "B" BASED ON 760 CALENDAR DAY FOR COMPLETION Bidder must provide a prices for each line item for their bid to be considered responsive.					
ITEM	DESCRIPTION	QUANTITY	UNIT PRICE	AMOUNT	
I. MISCELLANEOUS					
1	Mobilization (10%)	1	LS		
2	Maintenance of Traffic	1	LS		
3	Erosion and Sediment Control	1	LS		
4	Clearing and Grubbing	1	LS		
5	Preconstruction Video	1	LS		
6	Project Signs	1	LS		
7	Record Drawings	1	LS		
MISCELLANEOUS SUBTOTAL					
II. PROPOSED IMPROVEMENTS					
8	12" PVC SDR 26 Sanitary Sewer Main (Open Cut)	190	LF		
9	8" PVC SDR 26 Sanitary Sewer Main (Open Cut)	2050	LF		
10	10" PVC C900 DR 25 Sanitary Sewer Main (Open Cut)	1000	LF		
11	8" PVC C900 DR 25 Sanitary Sewer Main (Open Cut)	975	LF		
12	8" PVC C900 DR 18 Certalok (Close Tolerance HDD)	550	LF		
13	Cap and Replace Service Lateral (Right of Way) - 8-inch x 6-inch SDR 26 WYE	70	EA		
14	Cap and Replace Service Lateral (Right of Way) - 8-inch x 6-inch PVC C900 WYE (6" Branch to fit SDR 26 Service)	16	EA		
15	Cap and Replace Service Lateral (Right of Way) - 12-inch x 6-inch PVC SDR 26 WYE	7	EA		
16	Construct and Connect Service Lateral (Private Property)	34	EA		
17	Construct Service Lateral (Private Property)	70	LF		
18	Cut In Manhole	1	EA		
19	Precast Polymer Concrete Manhole	2	EA		
20	Standard Precast Concrete Manhole	14	EA		
21	Precast Polymer Concrete Drop Manhole	6	EA		
22	Connection to Existing 4" Force Main, Manhole Tie In, Below Grade Air Release Valve, Fittings, and Associated Appurtenances	1	LS		
23	Connection to Existing Lift Station Wet Well	1	EA		
24	Connection to Existing Manhole	3	EA		
25	Demolish Existing Manhole Cone, Ring, and Cover and Fill Abandoned Manhole with Compacted Soil	25	EA		
26	Pavement Full Depth Road Restoration	5000	SY		
27	Sidewalk & Concrete Driveway Restoration	400	SY		
28	Brick Driveway Restoration	120	SY		
29	Sodding	900	SY		
30	Shell Driveway Restoration	5000	SY		
31	Mailbox Removal and Replacement	20	EA		

Bidder Name:

Bidder Signature:

APPENDIX K BID FORM BRADENTON BEACH GRAVITY REPLACEMENT Bid "B" BASED ON 760 CALENDAR DAY FOR COMPLETION Bidder must provide a prices for each line item for their bid to be considered responsive.					
ITEM	DESCRIPTION	QUANTITY		UNIT PRICE	AMOUNT
32	Grout Fill and Abandon Existing Sanitary Sewer & 4" Force Main	100	CY		
33	Modify Existing Sanitary Service Lateral	13	EA		
34	Relocate Existing Water Main Service Lateral	3	EA		
35	Removal and Replacement of Unsuitable Material, Including Limerock, Brick, Concrete, Mucky Sand	950	CY		
36	FDOT Pavement Repair and Restoration: Mill and Resurfacing	300	SY		
37	Bypass Pumping	1	LS		
PROPOSED IMPROVEMENTS SUBTOTAL					
SUBTOTAL					
38	Contract Contingency 10% of Subtotal (Used with County Approval Only)	1	LS	10%	
TOTAL BID "B" PRICE INCLUDING TOTAL CONSTRUCTION COSTS BASED ON 760 CALENDAR DAY COMPLETION					

Bidder Name:

Bidder Signature:

SECTION C, BID ATTACHMENTS

BID ATTACHMENT 1, INSURANCE AND BOND REQUIREMENTS

The CONTRACTOR will not commence work under the resulting Agreement until all insurance coverages indicated by an “X” herein have been obtained. The CONTRACTOR shall obtain and submit to the Procurement Division within ten (10) calendar days from the date of notice of intent to award, at its expense, the following minimum amounts of insurance (inclusive of any amounts provided by an umbrella or excess policy): Work under this Agreement cannot commence until all insurance coverages indicated herein have been obtained on a standard ACORD form (inclusive of any amounts provided by an umbrella or excess policy):

Automobile Liability Insurance Required Limits

Coverage must be afforded under a per occurrence policy form including coverage for all owned, hired and non-owned vehicles for bodily injury and property damage of not less than:

- \$1,000,000 Combined Single Limit; OR
- \$ 500,000 Bodily Injury and \$500,000 Property Damage
- \$10,000 Personal Injury Protection (No Fault)
- \$500,000 Hired, Non-Owned Liability
- \$10,000 Medical Payments

This policy shall contain severability of interests’ provisions.

Commercial General Liability Insurance Required Limits (per Occurrence form only; claims-made form is not acceptable)

Coverage shall be afforded under a per occurrence policy form, policy shall be endorsed and name ‘Manatee County, a political subdivision of the State of Florida’ as an Additional Insured, and include limits not less than:

- \$1,000,000 Single Limit Per Occurrence
- \$2,000,000 Aggregate
- \$1,000,000 Products/Completed Operations Aggregate
- \$1,000,000 Personal and Advertising Injury Liability
- \$50,000 Fire Damage Liability
- \$10,000 Medical Expense, and
- \$1,000,000, Third Party Property Damage
- \$ Project Specific Aggregate (Required on projects valued at over \$10,000,000)

This policy shall contain severability of interests’ provisions.

Employer’s Liability Insurance

Coverage limits of not less than:

- \$100,000 Each Accident
- \$500,000 Disease Each Employee
- \$500,000 Disease Policy Limit

- Worker’s Compensation Insurance**
- US Longshoremen & Harbor Workers Act**
- Jones Act Coverage**

Coverage limits of not less than:

- Statutory workers’ compensation coverage shall apply for all employees in compliance with the laws and statutes of the State of Florida and the federal government.
- If any operations are to be undertaken on or about navigable waters, coverage must be included for the US Longshoremen & Harbor Workers Act and Jones Act.

Should ‘leased employees’ be retained for any part of the project or service, the employee leasing agency shall provide evidence of Workers’ Compensation coverage and Employer’s Liability coverage for all personnel on the worksite and in compliance with the above Workers’ Compensation requirements. NOTE: Workers’ Compensation coverage is a firm requirement. Elective exemptions are considered on a case-by-case basis and are approved in a very limited number of instances.

Aircraft Liability Insurance Required Limits

Coverage shall be afforded under a per occurrence policy form, policy shall be endorsed and name ‘Manatee County a political subdivision of the State of Florida’ as an Additional Insured, and include limits not less than:

- \$ Each Occurrence Property and Bodily Injury with no less than \$100,000 per passenger each occurrence or a ‘smooth’ limit.
- \$ General Aggregate.

Un-Manned Aircraft Liability Insurance (Drone)

Coverage shall be afforded under a per occurrence policy form, policy shall be endorsed and name ‘Manatee County a political subdivision of the State of Florida’ as an Additional Insured, and include limits not less than:

- \$ Each Occurrence Property and Bodily Injury; Coverage shall specifically include operation of Unmanned Aircraft Systems (UAS), including liability and property damage.
- \$ General Aggregate

Installation Floater Insurance

When the contract or agreement **does not** include construction of, or additions to, above ground building or structures, but does involve the installation of machinery or equipment, Installation Floater Insurance shall be afforded under a per occurrence policy form, policy shall be endorsed and name “Manatee County, a political subdivision of the State of Florida” as an Additional Insured, and include limits not less than:

- 100% of the completed value of such addition(s), building(s), or structure(s)

Professional Liability and/or Errors and Omissions (E&O) Liability Insurances

Coverage shall be afforded under either an occurrence policy form or a claims-made policy form. If the coverage form is on a claims-made basis, then coverage must be maintained for a minimum of three years from termination of date of the contract. Limits must not be less than:

- \$ 1,000,000 Bodily Injury and Property Damage Each Occurrence
- \$ 2,000,000 General Aggregate

Builder’s Risk Insurance

When the contract or agreement includes the construction of roadways and/or the addition of a permanent structure or building, including the installation of machinery and/or equipment, Builder’s Risk Insurance shall be afforded under a per occurrence policy form, policy shall be endorsed and name “Manatee County, a political subdivision of the State of Florida” as an Additional Insured, and include limits not less than:

- An amount equal to 100% of the completed value of the project, or the value of the equipment to be installed
- The policy shall not carry a self-insured retention/deductible greater than \$10,000

Coverage shall be for all risks and include, but not be limited to, storage and transport of materials, equipment, supplies of any kind whatsoever to be used on or incidental to the project, theft coverage, and Waiver of Occupancy Clause Endorsement, where applicable.

Cyber Liability Insurance

Coverage shall comply with Florida Statute 501.171, shall be afforded under a per occurrence policy form, policy shall be endorsed and name ‘Manatee County, a political subdivision of the State of Florida’ as an Additional Insured, and include limits not less than:

- \$ Security Breach Liability
- \$ Security Breach Expense Each Occurrence
- \$ Security Breach Expense Aggregate
- \$ Replacement or Restoration of Electronic Data
- \$ Extortion Threats
- \$ Business Income and Extra Expense
- \$ Public Relations Expense

NOTE: Policy must not carry a self-insured retention/deductible greater than \$25,000.

Hazardous Materials Insurance (As Noted Below)

Hazardous materials include all materials and substances that are currently designated or defined as hazardous by the law or rules of regulation by the State of Florida or federal government.

All coverage shall be afforded under either an occurrence policy form or a claims-made policy form, and the policy shall be endorsed and name 'Manatee County, a political subdivision of the State of Florida' as an Additional Insured. If the coverage form is on a claims-made basis, then coverage must be maintained for a minimum of three years from termination of date of the contract. Limits must not be less than:

Pollution Liability

Amount equal to the value of the contract, subject to a \$1,000,000 minimum, for Bodily Injury and Property Damage to include sudden and gradual release, each claim and aggregate.

Asbestos Liability (If handling within scope of Contract)

Amount equal to the value of the contract, subject to a \$1,000,000 minimum, for Bodily Injury and Property Damage to include sudden and gradual release, each claim and aggregate.

Disposal

When applicable, CONTRACTOR shall designate the disposal site and furnish a Certificate of Insurance from the disposal facility for Environmental Impairment Liability Insurance covering liability.

- Amount equal to the value of the contract, subject to a \$1,000,000 minimum, for Liability for Sudden and Accidental Occurrences, each claim and an aggregate.
- Amount equal to the value of the contract, subject to a \$1,000,000 minimum, for Liability for Non-Sudden and Accidental Occurrences, each claim and an aggregate.

Hazardous Waste Transportation Insurance

CONTRACTOR shall designate the hauler and have the hauler furnish a Certificate of Insurance for Automobile Liability insurance with Endorsement MCS-90 for liability arising out of the transportation of hazardous materials. EPA identification number shall be provided.

All coverage shall be afforded under either an occurrence policy form or a claims-made policy form and the policy shall be endorsed and name "Manatee County, a political subdivision of the State of Florida" as an Additional Insured. If the coverage form is on a claims-made basis, then coverage must be maintained for a minimum of three years from termination of date of the contract. Limits must not be less than:

- Amount equal to the value of the contract, subject to a \$1,000,000 minimum, per accident.

Liquor Liability Insurance

Coverage shall be afforded under a per occurrence policy form, policy shall be endorsed and name "Manatee County, a political subdivision of the State of Florida" as an Additional Insured, and include limits not less than:

- \$1,000,000 Each Occurrence and Aggregate

Garage Keeper’s Liability Insurance

Coverage shall be required if the maintenance, servicing, cleaning or repairing of any County motor vehicles is inherent or implied within the provision of the contract.

Coverage shall be afforded under a per occurrence policy form, policy shall be endorsed and name “Manatee County, a political subdivision of the State of Florida” as an Additional Insured, and include limits not less than:

- Property and asset coverage in the full replacement value of the lot or garage.

Bailee’s Customer Liability Insurance

Coverage shall be required for damage and/or destruction when County property is temporarily under the care or custody of a person or organization, including property that is on, or in transit to and from the person or organization’s premises. Perils covered should include fire, lightning, theft, burglary, robbery, explosion, collision, flood, earthquake and damage or destruction during transportation by a carrier.

Coverage shall be afforded under a per occurrence policy form, policy shall be endorsed and name “Manatee County, a political subdivision of the State of Florida” as an Additional Insured, and include limits not less than:

- Property and asset coverage in the full replacement value of the County asset(s) in the CONTRACTOR’S care, custody and control.

Hull and Watercraft Liability Insurance

Coverage shall be afforded under a per occurrence policy form, policy shall be endorsed and name “Manatee County, a political subdivision of the State of Florida” as an Additional Insured, and include limits not less than:

- \$ Each Occurrence
- \$ General Aggregate
- \$ Fire Damage Liability
- \$10,000 Medical Expense, and
- \$ Third Party Property Damage
- \$ Project Specific Aggregate (Required on projects valued at over \$10,000,000)

Other [Specify]

BOND REQUIREMENTS

Bid Bond

A Bid Bond in the amount of \$_____ or 5% of the total offer. Bid bond shall be submitted with the sealed response and shall include project name, location, and / or address and project number. In lieu of the bond, the bidder may file an alternative form of security in the amount of \$_____ or 5% of the total offer. in the form of a money order, a certified check, a cashier's check, or an irrevocable letter of credit issued to Manatee County. NOTE: A construction project over \$200,000 requires a Bid Bond in the amount of 5% of the total bid offer.

Payment and Performance Bond

A Payment and Performance Bond shall be submitted by Successful Bidder for 100% of the award amount and shall be presented to Manatee County within ten (10) calendar days of issuance of the notice of intent to award. NOTE: A construction project over \$200,000 requires a Payment and Performance Bond.

INSURANCE REQUIREMENTS

I. THE POLICIES BELOW ARE TO CONTAIN, OR BE ENDORSED TO CONTAIN, THE FOLLOWING PROVISIONS:

1. Commercial General Liability and Automobile Liability Coverages

- a. **“Manatee County, a Political Subdivision of the State of Florida,” is to be named as an Additional Insured in respect to:** Liability arising out of activities performed by or on behalf of the successful Bidder, his agents, representatives, and employees; products and completed operations of the successful Bidder; or automobiles owned, leased, hired or borrowed by the successful Bidder. The coverage shall contain no special limitation(s) on the scope of protection afforded to the County, its officials, employees or volunteers.

In addition to furnishing a Certificate of Insurance, the successful Bidder shall provide the endorsement that evidences Manatee County being listed as an Additional Insured. This can be done in one of two ways: (1) an endorsement can be issued that specifically lists “Manatee County, a Political Subdivision of the State of Florida,” as Additional Insured; or, (2) an endorsement can be issued that states that all Certificate Holders are Additional Insured with respect to the policy.

- b. The successful Bidder's insurance coverage shall be primary insurance with respect to the County, its officials, employees and volunteers. Any insurance or self-insurance maintained by the County, its officials, employees or volunteers shall be excess of successful Bidder's insurance and shall be non-contributory.
- c. The insurance policies must be on an occurrence form.

2. Workers' Compensation and Employers' Liability Coverages

The insurer shall agree to waive all rights of subrogation against the County, its officials, employees and volunteers for losses arising from work performed by the successful Bidder for the County.

II. GENERAL INSURANCE PROVISIONS APPLICABLE TO ALL POLICIES:

1. Prior to the execution of contract, or issuance of a Purchase Order, and then annually upon the anniversary date(s) of the insurance policy's renewal date(s) for as long as this contract remains in effect, successful Bidder shall furnish the County with a Certificate(s) of Insurance (using an industry accepted certificate form, signed by the Issuer, with applicable endorsements, and containing the solicitation or contract number, and title or description) evidencing the coverage set forth above and naming “Manatee County, a Political Subdivision of the State of Florida” as an Additional Insured on the applicable coverage(s) set forth above.
2. If the policy contains an aggregate limit, confirmation is needed in writing (letter, email, etc.) that the aggregate limit has not been eroded to procurement representative when supplying Certificate of Insurance.

In addition, when requested in writing from the County, successful Bidder will provide the County with a certified copy of all applicable policies. The address where such certificates and certified policies shall be sent or delivered is as follows:

Manatee County, a Political Subdivision of the State of Florida
Attn: Risk Management Division
1112 Manatee Avenue West, Suite 969
Bradenton, FL 34205

3. The project's solicitation number and title shall be listed on each certificate.
 4. successful Bidder shall provide thirty (30) days written notice to the Risk Manager of any cancellation, non-renewal, termination, material change, or reduction in coverage of any insurance policies to procurement representative including solicitation number and title with all notices.
 5. successful Bidder agrees that should at any time successful Bidder fail to meet or maintain the required insurance coverage(s) as set forth herein, the County may terminate this contract.
 6. The successful Bidder waives all subrogation rights against Manatee County, a Political Subdivision of the State of Florida, for all losses or damages which occur during the contract and for any events occurring during the contract period, whether the suit is brought during the contract period or not.
 7. The successful Bidder has sole responsibility for all insurance premiums and policy deductibles.
 8. It is the successful Bidder's responsibility to ensure that his agents, representatives and subcontractors comply with the insurance requirements set forth herein. successful Bidder shall include his agents, representatives, and subcontractors working on the project or at the worksite as insured under its policies, or successful Bidder shall furnish separate certificates and endorsements for each agent, representative, and subcontractor working on the project or at the worksite. All coverages for agents, representatives, and subcontractors shall be subject to all of the requirements set forth to the procurement representative.
 9. All required insurance policies must be written with a carrier having a minimum A.M. Best rating of A- FSC VII or better. In addition, the County has the right to review the successful Bidder's deductible or self-insured retention and to require that it be reduced or eliminated.
- III. Successful Bidder understands and agrees that the stipulated limits of coverage listed herein in this insurance section shall not be construed as a limitation of any potential liability to the County, or to others, and the County's failure to request evidence of this insurance coverage shall not be construed as a waiver of successful Bidder's obligation to provide and maintain the insurance coverage specified.
- IV. The enclosed Hold Harmless Agreement shall be signed by the successful Bidder and shall become a part of the contract.

- V.** Successful Bidder understands and agrees that the County does not waive its immunity, and nothing herein shall be interpreted as a waiver of the County's rights, including the limitation of waiver of immunity, as set forth in Florida Statutes 768.28, or any other statutes, and the County expressly reserves these rights to the full extent allowed by law.

- VI.** No award shall be made until the Procurement Division has received the Certificate of Insurance and Hold Harmless Agreement in accordance with this section.

[Remainder of page intentionally left blank]

BID ATTACHMENT 2, TECHNICAL SPECIFICATIONS

CONTRACT DOCUMENTS
TECHNICAL SPECIFICATIONS
FOR



Bradenton Beach
Gravity Replacement

PROJECT # 148400056

February 2021

PROJECT OWNER:

County of Manatee, Florida
c/o Manatee County Procurement Division
1112 Manatee Avenue West
Bradenton, Florida 34205
(941) 748-3014

PREPARED BY:

Kimley-Horn and Associates, Inc.
100 2nd Avenue South 105-N
St. Petersburg, FL 33701
(727) 547-3999
CA# 00000696

CONTACT:

Michael Semago, P.E.
Mike.Semago@Kimley-Horn.com
100 2nd Avenue South 105-N
St. Petersburg, FL 33701
(727)498-3633

INFRASTRUCTURE ENGINEERING STANDARD SPECIFICATIONS

DIVISION 1	GENERAL REQUIREMENTS	5
SECTION 01005	GENERAL REQUIREMENTS	5
SECTION 01010	SUMMARY OF WORK	16
SECTION 01015	CONTROL OF WORK	18
SECTION 01030	SPECIAL PROJECT PROCEDURES	22
SECTION 01045	CUTTING AND PATCHING	26
SECTION 01050	FIELD ENGINEERING AND SURVEYING	28
SECTION 01090	REFERENCE STANDARDS	29
SECTION 01150	MEASUREMENT AND PAYMENT	32
SECTION 01152	REQUESTS FOR PAYMENT	47
SECTION 01153	CHANGE ORDER PROCEDURES	48
SECTION 01200	PROJECT MEETINGS	51
SECTION 01310	CONSTRUCTION SCHEDULE & PROJECT RESTRAINTS	53
SECTION 01340	SHOP DRAWINGS, PROJECT DATA AND SAMPLES	58
SECTION 01370	SCHEDULE OF VALUES	63
SECTION 01380	CONSTRUCTION PHOTOGRAPHS	64
SECTION 01410	TESTING AND TESTING LABORATORY SERVICES	66
SECTION 01510	TEMPORARY AND PERMANENT UTILITIES	68
SECTION 01570	TRAFFIC REGULATION	70
SECTION 01580	PROJECT IDENTIFICATION AND SIGNS	72
SECTION 01590	COUNTY'S FIELD OFFICE	75
SECTION 01600	MATERIAL AND EQUIPMENT	77
SECTION 01620	STORAGE AND PROTECTION	79
SECTION 01700	CONTRACT CLOSEOUT	81
SECTION 01710	CLEANING	84
SECTION 01720	PROJECT RECORD DOCUMENTS	86
SECTION 01730	OPERATING AND MAINTENANCE DATA	93
SECTION 01740	WARRANTIES AND BONDS	96
DIVISION 2	SITE WORK	98
SECTION 02064	MODIFICATION OF EXISTING STRUCTURES, PIPING AND EQUIPMENT	98
SECTION 02100	SITE PREPARATION	104
SECTION 02220	EXCAVATION, BACKFILL, FILL AND GRADING FOR STRUCTURES	106
SECTION 02221	TRENCHING, BEDDING AND BACKFILL FOR PIPE	111
SECTION 02223	EXCAVATION BELOW GRADE AND CRUSHED STONE OR SHELL REFILL	118
SECTION 02260	FINISH GRADING	119
SECTION 02276	TEMPORARY EROSION AND SEDIMENTATION CONTROL	121
SECTION 02480	LANDSCAPING	123
SECTION 02485	SEEDING AND SODDING	128
SECTION 02513	ASPHALT CONCRETE PAVING	131
SECTION 02515	CONCRETE SIDEWALKS, DRIVEWAYS AND GUTTERS	140
SECTION 02575	PAVEMENT REPAIR AND RESTORATION	143
SECTION 02618	CLOSE TOLERANCE HORIZONTAL DIRECTIONAL DRILLING	146
SECTION 02620	POLYETHYLENE (HDPE) PIPE AND FITTING	149
SECTION 02623	POLYVINYL CHLORIDE (PVC) GRAVITY SEWER PIPE	152
SECTION 02624	SANITARY SEWER ROUTINE CLEANING AND TELEVISIONING	162
SECTION 02625	PRECAST POLYMER CONCRETE STRUCTURES	169
SECTION 02626	SANITARY SEWER GRAVITY MAIN REHABILITATION	179
SECTION 02627	SANITARY SEWER MANHOLE REHABILITATION	193
SECTION 02720	SANITARY SEWER BYPASS PUMPING	201

DIVISION 3	CONCRETE	204
SECTION 03200	CONCRETE REINFORCEMENT	204
SECTION 03300	CAST-IN-PLACE CONCRETE	207
SECTION 03350	CONCRETE FINISHES	212
SECTION 03410	PRECAST CONCRETE STRUCTURES	215
SECTION 09865	SURFACE PREPARATION AND SHOP PRIME PAINTING	224
SECTION 09900	PAINTING	230
SECTION 09970	SURFACE PROTECTION SPRAY SYSTEM	282

This specification includes by reference the Manatee County Public Works Standards, Part I Utilities Standards Manual approved February 2020.

DIVISION 1 GENERAL REQUIREMENTS

SECTION 01005 GENERAL REQUIREMENTS

PART 1 1.01 GENERAL SCOPE AND INTENT

A. Description

The work to be done consists of the furnishing of all labor, materials and equipment, and the performance of all work included in this Contract.

B. Work Included

The Contractor shall furnish all labor, superintendence, materials, plant, power, light, heat, fuel, water, tools, appliances, equipment, supplies, shop drawings, working drawings and other means of construction necessary or proper for performing and completing the work. The Contractor shall obtain and pay for all required permits necessary for the work, other than those permits such as the DEP permit and railroad permit, which may have already been obtained. The Contractor shall perform and complete the work in the manner best calculated to promote rapid construction consistent with safety of life and property and to the satisfaction of the County, and in strict accordance with the Contract Documents. The Contractor shall clean up the work and maintain it during and after construction, until accepted, and shall do all work and pay all incidental costs. The Contractor shall repair or restore all structures and property that may be damaged or disturbed during performance of the work.

The cost of incidental work described in these General Requirements, for which there are no specific Contract Items, shall be considered as part of the general cost of doing the work and shall be included in the prices for the various Contract Items. No additional payment will be made.

The Contractor shall be solely responsible for the adequacy of his workmanship, materials and equipment.

C. Public Utility Installations and Structures

Public utility installations and structures shall be understood to include all poles, tracks, pipes, wires, conduits, house service connections, vaults, manholes and all other appurtenances and facilities pertaining thereto.

The Contractor shall protect all installations and structures from damage during the work. Access across any buried public utility installation or structure shall be made only in such locations and by means approved by the County. All required protective devices and construction shall be provided by the Contractor at his expense. All existing public utilities damaged by the Contractor, which are shown on the Plans or have been located in the field by the utility, shall be repaired by the Contractor, at his expense, as approved by the County. No separate payment shall be made for such protection or repairs to public utility installations or structures.

Public utility installations or structures owned or controlled by the County or other governmental body, which are required by this contract to be removed, relocated, replaced or rebuilt by the Contractor not identified in any separate bid item shall be considered as a

part of the general cost of doing the work and shall be included in the prices bid for the various contract items. No separate payment shall be made.

Where public utility installations or structures owned or controlled by the County or other governmental body are encountered during the course of the work, and are not indicated on the Plans or in the Specifications, and when, in the opinion of the County, removal, relocation, replacement or rebuilding is necessary to complete the work under this Contract, such work shall be accomplished by the utility having jurisdiction, or such work may be ordered, in writing by the County, for the Contractor to accomplish. If such work is accomplished by the utility having jurisdiction, it will be carried out expeditiously and the Contractor shall give full cooperation to permit the utility to complete the removal, relocation, replacement or rebuilding as required. If such work is accomplished by the Contractor, it will be in accordance with the General and Supplemental General Conditions.

The Contractor shall give written notice to County and other governmental utility departments and other owners of public utilities of the location of his proposed construction operations, at least forty-eight hours in advance of breaking ground in any area or on any unit of the work. This can be accomplished by making the appropriate contact with the "Sunshine State One-Call of Florida, Inc. Call Center ("Call Sunshine") and per all requirements provided for in the Florida Underground Facilities Damage Prevention and Safety Act (Florida Statutes, Title XXXIII, Chapter 556).

The maintenance, repair, removal, relocation or rebuilding of public utility installations and structures, when accomplished by the Contractor as herein provided, shall be done by methods approved by the County.

1.02 PLANS AND SPECIFICATIONS

A. Plans

When obtaining data and information from the Plans, figures shall be used in preference to scaled dimensions, and large-scale drawings in preference to small-scale drawings.

B. Copies Furnished to Contractor

The Contractor shall furnish each of the subcontractors, manufacturers, and suppliers such copies of the Contract Documents as may be required for their work. Additional copies of the Plans and Specifications, when requested, may be furnished to the Contractor at cost of reproduction.

C. Supplementary Drawings

When, in the opinion of the County, it becomes necessary to explain more fully the work to be done or to illustrate the work further or to show any changes which may be required, drawings known as Supplementary Drawings, with specifications pertaining thereto, will be prepared by the County and five paper prints thereof will be given to the Contractor.

D. Contractor to Check Plans and Data

The Contractor shall verify all dimensions, quantities and details shown on the Plans, Supplementary Drawings, Schedules, Specifications or other data received from the County, and shall notify the County of all errors, omissions, conflicts, and discrepancies found therein. Failure to discover or correct errors, conflicts or discrepancies shall not

relieve the Contractor of full responsibility for unsatisfactory work, faulty construction or improper operation resulting therefrom nor from rectifying such conditions at his own expense. The Contractor will not be allowed to take advantage of any errors or omissions, as full instructions will be furnished by the County, should such errors or omissions be discovered. All schedules are given for the convenience of the County and the Contractor and are not guaranteed to be complete. The Contractor shall assume all responsibility for the making of estimates of the size, kind, and quality of materials and equipment included in work to be done under the Contract.

E. Specifications

The Technical Specifications consist of three parts: General, Products and Execution. The General Section contains General Requirements which govern the work. Products and Execution modify and supplement these by detailed requirements for the work and shall always govern whenever there appears to be a conflict.

F. Intent

All work called for in the Specifications applicable to this Contract, but not shown on the Plans in their present form, or vice versa, shall be of like effect as if shown or mentioned in both. Work not specified in either the Plans or in the Specifications, but involved in carrying out their intent or in the complete and proper execution of the work, is required and shall be performed by the Contractor as though it were specifically delineated or described.

The apparent silence of the Specifications as to any detail, or the apparent omission from them of a detailed description concerning any work to be done and materials to be furnished, shall be regarded as meaning that only the best general practice is to prevail and that only material and workmanship of the best quality is to be used, and interpretation of these Specifications shall be made upon that basis.

The inclusion of the Related Requirements (or work specified elsewhere) in the General part of the specifications is only for the convenience of the Contractor, and shall not be interpreted as a complete list of related Specification Sections.

1.03 MATERIALS AND EQUIPMENT

A. Manufacturer

All transactions with the manufacturers or subcontractors shall be through the Contractor, unless the Contractor shall request, in writing to the County, that the manufacturer or subcontractor deal directly with the County. Any such transactions shall not in any way release the Contractor from his full responsibility under this Contract.

Any two or more pieces or material or equipment of the same kind, type or classification, and being used for identical types of services, shall be made by the same manufacturer.

B. Delivery

The Contractor shall deliver materials in ample quantities to insure the most speedy and uninterrupted progress of the work to complete the work within the allotted time. The Contractor shall also coordinate deliveries in order to avoid delay in, or impediment of, the progress of the work of any related Contractor.

C. Tools and Accessories

The Contractor shall, unless otherwise stated in the Contract Documents, furnish with each type, kind or size of equipment, one complete set of suitably marked high grade special tools and appliances which may be needed to adjust, operate, maintain or repair the equipment. Such tools and appliances shall be furnished in approved painted steel cases, properly labeled and equipped with good grade cylinder locks and duplicate keys.

Spare parts shall be furnished as specified.

Each piece of equipment shall be provided with a substantial nameplate, securely fastened in place and clearly inscribed with the manufacturer's name, year of manufacture, serial number, weight and principal rating data.

D. Installation of Equipment.

The Contractor shall have on hand sufficient proper equipment and machinery of ample capacity to facilitate the work and to handle all emergencies normally encountered in work of this character.

Equipment shall be erected in a neat and workmanlike manner on the foundations at the locations and elevations shown on the Plans, unless directed otherwise by the County during installation. All equipment shall be correctly aligned, leveled and adjusted for satisfactory operation and shall be installed so that proper and necessary connections can be made readily between the various units.

The Contractor shall furnish, install and protect all necessary anchor and attachment bolts and all other appurtenances needed for the installation of the devices included in the equipment specified. Anchor bolts shall be as approved by the County and made of ample size and strength for the purpose intended. Substantial templates and working drawings for installation shall be furnished.

The Contractor shall furnish all materials and labor for, and shall properly bed in non-shrink grout, each piece of equipment on its supporting base that rests on masonry foundations.

Grout shall completely fill the space between the equipment base and the foundation. All metal surfaces coming in contact with concrete or grout shall receive a coat of coal tar epoxy per Specifications Section 09900 or provide a 1/32-inch neoprene gasket between the metal surface and the concrete or grout.

E. Service of Manufacturer's Engineer

The Contract prices for equipment shall include the cost of furnishing (as required by equipment specifications sections) a competent and experienced engineer or superintendent who shall represent the manufacturer and shall assist the Contractor, when required, to install, adjust, test and place in operation the equipment in conformity with the Contract Documents. After the equipment is placed in permanent operation by the County, such engineer or superintendent shall make all adjustments and tests required by the County to prove that such equipment is in proper and satisfactory operating condition, and shall instruct such personnel as may be designated by the County in the proper operation and maintenance of such equipment.

A. General

Inspection and testing of materials will be performed by the County unless otherwise specified.

For tests specified to be made by the Contractor, the testing personnel shall make the necessary inspections and tests and the reports thereof shall be in such form as will facilitate checking to determine compliance with the Contract Documents. Three (3) copies of the reports shall be submitted and authoritative certification thereof must be furnished to the County as a prerequisite for the acceptance of any material or equipment.

If, in the making of any test of any material or equipment, it is ascertained by the County that the material or equipment does not comply with the Contract, the Contractor will be notified thereof and he will be directed to refrain from delivering said material or equipment, or to remove it promptly from the site or from the work and replace it with acceptable material, without cost to the County.

Tests of electrical and mechanical equipment and appliances shall be conducted in accordance with recognized test codes of the ANSI, ASME, or the IEEE, except as may otherwise be stated herein.

The Contractor shall be fully responsible for the proper operation of equipment during tests and instruction periods and shall neither have nor make any claim for damage which may occur to equipment prior to the time when the County formally takes over the operation thereof.

B. Costs

All inspection and testing of materials furnished under this Contract will be performed by the County or duly authorized inspection engineers or inspections bureaus without cost to the Contractor, unless otherwise expressly specified.

The cost of shop and field tests of equipment and of certain other tests specifically called for in the Contract Documents shall be borne by the Contractor and such costs shall be deemed to be included in the Contract price.

Materials and equipment submitted by the Contractor as the equivalent to those specifically named in the Contract may be tested by the County for compliance. The Contractor shall reimburse the County for the expenditures incurred in making such tests on materials and equipment which are rejected for non-compliance.

C. Inspections of Materials

The Contractor shall give notice in writing to the County, at least two weeks in advance of his intention to commence the manufacture or preparation of materials especially manufactured or prepared for use in or as part of the permanent construction. Such notice shall contain a request for inspection, the date of commencement and the expected date of completion of the manufacture or preparation of materials. Upon receipt of such notice, the County will arrange to have a representative present at such times during the manufacture as may be necessary to inspect the materials or he will notify the Contractor that the inspection will be made at a point other than the point of manufacture, or he will notify the Contractor that inspection will be waived. The Contractor must comply with these provisions

before shipping any material. Such inspection shall not release the Contractor from the responsibility for furnishing materials meeting the requirements of the Contract Documents.

D. Certificate of Manufacture

When inspection is waived or when the County so requires, the Contractor shall furnish to him authoritative evidence in the form of Certificates of Manufacture that the materials to be used in the work have been manufactured and tested in conformity with the Contract Documents. These certificates shall be notarized and shall include copies of the results of physical tests and chemical analyses, where necessary, that have been made directly on the product or on similar products of the manufacturer.

E. Shop Tests of Operating Equipment

Each piece of equipment for which pressure, duty, capacity, rating, efficiency, performance, function or special requirements are specified shall be tested in the shop of the maker in a manner which shall conclusively prove that its characteristics comply fully with the requirements of the Contract Documents. No such equipment shall be shipped to the work until the County notifies the Contractor, in writing, that the results of such tests are acceptable.

The cost of shop tests and of furnishing manufacturer's preliminary and shop test data of operating equipment shall be borne by the Contractor.

F. Preliminary Field Tests

As soon as conditions permit, the Contractor shall furnish all labor, materials, and instruments and shall make preliminary field tests of equipment. If the preliminary field tests disclose any equipment furnished under this Contract which does not comply with the requirements of the Contract Documents, the Contractor shall, prior to the acceptance tests, make all changes, adjustments and replacements required. The furnishing Contractor shall assist in the preliminary field tests as applicable.

G. Final Field Tests

Upon completion of the work and prior to final payment, all equipment and piping installed under this Contract shall be subjected to acceptance tests as specified or required to prove compliance with the Contract Documents.

The Contractor shall furnish labor, fuel, energy, water and all other materials, equipment and instruments necessary for all acceptance tests, at no additional cost to the County. The Supplier shall assist in the final field tests as applicable.

H. Failure of Tests

Any defects in the materials and equipment or their failure to meet the tests, guarantees or requirements of the Contract Documents shall be promptly corrected by the Contractor. The decision of the County as to whether the Contractor has fulfilled his obligations under the Contract shall be final and conclusive. If the Contractor fails to make these corrections or if the improved materials and equipment, when tested, shall again fail to meet the guarantees of specified requirements, the County, notwithstanding its partial payment for work, and materials and equipment, may reject the materials and equipment and may order the Contractor to remove them from the site at his own expense.

In case the County rejects any materials and equipment, then the Contractor shall replace the rejected materials and equipment within a reasonable time. If the Contractor fails to do so, the County may, after the expiration of a period of thirty (30) calendar days after giving him notice in writing, proceed to replace such rejected materials and equipment, and the cost thereof shall be deducted from any compensation due or which may become due the Contractor under his Contract.

I. Final Inspection

During such final inspections, the work shall be clean and free from water. In no case will the final pay application be prepared until the Contractor has complied with all requirements set forth and the County has made his final inspection of the entire work and is satisfied that the entire work is properly and satisfactorily constructed in accordance with the requirements of the Contract Document.

1.05 TEMPORARY STRUCTURES

A. Temporary Fences

If, during the course of the work, it is necessary to remove or disturb any fence or part thereof, the Contractor shall, at his own expense, if so ordered by the County, provide a suitable temporary fence which shall be maintained until the permanent fence is replaced. The County shall be solely responsible for the determination of the necessity for providing a temporary fence and the type of temporary fence to be used.

1.06 TEMPORARY SERVICES

A. First Aid

The Contractor shall keep upon the site, at each location where work is in progress, a completely equipped first aid kit and shall provide ready access thereto at all times when people are employed on the work.

1.07 LINES AND GRADES

A. Grade

All work under this Contract shall be constructed in accordance with the lines and grades shown on the Plans, or as given by the County. The full responsibility for keeping alignment and grade shall rest upon the Contractor.

B. Safeguarding Marks

The Contractor shall safeguard all points, stakes, grade marks, monuments and bench marks made or established on the work, bear the cost of reestablishing them if disturbed, and bear the entire expense of rectifying work improperly installed due to not maintaining or protecting or removing without authorization such established points, stakes and marks.

The Contractor shall safeguard all existing and known property corners, monuments and marks adjacent to but not related to the work and, if required, shall bear the cost of reestablishing them if disturbed or destroyed.

C. Datum Plane

All elevations indicated or specified refer to the Mean Sea Level Datum of the NAVD 1988 and/or NGVD 1929.

1.08 ADJACENT STRUCTURES AND LANDSCAPING

A. Responsibility

The Contractor shall also be entirely responsible and liable for all damage or injury as a result of his operations to all other adjacent public and private property, structures of any kind and appurtenances thereto met with during the progress of the work. The cost of protection, replacement in their original locations and conditions or payment of damages for injuries to such adjacent public and private property and structures affected by the work, whether or not shown on the Plans, and the removal, relocation and reconstruction of such items called for on the Plans or specified shall be included in the various Contract Items and no separate payments will be made therefore. Where such public and private property, structures of any kind and appurtenances thereto are not shown on the Plans and when, in the opinion of the County, additional work is deemed necessary to avoid interference with the work, payment therefore will be made as provided for in the General Conditions.

Contractor is expressly advised that the protection of buildings, structures, tunnels, tanks, pipelines, etc. and related work adjacent and in the vicinity of his operations, wherever they may be, is solely his responsibility. Conditional inspection of buildings or structures in the immediate vicinity of the project which may reasonably be expected to be affected by the Work shall be performed by and be the responsibility of the Contractor.

Contractor shall, before starting operations, make an examination of the interior and exterior of the adjacent structures, buildings, facilities, etc., and record by notes, measurements, photographs, etc., conditions which might be aggravated by open excavation and construction. Repairs or replacement of all conditions disturbed by the construction shall be made to the satisfaction of the County. This does not preclude conforming to the requirements of the insurance underwriters. Copies of surveys, photographs, reports, etc., shall be given to the County.

Prior to the beginning of any excavations, the Contractor shall advise the County of all buildings or structures on which he intends to perform work or which performance of the project work will affect.

B. Protection of Trees

1. All trees and shrubs shall be adequately protected by the Contractor with boxes and otherwise and in accordance with ordinances governing the protection of trees. No excavated materials shall be placed so as to injure such trees or shrubs. Trees or shrubs destroyed by negligence of the Contractor or his employees shall be replaced by him with new stock of similar size and age, at the proper season and at the sole expense of the Contractor.
2. Beneath trees or other surface structures, where possible, pipelines may be built in short tunnels, backfilled with excavated materials, except as otherwise specified, or the trees or structures carefully supported and protected from damage.
3. The County may order the Contractor, for the convenience of the County, to remove trees along the line or trench excavation. If so ordered, the County will obtain any

permits required for removal of trees. Such tree removal ordered shall be paid for under the appropriate Contract Items.

C. Lawn Areas

Lawn areas shall be left in as good condition as before the starting of the work. Where sod is to be removed, it shall be carefully removed, and later replaced, or the area where sod has been removed shall be restored with new sod.

D. Restoration of Fences

Any fence, or part thereof, that is damaged or removed during the course of the work shall be replaced or repaired by the Contractor and shall be left in as good a condition as before the starting of the work. The manner in which the fence is repaired or replaced and the materials used in such work shall be subject to the approval of the County. The cost of all labor, materials, equipment, and work for the replacement or repair of any fence shall be deemed included in the appropriate Contract Item or items, or if no specific Item is provided therefore, as part of the overhead cost of the work, and no additional payment will be made therefore.

1.09 PROTECTION OF WORK AND PUBLIC

A. Barriers and Lights

During the prosecution of the work, the Contractor shall put up and maintain at all times such barriers and lights as will effectually prevent accidents. The Contractor shall provide suitable barricades, red lights, "danger" or "caution" or "street closed" signs and watchmen at all places where the work causes obstructions to the normal traffic or constitutes in any way a hazard to the public, in accordance with state and local requirements.

B. Smoke Prevention

A strict compliance with ordinances regulating the production and emission of smoke will be required. No open fires will be permitted.

C. Noise

The Contractor shall eliminate noise to as great an extent as practicable at all times. Air compressing plants shall be equipped with silencers and the exhaust of all engines or other power equipment shall be provided with mufflers. In the vicinity of hospitals and schools, special care shall be used to avoid noise or other nuisances. The Contractor shall strictly observe all local regulations and ordinances covering noise control.

D. Access to Public Services

Neither the materials excavated, nor the materials or plant used in the construction of the work shall be so placed as to prevent free access to all fire hydrants, valves or manholes.

E. Dust Prevention

The Contractor shall prevent dust nuisance from his operations or from traffic by keeping the roads and/or construction areas sprinkled with water at all times.

1.10 CUTTING AND PATCHING

- A. The Contractor shall do all cutting, fitting or patching of his portion of the work that may be required to make the several parts thereof join and coordinate in a manner satisfactory to the County and in accordance with the Plans and Specifications. The work must be done by competent workmen skilled in the trade required by the restoration.

1.11 CLEANING

- A. During Construction

During construction of the work, the Contractor shall, at all times, keep the site of the work and adjacent premises as free from material, debris and rubbish as is practicable and shall remove the same from any portion of the site if, in the opinion of the County, such material, debris, or rubbish constitutes a nuisance or is objectionable. The Contractor shall remove from the site all of his surplus materials and temporary structures when no further need therefore develops.

- B. Final Cleaning

At the conclusion of the work, all equipment, tools, temporary structures and materials belonging to the Contractor shall be promptly taken away, and he shall remove and promptly dispose of all water, dirt, rubbish or any other foreign substances.

The Contractor shall thoroughly clean all equipment and materials installed by him and shall deliver such materials and equipment undamaged in a bright, clean, polished and new operating condition.

1.12 MISCELLANEOUS

- A. Protection Against Siltation and Bank Erosion

1. The Contractor shall arrange his operations to minimize siltation and bank erosion on construction sites and on existing or proposed water courses and drainage ditches.
2. The Contractor, at his own expense, shall remove any siltation deposits and correct any erosion problems as directed by the County which results from his construction operations.

- B. Protection of Wetland Areas

The Contractor shall properly dispose of all surplus material, including soil, in accordance with Local, State and Federal regulations. Under no circumstances shall surplus material be disposed of in wetland areas as defined by the Florida Department of Environmental Protection or Southwest Florida Water Management District.

- C. Existing Facilities

The work shall be so conducted to maintain existing facilities in operation insofar as is possible. Requirements and schedules of operations for maintaining existing facilities in service during construction shall be as described in the Special Provisions.

D. Use of Chemicals

All chemicals used during project construction or furnished for project operation, whether herbicide, pesticide, disinfectant, polymer, reactant, or of other classification, must show approval of either EPA or USDA. Use of all such chemicals and disposal of residues shall be in strict conformance with instructions.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01010 SUMMARY OF WORK

PART 1 GENERAL

1.01 WORK COVERED BY CONTRACT DOCUMENTS/REQUIREMENTS INCLUDED

- A. The work included in this contract consists of the construction of
- Approximately 4400 LF of 8- to 12-inch gravity sewer installed via open cut, 550 LF of 8-inch gravity sewer installed via close tolerance HDD, 23 proposed manholes, grout filling and abandoning existing gravity sewer and 25 associated manholes, removing and reconnecting approximately 93 service laterals to the proposed sanitary sewer. Additionally the project includes restoration of sidewalks, driveways, and pavement that will be disturbed by the construction of the proposed improvements.
- B. The Contractor shall furnish all shop drawings, working drawings, labor, materials, equipment, tools, services and incidentals necessary to complete all work required by these Specifications and as shown on the Contract Drawings.
- C. The Contractor shall perform the work complete, in place and ready for continuous service and shall include any repairs, replacements, and/or restoration required as a result of damages caused prior to acceptance by the County.
- D. The Contractor shall furnish and install all materials, equipment and labor which is reasonably and properly inferable and necessary for the proper completion of the work, whether specifically indicated in the Contract Documents or not.

1.02 CONTRACTS

Construct all the Work under a single contract.

1.03 WORK SEQUENCE

- A. All work done under this Contract shall be done with a minimum of inconvenience to the users of the system or facility. The Contractor shall coordinate his work with private property owners such that existing utility services are maintained to all users to the maximum extent possible.
- B. The Contractor shall, if necessary and feasible, construct the work in stages to accommodate the County's use of the premises during the construction period; coordinate the construction schedule and operations with the County's Representative.
- C. The Contractor shall, where feasible, construct the Work in stages to provide for public convenience and not close off public use of any facility until completion of construction to provide alternative usage.

1.04 CONSTRUCTION AREAS

- A. The Contractor shall: Limit his use of the construction areas for work and for storage, to allow for:
1. Work by other Contractors.
 2. County's Use.

3. Public Use.

- B. Coordinate use of work site under direction of County's Representative.
- C. Assume full responsibility for the protection and safekeeping of products under this Contract, stored on the site.
- D. Move any stored products under the Contractor's control, which interfere with operations of the County or separate contractor.
- E. Obtain and pay for the use of additional storage of work areas needed for Contractor operations.

1.05 COUNTY OCCUPANCY

- A. It is assumed that portions of the Work will be completed prior to completion of the entire Work. Upon completion of construction of each individual facility, including testing, if the County, at its sole discretion, desires to accept the individual facility, the Contractor will be issued a dated certificate of completion and acceptance for each individual facility. The County will assume ownership and begin operation of the individual facility on that date and the three-year guaranty period shall commence on that date. The County has the option of not accepting the entire work as a whole until it is completed, tested and approved by the County.

1.06 PARTIAL COUNTY OCCUPANCY

The Contractor shall schedule his operations for completion of portions of the Work, as designated, for the County's occupancy prior to substantial completion of the entire work.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01015 CONTROL OF WORK

PART 1 GENERAL

1.01 WORK PROGRESS

The Contractor shall furnish personnel and equipment which will be efficient, appropriate and adequately sized to secure a satisfactory quality of work and a rate of progress which will insure the completion of the work within the time stipulated in the Contract. If at any time such personnel appears to the County to be inefficient, inappropriate, or insufficient for securing the quality of work required for producing the rate of progress aforesaid, he may order the Contractor to increase the efficiency, change the character, or increase the personnel and equipment and the Contractor shall conform to such order. Failure of the County to give such order shall in no way relieve the Contractor of his obligations to secure the quality of the work and rate of progress required.

1.02 PRIVATE LAND

The Contractor shall not enter or occupy private land outside of easements, except by permission of the affected property owner.

1.03 WORK LOCATIONS

Work shall be located substantially as indicated on the drawings, but the County reserves the right to make such modifications in locations as may be found desirable to avoid interference with existing structures or for other reasons.

1.04 OPEN EXCAVATIONS

- A. All open excavations shall be adequately safeguarded by providing temporary barricades, caution signs, lights and other means to prevent accidents to persons and damage to property. The Contractor shall, at his own expense, provide suitable and safe bridges and other crossings for accommodating travel by pedestrians and workmen. Bridges provided for access to private property during construction shall be removed when no longer required. If the excavation becomes a hazard, or if it excessively restricts traffic at any point, the County may require special construction procedures such as limiting the length of open trench, prohibiting stacking excavated material in the street and requiring that the trench shall not remain open overnight.
- B. The Contractor shall take precautions to prevent injury to the public due to open trenches. All trenches, excavated material, equipment, or other obstacles which could be dangerous to the public shall be barricaded and well lighted at all times when construction is not in progress.

1.05 DISTRIBUTION SYSTEMS AND SERVICES

- A. The Contractor shall avoid interruptions to water, telephone, cable TV, sewer, gas, or other related utility services. He shall notify the County and the appropriate agency well in advance of any requirement for dewatering, isolating, or relocating a section of a utility, so that necessary arrangements may be made.
- B. If it appears that utility service will be interrupted for an extended period, the County may order the Contractor to provide temporary service lines at the Contractor's expense.

Inconvenience of the users shall be kept to the minimum, consistent with existing conditions. The safety and integrity of the systems are of prime importance in scheduling work.

1.06 PROTECTION AND RELOCATION OF EXISTING STRUCTURES AND UTILITIES

- A. The Contractor shall assume full responsibility for the protection of all buildings, structures and utilities, public or private, including poles, signs, services to building utilities, gas pipes, water pipes, hydrants, sewers, drains and electric and telephone cables and other similar facilities, whether or not they are shown on the Drawings. The Contractor shall carefully support and protect all such structures and utilities from injury of any kind. Any damage resulting from the Contractor's operation shall be repaired by the Contractor at his expense.
- B. The Contractor shall bear full responsibility for obtaining locations of all underground structures and utilities (including existing water services, drain lines and sewers). Services to buildings shall be maintained and all costs or charges resulting from damage thereto shall be paid by the Contractor.
- C. Protection and temporary removal and replacement of existing utilities and structures as described in this Section shall be a part of the work under the Contract and all costs in connection therewith shall be included in the unit prices established in the Bid.
- D. If, in the opinion of the County, permanent relocation of a utility owned by the County is required, the County may direct the Contractor, in writing, to perform the work. Work so ordered will be paid for at the Contract unit prices, if applicable, or as extra work as classified in the General Conditions. If relocation of a privately-owned utility is required, the County will notify the utility to perform the work as expeditiously as possible. The Contractor shall fully cooperate with the County and utility and shall have no claim for delay due to such relocation. The Contractor shall notify public utility companies in writing at least 48 hours (excluding Saturdays, Sundays and legal holidays) before excavating near their utilities.

1.07 TEST PITS

Test pits for the purpose of locating underground pipeline or structures in advance of the construction shall be excavated and backfilled by the Contractor immediately after the utility location and the surface shall be restored in a manner equal or better than the original condition. No separate payment will be made.

1.08 CARE AND PROTECTION OF PROPERTY

- A. The Contractor shall be responsible for the preservation of all public and private property and shall use every precaution necessary to prevent damage thereto. If any direct or indirect damage is done to public or private property by or on account of any act, omission, neglect, or misconduct in the execution of the work on the part of the Contractor, such property shall be restored by the Contractor, at his expense, to a condition equal or better to that existing before the damage was done, or he shall make good the damage in another manner acceptable to the County.
- B. All sidewalks which are disturbed by the Contractor's operations shall be restored to their original or better condition by the use of similar or comparable materials. All curbing shall be restored in a condition equal to the original construction and in accordance with the best modern practice.
- C. Along the location of this work, all fences, walks, bushes, trees, shrubbery and other

physical features shall be protected and restored in a thoroughly workmanlike manner unless otherwise shown on the drawings. Fences and other features removed by the Contractor shall be replaced in the location indicated by the County as soon as conditions permit. All grass areas beyond the limits of construction which have been damaged by the Contractor shall be regraded and sodded to equal or exceed original conditions.

- D. Trees close to the work which drawings do not specify to be removed, shall be boxed or otherwise protected against injury. The Contractor shall trim all branches that are liable to damage because of his operations, but in no case shall any tree be cut or removed without prior notification to the County. All injuries to bark, trunk, limbs and roots of trees shall be repaired by dressing, cutting and painting according to approved methods, using only approved tools and materials.
- E. The protection, removal and replacement of existing physical features along the line of work shall be a part of the work under the Contract and all costs in connection therewith shall be included in the unit and/or lump sum prices established under the items in the Bid.

1.09 MAINTENANCE OF TRAFFIC

- A. Open pits, trenches, unpaved streets, debris, or other obstructions due to construction that will prevent the normal flow of traffic during an extended construction stoppage, for any reason, shall be minimized. In the event an extended construction stoppage is found to be necessary, Contractor shall, at his own expense, provide normal traffic flow during extended construction stoppage. Extended stoppage will be defined by the County.
- B. All excavated material shall be placed so that vehicular and pedestrian traffic may be maintained at all times. If the Contractor's operations cause traffic hazards, he shall repair the road surface, provide temporary roadways, erect wheel guards or fences, or take other safety measures which are satisfactory to the County.
- C. Any changes to the traffic pattern require a Traffic Control Plan as detailed in Specification Section 01570.

1.10 WATER FOR CONSTRUCTION PURPOSES

- A. In locations where public water supply is available, the Contractor may purchase water for all construction purposes.
- B. The Contractor shall be responsible for paying for all water tap fees incurred for the purpose of obtaining a potable water service or temporary use meter.

1.11 MAINTENANCE OF FLOW

The Contractor shall at his own cost, provide for the flow of sewers, drains and water courses interrupted during the progress of the work and shall immediately cart away and remove all offensive matter. The entire procedure of maintaining existing flow shall be fully discussed with the County well in advance of the interruption of any flow.

1.12 CLEANUP

During the course of the work, the Contractor shall keep the site of his operations in as clean and neat a condition as is possible. The Contractor shall dispose of all residue resulting from the construction work and at the conclusion of the work, he shall remove and haul away any surplus excavation, broken pavement, lumber, equipment, temporary structures and any other refuse remaining from the construction operations and shall leave the entire site of the work in a neat and orderly condition.

1.13 COOPERATION WITHIN THIS CONTRACT

- A. All firms or person authorized to perform any work under this Contract shall cooperate with the General Contractor and his subcontractors or trades and shall assist in incorporating the work of other trades where necessary or required.
- B. Cutting and patching, drilling and fitting shall be carried out where required by the trade or subcontractor having jurisdiction, unless otherwise indicated herein or directed by the County.

1.14 PROTECTION OF CONSTRUCTION AND EQUIPMENT

- A. All newly constructed work shall be carefully protected from injury in any way. No wheeling or walking or placing of heavy loads on it shall be allowed and all portions injured shall be reconstructed by the Contractor at his own expense.
- B. All structures shall be protected in a manner approved by the County. Should any of the floors or other parts of the structures become heaved, cracked, or otherwise damaged, all such damaged portions of the work shall be completely repaired and made good by the Contractor, at his own expense and to the satisfaction of the County. If, in the final inspection of the work, any defects, faults, or omissions are found, the Contractor shall cause the same to be repaired or removed and replaced by proper materials and workmanship without extra compensation for the materials and labor required. Further, the Contractor shall be fully responsible for the satisfactory maintenance and repair of the construction and other work undertaken herein, for at least the warranty period described in the Contract.
- C. Further, the Contractor shall take all necessary precautions to prevent damage to any structure due to water pressure during and after construction and until such structure is accepted and taken over by the County.

1.15 CONSTRUCTION WITHIN RIGHT-OF-WAY

Where pipe lines are installed within FDOT right-of-way, all excavation backfill and compaction for the purpose of reconstructing roadways and/or adjacent slopes contiguous thereto shall be in accordance with FDOT and/or Manatee County Standards and Specifications, whichever is applicable. Contractor shall satisfy the authorized representative of the FDOT with respect to proper safety procedures, construction methods, required permitting, etc., within the FDOT right-of-way.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01030 SPECIAL PROJECT PROCEDURES

PART 1 GENERAL

1.01 PERMITS

Upon notice of award, the Contractor shall immediately apply for all applicable permits not previously obtained by the County to do the work from the appropriate governmental agency or agencies. No work shall commence until all applicable permits have been obtained and copies delivered to the County. The costs for obtaining all permits shall be borne by the Contractor.

1.02 CONNECTIONS TO EXISTING SYSTEM

The Contractor shall perform all work necessary to locate, excavate and prepare for connections to the existing systems all as shown on the Drawings or where directed by the County. The cost for this work and for the actual connection shall be included in the price bid for the project and shall not result in any additional cost to the County. The termination point for each contract shall be as shown on the Contract Drawings.

1.03 RELOCATIONS

The Contractor shall be responsible for the coordination of the relocation of structures, including but not limited to light poles, power poles, signs, sign poles, fences, piping, conduits and drains that interfere with the positioning of the work as set out on the Drawings. No relocation of the items under this Contract shall be done without approval from the County.

1.04 EXISTING UNDERGROUND PIPING, STRUCTURES AND UTILITIES

- A. The attention of the Contractor is drawn to the fact that during excavation, the possibility exists of the Contractor encountering various utility lines not shown on the Drawings. The Contractor shall exercise extreme care before and during excavation to locate and flag these lines as to avoid damage to the existing lines.
- B. It is the responsibility of the Contractor to ensure that all utility or other poles, the stability of which may be endangered by the close proximity of excavation, are temporarily stayed in position while work proceeds in the vicinity of the pole and that the utility or other companies concerned be given reasonable advance notice.
- C. The existing utility locations are shown without express or implied representation, assurance, or guarantee that they are complete or correct or that they represent a true picture of underground piping to be encountered. The Contractor shall be responsible for notifying the various utility companies to locate their respective utilities in advance of construction in conformance with all requirements provided for in the Florida Underground Facilities Damage Prevention and Safety Act (Florida Statutes, Title XXXIII, Chapter 556).
- D. The existing piping and utilities that interfere with new construction shall be rerouted as shown, specified, or required. Before any piping and utilities not shown on the Drawings are disturbed, the Contractor shall notify the County and shall provide suggestions on how best to resolve the issue.

- E. The Contractor shall exercise care in any excavation to locate all existing piping and utilities. All utilities which do not interfere with complete work shall be carefully protected against damage. Any existing utilities damaged in any way by the Contractor shall be restored or replaced by the Contractor at his expense as directed by the County.
- F. It is intended that wherever existing utilities such as water, sewer, gas, telephone, electrical, or other service lines must be crossed, deflection of the pipe within recommended limits and cover shall be used to satisfactorily clear the obstruction unless otherwise indicated in the Drawings. However, when in the opinion of the County this procedure is not feasible, he may direct the use of fittings for a utility crossing as detailed on the Drawings. No deflections will be allowed in gravity sanitary sewer lines or in existing storm sewer lines.

1.05 SUSPENSION OF WORK DUE TO WEATHER

Refer to FDOT Standards and Specifications Book, Section 8.

1.06 HURRICANE PREPAREDNESS PLAN

- A. Within 30 days of the date of Notice to Proceed, the Contractor shall submit to the County a Hurricane Preparedness Plan. The plan should outline the necessary measures which the Contractor proposes to perform at no additional cost to the County in case of a hurricane warning.
- B. In the event of inclement weather, or whenever County shall direct, Contractor shall ensure that he and his Subcontractors shall carefully protect work and materials against damage or injury from the weather. If, in the opinion of the County, any portion of work or materials is damaged due to the failure on the part of the Contractor or Subcontractors to protect the work, such work and materials shall be removed and replaced at the expense of the Contractor.

1.07 POWER SUPPLY

Electricity as may be required for construction and permanent power supply shall be secured and purchased by the Contractor.

1.08 SALVAGE

Any existing equipment or material, including, but not limited to, valves, pipes, fittings, couplings, etc., which is removed or replaced as a result of construction under this project may be designated as salvage by the County and if so shall be protected for a reasonable time until picked up by the County. Any equipment or material not worthy of salvaging, as directed by the County, shall be disposed of by the Contractor at no additional cost.

1.09 DEWATERING

- A. The Contractor shall do all groundwater pumping necessary to prevent flotation of any part of the work during construction operations with his own equipment.
- B. The Contractor shall pump out water and wastewater which may seep or leak into the excavations for the duration of the Contract and with his own equipment. He shall dispose of this water in an appropriate manner.

1.10 ADDITIONAL PROVISIONS

- A. Before commencing work on any of the existing pipelines, structures or equipment, the Contractor shall notify the County, in writing, at least 10 calendar days in advance of the date he proposes to commence such work.
- B. The Contractor shall provide, at his own expense, all necessary temporary facilities for access to and for protection of, all existing facilities. The County's personnel must have ready access at all times to the existing facilities. The Contractor is responsible for all damage to existing structures, equipment and facilities caused by his construction operations and must repair all such damage when and as ordered by the County.

1.11 CONSTRUCTION CONDITIONS

The Contractor shall strictly adhere to the specific requirements of the governmental unit(s) and/or agency(ies) having jurisdiction over the work. Wherever there is a difference in the requirements of a jurisdictional body and these Specifications, the more stringent shall apply.

1.12 PUBLIC NUISANCE

- A. The Contractor shall not create a public nuisance including but not limited to encroachment on adjacent lands, flooding of adjacent lands, excessive noise or dust.
- B. Sound levels must meet Manatee County Ordinance #87-34, (which amends Ordinance 81-3, The Manatee County Noise Control Ordinance). Sound levels in excess of such ordinance are sufficient cause to have the work halted until equipment can be quieted to these levels. Work stoppage by the County for excessive noise shall not relieve the Contractor of the other portions of this specification.
- C. No extra charge may be made for time lost due to work stoppage resulting from the creation of a public nuisance.

1.13 WARRANTIES

- A. All material supplied under these Specifications shall be warranted by the Contractor and the manufacturers for a period of three (3) years. Warranty period shall commence on the date of County acceptance.
- B. The material shall be warranted to be free from defects in workmanship, design and materials. If any part of the system should fail during the warranty period, it shall be replaced at no expense to the County. All material and installation costs shall be 100% borne by the Contractor.
- C. The manufacturer's warranty period shall run concurrently with the Contractor's warranty or guarantee period. No exception to this provision shall be allowed. The Contractor shall be responsible for obtaining warranties from each of the respective suppliers or manufacturers for all the material specified under these contract specifications,
- D. In the event that the manufacturer is unwilling to provide a three-year warranty commencing at the time of County acceptance, the Contractor shall obtain from the manufacturer a four (4) year warranty starting at the time of equipment delivery to the job site. This four-year

warranty shall not relieve the Contractor of the three-year warranty starting at the time of County acceptance of the equipment.

1.14 FUEL STORAGE & FILLING

- A. If the contractor is storing fuel on site, or doing his own fuel filling of portable equipment (other than hand-held equipment), he is responsible for any required response, clean-up or reporting required, at no additional cost to the county.
- B. The Contractor shall prepare and submit a fuel storage / spill abatement plan prior to start of construction if required.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01045 CUTTING AND PATCHING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall be responsible for all cutting, fitting and patching, including excavation and backfill, required to complete the work or to:
 - 1. Make its several parts fit together properly.
 - 2. Uncover portions of the work to provide for installation of ill-timed work.
 - 3. Remove and replace defective work.
 - 4. Remove and replace work not conforming to requirements of Contract Documents.
 - 5. Provide penetrations of non-structural surfaces for installation of piping and electrical conduit.

PART 2 PRODUCTS

2.01 MATERIALS

Comply with specifications and standards for each specific product involved.

PART 3 EXECUTION

3.01 INSPECTION

- A. Inspect existing conditions of project, including elements subject to damage or to movement during cutting and patching.
- B. After uncovering work, inspect conditions affecting installation of products, or performance of work.
- C. Report unsatisfactory or questionable conditions to County. Do not proceed with work until County has provided further instructions.

3.02 PREPARATION

- A. Provide adequate temporary support as necessary to assure structural value to integrity of affected portion of work.
- B. Provide devices and methods to protect other portions of project from damage.
- C. Provide protection from elements for that portion of the project which may be exposed by cutting and patching work and maintain excavations free from water.

3.03 PERFORMANCE

- A. Execute cutting and demolition by methods which will prevent damage to other work and will provide proper surfaces to receive installation of repairs.
- B. Execute excavating and backfilling by methods which will prevent settlement or damage to other work.

- C. Fit and adjust products to provide a finished installation to comply with specified products, functions, tolerances and finishes.
- D. Restore work which has been cut or removed; install new products to provide completed work in accordance with the requirements of the Contract Documents.
- E. Replace surfaces airtight to pipes, sleeves, ducts, conduit and other penetrations through surfaces.
- F. Refinish entire surfaces as necessary to provide an even finish to match adjacent finishes.

END OF SECTION

SECTION 01050 FIELD ENGINEERING AND SURVEYING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall provide and pay for field surveying service required for the project.
- B. The Contractor shall furnish and set all necessary stakes to establish the lines and grades as shown on the Contract Drawings and layout each portion of the Work of the Contract.

1.02 QUALIFICATION OF SURVEYOR AND ENGINEER

All construction staking shall be conducted by or under the supervision of a Florida Registered Professional Surveyor and Mapper. The Contractor shall be responsible for the layout of all such lines and grades, which will be subject to verification by the County.

1.03 SURVEY REFERENCE POINTS

- A. Existing basic horizontal and vertical control points for the Project are designated on the Contract Drawings.
- B. Locate and protect all survey monumentation, property corners and project control points prior to starting work and preserve all permanent reference points during construction. All costs associated with the replacement of all survey monumentation, property corners and project control points shall be borne by the Contractor.
- C. Make no changes or relocations without prior written notice to County.
- D. Report to County when any reference point is lost or destroyed, or requires relocation because of necessary changes in grades or locations.
- E. Require surveyor to replace project control points which may be lost or destroyed.
- F. Establish replacements based on original survey control.

1.04 PROJECT SURVEY REQUIREMENTS

The Contractor shall establish temporary bench marks as needed, referenced to data established by survey control points.

1.05 RECORDS

The Contractor shall employ a Professional Engineer or Surveyor registered in the State of Florida to verify survey data and properly prepare record drawings per Specification Section 01720.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01090 REFERENCE STANDARDS

PART 1 GENERAL

1.01 REQUIREMENTS

Abbreviations and acronyms used in Contract Documents to identify reference standards.

- A. Application: When a standard is specified by reference, comply with requirements and recommendations stated in that standard, except when requirements are modified by the Contract Documents, or applicable codes established stricter standards.
- B. Publication Date: The most recent publication in effect on the date of issue of Contract Documents, except when a specific publication date is specified.

1.02 ABBREVIATIONS, NAMES AND ADDRESSES OR ORGANIZATIONS

Obtain copies of reference standards direct from publication source, when needed for proper performance of work, or when required for submittal by Contract Documents.

AA	Aluminum Association 818 Connecticut Avenue, N.W. Washington, DC 20006
AASHTO	American Association of State Highway and Transportation Officials 444 North Capital Street, N.W. Washington, DC 20001
ACI	American Concrete Institute Box 19150 Reford Station Detroit, MI 48219
AI	Asphalt Institute Asphalt Institute Building College Park, MD 20740
AISC	American Institute of Steel Construction 1221 Avenue of the Americas New York, NY 10020
AISI	American Iron and Steel Institute 1000 16th Street NW Washington, DC 20036
ANSI	American National Standards Institute 1430 Broadway New York, NY 10018
ASHRAE	American Society of Heating, Refrigerating and Air Conditioning Engineers 1791 Tullie Circle, N.E. Atlanta, GA 30329

ASME American Society of Mechanical Engineers
345 East 47th Street
New York, NY 10017

ASTM American Society for Testing and Materials
1916 Race Street
Philadelphia, PA 19103

AWWA American Water Works Association
6666 West Quincy Avenue
Denver, CO 80235

AWS American Welding Society
2501 N.W. 7th Street
Miami, FL 33125

CRSI Concrete Reinforcing Steel Institute
180 North LaSalle Street, Suite 2110
Chicago, IL 60601

FDEP Florida Department of Environmental Protection
3900 Commonwealth Blvd.
Tallahassee, Florida 32399

FDOT Florida Department of Transportation Standards Specifications for Road and
Bridge Construction
Maps & Publication Sales - Mail Station 12
605 Suwannee St.
Tallahassee, FL 32399-0450

FS Federal Specification
General Services Administration Specifications and Consumer Information
Distribution Section (WFSIS)
Washington Navy Yard, Bldg. 197
Washington, DC 20407

MCPW UTIL STD Manatee County Utility Engineering
4410-B 66th St. W.
Bradenton, FL 34210

MLSFA Metal Lath/Steel Framing Association
221 North LaSalle Street
Chicago, IL 60601

MMA Monorail Manufacturer's Association
1326 Freeport Road
Pittsburgh, PA 15238

NAAMM National Association of Architectural Metal Manufacturers
221 North LaSalle Street
Chicago, IL 60601

NEMA National Electrical Manufacturer's Assoc.

2101 L Street N.W.
Washington, DC 20037

OHSA Occupational Safety and Health Assoc.
5807 Breckenridge Pkwy., Suite A
Tampa, FL 33610-4249

PCA Portland Cement Association
5420 Old Orchard Road
Skokie, IL 20076

PCI Prestressed Concrete Institute
20 North Wacker Drive
Chicago, IL 60606

SDI Steel Door Institute
712 Lakewood Center North
Cleveland, OH 44107

SMACNA Sheet Metal and Air Conditioning Contractor's National Association
8224 Old Court House Road
Vienna, VA 22180

SSPC Steel Structures Painting Council
402 24th Street, Suite 600
Pittsburgh, PA 15213

SWFWMD Southwest Florida Water Management District
2379 Broad Street
Brooksville, FL 34604-6899

UL Underwriter's Laboratories, Inc.
333 Pfingston Road
Northbrook, IL 60062

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01150 MEASUREMENT AND PAYMENT

PART 1 GENERAL

1.01 SCOPE

- A. The scope of this section of the Contract Documents is to further define the items included in each Bid Item in the Bid Form section of the Contract Documents. Payment will be made based on the specified items included in the description in this section for each bid item.
- B. All contract prices included in the Bid Form section will be full compensation for all shop drawings, working drawings, labor, materials, tools, equipment and incidentals necessary to complete the construction as shown on the Drawings and/or as specified in the Contract Documents to be performed under this Contract. Actual quantities of each item bid on a unit price basis will be determined upon completion of the construction in the manner set up for each item in this section of the Specifications. Payment for all items listed in the Bid Form will constitute full compensation for all work shown and/or specified to be performed under this Contract.

1.02 ESTIMATED QUANTITIES

The quantities shown are approximate and are given only as a basis of calculation upon which the award of the Contract is to be made. The County does not assume any responsibility for the final quantities, nor shall the Contractor claim misunderstanding because of such estimate of quantities. Final payment will be made only for satisfactorily completed quantity of each item.

1.03 WORK OUTSIDE AUTHORIZED LIMITS

No payment will be made for work constructed outside the authorized limits of work.

1.04 MEASUREMENT STANDARDS

Unless otherwise specified for the particular items involved, all measurements of distance shall be taken horizontally or vertically.

1.05 AREA MEASUREMENTS

In the measurement of items to be paid for on the basis of area of finished work, the lengths and/or widths to be used in the calculations shall be the final dimensions measured along the surface of the completed work within the neat lines shown or designated.

1.06 LUMP SUM ITEMS

Where payment for items is shown to be paid for on a lump sum basis, no separate payment will be made for any item of work required to complete the lump sum items. Lump sum contracts shall be complete, tested and fully operable prior to request for final payment. Contractor may be required to provide a break-down of the lump sum totals.

1.07 UNIT PRICE ITEM

Separate payment will be made for the items of work described herein and listed on the Bid Form. Any related work not specifically listed, but required for satisfactory completion of the

work shall be considered to be included in the scope of the appropriate listed work items.

No separate payment will be made for the following items and the cost of such work shall be included in the applicable pay items of work. Final payments shall not be requested by the Contractor or made by the County until as-built (record) drawings have been submitted and approved by the County.

1. Shop Drawings, Working Drawings.
2. Clearing, grubbing and grading except as hereinafter specified.
3. Trench excavation, including necessary pavement removal and rock removal, except as otherwise specified.
4. Dewatering and disposal of surplus water.
5. Structural fill, backfill, and grading.
6. Replacement of unpaved roadways and shrubbery plots.
7. Cleanup and miscellaneous work.
8. Foundation and borrow materials, except as hereinafter specified.
9. Testing and placing system in operation.
10. Any material and equipment required to be installed and utilized for the tests.
11. Pipe, structures, pavement replacement, asphalt and shell driveways and/or appurtenances included within the limits of lump sum work, unless otherwise shown.
12. Maintaining the existing quality of service during construction.
13. Maintaining or detouring of traffic.
14. Appurtenant work as required for a complete and operable system.
15. Seeding and hydromulching.
16. As-built Record Drawings.

BID ITEM NO.1 - MOBILIZATION

Measurement and payment for this Bid Item shall include full compensation for the required 100 percent (100%) Performance Bond, 100 Percent (100%) Payment Bond, all required insurance for the project and the Contractor's mobilization and demobilization costs as shown in the Bid Form. Mobilization includes, but it not limited to: preparation and movement of personnel, equipment, supplies and incidentals such as safety and sanitary supplies/ facilities

Payment for mobilization shall not exceed 10 percent (10%) of the total Contract cost unless the Contractor can prove to the County that his actual mobilization cost exceeds 10 percent (10%).

Partial payments for this Bid Item will be made in accordance with the following schedule:

Percent of Original Contract Amount:	Percent Allowable Payment of Mobilization/Demobilization Bid Item Price:
5	25
10	35
25	45
50	50
75	75
100	100

These payments will be subject to the standard retainage provided in the Contract. Payment

of the retainage will be made after completion of the work and demobilization.

BID ITEM NO. 2 – MAINTENANCE OF TRAFFIC

Payment for all work included in this Bid Items will be made at the applicable Contract lump sum bid for the maintenance of traffic during the construction of the proposed improvements. Payment shall represent full compensation for all labor, materials, necessary equipment, coordination, and incidentals necessary to safely complete the work while complying to FDOT Design Standards Index 102-600 Series, ready for approval and acceptance by the County.

Measurement for periodic payments of this lump sum bid item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor In accordance with the Contract Documents.

BID ITEM NO. 3 – EROSION AND SEDIMENT CONTROL

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the lump sum price bid for erosion and sediment control, including permitting if required, coordination with federal, state and local agencies and all equipment and manpower necessary to comply with necessary agencies.

Measurement for periodic payments of this lump sum bid item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor in accordance with the Contract Documents.

BID ITEM NO. 4 - CLEARING AND GRUBBING

Payment for all work included under this Bid Item shall be quantified by the Contractor and paid for as a lump sum amount for all of the areas that will require clearing and grubbing for the pipe installation and in accordance with the plans and specifications. Clearing and grubbing shall include the removal and disposal of trees, tree roots, rock, abandoned pipe and other features not part of the proposed improvements. The Contractor shall include the cost of any and all permitting required for the burning or disposal of removed trees and vegetation.

Unless otherwise indicated herein these documents or in the construction plans, clearing and grubbing includes a ten (10) foot strip along the pipeline and service lateral routes (within private property and within Right-of-Way). The Contractor will be responsible for making their own determination as to the quantity of clearing and grubbing.

BID ITEM NO. 5 – PRECONSTRUCTION VIDEO

Payment for all work included in this Bid Items will be made at the applicable Contract lump sum bid for the preconstruction video of the existing site conditions including private property where sanitary service lateral construction is necessary. Payment shall represent full compensation for all labor, materials, necessary equipment, and incidentals necessary to complete the work, ready for approval and acceptance by the County.

Measurement for periodic payments of this lump sum bid item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor In accordance with the Contract Documents.

BID ITEM NO. 6 - PROJECT SIGNS

Payment for all work included in this Bid Item will be made at the applicable Contract lump sum bid for the necessary signage required during construction. At least two (2) project signs should be used per project. Payment shall represent full compensation for all labor, materials, necessary equipment, and incidentals necessary to complete the work, ready for approval and acceptance by the County.

Measurement for periodic payments of this lump sum bid item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor In accordance with the Contract Documents.

BID ITEM NO. 7 – RECORD DRAWINGS

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the lump sum price bid for as-built record drawings or any other required certifications to put proposed project into service. All items are subject to approval by the Engineer and the County.

Measurement for periodic payments of this lump sum bid item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor In accordance with the Contract Documents and Specifications Section: 01720.

BID ITEM - PVC SDR 26 SANITARY SEWER MAIN (OPEN CUT)

Payment for all work included under this Bid Item shall be made at the applicable Contract unit price bid per linear foot for furnishing and installing the listed diameter sanitary sewer main at the depths shown on the Contract Drawings and designated on the Bid Form for the actual length installed. Measurement for the installed length shall be measured horizontally from center to center of manholes.

Additionally, CCTV inspection, recording and testing of the sewer main while County Inspector is present after construction and additional testing per specification section 02623 shall be included in this Bid Item. Pipe deflection shall not deviate by more than 1-inch from the design line.

Payment shall represent full compensation for all labor, excavation, including rock as necessary, dewatering, pipe, bedding, materials, backfill, compaction, sheeting, CCTV inspection and testing and equipment and all other appurtenances and incidentals required or specified to complete the gravity sewer main. All compensation for adjustments to bring existing water meter boxes, fire hydrants, and valve boxes to final grade shall be included. No additional compensation will be made by the County for excavation performed below the bottom of the pipe, for rock removal or materials or for repair of any trench settlement. Class of pipe to be as specified or as listed on the Bid Form.

BID ITEM	DESCRIPTION	UNITS
8	12" PVC SDR 26 SANITARY SEWER MAIN (OPEN CUT)	LF
9	8" PVC SDR 26 SANITARY SEWER MAIN (OPEN CUT)	LF

BID ITEM - PVC C900 DR 25 SANITARY SEWER MAIN (OPEN CUT)

Payment for all work included under this Bid Item shall be made at the applicable Contract unit

price bid per linear foot for furnishing and installing the listed diameter sanitary sewer main at the depths shown on the Contract Drawings and designated on the Bid Form for the actual length installed. Measurement for the installed length shall be measured horizontally from center to center of manholes.

Additionally, CCTV inspection, recording and testing of the sewer main while County Inspector is present after construction and additional testing per specification section 02623 shall be included in this Bid Item. Pipe deflection shall not deviate by more than 1-inch from the design line.

Payment shall represent full compensation for all labor, excavation, including rock as necessary, dewatering, pipe, bedding, materials, backfill, compaction, sheeting, CCTV inspection and testing and equipment. All compensation for adjustments to bring existing water meter boxes, fire hydrants, and valve boxes to final grade shall be included. Also included shall be the recording of their location by station and offset method and all other appurtenances and incidentals required or specified to complete the gravity sewer main. No additional compensation will be made by the County for excavation performed below the bottom of the pipe, for rock removal or materials or for repair of any trench settlement. Class of pipe to be as specified or as listed on the Bid Form.

BID ITEM	DESCRIPTION	UNITS
10	10" PVC C900 DR25 SANITARY SEWER MAIN (OPEN CUT)	LF
11	8" PVC C900 DR25 SANITARY SEWER MAIN (OPEN CUT)	LF

BID ITEM NO. 12 - 8" PVC C900 DR 18 CERTALOK (CLOSE TOLERANCE HDD)

Payment for all work included under this Bid Item shall be made at the Contract unit price bid per the schedule of prices for furnishing and installing the 8-inch PVC C900 DR 18 Certalok (10 FT Segments) by close tolerance horizontal directional drill and associated connection pipe sections as shown on the Contract Drawings. Restoration of any disturbed areas, from either drill rigs, equipment, pressure relief and pilot holes, shall be included as part of this Bid Item.

Additionally, CCTV inspection, recording and testing of the sewer main while County Inspector is present after construction and additional testing per specification section 02623 shall be included in this Bid Item. Pipe deflection shall not deviate by more than 1-inch from the design line.

Measurement and Payment shall be made for the actual length of the listed diameter pipe close tolerance directional drilled and installed including final connections to manholes, and will represent full compensation for all labor, materials, excavation, including rock, dewatering, bedding, backfill, compaction, CCTV inspection and testing, pipe restraints, mud trailer, and equipment required to complete these Bid Items for a fully operational sewer system. Restoration of relief holes conforming to the Contract specifications and FDOT permit shall be included in this bid item. No additional compensation shall be made for excavation below the bottom of the pipe, for rock removal or bedding and backfill material, or for repair of any trench settlement. No additional compensation shall be made for extensive dewatering or any water treatment services or equipment that may be required for contaminated groundwater.

BID ITEM NO. 13 - CAP AND REPLACE SERVICE LATERAL (RIGHT OF WAY) - 8-inch x 6-inch SDR 26 WYE

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price bid for each service lateral replacement from main sewer line to the property line as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation at all depths and lengths to cut, cap and connect existing service lateral up to right of way and all associated appurtenances to construct proposed service lateral from property line to proposed sewer main as shown on the Contract Drawings.

Replaced service laterals shall comply to Contract Documents including Manatee County Standard Details. A cleanout shall be installed in conjunction with all service later replacements at the back of right of way and at any change in direction as specified in Contract Documents. All service laterals shall be single service. Service laterals that are double services shall be converted to two (2) single service laterals as shown on Contract Documents. This Bid Item shall represent full compensation, including but not limited to "8-inch SDR-26 x 6-inch SDR-26" service Wye, fittings, plugs, pad including cast iron ring and cover, vertical extension, concrete encasement, 2" PVC Pipe (painted green) where applicable, 6" SDR-26 Pipe, cleanouts and associated appurtenances as shown on Contract Documents and Manatee County Standard Details. No payment for service lateral construction or connection on private property, driveway rehabilitation, or driveway restoration shall be made under this Bid Item.

All service locations shown on the Contract Drawings are approximate and it shall be the responsibility of the Contractor to locate existing service laterals and determine, subject to approval by the County, the best location for each service lateral and cleanout. Locations of all single service connections at the main line sewer and at the property line shall be recorded on the as-built drawings per specifications section 01720 and shall be furnished to County by the Contractor.

Each service lateral replacement in right of way shall include, but not limited all labor, materials, equipment, fittings, connections, excavation, including rock, bedding, backfill, compaction, testing and disinfection, temporary bypassing, and equipment required to complete these Bid Items in accordance with Contract Documents.

BID ITEM NO. 14 - CAP AND REPLACE SERVICE LATERAL (RIGHT OF WAY) - 8-inch x 6-inch PVC C900 WYE (6" BRANCH TO FIT SDR 26 SERVICE)

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price bid for each service lateral replacement from main sewer line to the property line as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation at all depths and lengths to cut, cap and connect existing service lateral up to right of way and all associated appurtenances to construct proposed service lateral from property line to proposed sewer main as shown on the Contract Drawings.

Replaced service laterals shall comply to Contract Documents including Manatee County Standard Details. A cleanout shall be installed in conjunction with all service later replacements at the back of right of way and at any change in direction as specified in Contract Documents. All service laterals shall be single service. Service laterals that are double services shall be converted to two (2) single service laterals as shown on Contract Documents. This Bid Item shall represent full compensation, including but not limited to "8-inch C900 x 6-inch SDR-26" service Wye, fittings, plugs, pad including cast iron ring and cover, vertical extension, concrete encasement, 2" PVC Pipe (painted green) where applicable, 6" SDR-26 Pipe, cleanouts and associated appurtenances as shown on Contract Documents and Manatee County Standard Details. No payment for service lateral construction or connection on private property, driveway rehabilitation or driveway restoration shall be made under this Bid Item.

All service locations shown on the Contract Drawings are approximate and it shall be the responsibility of the Contractor to locate existing service laterals and determine, subject to approval by the County, the best location for each service lateral and cleanout. Locations of all single service connections at the main line sewer and at the property line shall be recorded on the as-built drawings per specifications section 01720 and shall be furnished to County by the Contractor.

Each service lateral replacement in right of way shall include, but not limited all labor, materials, equipment, fittings, connections, excavation, including rock, bedding, backfill, compaction, testing and disinfection, temporary bypassing, and equipment required to complete these Bid Items in accordance with Contract Documents.

BID ITEM NO. 15 - CAP AND REPLACE SERVICE LATERAL (RIGHT OF WAY) - 12-inch x 6-inch SDR 26 WYE

Payment for all work included in this Bid Item shall be made at the applicable Contract unit price bid for each service lateral replacement from main sewer line to the property line as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation at all depths and lengths to cut, cap and connect existing service lateral up to right of way and all associated appurtenances to construct proposed service lateral from property line to proposed sewer main as shown on the Contract Drawings.

Replaced service laterals shall comply to Contract Documents including Manatee County Standard Details. A cleanout shall be installed in conjunction with all service later replacements at the back of right of way and at any change in direction as specified in Contract Documents. All service laterals shall be single service. Service laterals that are double services shall be converted to two (2) single service laterals as shown on Contract Documents. This Bid Item shall represent full compensation, including but not limited to "12-inch SDR-26 x 6-inch SDR-26" service Wye, fittings, plugs, pad including cast iron ring and cover, vertical extension, concrete encasement, 2" PVC Pipe (painted green) where applicable, 6" SDR-26 Pipe, cleanouts and associated appurtenances as shown on Contract Documents and Manatee County Standard Details. No payment for service lateral construction or connection on private property, driveway rehabilitation or driveway restoration shall be made under this Bid Item.

All service locations shown on the Contract Drawings are approximate and it shall be the responsibility of the Contractor to locate existing service laterals and determine, subject to approval by the County, the best location for each service lateral and cleanout. Locations of all single service connections at the main line sewer and at the property shall be recorded on the as-built drawings per specifications section 01720 and shall be furnished to County by the Contractor.

Each service lateral replacement in right of way shall include, but not limited all labor, materials, equipment, fittings, connections, excavation, including rock, bedding, backfill, compaction, testing and disinfection, temporary bypassing, and equipment required to complete these Bid Items in accordance with Contract Documents.

BID ITEM NO. 16 - CONSTRUCT AND CONNECT SERVICE LATERAL (PRIVATE PROPERTY)

Payment for work included under this Bid Item shall be made at the Contract unit price bid for each (length up to 100-LF) property service lateral piping with associated fittings including cut, cap, and connecting on private property. Payment shall represent full compensation for 6-inch

diameter SDR-26 pipe service lateral construction (up to 100-LF) on private property, this shall be measured from right-of-way cleanout as stated in Contract Documents to shortest point of connection to existing service lateral as shown on Contract Documents or as alternately requested by the property owner with approval from County, including all bends, fittings, cleanouts, WYE's, sleeves, all other appurtenances, all labor, equipment, and materials necessary to complete each service connection on private property. This Bid Item shall include cleanouts at all changes in direction on private property. The elevation depth below grade as shown in the service connection detail on the Contract Drawings for the lateral invert shall be maintained by the Contractor installing the sanitary sewer service line.

All service locations shown on the Contract Drawings are approximate and it shall be the responsibility of the Contractor to contact all homeowners for locating the owner's existing service lateral and determine, subject to approval by the County, the best locations and depth for each service lateral. No payment for construction in right-of-way shall be made under this Bid Item. A licensed plumber shall be subcontracted to work on private property sewer service. EOR will obtain Right-of-Entry Agreement, Contractor to confirm agreement is in place with EOR before any work on private property is performed.

All restoration on private property shall be included in this bid item including fencing, landscaping, irrigation, water service, shell/rock, sod, concrete pavers, pavement, etc. Contractor shall coordinate with the homeowner prior to construction of the private lateral and shall be included in the bid price.

Also included in payment shall be all excavation, including rock as necessary, bedding, backfill, compaction, testing, CCTV, extensions, caps, and all restoration as shown on the Contract Drawings, furnished and installed watertight, ready for approval by the County.

BID ITEM NO. 17- CONSTRUCT SERVICE LATERAL (PRIVATE PROPERTY)

Payment for work included under this Bid Item shall be made at the Contract linear feet price bid for each additional linear feet of 6-inch diameter SDR-26 service lateral pipe which exceeds length of 100-LF, measured from back of right-of-way cleanout as shown on Contract Documents to shortest point of connection to existing service lateral as shown on Contract Documents or as alternately requested by the property owner and reviewed by County. This Bid Item shall account for any additional lengths of service laterals over 100-LF, measured from right-of-way cleanout to shortest point of connection and approved by Manatee County. Payment for this Bid Item shall include all appurtenances including all labor, equipment, and materials necessary to construct additional service lateral length over 100-LF on private property. The elevation depth below grade as shown in the service connection detail on the Contract Drawings for the lateral invert shall be maintained by the Contractor installing the sanitary sewer service line. No payment for construction in right-of-way, connection to existing lateral on private property, or linear feet of 6-inch diameter SDR-26 on private property under 100-LF shall be made under this Bid Item.

All service locations shown on the Contract Drawings are approximate and it shall be the responsibility of the Contractor to contact all homeowners for locating the owner's existing service lateral and determine, subject to approval by the County, the best locations and depth for each service lateral. Additional service lateral length shall be approved by County prior to any construction of additional service laterals. A licensed plumber shall be subcontracted to work on private property sewer service. EOR will obtain Right-of-Entry Agreement, Contractor to confirm agreement is in place with EOR before any work on private property is performed..

All restoration on private property shall be included in this bid item including fencing,

landscaping, irrigation, water service, shell/rock, sod, concrete pavers, pavement, etc. Contractor shall coordinate with the homeowner prior to construction of the private lateral and shall be included in the bid price.

Also included in payment shall be all excavation, including rock as necessary, bedding, backfill, compaction, testing, extensions, caps and all restoration as shown on the Contract Drawings, furnished and installed watertight, ready for approval by the County acceptance.

BID ITEM NO. 18 - CUT IN MANHOLE

Payment for work under this Bid Item shall be made at the Contract unit price bid for each cut in manhole including, cast in-place base slab and section, pre-cast risers, gaskets, cone, ring, and cover, furnished and installed including heavy duty composite frame and locking cover, frame and cover shall have min. three (3) 316 SS locking bolts, construction of inverts, sealing of lift holes, rainwater protector, waterstops, grade adjustment rings, manhole boot connectors, bench, plugs, etc. Included in this bid item is the removal of pipe within the manhole required to transfer flows from the existing gravity system to the new gravity system. South invert of cut in MH #1 on 11th Street South shall temporarily receive flow from existing sewer system (south of 11th Street South) until proposed system (Phase 2) is complete and approved by Manatee County. Upon approval from County, south invert shall be plugged per Contract Documents. All repair work, caps, and grout shall be included in this Bid item.

Additionally, CCTV inspection, recording and testing of the sewer main while County Inspector is present before any excavation over the pipe and after construction shall be included in this Bid Item. Pipe deflection shall not deviate by more than 1-inch from the design line.

Measurement shall be for each manhole installed complete and accepted. Payment shall be made per unit price for the category of depth as determined by the proposed rim and invert. All stubs and plugs shown or called for on the Contract Drawings shall be included in the unit price bid for manholes. Excavation, including rock as necessary, bedding, backfill, dewatering, sheeting, testing and any and all other items necessary for a completed system in accordance with the Contract Documents shall be included. Payment shall represent full compensation for all labor, materials, equipment and incidental items necessary to complete each concrete manhole structure, ready for approval and service by the County.

BID ITEM NO. 19 - PRECAST POLYMER CONCRETE MANHOLE

Payment for work under this Bid Item shall be made at the Contract unit price bid for each precast polymer concrete manhole furnished and installed including heavy duty composite frame and locking cover, frame and cover shall have min. three (3) 316 SS locking bolts, construction of inverts, sealing of lift holes, rainwater protector, grade adjustment rings, joint sealants, pipe connection to manhole, manhole boot connectors, polymer bench and polymer grout, concrete ballast, etc.

Additionally, CCTV inspection, recording and testing of the sewer main while County Inspector is present after construction shall be included in this Bid Item. Pipe deflection shall not deviate by more than 1-inch from the design line.

Measurement shall be for each manhole installed complete and accepted. Payment shall be made per unit price for the category of depth as determined by the proposed rim and invert. All stubs and plugs shown or called for on the Contract Drawings shall be included in the unit price bid for manholes. Excavation, including rock as necessary, bedding, backfill, dewatering, sheeting, CCTV inspection, testing and equipment and any and all other items necessary for

a completed system in accordance with the Contract Documents shall be included. Payment shall represent full compensation for all labor, materials, equipment and incidental items necessary to complete each polymer concrete manhole structure, ready for approval and service by the County.

BID ITEM NO. 20 - STANDARD PRECAST CONCRETE MANHOLE

Payment for work under this Bid Item shall be made at the Contract unit price bid for each precast concrete manhole furnished and installed including heavy duty composite frame and locking cover, frame and cover shall have min. three (3) 316 SS locking bolts, construction of inverts, drop connections if applicable, sealing of lift holes, rainwater protector, grade adjustment rings, pipe connection to manhole, manhole boot connectors, concrete ballast, bench, etc.

Additionally, CCTV inspection, recording and testing of the sewer main while County Inspector is present after construction shall be included in this Bid Item. Pipe deflection shall not deviate by more than 1-inch from the design line.

Measurement shall be for each manhole installed complete and accepted. Payment shall be made per unit price for the category of depth as determined by the proposed rim and invert. All stubs and plugs shown or called for on the Contract Drawings shall be included in the unit price bid for manholes. Excavation, including rock as necessary, bedding, backfill, dewatering, sheeting, CCTV inspection, testing and equipment and any and all other items necessary for a completed system in accordance with the Contract Documents shall be included. Payment shall represent full compensation for all labor, materials, equipment and incidental items necessary to complete each precast concrete manhole structure, ready for approval and service by the County.

BID ITEM NO. 21 - PRECAST POLYMER CONCRETE DROP MANHOLE

Payment for work under this Bid Item shall be made at the Contract unit price bid for each precast concrete drop manhole furnished and installed including heavy duty composite frame and locking cover, frame and cover shall have min. three (3) 316 SS locking bolts, construction of inverts, drop connections and associated fitting, sealing of lift holes, rainwater protector, grade adjustment rings, pipe connection to manhole, manhole boot connectors, pipe fittings, concrete encasement, concrete ballast, and pipe penetrations, etc.

Additionally, CCTV inspection, recording and testing of the sewer main while County Inspector is present after construction shall be included in this Bid Item. Pipe deflection shall not deviate by more than 1-inch from the design line.

Measurement shall be for each manhole installed complete and accepted. Payment shall be made per unit price for the category of depth as determined by the proposed rim and invert. All stubs and plugs shown or called for on the Contract Drawings shall be included in the unit price bid for manholes. Excavation, including rock as necessary, bedding, backfill, dewatering, sheeting, CCTV inspection, testing and equipment and any and all other items necessary for a completed system in accordance with the Contract Documents shall be included. Payment shall represent full compensation for all labor, materials, equipment and incidental items necessary to complete each concrete manhole structure, ready for approval and service by the County.

BID ITEM NO. 22 - CONNECTION TO EXISTING 4" FORCE MAIN, MANHOLE TIE IN, BELOW GRADE, AIR RELEASE VALVE, FITTINGS, AND ASSOCIATED APPURTENANCES

Payment for all work included, but is not limited to, under these Bid Items shall be made at the applicable Contract lump sum price bid for the force main connection, manhole tie in, below grade air release valve, fittings, and associated appurtenances. Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the lump sum price bid for all labor, below grade air release valve and associated appurtenances and precast polymer concrete ARV manhole, PVC C900 DR 18 pipe, P-trap and drop assembly PVC C907 fittings, ductile iron sleeve couplings as necessary, mechanical joint restraints, demolition of no more than 20-LF of 4-inch force main, blue fluoropolymer coated high-strength low alloy steel or uncoated 316 stainless steel hardware, grout, excavation, dewatering, bedding, backfill, compaction, testing, equipment, bypassing/pumper trucks, the temporary shutdown of the existing lift station to connect the proposed force main, and all temporary line stops, restraints, or thrust blocks for force main connections. All material and labor to connect the proposed 4" force main to the proposed manhole per County details on the Contract shall be included. Contractor shall make provisions to have an adequate number of septage trucks available to make the necessary force main connections.

Coordinate with Nick Wagner (Lift Station Superintendent) with Manatee County for shutdown of Lift Stations. At least four days' notice needs to be provided to Nick to coordinate shutdown. Phone Number: 941-792-8811 EXT 5377. Connection must also be made outside of peak hours between 9PM and 5AM.

Measurement for periodic payments of this item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor in accordance with the Contract Documents.

BID ITEM NO. 23 - CONNECTION TO EXISTING LIFT STATION WET WELL

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation for the proposed gravity main connection to the existing wet well. Payment for work under this Bid Item will be made for each connection as shown in the Contract Documents and shall represent full compensation for all labor, material, fittings, jack-in manhole boot per ASTM C-923, wet well liner repair, preparation, cleaning, excavation, dewatering, bedding, backfill, compaction, grout, testing, and equipment to complete this Bid Item in accordance with the Contract Documents.

Coordinate with Nick Wagner (Lift Station Superintendent) with Manatee County for shutdown of Lift Stations. At least four days' notice needs to be provided to Nick to coordinate shutdown. Phone Number: 941-792-8811 EXT 5377. Connection must also be made outside of peak hours between 9PM and 5AM.

BID ITEM NO. 24 - CONNECTION TO EXISTING MANHOLE

Payment for all work included in these Bid Items shall be made at the applicable Contract unit price bid per each manhole connection. Payment shall represent full compensation for all labor, materials, and equipment. This bid item includes, but is not limited to, connecting the new main to existing manholes, rebuilding the existing bench, coring as necessary, all necessary grout required to seal the manhole connection, and installing the jack-in manhole boot per ASTM C-923.

Coordinate with Nick Wagner (Lift Station Superintendent) with Manatee County for shutdown of Lift Stations. At least four days' notice needs to be provided to Nick to coordinate shutdown. Phone Number: 941-792-8811 EXT 5377. Connection must also be made outside of peak hours between 9PM and 5AM.

BID ITEM NO. 25 - DEMOLISH EXISTING MANHOLE CONE, RING, AND COVER AND FILL ABANDONED MANHOLE WITH COMPACTED SOIL

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the unit price bid per demolished and abandoned manhole as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation at all depths for demolishing existing manhole cone or flat top to 3-feet below proposed grade, installing a minimum of four (4) core drill holes on manhole base, and backfilling the remaining structure with compacted soil. Additionally dewatering and sheeting/shearing shall be represented in this Bid Item. Manholes less than 5-feet in depth shall be completely removed and backfilled. All soil backfill shall be compacted to 98% density, AASHTO T-180 per Contract Documents and Manatee County Specifications. Manholes outside of the roadway may be backfilled with soil compacted to 95% density, AASHTO T-180 or greater per Contract Documents and Manatee County Specifications. No payment for grout, fill and abandoning of the existing sanitary sewer main shall be made under this Bid Item. Payment will include all equipment, labor, appurtenances, compacted soils, required to demolish and abandon the existing manhole in accordance with County Standards and Contract drawings.

BID ITEM NO. 26 - PAVEMENT FULL DEPTH ROAD RESTORATION

Payment for all work included under this Bid Item will be made at the Contract unit price bid per square yard of base, subbase and asphalt furnished, installed, and tested conforming with these Specifications and as listed on the Bid Form. Measurement will be based on the actual number of square yards of road restoration installed, tested, complete and approved. The measurement will be from face of curb to face of curb or as specified, but not greater than the width of the existing roadway prior to construction. Payment will include complete restoration of the roadway section in accordance with the applicable details on the Contract Drawings, 1 lift of 1-inch Type S-III asphalt, and 1-inch lift of 1-inch Type S-I asphalt, 8-inches of crushed concrete base with LBR greater than or equal to 150, subbase or compacted suitable excavation material all in accordance with these Specifications. No payment for restoration of a private driveway within or outside the right-of-way shall be made under this Bid Item. No additional payment shall be made for installing layers of base, subbase, or asphalt thicker than what is specified on the Contract documents. Payment shall include all items and incidentals necessary to complete the road restoration, including restoring pavement markings and signalization loops, in accordance with the requirements of Manatee County ready for approval and acceptance by the County.

BID ITEM NO. 27 - SIDEWALK & CONCRETE DRIVEWAY RESTORATION

Payment for all work included under this Bid Item will be made at the Contract unit price bid per square yard of concrete sidewalk and concrete driveway installed as shown in the Contract Drawings and as listed on the Bid Form. Measurement will be based on the actual number of square yards of concrete sidewalk and concrete driveway installed, tested, completed and approved. No payment for restoration of a private driveway within or outside the right-of-way shall be made under this Bid Item. Sidewalks shall meet the requirements of the Manatee County Transportation Design Standards.

BID ITEM NO. 28 - BRICK DRIVEWAY RESTORATION

Payment for all work included under this Bid Item will be made at the Contract unit price bid per square yard of brick driveway restoration as shown in the Contract Drawings and as listed on the Bid Form. Measurement of driveway restoration will be per the actual number of square yards restored. Payment shall represent full compensation for all labor, materials and equipment for cutting the edges of existing driveways, compacting subgrade, furnishing and installing the concrete, brick, or decorative pavers, including all incidentals necessary to complete the driveway restoration as shown on the Contract Drawings and included in the Specifications, all ready for approval and acceptance by the County.

BID ITEM NO. 29 - SODDING

Payment for all work included in these Bid Items will be made at the applicable Contract unit price bid per square yard for furnishing and installing sodding as shown on the Contract Drawings and listed on the Bid Form. Payment shall represent full compensation for all labor, materials, necessary equipment, and incidentals necessary to complete the work, ready for approval and acceptance by the County.

BID ITEM NO. 30 - SHELL DRIVEWAY RESTORATION

Payment for all work included in these Bid Items will be made at the applicable Contract unit price bid per square yard of FDOT Band Run shell restoration as listed on the Bid Form. Density for backfill compaction shall be 98% per AASHTO T-180 density. Measurement of restoration will be per the actual number of square yards replaced. Payment shall represent full compensation for all labor, materials and equipment for compacting subgrade, furnishing and installing the shell, including all incidentals necessary to complete the restoration as shown on the Contract Drawings and included in the Specifications, all ready for approval and acceptance by the County.

BID ITEM NO. 31 - MAILBOX REMOVAL AND REPLACEMENT

Payment for all work included in this Bid Item shall be per each mailbox removed and replaced as shown in the construction plans. Payment shall represent full compensation for all labor, excavation, compaction, material, preparation, installation and equipment required to complete this Bid Item.

BID ITEM NO. 32 - GROUT FILL AND ABANDON EXISTING SANITARY SEWER & 4" FORCE MAIN

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the unit price bid per cubic yard of grout fill that is required to abandon all of the existing sanitary sewer & 4" force main section to be deactivated. Approved grout mix shall conform to Manatee County Specifications Section: 02064. Payment will include all equipment, labor, fittings, mud plugs, valves, caps, grout, and appurtenances required to abandon the existing sanitary sewer in accordance with Manatee County Specifications & Standards.

BID ITEM NO. 33 - MODIFY EXISTING SANITARY SERVICE LATERAL

Payment for all work included in this Bid Item shall be per each modified existing 6-inch sanitary sewer lateral in right-of-way and directly in conflict with proposed sewer main. County shall review each modified service lateral for direct conflict before any modifications are performed.

All service locations shown on the Contract Drawings are approximate and it shall be the responsibility of the Contractor to locate existing 6-inch service laterals, determine modifications (if necessary), and review with County prior to modifications. Payment shall represent full compensation for all labor, excavation, compaction, material, fittings, spool pieces, preparation, bypassing, temporary installation and equipment required to complete this Bid Item.

BID ITEM NO. 34 - RELOCATE EXISTING WATER MAIN SERVICE LATERAL

Payment for all work included in this Bid Item shall be per each permanent or temporary relocation of existing water main service lateral in conflict with proposed sanitary sewer construction. County shall review each conflicted service lateral for direct conflict before any relocations are performed. All service locations shown on the Contract Drawings are approximate and it shall be the responsibility of the Contractor to locate existing water main service laterals, determine relocation (if necessary), and review with County prior to temporary or permanent relocation. Payment shall represent full compensation for all labor, excavation, compaction, material, fittings, spool pieces, preparation, bypassing, temporary installation and equipment required to complete this Bid Item.

BID ITEM NO. 35 - REMOVAL AND REPLACEMENT OF UNSUITABLE MATERIAL, INCLUDING LIMEROCK, BRICK, CONCRETE, MUCKY SAND

Payment for all work included, but is not limited to, under this Bid Item shall represent full compensation in accordance with the unit price bid per cubic yard of removal and replacement of unsuitable material encountered during excavation for pipeline and manhole installation; including but not limited to limerock, brick, concrete, and mucky sand. Unsuitable material shall be replaced with suitable backfill material per Contract Documents and Manatee County Specifications. Payment shall represent full compensation for all labor, materials, equipment, and dewatering for properly removing and disposing of all unsuitable material, including the import of suitable backfill material. Contractor shall notify Owner/Engineer when unsuitable materials are encountered. Contractor shall provide backup documentation (load tickets) to County Inspector at time of export or import of material.

BID ITEM NO. 36 - FDOT PAVEMENT REPAIR AND RESTORATION: MILL AND RESURFACE

Payment for all work included in these Bid Items will be made at the applicable Contract unit price bid per square yard for milling and asphaltic concrete resurfacing for the roadway restoration associated with the Close Tolerance Horizontal Direction Drill (CTHDD) gravity main construction on FDOT roadway as listed on the Bid Form. Contractor will be required to mill 1.5-inches and resurface with 1.5-inches of Asphalt Type FC 12.5. Payment shall represent full compensation for all labor, materials and equipment for milling, asphaltic concrete and all incidentals necessary to complete the roadway repair and restoration as shown on the Contract Drawings and in accordance with FDOT specifications.

BID ITEM NO. 37 - BYPASS PUMPING

Payment for all work included in this Bid Item shall represent full compensation in accordance with the lump sum price bid for bypassing the existing manholes and gravity sewer pipe to be removed and replaced. Payment shall represent full compensation in accordance with the lump sum price bid for all labor, equipment, pumps, piping, fittings, and temporary line stops required to bypass the existing manholes and gravity sewer pipe in order to complete the proposed improvements while maintaining sewer flows.

Measurement for periodic payments of this lump sum bid item will be in accordance with the approved Schedule of Values, to be supplied by the Contractor in accordance with the Contract Documents.

BID ITEM NO. 38 - CONTRACT CONTINGENCY

Payment for all work under this Bid Item shall be made only at the County's discretion. This Bid Item shall not exceed 10% of the Bidders Total Base Bid. The Bidder shall calculate and enter a dollar amount for this Bid Item.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01152 REQUESTS FOR PAYMENT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Submit Applications for Payment to the Project Manager or as directed at the preconstruction meeting, in accordance with the schedule established by Conditions of the Contract and Agreement between County and Contractor.

1.02 FORMAT AND DATA REQUIRED

- A. Submit payment requests in the form provided by the County with itemized data typed in accordance with the Bid Form.
- B. Provide construction photographs in accordance with Contract Documents.

1.03 SUBSTANTIATING DATA FOR PROGRESS PAYMENTS

- A. When the County requires substantiating data, Contractor shall submit suitable information with a cover letter.
- B. Submit one copy of data and cover letter for each copy of application.

1.04 PREPARATION OF APPLICATION FOR FINAL PAYMENT

Fill in application form as specified for progress payments.

1.05 SUBMITTAL PROCEDURE

- A. Submit applications for payment at the times stipulated in the Agreement.
- B. Number: Three (3) copies of each application; all signed and certified by the Contractor.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01153 CHANGE ORDER PROCEDURES

PART 1 GENERAL

1.01 DEFINITION

- A. Change Order: A written order signed by the Owner, the Architect/Engineer and the Contractor authorizing a change in the Project Plans and/or Specifications and, if necessary, a corresponding adjustment in the Contract Sum and/or Contract Time, pursuant to Article V of the General Conditions of the Construction Agreement.
- B. Administrative Change Adjustment: Minor change order under 10% of project cost or 20% time, does not have to be Board approved.
- C. Field Directive: A written order issued by Owner which orders minor changes in the Work not involving a change in Contract Time, to be paid from the Owner's contingency funds.
- D. Field Order: Minor change to contract work that does not require adjustment of contract sum or expected date of completion.

1.02 REQUIREMENTS INCLUDED

- A. The Contractor shall promptly implement change order procedures:
 - 1. Provide full written data required to evaluate changes.
 - 2. Maintain detailed records of work done on a time-and-material/force account basis.
 - 3. Provide full documentation to County on request.
- B. The Contractor shall designate a member of the Contractor's organization who:
 - 1. Is authorized to accept changes to the Work.
 - 2. Is responsible for informing others in the Contractor's employ of the authorized changes into the Work.

1.03 PRELIMINARY PROCEDURES

- A. Project Manager may initiate changes by submitting a Request to Contractor. Request will include:
 - 1. Detailed description of the change, products, costs and location of the change in the Project.
 - 2. Supplementary or revised Drawings and Specifications.
 - 3. The projected time extension for making the change.
 - 4. A specified period of time during which the requested price will be considered valid.
 - 5. Such request is for information only and is not an instruction to execute the changes, nor to stop work in progress.
- B. Contractor may initiate changes by submitting a written notice to the Project Manager, containing:
 - 1. Description of the proposed changes.
 - 2. Statement of the reason for making the changes.
 - 3. Statement of the effect on the Contract Sum and the Contract Time.

4. Statement of the effect on the work of separate contractors.
5. Documentation supporting any change in Contract Sum or Contract Time, as appropriate.

1.04 FIELD ORDER CHANGE

- A. In lieu of a Change Order, the Project Manager may issue a Field Order for the Contractor to proceed with additional work within the original intent of the Project.
- B. Field Order will describe changes in the work, with attachments of backup information to define details of the change.
- C. Contractor must sign and date the Field Order to indicate agreement with the terms therein.

1.05 DOCUMENTATION OF PROPOSALS AND CLAIMS

- A. Support each quotation for a lump sum proposal and for each unit price which has not previously been established, with sufficient substantiating data to allow the County to evaluate the quotation.
- B. On request, provide additional data to support time and cost computations:
 1. Labor required.
 2. Equipment required.
 3. Products required.
 - a. Recommended source of purchase and unit cost.
 - b. Quantities required.
 4. Taxes, insurance and bonds.
 5. Credit for work deleted from Contract, similarly documented.
 6. Overhead and profit.
 7. Justification for any change in Contract Time.
- C. Support each claim for additional costs and for work done on a time-and-material/force account basis, with documentation as required for a lump-sum proposal.
 1. Name of the County's authorized agent who ordered the work and date of the order.
 2. Date and time work was performed and by whom.
 3. Time record, summary of hours work and hourly rates paid.
 4. Receipts and invoices for:
 - a. Equipment used, listing dates and time of use.
 - b. Products used, listing of quantities.
 - c. Subcontracts.

1.06 PREPARATION OF CHANGE ORDERS

- A. Project Manager will prepare each Change Order.
- B. Change Order will describe changes in the Work, both additions and deletions, with attachments as necessary to define details of the change.
- C. Change Order will provide an accounting of the adjustment in the Contract Sum and in the Contract Time.

1.07 LUMP SUM/FIXED PRICE CHANGE ORDER

- A. Project Manager initiates the form, including a description of the changes involved and attachments based upon documents and proposals submitted by the Contractor, or requests from the County, or both.
- B. Once the form has been completed, all copies should be sent to Contractor for approval. After approval by Contractor, all copies should be sent to County for approval. The County will distribute executed copies after approval by the Board of County Commissioners.

1.08 UNIT PRICE CHANGE ORDER

- A. Contents of Change Orders will be based on, either:
 - 1. County's definition of the scope of the required changes.
 - 2. Contractor's Proposal for a change, as approved by the County.
 - 3. Survey of completed work.
- B. The amounts of the unit prices to be:
 - 1. Those stated in the Agreement.
 - 2. Those mutually agreed upon between County and Contractor.

1.09 TIME AND MATERIAL/FORCE ACCOUNT CHANGE ORDER/CONSTRUCTION CHANGE AUTHORIZATION

- A. Refer to Article V.5.6 of the General Conditions of the Construction Agreement.

1.10 CORRELATION WITH CONTRACTOR'S SUBMITTALS

- A. Periodically revise Schedule of Values and Application for Payment forms to record each change as a separate item of work, and to record the adjusted Contract Sum.
- B. Periodically revise the Construction Schedule to reflect each change in Contract Time. Revise sub schedules to show changes for other items of work affected by the changes.
- C. Upon completion of work under a Change Order, enter pertinent changes in Record Documents.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01200 PROJECT MEETINGS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The County shall schedule the pre-construction meeting, periodic progress meetings and special meetings, if required, throughout progress of work.
- B. Representatives of contractors, subcontractors and suppliers attending meetings shall be qualified and authorized to act on behalf of the entity each represents.
- C. The Contractor shall attend meetings to ascertain that work is expedited consistent with Contract Documents and construction schedules.

1.02 PRE-CONSTRUCTION MEETING

- A. Attendance:
 - 1. County's Engineer
 - 2. County's Project Manager
 - 3. Contractor
 - 4. Resident Project Representative
 - 5. Related Labor Contractor's Superintendent
 - 6. Major Subcontractors
 - 7. Major Suppliers
 - 8. Others as appropriate
- B. Suggested Agenda:
 - 1. Distribution and discussion of:
 - a. List of major subcontractors.
 - b. Projected Construction Schedules.
 - c. Coordination of Utilities
 - 2. Critical work sequencing
 - 3. Project Coordination:
 - a. Designation of responsible personnel.
 - b. Emergency contact persons with phone numbers.
 - 4. Procedures and processing of:
 - a. Field decisions.
 - b. Submittals.
 - c. Change Orders.
 - d. Applications for Payment.
 - 5. Procedures for maintaining Record Documents
 - 6. Use of premises:
 - a. Office, work and storage areas.
 - b. County's REQUIREMENTS.
 - 7. Temporary utilities
 - 8. Housekeeping procedures
 - 9. Liquidated damages
 - 10. Equal Opportunity Requirements
 - 11. Laboratory testing
 - 12. Project / Job meetings: Progress meeting, other special topics as needed.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01310 CONSTRUCTION SCHEDULE & PROJECT RESTRAINTS

PART 1 GENERAL

1.01 GENERAL

- A. Construction under this contract must be coordinated with the County and accomplished in a logical order to maintain utilization and flow through existing facilities and public properties and rights-of-way and to allow construction to be completed within the time allowed by Contract Documents and in the manner set forth in the Contract.

1.02 CONSTRUCTION SCHEDULING GENERAL PROVISIONS

- A. No work shall be done between 7:00 p.m. and 7:00 a.m. nor on weekends or legal holidays without written permission of the County. However, emergency work may be done without prior permission.
- B. Night work may be established by the Contractor as regular procedure with the written permission of the County. Such permission, however, may be revoked at any time by the County if the Contractor fails to maintain adequate equipment and supervision for the proper execution and control of the work at night.
- C. Due to potential health hazards and requirements of the State of Florida and the U.S. Environmental Protection Agency, existing facilities must be maintained in operation.
- D. The Contractor shall be fully responsible for providing all temporary piping, plumbing, electrical hook-ups, lighting, temporary structure, or other materials, equipment and systems required to maintain the existing facility's operations. All details of temporary piping and temporary construction are not necessarily shown on the Drawings or covered in the Specifications. However, this does not relieve the Contractor of the responsibility to ensure that construction will not interrupt proper facility operations.
- E. The Contractor shall designate an authorized representative of his firm who shall be responsible for development and maintenance of the schedule and of progress and payment reports. This representative of the Contractor shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the commitments of the Contractor's schedule.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. The Contractor shall submit a critical path schedule as described herein.
- B. The planning, scheduling, management and execution of the work is the sole responsibility of the Contractor. The progress schedule requirement is established to allow County to review Contractor's planning, scheduling, management and execution of the work; to assist County in evaluating work progress and make progress payments and to allow other contractors to cooperate and coordinate their activities with those of the Contractor.

2.02 FORM OF SCHEDULES

- A. Prepare schedules using the latest version of Microsoft Project, or other County approved

software, in the form of a horizontal bar chart diagram. The diagram shall be time-scaled and sequenced by work areas. Horizontal time scale shall identify the first work day of each week.

- B. Activities shall be at least as detailed as the Schedule of Values. Activity durations shall be in whole working days. In addition, man-days shall be shown for each activity or tabulated in an accompanying report.
- C. Diagrams shall be neat and legible and submitted on sheets at least 8-1/2 inches by 11 inches suitable for reproduction. Scale and spacing shall allow space for notations and future revisions.

2.03 CONTENT OF SCHEDULES

- A. Each monthly schedule shall be based on data as of the last day of the current pay period.
- B. Description for each activity shall be brief, but convey the scope of work described.
- C. Activities shall identify all items of work that must be accomplished to achieve substantial completion, such as items pertaining to Contractor's installation and testing activities; items pertaining to the approval of regulatory agencies; contractor's time required for submittals, fabrication and deliveries; the time required by County to review all submittals as set forth in the Contract Documents; items of work required of County to support pre-operational, startup and final testing; time required for the relocation of utilities. Activities shall also identify interface milestones with the work of other contractors performing work under separate contracts with County.
- D. Schedules shall show the complete sequence of construction by activities. Dates for beginning and completion of each activity shall be indicated as well as projected percentage of completion for each activity as of the first day of each month.
- E. Submittal schedule for shop drawing review, product data, and samples shall show the date of Contractor submittal and the date approved submittals will be required by the County, consistent with the time frames established in the Specifications.
- F. For Contract change orders granting time extensions, the impact on the Contract date(s) shall equal the calendar-day total time extension specified for the applicable work in the Contract change orders.
- G. For actual delays, add activities prior to each delayed activity on the appropriate critical path(s). Data on the added activities of this type shall portray all steps leading to the delay and shall further include the following: separate activity identification, activity description indicating cause of the delay, activity duration consistent with whichever set of dates below applies, the actual start and finish dates of the delay or, if the delay is not finished, the actual start date and estimated completion date.
- H. For potential delays, add an activity prior to each potentially delayed activity on the appropriate critical path(s). Data for added activities of this type shall include alternatives available to mitigate the delay including acceleration alternatives and further show the following: separate activity identification, activity description indicating cause of the potential delay and activity duration equal to zero work days.

2.04 SUPPORTING NARRATIVE

- A. Status and scheduling reports identified below shall contain a narrative to document the project status, to explain the basis of Contractor's determination of durations, describe the Contract conditions and restraints incorporated into the schedule and provide an analysis pertaining to potential problems and practical steps to mitigate them.
- B. The narrative shall specifically include:
 - 1. Actual completion dates for activities completed during the monthly report period and actual start dates for activities commenced during the monthly report period.
 - 2. Anticipated start dates for activities scheduled to commence during the following monthly report period.
 - 3. Changes in the duration of any activity and minor logic changes.
 - 4. The progress along the critical path in terms of days ahead or behind the Contract date.
 - 5. If the Monthly Status Report indicates an avoidable delay to the Contract completion date or interim completion dates as specified in the Agreement, Contractor shall identify the problem, cause and the activities affected and provide an explanation of the proposed corrective action to meet the milestone dates involved or to mitigate further delays.
 - 6. If the delay is thought to be unavoidable, the Contractor shall identify the problem, cause, duration, specific activities affected and restraints of each activity.
 - 7. The narrative shall also discuss all change order activities whether included or not in the revised/current schedule of legal status. Newly introduced change order work activities and the CPM path(s) that they affect, must be specifically identified. All change order work activities added to the schedule shall conform with the sequencing and Contract Time requirements of the applicable Change Order.
 - 8. Original Contract date(s) shall not be changed except by Contract change order. A revision need not be submitted when the foregoing situations arise unless required by County. Review of a report containing added activities will not be construed to be concurrence with the duration or restraints for such added activities; instead the corresponding data as ultimately incorporated into the applicable Contract change order shall govern.
 - 9. Should County require additional data, this information shall be supplied by Contractor within 10 calendar days.

2.05 SUBMITTALS

- A. Contractor shall submit estimated and preliminary progress schedules (as identified in the Terms and Conditions of the Contract and the General Conditions), monthly status reports, a start-up schedule and an as-built schedule report all as specified herein.
- B. All schedules, including estimated and preliminary schedules, shall be in conformance with the Contract Documents.
- C. The finalized progress schedule discussed in the Contract Documents shall be the first monthly status report and as such shall be in conformance with all applicable specifications contained herein.
- D. Monthly Status Report submittals shall include a time-scaled (days after notice to proceed) diagram showing all contract activities and supporting narrative. The initial detailed schedule shall use the notice to proceed as the start date. The finalized schedule, if

concurring with by County, shall be the work plan to be used by the contractor for planning, scheduling, managing and executing the work.

- E. The schedule diagram shall be formatted as above. The diagram shall include (1) all detailed activities included in the preliminary and estimated schedule submittals, (2) calendar days prior to substantial completion, (3) summary activities for the remaining days. The critical path activities shall be identified, including critical paths for interim dates, if possible.
- F. The Contractor shall submit progress schedules with each application for payment.

2.06 MONTHLY STATUS REPORTS

- A. Contractor shall submit detailed schedule status reports on a monthly basis with the Application for Payment. The first such status report shall be submitted with the first Application for Payment and include data as of the last day of the pay period. The Monthly Report shall include a "marked-up" copy of the latest detailed schedule of legal status and a supporting narrative including updated information as described above. The Monthly Report will be reviewed by County and Contractor at a monthly schedule meeting and Contractor will address County's comments on the subsequent monthly report. Monthly status reports shall be the basis for evaluating Contractor's progress.
- B. The "marked-up" diagram shall show, for the latest detailed schedule of legal status, percentages of completion for all activities, actual start and finish dates and remaining durations, as appropriate. Activities not previously included in the latest detailed schedule of legal status shall be added, except that contractual dates will not be changed except by change order. Review of a marked-up diagram by County will not be construed to constitute concurrence with the time frames, duration, or sequencing for such added activities; instead the corresponding data as ultimately incorporated into an appropriate change order shall govern.

2.07 STARTUP SCHEDULE

- A. At least 60 calendar days prior to the date of substantial completion, Contractor shall submit a time-scaled (days after notice to proceed) diagram detailing the work to take place in the period between 60 days prior to substantial completion, together with a supporting narrative. County shall have 10 calendar days after receipt of the submittal to respond. Upon receipt of County's comments, Contractor shall make the necessary revisions and submit the revised schedule within 10 calendar days. The resubmittal, if concurred with by County, shall be the Work Plan to be used by Contractor for planning, managing, scheduling and executing the remaining work leading to substantial completion.
- B. The time-scaled diagram shall use the latest schedule of legal status for those activities completed ahead of the last 60 calendar days prior to substantial completion and detailed activities for the remaining 60-day period within the time frames outlined in the latest schedule of legal status.
- C. Contractor will be required to continue the requirement for monthly reports, as outlined above. In preparing this report, Contractor must assure that the schedule is consistent with the progress noted in the startup schedule.

2.08 REVISIONS

- A. All revised Schedule Submittals shall be made in the same form and detail as the initial submittal and shall be accompanied by an explanation of the reasons for such revisions, all of which shall be subject to review and concurrence by County. The revision shall incorporate all previously made changes to reflect current as-built conditions. Minor changes to the approved submittal may be approved at monthly meetings; a minor change is not considered a revision in the context of this paragraph.
- B. A revised schedule submittal shall be submitted for review when required by County.

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01340 SHOP DRAWINGS, PROJECT DATA AND SAMPLES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall submit to the County for review and approval: working drawings, shop drawings, test reports and data on materials and equipment (hereinafter in this section called data), and material samples (hereinafter in this section called samples) as are required for the proper control of work, including, but not limited to those working drawings, shop drawings, data and samples for materials and equipment specified elsewhere in the Specifications and in the Contract Drawings.
- B. The Contractor is to maintain an accurate updated submittal log and will bring this log to each scheduled progress meeting with the County. This log should include the following items:
1. Submittal description and number assigned.
 2. Date to County.
 3. Date returned to Contractor (from County).
 4. Status of Submittal (No exceptions taken, returned for confirmation or resubmittal, rejected).
 5. Date of Resubmittal and Return (as applicable).
 6. Date material released (for fabrication).
 7. Projected date of fabrication.
 8. Projected date of delivery to site.
 9. Projected date and required lead time so that product installation does not delay contact.
 10. Status of O&M manuals submitted.

1.03 CONTRACTOR'S RESPONSIBILITY

- A. It is the duty of the Contractor to check all drawings, data and samples prepared by or for him before submitting them to the County for review. Each and every copy of the Drawings and data shall bear Contractor's stamp showing that they have been so checked. Shop drawings submitted to the County without the Contractor's stamp will be returned to the Contractor for conformance with this requirement. Shop drawings shall indicate any deviations in the submittal from requirements of the contract Documents.
- B. Determine and verify:
1. Field measurements.
 2. Field construction criteria.
 3. Catalog numbers and similar data.
 4. Conformance with Specifications and indicate all variances from the Specifications.
- C. The Contractor shall furnish the County a schedule of Shop Drawing submittals fixing the respective dates for the submission of shop and working drawings, the beginning of manufacture, testing and installation of materials, supplies and equipment. This schedule shall indicate those that are critical to the progress schedule.

- D. The Contractor shall not begin any of the work covered by a drawing, data, or a sample returned for correction until a revision or correction thereof has been reviewed and returned to him, by the County, with No Exceptions Taken or Approved as Noted.
- E. The Contractor shall submit to the County all drawings and schedules sufficiently in advance of construction requirements to provide no less than twenty-one (21) calendar days for checking and appropriate action from the time the County receives them.
- F. All material & product submittals, other than samples, may be transmitted electronically as a pdf file. All returns to the contractor will be as a pdf file only unless specifically requested otherwise.
- G. The Contractor shall be responsible for and bear all cost of damages which may result from the ordering of any material or from proceeding with any part of work prior to the completion of the review by County of the necessary Shop Drawings.

1.04 COUNTY'S REVIEW OF SHOP DRAWINGS AND WORKING DRAWINGS

- A. The County's review of drawings, data and samples submitted by the Contractor shall cover only general conformity to the Specifications, external connections and dimensions which affect the installation.
- B. The review of drawings and schedules shall be general and shall not be construed:
 - 1. As permitting any departure from the Contract requirements.
 - 2. As relieving the Contractor of responsibility for any errors, including details, dimensions and materials.
 - 3. As approving departures from details furnished by the County, except as otherwise provided herein.
- C. If the drawings or schedules as submitted describe variations and show a departure from the Contract requirements which the County finds to be in the interest of the County and to be so minor as not to involve a change in Contract Price or time for performance, the County may return the reviewed drawings without noting any exception.
- D. When reviewed by the County, each of the Shop and Working Drawings shall be identified as having received such review being so stamped and dated. Shop Drawings stamped "REJECTED" and with required corrections shown shall be returned to the Contractor for correction and resubmittal.
- E. Resubmittals will be handled in the same manner as first submittals. On resubmittals, the Contractor shall direct specific attention, in writing or on resubmitted Shop Drawings, to revisions other than the corrections requested by the County on previous submissions. The Contractor shall make any corrections required by the County.
- F. If the Contractor considers any correction indicated on the drawings to constitute a change to the Contract Drawings or Specifications, the Contractor shall give written notice thereof to the County.
- G. The County shall review a submittal/resubmittal a maximum of three (3) times after which cost of review shall be borne by the Contractor. The cost of engineering shall be equal to the County's actual payroll cost.

- H. When the Shop and Working Drawings have been completed to the satisfaction of the County, the Contractor shall carry out the construction in accordance therewith and shall make no further changes therein except upon written instructions from the County.
- I. No partial submittals shall be reviewed. Incomplete submittals shall be returned to the Contractor and shall be considered not approved until resubmitted.

1.05 SHOP DRAWINGS

- A. When used in the Contract Documents, the term "Shop Drawings" shall be considered to mean Contractor's plans for material and equipment which become an integral part of the Project. These drawings shall be complete and detailed. Shop Drawings shall consist of fabrication, drawings, setting drawings, schedule drawings, manufacturer's scale drawings and wiring and control diagrams. Cuts, catalogs, pamphlets, descriptive literature and performance and test data, shall be considered only as supportive to required Shop Drawings as defined above.
- B. Drawings and schedules shall be checked and coordinated with the work of all trades involved, before they are submitted for review by the County and shall bear the Contractor's stamp of approval and original signature as evidence of such checking and coordination. Drawings or schedules submitted without this stamp of approval and original signature shall be returned to the Contractor for resubmission.
- C. Each Shop Drawing shall have a blank area 3-1/2 inches by 3-1/2 inches, located adjacent to the title block. The title block shall display the following:
 - 1. Number and title of the drawing.
 - 2. Date of Drawing or revision.
 - 3. Name of project building or facility.
 - 4. Name of contractor and subcontractor submitting drawing.
 - 5. Clear identification of contents and location of the work.
 - 6. Specification title and number.
- D. If drawings show variations from Contract requirements because of standard shop practice or for other reasons, the Contractor shall describe such variations in his letter of transmittal. If acceptable, proper adjustment in the contract shall be implemented where appropriate. If the Contractor fails to describe such variations, he shall not be relieved of the responsibility of executing the work in accordance with the Contract, even though such drawings have been reviewed.
- E. Data on materials and equipment shall include, without limitation, materials and equipment lists, catalog sheets, cuts, performance curves, diagrams, materials of construction and similar descriptive material. Materials and equipment lists shall give, for each item thereon, the name and location of the supplier or manufacturer, trade name, catalog reference, size, finish and all other pertinent data.
- F. For all mechanical and electrical equipment furnished, the Contractor shall provide a list including the equipment name and address and telephone number of the manufacturer's representative and service company so that service and/or spare parts can be readily obtained.
- G. All manufacturers or equipment suppliers who proposed to furnish equipment or products shall submit an installation list to the County along with the required shop drawings. The

installation list shall include at least five installations where identical equipment has been installed and have been in operation for a period of at least one (1) year.

- H. Only the County will utilize the color "red" in marking shop drawing submittals.

1.06 WORKING DRAWINGS

- A. When used in the Contract Documents, the term "working drawings" shall be considered to mean the Contractor's fabrication and erection drawings for structures such as roof trusses, steelwork, precast concrete elements, bulkheads, support of open cut excavation, support of utilities, groundwater control systems, forming and false work; underpinning; and for such other work as may be required for construction of the project.
- B. Copies of working drawings as noted above, shall be submitted to the County where required by the Contract Documents or requested by the County and shall be submitted at least thirty (30) days (unless otherwise specified by the County) in advance of their being required for work.
- C. Working drawings shall be signed by a registered Professional Engineer, currently licensed to practice in the State of Florida and shall convey, or be accompanied by, calculation or other sufficient information to completely explain the structure, machine, or system described and its intended manner of use. Prior to commencing such work, working drawings must have been reviewed without specific exceptions by the County, which review will be for general conformance and will not relieve the Contractor in any way from his responsibility with regard to the fulfillment of the terms of the Contract. All risks of error are assumed by the Contractor; the County and Engineer shall not have responsibility therefor.

1.07 SAMPLES

- A. The Contractor shall furnish, for the review of the County, samples required by the Contract Documents or requested by the County. Samples shall be delivered to the County as specified or directed. The Contractor shall prepay all shipping charges on samples. Materials or equipment for which samples are required shall not be used in work until reviewed by the County.
- B. Samples shall be of sufficient size and quantity to clearly illustrate:
 - 1. Functional characteristics of the product, with integrally related parts and attachment devices.
 - 2. Full range of color, texture and pattern.
 - 3. A minimum of two samples of each item shall be submitted.
- C. Each sample shall have a label indicating:
 - 1. Name of product.
 - 2. Name of Contractor and Subcontractor.
 - 3. Material or equipment represented.
 - 4. Place of origin.
 - 5. Name of Producer and Brand (if any).
 - 6. Location in project.
(Samples of finished materials shall have additional markings that will identify them under the finished schedules.)
 - 7. Reference specification paragraph.

- D. The Contractor shall prepare a transmittal letter in triplicate for each shipment of samples containing the information required above. He shall enclose a copy of this letter with the shipment and send a copy of this letter to the County. Review of a sample shall be only for the characteristics or use named in such and shall not be construed to change or modify any Contract requirements.
- E. Reviewed samples not destroyed in testing shall be sent to the County or stored at the site of the work. Reviewed samples of the hardware in good condition will be marked for identification and may be used in the work. Materials and equipment incorporated in work shall match the reviewed samples. If requested at the time of submission, samples which failed testing or were rejected shall be returned to the Contractor at his expense.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01370 SCHEDULE OF VALUES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall submit to the County a Schedule of Values allocated to the various portions of the work, within 10 days after date of Notice to Proceed.
- B. Upon request of the County, the Contractor shall support the values with data which will substantiate their correctness.
- C. The Schedule of Values shall be used only as the basis for the Contractor's Applications for Payment.

1.02 FORM AND CONTENT OF SCHEDULE OF VALUES

- A. Schedule of Values will be considered for approval by County upon Contractor's request. Identify schedule with:
 - 1. Title of Project and location.
 - 2. Project number.
 - 3. Name and address of Contractor.
 - 4. Contract designation.
 - 5. Date of submission.
- B. Schedule of Values shall list the installed value of the component parts of the work in sufficient detail to serve as a basis for computing values for progress payments during construction.
- C. Follow the table of contents for the Contract Document as the format for listing component items for structures:
 - 1. Identify each line item with the number and title of the respective major section of the specification.
 - 2. For each line item, list sub values of major products or operations under item.
- D. Follow the bid sheets included in this Contract Documents as the format for listing component items for pipe lines.
- E. The sum of all values listed in the schedule shall equal the total Contract sum.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01380 CONSTRUCTION PHOTOGRAPHS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall employ a competent photographer to take construction record photographs or perform video, recording including furnishing all labor, materials, equipment and incidentals necessary to obtain photographs and/or video recordings of all construction areas.
- B. Preconstruction record information shall consist of video recordings on digital video disks (DVD).
- C. Construction progress information shall consist of photographs and digital photographs on a recordable compact disc (CD-R).

1.02 QUALIFICATIONS

- A. All photography shall be done by a competent camera operator who is fully experienced and qualified with the specified equipment.
- B. For the video recording, the audio portion should be done by a person qualified and knowledgeable in the specifics of the Contract, who shall speak with clarity and diction so as to be easily understood.

1.03 PROJECT PHOTOGRAPHS

- A. Provide one print of each photograph with each pay application.
- B. Provide one recordable compact disc with digital photographs with each pay application.
- C. Negatives:
 - 1. All negatives shall remain the property of photographer.
 - 2. The Contractor shall require that photographer maintain negatives or protected digital files for a period of two years from date of substantial completion of the project.
 - 3. Photographer shall agree to furnish additional prints to County at commercial rates applicable at time of purchase. Photographer shall also agree to participate as required in any litigation requiring the photographer as an expert witness.
- D. The Contractor shall pay all costs associated with the required photography and prints. Any parties requiring additional photography or prints shall pay the photographer directly.
- E. All project photographs shall be a single weight, color image. All finishes shall be smooth surface and glossy and all prints shall be 8 inches x 10 inches.
- F. Each print shall have clearly marked on the back, the name of the project, the orientation of view, the date and time of exposure, name and address of the photographer and the photographers numbered identification of exposure.
- G. All project photographs shall be taken from locations to adequately illustrate conditions prior

to construction, or conditions of construction and state of progress. The Contractor shall consult with the County at each period of photography for instructions concerning views required.

1.04 VIDEO RECORDINGS

- A. Video recording shall be done along all routes that are scheduled for construction. Video recording shall include full recording of both sides of all streets and the entire width of easements plus 10 feet on each side on which construction is to be performed. All video recording shall be in full color.
- B. A complete view, in sufficient detail with audio description of the exact location shall be provided.
- C. The engineering plans shall be used as a reference for stationing in the audio portion of the recordings for easy location identification.
- D. Two complete sets of video recordings shall be delivered to the County on digital video disks (DVD) for the permanent and exclusive use of the County prior to the start of any construction on the project. Included in this delivery shall be a printed video log which includes time stamps and project stationing.
- E. All video recordings shall contain the name of the project, the date and time of the video, recording, the name and address of the photographer and any other identifying information required.
- F. Construction shall not start until preconstruction video recordings are completed, submitted and accepted by the County. In addition, no progress payments shall be made until the preconstruction video recordings are accepted by the County.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01410 TESTING AND TESTING LABORATORY SERVICES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. County shall employ and pay for the services of an independent testing laboratory to perform testing specifically indicated on the Contract Documents or called out in the Specifications. County may elect to have materials and equipment tested for conformity with the Contract Documents at any time.
1. Contractor shall cooperate fully with the laboratory to facilitate the execution of its required services.
 2. Employment of the laboratory shall in no way relieve the Contractor's obligations to perform the work of the Contract.

1.02 LIMITATIONS OF AUTHORITY OF TESTING LABORATORY

- A. Laboratory is not authorized to:
1. Release, revoke, alter or enlarge on requirements of Contract Documents.
 2. Approve or accept any portion of the Work.
 3. Perform any duties of the Contractor.

1.03 CONTRACTOR'S RESPONSIBILITIES

- A. Cooperate with laboratory personnel; provide access to Work and/or to Manufacturer's operations.
- B. Secure and deliver to the laboratory adequate quantities of representational samples of materials proposed to be used and which require testing.
- C. Provide to the laboratory the preliminary design mix proposed to be used for concrete, and other material mixes which require control by the testing laboratory.
- D. Materials and equipment used in the performance of work under this Contract are subject to inspection and testing at the point of manufacture or fabrication. Standard specifications for quality and workmanship are indicated in the Contract Documents. The County may require the Contractor to provide statements or certificates from the manufacturers and fabricators that the materials and equipment provided by them are manufactured or fabricated in full accordance with the standard specifications for quality and workmanship indicated in the Contract Documents. All costs of this testing and providing statements and certificates shall be a subsidiary obligation of the Contractor and no extra charge to the County shall be allowed on account of such testing and certification.
- E. Furnish incidental labor and facilities:
1. To provide access to work to be tested.
 2. To obtain and handle samples at the project site or at the source of the product to be tested.
 3. To facilitate inspections and tests.
 4. For storage and curing of test samples.

- F. Notify laboratory sufficiently in advance of operations to allow for laboratory assignment of personnel and scheduling of tests.
 - 1. When tests or inspections cannot be performed due to insufficient notice, Contractor shall reimburse County for laboratory personnel and travel expenses incurred due to Contractor's negligence.
- G. Employ and pay for the services of the same or a separate, equally qualified independent testing laboratory to perform additional inspections, sampling and testing required for the Contractor's convenience and as approved by the County.
- H. If the test results indicate the material or equipment complies with the Contract Documents, the County shall pay for the cost of the testing laboratory. If the tests and any subsequent retests indicate the materials and equipment fail to meet the requirements of the Contract Documents, the contractor shall pay for the laboratory costs directly to the testing firm or the total of such costs shall be deducted from any payments due the Contractor.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01510 TEMPORARY AND PERMANENT UTILITIES

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

The Contractor shall be responsible for furnishing all requisite temporary utilities, i.e., power, water, sanitation, etc. The Contractor shall obtain and pay for all permits required as well as pay for all temporary usages. The Contractor shall remove all temporary facilities upon completion of work.

1.02 REQUIREMENTS OF REGULATORY AGENCIES

- A. Comply with National Electric Code.
- B. Comply with Federal, State and Local codes and regulations and with utility company requirements.
- C. Comply with County Health Department regulations.

PART 2 PRODUCTS

2.01 MATERIALS, GENERAL

Materials for temporary utilities may be "used". Materials for electrical utilities shall be adequate in capacity for the required usage, shall not create unsafe conditions and shall not violate requirements of applicable codes and standards.

2.02 TEMPORARY ELECTRICITY AND LIGHTING

Arrange with the applicable utility company for temporary power supply. Provide service required for temporary power and lighting and pay all costs for permits, service and for power used.

2.03 TEMPORARY WATER

- A. The Contractor shall arrange with Manatee County Utilities Customer Service office to provide water for construction purposes, i.e., meter, pay all costs for installation, maintenance and removal, and service charges for water used.
- B. The Contractor shall protect piping and fitting against freezing.

2.04 TEMPORARY SANITARY FACILITIES

- A. The Contractor shall provide sanitary facilities in compliance with all laws and regulations.
- B. The Contractor shall service, clean and maintain facilities and enclosures.

PART 3 EXECUTION

3.01 GENERAL

- A. The Contractor shall maintain and operate systems to assure continuous service.

- B. The Contractor shall modify and extend systems as work progress requires.

3.02 REMOVAL

- A. The Contractor shall completely remove temporary materials and equipment when their use is no longer required.
- B. The Contractor shall clean and repair damage caused by temporary installations or use of temporary facilities.

END OF SECTION

SECTION 01570 TRAFFIC REGULATION

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. The Contractor shall be responsible for providing safe and expeditious movement of traffic through construction zones. A construction zone is defined as the immediate areas of actual construction and all abutting areas which are used by the Contractor and which interfere with the driving or walking public.
- B. The Contractor shall remove temporary equipment and facilities when no longer required, restore grounds to original or to specified conditions.

1.02 TRAFFIC CONTROL

- A. The necessary traffic control shall include, but not be limited to, such items as proper construction warning signs, signals, lighting devices, markings, barricades, channelization and hand signaling devices. The Contractor shall be responsible for installation and maintenance of all devices and detour routes and signage for the duration of the construction period. The Contractor shall utilize the appropriate traffic plan from the FDOT Maintenance of Traffic Standards, Series 600 of the FDOT Roadway & Traffic Design Standards, Latest Edition.
- B. Should there be the necessity to close any portion of a roadway carrying vehicles or pedestrians the Contractor shall submit a Traffic Control Plan (TCP) at least 5 days before a partial or full day closure, and at least 8 days before a multi-day closure. TCP shall be submitted, along with a copy of their accreditation, by a certified IMSA or ATSA Traffic Control Specialist.
 - 1. At no time will more than one (1) lane of a roadway be closed to vehicles and pedestrians without an approved road closure from the County Transportation Department. With any such closings, adequate provision shall be made for the safe expeditious movement of each.
 - 2. All traffic control signs must be in place and inspected at least 1 day in advance of the closure. Multi-day closures notification signs shall be in place at least 3 days in advance of the closure. All signs must be covered when not in effect, and checked twice a day by the Worksite Traffic Supervisor when they are in effect.
- C. The Contractor shall be responsible for removal, relocation, or replacement of any traffic control device in the construction area which exists as part of the normal preconstruction traffic control scheme. Any such actions shall be performed by the Contractor under the supervision and in accordance with the instructions of the applicable highway department unless otherwise specified.
- D. The Contractor will consult with the County immediately on any vehicular or pedestrian safety or efficiency problem incurred as a result of construction of the project.
- E. The Contractor shall provide ready access to businesses and homes in the project area during construction. The Contractor shall be responsible for coordinating this work with affected homeowners.
- F. When conditions require the temporary installation of signs, pavement markings and traffic

barriers for the protection of workers and traffic, the entire array of such devices shall be depicted on working drawings for each separate stage of work. These drawings shall be submitted to the County for review and approval prior to commencement of work on the site.

- G. Precast concrete traffic barriers shall be placed adjacent to trenches and other excavations deeper than six inches below the adjacent pavement surface.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01580 PROJECT IDENTIFICATION AND SIGNS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Furnish, install and maintain County project identification signs.
- B. Remove signs on completion of construction.
- C. Allow no other signs to be displayed except for traffic control and safety.

1.02 PROJECT IDENTIFICATION SIGN (COUNTY)

- A. Two painted signs, of not less than 32 square feet (3 square meters) area, with painted graphic content to include:
 - 1. Title of Project.
 - 2. Name of County.
 - 3. Names and titles of authorities as directed by County.
 - 4. Prime Contractor.
- B. Graphic design, style of lettering and colors: As approved by the County.
- C. Erect on the site at a lighted location of high public visibility, adjacent to main entrance to site, as approved by the County

1.03 INFORMATIONAL SIGNS

- A. Painted signs with painted lettering, or standard products.
- B. Size of signs and lettering: as required by regulatory agencies, or as appropriate to usage.
- C. Colors: as required by regulatory agencies, otherwise of uniform colors throughout project.
- D. Erect at appropriate locations to provide required information.

1.04 QUALITY ASSURANCE

- A. Sign Painter: Professional experience in type of work required.
- B. Finishes, Painting: Adequate to resist weathering and fading for scheduled construction period.

1.05 PUBLIC NOTIFICATION


- A. Door Hangers: The Contractor shall generate and distribute door hangers to all residents who will be impacted by project construction.
 - 1. Residents impacted include anyone who resides inside, or within 500 feet of project limits of construction.

- B. Door Hangers shall be distributed prior to start of construction of the project. Hangers shall be affixed to doors of residents via elastic bands or tape.

EXAMPLE:

PLEASE PARDON THE INCONVENIENCE WHILE THE ROADWAY IS BEING RECONSTRUCTED IN YOUR NEIGHBORHOOD

This project consists of utility improvements and the reconstruction of approximately 4400 LF of 8- to 12-inch gravity sewer installed via open cut, 550 LF of 8-inch gravity sewer installed via close tolerance HDD, 23 proposed manholes, grout fill and abandoning existing sanitary sewer and 25 associated manholes, removing and reconnecting approximately 97 service laterals to the proposed sanitary sewer. Additionally the project includes restoration of sidewalks, driveways, and pavement that will be disturbed by the construction of the proposed improvements. The project is expected to begin in June, 2021 and be completed in July 2022.

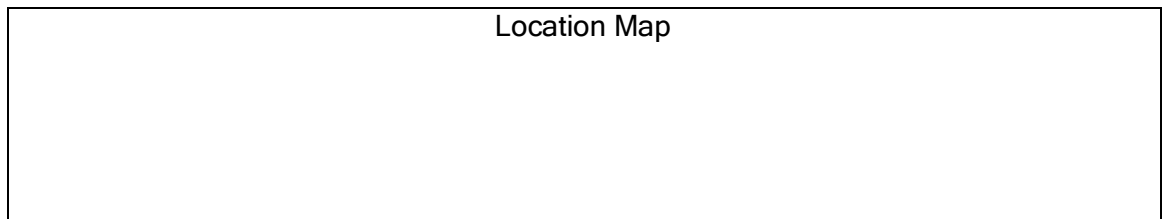

WE HOPE TO KEEP ANY INCONVENIENCE TO A MINIMUM. HOWEVER, IF YOU HAVE ANY PROBLEMS, PLEASE CONTACT THE FOLLOWING:

Contractor
Contractor Address
Contractor Phone (Site Phone)

Project Manager
PM Address
PM Phone No. & Ext.

Project Inspector
Inspector Phone Number

AFTER HOURS EMERGENCY NUMBER - (941) 747-HELP
THANK YOU FOR YOUR UNDERSTANDING AND PATIENCE
MANATEE COUNTY GOVERNMENT - PROJECT MANAGEMENT DEPT.

PART 2 PRODUCTS

2.01 SIGN MATERIALS

- A. Structure and Framing: May be new or used, wood or metal, in sound condition structurally adequate to work and suitable for specified finish.
- B. Sign Surfaces: Exterior softwood plywood with medium density overlay, standard large sizes to minimize joints.
- C. Thickness: As required by standards to span framing members, to provide even, smooth surface without waves or buckles.
- D. Rough Hardware: Galvanized.

- E. Paint: Exterior quality, as specified in the Contract Documents.

PART 3 EXECUTION

3.01 PROJECT IDENTIFICATION SIGN

Paint exposed surface or supports, framing and surface material; one coat of primer and one coat of exterior paint.

Paint graphics in styles, size and colors selected.

3.02 MAINTENANCE

The Contractor shall maintain signs and supports in a neat, clean condition; repair damages to structures, framing or sign.

3.03 REMOVAL

The Contractor shall remove signs, framing, supports and foundations at completion of project.

END OF SECTION

SECTION 01590 COUNTY'S FIELD OFFICE

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Contractor shall furnish, install and maintain one temporary field office during the entire construction period for the sole use of the County.

1.02 OTHER REQUIREMENTS

Prior to installation of the County's field office, the Contractor shall consult with the County on location, access and related facilities.

All site use approvals shall be obtained by the Contractor.

Upon completion of construction, the Contractor shall remove the field office and restore the site to its original condition.

1.03 REQUIREMENTS FOR FACILITIES

A. Construction:

1. The field office shall be structurally sound, weather tight, with floors raised aboveground.
2. At Contractor's option, portable or mobile buildings may be used.

B. Office for Field Engineer:

1. A separate office for sole use of the County with secure entrance doors, key and lock shall be provided.
2. Area: 250 sq. ft. minimum, with minimum dimension of 8 feet.
3. Windows:
 - a. Minimum of three (3).
 - b. Operable sash and insect screens.
 - c. Locate field office to provide maximum view of construction areas.
4. Furnishings:
 - a. Two standard size chairs and desks with three drawers each.
 - b. One drafting table: 39"x72"x36" high, with one equipment drawer.
 - c. One metal, double-door storage cabinet with lock and key.
 - d. One plan rack to hold a minimum of six sets of project drawings.
 - e. One standard four-drawer legal-size metal filing cabinet with lock and key.
 - f. Six linear feet of bookshelves.
 - g. One swivel arm chair.
 - h. Two straight chairs.
 - i. One drafting table stool.
 - j. One waste basket.
 - k. One tackboard, 36"x30".
 - l. One fire extinguisher.
 - m. One first aid kit.

5. Services:

- a. Adequate lighting.
 - b. Exterior lighting at entrance door.
 - c. Automatic heating and mechanical cooling equipment to maintain comfort conditions.
 - d. Minimum of four 110 volt duplex electric convenience outlets, at least one on each wall.
 - e. Electric distribution panel: Two circuits minimum 110 volt, 60 hertz service.
 - f. Convenient access to drinking water and toilet facilities.
6. Telephone: One private direct line instrument.
 7. Fax: combination fax/duplicator.

PART 2 PRODUCTS

2.01 MATERIALS, EQUIPMENT, FURNISHINGS

May be new or used, but must be serviceable, adequate for required purpose and must adhere to all applicable codes or regulations including the Manatee County Building Codes.

PART 3 EXECUTION

3.01 PREPARATION

Fill and grade site as necessary for temporary structure to provide positive surface drainage.

3.02 INSTALLATION

Construct temporary field office on proper foundation and provide connections for all utility services.

1. Secure portable or mobile building when used.
2. Provide steps and landings at entrance doors.

END OF SECTION

SECTION 01600 MATERIAL AND EQUIPMENT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Material and equipment incorporated into the work:
1. Conform to applicable specifications and standards.
 2. Comply with size, make, type and quality specified, or as specifically approved in writing by the County.
 3. Manufactured and Fabricated Products:
 - a. Design, fabricate and assemble in accordance with the best engineering and shop practices.
 - b. Manufacture like parts of duplicate units to standard sizes and gages, to be interchangeable.
 - c. Two or more items of the same kind shall be identical and manufactured by the same manufacturer.
 - d. Products shall be suitable for service conditions.
 - e. Equipment capacities, sizes and dimensions shown or specified shall be adhered to unless variations are specifically approved in writing.
 4. Do not use material or equipment for any purpose other than that for which it is specified.
 5. All material and equipment incorporated into the project shall be new.

1.02 MANUFACTURER'S INSTRUCTIONS

- A. When Contract Documents require that installation of work shall comply with manufacturer's printed instructions, obtain and distribute copies of such instructions to parties involved in the installation, including two copies to County. Maintain one set of complete instructions at the job site during installation and until completion.
- B. Handle, install, connect, clean, condition and adjust products in strict accordance with such instructions and in conformity with specified requirements. Should job conditions or specified requirements conflict with manufacturer's instructions, consult with County prior to proceeding. Do not proceed with work without clear instructions.

1.03 TRANSPORTATION AND HANDLING

- A. Arrange deliveries of products in accordance with construction schedules, coordinate to avoid conflict with work and conditions at the site.
1. Deliver products in undamaged condition, in manufacturer's original containers or packaging, with identifying labels intact and legible.
 2. Immediately on delivery, inspect shipments to assure compliance with requirements of Contract Documents and approved submittals and that products are properly protected and undamaged.
- B. Provide equipment and personnel to handle products by methods to prevent soiling or damage to products or packaging.
- C. The Contractor shall take extreme care when handling pipe, valves, fittings to ensure the interior lining does not get damaged during construction. Lined pipe, valves, and fittings

must be handled only from the outside surfaces. No forks, chains, straps, hooks, etc. shall be placed inside the pipe, valves, and fittings for lifting, positioning, or laying. The materials shall not be dropped or unloaded by rolling.

- D. Care should be taken not to let the pipe, valves, and fittings strike sharp objects while swinging or being off loaded. Materials should never be placed on grade by use of hydraulic pressure from an excavator bucket or by banging with heavy hammers.
- E. A County representative shall have the right to deny any pipe/valve/fitting that shows cracking due to improper handling/storage.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01620 STORAGE AND PROTECTION

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Provide secure storage and protection for products to be incorporated into the work and maintenance and protection for products after installation and until completion of Work.

1.02 STORAGE

- A. Store products immediately on delivery and protect until installed in the Work, in accord with manufacturer's instructions, with seals and labels intact and legible.
- B. Exterior Storage
 - 1. Provide substantial platform, blocking or skids to support fabricated products above ground to prevent soiling or staining.
 - a. Cover products, particularly any pipe, fittings, and valves, subject to discoloration or deterioration from exposure to the elements, with impervious sheet coverings. Provide adequate ventilation to avoid condensation.
 - b. Prevent mixing of refuse or chemically injurious materials or liquids.
- C. Arrange storage in manner to provide easy access for inspection.

1.03 MAINTENANCE OF STORAGE

- A. Maintain periodic system of inspection of stored products on scheduled basis to assure that:
 - 1. State of storage facilities is adequate to provide required conditions.
 - 2. Required environmental conditions are maintained on continuing basis.
 - 3. Surfaces of products exposed to elements are not adversely affected. Any weathering of products, coatings and finishes is not acceptable under requirements of these Contract Documents.
- B. Mechanical and electrical equipment which requires servicing during long term storage shall have complete manufacturer's instructions for servicing accompanying each item, with notice of enclosed instructions shown on exterior of package.
 - 1. Equipment shall not be shipped until approved by the County. The intent of this requirement is to reduce on-site storage time prior to installation and/or operation. Under no circumstances shall equipment be delivered to the site more than one month prior to installation without written authorization from the County.
 - 2. All equipment having moving parts such as gears, electric motors, etc. and/or instruments shall be stored in a temperature and humidity controlled building approved by the County until such time as the equipment is to be installed.
 - 3. All equipment shall be stored fully lubricated with oil, grease, etc. unless otherwise instructed by the manufacturer.
 - 4. Moving parts shall be rotated a minimum of once weekly to insure proper lubrication and to avoid metal-to-metal "welding". Upon installation of the equipment, the Contractor shall start the equipment, at least half load, once weekly for an adequate period of time to ensure that the equipment does not deteriorate from lack of use.
 - 5. Lubricants shall be changed upon completion of installation and as frequently as

- required, thereafter during the period between installation and acceptance.
6. Prior to acceptance of the equipment, the Contractor shall have the manufacturer inspect the equipment and certify that its condition has not been detrimentally affected by the long storage period. Such certifications by the manufacturer shall be deemed to mean that the equipment is judged by the manufacturer to be in a condition equal to that of equipment that has been shipped, installed, tested and accepted in a minimum time period. As such, the manufacturer will guaranty the equipment equally in both instances. If such a certification is not given, the equipment shall be judged to be defective. It shall be removed and replaced at the Contractor's expense.

1.04 PROTECTION AFTER INSTALLATION

- A. Provide protection of installed products to prevent damage from subsequent operations. Remove when no longer needed, prior to completion of work.
- B. Control traffic to prevent damage to equipment and surfaces.
- C. Provide coverings to protect finished surfaces from damage.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01700 CONTRACT CLOSEOUT

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Comply with requirements stated in Conditions of the Contract and in Specifications for administrative procedures in closing out the work.

1.02 SUBSTANTIAL COMPLETION

- A. The Contractor shall submit the following items when the Contractor considers the work to be substantially complete:
 - 1. A written notice that the work, or designated portion thereof, is substantially complete.
 - 2. A list of items to be completed or corrected.
- B. Within a reasonable time after receipt of such notice, the County shall make an inspection to determine the status of completion.
- C. Project record documents and operations and maintenance manuals must be submitted before the project shall be considered substantially complete.
- D. If the County determines that the work is not substantially complete:
 - 1. The County shall notify the Contractor in writing, stating the reasons.
 - 2. The Contractor shall remedy the deficiencies in the work and send a second written notice of substantial completion to the County.
 - 3. The County shall reinspect the work.
- E. When the County finds that the work is substantially complete:
 - 1. The Engineer shall prepare and deliver to the County a tentative Certificate of Substantial Completion (Manatee County Project Management Form PMD-8) with a tentative list of the items to be completed or corrected before final payment.
 - 2. The Engineer shall consider any objections made by the County as provided in Conditions of the Contract. When the Engineer considers the work substantially complete, he will execute and deliver to the County a definite Certificate of Substantial Completion (Manatee County Project Management Form PMD-8) with a revised tentative list of items to be completed or corrected.

1.03 FINAL INSPECTION

- A. When the Contractor considered the work to be complete, he shall submit written certification stating that:
 - 1. The Contract Documents have been reviewed.
 - 2. The work has been inspected for compliance with Contract Documents.
 - 3. The work has been completed in accordance with Contract Documents.
 - 4. The equipment and systems have been tested in the presence of the County's representative and are operational.
 - 5. The work is completed and ready for final inspection.

- B. The County shall make an inspection to verify the status of completion after receipt of such certification.
- C. If the County determines that the work is incomplete or defective:
 - 1. The County shall promptly notify the Contractor in writing, listing the incomplete or defective work.
 - 2. The Contractor shall take immediate steps to remedy the stated deficiencies and send a second written certification to County that the work is complete.
 - 3. The County shall reinspect the work.
- D. Upon finding the work to be acceptable under the Contract Documents, the County shall request the Contractor to make closeout submittals.
- E. For each additional inspection beyond a total of three (3) inspections for substantial and final completion due to the incompleteness of the work, the Contractor shall reimburse the County's fees.

1.04 CONTRACTOR'S CLOSEOUT SUBMITTALS TO COUNTY

- A. Project Record Documents (prior to substantial completion).
- B. Operation and maintenance manuals (prior to substantial completion).
- C. Warranties and Bonds.
- D. Evidence of Payment and Release of Liens: In accordance with requirements of General and Supplementary Conditions.
- E. Certification letter from Florida Department of Transportation and Manatee County Department of Transportation, as applicable.
- F. Certificate of Insurance for Products and Completed Operations.
- G. Final Reconciliation, Warranty Period Declaration, and Contractor's Affidavit (Manatee County Project Management Form PMD-9).

1.05 FINAL ADJUSTMENT OF ACCOUNTS

- A. Submit a final statement of accounting to the County.
- B. Statement shall reflect all adjustments to the Contract Sum:
 - 1. The original Contract Sum.
 - 2. Additions and deductions resulting from:
 - a. Previous Change Orders
 - b. Unit Prices
 - c. Penalties and Bonuses
 - d. Deductions for Liquidated Damages
 - e. Other Adjustments
 - 3. Total Contract Sum, as adjusted.
 - 4. Previous payments.

5. Sum remaining due.

- C. Project Management shall prepare a final Change Order, reflecting approved adjustments to the Contract Sum which were not previously made by Change Orders.

1.06 FINAL APPLICATION FOR PAYMENT

Contractor shall submit the final Application for Payment in accordance with procedures and requirements stated in the Conditions of the Contract.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01710 CLEANING

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

Execute cleaning during progress of the work and at completion of the work, as required by the General Conditions.

1.02 DISPOSAL REQUIREMENTS

Conduct cleaning and disposal operations to comply with all Federal, State and Local codes, ordinances, regulations and anti-pollution laws.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Use only those cleaning materials which will not create hazards to health or property and which will not damage surfaces.
- B. Use only those cleaning materials and methods recommended by manufacturer of the surface material to be cleaned.
- C. Use cleaning materials only on surfaces recommended by cleaning material manufacturer.

PART 3 EXECUTION

3.01 DURING CONSTRUCTION

- A. Execute periodic cleaning to keep the work, the site and adjacent properties free from accumulation of waste materials, rubbish and wind-blown debris, resulting from construction operations.
- B. Provide on-site containers for the collection of waste materials, debris and rubbish.
- C. Remove waste materials, debris and rubbish from the site periodically and dispose of at legal disposal areas away from the site.

3.02 DUST CONTROL

- A. Clean interior spaces prior to the start of finish painting and continue cleaning on an as-needed basis until painting is finished.
- B. Schedule operations so that dust and other contaminants resulting from cleaning process will not fall on wet or newly-coated surfaces.

3.03 FINAL CLEANING

- A. Employ skilled workmen for final cleaning.
- B. Broom clean exterior paved surfaces; rake clean other surfaces of the grounds.

- C. Prior to final completion or County occupancy, Contractor shall conduct an inspection of sight-exposed interior and exterior surfaces and all work areas to verify that the entire work is clean.

END OF SECTION

SECTION 01720 PROJECT RECORD DOCUMENTS

PART 1 STANDARDS

1.01 MINIMUM RECORD DRAWING STANDARDS FOR ALL RECORD DRAWINGS SUBMITTED TO MANATEE COUNTY

- A. Record drawings shall be submitted to at least the level of detail in the contract documents. It is anticipated that the original contract documents shall serve as at least a background for all record information. Original drawings in CAD format may be requested of the County.
- B. Record drawings shall meet the criteria of these specifications and the latest edition of Manatee County Public Works Standards, Part I Utilities Standards Manual.

PART 2 STANDARDS

2.01 REQUIREMENTS INCLUDED

- A. Contractor shall maintain at the site for the County one record copy of:
 - 1. Drawings.
 - 2. Specifications.
 - 3. Addenda.
 - 4. Change Orders and other modifications to the Contract.
 - 5. County's field orders or written instructions.
 - 6. Approved shop drawings, working drawings and samples.
 - 7. Field test records.
 - 8. Construction photographs.

2.02 MAINTENANCE OF DOCUMENTS AND SAMPLES

- A. Store documents and samples in Contractor's field office apart from documents used for construction.
 - 1. Provide files and racks for storage of documents.
 - 2. Provide locked cabinet or secure storage space for storage of samples.
- B. File documents and samples in accordance with CSI format.
- C. Maintain documents in a clean, dry, legible, condition and in good order. Do not use record documents for construction purposes.
- D. Make documents and samples available at all times for inspection by the County.

2.03 MARKING DEVICES

- A. Provide felt tip marking pens for recording information in the color code designated by the County.

2.04 RECORDING DRAWINGS PREPARATION

- A. Record information concurrently with construction progress.

- B. Do not conceal any work until required information is recorded.
- C. Record drawings shall be legibly produced to record actual construction. It shall minimally include the following:
1. The Cover Sheet shall include a list of all contractors/subcontractors that performed work to complete the project and their specific role(s).
 2. Record drawings shall have a revision note such as "Record Drawing" in the revision block and a date corresponding to the date the record drawing was issued.
 3. Record drawing notes shall be notably bold, italicized, or boxed ([X]) to identify them as record information.
 4. The drawing scales used in the record drawings shall be the same as were used in the construction drawings, and the sheet number of each record drawing sheet shall be the same as the sheet numbers that were used on the construction drawings from which the record drawings originate. If additional sheets need to be added shall be numbered with a letter following the preceding sheet number: a sheet added between sheet 4 and 5 would be labeled 4a.
 5. All plan, profile, and detail sheets that were used to depict locations and elevations of utility structures in the construction drawings shall be included in the record drawing set.
 6. Record drawings shall accurately depict all existing improvements within the immediate vicinity of the constructed utilities. Existing improvements shall include, but not be limited to:
 1. Sidewalks, walls, fences, road surfaces, buildings, and other utilities,
 2. Areas within utility easements and areas within rights of way,
 3. Areas within 15 feet of potable water mains, reclaimed water mains, sanitary force mains, and gravity sewer mains,
 4. Areas within 10 feet of potable water meters, reclaimed water meters, backflow prevention assemblies, and fire hydrants.
 7. Rights of way, easements, and property corners shall be shown and shall be of sufficient detail as to determine if the constructed utilities are within the easements or rights of way. A reference to the recording document (O.R. Book or Plat Book and Page) shall be included with any depiction of a right-of-way or easement. O.R. Book or Plat Book and Page are not required to be shown on the record drawings of a project for proposed rights of way or proposed easements that will be identified on the proposed final plat for the said project.
 8. Each roadway depicted on the drawings shall have the correct roadway name noted on it.
 9. Horizontal locations required for valves, fittings, services, and other utility structures shall be to the center of each installation.
 - a. Horizontal locations of all features shall be reported to the nearest 0.1 feet.
 10. Vertical elevations of required valves, fittings, services, and other utility structures shall be reported as follows:
 - a. Top of ground or pavement elevations required along pipelines shall be reported to the nearest 0.1 feet.

- b. Top of pipe elevations shall be to the nearest 0.1 feet.
 - c. Elevations of manhole rims and manhole pipe inverts shall be reported to the nearest 0.01 feet.
- 11. Water distribution utility systems, reclaimed water (or irrigation) utility systems, and sanitary sewer collection utility systems shall be located and the locations shall be depicted and noted on the record drawings by Northing and Easting (NAD83 Florida State Planes, West Zone, US Foot), and by Swing-ties, with Elevations relative to established benchmarks. For “single point” installations, swing ties rather than station and offset may be allowed.
- 12. Elements of the utility systems that shall be located and noted by State Plane Northing and Easting and Swing-ties:
 - a. water services (center of meter or meter box),
 - b. reclaimed water (or irrigation) services (center of meter or meter box),
 - c. backflow prevention assembly (directly beneath the assembly),
 - d. other miscellaneous utility structures with features at or above the surface of the ground.
- 13. Elements of the utility systems that shall be located and noted by State Plane Northing and Easting, Swing-ties, and Elevation:
 - a. center of valve cover lids,
 - b. top of nut elevation,
 - c. center of sanitary sewer manhole covers (top of rim for elevations),
 - d. center of lift stations along with quadrant points of round tops / corners of rectangular tops (top of slab for elevations),
 - e. center of above-ground valve assembly slab, along with corners of slab (top of slab for elevation),
 - f. bottom center elevation of the lowest control panel cabinet,
 - g. all fittings, including water and reclaimed water service saddles,
 - h. center of sanitary sewer service clean-out cover (invert of 45° wye that is located directly below the clean-out cover for elevation),
 - i. center of fire hydrants, (center of 5-inch Storz connection nozzle for elevation).
- 14. At locations where a top-of-pipe elevation is required for pipeline, a top-of-ground or top-of-pavement elevation shall also be measured and noted on the drawings.
- 15. Elements of the utility systems that shall be located and noted by elevation only: sanitary sewer manhole inverts of individual sewer pipes where they enter and exit the manhole.
- 16. On record drawings, the actual positions of the pipelines or structures shall be measured, and they shall be depicted in their actual installed positions on the record drawings in all plan and profile views.
- 17. Record information shall include:
 - a. A thorough description of the pipes and all appurtenances that have been installed, including type of material or casing, size, class, diameter ratio, and other basic information, i.e., 45° Bend DI, or 6” PVC (DR18), etc.).

- b. The recalculated slopes of gravity sewer mains, based on the record survey of manhole inverts and lengths of pipes. Rounding up shall not be allowed.
 - c. A bold notation shall be placed on each sheet, near the title block, indicating the status of the electrically detectable path marking tape and/or tracer wire installations. "Electrically detectable path marking tape and tracer wire were installed and successfully tested"; and/or "No electrically detectable path marking tape was required"; and/or "No tracer wire was required." The notation shall also include the date of the successful test"
 - d. For new valves, the manufacture type (as in gate, plug, etc.), size (pipe nominal diameter) and make (manufacturer) of each valve shall be noted on the record drawings.
 - e. Pipelines shall be dimensioned every 200 feet (measured along the centerline) or alternate lot lines, whichever is closer, from the right-of-way to the centerline of the facility.
 - f. Changes made by Field Order or by Change Order.
 - g. Details not on original contract drawings.
 - h. Equipment and piping relocations.
 - i. Centerline of roads shall be tied to right-of-way lines. Elevation of roadway centerline shall be given at PVI's and at all intersections.
 - j. Record drawings shall show bearings and distances for all right-of-way and easement lines, and property corners.
 - k. Sidewalks, fences and walls, if installed at the time of initial record drawing submittal, shall be dimensioned every 200 feet or alternate lot lines, whichever is closer, from the right-of-way line and the back of curb and lot line or easement line.
 - l. Sanitary sewer mainline wyes shall be located from the downstream manhole. These dimensions shall be provided by on-site inspections or televising of the sewer following installation.
18. If applicable, Lift station control and equipment elevations that were shown on the original construction drawing lift station detail sheet shall be measured and the record survey elevations shall be shown on the record drawing revision of the detail sheet. Record pump information, including pump make, model, year of manufacture, serial number, impeller diameter, voltage, horsepower and speed, shall be shown on the record drawing revision of the lift station detail sheet.
19. Also included shall be the "Lift Station Start-up Information Sheet" provided by the pump manufacturer shall be included in the record drawings.
20. Horizontal Directional Drilling (HDD) and Jack-and-Bore locations and elevations shall be shown on the Record Drawing. The Surveyor shall locate the beginning, ending and the surface tracking locations of the driller's log readings, and these locations shall be indicated on the record drawings. The HDD Contractor shall provide a certified report and bore log indicating the horizontal and vertical location at least every 25 lineal feet along the pipe. The horizontal locations on the bore log shall also indicate the location per the stationing of the construction baseline. The information provided by the HDD Contractor shall be depicted on the Record Drawing and identified as having been provided by the HDD Contractor.
21. Abandoned infrastructure shall also be depicted as record information and noted as

“abandoned”.

22. Each sheet of the record drawings shall have the title “RECORD DRAWING” printed on it in large, bold lettering, near the title block. Each sheet shall also have the words “COUNTY MAINTAINED - WATER”, “-SEWER” and/or “- RECLAIMED”, or “PRIVATELY MAINTAINED - WATER”, “- SEWER”, and/or “-RECLAIMED” in large, bold lettering near the title block, and shall clearly define the separation between Public and Private via a text box with a leader arrow.
23. Every set of record drawings shall have a cover sheet with a vicinity map, which shows where the project is located, and the address of the property.
24. Computer drawing files submitted shall be AutoCAD 2016 or later release date versions. All CAD files and referenced CAD files, fonts, plot styles, etc. used to create the signed and sealed record drawings shall be provided and are required to be included in the submitted digital files. Computer drawing files’ format submitted shall be compatible with the County’s current version of AutoCAD, shall be in a .DWG format only, and shall be Windows 10 compatible. (*Tip: Use the e-transmit function of the AutoCad program.*)
25. Properly prepared record drawings on mylar, together with two copies, shall be certified by a design professional (Engineer and/or Surveyor registered in the State of Florida), employed by the Contractor, and submitted to the County.

D. Monumentation Requirements:

1. Record information within the right-of-way shall be referenced by State Plane coordinates and swing-ties.
2. A minimum of one on-site benchmark shall be described including datum. All benchmarks shall be based upon NAVD88. All record drawings shall be in NAVD88.
3. All locations and elevations shall be field located by or under the direct supervision of a Florida Licensed Surveyor and Mapper.

E. Certification Requirements:

1. Record Drawings shall be certified by a Florida Licensed Surveyor and Mapper. The certification shall state that the Record Locations and Elevations depicted on the Record Drawing are true and correct and were collected in the field by the Surveyor and Mapper or by a representative under the direct supervision of the Surveyor and Mapper.
2. Record Drawings shall be certified by the Engineer-of-Record. The certification must state that the improvements have been constructed in substantial conformance with the approved plans.
3. All visible record features, including sewer inverts, must be measured and located by the Surveyor or by personnel under his or her direct supervision. The certifying Surveyor shall be fully responsible for the accuracy of the record locations and elevations shown on the record drawings. However, the Surveyor may include statements on the record drawings indicating the following:
 - a. With the exception of the beginning, ending and the surface locations of the Horizontal Directional Drilling (HDD) log readings, the Horizontal Directional Drilling (HDD) locations and elevations provided by the HDD Contractor have not been field verified.
 - b. State Plane coordinates and offset of pipe fittings are based on PVC pipe markers or 2” x 4” markers inserted by the Contractor on the top of pipe fittings.

- c. State Plane coordinates and elevation of potable water mains, reclaimed water mains, and sanitary force mains are based on PVC pipe markers or 2" x 4" markers inserted by the Contractor on the top of pipe.

F. Specifications and Addenda; Legibly mark each Section to record:

- 1. Manufacturer, trade name, catalog number and supplier of each product and item of equipment actually installed.
- 2. Changes made by field order or by change order.

G. Shop Drawings (after final review and approval):

- 1. Five sets of record drawings for each process equipment, piping, electrical system and instrumentation system.

2.05 SUBMITTAL

A. Prior to substantial completion and prior to starting the bacteria testing of water lines, deliver signed and sealed Record Documents and Record Drawings to the County. These will be reviewed and verified by the inspector. If there are any required changes or additions, these shall be completed and the entire signed and sealed set resubmitted prior to final pay application.

B. The Contractor shall employ a Professional Engineer or Surveyor registered in the State of Florida to verify survey data and properly prepare record drawings. Record drawings shall be certified by the professional(s) (Engineer or Surveyor licensed in Florida), as stipulated by the Land Development Ordinance and submitted on signed and sealed paper drawings, signed and dated mylar drawings together with AutoCAD drawings. Computer drawing files submitted shall be AutoCAD 2016 or later release date versions. All CAD files and referenced CAD files, fonts, plot styles, etc. used to create the signed and sealed record drawings shall be provided and are required to be included in the submitted digital files. Computer drawing files' format submitted shall be compatible with the County's current version of AutoCAD, shall be in a .DWG format only, and shall be Windows 10 compatible.

C. Accompany submittal with transmittal letter, containing:

- 1. Date.
- 2. Project title and number.
- 3. Contractor's name and address.
- 4. Title and number of each Record Document.
- 5. Signature of Contractor or his authorized representative.

Note: The data required to properly prepare these record drawings shall be obtained at the site, at no cost to the County by the responsible design professional or his/her duly appointed representative. The appointed representative shall be a qualified employee of the responsible design professional or a qualified inspector retained by the responsible design professional on a project-by-project basis.

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01730 OPERATING AND MAINTENANCE DATA

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Compile product data and related information appropriate for County's maintenance and operation of products furnished under Contract.
- B. Prepare operating and maintenance data as specified in this and as referenced in other pertinent sections of Specifications.
- C. Instruct County's personnel in maintenance of products and equipment and systems.
- D. Provide three (3) sets of operating and maintenance manuals for each piece of equipment provided within this Contract.

1.02 FORM OF SUBMITTALS

- A. Prepare data in form of an instructional manual for use by County's personnel.
- B. Format:
 - 1. Size: 8-1/2 inch x 11 inch
 - 2. Paper: 20 pound minimum, white, for typed pages
 - 3. Text: Manufacturer's printed data or neatly typewritten
 - 4. Drawings:
 - a. Provide reinforced punched binder tab, bind in with text.
 - b. Fold larger drawings to size of text pages.
 - 5. Provide fly-leaf for each separate product or each piece of operating equipment.
 - a. Provide typed description of product and major component parts of equipment.
 - b. Provide indexed tabs.
 - 6. Cover: Identify each volume with typed or printed title "OPERATING AND MAINTENANCE INSTRUCTIONS". List the following:
 - a. Title of Project.
 - b. Identity of separate structures as applicable.
 - c. Identity of general subject matter covered in the manual.
- C. Binders:
 - 1. Commercial quality three-ring binders with durable and cleanable plastic covers.
 - 2. Maximum ring size: 1 inch.
 - 3. When multiple binders are used, correlate the data into related consistent groupings.

1.03 MANUAL FOR EQUIPMENT AND SYSTEMS

- A. Submit three copies of complete manual in final form.
- B. Content for each unit of equipment and system, as appropriate:
 - 1. Description of unit and component parts.
 - a. Function, normal operating characteristics and limiting conditions.

- b. Performance curves, engineering data and tests.
- c. Complete nomenclature and commercial number of replaceable parts.
- 2. Operating Procedures:
 - a. Start-up, break-in, routine and normal operating instructions.
 - b. Regulation, control, stopping, shut-down and emergency instructions.
 - c. Summer and winter operating instructions.
 - d. Special operating instructions.
- 3. Maintenance Procedures:
 - a. Routine operations.
 - b. Guide to "trouble-shooting".
 - c. Disassembly, repair and reassembly.
 - d. Alignment, adjusting and checking.
- 4. Servicing and lubricating schedule.
 - a. List of lubricants required.
- 5. Manufacturer's printed operating and maintenance instructions.
- 6. Description of sequence of operation by control manufacturer.
- 7. Original manufacturer's parts list, illustrations, assembly drawings and diagrams required for maintenance.
 - a. List of predicted parts subject to wear.
 - b. Items recommended to be stocked as spare parts.
- 8. As installed control diagrams by controls manufacturer.
- 9. Each contractor's coordination drawings.
 - a. As installed color coded piping diagrams.
- 10. Charts of valve tag numbers, with location and function of each valve.
- 11. List of original manufacturer's spare parts, manufacturer's current prices and recommended quantities to be maintained in storage.
- 12. Other data as required under pertinent sections of specifications.

C. Content, for each electric and electronic system, as appropriate:

- 1. Description of system and component parts.
 - a. Function, normal operating characteristics and limiting conditions.
 - b. Performance curves, engineering data and tests.
 - c. Complete nomenclature and commercial number of replaceable parts.
- 2. Circuit directories of panelboards.
 - a. Electrical service.
 - b. Controls.
 - c. Communications.
- 3. As-installed color coded wiring diagrams.
- 4. Operating procedures:
 - a. Routine and normal operating instructions.
 - b. Sequences required.
 - c. Special operating instructions.
- 5. Maintenance procedures:
 - a. Routine operations.
 - b. Guide to "trouble-shooting".
 - c. Disassembly, repair and reassembly.
 - d. Adjustment and checking.
- 6. Manufacturer's printed operating and maintenance instructions.
- 7. List of original manufacture's spare parts, manufacturer's current prices and recommended quantities to be maintained in storage.
- 8. Prepare and include additional data when the need for such data becomes apparent during instruction of County's personnel.

- D. Prepare and include additional data when the need for such data becomes apparent during instruction on County's personnel.
- E. Additional requirements for operating and maintenance data: Respective sections of Specifications.

1.04 SUBMITTAL SCHEDULE

- A. Submit one copy of completed data in final form fifteen days prior to substantial completion.
 - 1. Copy will be returned after substantial completion, with comments (if any).
- B. Submit two copies of approved data in final form. Final acceptance will not be provided until the completed manual is received and approved.

1.05 INSTRUCTION OF COUNTY'S PERSONNEL

- A. Prior to final inspection or acceptance, fully instruct County's designated operating and maintenance personnel in operation, adjustment and maintenance of products, equipment and systems.
- B. Operating and maintenance manual shall constitute the basis of instruction.
 - 1. Review contents of manual with personnel in full detail to explain all aspects of operations and maintenance.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

SECTION 01740 WARRANTIES AND BONDS

PART 1 GENERAL

1.01 REQUIREMENTS INCLUDED

- A. Compile specified warranties and bonds.
- B. Compile specified service and maintenance contracts.
- C. Co-execute submittals when so specified.
- D. Review submittals to verify compliance with Contract Documents.
- E. Submit to County for review and transmittal.

1.02 SUBMITTAL REQUIREMENTS

- A. Assemble warranties, bonds and service and maintenance contracts, executed by each of the respective manufacturers, suppliers and subcontractors.
- B. Number of original signed copies required: Two each.
- C. Table of Contents: Neatly typed, in orderly sequence. Provide complete information for each item.
 - 1. Product or work item.
 - 2. Firm, with name of principal, address and telephone number.
 - 3. Scope.
 - 4. Date of beginning of warranty, bond or service and maintenance contract.
 - 5. Duration of warranty, bond or service maintenance contract.
 - 6. Provide information for County's personnel:
 - a. Proper procedure in case of failure.
 - b. Instances which might affect the validity of warranty or bond.
 - 7. Contractor, name of responsible principal, address and telephone number.

1.03 FORM OF SUBMITTALS

- A. Prepare in duplicate packets.
- B. Format:
 - 1. Size 8-1/2 inch x 11 inch punched sheets for standard 3-ring binder. Fold larger sheets to fit into binders.
 - 2. Cover: Identify each packet with typed or printed title "WARRANTIES AND BONDS". List the following:
 - a. Title of Project.
 - b. Name of Contractor.
- C. Binders: Commercial quality, three-ring, with durable and cleanable plastic covers.

1.04 TIME OF SUBMITTALS

- A. Make submittals within ten days after date of substantial completion and prior to final request for payment.
- B. For items of work, where acceptance is delayed materially beyond date of substantial completion, provide updated submittal within ten days after acceptance, listing date of acceptance as start of warranty period.

1.05 SUBMITTALS REQUIRED

- A. Submit warranties, bonds, service and maintenance contracts as specified in respective sections of Specifications.
- B. Approval by the County of all documents required under this section is a pre-requisite to requesting a final inspection and final payment

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION (NOT USED)

END OF SECTION

DIVISION 2 SITE WORK

SECTION 02064 MODIFICATION OF EXISTING STRUCTURES, PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish all labor, materials, equipment and incidentals required to demolish, modify, alter and/or convert existing structures as shown or specified and as required for the installation of piping, mechanical equipment and appurtenances. Existing piping and equipment shall be removed and dismantled as necessary for the performance of facility alterations in accordance with the requirements herein specified.

PART 2 PRODUCTS

2.01 GENERAL

- A. Epoxy mortar shall be fiberglass fiber mixed with an epoxy filler.
- B. Non-shrink grout shall be a sand-cement, non-metallic formulation, having a minimum 28-day strength of 4,000 psi and 0.0 percent shrinkage per ASTM C1090.
- C. Liners to be installed in existing concrete manholes and wetwells shall be spray-applied, monolithic, reinforced urethane resin. Urethane resin-based manhole liner material shall be resistant to hydrogen sulfide gas, and other common contents found in a sanitary sewer environment.
- D. Refer to the County's Approved Products List for approved concrete manhole and wet well liner products.

PART 3 EXECUTION

3.01 GENERAL

- A. Cut, repair, reuse, excavate, demolish or otherwise remove parts of the existing structures or appurtenances, as indicated on the construction drawings, or as necessary to complete the work as required. Dispose of surplus materials resulting from the above work in an approved manner. The work shall include all necessary cutting and bending of reinforcing steel, structural steel, or miscellaneous metal work found embedded in the existing structures.
- B. Dismantle and remove all existing equipment, piping, and other appurtenances required for the completion of the work. Where called for or required, cut existing pipelines for the purpose of making connections thereto.
- C. Anchor bolts for equipment and structural steel to be removed shall be cut off one inch below the concrete surface. Surfaces shall then be refinished using non-shrink grout or epoxy mortar or as indicated on the construction drawings. Repairs to the interior surfaces of existing concrete structures in sanitary sewers shall be made with epoxy mortar. Repairs to be made on other existing concrete surfaces using non-shrink grout shall be made using a bonding agent such as Acrylbond by Concrete Producers Solutions or an equal approved by the County. Remove all dirt, curing compounds, sealers, paint, rust or other foreign

material, and etch with a muriatic acid solution. Flush with clean water and while still damp, apply a coating of the bonding agent. Place the new grout patch onto the treated area immediately.

- D. At the time that a new connection is made to an existing pipeline, additional new piping, extending to and including a new valve, shall be installed. Pipe restraint devices, if required, shall also be installed as required. At the time when a new potable or reclaimed water service is installed, a pipe locator tracer wire shall be installed and connected to the tracer wire at the main.
- E. No existing structure, equipment, or appurtenance shall be shifted, cut, removed, or otherwise altered except with the expressed approval of and only to the extent approved by the County. All existing valve boxes, fire hydrants, air release valve cabinets, and manholes shall be relocated to meet the new finished grade elevations after construction.
- F. When removing materials or portions of existing utility pipelines or structures or when making openings in walls and partitions, take all precautions and use all necessary barriers and other protective devices so as not to damage the structures beyond the limits necessary for the new work, and not to damage the structures or contents by falling or flying debris. Unless otherwise approved by the County, saw-cutting, rotary core-boring, or line drilling will be required in removing material from existing concrete structures or pipes.
- G. Materials and equipment removed in the course of making alterations and additions shall remain the property of the County, except that items not salvageable, as determined by the County, shall be disposed of off the work site.
- H. All alterations to existing utility pipes and structures shall be done at such time and in such a manner as to comply with the approved time schedule. Before any part of the work is started, all tools, equipment, and materials shall be assembled and made ready so that the work can be completed without delays.
- I. All cutting of existing concrete or other material to provide suitable bonding to new work shall be done in a manner to meet the requirements of the respective section of these Standards covering the new work. When not covered, the work shall be carried on in the manner and to the extent directed by the County or per the construction drawings.
- J. Surfaces of seals visible in the completed work shall be made to match as nearly as possible the adjacent surfaces.
- K. Non-shrink cementitious grout shall be used for setting wall castings, sleeves, leveling pump bases, doweling anchors into existing concrete and elsewhere as shown on the construction drawings. The surface to which grout is to be applied shall be wetted to facilitate good bonding.
- L. Where necessary or required for the purpose of making connections; cut existing pipelines in a manner to provide an approved joint. Where required, use flanges, couplings, or adapters, all as required.
- M. Provide flumes, hoses, piping, pumps and well points, and other related items to divert or provide suitable plugs, bulkheads, or other means to hold back the flow of water or other liquids, all as required in the performance of the work.

- N. Care shall be taken not to damage any part of existing buildings or foundations or outside structures.
- O. Prior to entering confined spaces in sanitary sewer structures, conduct an evaluation of the atmosphere within, in accordance with local, state, and federal regulations. Provide ventilation equipment and other equipment as required to assure safe working conditions.

3.02 CONNECTING TO EXISTING PIPING AND EQUIPMENT

The Contractor shall verify exact location, material, alignment, joint, etc. of existing piping and equipment prior to making the connections called out in the Drawings. The verifications shall be performed with adequate time to correct any potential alignment or other problems prior to the actual time of connection. A County Inspector must be present for all tie-ins for a visual inspection.

3.03 REMOVAL AND ABANDONMENT OF ASBESTOS CEMENT PIPE AND APPURTENANCES

- A. All work associated with the removal or abandonment of existing asbestos cement pipe and appurtenances shall be performed by a licensed asbestos removal Contractor registered in the State of Florida.
- B. The asbestos Contractor shall contact the appropriate regulatory agencies prior to removal or abandonment of any asbestos material and shall obtain all required permits and licenses and issue all required notices. The cost for all fees associated with permits, licenses and notices to the governing regulatory agencies shall be borne by the asbestos Contractor.
- C. All work associated with removal or abandonment of asbestos cement pipe and appurtenances shall be performed in accordance with the standards listed below and all other applicable local, State, or Federal standards.
 - (1) Florida Administrative Code, Chapter 62-257, ASBESTOS PROGRAM
 - (2) Title 40 CFR, Part 61, Subpart M, NATIONAL EMISSION STANDARD FOR ASBESTOS
 - (3) Occupational Safety and Health Act, Title 29 CFR
 - (4) Title 40 CFR, Part 763, ASBESTOS
 - (5) Florida Statute Title XXXII, Chapter 469, ASBESTOS ABATEMENT
- D. All asbestos cement pipe sections indicated on the construction drawings to be removed, and all related tees, valves, fittings and appurtenances shall be removed in their entirety and disposed of by the asbestos Contractor in accordance with this Section. Asbestos cement nipples between tees and valves shall be replaced. After removal of the pipelines, all excavations shall be backfilled in accordance with the applicable provisions of the Trenching and Excavation Section of these Standards. The cost of disposing of the removed materials shall be borne by the asbestos Contractor.
- E. The cutting of existing asbestos-cement (A/C, a.k.a. "Transite") pipe shall be by hand tools only. No powered machine cutting is allowed. Removal of all fragments of pipe shall be double bagged prior to shipment. Longer sections of pipe removed may be shipped without double bagging. An asbestos manifest form must accompany each shipment of such pipe or pipe material waste to the Manatee County Lena Road Landfill. Prior to each shipment, a minimum of 24 hours notice to the Landfill field office (telephone (941) 748-5543) is required.

3.04

IN-PLACE GROUTING OF EXISTING PIPE

- A. Where water and wastewater utility pipes are to be abandoned in place, they shall be filled with a nonshrinking sand-cement grout or cement slurry. When such pipes are made of asbestos-cement materials, the abandonment activities shall be performed by a licensed asbestos Contractor. It is completely the Contractor's responsibility to obtain all regulatory clearances and provide documentation in cases where they have determined that an asbestos-cement pipe abandonment activity by in-place grouting does not require a licensed asbestos Contractor.
- B. The ends of the pipe sections to be grout or slurry filled shall be capped or plugged with suitable pipe fittings. The pumping material shall be of suitable properties and the pumping pressure shall be such that the pipe sections are filled completely with grout or slurry. All above ground features shall be removed: hydrants, meters, valve & meter boxes, pads, vaults, etc. Existing tees, crosses, and valves left in service shall be plugged and restrained.
- C. The County shall be given at least 2 day notice so that the County's representative may be present to monitor all pipe filling operations. Provide standpipes and/or additional means of visual inspection as required to determine if adequate grout/slurry material has filled the entire pipe sections.
- D. All tees, crosses, and valves left in service shall be plugged and restrained.
- E. Existing pipelines that are being grouted and abandoned must be cut and capped at a maximum distance of 2,000 linear foot segments. The caps must have offset grout port on the top side of the cap. The County preferred grout mix in the contract specifications must be used.

F. Approved Grout Mix is shown below:

Materials Per Cubic Yard				
Material	Description	Amount Qty	Specific Gravity	Absolute Volume
Cement	Cement Type I/II ASTM C150	400 lbs	3.15	2.04
Fly Ash	Fly Ash Class F ASTM C618	1350 lbs	2.45	8.83
Total Water	Potable	118 gal.		
Total Water	(includes any admixture water present)	982.9 lbs		15.75
TOTAL CEMENTITIOUS MATERIAL PER ASTM C595		1750 lbs		
Design Percent Air (Entrapped and Entrained)		1.5%		
Slump Range (From Mixer Discharge)		N/A		Absolute Volume 27 CF
Air Content (From Mixer Discharge)		2.0% (±1.5%)		
Plastic Density ("Unit Weight")		101.2 lb/sf		
W/CM Ratio		0.56		
Total Mix Weight		2733 lb/cy		

Note: Grout mix strength shall be 340 psi @ 28 days

3.05 SPRAY-APPLIED LINERS

- A. Use a high-pressure water spray to remove all foreign material from the walls and bench of the structure. Loose or protruding masonry materials shall be removed using a hammer and chisel. Fill any voids, holes or cracks using a hand trowel with epoxy mortar to form a uniform surface. Place covers over all pipe openings to prevent extraneous material from entering the pipes. Block or divert sewer flow from entering the structure. Any infiltration leaks shall be stopped by using such methods as approved by the County.
- B. The liner material shall be sprayed onto the invert, bench and wall areas. The sprayed-on material shall be applied such that the entire structure is lined with a structurally enhanced monolithic liner. The thickness of the wall liner material shall be such that it will withstand the hydraulic load generated by the surrounding groundwater table, using a factor of safety of two, and using the assumption that the groundwater table is at the level of the top of the structure. The invert and bench liner material shall be the same thickness as that required for the base of the wall.

- C. Special care shall be used to provide a smooth transition between the intersecting pipelines and the manhole inverts such that flow is not impaired. Remove concrete material from the existing manhole base channel in depth to the required thickness of the new liner material.
- D. No active sewer flow shall be allowed in the newly lined structure, nor shall any vacuum tests be performed, until the liner material has had adequate time to cure, as recommended by the liner material manufacturer.
- E. Install the coating systems per manufacturer's recommendation and completely protect the structure from corrosion. The liner or coating systems must extend and seal onto manhole ring, onto and around pipe openings and any other protrusions, and completely cover the bench and flow invert. Provide a five (5)-year unlimited warranty on all workmanship and products. The work includes the surface preparation and application of the coating or liner system, and shall protect the structure for at least five (5) years from all leaks and from failure due to corrosion from exposure to corrosive gases such as hydrogen sulfide.

3.06 CONNECTION TO EXISTING MANHOLE

- A. Where required or as indicated on the construction drawings, make connection of new pipelines to existing manhole structures. If pipe stub-outs of the correct size and position are not available, make connections by removing a portion of the manhole wall by mechanical rotary core boring. The connection between pipe and concrete manhole shall be completed with resilient seals meeting the requirements of ASTM C923 and according to the latest edition of the County's Approved Products List.
- B. A new channel shall be formed in the manhole base by removing and reforming or by providing new concrete to convey the new flow into the existing channel in accordance with the standard requirements for new sewer manhole structures. Flow direction shall not change by more than 90 degrees within the manhole base.
- C. Repair internal coating of existing manholes cored during connection of new sewers by applying approved coating material as listed in the County's Approved Products List in accordance with the manufacturer's recommendations. If the existing manhole is lined with a non-conforming liner, sandblast the interior of the existing manhole and apply an approved coating in accordance with the manufacturer's recommendations.
- D. When connecting a force main to an existing manhole, the force main termination manhole and the next two manholes downstream shall be rehabilitated and lined with a liner listed in the County's Approved Products List . If the existing manholes are lined with a non-conforming liner, the existing liner shall be removed and replaced, unless otherwise noted on the plans or with written approval by the County.

END OF SECTION

SECTION 02100 SITE PREPARATION

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. This Section covers general site preparation such as, clearing, grubbing, stripping of the project site and/or along the pipeline route, grading, dust abatement, etc.
- B. The Contractor shall clear and grub all of the area within the limits of construction or as required, which includes, but is not limited to utility easements. The width of the area to be cleared shall be reviewed by the County prior to the beginning of any clearing.
- C. The Contractor's attention is directed to any Soil Erosion and Sediment Control Ordinances enforced in Manatee County. The Contractor shall comply with all applicable sections of these ordinances.

PART 2 PRODUCTS (NOT USED)

PART 3 EXECUTION

3.01 CLEARING

The surface of the ground, for the area to be cleared and grubbed shall be completely cleared of all timber, brush, stumps, roots, grass, weeds, rubbish and all other objectionable obstructions resting on or protruding through the surface of the ground. However, trees shall be preserved as hereinafter specified unless otherwise designated by the County. Clearing operations shall be conducted so as to prevent damage to existing structures and installations and to those under construction, so as to provide for the safety of employees and others. Soil erosion control devices such as hay bales and silt fences shall be installed to satisfy all Federal, State and County requirements.

3.02 GRUBBING

Grubbing shall consist of the complete removal of all stumps, roots larger than 1-1/2 inches in diameter, matted roots, brush, timber, logs and any other organic or metallic debris not suitable for foundation purposes, resting on, under or protruding through the surface of the ground to a depth of 18 inches below the subgrade. All depressions excavated below the original ground surface for or by the removal of such objects, shall be refilled with suitable materials and compacted to a density conforming to the surrounding ground surface.

3.03 STRIPPING

In areas so designated, topsoil shall be stockpiled. Topsoil so stockpiled shall be protected until it is placed as specified. The County shall have the option to receive all excess topsoil materials. The Contractor shall pay all equipment and labor cost to deliver excess top soil material to a remote site chosen by the County within a five mile radius of the construction site. Should the County not choose to receive any or all excess topsoil materials, the Contractor shall dispose of said material at no additional cost to the County.

3.04 DISPOSAL OF CLEARED AND GRUBBED MATERIAL

The Contractor shall dispose of all material and debris from the clearing and grubbing operation by hauling such material and debris off site. The cost of disposal (including hauling) of cleared and grubbed material and debris shall be considered a subsidiary obligation of the Contractor; the cost of which shall be included in the prices bid for the various classes of work.

3.04 DUST ABADEMENT

It is the responsibility of the Contractor to control all dust problems that may occur during the construction, with required watering. Dust control will be required seven days a week.

3.05 PRESERVATION OF TREES

Those trees which are not designated for removal by the County shall be carefully protected from damage. The Contractor shall erect such barricades, guards and enclosures as may be considered necessary by him for the protection of the trees during all construction operation.

3.06 PRESERVATION OF DEVELOPED PRIVATE PROPERTY

- A. The Contractor shall exercise extreme care to avoid unnecessary disturbance of developed private property adjacent to proposed project site. Trees, shrubbery, gardens, lawns and other landscaping, which are not designated by the County to be removed, shall be replaced and replanted to restore the construction easement to the condition existing prior to construction.
- B. All soil preservation procedures and replanting operations shall be under the supervision of a nursery representative experienced in such operations.
- C. Improvements to the land such as fences, walls, outbuildings and other structures which of necessity must be removed, shall be replaced with equal quality materials and workmanship.
- D. The Contractor shall clean up the construction site across developed private property directly after construction is completed upon approval of the County.

3.07 PRESERVATION OF PUBLIC PROPERTY

The appropriate paragraphs of these Specifications shall apply to the preservation and restoration of public lands, parks, rights-of-way, easements and all other damaged areas. This includes, but is not limited to the trimming of trees damaged by contractor's equipment.

END OF SECTION

SECTION 02220 EXCAVATION, BACKFILL, FILL AND GRADING FOR STRUCTURES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Structural excavation shall consist of the removal of material for the construction of foundations for structures and other excavation designated on the drawings or in these specifications.
- B. Structural excavation and backfill shall consist of furnishing material, if necessary and placing and compacting backfill material around structures to the lines and grades designated on the drawings, as specified or directed by the County.
- C. Structural excavation and backfill shall include the furnishing of all materials, equipment and other facilities which may be necessary to perform the excavations, place and compact the backfill, install sheeting and bracing, and carry out any necessary dewatering. It shall also include the wasting or disposal of surplus excavated material in a manner and in locations approved by the County.
- D. The Contractor is responsible for the protection of every tree which is scheduled to remain in the project area. This includes trees which may or may not be shown on the plans. Every tree shall be adequately protected in place at no additional cost to the County. This includes, but is not limited to, protecting the root systems and adjusting grades as necessary for tree/root protection.

1.02 QUALITY ASSURANCE

- A. Testing Agency:
 - 1. In place soil compaction tests shall be performed by a qualified testing laboratory.
 - 2. Compaction tests shall be taken every 500 feet, except in the road crossings or road shoulders. Tests are to be taken according to current FDOT Standards.
- B. Reference Standards:
 - 1. American Society for Testing and Materials (ASTM):
 - a. ASTM D1557, Moisture-Density Relations of Soils Using 10-lb. (4.5-kg) Rammer and 18-in. (457-mm) Drop.

1.03 JOB CONDITIONS

- A. The Contractor shall provide, operate and maintain all necessary pumps, discharge lines, well points, etc., in sufficient number and capacity to keep all excavation, bases, pits, etc., free from seepage, standing or running water at all times throughout the period of construction.
- B. The Contractor shall assume all responsibility for the security of the excavation required, employing bracing, lining or other accepted means necessary to accomplish same.
- C. Excavated areas shall be cleared of all debris, water, slush, muck, clay and soft or loose earth and shall be conditioned to the entire satisfaction of the County.

- D. All excavated material unsuitable for use or which will not be used shall be disposed of in a manner consistent with State and County regulation.
- E. All unsuitable organic materials, roots, logs, etc., found during excavation shall be removed by the Contractor and the trench shall be refilled with suitable material.

PART 2 PRODUCTS

2.01 MATERIAL FOR CONTROLLED FILL

- A. Composition: Only approved material free from organic matter and lumps of clay, shall be used for backfill. Excavated earth free from debris or organic material may be used for backfilling foundations or fill.
- B. Crushed stone and shell shall meet or exceed current FDOT Standards.

2.02 MATERIAL FOR SHORING AND SHEETING

Wood for shoring and sheeting shall be green, rough cut hardwood planking.

2.03 UNSUITABLE MATERIAL

Unsuitable material shall be defined as highly organic soil per ASTM D2487 Group PT. This includes, but is not limited to, such items as topsoil, roots, vegetable matter, trash, debris, and clays that cannot be dried sufficiently to obtain specified compaction.

PART 3 EXECUTION

3.01 INSPECTION

- A. The Contractor shall verify that work preceding the affected work of this Section has been satisfactorily completed.
- B. Conditions adversely affecting the work of this Section shall be corrected to the satisfaction of the County.

3.02 REMOVAL OF UNSUITABLE MATERIALS

- A. The Contractor shall remove unsuitable material from within the limits of the Work.
- B. Materials meeting requirements for controlled fill shall be stockpiled as necessary and in such a manner satisfactory to the County.
- C. All material excavated shall be placed so as to minimize interference with public travel and to permit proper access for inspection of the work.

3.03 EXCAVATION

- A. When concrete or shell subbase footing is to rest on an excavated surface, care shall be taken not to disturb the natural soil. Final removal and replacement of the foundation material and subbase compaction to grade shall not be made until just before the concrete or masonry is placed.

- B. When any structural excavation is completed, the Contractor shall notify the County who will make an inspection of the excavation. No concrete or masonry shall be placed until the excavation has been approved by the County.
- C. The elevations of the footing bottom and the base slab as shown on the Drawings, shall be considered as approximate and the County may order in writing, such changes in dimensions or elevations of the footings and slab base as necessary to secure satisfactory foundations.
- D. All excavation shall be made within an area bounded by lines five feet outside and parallel to the exterior walls of the structure to allow for correct forming, shoring and inspection of foundation work. Pouring of concrete against earth side walls shall not be permitted.
- E. If the ground is excavated below the grade called for by the Drawings or becomes unstable due to the Contractor's carelessness or operations, the ground shall be excavated to undisturbed native soil before continuing concreting operations.
- F. If in the opinion of the County, the material at or below the normal grade of the bottom of the trench is unsuitable for pipe or structure foundation, it shall be removed to the depth directed by the County and if so directed, replaced by crushed stone or washed shell.

3.04 INSTALLATION OF SHORING AND SHEETING

- A. The Contractor shall furnish, install and maintain sheeting and bracing required to support the sides of excavations, to prevent any movement which could in any way diminish the width of the excavation below which is necessary for proper construction and to protect adjacent structures from undermining or other damage. If the County determines that insufficient or improper supports have been provided, additional supports shall be installed at the expense of the Contractor. Compliance with such orders shall not relieve or release the Contractor from his responsibility for the sufficiency of such supports. Care shall be taken to prevent voids outside of the sheeting. Should voids form, they shall be immediately filled and rammed.
- B. The Contractor shall embed and leave in place all sheeting, bracing and other related items as shown on the Contract Drawings. The County may direct that sheeting and bracing timber be cut off at a specified elevation. No additional payment or compensation shall be made for this work.
- C. Sheeting and bracing not left in place shall be removed carefully in such manner as not to endanger other structures, utilities, property, or proposed construction.
- D. The County may order sheeting and bracing to be left in place; however, this shall not relieve the Contractor from liability for damages to persons or property due to negligence or the failure on the part of the Contractor to leave in place sufficient sheeting and bracing to prevent any caving or moving of the ground.
- E. The Contractor shall receive no payment other than that included in the pipe bid item price for any timber used for sheeting, bracing, or other related items.

3.05 STRUCTURAL BACKFILL

- A. Structural backfill shall not be placed until the footings or other portions of the structure or facility have been inspected by the County and approved for backfilling.

- B. A minimum of 1-1/2" layer of lean concrete shall be placed as a working mat for the concrete base slabs and footings if required by the County.
- C. Fill shall be placed in uniform layers not more than 12" thick and compacted to a minimum of 98 percent of the maximum density determined by ASTM D1557, Method A or C, or as directed by the County. The Contractor shall securely tamp the backfill with pneumatic rammer around all wall foundations. The method of compaction shall be satisfactory to the County.
- D. Compaction of structural backfill by ponding and jetting may be permitted when, as determined by the County: the backfill material is of such character that it will be self-draining when compacted; foundation materials will not soften or be otherwise damaged by the applied water; no damage from hydrostatic pressure will result to the structure. Ponding and jetting within two feet below finished subgrade shall not be permitted in roadway areas. At the discretion of the County, ponding and jetting may be permitted with compaction layers not to exceed four feet.
- E. Surplus material not used on-site shall be removed and disposed of off-site by the Contractor. In no case shall surplus material be deposited on adjacent lands. Fill used for grading shall be placed in layers not to exceed 12 inches in thickness and shall be compacted to a density equal or greater to that of the surrounding natural ground.

3.06 BACKFILLING AROUND STRUCTURES

- A. Common fill and structural fill are specified for use as backfill against the exterior walls of the structures. Fill shall be placed in layers having a maximum thickness of eight (8) inches in loose state and shall be compacted sufficiently to prevent settlement. If compaction is by rolling or ramming, material shall be wetted down as required. Where material can be suitably compacted by jetting or puddling, the Contractor may use one of these methods. No boulders shall be allowed to roll down the slopes and hit the walls.
- B. Backfilling shall be carried up evenly on all walls of an individual structure simultaneously. A variation of two (2) feet in elevation will be the maximum allowable. No backfill shall be allowed against walls until the walls and their supporting slabs, if applicable, have attained sufficient strength. Backfilling shall be subjected to approval by the County.
- C. In locations where pipes pass through building walls, the Contractor shall take the following precautions to consolidate the refill up to an elevation of at least one foot above the bottom of the pipes:
 - 1. Place structural fill in such areas for a distance of not less than three feet either side of the center line of the pipe in level layers not exceeding 6-inches in depth.
 - 2. Wet each layer to the extent directed and thoroughly compact each layer with a power tamper to the satisfaction of the County.
 - 3. Structural fill shall be of the quality specified under Part 2 of this Section.
- D. The surface of filled areas shall be graded to smooth true lines, strictly conforming to grades indicated on the grading plan. No soft spots or uncompacted areas shall be allowed in the work.
- E. Temporary bracing shall be provided as required during construction of all structures to protect partially completed structures against all construction loads, hydraulic pressure and

earth pressure. The bracing shall be capable of resisting all loads applied to the walls as a result of backfilling.

3.07 FIELD QUALITY CONTROL

- A. The density of soil in place shall be a minimum of 95 percent in accordance with ASTM D1557, Method A or C.

END OF SECTION

SECTION 02221 TRENCHING, BEDDING AND BACKFILL FOR PIPE

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals necessary to perform all dewatering, excavation, backfill, fill, grading, trench protection or other related work required to complete the piping work shown on the Drawings and specified herein. The work shall include, but not be limited to: vaults; duct conduit; pipe; roadways and paving; backfilling; required fill or borrow operations; grading; disposal of surplus and unsuitable materials; and all related work such as sheeting, bracing and dewatering.
- B. Prior to commencing work, the Contractor shall examine the site and review test borings if available, or undertake his own subsurface investigations and take into consideration all conditions that may affect his work.
- C. The Contractor is responsible for the protection of every tree which is scheduled to remain in the project area. This includes trees which may or may not be shown on the plans. Every tree shall be adequately protected in place at no additional cost to the County. This includes, but is not limited to protecting the root systems and adjusting grades as necessary for tree/root protection.

1.02 PROTECTION

- A. Sheeting and Bracing in Excavations:
 - 1. In connection with construction of underground structures, the Contractor shall properly construct and maintain cofferdams. These shall consist of: sheeting and bracing as required to support the sides of excavations, to prevent any movement which could in any way diminish the width of the excavation below that necessary for proper construction and to protect adjacent structures, existing yard pipe and/or foundation material from disturbance, undermining, or other damage. Care shall be taken to prevent voids outside of the sheeting, but if voids are formed, they shall be immediately filled and rammed.
 - 2. Trench sheeting for pipes: no sheeting is to be withdrawn if driven below, mid-diameter of any pipe and no wood sheeting shall be cut off at a level lower than one foot above the top of any pipe unless otherwise directed by the County. During the progress of the work, the County may direct the Contractor in writing to leave additional wood sheeting in place. If steel sheeting is used for trench sheeting, removal shall be as specified above, unless written approval is given for an alternate method of removal.
 - 3. All sheeting and bracing not left in place shall be carefully removed in such a manner as not to endanger the construction or other structures, utilities, existing piping, or property. Unless otherwise approved or indicated on the Drawings or in the Specification, all sheeting and bracing shall be removed after completion of the piping or structure, care being taken not to disturb or otherwise injure the pipeline or finished masonry. All voids left or caused by withdrawal of sheeting shall be immediately refilled with sand by ramming with tools specifically made for that purpose, by watering, or as may otherwise be directed.

4. The Contractor shall construct, to the extent he deems it desirable for his method of operation, the cofferdams and sheeting outside the neat lines of the pipeline trench or foundation unless otherwise indicated on the Drawings or directed by the County. Sheeting shall be plumb and securely braced and tied in position. Sheeting, bracing and cofferdams shall be adequate to withstand all pressures to which the pipeline or structure will be subjected. Pumping, bracing and other work within the cofferdam shall be done in a manner to avoid disturbing any construction of the pipeline or the enclosed masonry. Any movement or bulging which may occur shall be corrected by the Contractor at his own expense so as to provide the necessary clearances and dimensions.
5. Drawings of the cofferdams and design computations shall be submitted to the County and approved prior to any construction. However, approval of these drawings shall not relieve the Contractor of the responsibility for the cofferdams. The drawings and computations shall be prepared and stamped by a Registered Professional Engineer in the State of Florida and shall be in sufficient detail to disclose the method of operation for each of the various stages of construction, if required, for the completion of the pipeline and substructures.

B. Dewatering, Drainage and Flotation

1. The Contractor shall construct and place all pipelines, concrete work, structural fill, bedding rock and limerock base course, in-the-dry. In addition, the Contractor shall make the final 24" of excavation for this work in-the-dry and not until the water level is a minimum of 18 inches below proposed bottom of excavation.
2. The Contractor shall, at all times during construction, provide and maintain proper equipment and facilities to remove promptly and dispose of properly all water entering excavation and keep such excavations dry so as to obtain a satisfactory undisturbed subgrade foundation condition until the fill, structure, or pipes to be built thereon have been completed to such extent that they will not be floated or otherwise damaged by allowing water levels to return to natural elevations. At all times during the construction operations, the groundwater levels shall be maintained at an elevation 18 inches below the lowest level where structures are being installed.
3. Dewatering shall at all times be conducted in such a manner as to preserve the natural undisturbed bearing capacity of the subgrade soils at proposed bottom of excavation.
4. Wellpoints may be required for dewatering the soil prior to final excavation for deeper in-ground structures or piping and for maintaining the lowered groundwater level until construction has been completed to avoid the structure, pipeline, or fill from becoming floated or otherwise damaged. Wellpoints shall be surrounded by suitable filter sand and no fines shall be removed by pumping. Pumping from wellpoints shall be continuous and standby pumps shall be provided.
5. The Contractor shall furnish all materials and equipment to perform all work required to install and maintain the proposed drainage systems for handling groundwater and surface water encountered during construction of structures, pipelines and compacted fills.
6. Where required, the Contractor shall provide a minimum of two operating groundwater observation wells at each structure to determine the water level during

construction of the pipeline or structure. Locations of the observation wells shall be at structures and along pipelines as approved by the County prior to their installation. The observation wells shall be extended to 6 inches above finished grade, capped with screw-on caps protected by 24" x 24" wide concrete base and left in place at the completion of this Project.

7. Prior to excavation, the Contractor shall submit his proposed method of dewatering and maintaining dry conditions to the County for approval. Such approval shall not relieve the Contractor of the responsibility for the satisfactory performance of the system. The Contractor shall be responsible for correcting any disturbance of natural bearing soils for damage to pipeline or structures caused by an inadequate dewatering system or by interruption of the continuous operation of the system as specified.
8. As part of his request for approval of a dewatering system, the Contractor shall demonstrate the adequacy of the proposed system and wellpoint filter sand by means of a test installation. Discharge water shall be clear, with no visible soil particles in a one quart sample. Discharge water shall not flow directly into wetlands or Waters of the State as defined by FDEP and SWFWMD.
9. During backfilling and construction, water levels shall be measured in observation wells located as directed by the County.
10. Continuous pumping will be required as long as water levels are required to be below natural levels.

PART 2 PRODUCTS

2.01 MATERIALS

A. General

1. Materials for use as fill and backfill shall be described below and shall be from an FDOT certified pit. For each material, the Contractor shall notify the County of the source of the material and shall furnish the County, for approval, a representative sample weighing approximately 50 pounds, at least ten calendar days prior to the date of anticipated use of such material.
2. Additional materials shall be furnished as required from off-site sources and hauled to the site.

B. Bedding - shall conform to FDOT Standard Specifications for Road and Bridge Construction, Section 901 Coarse Aggregate, and shall be either coarse aggregate of Size No. 57 or coarse sand of Size No. 9. Washed shell size No.57 may be used as an alternate bedding material.

C. Wood for shoring and sheeting shall be green, rough cut hardwood planking.

D. Structural Fill

1. Structural fill in trenches shall be used below spread footing foundations, slab-on-grade floors and other structures as backfill within three feet of the below grade portions of structures.

2. Shall be either soil classification A-1, A-2 or A-3, per AASHTO M-145, and shall be free of organic matter, lumps of clay or marl, muck, compressible materials, and rock exceeding 2.5 inches in diameter. Broken concrete, masonry, rubble or other similar materials shall not be used as backfill. Minimum acceptable density shall be 98 percent of the maximum density as determined by AASHTO T-180.
- E. Selected Common Fill - shall have the same material classification and requirements as Structural Fill, as described above.
- F. Common Fill
1. Shall be either soil classification A-1, A-2, A-3, A-4, A-5 or A-6, per AASHTO M-145, and shall be free of organic matter, lumps of clay or marl, muck, compressible materials and rock exceeding 2.5 inches in diameter. Broken concrete, masonry, rubble or other similar materials shall not be used as backfill.
 2. Material falling within the above specification, encountered during the excavation, may be stored in segregated stockpiles for reuse. All material which, in the opinion of the County, is not suitable for reuse shall be spoiled as specified herein for disposal of unsuitable materials by the Contractor.
- G. Unsuitable Material - soil classification A-7 and A-8, per AASHTO M-145, shall not be used as backfill material.

PART 3 EXECUTION

3.01 EXCAVATION

- A. Excavate trenches and pits for structures to the elevations indicated on the construction drawings. Take special care to avoid over-excavating or disturbing the bottom of the trench or pit, so that the soil at the bottom of the hole remains in a naturally compacted condition. Excavate to widths sufficient to provide adequate working room to install the required structures. Do not excavate the final layer of soil to the designed grade until just before placing the bedding, foundation, pipe, structure, or masonry work required. Remove boulders, rocks, logs or any unforeseen obstacles encountered.
- B. In case the foundation soil found at the bottom of the trench or pit is soft, plastic or mucky, or does not conform to the soils classification specified as suitable foundation material, over-excavation to a greater depth will be required. Soils not meeting the classification required for foundation material shall be removed to a depth at least four inches below the bottom of the pipe, bedding or structure bottom elevation. Rock, boulders or other hard or lumpy material shall be removed to a depth 12 inches below the bottom of the pipe, bedding or structure bottom elevation. Remove muck, clay or other soft material to a depth as needed to establish a firm foundation.
- C. Where possible, the sides of trenches should be vertical up to at least the spring line of the installed pipe.
- D. Trench excavation shall be performed in accordance with Florida Statute Title XXXIII, Chapter 553, Part III, Trench Safety Act.

3.02 BACKFILLING

- A. Backfill materials shall be placed on solid, firm, naturally compacted or compacted to 98 percent of the maximum dry density of the material as determined by AASHTO T-180, dry or dewatered in place soil foundations.
- B. Where over-excavation is required due to nonconforming soil classification or rocky, unstable, or otherwise undesirable soil conditions, place Structural Fill or Selected Common Fill in the over-excavated zone up to the base of the bedding material layer. Compact the over-excavated zone to 98 percent of the maximum dry density of the material as determined by AASHTO T-180.
- C. When backfilling in an over-excavated zone where moist or watery conditions exist, backfill shall be coarse No. 9 sand or a mixture of No. 57 coarse aggregate with either No. 9 coarse sand, A-1, or A-3 material.
- D. After compaction, backfill material in the over-excavation zone shall form a solid and firm foundation on which to build up successive layers of backfill and structures.
- E. Bedding materials shall be placed on solid, firm soil foundations and shall be compacted to 98 percent of the maximum dry density of the material as determined by AASHTO T-180.
- F. Concrete and masonry structures shall be backfilled using Structural Fill. Backfilling and compaction shall be underneath the structure and carried up evenly on all walls of an individual structure simultaneously. The maximum allowable difference in backfill elevations shall be two feet. No backfilling shall be allowed against concrete or masonry walls until the walls and their supporting slabs have been in place at least seven days or until the specified 28-day strength has been attained. Compaction of Structural Fill underneath the base and along the walls shall be 98 percent of the maximum dry density of the material as determined by AASHTO T-180. The Structural Fill shall be either dried or shall have water added so that the moisture content of the material is within a range that will allow the required density to be achieved.
- G. Trenching backfill for pipe installation shall be Selected Common Fill for the pipe bedding zone. The pipe bedding envelope shall begin at the level four inches, six inches, or nine inches, depending on pipe diameter, below the bottom of the pipe, and shall extend vertically up to a level 12 inches above the top of the pipe. Where the in-place soil material within the four inch, six inch, or nine inch pipe bedding zone beneath the bottom of the pipe meets the soil classification for Selected Common Fill, undercutting of the trench below the bottom of the pipe will not be required. In this case, loosen the soil in the bottom of the trench immediately below the middle third of the pipe diameter, and place the pipe upon it. Where the in-place soil material within the pipe bedding zone does not meet the soil classification for Selected Common Fill, undercutting shall be required, and the bedding zone shall be backfilled with Selected Common Fill. In this case, place the pipe bedding material and leave it in a moderately firm uncompacted condition under the middle third of the pipe diameter, and compact the outer portions of the trench bottom to 98 percent of the maximum dry density. Soils that were over-excavated due to rocky, soft or otherwise unsuitable soil foundation conditions shall also be replaced with Selected Common Fill. Compaction of Selected Common Fill shall be 98 percent of the maximum dry density as determined by AASHTO T-180. Such backfill material shall have an optimized moisture content that will allow the required density to be achieved.
- H. Pipe sections for gravity flow systems shall be laid with spigots downstream and bells upstream. Excavate for pipe bells before laying pipe. Lay pipe true to the lines and grades

indicated on the construction plans. Place backfill material on both sides of the pipe and compact to 98 percent of the maximum dry density of the material as determined by AASHTO T-180. Take special care to effectively fill and compact the material in the haunch areas under the sides of the pipe.

- I. For pipes that are not installed under roadways or driveways, trenching backfill for pipe installation shall be Common Fill above the pipe envelope zone, and shall be compacted to 95 percent of the maximum dry density of the material as determined by AASHTO T-180, and shall have moisture content optimized to allow the required density. For pipes that are installed under roadways or driveways, trenching backfill for pipe installation shall be Selected Common Fill above the pipe envelope zone, and shall be compacted to 98 percent of the maximum dry density of the material as determined by AASHTO T-180, and shall have moisture content optimized to allow the required density. Selected Common Backfill shall be placed in layers not to exceed 6 inches. Common Backfill shall be placed in layers not to exceed 12 inches.
- J. Backfill compaction tests shall be performed every 500 feet in pipe line trenches and for every utility structure. Test reports shall be presented to the County Inspector.

3.03 INSTALLATION OF SHORING AND SHEETING

- A. The Contractor shall furnish, install and maintain sheeting and bracing required to support the sides of excavations, to prevent any movement which could in any way diminish the width of the excavation below which is necessary for proper construction and to protect adjacent structures from undermining or other damage. If the County determines that insufficient or improper supports have been provided, additional supports shall be installed at the expense of the Contractor. Compliance with such orders shall not relieve or release the Contractor from his responsibility for the sufficiency of such supports. Care shall be taken to prevent voids outside of the sheeting. Should voids form, they shall be immediately filled and rammed.
- B. The Contractor shall embed and leave in place all sheeting, bracing and other related items as shown on the Contract Drawings. The County may direct that sheeting and bracing timber be cut off at a specified elevation. No additional payment or compensation shall be made for this work.
- C. Sheeting and bracing not left in place shall be removed carefully in such manner as not to endanger other structures, utilities, property, or proposed construction.
- D. The County may order sheeting and bracing to be left in place; however, this shall not relieve the Contractor from liability for damages to persons or property due to negligence or the failure on the part of the Contractor to leave in place sufficient sheeting and bracing to prevent any caving or moving of the ground.
- E. The Contractor shall receive no payment other than that included in the pipe bid item price for any timber used for sheeting bracing, or other related items.

3.04 GRADING AND CLEAN UP

- A. Surplus and unsuitable soil materials not used on-site shall be removed and disposed of off-site in a manner that is consistent with state and local regulations. In no case shall surplus or unsuitable material be deposited on-site or on adjacent lands.

- B. The surface of backfilled areas shall be graded smooth and true to the lines and grades indicated on the construction plans. No soft spots or uncompacted areas shall be allowed in the work.
- C. Upon completion of the work, leave the work areas and all adjacent areas in a neat and presentable condition, clear of all temporary structures, rubbish and surplus materials. Pile any salvageable materials that have been removed in neat piles for pickup by County crews, unless otherwise directed.

END OF SECTION

**SECTION 02223 EXCAVATION BELOW GRADE AND CRUSHED STONE OR SHELL
REFILL**

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. If in the opinion of the County, the material at or below the normal grade of the bottom of the trench is unsuitable for pipe or structure foundation, it shall be removed to the depth directed by the County and replaced by crushed stone or washed shell.

PART 2 PRODUCTS (NOT USED)

PART 3 MATERIALS

3.01 EXCAVATION AND DRAINAGE

- A. Whatever the nature of unstable material encountered or the groundwater conditions, trench stabilization shall be complete and effective.
- B. Should the Contractor excavate below the grade shown on the Contract drawings because of negligence or for his own convenience; due to failure in properly dewatering the trench; disturbs the subgrade before dewatering is sufficiently complete; he shall be directed by the County to excavate below grade. The work of excavating below grade and furnishing and placing the approved refill material shall be performed at the Contractor's expense.

3.02 REFILL

- A. Soils not meeting the classification required for foundation material shall be removed to a depth at least four inches below the bottom of the pipe, bedding or structure bottom elevation. Rock, boulders or other hard or lumpy material shall be removed to a depth 12 inches below the bottom of the pipe, bedding or structure bottom elevation. Remove muck, clay or other soft material to a depth as needed to establish a firm foundation.

END OF SECTION

SECTION 02260 FINISH GRADING

PART 1 GENERAL

1.01 WORK INCLUDED

- A. The Contractor shall finish grade sub-soil.
- B. The Contractor shall cut out areas to receive stabilizing base course materials for paving and sidewalks.
- C. The Contractor shall place, finish grade and compact top soil.

1.02 PROTECTION

- A. The Contractor shall prevent damage to existing fencing, trees, landscaping, natural features, bench marks, pavement and utility lines. Damage shall be corrected at no cost to the County.

PART 2 PRODUCTS

- A. Topsoil: Shall be friable loam free from subsoil, roots, grass, excessive amount of weeds or other organics, stones, and foreign matter; acidity range (pH) of 5.5 to 7.5; containing a minimum of 4 percent and a maximum of 25 percent organic matter. The Contractor may use topsoil stockpiles on site if they conform to these requirements.

PART 3 EXECUTION

3.01 SUB-SOIL PREPARATION

- A. The Contractor shall rough grade sub-soil systematically to allow for a maximum amount of natural settlement and compaction. Uneven areas and low spots shall be eliminated. Debris, roots, branches or other organics, stones, and sub-soil shall be removed by the Contractor and disposed of in a manner consistent with the latest Manatee County Standards as well as any affected regulatory agency. Should contaminated soil be found, the Contractor shall notify the County.
- B. The Contractor shall cut out areas to sub-grade elevation to stabilize base material for paving and sidewalks and shall be compacted to 98 percent of the maximum dry density of the material as determined by AASHTO T-180, and shall have moisture content optimized to allow the required density.
- C. The Contractor shall bring sub-soil to required profiles and contour grades gradually; and blend slopes into level areas.
- D. The Contractor shall slope the structure grade a minimum of two (2) inches in ten (10) feet unless indicated otherwise on the Drawings.
- E. The Contractor shall cultivate sub-grade to a depth of 3 inches where the topsoil is to be placed. He shall repeat cultivation in areas where equipment use has compacted sub-soil.
- F. The Contractor shall not make grade changes which causes water to flow onto adjacent lands.

3.02 PLACING TOPSOIL

- A. The Contractor shall place topsoil in areas where seeding, sodding and planting is to be performed. He shall place from the following minimum depths, up to finished grade elevations:
 - 1. 6 inches for seeded areas
 - 2. 4-1/2 inches for sodded areas
 - 3. 24 inches for shrub beds
 - 4. 18 inches for flower beds
- B. The Contractor shall use topsoil in a dry state as determined by the County. He shall place the material during dry weather.
- C. The Contractor shall use fine grade topsoil eliminating rough and low areas to ensure positive drainage. He shall maintain levels, profiles and contours of the sub-grades.
- D. The Contractor shall remove stone, roots, grass, weeds, debris, and other organics or foreign material while spreading the material.
- E. The Contractor shall manually spread topsoil around trees, plants and structures to prevent damage which may be caused by grading equipment.
- F. The Contractor shall lightly compact and place the topsoil.

3.03 SURPLUS MATERIAL

- A. The Contractor shall remove surplus sub-soil and topsoil from site at his expense.
- B. The Contractor shall leave stockpile areas and entire job site clean and raked, ready for landscaping operations.

END OF SECTION

SECTION 02276 TEMPORARY EROSION AND SEDIMENTATION CONTROL

PART 1 GENERAL

1.01 DESCRIPTION

- A. The work specified in this Section consists of the design, provision, maintenance and removal of temporary erosion and sedimentation controls as necessary.
- B. Temporary erosion controls include, but are not limited to: grassing, mulching, netting, watering, and the reseeding of on-site surfaces and spoil and borrow area surfaces, interceptor ditches at ends of berms and other such work at those locations which will ensure that erosion during construction will be either eliminated or maintained within acceptable limits as established by the County.
- C. Temporary sedimentation controls include, but are not limited to: silt dams, traps, barriers, and appurtenances at the foot of sloped surfaces which shall ensure that sedimentation pollution will be either eliminated or maintained within acceptable limits as established by the County.
- D. The Contractor is responsible for providing effective temporary erosion and sediment control measures during construction or until final controls become effective.

1.02 REFERENCE DOCUMENTS

- A. Florida Building Code.
- B. FDEP/COE Dredge and Fill Regulations and/or Permit as applicable.
- C. SWFWMD Permit Regulations and/or Permit as applicable.
- D. Florida Stormwater, Erosion and Sedimentation Control Inspector's Manual.

PART 2 PRODUCTS

2.01 EROSION CONTROL

- A. Netting - fabricated of material acceptable to the County.
- B. Seed and sod.

2.02 SEDIMENTATION CONTROL

- A. Bales - clean, seed free cereal hay type.
- B. Netting - fabricated of material acceptable to the County.
- C. Filter stone - crushed stone conforming to Florida Dept. of Transportation specifications.
- D. Concrete block - hollow, non-load-bearing type.
- E. Concrete - exterior grade not less than one inch thick.

PART 3 EXECUTION

3.01 EROSION CONTROL

A. Minimum procedures for grassing shall be:

1. Scarify slopes to a depth of not less than six inches and remove large clods, rock, stumps, roots larger than 1/2 inch in diameter and debris.
2. Sow seed within twenty-four (24) hours after the ground is scarified with either mechanical seed drills or rotary hand seeders.
3. Apply mulch loosely and to a thickness of between 3/4-inch and 1-1/2 inches.
4. Apply netting over mulched areas on sloped surfaces.
5. Roll and water seeded areas in a manner which will encourage sprouting of seeds and growing of grass. Reseed areas which exhibit unsatisfactory growth. Backfill and seed eroded areas.

3.02 SEDIMENTATION CONTROL

A. The Contractor shall install and maintain silt dams, traps, barriers, and appurtenances as shown on the approved descriptions and working drawings. Deteriorated hay bales and dislodged filter stone shall be replaced by the Contractor at his expense.

3.03 PERFORMANCE

A. The Contractor, at his own expense, shall immediately take whatever steps are necessary to correct any deficiencies of the temporary erosion and sediment control measures employed if they fail to produce results or do not comply with the requirements of the State of Florida or any other federal, governmental or regulatory agency.

END OF SECTION

SECTION 02480 LANDSCAPING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment, and incidentals required to install trees, ground cover, and shrubs, to place accessory planting materials, to maintain and guarantee all planted areas. All work shall be in strict accordance with sound nursery practice and shall include maintenance and watering of all of the work of this Contract until final completion and acceptance by the County.
- B. The landscaping shall be performed by a contractor or subcontractor who specializes in landscaping and who is fully familiar and experienced in projects of this type and scope. The landscaping contractor or subcontractor shall be subject to the approval of the County.
- C. The Contractor shall provide all landscaping complete and ready for use as specified in the Contract Documents and as shown on the Drawings.

1.02 SUBMITTALS

- A. The Contractor shall submit to the County for review and approval, shop drawings and complete written maintenance instructions for each type of plant furnished under this Contract.
- B. The Contractor shall submit representative samples of any or all of required accessory planting materials as requested by the County.

1.03 OBSTRUCTIONS BELOW GROUND

- A. The County may change the location of plant material if underground construction, utilities or obstructions are encountered in excavation of planting areas or pits.
- B. The Contractor shall make such changes without additional compensation from the County.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Plant species and size shall conform to those indicated in the Plant List and in plan locations shown on the Drawings. Nomenclature shall conform to the Florida Department of Agriculture: "Grades and Standards for Nursery Plants". The designated authority for identification of plants shall be in conformance with FDOT Standard Specification Section 580-2.1.1 Plants.
- B. Plants shall be sound, healthy, vigorous, free from plant diseases, insects, pests, or their eggs and shall have healthy normal root systems. Plants shall be nursery grown stock, freshly dug. No heeled in, cold storage, or collected stock shall be accepted.
- C. Shape and Form
 - 1. Plant material shall be symmetrical, typical for the variety and species, and shall conform to the measurements specified in the Plant List.

2. Plants used where symmetry is required shall be matched as nearly as possible.
 3. Plants shall not be pruned prior to delivery except as authorized by the County.
 4. All plants shall have been transplanted or root pruned at least once in the past three years.
 5. Unless otherwise noted, street trees shall be free of branches up to six feet, with the single leader well branched, and with straight trunks.
 6. Shrubs shall have been transplanted twice, have fully developed root systems, be heavily canned with foliage to base, fulfill dimensions required, and be typical of species.
 7. Ground covers shall have sturdy fibrous root systems and shall be heavily leafed.
- D. Measurement: The height and/or width of trees shall be measured from the ground or across the normal spread of branches with the plants in their normal position. This measurement shall not include the immediate terminal growth.
- E. Substitutions in plant species or size shall be made only with the written approval of the County.
- F. Ground cover plants shall be planted in beds of four inches of approved topsoil. The beds shall be thoroughly disked into the soil. The compacted and settled finished surface shall be set to the required grade. Plants shall be spaced as described in the Contract Documents or shown on the Contract Drawings, or otherwise directed by the County in accordance with the best practices of the trade.
- G. Planting Soil
1. Soil for backfilling around plants and planting beds shall be a good grade of garden loam as approved by the County. Soil shall be free of heavy clay, coarse sand, stones, lumps, sticks, or other foreign material. The soil shall not be delivered or used in a muddy condition.
 2. The soil shall be taken from ground that has never been stripped. There shall be a slight acid reaction to the soil with no excess of calcium or carbonate. The soil shall be free from excess weeds or other objectionable material.
 3. Soil for trees and shrubs shall be delivered in a loose, friable condition. All trees shall average approximately one cubic yard per tree, except Sabal Palmetto, which shall be planted with clean sand. There shall be a minimum of 4-inches of planting soil in ground cover areas and 1/8 cubic yard per shrub or vine.
 4. No marl shall be allowed in ground cover planting beds.
- H. Before plants are backfilled with planting soil, fertilizer tablets, Agriform 20-10-5 or equal, shall be placed in each pit. The Contractor shall provide three tablets for each tree and one for each shrub or vine.
- I. Tree Staking: All tree staking and bracing shall be included herein in accordance with sound nursery practice and shall be in accordance with the Contract Documents. The Contractor shall furnish all materials required for staking and bracing as approved.
- J. Landscaping stones shall be inert and nonleaching. The Contractor shall provide physical samples for approval prior to installation. Crushed limerock shall not be acceptable.

PART 3 EXECUTION

3.01 PLANTING PROCEDURES

- A. Plant Locations: All plants shall be located as shown on the Drawings, to dimensions if shown, to scale if not dimensioned. Large areas or beds shall be scaled and the plants spaced evenly. Approval by the County is required before any plants may be installed.
- B. Tree Pits: Pits for trees shall be at least two feet greater in diameter than the specified diameter of the ball. Pits shall be of sufficient depth to allow a 12-inch layer of planting soil under the ball when it is set to grade. Bottom of pit shall be loosened prior to backfilling.
- C. Digging and Handling
 - 1. Plants shall be handled at all times so that roots or balls are adequately protected from sun or drying winds. Tops or roots of plant allowed to dry out will be rejected.
 - 2. Balled and burlapped plants shall be moved with firm, natural balls of soil, not less than one foot diameter of ball to every one inch caliper of trunk, and a depth of not less than 2/3 of ball diameter. No plant shall be accepted when the ball of earth surrounding its roots has been cracked or broken. All trees, except palms, shall be dug with ball and burlapped. Root pruning shall have been done at minimum of four weeks before planting at the job.
 - 3. Bare root plants shall be dug with spread of root and of sufficient depth to insure full recovery of plant.
- D. Cabbage Palms (Sable Palmetto):
 - 1. Cabbage Palms shall be taken from moist black sand areas. Only a minimum of fronds shall be removed from the crown to facilitate moving and handling. Clear trunk or overall height shall be as specified after the minimum of fronds have been removed.
 - 2. Cabbage Palms buds shall be tied to a suitable support with a burlap strip, to be left in place until the tree is well established in its new location.
 - 3. Cabbage Palms shall be planted in sand, thoroughly washed in during planting operations, and with a dished or saucer depression left at the soil line for future waterings. Palms with marred or burned trunks will be accepted at the discretion of the County only.
 - 4. Trees moved by winch or crane shall be thoroughly protected from chain marks, girdling or bark slippage by means of burlap, wood battens, or other approved method.
- E. When balled or burlapped plants are set, planting soil shall be carefully tamped under and around the base of the balls to prevent voids. All burlap, rope, wires, etc., shall be removed from the sides and tops of balls, but no burlap shall be pulled from underneath. Roots of bare rooted plants shall be properly spread out and planting soil carefully worked in among them.
- F. All plants shall be set straight or plumb, in locations shown on the Drawings. Except as otherwise specified, plants shall be planted in pits which shall be set at such level that, after settlement, they bear the same relation to the finished grade or the surrounding ground as they bore to the grade of the soil from which they are taken.
- G. Pruning shall be carefully done by experienced plantmen. Prune immediately upon acceptance by the County, including any broken branches, thinning small branches and

tipping back main branches (except main leaders).

- H. Excess soil and debris shall be disposed of off the project site unless ordered stockpiled by the County.

3.02 NORMAL MAINTENANCE OF PLANT MATERIALS

- A. Plant material maintenance shall begin when planting operations start and shall extend until final acceptance of work.
- B. Maintain all plant materials under this Contract to the satisfaction of the County. Maintenance shall include necessary watering, cultivation, weeding, pruning, spraying, tightening and repair to guy wires, removal of dead material, resetting, and other work required to conform with referenced standards and accepted nursery standards as approved.
- C. Plant materials which are in a tilted or in a leaning position shall be properly righted.
- D. After final acceptance by the County and until one calendar year after acceptance of all plantings, the landscaping contractor or subcontractor shall make monthly inspections of materials and report in writing to the County the conditions of the plants and the necessary requirements to keep the plants in a healthy growing condition.

3.03 TREE AND PLANT PROTECTION

- A. The Contractor shall remove all trees (if any) within the limit of landscaping shown on the detail sheet except those designated to be salvaged (if any). Prior to removal of said trees, the Contractor shall obtain a tree removal permit, if required. All other trees in the vicinity of the work shall be protected against damage by the Contractor until all work under the Contract has been completed.
- B. Consult with the County, and remove agreed-on roots and branches which interfere with construction. Employ qualified tree surgeon to remove, and to treat cuts.
- C. Provide temporary barriers to a height of six feet around each group of trees and plants.
- D. Protect root zones of trees and plants
 - 1. Do not allow vehicular traffic or parking.
 - 2. Do not store materials or products.
 - 3. Prevent dumping or refuse or chemically injurious materials or liquids.
 - 4. Prevent puddling or continuous running water.
- E. Carefully supervise excavating, grading, and filling, and subsequent construction operations, to prevent damage.
- F. In case of inadvertent damage to any tree or plant by the Contractor or any of his subcontractors or employees, the Contractor shall provide replacement of each such damaged tree or plant with a new one of acceptable type, size and quality.
- G. Completely remove barricades, including foundations, when construction has progressed to the point that they are no longer needed, and when approved by the County.

- H. Clean and repair damage caused by installation, fill and grade the areas of the site to required elevations and slopes, and clean the area.

3.04 GUARANTEE

The life and satisfactory condition of all plant material planted shall be guaranteed by the Contractor for a minimum of one calendar year. Guarantee shall include complete replacement with material of the same kind and size as in the original work if not in a healthy condition, as determined by the County, at the end of the guarantee period.

3.05 REPLACEMENT

- A. At the end of the guarantee period, any plant required under this Contract that is dead or not in satisfactory growth as determined by the County, shall be removed. Plants replaced shall be guaranteed for 90 days after date of replacement.
- B. Replacement of plants necessary during guarantee period shall be the responsibility of the Contractor, except for possible replacements of plants resulting from removal, vandalism, acts of neglect on the part of others, or acts of God.
- C. All replacements shall be plants of the same kind and size as specified in the Drawings. They shall be furnished and planted as herein specified. The cost shall be the responsibility of the Contractor.

END OF SECTION

SECTION 02485 SEEDING AND SODDING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials and equipment necessary to satisfactorily return all construction areas to their original conditions or better.
- B. Work shall include furnishing and placing seed or sod, fertilizing, planting, watering and maintenance until acceptance by County.

1.02 RELATED WORK NOT INCLUDED

Excavation, filling and grading required to establish elevation shown on the Drawings are included under other sections of these Specifications.

1.03 QUALITY ASSURANCE

- A. It is the intent of this Specification that the Contractor is obliged to deliver a satisfactory stand of grass as specified. If necessary, the Contractor shall repeat any or all of the work, including grading, fertilizing, watering and seeding or sodding at no additional cost to the County until a satisfactory stand is obtained. For purposes of grassing, a satisfactory stand of grass is herein defined as a full lawn cover over areas to be sodded or seeded, with grass free of weeds, alive and growing, leaving no bare spots larger than 3/4 square yard within a radius of 8 feet.
- B. All previously grassed areas where pipelines are laid shall be sodded. All sodding and grassing shall be installed in accordance with these Specifications or as directed by the County.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Fertilizer: The fertilizer shall be of the slow-release type meeting the following minimum requirements: 12 percent nitrogen, 8 percent phosphorus, 8 percent potassium; 40 percent other available materials derived from organic sources. At least 50 percent of the phosphoric acid shall be from normal super phosphate or an equivalent source which will provide a minimum of two units of sulfur. The amount of sulfur shall be indicated on the quantitative analysis card attached to each bag or other container. Fertilizer shall be uniform in composition, dry and free flowing delivered to sites in original unopened containers bearing manufacturer's statement or guarantee.
- B. Seeding/Grassing: The Contractor shall grass all unpaved areas disturbed during construction which do not require sod. All grassing shall be completed in conformance with FDOT Specifications, Sections 570 and 981. The grassed areas shall be mulched and fertilized in accordance with FDOT Specifications, except that no additional payment will be made for mulching, fertilizing and/or watering.
- C. Sodding: Sod shall be provided as required on the construction drawings or at locations as directed by the County in accordance with Florida Department of Transportation, Specifications Section 575 and 981. The Contractor shall furnish Bahia grass sod or match

existing sod. Placement and watering requirements shall be in accordance with FDOT Specifications Section 575, except that no additional payment will be made for placement and/or watering. This cost shall be included in the Contract price bid for sodding.

- D. Topsoil: Topsoil stockpiled during excavation may be used as necessary. If additional topsoil is required to replace topsoil removed during construction, it shall be obtained off site at no additional cost to the County. Topsoil shall be fertile, natural surface soil, capable of producing all trees, plants and grassing specified herein.
- E. Water: It is the Contractor's responsibility to supply all water to the site, as required during seeding and sodding operations and through the maintenance period and until the work is accepted. The Contractor shall make whatever arrangements that may be necessary to ensure an adequate supply of water to meet the needs for his work. He shall also furnish all necessary hose, equipment, attachments and accessories for the adequate irrigation of lawns and planted areas as may be required. Water shall be suitable for irrigation and free from ingredients harmful to plant life.

PART 3 EXECUTION

3.01 INSTALLATION

- A. When the trench backfill has stabilized sufficiently, the Contractor shall commence work on lawns and grassed areas, including fine grading as necessary and as directed by the County.
- B. Finish Grading: Areas to be seeded or sodded shall be finish graded, raked, and debris removed. Soft spots and uneven grades shall be eliminated. The County shall approve the finish grade of all areas to be seeded or sodded prior to seed or sod application.
- C. Areas to be sodded shall be excavated or cut-down to accept the approximate 2" thick sod, so finish grade matches existing. Sod shall not be thrown over top of existing sod or debris.
- D. Protection: Seeded and sodded areas shall be protected against traffic or other use by placing warning signs or erecting barricades as necessary. Any areas damaged prior to acceptance by the County shall be repaired by the Contractor as directed by the County.

3.02 CLEANUP

Soil or similar materials spilled onto paved areas shall be removed promptly, keeping those areas as clean as possible at all times. Upon completion of seeding and sodding operations, all excess soil, stones and debris remaining shall be removed from the construction areas.

3.03 LANDSCAPE MAINTENANCE

- A. Any existing landscape items damaged or altered during construction by the Contractor shall be restored or replaced as directed by the County.
- B. Maintain landscape work for a period of 90 days immediately following complete installation of work or until County accepts project. Watering, weeding, cultivating, restoration of grade, mowing and trimming, protection from insects and diseases, fertilizing and similar operations as needed to ensure normal growth and good health for live plant material shall be included at no additional cost to the County.

3.04

REPAIRS TO LAWN AREAS DISTURBED BY CONTRACTOR'S OPERATORS

Lawn areas planted under this Contract and all lawn areas damaged by the Contractor's operation shall be repaired at once by proper soil preparation, fertilizing and sodding, in accordance with these Specifications.

END OF SECTION

SECTION 02513 ASPHALT CONCRETE PAVING

PART 1 GENERAL

1.01 SCOPE OF WORK

The Contractor shall furnish all labor, materials and equipment necessary to complete all milling asphalt pavement and asphalt concrete paving (including restoration of driveways) as called out on the Contract Documents or as shown on the Drawings.

1.02 QUALITY ASSURANCE

- A. Qualifications of Asphalt Concrete Producer: The only materials permitted shall be furnished by a bulk asphalt concrete producer exclusively engaged in the production of hot-mix, hot-laid asphalt concrete.
- B. Qualification of Testing Agency: The County may employ a commercial testing laboratory to conduct tests and evaluations of asphalt concrete materials and design. The Contractor shall:
 - 1. Provide asphalt concrete testing and inspection service acceptable to County.
 - 2. Include sampling and testing asphalt concrete materials proposed, and tests and calculations for asphalt concrete mixtures.
 - 3. Provide field testing facilities for quality control testing during paving operations.
- C. Requirements of Regulatory Agencies: The Contractor shall comply with the applicable requirements of:
 - 1. Manatee County Utility Operations Department
 - 2. Manatee County Transportation Department
 - 3. State of Florida Dept. of Transportation

1.03 PAVING QUALITY REQUIREMENTS

- A. General: In addition to other specified conditions, the Contractor shall comply with the following minimum requirements:
 - 1. In-place asphalt concrete course shall be tested for compliance with requirements for density, thickness and surface smoothness.
 - 2. Final surface shall be provided of uniform texture, conforming to required grades and cross sections.
 - 3. A minimum of four inch diameter pavement specimens for each completed course shall be taken from locations as directed by the County.
 - 4. Holes from test specimens shall be repaved as specified for patching defective work.
- B. Density:
 - 1. When subjected to 50 blows of standard Marshall hammer on each side of an in place material specimen, densities shall be comparable to a laboratory specimen of same asphalt concrete mixture.
 - 2. The minimum acceptable density of in-place course material shall be 98% of the recorded laboratory specimen density.

- C. Thickness: In-place compacted thicknesses shall not be acceptable if less than the minimum thicknesses shown on the Drawings.
- D. Surface Smoothness:
 - 1. Finished surface of each asphalt concrete course shall be tested for smoothness, using a 10 ft. straightedge applied parallel to and at right angles to centerline of paved areas.
 - 2. Surface areas shall be checked at intervals directed by County.
 - 3. Surfaces shall not be acceptable if they exceed the following:
 - a. Base Course: 1/4 in. in 10 ft.
 - b. Surface Course: 3/16 in. in 10 ft.
 - c. Crowned Surfaces:
 - (1) Test crowned surfaces with a crown template, centered and at right angles to the crown.
 - (2) Surfaces will not be acceptable if varying more than 1/4 in. from the template.

1.04 SUBMITTALS

- A. Samples: The Contractor may be required to provide samples of materials for laboratory testing and job-mix design.
- B. Test Reports: The Contractor shall submit laboratory reports for following materials tests:
 - 1. Coarse and fine aggregates from each material source and each required grading:
 - a. Sieve Analysis: ASTM C136 (AASHTO T 27).
 - b. Unit Weight of Slag: ASTM C29 (AASHTO T 19).
 - c. Soundness: ASTM C88 (AASHTO T 104) for surface course aggregates only.
 - d. Sand Equivalent: ASTM D2419 (AASHTO T 176).
 - e. Abrasion of Coarse Aggregate: ASTM C131 (AASHTO T96), for surface course aggregates only.
 - 2. Asphalt cement for each penetration grade:
 - a. Penetration: ASTM D5 (AASHTO T49).
 - b. Viscosity (Kinematic): ASTM D2170 (AASHTO T 201).
 - c. Flash Point: ASTM D92 (AASHTO T 48).
 - d. Ductility: ASTM D 113 (AASHTO T 51).
 - e. Solubility: ASTM D4 (AASHTO T 44).
 - f. Specific Gravity: ASTM D 70 (AASHTO T 43).
 - 3. Job-mix design mixtures for each material or grade:
 - a. Bulk Specific Gravity for Coarse Aggregate: ASTM C117 (AASHTO T 85).
 - b. Bulk Specific Gravity for Fine Aggregate: ASTM C128 (AASHTO T 84).
 - 4. Uncompacted asphalt concrete mix: Maximum Specific Gravity: ASTM D2041 (AASHTO T209).
 - 5. Compacted asphalt concrete mix:
 - a. Bulk Density: ASTM D 1188 (AASHTO T166).
 - b. Marshall Stability and Flow: ASTM D 1559.
 - 6. Density and voids analysis:
 - a. Provide each series of asphalt concrete mixture test specimens, in accordance with A.I. MS-2 "Mix Design Methods for Asphalt Concrete".
 - b. Use Marshall method of mix design unless otherwise directed or acceptable to the County.
 - c. Report the quantity of absorbed asphalt cement in pounds of dry aggregate,

- percent air voids, and percent voids in mineral aggregate.
7. Sampling and testing of asphalt concrete mixtures for quality control during paving operations:
 - a. Uncompacted asphalt concrete mix.
 - (1) Asphalt Cement Content: ASTM D2172 (AASHTO T164).
 - (2) Penetration of Recovered Asphalt Cement: ASTM D5 (AASHTO T49).
 - (3) Ductibility of Recovered Asphalt Cement: ASTM D113 (AASHTO T51).
 - b. Compacted asphalt concrete mix:
 - (1) Bulk Density: ASTM D1188 (AASHTO T166).
 - (2) Marshall Stability and Flow: ASTM D1559).
 - c. Perform at least one test for each day's paving.
 8. Asphalt plant inspection: ASTM D290.
 9. Additional testing:
 - a. Retesting shall be required if previous tests indicate insufficient values, or if directed by the County.
 - b. Testing shall continue until specified values have been attained.
 10. Asphalt concrete materials which do not comply with specified requirements shall not be permitted in the work.

1.05 JOB CONDITIONS

A. Weather Limitations:

1. Apply bituminous prime and tack coats only when the ambient temperature in the shade is 50 degrees F. and when the temperature has not been below 35 degrees F. for 12 hours immediately prior to application.
2. Do not apply when the base surface is wet or contains an excess of moisture which would prevent uniform distribution and the required penetration.
3. Construct asphalt concrete surface course only when atmospheric temperature is above 40 degrees F., when the underlying base is dry, and when weather is not rainy.
4. Base course may be placed when air temperature is not below 30 degrees F. and rising, when acceptable to the County.

B. Grade Control: Establish and maintain the required lines and grades, including crown and cross-slope, for each course during construction operations.

C. Traffic Control: Maintain vehicular and pedestrian traffic during paving operations, as required for other construction activities.

PART 2 PRODUCTS

2.01 MATERIALS

A. Soil Cement or Shell Base Course: as specified in FDOT Section 270, "Material for Base and Stabilized Base", and as called for in the Contract Documents.

B. Aggregate for Asphalt Concrete, General:

1. Sound, angular crushed stone, crushed gravel, or crushed slag: ASTM D692.
2. Sand, stone, or slag screening: ASTM D1073.
3. Provide aggregate in gradations for various courses to comply with local highway standards.

- C. Surface Course Aggregates:
 - 1. Provide natural sand, unless sand prepared from stone, slag, gravel, or combinations are required to suit local conditions.
- D. Asphalt Cement: Comply with ASTM D946 for 85-100 penetration grade.
- E. Prime Coat:
 - 1. Cut-back liquid asphalt.
 - 2. Medium-Curing type: ASTM D2027, Grade MC-70.

2.02 ASPHALT-AGGREGATE MIXTURES

- A. Job-mix criteria:
 - 1. Provide job-mix formulas for each required asphalt-aggregate mixture.
 - 2. Establish a single percentage of aggregate passing each required sieve size, a single percentage of asphalt cement to be added to aggregate, and a single temperature at which asphalt concrete is to be produced.
 - 3. Comply with the mix requirements of local governing highway standards.
 - 4. Maintain material quantities within allowable tolerances of the governing standards.

2.03 TRAFFIC AND PARKING MARKING MATERIALS

- A. Traffic lane marking paint with chlorinated rubber base.
- B. Factory mixed, quick drying and non bleeding, FS TT-P-115C, Type III.
- C. Color: Driving Lane Dividers - White
No Parking Zone - Yellow
Parking Dividers - White

PART 3 EXECUTION

3.01 SURFACE PREPARATION

- A. Subbase Preparation:
 - 1. The Contractor shall remove from the area all organic substance encountered to a depth of six or eight inches (6" or 8"), or to such depth and width as directed by the County. The entire area shall be plowed and dragged prior to placing a stabilizing additive, if required to meet minimum bearing value.
 - 2. Subbase shall be compacted to a minimum density of 98 percent of the maximum as determined by the Modified Proctor Density AASHTO T180, and shall have a minimum bearing value of 40 pounds per square inch as determined by the Florida Bearing Test.
- B. Base Course:
 - 1. Check subgrade for conformity with elevations and section immediately before placing base material.

2. Place base material in compacted layers not more than 6 inches thick, unless continuing tests indicate the required results are being obtained with thicker layers.
3. In no case will more than 8-inches of compacted base be placed in one lift.
4. Spread, shape, and compact all base material deposited on the subgrade during the same day.
5. Compact base course material to be not less than 98% of maximum density: ASTM D1557, Method D (98 percent maximum density: AASHTO T-180).
6. Test density of compacted base course: ASTM D2167.
7. Conduct one test for each 250 sq. yds. of in-place material, but in no case not less than one daily for each layer.

C. Loose and Foreign Material:

1. Remove loose and foreign material from compacted subbase surface immediately before application of paving.
2. Use power brooms or blowers, and brooming as required.
3. Do not displace subbase material.

D. Prime Coat:

1. Uniformly apply at rate of 0.20 to 0.5 gal. per sq. yd. over compacted and cleaned subbase surface.
2. Apply enough material to penetrate and seal, but not flood the surface.
3. Allow to cure and dry as long as required to attain penetration and evaporation of volatile, and in no case less than 24 hours unless otherwise acceptable to the County.
4. Blot excess asphalt with just enough sand to prevent pick-up under traffic.
5. Remove loose sand before paving.

E. Tack Coat:

1. Dilute material with equal parts of water and apply to contact surfaces of previously constructed asphalt concrete or Portland cement concrete and similar surfaces.
2. Apply at rate of 0.05 to 0.15 gal. per sq. yd. of surface.
3. Apply tack coat by brush to contact surfaces of structures projecting into or abutting asphalt concrete pavement.
4. Allow surfaces to dry until material is at condition of tackiness to receive pavement.

3.02 MANHOLE FRAME / VALVE BOX ADJUSTMENTS (IF APPLICABLE)

A. Placing Manhole frames:

1. Surround manhole frames set to elevation with a ring of compacted asphalt concrete base prior to paving.
2. Place asphalt concrete mixture up to 1 in. below top of frame, slope to grade, and compact by hand tamping.

B. Adjust manhole frames to proper position to meet paving.

C. If permanent covers are not in place, provide temporary covers over openings until completion of rolling operations.

D. Set cover manhole frames to grade, flush with surface of adjacent pavement.

3.03 PREPARING THE MIXTURE

- A. Comply with ASTM D995 for material storage, control, and mixing, and for plant equipment and operation.
- B. Stockpiles:
 - 1. Keep each component of the various-sized combined aggregates in separate stockpiles.
 - 2. Maintain stockpiles so that separate aggregate sizes shall not be intermixed.
- C. Heating:
 - 1. Heat the asphalt cement at the mixing plant to viscosity at which it can be uniformly distributed throughout mixture
 - 2. Use lowest possible temperature to suit temperature-viscosity characteristics of asphalt.
 - 3. Do not exceed 350 degrees F. (176.6 degrees C.).
- D. Aggregate:
 - 1. Heat-dry aggregates to reduce moisture content to not more than 2.0%.
 - 2. Deliver dry aggregate to mixer at recommended temperature to suit penetration grade and viscosity characteristics of asphalt cement, ambient temperature, and workability of mixture.
 - 3. Accurately weigh or measure dry aggregates and weigh or meter asphalt cement to comply with job-mix formula requirements.
- E. Mix aggregate and asphalt cement to achieve 90-95% of coated particles for base mixtures and 85-90% of coated particles for surface mixture, when tested in accordance with ASTM D2489.
- F. Transporting:
 - 1. Transport asphalt concrete mixtures from mixing site in trucks having tight, clean compartments.
 - 2. Coat hauling compartments with a lime-water mixture to prevent asphalt concrete mixture from sticking.
 - 3. Elevate and drain compartment of excess solution before loading mix.
 - 4. Provide covers over asphalt concrete mixture when transporting to protect from weather and to prevent loss of heat.
 - 5. During periods of cold weather or for long-distance deliveries, provide insulation around entire truck bed surfaces.

3.04 EQUIPMENT

- A. Provide size and quantity of equipment to complete the work specified within project time schedule.
- B. Bituminous Pavers: Self-propelled that spread hot asphalt concrete mixtures without tearing, shoving or gouging surfaces, and control pavement edges to true lines without use of stationary forms.
- C. Rolling Equipment:
 - 1. Self-propelled, steel-wheeled and pneumatic-tired rollers that can reverse direction without backlash.
 - 2. Other type rollers may be used if acceptable to the County.
- D. Hand Tools: Provide rakes, lutes, shovels, tampers, smoothing irons, pavement cutters, portable heaters, and other miscellaneous small tools to complete the work specified.

3.05 PLACING THE MIX

- A. Place asphalt concrete mixture on prepared surface, spread and strike-off using paving machine.
- B. Spread mixture at a minimum temperature of 225 degrees F. (107.2 degrees C.).
- C. Inaccessible and small areas may be placed by hand.
- D. Place each course at thickness so that when compacted, it will conform to the indicated grade, cross-section, finish thickness, and density indicated.
- E. Paver Placing:
 - 1. Unless otherwise directed, begin placing along centerline of areas to be paved on crowned section, and at high side of sections on one-way slope, and in direction of traffic flow.
 - 2. After first strip has been placed and rolled, place succeeding strips and extend rolling to overlap previous strips.
 - 3. Complete base courses for a section before placing surface courses.
 - 4. Place mixture in continuous operation as practicable.
- F. Hand Placing:
 - 1. Spread, tamp, and finish mixture using hand tools in areas where machine spreading is not possible, as acceptable to County.
 - 2. Place mixture at a rate that will insure handling and compaction before mixture becomes cooler than acceptable working temperature.
- G. Joints:
 - 1. Carefully make joints between old and new pavements, or between successive days' work, to ensure a continuous bond between adjoining work.
 - 2. Construct joints to have same texture, density and smoothness as adjacent sections of asphalt concrete course.

3. Clean contact surfaces free of sand, dirt, or other objectionable material and apply tack coat.
4. Offset transverse joints in succeeding courses not less than 24 inches.
5. Cut back edge of previously placed course to expose an even, vertical surface for full course thickness.
6. Offset longitudinal joints in succeeding courses not less than 6 inches.
7. When the edges of longitudinal joints are irregular, honeycombed, or inadequately compacted, cut back unsatisfactory sections to expose an even, vertical surface for full course thickness.

3.06 COMPACTING THE MIX

- A. Provide sufficient rollers to obtain the required pavement density.
- B. Begin rolling operations as soon after placing when the mixture will bear weight of roller without excessive displacement.
- C. Do not permit heavy equipment, including rollers to stand on finished surface before it has thoroughly cooled or set.
- D. Compact mixture with hot hand tampers or vibrating plate compactors in areas inaccessible to rollers.
- E. Start rolling longitudinally at extreme lower side of sections and proceed toward center of pavement. Roll to slightly different lengths on alternate roller runs.
- F. Do not roll centers of sections first under any circumstances.
- G. Breakdown Rolling:
 1. Accomplish breakdown or initial rolling immediately following rolling of transverse and longitudinal joints and outside edge.
 2. Operate rollers as close as possible to paver without causing pavement displacement.
 3. Check crown, grade, and smoothness after breakdown rolling.
 4. Repair displaced areas by loosening at once with lutes or rakes and filling, if required, with hot loose material before continuing rolling.
- H. Second Rolling:
 1. Follow breakdown rolling as soon as possible, while mixture is hot and in condition for compaction.
 2. Continue second rolling until mixture has been thoroughly compacted.
- I. Finish Rolling:
 1. Perform finish rolling while mixture is still warm enough for removal of roller marks.
 2. Continue rolling until roller marks are eliminated and course has attained specified density.
- J. Patching:
 1. Remove and replace defective areas.

2. Cut-out and fill with fresh, hot asphalt concrete.
3. Compact by rolling to specified surface density and smoothness.
4. Remove deficient areas for full depth of course.
5. Cut sides perpendicular and parallel to direction of traffic with edges vertical.
6. Apply tack coat to exposed surfaces before placing new asphalt concrete mixture.

3.07 MARKING ASPHALT CONCRETE PAVEMENT

A. Cleaning:

1. Sweep surface with power broom supplemented by hand brooms to remove loose material and dirt.
2. Do not begin marking asphalt concrete pavement until acceptable to the County.

B. Apply paint with mechanical equipment.

1. Provide uniform straight edges.
2. Not less than two separate coats in accordance with manufacturer's recommended rates.

3.08 CLEANING AND PROTECTION

A. Cleaning: After completion of paving operations, clean surfaces of excess or spilled asphalt materials to the satisfaction of the County.

B. Protection:

1. After final rolling, do not permit vehicular traffic on asphalt concrete pavement until it has cooled and hardened, and in no case sooner than 6 hours.
2. Provide barricades and warning devices as required to protect pavement.
3. Cover openings of structures in the area of paving until permanent coverings are placed (if applicable).

END OF SECTION

SECTION 02515 CONCRETE SIDEWALKS, DRIVEWAYS AND GUTTERS

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Contractor shall furnish all labor and materials required to restore and construct concrete sidewalks, driveways and gutters as specified herein.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Sidewalk shall be 3000 psi concrete, at least five (5) feet wide, and four (4) inches thick, except at driveways. Driveway sidewalks shall be six (6) inches thick with six (6) inches by six (6) inches #10 wire mesh reinforcing.
- B. Replacement of concrete driveways shall be in accordance with County Standards (six (6) inches thick, 3000 psi/28 day with six (6) inches x six (6) inches #10 wire mesh from back of curb to property line).
- C. Curb and curb and gutter shall consist of 3000 psi/28 day concrete.
- D. Expansion joints shall be installed between the back-of-curb and concrete driveways, and between concrete driveways and sidewalks, where new concrete abuts old concrete.

PART 3 EXECUTION

3.01 CURB AND GUTTER

- A. Curb or curb and gutter removal, where required in the construction of this work, shall be held to a minimum. Curb and gutter material to be removed shall be carefully separated from the trench excavation material and shall be disposed of as directed. The Contractor shall replace all curb or curb and gutter which has been removed. Curb and gutter shall be removed up to the nearest regular joint on each side of the trench.
- B. Curb or curb and gutter shall be replaced as soon as possible after the backfill is placed and compacted and shall duplicate in all respects the original construction. Workmanship shall be in accordance with the best standard practices for this type of work. Curb and curb and gutter shall consist of 3,000 psi/28 day concrete reinforced with bars or mesh of the same size, spacing and number as the section of curb or curb and gutter it replaces.

3.02 SIDEWALKS

- A. Sidewalk removal, where required in the construction of this work, shall be held to a minimum. Sidewalk material removed shall be carefully separated from the trench excavation material and shall be disposed of as directed. Sidewalk shall be cut at the nearest regular joint on each side of the trench.

- B. The Contractor shall replace all sidewalks which are removed. Sidewalks shall be replaced as soon as practicable after the backfill is placed and compacted and shall duplicate, in all respects, the original sidewalk.
- C. The Contractor shall replace all sidewalks which are damaged by the construction operation or by the heavy equipment traveling over them and shall replace them at their own expense.
- D. The top surface of all sidewalks shall be given a light broom finish.

3.03 DRIVEWAYS

- A. Concrete driveways that are crossed or traversed by the trenches shall be restored to the conditions existing prior to the excavation.
- B. Removal shall be held to a minimum, but when necessary removal shall be made in neat sawcut lines or to the nearest joint if approved by the Engineer.

3.04 TESTS

- A. The quality of the concrete as to conformance to the specifications is the entire responsibility of the Contractor until it is accepted in place. When required by the County or the Engineer, the Contractor shall arrange for field testing. Field testing shall include, but may not be limited to, the following:
 - 1. Compressive Strength Test: Compressive strength tests shall be made by breaking standard six inch diameter by twelve (12) inch high test specimens prepared, cured and broken in accordance with the ASTM Methods C31 and C39, Latest Revision. Four specimen test cylinders shall be taken from each concrete pour of five cubic yards or more. One additional test shall be taken from each fifty (50) cubic yards or fraction thereof in each pour in excess of thirty (30) cubic yards. One cylinder from each pour shall be broken at seven days, the remainder at twenty-eight (28) days. Additional test cylinders may be ordered for determining the characteristics of a new design mix or changes in equipment or methods, and under adverse weather or curing conditions.
 - 2. Slump Test: Slump test shall be made in accordance with ASTM C43, and shall be made on each load of concrete unless directed differently by the County or Engineer.
 - 3. Reports: Proper reports of all tests performed by the laboratory shall be prepared by the laboratory and submitted promptly to the County and Engineer. Such reports shall be properly labeled so as to identify the portions of the Project into which the materials are being placed, and the results of the test indicating whether or not the test met the requirements of these specifications.

3.05 CAUSE FOR REJECTION

- A. Should the concrete fail to conform to all the requirements of this Section, the Engineer may require the Contractor to remove the defective concrete and reconstruct the work as directed.

END OF SECTION

SECTION 02575 PAVEMENT REPAIR AND RESTORATION

PART 1 GENERAL

1.01 SCOPE OF WORK

The Contractor shall furnish all labor, materials, equipment, obtain County or State right-of-way permits and incidentals required and remove and replace pavements over trenches excavated for installation of pipelines and appurtenances as shown on the Contract Drawings.

1.02 GENERAL

- A. The Contractor shall take before and after photographs.
- B. The Contractor shall repair in a manner satisfactory to the County or State, all damage done to existing structures, pavement, driveways, paved areas, curbs and gutters, sidewalks, shrubbery, grass, trees, utility poles, utility pipelines, conduits, drains, catch basin, flagstones, or stabilized areas or driveways and including all obstructions not specifically named herein, which results from this Project.
- C. The Contractor shall keep the surface of the backfilled area of excavation in a safe traffic bearing condition and firm and level with the remaining pavement until the pavement is restored in the manner specified herein. All surface irregularities that are dangerous or obstructive to traffic are to be removed. The repair shall conform to applicable requirements of Manatee County Transportation Department requirements for pavement repair and as described herein, including all base, subbase and asphalt replacement.
- D. All materials and workmanship shall meet or exceed the County requirements and as called for in the Contract Documents and nothing herein shall be construed as to relieve the Contractor from this responsibility.
- E. All street, road and highway repair shall be made in accordance with the FDOT and County details indicated on the Drawings and in accordance with the applicable requirements and approval of affected County and State agencies.

PART 2 PRODUCTS

2.01 PAVEMENT SECTION

- A. Asphaltic concrete shall consist of asphalt cement, coarse aggregate, fine aggregate and mineral filler conforming to FDOT Type S-III and Type S-I Asphalt. Pavement replacement thickness shall match that removed but in no case shall be less than 1-3/4" compacted thickness. All asphalt concrete pavement shall be furnished, installed and tested in accordance with FDOT Specifications for Road and Bridge Construction.
- B. Asphalt or crushed concrete or approved equal base material shall be furnished and installed under all pavement sections restored under this Contract. Asphalt base shall have a minimum 6" compacted thickness, meet requirements for FDOT ABC III (Minimum Marshall Stability of 1000) and be furnished, installed and tested in accordance with the requirements of the FDOT Standards. Crushed concrete base shall be 8" minimum compacted thickness. Crushed concrete aggregate material shall have a minimum LBR of

150 compacted to 98% T-180 AASHTO density. Asphalt base and crushed concrete base are acceptable. Other bases shall be submitted for approval.

- C. Prime and tack will be required and applied in accordance with Section 300 - FDOT Specifications: Prime and Tack Coat for Base Courses.

PART 3 EXECUTION

3.01 CUTTING PAVEMENT

- A. The Contractor shall saw cut in straight lines and remove pavement as necessary to install the new pipelines and appurtenances and for making connections to existing pipelines.
- B. Prior to pavement removal, the Contractor shall mark the pavement for cuts nearly paralleling pipe lines and existing street lines. Asphalt pavement shall be cut along the markings with a rotary saw or other suitable tool. Concrete pavement shall be scored to a depth of approximately two (2) inches below the surface of the concrete along the marked cuts. Scoring shall be done by use of a rotary saw, after which the pavement may be broken below the scoring with a jackhammer or other suitable equipment.
- C. The Contractor shall not machine pull the pavement until it is completely broken and separated along the marked cuts.
- D. The pavement adjacent to pipeline trenches shall neither be disturbed nor damaged. If the adjacent pavement is disturbed or damaged, irrespective of cause, the Contractor shall remove and replace the pavement. In addition, the base and sub-base shall be restored in accordance with these Specifications, Florida Dept. of Transportation Standard Specifications and as directed by the County.

3.02 PAVEMENT REPAIR AND REPLACEMENT

- A. The Contractor shall repair, to meet or exceed original surface material, all existing concrete or asphaltic pavement, driveways, or sidewalks cut or damaged by construction under this Contract. He shall match the original grade unless otherwise specified or shown on the Drawings. Materials and construction procedures for base course and pavement repair shall conform to those of the Florida Dept. of Transportation.
- B. The Contractor's repair shall include the preparation of the subbase and base, place and maintain the roadway surface, any special requirements whether specifically called for or implied and all work necessary for a satisfactory completion of this work. Stabilized roads and drives shall be finished to match the existing grade. Dirt roads and drives shall have the required depth of backfill material as shown on the Contract Drawings.
- C. The asphaltic concrete repairs shall be in accordance with the Manatee County Public Works Standards, Part I Utilities Standards Manual. The asphaltic concrete repairs shall extend the full width and length of the excavation or to the limits of any damaged section. The edge of the pavement to be left in place shall be cut to a true edge with a saw or other approved method so as to provide a clean edge to abut the repair. The line of the repair shall be reasonably uniform with no unnecessary irregularities. The existing asphalt beyond the excavation or damaged section shall be milled 25 feet back from the saw cut. Final overlay shall match existing with no discernable "bump" at joint.

3.03 MISCELLANEOUS RESTORATION

Sidewalks or driveways cut or damaged by construction shall be restored in full sections or blocks as specified in Section 02515. Concrete curb or curb and gutter shall be restored to the existing height and cross section in full sections or lengths between joints as specified in Section 02515. RCP pipe shall be repaired or installed in accordance with manufacturer's specifications. Grassed yards, shoulders and parkways shall be restored to match the existing sections with grass sod of a type matching the existing grass.

3.04 SPECIAL REQUIREMENTS

The restoration of all surfaces, as described herein, disturbed by the installation of pipelines shall be completed as soon as is reasonable and practical. The complete and final restoration of both paved and shell stabilized roads within a reasonable time frame is of paramount importance. To this end, the Contractor shall, as part of his work schedule, complete the restoration of any area of road within five weeks after removing the original surface. Successful leak testing shall be performed prior to restoring any area of road. All restoration and replacement or repairs are the responsibility of the Contractor.

3.05 CLEANUP

After all repair and restoration or paving has been completed, all excess asphalt, dirt and other debris shall be removed from the roadways. All existing storm sewers and inlets shall be checked and cleaned of any construction debris.

3.06 MAINTENANCE OR REPAIR

All wearing surfaces shall be maintained by the Contractor in good order suitable for traffic prior to completion and acceptance of the work.

END OF SECTION

SECTION 02618 CLOSE TOLERANCE HORIZONTAL DIRECTIONAL DRILLING

PART 1 GENERAL REQUIREMENTS AND CONTRACTOR QUALIFICATIONS

1.01 SCOPE

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required to install all pipe, fittings and appurtenances as shown on the Drawings and specified in the Contract Documents by Horizontal Directional Drilling (HDD).
- B. This section covers close tolerance horizontal directional drilled pipelines. Close tolerance HDD (CTHDD) is used in gravity flow installations and shallow depth pressure main installations. The pipe shall be installed in a manner that causes minimal disruption to the surface topography (no pressure humping or damage of driveways, yards and streets).
- C. The Contractor will need to be trained and licensed to provide CTHDD trenchless services within the industry. The Contractor's crew leader shall have completed a minimum of 3 similar installations. Similar installations shall consist of critical line, grade and tight fitted hole bores for gravity flow and pressure main applications in an urbanized area with geological conditions similar to those at the site. River crossing installations and cable or phone duct installations are not considered similar installations due to the significantly different HDD techniques that are involved.

1.02 GENERAL

All existing structures, pipelines, storm drains, utilities, driveways, sidewalks, signs, mail boxes, fences, trees, landscaping, and any other improvement or facility in the construction area that the Contractor disturbs for his own construction purposes shall be replaced to original condition at no additional cost to the County.

1.03 QUALIFICATIONS

- A. Pipe Manufacturer: All pipe and fittings shall be furnished by a single manufacturer who is fully experienced, reputable and qualified in the manufacture of the items to be furnished.
- B. The Contractor shall submit, to the Owner/Engineer, the names of the directional boring machine operator and directional boring machine navigational equipment operator. Both of these individuals shall have a minimum of three years each of directional boring experience and a minimum of one-year each in critical line and grade installations. If neither have such experience, then they need to show proof of formal training by an experienced industry professional.
- C. The Contractor shall submit, to the Owner/Engineer, in writing, the planned procedure for performing the bore within the allowable tolerances of these specifications. The procedure shall, at a minimum, include the following:
 - a. Verification method for pilot bore location. The Contractor shall, to the satisfaction of the Owner/Engineer, provide a means for accurately verifying the location of the pilot bore at certain points throughout the bore. Verification must be by visible detection or physical measurement along with the use of existing electronic detection. Electronic detection alone will not be allowed.
 - b. Pilot bore stem placement and stability. To the satisfaction of the Owner/Engineer,

the Contractor must use CTHDD approved tooling that will provide a method to control the pilot bore stem in the correct alignment prior to back reaming.

- c. The Contractor shall follow the sight relief hole spacing installation recommendations below for gravity sewer installations. The Contractor is responsible for any additional expenses incurred for installations not conforming to the grade and specifications of the Contract documents.


**Recommended Vertical Sight Relief Hole Spacing
For Gravity Sewer Installations.**

Soil conditions and the % of grade will determine the spacing.

For grades above .50% spacing can vary based on the operators experience.

Spacing should never exceed 40 foot (only in special situations).

Feet Spacing	Percent Grade		Feet Spacing	Percent Grade	
30	0.40%	Heavy Clay	30	0.40%	Sand/no Water Table
30	0.30%	Heavy Clay	20	0.30%	Sand/no Water Table
20	0.15%	Heavy Clay	15	0.20%	Sand/Water Table
20	0.30%	River Bottom Silt	15	0.15%	Sand/Water Table
20	0.20%	River Bottom Silt	15	0.15%	Sand/Water Table

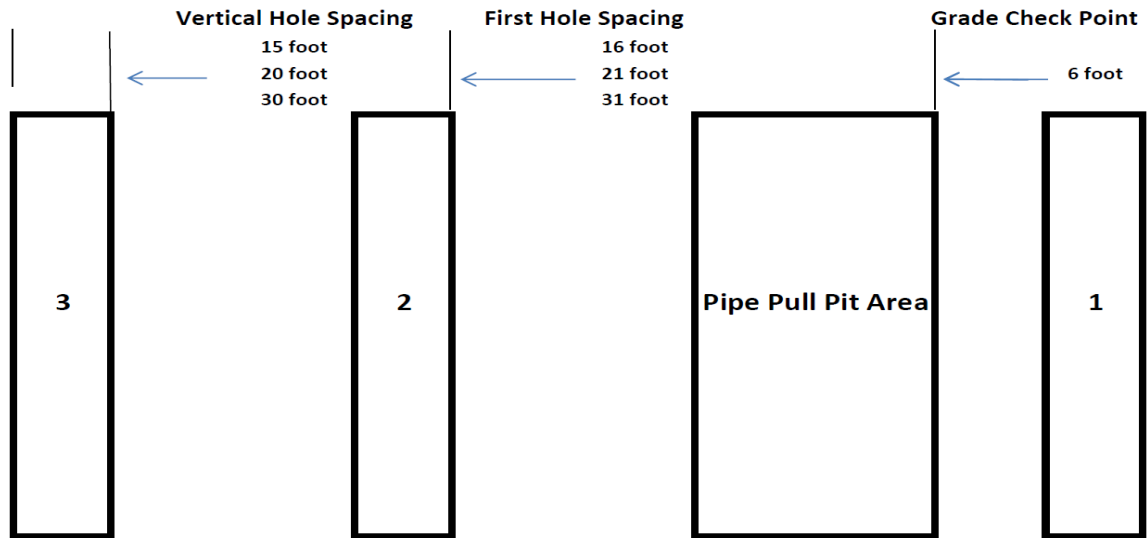

- D. If the Contractor does not meet the experience requirements set forth in the first two paragraphs of this section, the Contractor must satisfy the following:
 - a. The contractor must, to the satisfaction of the County, show that he has been trained to provide CTHDD technology within the industry and has completed the educational program that provides the Contractor a reasonably high probability of successfully completing the bore.

PART 2 PRODUCTS

2.01 MATERIALS

- A. No individual bore shall exceed the total distance between any two manholes, fire hydrants or mainline valves and tees unless approved by the Owner/Engineer prior to start of the installation.

- B. Depths and grades shall be as shown on the plans for gravity flow installation. Adjustments can be made for pressure pipelines as needed based on existing utility locations and approval by the design engineer. Pressure pipelines shall be installed at a serviceable depth.
- C. For the equipment proposed to be used, the Contractor shall supply, to the Owner/Engineer, the manufacturer's specifications for the directional boring equipment. This submittal shall detail thrust and pullback. Additionally, the Contractor shall supply, to the Owner/Engineer, the manufacturer's specifications for the navigational equipment that details the precisions of beacon and maximum line and grade deviations. Contractor shall only use CTHDD approved tooling based on the soil conditions.
- D. The exact CTHDD procedure for completing the bore shall be the responsibility of the Contractor. However, in order to prevent pipe deflection in the bored hole, the following requirements must be met:
 - a. The maximum annular space around the greater diameter of the pipe shall be no greater than $\frac{1}{4}$ " to $\frac{1}{2}$ ", i.e., for a 12" O.D. PVC pipe the back reamer shall be no larger than 12 $\frac{1}{2}$ " inches. Multiple back reams will not be allowed.
 - b. The Contractor shall not leave any unfilled reamed bore holes. All reamed bore holes that are not used for pipe placement shall be grouted with a mixture that meets the Owner/Engineer's approval. In general, this applies to bore holes that are created by pulling the pipe from the ground surface rather than from an excavated pit, but may apply elsewhere. The displaced volume for pilot bore stems alone is not of sufficient volume to require grouting, i.e., pilot bore from machine to grade position than is not reamed.
 - c. Any vertical sight relief holes used to visibly verify the location of the pilot bore stem shall be filled with an earthen material unless they are located in areas that receive traffic bearing loads in which case they shall be filled with an engineer approved backfill like, "flowable fill" (CLSM).

PART 3 EXECUTION

3.01 TESTING AND INSPECTION FOR ACCEPTANCE OF PIPELINES

Refer to Section 02623 for gravity sewer testing requirements or Section 02619 for pressure pipe testing requirements.

3.02 DRILLING FLUID DISPOSAL

The Contractor is responsible for drilling fluid disposal and all other restoration. Contractor must comply with all regulations regarding the proper disposal of drilling fluid. Cleaning, flushing, and hydrostatic testing of the pipe shall be conducted as specified elsewhere in our standards.

END OF SECTION

SECTION 02620 POLYETHYLENE (HDPE) PIPE AND FITTING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required to install polyethylene pressure pipe, fittings and appurtenances as shown on the Drawings and specified in the Contract Documents and these Standards.
- B. Newly installed pipe shall be kept clean and free of all foreign matter & gouges.
- C. All pipe shall be correctly color coded / identified.

1.02 QUALIFICATIONS

All polyethylene pipe shall be furnished by a single manufacturer who is fully experienced, reputable and qualified in the manufacture of the items to be furnished.

1.03 SUBMITTALS

- A. The Contractor shall submit to the County, within ten days after receipt of Notice to Proceed, a list of materials to be furnished, the names of the suppliers and the appropriate shop drawings for all polyethylene pipe and fittings.
- B. The Contractor shall submit the pipe manufacturer's certification of compliance with the applicable sections of the Specifications.
- C. The Contractor shall submit shop drawings showing installation method and the proposed method and specialized equipment to be used.

PART 2 PRODUCTS

2.01 POLYETHYLENE PRESSURE PIPE

- A. Polyethylene pipe for mains of 2-inch diameter and larger shall be high-density bimodal PE4710 polyethylene resin with a minimum cell classification of 445574 per ASTM D3350, Class 200, DR 11, meeting the requirements of AWWA C906. All pipe materials used in potable water systems shall comply with NSF Standard 61. Outside diameters of water, reclaimed water and pressure sewer HDPE mains shall be ductile-iron pipe sizing system (DIPS).
- B. Polyethylene tubing 2-inches in diameter and smaller for potable water and reclaimed water services shall be high-density PE4710 polyethylene resin with a minimum cell classification of 445574 per ASTM D3350, Pressure Class 250, Copper Tube Size (CTS), SDR 9, meeting the requirements of AWWA C901 and ASTM D2737. Butt fusion or CTS brass connections shall be used. All pipe materials used in potable water systems shall comply with NSF Standard 61.

- C. Alternatively, polyethylene tubing 2 inches in diameter and smaller for potable water and reclaimed water services shall be crosslinked high-density polyethylene (PEXa) 3306 pipe, Pressure Class 250, Copper Tube Size (CTS), SDR 9, meeting the requirements of AWWA C904. Butt fusion or CTS brass connections shall be used. All pipe materials used in potable water systems shall comply with NSF Standard 61.
- D. Polyethylene pressure pipe and tubing shall be furnished per the latest edition of the County's Approved Products List.

2.02 JOINTS

- A. Where PE pipe is joined to PE pipe, it shall be by thermal butt fusion. Thermal fusion shall be accomplished in accordance with the written instructions of the pipe manufacturer and fusion equipment supplier. The installer of the thermal butt fused PE pipe shall have received training in heat fusion pipe joining methods and shall have had experience in performing this type of work.
- B. Molded fittings for 4" and larger pipe shall be Pressure Class 200, PE4710, Ductile Iron Pipe Size (DIPS), DR 11, conforming to AWWA C906 with min. cell classification of 445474 per ASTM D3350. Mechanical joints and fittings for 2" and smaller tubing shall meet the requirements of: AWWA C901, ASTM D3350 and ASTM D3140.
- C. All connections to fittings or valves shall use a thermally fused mechanical joint or flanged joint adapter with a 316 stainless steel backup ring. The pipe shall also have a 316 stainless steel insert stiffener.

2.03 DETECTION

- A. Pipe shall have a 6-inch wide electronic detectable warning/path marking tape, color-coded per service type, placed directly above the pipe center. The tape shall be placed at least 12 inches below finished grade to a maximum depth of 24 inches below finished grade.
- B. The electronic detectable warning/path marking tape shall have detectable markers embedded in the tape and spaced adequately to provide a near continuous path to allow for easy detection at any point along the pipe. The embedded markers shall be spaced every 8-feet along the warning tape. The electronic marking tape shall be supplied per the latest edition of the County's Approved Products List.
- C. Direct buried or horizontal directional drilled HDPE pipe shall also have tracer wire installed along the pipe alignment. The tracer wire to be used shall be per Section 02800 of these Specifications.

2.04 IDENTIFICATION

- A. Pipe shall bear identification markings in accordance with AWWA C906.
- B. HDPE mains shall be color coded blue for potable water, purple for reclaimed water, or green for pressure sewer using embedded colored striping on 3 sides (120 degrees apart).
- C. PE services shall be fully color coded blue for potable water or purple for reclaimed water using a solid pipe color.

PART 3 EXECUTION

3.01 INSTALLING POLYETHYLENE PRESSURE PIPE AND FITTINGS

All polyethylene pressure pipe shall be installed by direct bury, directional bore, or a method approved by the County prior to construction. If directional bore is used, or if directed by the County, the entire area of construction shall be surrounded by silt barriers during construction.

Exposure of product pipe to sunlight shall be limited to 14 consecutive days unless approved by the County. If after 14 days, the product pipe is still stored on site then it shall be fully covered to avoid UV degradation of the pipe material.

3.02 INSPECTION AND TESTING

All pipelines shall remain undisturbed for 24 hours to develop complete strength at all joints. All pipelines shall be subjected to a hydrostatic pressure and leak testing. Refer to Manatee County Public Works Part I Utilities Standards Manual Section 1.9.

END OF SECTION

SECTION 02623 POLYVINYL CHLORIDE (PVC) GRAVITY SEWER PIPE

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, equipment, materials, pipe and incidentals and shall construct gravity sewers, complete, as shown on the drawings and as herein specified.
- B. The work shall include furnishing, laying and testing gravity sewer pipe.

1.02 SUBMITTALS DURING CONSTRUCTION

- A. The Contractor shall submit prior to construction, Shop Drawings for approval to the County.
- B. The pipe manufacturer shall inspect all pipe joints for out-of-roundness and pipe ends for squareness. The Contractor shall furnish to the County, a manufacturer's Notarized Affidavit stating all pipe meets the requirements of ASTM, ASCE, ANSI, the Contract Documents, as well as all applicable standards regarding the joint design with respect to square ends and out-of-round joint surfaces.

PART 2 MATERIALS

2.01 GENERAL

- A. The sizes of gravity sewer pipe shall be shown on the Drawings.
- B. Each length of pipe shall bear the name or trademark of the manufacturer, the location of the manufacturing plant and the class or strength classification of the pipe. The markings shall be plainly visible on the pipe barrel.

2.02 POLYVINYL CHLORIDE (PVC) GRAVITY SEWER PIPE

- A. Polyvinyl chloride (PVC) gravity sewer pipe and fittings, 4-15 inches in diameter, shall be SDR 26, meeting the requirements of ASTM D3034 and D3212. Joining of pipe sections and fittings shall be by water-tight push-on joints using elastomeric gaskets in accordance with ASTM F477.
- B. Unless otherwise specified, Polyvinyl chloride (PVC) gravity sewer pipe, 18-54 inches in diameter, shall be DR 25, meeting the requirements of AWWA C900-16. Joining of pipe sections and fittings shall be by water-tight push-on joints using elastomeric gaskets in accordance with ASTM F477.
- C. All PVC sewer pipe bell ends shall be field inspected for out-of-roundness and spigot ends shall be field inspected for out-of-roundness and for squareness of the pipe end. Any materials not in conformance with the tolerances of ASTM D3212 or ASTM F477 shall be removed from the work site.
- D. All PVC sewer pipe sections shall also be field inspected for excessive cross-section deflection. Any pipe section visually found to have a pipe deflection, before installation, of 2 percent of the Base Inside Diameter or greater shall be removed from the work site. After installation and backfill, pipe deflection shall not be allowed to be 5 percent or greater of the

Base Inside Diameter. Any length of pipe found installed having excessive deflection shall be dug up and either reinstalled or removed from the work site.

- E. Six inch PVC fittings for sewer laterals shall also be SDR 26, molded in one piece, with elastomeric joints in accordance with ASTM D3034. Fittings not currently available in molded form may be fabricated in accordance with ASTM D3034 with manufacturer's standard pipe bells and gaskets.

2.03 JOINING PVC GRAVITY SEWER AND FITTING

- A. The PVC joints shall be of the push-on type with a single rubber gasket conforming to ASTM F477.
- B. Wyes and riser fittings shall be gasketed connections. Rubber doughnuts are not to be used.
- C. Joints between pipes of different materials shall be made using couplings per the latest edition of the County's Approved Products List. Metal piping shall not be threaded into plastic fittings, valves, or couplings, nor shall plastic piping be threaded into metal valves, fittings, or couplings.

2.04 CLOSED CIRCUIT TELEVISION (CCTV) CAMERA

- A. Video inspection shall be performed using National Association of Sewer Companies (NASSCO) Pipeline Assessment and Certification Program (PACP) certified software.
- B. Closed Circuit Television Inspection Equipment shall produce a color video.
- C. Pipe inspection camera shall be a pan-and-tilt and radial viewing pipe inspection camera that pans a minimum of ± 275 degrees and rotates 360 degrees.
- D. A slope indicator shall be included on the camera and accurately calibrated per manufacturer's instructions for measurement of pipe slope.
- E. A camera with an accurate footage counter shall be used, which displays on the monitor the exact distance of the camera from the centerline of the starting manhole.
- F. The camera will be capable of height adjustment so that the camera lens is always centered at one-half the inside diameter, or higher, in the pipe being televised.
- G. Lighting for the camera shall be suitable to allow a clean picture of the entire periphery of the pipe. A reflector in front of the camera may be required to enhance lighting in dark or large diameter pipe.
- H. The camera, television monitor and other components of the video system shall be capable of producing a minimum 500-line resolution colored video picture.

PART 3 EXECUTION

3.01 PIPE DISTRIBUTION

The Contractor shall not distribute material on the job faster than it can be used to good advantage. He shall unload pipe, which cannot be physically lifted by workers from the trucks, by a forklift or other approved means. Contractor shall not drop pipe of any size from the bed of the truck to the ground. Contractor shall not distribute more than one week's supply of material in advance of laying, unless otherwise approved by the County.

3.02 PIPE PREPARATION AND HANDLING

- A. The Contractor shall inspect all pipe and fittings prior to lowering them into trench. Cracked, broken, or otherwise defective materials are not acceptable and shall not be used. The Contractor shall clean the ends of the pipe thoroughly. Contractor shall remove foreign matter and dirt from inside of pipe and keep the pipe clean during and after laying.
- B. The Contractor shall use proper implements, tools and facilities for the safe and proper protection of the work. Contractor shall lower the pipe into the trench in a manner to avoid any physical damage to the pipe, remove all damaged pipe from the job site and under no circumstances shall the pipe be dropped or dumped into trenches.

3.03 LINE AND GRADE

- A. The Contractor shall not deviate more than 1/2-inch for line and 1/4-inch for grade from the line design and design grade established by the County provided that such variation does not result in a level or a reverse sloping invert. Contractor shall measure the grade at the pipe invert and not at the top of the pipe. The Contractor shall furnish, set and control the line and grade by laser beam method. Other methods of controlling line and grade may be submitted to the County for approval if using the laser beam method proves to be impractical because of other conditions.
- B. The Contractor shall use the laser beam method of maintaining line and grade. The Contractor shall submit evidence to the County that a qualified operator shall handle the equipment during the course of construction. A "Caution-Laser Light" placard shall be displayed in a conspicuous place. When "in the pipe" method is used, grade boards shall be installed for the first 50 feet of pipe. The Contractor shall check the line and grade at any additional points at which offset stakes have been placed and when requested by the County. A fan shall be provided to circulate the air if bending of the beam due to air temperature variations becomes apparent with "in the pipe" units. However excessive air velocity shall not be permitted to cause pulsating or vibrating of the beam. If, in the opinion of the County, the beam cannot be accurately controlled, this method of setting line and grade shall be discontinued. When the above ground method is used, the set-up shall be checked with the three grade boards including one set at the upstream manhole. If the laser has a gradient indicator, two boards may be used to check the set-up. The grade board at the up-stream manhole shall be retained to check into as pipe laying progresses.

3.04 PREPARATION OF TRENCH

- A. The Contractor shall provide pipe bedding material under all the pipe for the full trench width. The minimum depth of bedding material below the pipe barrel shall be as follows:

<u>Pipe Size</u>	<u>Bedding Under Pipe Barrel</u>
15" & Smaller	4 inches
18" to 36"	6 inches
42" & Large	9 inches

- B. The depth of pipe bedding material under the pipe bell shall not be less than three inches under normal trench conditions.
- C. The Contractor shall hand-grade bedding to proper grade ahead of the pipe laying operation. The bedding shall provide a firm, unyielding support along the entire pipe length.
- D. Should the Contractor excavate the trench below the required depth for pipe bedding material placement without direction from the County, the Contractor shall fill the excess depth with pipe bedding material as specified herein to the proper subgrade.
- E. The Contractor shall excavate bell holes at each joint to permit proper assembly and inspection of the entire joint.

3.05 DEWATERING

The Contractor shall prevent water from entering the trench during excavation and pipe laying operations to properly grade the bottom of the trench and allow for proper compaction of the backfill. Pipe shall not be laid in water.

3.06 LAYING AND JOINTING PIPE AND FITTINGS

- A. The Contractor shall lay pipe upgrade with spigot ends pointing in direction of flow. After a section of pipe has been lowered into the prepared trench, he shall clean the end of the pipe to be joined, the inside of the joint and, if applicable, the rubber ring immediately prior to joining the pipe. The Contractor shall assemble the joint in accordance with the recommendations of the manufacturer of the type of joint used. He shall provide all special tools and appliances required for the jointing assembly.
- B. The Contractor shall lay all pipe uniformly to line and grade so that the finished sewer shall present a uniform bore. Variations from line and grade in excess of the tolerances specified under LINE AND GRADE are not acceptable and the work shall be rejected.
- C. The Contractor shall check the pipe for alignment and grade after the joint has been made. The pipe bedding shall form a continuous and uniform bearing and support for the pipe barrel between joints. Sufficient pressure shall be applied to the joint to assure that the joint is "home" as defined in the standard installation instructions provided by the pipe manufacturer. The Contractor shall place sufficient pipe cover material to secure the pipe from movement prior to installing the next joint to assure proper pipe alignment and joint makeup.
- D. Pipe 21" and smaller intended to be in straight alignment shall be laid so that the inside joint space does not exceed 3/8" in width. If interior joints on 24" and larger pipe laid either in straight alignment or on a curve are greater than 3/8", the Contractor shall thoroughly clean the joint surfaces and fill and seal the entire joint with premixed mortar conforming to ASTM C387 only after the trench has been backfilled, unless otherwise approved by the County. Trowel smooth on the inside surface. Water shall not be allowed to rise in or around, or pass over any joint before it has substantially set.
- E. When the Contractor lays pipe within a movable trench shield, he shall take all necessary precautions to prevent pipe joints from pulling apart when moving the shield ahead.
- F. The Contractor shall prevent excavated or other foreign material from getting into the pipe during the laying operation. He shall close and lock the open end of the last laid section of

pipe to prevent entry of foreign material or creep of the gasketed joints when laying operations cease, at the close of the day's work, or whenever the workers are absent from the job.

- G. The Contractor shall plug or close off the pipes which are stubbed off with temporary plugs.
- H. The Contractor shall take all necessary precautions to prevent the "uplift" or floating of the line prior to the completion of the backfilling operation.
- I. The Contractor shall make connections of non-reinforced pipe to manholes or concrete structures, so that a standard pipe joint is located at a minimum of 18" outside the edge of structure.
- J. When field cutting and/or machining the pipe is necessary, the Contractor shall use only tools and methods recommended by the pipe manufacturer and approved by the County.
- K. Service lateral shall be constructed by the Contractor as shown on the standard sewer details and located approximately as shown on the Contract Drawings.

3.07 LAYING PLASTIC PIPE

- A. Polyvinyl chloride (PVC) pipe shall be installed by the Contractor in accordance with the instructions of the manufacturer, as shown on the Drawings and as called out in the Contract Documents.
- B. The Contractor shall lay the pipe, bedding and backfill to lines and grade shown on the Drawings and called out in the Contract Documents. Blocking under the pipe will not be permitted.
- C. The Contractor shall use care in the handling, storage and installation of pipe. Storage of pipe on the job site shall be done in accordance with the pipe manufacturer's recommendation.

3.08 BACKFILL IN THE PIPE ZONE

- A. The pipe zone shall be considered to include the full width of the excavated trench from the bottom of the trench to a point above the top outside surface of the barrel of the pipe.
- B. The Contractor shall pay particular attention to the area of the pipe zone from the flow line to the springline of the pipe to insure that firm support is obtained to prevent any lateral movement of the pipe during the final backfilling of the pipe zone.
- C. The Contractor shall take care to ensure that the pipe does not rest directly on the bell or pipe joint, but is uniformly supported on the barrel throughout its entire length.
- D. After the pipe is laid by the Contractor to line and grade, the Contractor shall place and carefully compact pipe bedding material for the full width of the trench to the springline of the pipe. Contractor shall place the material around the pipe in 6-inch layers and thoroughly hand tamp with approved tamping sticks supplemented by "walking in" and slicing with a shovel to assure that all voids are filled.

- E. The Contractor shall backfill and carefully compact the area above the pipe springline with pipe cover material to a point 12" above the top outside surface of the pipe barrel. Pipe bedding material may, at the Contractor's option, be substituted for pipe cover material.

3.09 EXCESS TRENCH WIDTH

- A. Normal trench widths shall be as shown on the Drawings. If the normal trench width below the top of the pipe is exceeded for any reason, the Contractor shall furnish an adequate support for the pipe. The County may determine that the pipe being used is strong enough for the actual trench width or the Contractor may furnish a stronger pipe or a concrete cradle for approval.
- B. Concrete thickness under the pipe shall be one-third of the nominal diameter of the pipe, but not less than four inches. Concrete block or brick may be used for adjusting and maintaining proper grade and elevation of pipe. After the pipe is laid to line and grade, the Contractor shall place 3,000 psi concrete under the pipe for the full width of the trench to form a cradle of the required length and thickness with the concrete brought up to a level equal to 1/4 of the inside pipe diameter below the springline of the pipe. Start and terminate the concrete cradle at the face of a pipe bell or collar. Do not encase pipe joints at the ends of the concrete cradle.
- C. After the concrete has taken initial set, the Contractor shall place cover material over the concrete cradle and up to a level 12" above the pipe barrel and for the full width of the trench. Cover material shall be placed by hand or by equally careful means.

3.10 CONNECTING DISSIMILAR PIPE MATERIALS

The Contractor shall use the following method to connect dissimilar pipe materials. Use concrete closure collars only when approved by the County and then only to make connections between dissimilar pipe when standard rubber gasketed joints or shielded couplings are impracticable. Before the closure collars are poured, wash the pipe to remove all loose material and soil from the surface on which the concrete will be placed. Wet nonmetallic pipe thoroughly prior to pouring the collars. Wrap and securely fasten a light gauge of sheet metal or building-felt around the pipe to insure that no concrete shall enter the line. Place reinforcement as shown on the plans. Make entire collar in one pour using 3,000 psi concrete and extend a minimum 12" on each side of the joint. The minimum thickness around the outside diameter of the pipe shall be 6". No collar shall be poured in water. After the collars are poured and have taken their initial set, cure by covering with well-moistened earth.

3.11 PIPE BULKHEADS

- A. Connections for future sewers shall be bulkheaded by the Contractor in the following manner:
 - 1. All wyes and bell-and-spigot pipe sewers 18" in diameter or smaller shall be bulkheaded with caps or disc stoppers with factory-fabricated resilient joints. The disk or cap shall be banded or otherwise secured to withstand all test pressures without leakage.
 - 2. Connections 21" and 24" in diameter shall be bulkheaded with a four-inch brick wall, using clay brick or concrete brick. The wall shall be capable of withstanding all test pressures without leakage.

3. Connections 27" in diameter and larger shall be bulkheaded with an eight-inch wall, using clay brick or concrete brick. The wall shall be capable of withstanding all test pressures without leakage.

3.12 AIR TEST FOR GRAVITY SEWERS - GENERAL

- A. Gravity sewers shall be required to pass the low pressure air test. All pipelines shall remain undisturbed for 24 hours to develop complete strength at all joints. Refer to Manatee County Public Works Part I Utilities Standards Manual Section 1.9.
- B. Air loss rates may be measured by the County. These tests shall be performed by the Contractor under the observation of the County Inspector.
- C. The groundwater height above the installed pipe shall be determined by attaching a transparent plastic tube to a pipe nipple in the manhole and using the plastic tube as a manometer. A test hole may be dug directly above the sewer main for visual inspection.
- D. The ends of branches, laterals, tees, wyes and stubs included in a test section shall be plugged to prevent air leakage. All plugs shall be secured to prevent blowout due to internal pressure. A test section is defined as the length of sewer between manholes.
- E. The Contractor shall repair all visible leaks in manholes and pipe, even if the leakage test requirements are met.

3.13 CLOSED CIRCUIT TELEVISION (CCTV) INSPECTION OF GRAVITY SEWERS

- A. TV inspection of the entire length of the inside of new gravity sewer mains shall be conducted by the Contractor. The County Inspector shall have been notified and shall be present during the TV inspection.
- B. The sewer pipelines shall be thoroughly cleaned of all dirt, debris or obstructions before the TV inspection. Water shall be added to the upstream manhole until it is seen flowing from the most downstream point of the system to be inspected
- C. The Contractor shall provide Manatee County with digital media that includes video and data base file that is compatible with Granite XP in NASSCO PACP format. Compatibility issues with software other than Granite XP latest version are the Contractor's responsibility.
- D. CCTV inspection shall be performed by NASSCO PACP certified operators who use NASSCO certified software that is compatible with Granite XP latest version using PACP defect coding methodology.
- E. Perform CCTV inspection immediately after line cleaning. Before insertion of the camera into the sewer, the camera shall record on video the upstream and downstream manhole asset numbers, pipe size, specific location of the sewer, and the direction in which the camera will travel. The camera shall be moved through the line in either direction at a moderate rate, stopping when necessary to permit proper documentation of the sewer's condition in audio and documented on the television inspection log.
- F. The camera height shall be adjusted so that the camera lens is always centered at one-half the inside diameter, or higher, in the pipe being televised.

- G. The camera shall not travel at a speed greater than thirty (30) feet per minute. To better understand the flow from each individual lateral (if flowing) the camera shall be positioned at each lateral for a sufficient duration to determine the nature of flow and condition of the lateral (minimum of 30-seconds).
- H. Videos shall span beginning and ending manholes to demonstrate that all debris has been removed. A manhole inspection shall be performed for all manholes.
- I. Manual winches, power winches, TV cable powered rewinds, or selfpropelled cameras may be used to move the camera through the sewer line.
- J. When manually operated winches are used to pull the television camera through the line, telephones or other suitable means of communication should be set up between the two manholes of the section being inspected to ensure good communication between members of the crew.
- K. If during CCTV inspection of a pipeline, the television camera is unable to pass through the entire pipeline section, the Contractor shall set up his equipment so that the inspection can be performed from the opposite direction (reverse setup) in order to obtain a complete video of the line. If, again, the camera fails to pass through the pipeline section, the Contractor shall contact the Engineer for direction. Contractor is responsible for identifying cause of blockage and repairing the section to allow a fully unobstructed flow.
- L. In the event that the TV camera encounters broken pipe, the Contractor shall be responsible for repairing the pipe per Specification Section 02626.
- M. Distance Measurements: The accuracy of the measurements for location of defects, service connections, changes in pipe materials, and all other PACP recognized conditions is paramount, particularly when it may require later corrective action or a dig-up. The accuracy of the footage meter shall be checked by taking a reading at the entrance to the away manhole and comparing with a surface measurement made with a steel tape or walking meter (Roll-A-Tape). These measurements shall be performed by the Contractor in the presence of the Manatee County inspector. Measurement meters shall be accurate to one-tenth of a foot over the entire length of the sewer line section being inspected. Otherwise, the Contractor shall take corrective action.
- N. The video inspection shall be clear and visible with adequate lighting to enable the viewer to discern even small defects in the pipe being inspected. Camera distortions, inadequate lighting, dirty lens, or blurred/hazy picture will be cause for rejection of a video and rejection of the associated line segment. Any pipeline television inspection video that does not meet this requirement or fails to meet PACP specifications shall be cause for Contractor to re-inspect the pipe at no additional cost to the County. Payment for television inspection and sewer rehabilitation will not be made until the County approves the quality of the video and logs.
- O. CCTV inspection video shall be continuous for pipe segments between manholes. Do not leave gaps in the video of a segment between manholes and do not show a single segment on more than one video, unless specifically allowed by the County.

- P. Documentation of television inspection by the Contractor shall be performed in accordance with the Specifications. TV reports can be assembled elsewhere, but documentation must be done in the field. A video inspection report shall be prepared by the Contractor for every segment and manhole that is CCTV-inspected. The Contractor shall provide written records that show the location in relation to an identified manhole of each infiltration point observed during inspection. In addition, other points of significance such as locations of building sewers, unusual conditions, roots, sewer connections, broken pipe, presence of scale and corrosion, and other discernible features shall be recorded on the PACP television inspection report. The video, PACP television inspection report and the NASSCO Manhole Inspection Form (latest version), with all applicable fields accurately completed per PACP format, shall be supplied to the County with each Pay Request.
- Q. A calibration report shall be submitted with each digital video disk (DVD), which shall include a drawing of the depth gauge, indicating the marks on the gauge, and what depth each mark represents.
- R. The County Inspector shall be present and will observe the TV monitor along with the camera operator as the camera progresses through the pipe. All pipelines will be inspected with the camera progressing in an upstream direction when possible. The camera operator shall record the manhole numbers and the distance the camera has progressed from the downstream manhole as the inspection proceeds. The operator shall stop the progress of the camera and record the distance at all locations along the pipeline where unusual or defective features are encountered. The operator shall record the distance and depth of the water in the pipe at all locations where the depth is greater than or equal to 75% of the maximum depth as listed in the table below. The camera operator shall make records where cracked, dented or deformed pipe is found, or at joints that are not properly installed, or where infiltration is observed, or at any other abnormality or where any other defective feature is encountered.
- S. Pipe grade between manholes shall not deviate by more than the maximum depth as list below from the design grade line, as measured with the television (TV) camera's depth gauge during the TV inspection, provided that such deviation does not result in a level or a reverse slope. Joint deflection and longitudinal pipe deflection between manholes that exceeds the maximum depth or more than two deflections that exceed 75% of the maximum depth, as measured with the television camera's depth gauge during the TV inspection, shall not be accepted.

Pipe Sizes	Water Holding Max Depth (inches)
8 inch to 15 inch	1.00
18 inch to 21 inch	2.00
24 inch and greater	2.50

- T. At the end of the inspections, or at the end of the day, one original digital video disk (DVD) or external removable drive of the TV record shall be submitted to the County Inspector along with the written inspection report and depth gauge calibration for evaluation. The County's representative shall be the sole judge of whether any information imparted by the TV test digital media will cause the County to accept or reject the pipe test section.

- A. The Contractor shall perform a pipe ring deflection test on all new gravity sanitary sewer mains. The rigid ball or mandrel used for the ring deflection test shall have a diameter not less than 95 percent of the base inside diameter or average inside diameter of the pipe depending on which is specified in the ASTM C3034, to which the pipe is manufactured. The test shall be performed without mechanical pulling devices.
- B. The allowable ring deflection is 5 percent of the inside pipe diameter. Pipes that have a ring deflection that exceeds this amount shall not be accepted.

3.15 FINAL SEWER CLEANING

- A. Prior to final acceptance and final manhole-to-manhole inspection of the sewer system by the County, the Contractor shall flush and clean all parts of the system, remove all accumulated construction debris, rocks, gravel, sand, silt and other foreign material from the sewer system at or near the closest downstream manhole.
- B. During the final manhole-to-manhole inspection of the sewer system, the County may require the Contractor to reflush and clean any section or portion of the line if any foreign matter is still present in the system.

3.16 IDENTIFICATION

- A. PVC gravity sewer pipe shall bear identification markings in accordance with ASTM D3034 or AWWA C900-16.
- B. PVC gravity sewer pipe shall be color-coded green using a solid pipe color pigment.

END OF SECTION

SECTION 02624 SANITARY SEWER ROUTINE CLEANING AND TELEVISION

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall provide for routine maintenance cleaning and closed-circuit television inspection (CCTV) of assigned pipes and inspection of manholes within the Manatee County sanitary sewer collection system including removal and disposal of debris removed during the cleaning process, which is preventing the design flow of the pipe, prevent blockages and restore the sewer to near full capacity and self-scouring velocity. The Contractor shall be aware that this specification requires work in active sewers.
- B. The work includes furnishing all labor, tools, equipment and materials including various forms of specialized pipe cleaning, and televising of sanitary sewage mains and related manholes, and all operations to support the primary maintenance cleaning and inspection activities are also to be provided.
- C. This specification section also applies to new installation, replacement and repair inspection for compliance documentation of construction specifications.

1.02 SUBMITTALS

- A. The Contractor shall submit the following information:
 - 1. Information on all types of processes that will be used for cleaning.
 - 2. Copies of PACP/ MACP certifications for personnel performing television and manhole inspections.
 - 3. Manufacturer's certification that the equipment to be used meets the referenced standards and these specifications.
 - 4. Proposed equipment and procedures for accomplishing the work.
 - 5. Proposed personnel and qualifications assigned to the cleaning work.

PART 2 PRODUCTS

2.01 CLEANING EQUIPMENT

- A. All sanitary sewer pipes shall be cleaned with truck-mounted high velocity hydraulic cleaning (hydra-cleaning) equipment and equipped vacuum debris removal system. Sufficient high pressure hose length should be available on the vehicle described to perform cleaning on manhole runs up to 900 linear feet in length. High pressure hose should be at least 1 inch in diameter with the ability to deliver at least 80 gallons per minute at 3,000 PSI. Water tanks on the vehicle should be at least 1,200 gallons in capacity. All controls for cleaning equipment shall be located so that the equipment can be operated above ground.
- B. The nozzle and skids used for cleaning should be designed for use in a manner consistent with the diameter of the pipe being cleaned. Specialty heads and nozzles may be required for hardened debris, grease, and scale removal.
- C. Cutting heads to remove intruding roots or projecting obstructions will also be required and shall be designed specifically for the diameter of the pipe in which they are used.

- D. Vacuum debris removal system shall be used to remove sand, silt, grease, rocks, bricks, and all other debris from manholes during the cleaning process. It is essential that the debris be removed from the wastewater system and not allowed to move into adjacent pipes or manholes. Wastewater removed from the collection system during the vacuuming process can be decanted back into the system only after the solids are allowed to settle sufficiently to prevent the materials from re-entering the system.
- E. Contractor shall provide equipment capable of removing all sand, dirt, rocks and other debris from the sewer reach to allow unobstructed remote television internal inspection of all internal surfaces.
- F. Cleaning system shall utilize a device capable of dislodging sediments found in sewer lines without damaging the structural integrity of the pipe. Cleaning devices shall have sufficient power to force and move the debris commonly found in large diameter sewers to a manhole for extraction. Cleaning method may maintain normal sewer flows during the cleaning process.
- G. Contractor shall certify that backup cleaning equipment including machines, devices, tools, etc. is available and can be delivered to the site within 24 hours.
- H. Contractor shall provide all equipment required for specialty cleaning including removing roots and de-scaling sewer pipes.

2.02

CLOSED CIRCUIT TELEVISION EQUIPMENT

- A. Video inspection shall be performed using National Association of Sewer Companies (NASSCO) Pipeline Assessment and Certification Program (PACP) certified software.
- B. Closed Circuit Television Inspection Equipment shall produce a color video.
- C. Pipe inspection camera shall be a pan-and-tilt and radial viewing pipe inspection camera that pans a minimum of ± 275 degrees and rotates 360 degrees.
- D. A slope indicator shall be included on the camera and accurately calibrated per manufacturer's instructions for measurement of pipe slope.
- E. A camera with an accurate footage counter shall be used, which displays on the monitor the exact distance of the camera from the centerline of the starting manhole.
- F. The camera will be capable of height adjustment so that the camera lens is always centered at one-half the inside diameter, or higher, in the pipe being televised.
- G. Lighting for the camera shall be suitable to allow a clean picture of the entire periphery of the pipe. A reflector in front of the camera may be required to enhance lighting in dark or large diameter pipe.
- H. The camera, television monitor and other components of the video system shall be capable of producing a minimum 500-line resolution colored video picture.
- I. Video data shall be provided to the County in a digital format such as an external removable drive, or other device or media, as required by the County to be uploaded to the CCTV

inspection database.

- J. Video data shall be PACP database compliant and compatible with the County's existing Granite XP software database system.

PART 3 EXECUTION

3.01 NEIGHBORHOOD NOTIFICATION

Not less than 48 hours prior to the commencement of work in a right-of way, the Contractor shall notify all residents and businesses affected by the work with an Engineer or County approved printed door hanger notice indicating the schedule date of work, the type of work, and Contractor's and superintendent's name, address and telephone number. The notice shall contain wording indicating any disruption of sanitary service or access to property that may be required to perform the work. Disruption in sanitary sewer service shall be minimized. Access to private property shall be maintained at all times.

3.02 DEWATERING

- A. All gravity sanitary sewer pipes (lines) less than 48" in diameter shall be dewatered for cleaning and inspection purposes. Lines 48" and larger may be cleaned and inspected without dewatering only when the County agrees that dewatering is not feasible. Each exception to the dewatering requirement shall be considered on a case by case basis. Contractor will assume that dewatering is required for bidding purposes.
- B. Dewatering may be accomplished by pumping water around the work area or by plugging off pipes to isolate the portion of the system being worked on while cleaning and performing inspection. If plugging the line is used for dewatering purposes, the system must be properly monitored so that no overflows occur. If a pipe that has been rehabilitated by the installation of a liner is plugged, the liner must be braced at the manhole to prevent movement of the liner pipe.

3.03 CLEANING

- A. The sewers shall be cleaned by removing dirt, rock, sand, roots and other deleterious materials from the pipe and manholes. The cleaning equipment shall remove grease or roots and restore ninety-five (95) percent of original pipe inside diameter.
- B. All necessary precautions are to be taken to protect the sewer lines from damage resulting from the cleaning and inspection process. Reimbursement for damage to the sewer infrastructure or damage or flooding of private or public property, as a direct or indirect result of the cleaning and inspection operation shall be the responsibility of the Contractor.
- C. Contractor shall be responsible for all permits required to perform assigned Work.
- D. Contractor shall obtain permission from the property owner whenever access to manholes in easements and right-of-way is required for equipment.
- E. Cleaning and inspection work required includes, but not limited to the following:
 - a. Field locating all manholes along the sewer pipes to be cleaned.

- b. Maintaining and protecting both vehicular and pedestrian traffic, and meeting all requirements of the County and all other government agencies having jurisdiction.
- c. Cleaning and inspecting existing sanitary sewer pipes and manholes, as herein specified, and to record the inspection information in the format identified by the County.
- d. Disposal of waste, sediment and debris as specified herein.
- e. Removal of roots, scale, and protrusions as specified herein.
- f. Cleaning and restoring the work area as the work progresses and after the completion of all work activities.
- g. All other work required for the complete and satisfactory cleaning and inspection of the pipeline and adjacent manholes.

3.04 CLEANING PROCEDURE

- A. After determining and performing all preliminary requirements, Contractor shall thoroughly clean assigned pipelines sufficiently to permit an unrestricted inspection by closed circuit television. The Contractor shall remove accumulated grease, roots, sand, rock, bricks, sludge and all other debris that obstructs video inspection such that all portions of the pipe being inspected will be clearly visible.
- B. Contractor shall remove all brick, rocks, debris, sludge, dirt, sand, grease, roots and other materials from the sewers shown in the work order, and collect and remove the resulting debris from the manholes of the sewer section being cleaned. Equipment shall decant or separate the water from the solids before it is transported to the designated disposal site. Liquid decanted from the solids shall be returned to the sewer. Debris remaining in the sewer after cleaning shall not exceed 5% of the pipe diameter. Passing waste material between manholes, causing line stoppages, accumulations of sand, or damage to the pumping equipment, shall not be permitted.
- C. Contractor shall complete a NASSCO Manhole Assessment and Certification Program (MACP) manhole inspection form for both upstream and downstream terminal manholes during cleaning and inspection operation.
- D. Normal cleaning consists of removing all debris and requires a minimum of two passes. The first pass shall be restricted to 800 psi at the nozzle head. The second and subsequent passes shall be at 1200 psi.
- E. Specialty cleaning consists of removing all heavy grease, roots and tuberculation by use of special equipment such as a high pressure descaling head, root cutter, or other mechanical means approved by the County.
- F. Contractor is responsible for damage to the sewer as a direct result of the cleaning method.
- G. Contractor shall use all cleaning equipment in accordance with manufacturer's recommendations to prevent damage to sewer lines.
- H. Contractor shall immediately notify the County if fresh soil, pieces of pipe, or other visible signs of potential problems occur during cleaning operations.

- I. Contractor shall ensure that water pressure created does not cause damage due to flooding of property being served by sewer section(s) involved.
- J. Contractor shall conform to the following requirements:
 - a. Cleaning of sewers shall commence from furthest upstream point from access point.
 - b. Hydraulic cleaning equipment shall be inserted in the downstream manhole of the reach and the work shall proceed upstream unless otherwise approved by the County.
- K. Any blockages of lateral building connections resulting from the cleaning or other items of work shall be removed by cleaning of the building connection by Contractor, at its own expense. Any damage caused by flooding of lateral building connections shall be corrected by Contractor, at its own expense.

3.05 WASTE DISPOSAL

- A. Waste materials and debris resulting from sanitary sewer cleaning operations shall be removed and conveyed by the Contractor to an approved waste site. The disposal site shall be accessible during the Contractor's working hours. All permits required shall be the responsibility of the Contractor. Waste material and debris resulting from the cleaning operation shall be drained in the collection system and disposed of at Manatee County Solid Waste Operations, located at 3333 Lena Rd, Bradenton, FL 34211. The material deposited at Solid Waste Operations, shall not exhibit any liquid when deposited at the location as specified by Manatee County Solid Waste Operations. Disposal manifest records shall be supplied to Manatee County Utilities. Under no circumstances shall sewage or solids removed from sewer lines be dumped onto the streets or into ditches, catch basins or storm drains. It shall not be necessary to stop the cleaning operation while the debris is transported to the disposal site.

3.06 CLOSE CIRCUIT TELEVISION INSPECTION PROCEDURE

- A. The Contractor shall provide Manatee County with digital media that includes video and data base file that is compatible with Granite XP in NASSCO PACP format. Compatibility issues with software other than Granite XP latest version are the Contractor's responsibility.
- B. CCTV inspection shall be performed by NASSCO PACP certified operators who use NASSCO certified software that is compatible with Granite XP latest version using PACP defect coding methodology.
- C. Perform CCTV inspection immediately after line cleaning. Before insertion of the camera into the sewer, the camera shall record on video the upstream and downstream manhole asset numbers, pipe size, specific location of the sewer, and the direction in which the camera will travel. The camera shall be moved through the line in either direction at a moderate rate, stopping when necessary to permit proper documentation of the sewer's condition in audio and documented on the television inspection log.
- D. The camera height shall be adjusted so that the camera lens is always centered at one-half the inside diameter, or higher, in the pipe being televised.

- E. The camera shall not travel at a speed greater than thirty (30) feet per minute. To better understand the flow from each individual lateral (if flowing) the camera shall be positioned at each lateral for a sufficient duration to determine the nature of flow and condition of the lateral (minimum of 30-seconds).
- F. Videos shall span beginning and ending manholes to demonstrate that all debris has been removed. A manhole inspection shall be performed for all manholes.
- G. Manual winches, power winches, TV cable powered rewinds, or selfpropelled cameras may be used to move the camera through the sewer line.
- H. When manually operated winches are used to pull the television camera through the line, telephones or other suitable means of communication should be set up between the two manholes of the section being inspected to ensure good communication between members of the crew.
- I. If during CCTV inspection of a pipeline, the television camera is unable to pass through the entire pipeline section, the Contractor shall set up his equipment so that the inspection can be performed from the opposite direction (reverse setup) in order to obtain a complete video of the line. If, again, the camera fails to pass through the pipeline section, the inspection of the entire pipeline section will be considered complete for purposes of payment. The Contractor shall provide a summary of findings describing probable issue(s) that prevented a complete pass through of the pipeline section.
- J. In the event that the TV camera encounters broken pipe and there is a possibility that continuation of the inspection could cause the TV Camera to become stuck or result in additional pipe damage or collapse, the Engineer may elect to discontinue the inspection.
- K. Distance Measurements: The accuracy of the measurements for location of defects, service connections, changes in pipe materials, and all other PACP recognized conditions is paramount, particularly when it may require later corrective action or a dig-up. The accuracy of the footage meter shall be checked by taking a reading at the entrance to the away manhole and comparing with a surface measurement made with a steel tape or walking meter (Roll-A-Tape). These measurements shall be performed by the Contractor in the presence of the Manatee County inspector. Measurement meters shall be accurate to one-tenth of a foot over the entire length of the sewer line section being inspected. Otherwise, the Contractor shall take corrective action.
- L. The video inspection shall be clear and visible with adequate lighting to enable the viewer to discern even small defects in the pipe being inspected. Camera distortions, inadequate lighting, dirty lens, or blurred/hazy picture will be cause for rejection of a video and rejection of the associated line segment. Any pipeline television inspection video that does not meet this requirement or fails to meet PACP specifications shall be cause for Contractor to re-inspect the pipe at no additional cost to the County. Payment for television inspection and sewer rehabilitation will not be made until the County approves the quality of the video and logs.

- M. CCTV inspection video shall be continuous for pipe segments between manholes. Do not leave gaps in the video of a segment between manholes and do not show a single segment on more than one video, unless specifically allowed by the County.
- N. Documentation of television inspection by the Contractor shall be performed in accordance with the Specifications. TV reports can be assembled elsewhere, but documentation must be done in the field. A video inspection report shall be prepared by the Contractor for every segment and manhole that is CCTV-inspected. The Contractor shall provide written records that show the location in relation to an identified manhole of each infiltration point observed during inspection. In addition, other points of significance such as locations of building sewers, unusual conditions, roots, sewer connections, broken pipe, presence of scale and corrosion, and other discernible features shall be recorded on the PACP television inspection report. The video, PACP television inspection report and the NASSCO Manhole Inspection Form (latest version), with all applicable fields accurately completed per PACP format, shall be supplied to the County with each Pay Request.

3.07 REMOVAL OF DEBRIS

Materials generated by the cleaning operation shall be removed by vacuuming at the upstream or downstream manhole of the section being cleaned. Suitable traps or weirs shall be used to prevent the movement of solids to adjacent sections of pipe.

3.08 WATER

- A. The use of potable water from the municipal, private, or reclaimed water systems for filling the water tanks on cleaning vehicles shall be permitted however, Contractor shall be required to acquire and use a meter approved by the County to monitor the use of this water and will be charged for water use in accordance with the current rate as described in Manatee County Utilities Standards and the schedule of rates and fees. Contractor shall be responsible for obtaining and hooking up the potable water meter at their own expense. A reduced pressure type backflow preventer approved by the County shall be used to prevent contamination of the potable water system. Contractor is responsible for any damage resulting from improper operation of hydrants. Contractor shall not use or obstruct a fire hydrant when there is a fire in the area.
- B. Contractor shall not waste water from the public water supply because of improper connections or from hydrants left open.

3.09 FINAL ACCEPTANCE OF SEWER LINE CLEANING

- A. Acceptance of sewer line cleaning work is contingent upon the completion of the CCTV inspection and successful review of the television inspection video by the County. If the inspection shows the cleaning to be unsatisfactory, Contractor shall be required to re-clean and re-inspect the sewer line until the cleaning is shown to be satisfactory. Such re-cleaning and re-inspection shall be made at Contractor's expense.

END OF SECTION

SECTION 02625 PRECAST POLYMER CONCRETE STRUCTURES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all materials, labor and equipment necessary to construct polymer concrete manholes and/or wetwells as shown on the Drawings and as specified herein.
- B. Precast polymer concrete structures shall be manufactured from chemical-resistant polymer concrete with fiber-reinforced polymer (FRP) or steel reinforcement bars. Structures shall be manufactured by an established national manufacturer exclusively producing polymer concrete sanitary sewer manholes and wetwells. Polymer concrete structures shall be furnished per the latest edition of the County's Approved Products List.
- C. Drop manholes, manholes with opposing turbulent flows as defined in the Manatee County Utility Standards US-3, manholes immediately upstream of a lift station as defined in Manatee County Utility Standards US-17A, manholes with gravity sewers greater than 12-inch diameter, manholes receiving a force main and the first two gravity manholes downstream of manholes receiving a force main, and all lift station wetwells shall be manufactured from polymer concrete as specified herein. Traditional lined Portland concrete wet wells may be accepted, when the required diameter exceeds the diameters available by the authorized manufacturers of the polymer concrete wet well.
- D. The manufacturer, dimensions, material and construction methods shall be available for inspection and approved by the County in advance of construction. The County reserves the right to inspect the facilities of the supplier and the manufacturer if they are different.
- E. These Specifications are intended to give a general description of what is required, but do not purport to cover all of the structural design details which will vary in accordance with the requirements of the plans. It is, however, intended to cover the furnishing, shop testing, delivery and complete installation of all precast structures whether specifically mentioned in these Specifications or not.
- F. The supplier of the precast items shall coordinate his work with that of the Contractor to insure that the units will be delivered and installed in the excavation provided by the Contractor, in accordance with the Contractor's construction schedule.
- G. The Contractor will ensure coordination of the precast structures fabrication with the supplier to achieve the proper structural top slab openings, spacings and related dimensions for the selected equipment frames and covers. The top slabs, frames, covers, and subsurface structures outside of roadways shall be capable of live load of 300 pounds per square foot unless noted otherwise.

1.02 SUBMITTALS

- A. The contractor shall submit the following items to the County for review and approval:
1. Shop drawings of structure sections, top and bottom slabs, construction details, reinforcement methods, jointing methods, materials, dimensions, rim and invert elevations, and component parts.
 2. Summary of criteria used in design including, as minimum, material properties, loadings, load combinations and dimensions assumed.
 3. Include certification from manufacturer that polymer concrete structure design meets or exceeds the load and strength requirements of ASTM C478 and ASTM C857, reinforced in accordance with ACI 440.1R if applicable.
 4. Frames, grates, rings, and covers.
 5. Materials to be used in fabricating pipe drop connections.
 6. Materials to be used for pipe connections.
 7. Materials to be used for stubs and stub plugs, if required.
 8. Proof of independent Chemical Resistance testing conducted in accordance with the Standard Specifications for Public Works Construction (California Greenbook) Section 211-2 or ASTM C267 Standard Test Methods for Chemical Resistance of Mortars, Grouts, and Monolithic Surfacing and Polymer Concretes.
 9. Signed and sealed calculations and drawings by a Florida registered Professional Engineer showing structure meets designated strengths per ASTM standards referenced below.
 10. Signed and sealed buoyancy calculations by a Florida registered Professional Engineer with a Factor of Safety of 1.25 without incorporating soil friction.

1.03 INSPECTION

- A. The quality of all materials, the process of manufacture and the finished sections shall be subject to inspection and approval by the County or authorized representative of the County. Such inspection may be made at the place of manufacture, on site, or both locations. The polymer concrete section may be inspected prior to unloading from the delivery truck and marked by the inspector showing acceptance or rejection. However, discovery of failure at any time to meet the requirements of these Specifications is cause for rejection.
- B. Sections rejected after delivery to the job shall be marked for identification and shall be removed from the job at once. All sections which are damaged after delivery as determined by the County, shall be rejected. Sections already installed, shall be removed and replaced entirely at the Contractor's expense.
- C. At the time of inspection, the sections shall be examined for compliance with the standards referenced below, latest revision, these Specifications and with the approved manufacturer's drawings. All sections shall be inspected for general appearance, dimension, blisters, cracks, roughness, soundness, etc. The surface shall be free of defect.

- D. Imperfections may be repaired subject to the approval of the County and after demonstration by the manufacturer that strong and permanent repairs result.

1.04 REFERENCES

ASTM C33 (most current) Standard Specification for Concrete Aggregates

ASTM C267 (most current) Standard Test Methods for Chemical Resistance of Mortars, Grouts, and Monolithic Surfacing and Polymer Concretes

ASTM C443 (most current) Standard Specification for Joints for Concrete Pipe and Manholes Using Rubber Gaskets

ASTM C478 (most current) Standard Specification for Precast Reinforced Concrete Manhole Sections

ASTM C497 (most current) Test Methods for Concrete Pipe, Manhole Sections, or Tile

ASTM C579 (most current) Standard Test Methods for Compressive Strength of Chemical-Resistant Mortars, Grouts, Monolithic, Surfacing, and Polymer Concretes

ASTM C580 (most current) Standard Test Method for Flexural Strength and Modulus of Elasticity of Chemical-Resistant Mortars, Grouts, Monolithic Surfacing, and Polymer Concretes

ASTM C857 (most current) Standard Practice for Minimum Structural Design Loading for Underground Utility Structures

ASTM C923 (most current) Standard Specifications for Resilient Connectors between Concrete Manholes Structures and Pipe

ASTM C990 (most current) Standard Specification for Joints for Concrete Pipe, Manholes and Precast Box Sections using Preformed Flexible Joint Sealants

ASTM D648 (most current) Test Method for Deflection Temperature of Plastics Under Flexural Load in Edgewise Position, if applicable

ASTM D2584 (most current) Test Method for Ignition Loss of Cured Reinforced Resins

ASTM D6783 (most current) Standard Specification for Polymer Concrete Pipe

ACI 350 (most current) Code Requirements for Environmental Engineering Concrete Structures & Commentary

ACI 440.1R (most current) Guide for the Design and Construction of Structural Concrete Reinforced with Fiber-Reinforced Polymer (FRP) Bars, if applicable

ACI 548.6R (most current) Polymer Concrete: Guidelines for Structural Applications

PART 2 PRODUCTS

2.01 MANHOLE AND/OR WETWELL MATERIALS

- A. Design shall be of sufficient strength to safely support HS-20 loading in accordance with AASHTO.
- B. Provide polymer concrete sections, monolithic top and bottom base sections, and related components referencing to ASTM C478 and ASTM C857. ASTM C478 and ASTM C857 material and manufacturing is allowed compositional and dimensional differences required by a polymer concrete product. Manholes shall be designed based upon live and dead load criteria in ASTM C857.
- C. Provide base riser section with monolithic floors, unless shown otherwise.
- D. Provide riser sections joined with bell and spigot or tongue and groove smooth wall design seamed with butyl mastic and joint lubricated rubber gaskets conforming to ASTM C990 so that on assembly, base, riser and top section make a continuous and uniform structure.
- E. Construct riser sections for polymer concrete structures from standard polymer concrete sections of the diameter indicated on drawings. Use various lengths of polymer concrete manhole or wetwell sections in combination to provide correct height with the fewest practical joints.
- F. Design wall sections for depth and loading conditions with wall thickness as designed by polymer concrete manufacturer. Wall thicknesses shall be as stated by manufacturer based upon loading conditions and material properties. For manholes, riser walls shall have a minimum thickness of 2" and the cone walls shall have a minimum thickness of 5". For wetwells, the section walls shall have a minimum thickness of 4".
- G. Provide tops to support AASHTO HS-20 or vehicle loading or loads as required and receiving frame, covers, or hatches, as indicated on drawings.
- H. Minimum clear distance between two wall penetrations shall be a minimum of 6" on 48" to 72" diameter structures and a minimum of 8" on larger diameter structures. A clearance of 6" is required between wall penetration and joint.
 - 1. Wall thickness shall be designed to resist hydrostatic pressures with a minimum safety factor of 2.0 for full depth conditions from grade to invert.
 - 2. The wall thickness of risers and conical tops shall be not less than that prescribed by the manufacturer's design by more than 5%. A wall greater than the prescribed design shall not be cause for rejection.
 - 3. Wall thickness shall be as required by structural design performed by manufacturer. Wall thickness design calculations shall be provided, signed and sealed by a licensed Florida Professional Engineer.
- I. Polymer concrete shall have a minimum unconfined compressive strength 28-day strength of 9,000 psi when measured in accordance with ASTM C497.

- J. Structures shall have engineered and rated lifting devices that shall not penetrate completely through the wall. All openings shall be patched with non-shrink polymer grout as recommended by manufacturer.

2.02 MANHOLE FRAMES AND LIDS

Frames and lids shall be heavy duty composite with minimum three (3) 316 stainless steel locking bolts. All frames and lids shall be designed to withstand an AASHTO HS-20 wheel loading with an added 30% impact factor and shall be Class Heavy Duty traffic bearing. Refer to the latest edition of the County's Approved Products List for approved products.

2.03 MANHOLE INSERTS

All sanitary sewer manholes installed shall require watertight rainwater protection inserts made of minimum 18 gauge, 304 stainless steel. Neoprene gaskets shall be installed under the insert lip to insure a leakproof seal. Refer to the latest edition of the County's Approved Products List for approved products.

2.04 MANHOLE INVERTS

- A. Benched inverts shall be factory-built polymer concrete and shall be monolithically cast per ASTM C478.
- B. The width of the invert channel shall be the same as the inside diameter of the connected sewer pipes and shall have a "U" - shaped cross-section with the bottom of the channel shaped to correspond with the lower half of the pipe. The depth of the channel shall be a minimum of half the inside diameter of the connected pipes.
- C. The channel shall be formed smooth and streamlined, and, where the flow changes directions, shall have true curves of the largest radius possible within the manhole base. The maximum change of direction of flow within a manhole shall be 90 degrees.
- D. The channel invert slope shall be uniform through the manhole and shall have a minimum vertical drop of 1 inch from the inlet(s) to the outlet.

2.05 DESIGN CRITERIA:

- A. Polymer concrete risers, cones, flat lids, grade rings and base sections shall be designed by manufacturer to meet loading requirements of ASTM C478, ASTM C857 and ACI 350 as modified for polymer concrete manhole and wetwell design as follows:
 - 1. Polymer Concrete Mix Design shall consist of thermosetting resin, sand, and aggregate. No Portland cement shall be allowed as part of the mix design matrix. All sand and aggregate shall be inert in an acidic environment.
 - 2. Reinforcement - Shall use acid resistant reinforcement (FRP Bar) in accordance with ACI 440.1R or steel in accordance with ASTM C478 as applicable for polymer concrete design.
 - 3. The wall thickness of polymer concrete structures shall not be less than that prescribed by the manufacturer's design by less than 95% of stated design thickness.

4. Thermosetting Resin - The resin shall have a minimum deflection temperature of 158° F when tested at 264 psi following Test Method ASTM D648. The resin content shall not be less than 7% of the weight of the sample as determined by Test Method ASTM D2584. Resin selection shall be suitable for applications in the corrosive conditions to which the polymer concrete structures will be exposed.
5. AASHTO HS-20 design or as required loading applied to manhole cover and transition and base slabs.
6. Polymer concrete structured shall be designed based upon live and dead load criteria in ASTM C857 and ACI 350.
7. Unit soil weight of 130 pcf located above portions of manhole or wetwell, including base slab projections.
8. Internal liquid pressure based on unit weight of 63 pcf.
9. Dead load of manhole or wetwell sections fully supported by transition and base slab.

PART 3 EXECUTION

- A. Each polymer concrete manhole or wetwell component shall be free of all defects, including indentations, cracks, foreign inclusions and resin starved areas that, due to their nature and degree or extent, detrimentally affect the strength and serviceability of the component part. The nominal internal diameter of manhole or wetwell components shall not vary more than 1%. Variations in height of two opposite sides of risers and cones shall not be more than 5/8 inch. The under run in height of a riser or cone shall not be more than ¼ in/ft of height with a maximum of ½ inch in any one section.
- B. Marking and Identification - Each manhole or wetwell shall be marked with the following information - Manufacturer's name or trademark, Manufacturer's location and Production Date.
- C. Manhole or wetwell joints of a bell and spigot or smooth wall tongue and groove design shall be assembled with a butyl rubber sealant, an elastomeric sealing gasket, and external joint wrap so that on assembly the manhole or wetwell base, riser, and top sections make a continuous and uniform structure meeting the requirements of ASTM C443. Joint sealing surfaces shall be free of dents, gouges and other surface irregularities that would affect joint integrity.
- D. Construct invert channels to provide smooth flow transition with minimal disruption of flow at pipe connections. Invert slope through manhole or wetwell as indicated on drawings. All precast base slabs to be cast monolithically. Polymer concrete bench and channel are to be factory constructed with all resin aggregate material. Extended ballast slab requirements for buoyancy concerns can be addressed with cementitious concrete material. Any modifications required in the bench or channel during construction shall be used with non-shrink polymer grout per the latest revision of the County's Approved Products List.
- E. Provide cast-in resilient connectors conforming to requirements of ASTM C923 installed at the factory. All connectors are to be water tight. Install resilient connectors at each pipe entering and exiting the structure in accordance with manufacturer's instructions. The

external take down clamp and its hardware shall be 316 stainless steel. Cold joint pipe stub grouting shall not be allowed. Cast-in resilient connectors shall be furnished per the latest edition of the County's Approved Products List.

- F. All pipe penetrations shall be made in the factory unless otherwise specified in the plans.
- G. If the Contractor is required to connect a new line to an existing manhole, jack-in resilient connectors conforming to requirements of ASTM C923. All connectors are to be watertight. Install resilient connectors at each pipe entering and exiting the structure in accordance with manufacturer's instructions. The internal expansion band and hardware shall be minimum 304 stainless steel. The external take down clamp and its hardware shall be 316 stainless steel. Jack-in resilient connectors shall be furnished per the latest edition of the County's Approved Products List.

3.01 QUALITY CONTROL

Manufacturer of manholes or wetwells shall employ manufacturing methods and material formulation in use for a minimum of five (5) years. Manufacturer shall provide at least two (2) references of projects of similar size and scope.

3.02 GROUTING

All materials needed for grouting and patching shall be non-shrink polymer grout per the latest edition of the County's Approved Products List. All holes in sections used for handling and annular spaces, around influent and effluent pipes, shall be filled using the materials listed above. Non-shrink polymer grout shall be placed in the gap between the boot or seal and the manhole invert channel, to make a smooth transition, unless otherwise directed by the manufacturer's instructions.

3.03 INTERNAL JOINT SEALANTS

A butyl rubber sealant shall be applied to the interior of manhole and wetwell bell and spigot or tongue and groove smooth wall joints per manufacturer's recommendations and shall be furnished per the latest edition of the County's Approved Products List.

3.04 EXTERNAL JOINT WRAP

Gasketed bell and spigot joint: If the joint design has the risers' outer walls offset from each other, an 18-inch wide heat shrinkable joint wrap shall be centered over all these joints including the chimney to cone section per manufacturer's recommendations and shall be furnished per the latest edition of the County's Approved Products List.

Gasketed tongue and groove smooth wall joint: If the joint design has the risers' outer walls flush with each other, a 12-inch non-shrink elastomeric plastic joint wrap shall be centered over all these joints including chimney to cone section per manufacturer's recommendations and shall be furnished per the latest edition of the County's Approved Products List.

3.05 CERTIFICATION

As a basis of acceptance, the manufacturer shall provide an independent certification consisting of a copy of the manufacturer's test reports along with a copy of the test results certifying that representative manhole or wetwell samples have been tested, and inspected in accordance with the provisions of this Specification and meet all requirements of same,

to include but not limited to the load and strength requirements of ASTM C478 and ASTM C857.

3.06 MANHOLE AND/OR WETWELL CONSTRUCTION

- A. POLYMER CONCRETE MANHOLE AND/OR WETWELL INSTALLATION: The Contractor shall set section vertical and in true alignment. All structures shall meet the following installation tolerances: The finished structure shall not be out of plumb by more than 3/8" per 10 feet of height.
- B. GRADE ADJUSTMENT: The Contractor shall set polymer concrete corrosion proof grade rings on top of manhole slabs and polymer concrete manhole cones to provide grade adjustment in setting manhole frames. Contractor shall use butyl rubber strip sealant between rings, minimum 3" wide by 1/2" thick. Contractor shall ensure a watertight seal by removing debris, stones, and dirt between rings.
- C. BACKFILL: Unless otherwise shown on the Drawings, a minimum distance of one (1) foot from the outside surface and extending from the bottom of the excavation to the top of the reducer section shall be backfilled using select material as specified in the Contract Documents. The material chosen shall be free of large lumps or clods, which will not readily break down under compaction. This material will be subject to approval by County.
- D. BACKFILL PROCEDURE: The Contractor shall place backfill in maximum layers of 12 inches loose measure and mechanically tamp to 98% Standard Proctor Density, unless otherwise approved by County. Flooding shall not be permitted. Backfill shall be placed in such a manner as to prevent any wedging action against the structure.
- E. A minimum of an 8-inch shell base compacted layer of washed shell or crushed stone shall be placed as a foundation for the structure's base slabs.
- F. Allow joints to set for 24 hours before backfilling. Backfilling shall be done in a careful manner, bringing the fill up evenly on all sides. The Contractor shall install the precast sections in a manner that will result in a watertight joint. Leaking joints are not acceptable.
- G. MARKING AND IDENTIFICATION: Each structure shall be marked on the inside and outside with the following information:
 - 1. Manufacturer's name or trademark.
 - 2. Manufacturer's factory location.
 - 3. Manufacturer's serial number.
 - 4. Total length.
- H. Holes or penetrations in the polymer concrete sections required for handling or other purposes shall be plugged with a non-shrink polymer grout approved by the manufacturer. Holes or penetrations shall not penetrate through the wall.
- I. Where holes must be cut in the precast sections to accommodate pipes, cutting shall be done prior to setting them in place to prevent any subsequent jarring which may loosen the joints.
- J. Frames and hatches specified and furnished shall be cast in the cover slab prior to setting. Normal installation shall include 6" to 12" of polymer concrete grade rings between the top of the cone section and the cover plate ring slab.

K. TESTING

1. After each manhole and/or wetwell is constructed to grade and prior to being backfilling, each structure shall be tested for water tightness.
 - a. Plug pipe lines and perform vacuum test. Observing all recommended safety measures, induce a backpressure of 5.0 psi equivalent to 10" Hg (mercury). The assembly is considered satisfactory if the vacuum loss is less than 1" Hg for the length of time listed in the following table:

Time of Test (Seconds)			
Depth (Feet)	Structure Diameter (Feet)		
	4	5	6 or Larger
4	10	13	16
8	20	26	32
12	30	39	48
16	40	52	64
20	50	65	80
24	60	78	96
T (Seconds)	5	6.5	8

Note: Add "T" seconds for each additional 2'-0" of depth.

2. Failure to pass one of these tests requires the Contractor to correct the problems and retest. The Contractor shall replace leaking gaskets and/or polymer concrete sections and retest the completed manhole/or wetwell. No structure will be accepted without successfully passing this test.
- L. STUB LINES: The Contractor shall provide stub lines where shown on the Drawings or as directed by the County for the connection of future sewer lines to manholes and/or wetwell. Provide bell end enclosed with an approved plug at the end of each stub line. Bell of stub line shall be as close to structure exterior surface as practical. The Contractor shall accurately reference each stub line for direction and record along with the actual invert elevation. He shall furnish the County two copies of the above specified data on stub lines.
- M. CONNECTION TO EXISTING STRUCTURES: All piping entering existing manholes and/or wetwell shall have a jack-in resilient pipe to manhole seals per ASTM C923. The external take down clamp and its hardware shall be 316 stainless steel. The internal expansion band and its hardware shall be minimum 304 stainless steel. Connectors shall be installed in strict accordance with the written installation instructions of the manufacturer. Non-shrink grout shall be placed in the gap between the boot or seal and the manhole invert channel, to make a smooth transition, unless otherwise directed by the manufacturer's instructions. Jack-in resilient connectors shall be furnished per the latest edition of the County's Approved Products List.
- N: WARRANTY: Manufacturer shall provide a fifty-year (50) warranty that the polymer concrete structure will not fail due to corrosion.

END OF SECTION

SECTION 02626 SANITARY SEWER GRAVITY MAIN REHABILITATION

PART 1 GENERAL

1.01 DESCRIPTION

This section describes the materials and methods for the rehabilitation of sanitary sewer lines by the insertion of a fiberglass reinforced plastic or polyethylene liner pipe into the existing sewer line. All such work shall comply with these Specifications and the specific product manufacturer's recommendations. Any conflict between the product manufacturer's recommendations and any portion of the Contract Documents shall be resolved prior to beginning the work.

The Contractor shall utilize the products of one manufacturer which meet the requirements of these Specifications when relining sections of existing sewer which are straight or have minor offsets.

It shall be the Contractor's sole responsibility to insure that materials provided by the liner manufacturer will function as intended when installed in curved or offset sections of existing pipe.

1.02 DESIGN CRITERIA

Pipe, fittings and special pieces shall be designed to withstand all loadings as described below. No structural consideration is to be given to any part of the existing sewer pipe.

The following design criteria shall be utilized to develop a suitable structural and corrosion resistant design for the liner pipe for sliplining:

1. Hydrostatic Pressure - Water table shall be construed as 2' - 0" below finished grade on the entire length of the project.
2. Dead Loads - Invert of pipe and finish grade elevations are shown on the plan and profile drawings. Assume soil weight of 120 pounds per cubic foot and soil modulus of elasticity (E') of 2000 psi.
3. Live Loads - Highway loads are based on HS20-44 (A.A.S.H.T.O. Latest Edition). Railroad loadings are Cooper E 80 (A.R.E.A. Latest Edition).
4. Corrosion - Pipe carries domestic waste and shall be resistant to sulfuric acid attack resulting from hydrogen sulfide oxidation.
5. Buckling - Pipe design shall incorporate a safety factor of 2.5 for buckling strength calculations, in accordance with Section A2.5 of Appendix A of AWWA C950.

1.03 SUBMITTALS

After award of the Contract, (5) five copies of the pipe design and installation procedure shall be submitted by the Contractor. Contractor shall provide design in accordance with the operating load conditions described under Design Criteria. Complete pipe design shall include both structural and corrosion resistant design elements. Submittal shall address the Contractor's proposed method(s) to accomplish the following:

1. Install liner pipe through the existing pipe, including line deflections and curves and location of insertion pits.
2. Install grout in annular space between liner pipe and existing sewer pipe and details on proposed grout mix to be used.

3. Technical data on pipe including information on pipe materials, physical properties and dimensions.

Before beginning work, the Contractor shall submit for approval, the vendor's specific technical data with complete information on resin and material composition, physical properties of pipe, and pipe dimensions pertinent to this job. A certificate of "Compliance with Specification" shall also be furnished for all materials to be supplied.

PART 2 PRODUCTS

2.01 FIBERGLASS REINFORCED PIPE

A. Workmanship:

1. All liner pipe delivered to the job site will be inspected prior to installation for the following:
 - a) Inside surfaces of each pipe section shall be free of bulges, dents, ridges, and other defects that result in a variation of inside diameter of more than 1/8 - inch.
 - b) The interior and exterior surfaces of the pipe shall be completely free from pinholes, cracks, pits, or defects which is detrimental to the intended use of product. No pipe will be installed which has apparent holes or openings which will permit the passage of liquid or gases through the pipe wall.
 - c) Joint sealing surfaces shall be completely free of dents, bumps or other surface irregularities which will affect the proper seals of the joints.
 - d) Factory repairs shall not be permitted.
 - e) On site repairs shall not be permitted. Segments of pipe having cuts or gouges in excess of 5% of the wall thickness shall be cut and removed.

The following materials are approved for installation as a liner pipe in the existing gravity sewer pipe:

B. Fiberglass Materials:

- a) Resin Systems: The manufacturer shall use only polyester or vinyl ester resin systems with a proven history of performance in this particular application. The historical data shall have been acquired from a composite material of similar construction and composition as the proposed product.
- b) Glass Reinforcements: The reinforcing glass fibers used to manufacture the components shall be of highest quality commercial grade E-CR glass (corrosion resistant and boron free E-glass) filaments with binder and sizing compatible with impregnating resins.
- c) Silica Sand: Sand shall be minimum 98% silica with a maximum moisture content of 0.2%.
- d) Additives: Resin additives, such as curing agents, pigments, dyes, fillers, thixotropic agents, etc., when used, shall not detrimentally affect the performance of the product.
- e) Elastomeric Gaskets: Gaskets shall meet ASTM F477 and be supplied by qualified gasket manufacturers and be suitable for the service intended.

C. Fiberglass Pipe Construction:

- a) Pipe shall be dense, nonporous, corrosion-resistant, consistent composite structure. It shall be manufactured using a resin which shall provide crack resistance and abrasion resistance. The exterior surface of the pipes shall be comprised of a sand and resin layer which provides UV protection to the exterior.
- b) Joints: Unless otherwise specified, the pipe shall be field connected with low-profile, fiberglass bell-spigot joints or flush fiberglass bell-spigot joints, when the fit requires. Either joint shall utilize elastomeric sealing gaskets as the sole means to maintain joint water tightness and shall meet the performance requirements of ASTM D4161. Joints at Tie-ins, when needed, may utilize gasket-sealed closure couplings.
- c) Fittings: Flanges, elbows, reducers, tees, wyes, laterals and other fittings shall be capable of withstanding all operating conditions when installed. They may be contact molded or manufactured from mitered sections of pipe joined by glass-fiber-reinforced overlays.
- d) Diameters: The actual outside diameter of the pipes shall be in accordance with ASTM D3262 Table 3. For unlisted diameters, OD's shall be per manufacturer's literature unless otherwise agreed to between manufacturer and owner.
- e) Lengths: Pipe shall be supplied in nominal lengths of 10 to 40 feet. Actual laying length shall be nominal +1, -1 inches. At least 90% of the total footage of each size and class of pipe, excluding special order lengths, shall be furnished in nominal length sections.
- f) Wall Thickness: The average wall thickness of the pipe shall not be less than the nominal wall thickness published in the manufacturer's literature, and the minimum wall thickness at any point shall not be less than 87.5% of the nominal wall thickness.
- g) End Squareness: All points around each end of a pipe unit shall fall within +/-1/4 inch or +/-0.5% of the nominal diameter of the pipe, whichever is greater, to a plane perpendicular to the longitudinal axis of the pipe.
- h) Pipe diameter shall be the largest diameter liner pipe available that can be installed into the existing ductile iron pipe. Actual pipe diameter utilized shall be approved by County prior to manufacturing and delivery.
- i) Pipe shall be field connected with bell and spigot meeting the performance requirements of ASTM D-3262. An o-ring or profile type elastomeric gasket meeting the requirements of ASTM F-477 shall be used to affect a positive leakproof sealing system at each joint.
- j) The pipe produced shall have a minimum stiffness factor requirement of 36 psi at 5% deflection when tested in accordance with ASTM D-2412.

PIPE WALL THICKNESS AT 36 PSI PIPE STIFFNESS

<u>NOMINAL DIAMETER</u> (inches)	<u>OUTSIDE DIAMETER</u> (inches)	<u>WALL THICKNESS</u> (inches)
18	19.5	0.37
20	21.6	0.40
24	25.8	0.47
30	32.0	0.58
36	38.3	0.69
42	44.5	0.80
48	50.8	0.90

- k) Length: Pipe shall be furnished in maximum 20 foot lengths.
- l) Pipes, fittings and special pieces shall be designed to withstand all jacking loads.
- m) Pipe shall be provided with marks, where appropriate, to ensure complete installation of bell and spigot joints.

D. Filament Wound Fiberglass Pipe:

- a) Pipes: Manufacture pipe by the filament wound process to result in a dense, nonporous, corrosion-resistant, consistent composite structure. Pipes shall be Type 1, Liner 1, and Grade 1 per ASTM D3262.

E. Centrifugally Cast Fiberglass Pipe:

- a) Pipes: Manufacture pipe by the centrifugally cast process to result in a dense, nonporous, corrosion-resistant, consistent composite structure. Polyester resin pipe conforming to Type 1, Liner 2, Grade 3 per ASTM D3262.

F. Qualification Testing:

- a) Pipes: Pipes shall be manufactured and tested in accordance with ASTM D3262.
- b) Joints: Joints shall meet the requirements of ASTM D4161.
- c) Stiffness: Each pipe shall have sufficient strength to exhibit the minimum pipe stiffness at 5% deflection as required by the Engineer. Stiffness shall be tested in accordance with the test method of ASTM D2412. One pipe shall be tested every 100 lengths of each type, grade, and size pipe produced.
- d) Chemical Resistance: Pipe shall meet or exceed the requirements of ASTM D3262 when tested in accordance with ASTM D3681.

2.02 POLYETHYLENE PIPE

A. Polyethylene Materials:

- a) Pipe and fittings shall be manufactured of a polyethylene resin Type III, Class C, Category 5, Grade P-34 (in accordance with ASTM D-1248) having an average specific base resin density of between 0.941 g/cc and 0.959 g/cc (in accordance with ASTM D-1505) and having an average melt index of between 0.4 g/10 minutes and 0.15 g/cc minutes maximum (in accordance with ASTM

D-1238).

- b) The polyethylene resin shall contain antioxidants and be stabilized against ultraviolet degradation to provide protection during processing and subsequent weather exposure.
- c) The polyethylene resin compound shall have a resistance to environmental stress cracking as determined by the procedure detailed in ASTM D-1693, condition B, with sample preparation by procedure C of ASTM D-1928 for not less than 100 hours in 25% solution Iquepal CO-630 before reaching a 50% failure point F (50).

B. Polyethylene Pipe:

- a) Polyethylene pipe shall be SDR 26. The existing pipe shall be lined with liner pipe as listed in the table of pipe liner sizes included herein.
- b) Sizes of the pipe linings to be used shall be such to restore the flow capacity to at least 95% of its original flow capacity using the maximum size lining that can be inserted into the existing lines. The original flow capacity shall be determined by use of the Manning formula for gravity flow using the diameter and gradients as determined from the Contract Plans, and using a roughness coefficient as shown in Table A. The sliplinings to be used shall be designed to withstand the long-term (50 Years) continuous external hydrostatic pressure, in feet of water head and in no case shall the Standard Dimension Ratio (SDR) exceed 26. The pipe manufacturer shall furnish written certification to the County that the proposed pipe and pipe sizes, pipe flows, and design strengths of the proposed materials meet or exceed the provisions in this section. This submittal shall accompany the bid proposal.
- c) All pipe is to be manufactured from virgin materials. No rework compound except that obtained from the manufacturers own production of the same formula shall be used.

Pipe shall be homogeneous throughout, and be free of visible cracks, foreign materials, blisters other deleterious faults.

TABLE A

<u>Type of Pipe</u>	<u>Manning's N</u>
Vitrified Clay	.013
Concrete	.015
Ductile Iron (old)	.015
Galvanized Iron	.016

- d) Submittal: After receipt of the bid, the successful bidder shall submit to the County for approval and evaluation a sample of the products to be used from the manufacturing source production facility that will meet or exceed the Contract Specifications along with the address of said manufacturer. Approval of the sample shall be required prior to any work on the Project.

All materials shall be supplied by the Contractor and shall be new and free from damage when delivered to the job site and prior to installation; and any defective materials discovered after installation will be removed and replaced at the Contractor's expense.

- e). Properties: The tensile strength, yield strength, elongation, and elastic modulus of the material shall be determined by ASTM D-638 along with the thermal butt fusion joints to assure the joints are stronger than the materials joined for Type III (or the type proposed with properties greater than those of Type III).
- f) Deviations: Any deviations from the above standards will be sufficient grounds to reject the proposal. Materials not meeting (or exceeding) the set standards will be sufficient basis for the rejection of the materials proposed.
- g) Testing: The above required test results shall be submitted according to the ASTM sections referenced above. If additional testing is requested, the County will bear the costs of the additional testing unless the materials fall below that which is specified according to the applicable ASTM standards. When the test results show results lower than required in these Specifications and/or in the applicable ASTM standards, the entire cost of testing shall be borne by the Contractor.
- h) Delivery and Handling: The Contractor is responsible for making provisions to furnish labor, equipment, materials, and services necessary to order, receive, unload, store, and protect. After Award of Contract, and prior to beginning work, the Contractor shall submit to the County a schedule and location of delivery and storage. The pipe is to be trucked to the site in sections thirty eight feet (38 ft. +/- 2 inches) in length.

Upon delivery, the pipe shall be inspected by the Contractor. Any damaged pipe shall be set aside by the County or his agent who will determine if the pipe shall be accepted or rejected.

The Contractor shall make provisions for pipe storage as close to the job site as practical. The pipe shall be unloaded and placed for storage using suitable hoisting equipment and belt slings for field use.

PART 3 EXECUTION

3.01 CONSTRUCTION (ALL METHODS)

A. General: Unless otherwise noted, the sliplining methods listed below are acceptable to the County. Should the Contractor desire to use different methods than described in these Specifications, written permission must be obtained from the County. The finished product is to be of highest quality and shall eliminate any infiltration or corrosion problems which may exist in the system.

B. Installation Procedures:

1. No down time shall be permitted for the existing sewer line. By-passing as outlined in the following section is permitted. Alternate methods shall be submitted to the County for approval.

2. By-Passing Existing Flows: The Contractor shall furnish equipment, materials, supplies, labor and all incidentals required to by-pass the sanitary sewer flow such that the sliplining process may be completed. The Contractor shall plug the upstream line and pump the flow to the nearest downstream manhole (or, when approved by the County, to another system all together) per Section 02720. Dumping the existing flow onto private property or streets shall not be allowed. At the end of each day, the Contractor shall make temporary tie-ins such that no service be interrupted overnight. By-passing of existing flows shall be considered an incidental part of this Contract and will not be paid for directly.

3. Quality Assurance: The Contractor shall submit an experience statement for the design, manufacture, and installation of liner pipe for a similar application, of equal or larger diameter of the pipe included in this Project. As a minimum, the statement shall include length, size of pipe, application, type of joints and fittings installed, along with a list of clients and installation dates for these projects.

Prior to the installation of the liner pipe, the existing pipe shall be thoroughly cleaned and inspected by closed circuit television or visual inspection. The Contractor shall inspect the existing polylining in the ductile iron pipeline and ascertain where the lining is loose, hanging, etc. and may interfere with the sliplining process. Where found, the existing polylining shall be cut free, etc. so as to allow for the free passage of the sliplining pipe. Repair procedure shall be prior approved by the County.

The liner pipe shall be installed to the limits shown on the Drawings by pushing or pulling the liner pipe into the existing pipe with an approved pipe insertion system. It shall be the responsibility of the Contractor to clear the line of obstructions, solids, or dropped joints that prevent the insertion of the liner prior to beginning insertion process.

The pipe shall be guided into the existing pipe through an insertion pit constructed in accordance with these Specifications and the detail drawings. Once the insertion is initiated, the Contractor shall continue to push or pull to completion without interruption. During insertion, precautions should be taken to protect the liner pipe and prevent the rough or ragged edges or broken sewer pipe from scoring the outside of the liner as it is being pushed into the existing sewer pipe.

After insertion, the liner pipe should terminate at the inside face of each manhole or

concrete structure and be sealed in accordance with these Specifications.

Also, prior to the sliplining process, a test head pull will be required to insure that proper clearance has been achieved. The Contractor shall use a steel nose cone (which is the same size and length as the liner pipe) for the test head pull. This item will be considered an incidental part of this Contract and will not be paid for directly.

4. Excavation: Excavations shall be completed in as small an area as is practical to complete the sliplining process. Excavation and backfill shall be in accordance with Section 02221 and FDOT. When excavating around existing utilities, the Contractor shall be responsible for protecting in place existing utilities. Prior to commencing any excavation operation, the Contractor shall contact the utility owner for the proper location of existing underground services in the areas of excavation. Asphalt and concrete shall be saw-cut to insure smooth joints.

Utility services encountered shall be excavated prior to the sliplining operation of the main pipeline to prevent blockage of the service and potential home damage. Service shall be maintained throughout the project life or until permanent tie-in can be made. At no time will excavations be left open overnight without the expressed written permission from the County. If the excavations are left open, it the Contractor's responsibility to properly barricade and otherwise safely maintain the excavated pit. Proper precautions shall be taken to protect the public, existing facilities, structures, and utilities. Traffic bearing areas, (streets, driveways, parking lots, shall be maintained until such time as they are permanently repaired.

All surface restoration materials, methods and work shall meet or exceed the quality and workmanship of the existing facilities prior to construction, and shall be in accordance with the Florida Department of Transportation and County Standards. Where dewatering is required for any segment of this project, it will be considered an incidental cost and will not be paid for directly. Access pit excavation shall be paid for directly as indicated on the bid proposal.

5. Pipe Joining-Polyethylene Liner Pipe Method: Sections of polyethylene liner pipe shall be assembled and joined on the site above ground per Section 02620 in accordance with ASTM D-2657. If the County deems it necessary, the Contractor at his own expense will have a joint tensile test made in accordance with ASTM D-638.

Pipe Insertion: Immediately prior to insertion, the pipe shall be coated with a lubricant as recommended by the pipe manufacturer. Where installing of liner pipe is to be made through an access pit or manholes, the top of the existing main shall be exposed to the spring line of the main for the full length of the excavation shaft prior to removal of a section of the existing main. The insertion pipe with a pulling steel nosed cone head installed on each end shall also be lubricated and pulled into the existing pipe in such a manner as to prevent damage to the existing and new pipe. The heads shall be constructed such that sewage may flow though. The insertion pipe shall be accurately measured for proper length taking into account any thermal expansion or contractions. A power winch shall be connected to the end of the steel nosed cone pulling head so the line can be fed into the existing sewer pipe. Extreme care shall be taken so as not to damage, gouge, scratch or decrease the thickness of the liner pipe so as to not meet the SDR requirements or damage the joints of the liner pipe.

6. Grouting at Manhole Locations and Termination Points (Polyethylene and Fiberglass Liners)

- A. Seal space between liner and manhole opening with mortar made with calcium aluminate cement per manufacturer's recommendations. The Contractor shall apply the grout or employ an approved subcontractor for the application per Manufacturer's specifications.
- B. Filling Annular Space After the pipe liner has been inserted, the annular space between the pipe liner and the existing sewer pipe shall be filled with grout. The grout shall be worked into the annular space to provide an even, solid bedding for the pipe liner as directed and accepted by the County.
- C. Acceptable grout mixtures are tabulated per Table 1.

**TABLE 1
ACCEPTABLE GROUT MIXTURES**

Compressive Strength - psi 75 F	<u>Water gal/sk</u>	<u>Density lb/gal</u>	<u>Yield ft/sk</u>	<u>Consistency Uc*</u>
<u>Type and Description</u>				
<u>1 day 3 day 28 day</u>				
<u>Type I Cement - Neat</u>				
1500 4000 6700	5.2	15.6	1.18	8 - 12
<u>Narrow Annulus Expansive</u>				
450 1400 500	4.4	15.0	1.10	2 - 4
50-50 Fly Ash Type I CMT + EXP + WRD				
<u>Low Cost Grouts - Cement Only</u>				
Type I CMT + 2.5% Pregelled Bentonite				
145 500 1200	12.7	12.3	2.20	5 - 10
Type I CMT + Econolite-L (0.66 gal/sk)				
720 1080 1500	11.3	12.7	2.08	5 - 10
<u>Low Cost Grout with Fly Ash</u>				
75-25 Fly Ash - Type I CMT				
100 350 2300	4.0	14.9	1.02	8 - 12
87.5-12.5 Fly Ash-Type I CMT + Activators				
20 230 2300	4.0	14.7	1.07	15 - 20
<u>Low Cost High Sand Grout</u>				
Type 1 + 3.4 Parts Sand + 2.5% Pregelled Bentonite				
300 750 1120	15.0	16.3	4.42	20 - 40
<u>Normal Strength High Sand Grout</u>				
33-67 Fly Ash - Type I CMT 3.5 Port Sand + WRD				
1000 2000 4400	6.57	18.6	3.41	20 - 30
<u>Expansive High Strength Grout</u>				
Type I CMT 150% Sand + EXP + WRD				
5000 1500 10,500	5.0	18.5	2.03	10 - 20

*Uc = Units of Consistency. Equivalent to poses viscosity, but not directly related.

CMT = Cement, EXP = Expansive Admixture, WRD - Water reducing dispersant

3.02 MATERIALS - POLYESTER FELT LINING

The liner shall consist of polyester fiber felt tube, lined on one side with an impermeable coating and impregnated with a liquid thermo-setting resin. The materials shall be chemically resistant to withstand internal exposure to the corrosive effects of sewage liquids or gases, and solid in the surrounding ground and shall meet or exceed the following standard specifications.

<u>Property</u>	<u>ASTM Test Method</u>	<u>Value</u>
Tensile Stress	D 638	3,000 psi
Flexural Stress	D 790	3,000 psi
Modulus of Elasticity	D 790	300,000 psi

The Contractor shall also comply with all of the manufacturer's standards.

3.03 SIZING

The liner shall be fabricated to fit neatly into the circumference of the existing sewer pipe.

The length of the liner shall be that deemed necessary by the Contractor to effectively carry out the insertion and seal the liner at the inlet and outlet points. The Contractor shall verify the lengths in the field before cutting the liner to length. Individual inversion run can be made over one or more access points as determined in the field by the Contractor and approved by the County.

3.04 THICKNESS DESIGN OF LINER

Refer to Table 02 for the design of the wall thickness required for liner based on external pressure and three shape factor considerations. As long as the actual field conditions are within the parameters listed, this single table provides the thickness necessary. If the parameters are not met, the Contractor shall contact the County for an alternate thickness design. The thickness shall be sufficient to bear all live and dead loads encountered.

3.05 INSTALLATION OF LINE

The wet liner material shall be inserted through an existing manhole by means of an inversion process and the application of a hydrostatic head sufficient to fully extend the liner to the next designated access point. The impregnated liner materials shall be inserted into the inversion tubes with the impermeable plastic membrane side out. At the lower end of the inversion tube, the liner tube shall be turned inside out and attached to the inversion tube so that a leak proof seal is created. The inversion head will be adjusted to be of sufficient height to invert the liner to the next access point designated and to hold the liner snug to pipe wall and to produce dimples at side connections and flared ends at the entrance and exit access points. If the use of a lubricant is recommended, such lubricant shall be as approved by INA manufacturer's standards. The INA manufacturer's standards shall be closely followed during the elevated curing temperature so as not to overstress the felt fiber and cause damage or failure of the liner prior to cure. (In certain cases, the Contractor may elect to use a Top Inversion. In this method the liner is pre- inverted to attaching to an elbow at the base of the inversion tube, the liner is attached to a top ring.)

3.06 LINER CURING

After inversion is completed, the Contractor shall supply a suitable heat source and water recirculation equipment. The equipment shall be capable of delivering hot water to the far end of the liner through a hose, which has been perforated per INA manufacturer's recommendations, to uniformly raise the water temperature in the entire liner above the temperature required to effect a cure of the resin. This temperature shall be determined by the resin/catalyst system employed.

The heat source shall be fitted with suitable monitors to gauge the temperature of the incoming and outgoing heat exchanger circulating water. Thermocouples shall be placed between the liner and invert at near and far access to determine the temperature of the liner and time of exotherm. Water temperature in the line during the cure period shall not be less than 150° or more than 200° F as measured at the heat exchanger return line.

3.07 COOL-DOWN

The Contractor shall cool the hardened liner to a temperature below 100° F before relieving the static head in the inversion tube. Cool-down may be accomplished by the introduction of cool water into the inversion tube to replace water being drained from a small hole made in the end of the liner at the at the downstream end. Care shall be taken in the release of the static head such that a vacuum will not be developed that could damage the newly installed liner.

3.08 FINISH

The finished lining shall be continuous over the entire length of an insertion run and be as free as commercially practicable from visual defects such as foreign inclusions, dry spots, pinholes, and delamination. The lining shall be impervious and free of any leakage from the pipe to the surrounding ground to the inside of the lined pipe.

Any defects which will affect, in the foreseeable future the integrity or strength of the linings, shall be repaired at Contractor's expense, in a manner mutually agreed by the County.

**TABLE 2
SPECIFIED THICKNESS REQUIRED BASED ON
EXTERNAL PRESSURE AND THREE SHAPE FACTOR CONSIDERATIONS**

Exist. Pipe I.D.	Thickness in Inches for 0' to 8.0' Depth	Thickness in Inches for 8.1' to 12' Depth	Thickness in Inches for 12.1' to 16' Depth	Thickness in Inches for 16.1' to 20' Depth	Thickness in Inches for 20' to 24' Depth	Thickness in Inches for 24.1'to 28' Depth
6"	0.10	0.11	0.12	0.13	0.14	0.14
8"	0.13	0.15	0.16	0.17	0.18	0.19
10"	0.16	0.18	0.20	0.22	0.24	0.24
12"	0.19	0.22	0.24	0.26	0.28	0.29
15"	0.24	0.27	0.30	0.32	0.34	0.36
18"	0.29	0.33	0.36	0.39	0.41	0.43
21"	0.34	0.38	0.42	0.45	0.48	0.51
24"	0.38	0.44	0.48	0.52	0.55	0.58
27"	0.43	0.49	0.54	0.58	0.62	0.65
30"	0.48	0.55	0.60	0.65	0.69	0.72
36"	0.58	0.66	0.72	0.78	0.83	0.87
42"	0.67	0.77	0.84	0.91	0.96	1.01
48"	0.77	0.88	0.96	1.04	1.10	1.16
54"	0.86	0.99	1.08	1.17	1.24	1.30
60"	0.96	1.10	1.21	1.30	1.38	1.45

Table 2 is based on an open channel insitu-pipe subjected to an external static water head equal to the total flowline depth and shape factors of worse condition than an ovality of 2%, a flat in the circumference no greater in width than 20% of the diameter, and no missing segment of pipe greater than angle of 60 on the circumference. The design is based on insitu-pipe with a flexural modulus E of 250,000 psi and long-term behavior being taken into account by using a lower value to allow for creep. NOTE: The table recommends a thickness based upon the fiberfelt tubes currently manufactured. The thickness of the liner after curing is dependent upon the condition of the pipe and the resin used. Fractured pipe and open joints draw off resin and can yield a lesser finished thickness.

NOTE: THIS TABLE IS FOR PIPE LINES THAT ARE NOT FULLY DETERIORATED WHERE THE DESIGN THICKNESS WAS CALCULATED WITH THE GROUNDWATER SURFACE EQUAL TO THE EXISTING GRADE.

3.09 SEALING LINER AT THE ENDS

If due to broken or misaligned pipe at the access point, the joint fails to make a tight seal, the Contractor shall apply a seal at the point. The seal shall be of a resin mixture compatible with the liner.

3.10 TV TAPES OF SEWERS

The Contractor will be required to provide, before and after, TV records of the pipe interior per applicable language in Section 02624, 2.02.

3.11 CLEANING AND OBSTACLE REMOVAL

Follow procedure as specified in Section 02624, 2.02.

END OF SECTION

SECTION 02627 SANITARY SEWER MANHOLE REHABILITATION

PART 1 GENERAL

1.01 DESCRIPTION

- A. This specification consists of all work, materials, labor and equipment required for manhole rehabilitation for the purpose of eliminating infiltration and exfiltration, providing corrosion protection, adjusting final grade of manhole top, repair of voids and restoration of the structural integrity of the manhole. All such work shall comply with these Specifications and the specific product manufacturer's recommendations. Any conflict between the product manufacturer's recommendations and any portion of the Contract Documents shall be resolved prior to beginning the work.

1.02 PRODUCT AND MANUFACTURER QUALIFICATION REQUIREMENTS

- A. Since sewer products are intended to have a 50 year design life, and in order to minimize the County's risk, only proven products with substantial successful long term track records will be allowed. At a minimum, products and installers must meet all of the following criteria to be deemed commercially acceptable:
1. For a Product to be considered commercially acceptable, the product must have a minimum of two (2) million square feet and ten (10) year history of successful wastewater collection system installations in the United States. In addition, products must provide Third Party Test Results supporting the long-term performance and structural strength of the product and such data shall be satisfactory to the Owner. No product will be allowed without Independent Third Party Testing verification.
 2. For an installing Contractor to be considered commercially acceptable, the installer must have a certification from the manufacturer as a licensed and fully trained installer of the product. The installer must also have a minimum of one (1) million square feet of successful wastewater collection system installations on underground concrete/masonry structures and ten (10) years of rehabilitation experience.

1.03 SUBMITTALS:

- A. Product
1. Technical data sheets showing the physical and chemical properties.
 2. Material Safety Data Sheets (MSDS).
 3. Third Party Testing results.
 4. Verification of minimum installation requirements set forth in section 1.02.A.1 above.
- B. Installer
1. Verification of "certified applicator" status.
 2. Verification of minimum installation requirements set forth in section 1.02.A.2 above.
- C. Written certification from the product manufacturer that each of the proposed rehabilitation products is compatible with each other.

- D. Submit with Each Project:
1. Description, layout, and application sequencing plan.
 2. Rehabilitation system application requirements including material handling and storage requirements, mixing and proportioning requirements (as applicable), maximum pot life, film/coating thickness, curing, testing and certification requirements of all rehabilitation materials. Product Material Safety Data Sheets.
 3. Detailed instructions and methodology for finishing all pipe and manhole connections to rehabilitated manholes to prevent infiltration and exfiltration.
 4. Wastewater Flow Control/Bypassing Plan.
 5. Confined Space Entry Plan/Permit.
 6. Plan for capturing extraneous debris during rehabilitation processes and debris disposal.

PART 2 PRODUCTS

2.01 MATERIAL

- A. Refer to the latest edition of the County's Approved Product List for acceptable products.

2.02 CEMENTITIOUS MORTAR

- A. Mortar shall be made of one part Portland cement and two parts clean sharp sand. Cement shall be Type 1 and shall conform to ASTM C150. Sand shall meet the requirements of ASTM C144.

2.03 PATCHING MATERIAL

- A. A quick setting fiber reinforced cementitious material shall be used as a patching material and is to be mixed and applied according to manufacturer's recommendations.

2.04 HYDRAULIC CEMENT

- A. A rapid setting, high-early-strength, cementitious product specifically formulated for leak control shall be used to stop water infiltration. The material shall be mixed and applied according to the manufacturer's recommendations.

2.05 CHEMICAL GROUT

- A. A chemical grout shall be used for stopping very active infiltration and filling voids.

2.06 LINER MATERIAL

A. CEMENTITIOUS MATERIAL

1. Cementitious liner products shall be used to form a structural monolithic liner covering all interior manhole surfaces and shall have the following minimum requirements:
 - a. Compressive Strength (ASTM C109): 7,000 psi, 28days
 - b. Tensile Strength (ASTM C496): 700 psi, 28 days
 - c. Flexural Strength (ASTM C293): 1,300 psi, 28 days
 - d. Shrinkage (ASTM C596): 0.02% at 28 days
 - e. Minimum Bond (ASTM C952): 200 psi, 28 days
2. Refer to Section 09920 Sewpercoat Surface System of the specifications.

When used as the final rehabilitation liner material (no epoxy liner), product shall be made with calcium aluminate cement. Calcium aluminate is not required when the cementitious liner is used as the underlayment for a protective coating liner application.

B. PROTECTIVE COATING LINER MATERIAL

1. The protective coating liner is to be applied where corrosion is anticipated. The protective coating liner material shall be applied over the completed cementitious liner material (without the calcium aluminate). The liner shall be spray applied or spin cast. The manufacturer of the selected protective coating liner material shall approve in writing that their protective coating liner is compatible with cementitious repair and liner material.
2. The protective coating liner material shall conform to Section 09970 Surface Protection Spray Systems of the specifications.

C. WATER

1. Water shall be clean and potable.

2.07 INTERNAL MANHOLE CHIMNEY SEAL MATERIAL

- A. Butyl rubber strips used to prevent leakage of water into the manhole through the frame joint area and the area above the manhole cone and shall have the following minimum requirements:
1. Elongation (ASTM D412): 600%
 2. Tensile Strength (ASTM D412): 1,150 psi
 3. Adhesive Strength (ASTM D903): 175 lb. /in.
 4. Tear Resistance (ASTM D1004): 155 lb. /in.

The seal shall extend from the inside of the manhole frame down to the cone or corbel of the manhole. Seal shall be minimum 3" wide x ½" thick so that all joints are watertight.

2.08 EXTERNAL MANHOLE SEAL WRAP

- A. External Manhole Seal Wrap: When work consists of adjusting manholes or cone replacements, an external seal wrap shall be installed to the outside of concrete risers and joints of the precast manhole in order to eliminate infiltration. The external seal wrap shall be installed in accordance with the details of the Contract Documents and the manufacturer's recommendations.

PART 3 EXECUTION

3.01 PREPARATION

- A. Perform traffic control in accordance with the approved traffic control submittal.
- B. Store materials in accordance with manufacturer's recommendations.
- C. Schedule and perform the work in a manner that does not cause or contribute to overflows or spills of sewage from the sewer system.
- D. Install devices to prevent extraneous material from entering the sewer system and to prevent upstream line from flooding the manhole. If extraneous material or debris falls into a "live" manhole during adjustment operations, the Contractor shall remove debris at no cost to the Owner.
- E. Dispose of wastes in accordance with applicable regulations.
- F. Schedule and perform any bypass pumping that will be necessary to properly rehabilitate the manhole.
- G. If present in the manhole, Contractor shall remove all access steps. Removal shall consist of neatly cutting steps flush with the wall prior to any lining installation. Contractor shall be responsible for proper disposal of steps.
- H. For manholes that are located within pavement areas and require resetting or replacement of concrete riser rings, cones, and /or frames, the Contractor shall sawcut, remove, and replace a 6 ft. x 6 ft. square or round section of pavement and base for rehabilitation operations. Costs for removal and replacement of pavement and base beyond these limits shall be borne by the Contractor.

3.02 INSTALLATION

- A. Prior to any lining all other miscellaneous work must be complete.
- B. Prior to man entry into any structure to be rehabilitated, proper ventilation and strict confined space OSHA regulations shall be followed. Failure to do so shall be grounds for removal from the project.

3.03 CONE REPLACEMENT

- A. The Contractor shall replace existing deteriorated manhole cone section with new precast concrete cone section. A preformed rubber gasket shall be placed in all keyways between existing manhole riser section and cone joints. Prior to backfilling, rubber external seal wraps shall be applied to the cone and manhole section joint, riser rings and frame in accordance with Manatee County Public Works Department Utility Standards. If the existing manhole is of brick construction, the cone shall be set in a full bed of mortar on the top course of bricks.

3.04 GRADE ADJUSTMENT RINGS

- A. The Contractor shall replace existing, deteriorated grade adjustment rings with new precast concrete riser rings. All manholes designated to receive casting adjustment and/or

alignment shall be adjusted to meet existing finished grade unless an alternative elevation is specified. A minimum 3-inch wide by ½-inch thick butyl rubber sealant strip adhesive shall be placed in between individual precast concrete grade adjustment rings, and precast concrete rings and cone joints. If the manhole is corrosion-prone as defined by Specification Section 02625, then the grade adjustment rings shall be made of polymer concrete. The butyl rubber sealant strips shall be per the latest edition of the County's Approved Products List. Prior to backfilling, rubber external seal wraps shall be applied to the cone and manhole section joint, grade adjustment rings and frame in accordance with Manatee County Public Works Department Utility Standards.

3.05 MANHOLE FRAME AND COVER

- A. Existing frames and covers which must be removed to facilitate manhole rehabilitation, riser reconstruction, and/or casting alignment or grade adjustments shall be salvaged, cleaned and given two coats of an approved bituminous coating by the Contractor for replacement unless determined to be defective by County. If manhole frame and/or cover are determined to be defective, Contractor shall replace with new standard frame and/or cover per the latest edition of the County's Approved Products List. If the manhole is corrosion-prone as defined by Specification Section 02625, then the frame and cover shall be heavy duty composite per the latest edition of the County's Approved Products List. A minimum 3-inch wide by ½-inch thick butyl rubber sealant strip adhesive shall be placed between manhole frame and grade adjustment rings or manhole cone.
- B. Existing manhole covers, which must be adjusted to existing or new pavement surfaces, shall be adjusted by modifying the existing precast concrete adjustment rings to bring the entire existing ring and cover to grade.
- C. No manhole cover adjustment rings shall be allowed.

3.06 CEMENTITIOUS LINER

- A. Active leaks shall be stopped using hydraulic cement or chemical grout as necessary. Installation shall be in accordance with the manufacturer's recommendations.
- B. All manholes to be lined shall be cleaned and scarified with a minimum of 5,000 psi water jet at a minimum water temperature of 180 degrees F. The water jet shall hit the manhole wall surface at as near perpendicular angle as possible. Cleaning the manhole walls from the ground surface without the appropriate angled nozzles will not be accepted. Manhole surface build-up of debris and loose manhole construction materials shall be removed during the cleaning process.
- C. The intent of the surface preparation and cleaning work is to remove debris, films (oil, greases, etc.) or unsound, deteriorated concrete and to provide a structurally sound, clean surface that will enable lining materials to bond to the original substrate at adhesion strengths of that specified herein. A substrate pH of 8.3 is the minimum pH that will be considered acceptable to demonstrate that the surface preparation and cleaning have been properly performed.
- D. Additional aggressive surface preparation and cleaning methods may be necessary to remove carbonated cementitious lining concrete or contaminants that remain after the cleaning performed as described above. The Contractor shall test the pH of the cleaned manhole interior surface at various locations of the manhole and when the results indicate a pH less than 8.3, then additional surface preparations and cleaning will be required. As a

minimum level of effort the Contractor shall either dry sand blast or pneumatic jackhammer with a bushing bit followed by a minimum 5,000 psi water blast.

- E. Any bench, invert or service line repairs shall be made at this time using quick setting grout or repair mortar per the manufacturer's recommendations.
- F. Invert repair shall be performed on all inverts with visible damage or where infiltration is present. After blocking flow through the manhole and thoroughly cleaning the invert, quick setting patch material shall be applied to the invert in an expeditious manner. The finished invert surfaces shall have a smooth surface and form a continuous monolithic conduit with the sewer pipe entering and leaving the manhole. The bench and invert shall form a watertight seal with the manhole walls, base, and pipe seal.
- G. Wastewater flow shall be controlled by methods which prevent contact with the new bench and invert for 6-8 hours after mortar placement. If 6-8 hours set time is not possible, a fast setting, high early strength mortar shall be used with provisions for flow control until concrete has set.
- H. Fill all cracks, holes, and joints that have voids using non-shrink grouts in accordance with the manufacturer's recommendations.
- I. Apply Cementitious Liner Material per the Manufacturer's recommendations. Apply Cementitious Liner material so that the final thickness is 0.5-inch minimum or per the thickness required by the manufacturer's minimum specification, whichever is greater. The material shall start at the bottom of the manhole frame and extend to the water level of the invert.
- J. Finishing: Trowel the surface of the liner to create a uniform smooth finish. Caution shall be taken to prevent over working the material. Once the initial cure has taken place, the exposed surface area should be given a broom finish. Thickness may be verified at any point with a wet gage.
- K. If the cementitious lining material is not immediately coated with a protective coating liner, apply a seal coat compatible with the repair material to aid in curing and minimize recontamination of the substrate prior to application of the protective coating liner material.

3.07 PROTECTIVE COATING LINER

- A. Prior to any protective coating lining, perform all work shown in Section 3.06 above.
- B. Remove any curing compounds, sealers or contaminants prior to protective coating lining.
- C. Apply protective coating lining material in accordance with the manufacturer's recommendations over the waterproofing/structural repair material shown in Section 3.06.
- D. Apply protective coating lining material to all internal surface area of the structure.
- E. Apply protective coating lining material in accordance to Section 09970 Surface Protection Spray System of the specifications.

3.08 EXTERNAL MANHOLE JOINT WRAP

- A. When Work consists of adjusting sewer manholes or cone replacement, an external seal wrap shall be installed on the outside joints of concrete risers, concrete cones, grade adjustment rings, and manhole frames in order to eliminate infiltration. Frame and cover shall be completely coated prior to installation of the external seal wrap. The external seal wrap shall be installed using min. twelve-inch wide elastomeric plastic joint wrap centered over all exposed manhole joints in accordance with the manufacturer's recommendations. External manhole joint wrap shall be per the latest edition of the County's Approved Products List.

3.09 INTERNAL MANHOLE JOINT SEALANT

- A. When Work consists of adjusting sewer manholes or cone replacement, an internal manhole joint sealant shall be applied just before the manhole riser section reassembly in order to eliminate infiltration. The sealant shall be a minimum of ½-inch x ¾ inch bead of urethane paste per the latest edition of the County's Approved Products List.

3.10 MANHOLE INSERT

- A. If existing manhole is not equipped with a watertight manhole rainwater insert, Contractor shall furnish and install a new manhole insert per Manatee County Public Works Utility Standards Section 12 and in accordance with the manufacturer's recommendations. The rainwater insert shall be minimum 18 gauge 304 stainless steel or 1/8" thick thermoplastic polyolefin per the latest edition of the County's Approved Products List.
- B. If existing manhole is equipped with a watertight manhole insert to prevent intrusion of storm water, the insert shall be cleaned and reinstalled by the Contractor, unless determined to be defective by the County. If insert is determined to be defective, Contractor shall furnish a new watertight manhole insert and install in accordance with manufacturer's recommendations at the completion of manhole rehabilitation operations.

3.11 TESTING

- A. After completion of any rehabilitation operation and prior to backfilling (if required), the Contractor shall conduct the following tests on the manholes:
 - 1. Visual Inspection: The County and Contractor shall make a final visual inspection. Any deficiencies in the finished system shall be marked and repaired.
- B. If a protective coating liner is applied, the following additional tests will be required:
 - 1. Wet Film Thickness Gage: During application a wet film thickness gage, meeting ASTM D4414 - Standard Practice for Measurement of Wet Film Thickness of Organic Coatings by Notched Gages, shall be used to ensure a monolithic coating and uniform thickness during application.

3.12 WARRANTY

- A. The Contractor shall guarantee the work to be free of defects in materials and workmanship for five-year period, unless otherwise stated, after completion and acceptance of the work. The Contractor shall repair defects in materials or workmanship, which may develop during the warranty period; and any damage to other work caused by such defects or discovered within the same period at no additional cost to the County.

3.13

WARRANTY INSPECTIONS

- A. Conduct visual inspection prior to expiration of warranty to determine integrity of rehabilitation materials and water-tightness.
 - 1. Complete post inspection during first high groundwater period (spring or fall) following acceptance of work.
 - 2. Contractor should accompany County on inspections.
 - 3. Inspect a minimum of 25 percent of the manholes rehabilitated at locations selected by County.
 - a. Infiltration and Inflow: None
 - b. Structural Repair: Sound
 - c. If more than one manhole fails warranty inspection, inspect all manholes with similar characteristics.
 - d. Repair defects in accordance with Warranty.

END OF SECTION

SECTION 02720 SANITARY SEWER BYPASS PUMPING

PART 1 GENERAL

1.01 SCOPE

The Contractor shall furnish all labor, materials, equipment and incidentals required to maintain existing and anticipated flows within the affected portion of the collection system throughout the construction period.

1.02 PUBLIC IMPACTS

The Contractor shall not create a public nuisance due to excessive noise or dust, nor impact the public with flooding of adjacent lands, discharge of raw sewage, or release of other potential hazards, nor shall he encroach on or limit access to adjacent lands. No extra charge may be made for increased costs to the Contractor due to any of the above.

1.03 SUBMITTALS

- A. The Contractor shall, within 30 days of the date of the Notice to Proceed, submit to the Project Manager a detailed Pumping Plan for each site in which by-pass pumping will be needed. The Pumping Plan shall address all measures and systems to prevent a sanitary sewer overflow (SSO) as defined by the EPA. The Plan shall include as a minimum:
1. Working drawings and sketches showing work location, pump location, piping layout & routing. Show all proposed encroachment and access impacts on adjacent properties or facilities.
 2. Pump, control, alarm and pipe specifications or catalog cuts. Detailed sketch of controls and alarm system.
 3. Power requirements and details on methods to provide by-pass power or fueling.
 4. Calculation and determination of response times to prevent an SSO after a high water alarm. If anticipated peak flows are 750 G.P.M. or greater, an operator is required on site at all times pump is in service. If the anticipated peak flows are less than 750 G.P.M. an operator may not be required to be on site at all times; show operator on-site schedule.
 5. Procedures to be taken in case of power, pump, or piping failures; including contact names and numbers for emergency notifications.
 6. Frequency and specific responsibility for monitoring pump operation, fuel levels, pump maintenance and entire length of piping.

PART 2 PRODUCTS

2.01 EQUIPMENT

- A. Pumps:
1. By-pass pumping system shall consist of at least a primary pump and a backup pump. Each pump shall have a minimum pumping capacity of 100% of the anticipated peak flows. When bypassing a pump station, 100% of the lift station capacity (G.P.M. & T.D.H) shall be provided.
 2. Pumps shall be low noise or sound attenuated. The noise level at any operating condition, in any direction, shall not exceed 70dBA at a distance of twenty-three (23) feet (7 meters) from the pump and/or power source.

B. Controls:

The by-pass pump system shall be equipped with automatic controls and an alarm system. The automatic controls will automatically start the backup pump in the event of a high water condition or failure of the primary pump. The alarm system will immediately notify the Contractor of a pump failure or high water condition.

C. Pipe:

Pipe shall be of adequate size and capacity to match the pumps. Pipe type and materials will depend on the particulars of the site conditions, and shall be detailed in the Pumping Plan. Contractor will provide all connections.

PART 3 EXECUTION

3.01 SITE CONDITIONS

Site conditions will vary by site. Contractor is responsible to determine and address requirements such as traffic control, excavation, connections & fittings, impacts on access to adjacent properties, routing and support of by-pass piping, etc., in the Pumping Plan.

3.02 ON-SITE MONITORING

- A. All by-pass operations where the anticipated flow rates are 750 G.P.M or greater shall require an employee on-site at all times (full-time on-site monitoring attended by personnel experienced with the pumps and controls, with demonstrated ability to monitor, turn on & off, and switch between pumps) while the by-pass pump system is in service.
- B. By-pass operations where the anticipated flow rates are less than 750 G.P.M may not require an employee on-site at all times while the by-pass pump system is in operation. The Contractor shall have personnel experienced with the pumps and controls on site within the calculated response time to prevent an SSO after a high water alarm.
- C. During by-pass operations, the Contractor shall have posted on site with the permit, a copy of the approved Plan and the name and 24 hour contact number of the primary response person, the job site superintendent, and the construction company owner.

3.03 OPERATIONS

- A. The Contractor is responsible for securing and providing power, fuel, site security, traffic control and all other supplies, materials and permits required for the by-pass pumping.
- B. Contractor shall demonstrate automatic pump switching and alarm system to the satisfaction of: the County inspector, Project Manager, or Lift Stations Superintendent prior to beginning by-pass pumping. Satisfactory demonstration shall be documented by the inspector's, PM's or Lift Station Superintendent's dated signature on the posted copy of the approved Pumping Plan.

3.04 DAMAGE RESTORATION & REMEDIATION

- A. The Contractor shall be responsible for any pre-pump notifications, all restoration of pre-pump conditions and any damage caused by by-pass operations.
- B. Should there be an SSO caused by or as a direct result of the by-pass pumping, the Contractor is responsible for all immediate & long term response, notifications, clean up, mitigation, etc. Copies of all written response plans, notifications, documentation, mitigation plans, etc., shall be submitted to the County Project Manager.

END OF SECTION

DIVISION 3 CONCRETE

SECTION 03200 CONCRETE REINFORCEMENT

PART 1 GENERAL

1.01 WORK INCLUDED

- A. Reinforcing steel bars and welded steel wire fabric for cast-in-place concrete, complete with tie wire.
- B. Support chairs, bolsters, bar supports and spacers, for reinforcing.

1.02 QUALITY ASSURANCE

Perform concrete reinforcing work in accordance with ACI 318 unless specified otherwise in this Section.

1.03 REFERENCES

- A. ACI 318 - Building Code Requirements for Reinforced Concrete.
- B. ASTM A185 - Welded Steel Wire Fabric for Concrete Reinforcement.
- C. ASTM A615 - Deformed and Plain Billet Steel Bars for Concrete Reinforcement.
- D. CRSI 63 - Recommended practice for placing reinforcing bars.
- E. CRSI 65 - Recommended practice for placing bar supports, specifications and nomenclature.
- F. ACI 315 - American Concrete Institute - Manual of Standard Practice.

1.04 SHOP DRAWINGS

- A. Submit shop drawings in accordance with Contract Documents.
- B. Indicate bar sizes, spacings, locations and quantities of reinforcing steel and wire fabric, bending and cutting schedules and supporting and spacing devices.
- C. Manufacturer's Literature: Manufacturer's specifications and installation instructions for splice devices.

PART 2 PRODUCTS

2.01 REINFORCING

- A. Reinforcing steel: Grade 60, Minimum Yield Strength 60,000 psi, deformed billet steel bars, ASTM A615; plain finish.
- B. Welded steel wire fabric: Deformed wire, ASTM A497; smooth wire ASTM A185 in flat sheets; plain finish.

2.02 ACCESSORY MATERIALS

- A. Tie wire: Minimum 16 gauge annealed type, or patented system accepted by County.
- B. Chairs, bolsters, bar supports, spacers: Sized and shaped for strength and support of reinforcing during construction conditions.
- C. Special chairs, bolsters, bar supports, spacers (where adjacent to architectural concrete surfaces): Stainless steel type sized and shaped as required.

2.03 FABRICATION

- A. Fabricate concrete reinforcing in accordance with ACI 315.
- B. Locate reinforcing splices, not indicated on Drawings, at points of minimum stress. Location of splices shall be reviewed by County.
- C. Where indicated, weld reinforcing bars in accordance with AWS D12.1.

PART 3 EXECUTION

3.01 PLACEMENT

- A. Reinforcing shall be supported and secured against displacement. Do not deviate from true alignment.
- B. Before placing concrete, ensure reinforcing is clean, free of loose scale, dirt, or other foreign coatings which would reduce bond to concrete.

3.02 QUALITY ASSURANCE

- A. Acceptable Manufacturers: Regularly engaged in manufacture of steel bar and welded wire fabric reinforcing.
- B. Installer Qualifications: Three years experience in installation of steel bar and welded wire fabric reinforcing.
- C. Allowable Tolerances:
 - 1. Fabrication:
 - a. Sheared length: ± 1 in.
 - b. Depth of truss bars: $\pm 0, -1/2$ in.
 - c. Stirrups, ties and spirals: $\pm 1/4$ in.
 - d. All other bends: ± 1 in.
 - 2. Placement:
 - a. Concrete cover to form surfaces: $\pm 1/4$ in.
 - b. Minimum spacing between bars: 1 in.
 - c. Top bars in slabs and beams:
 - (1) Members 8 in. deep or less: $\pm 1/4$ in.
 - (2) Members more than 8 in.: $\pm 1/2$ in.
 - d. Crosswise of members: Spaced evenly within 2 in. of stated separation.
 - e. Lengthwise of members: Plus or minus 2 in.

3. Maximum bar movement to avoid interference with other reinforcing steel, conduits, or embedded items: 1 bar diameter.

3.04 PRODUCT DELIVERY, STORAGE AND HANDLING

- A. Deliver reinforcement to project site in bundles marked with metal tags indicating bar size and length.
- B. Handle and store materials to prevent contamination.

3.05 INSTALLATION

- A. Placement:
 1. Bar Supports: CRSI 65.
 2. Reinforcing Bars: CRSI 63.
- B. Steel Adjustment:
 1. Move within allowable tolerances to avoid interference with other reinforcing steel, conduits, or embedded items.
 2. Do not move bars beyond allowable tolerances without concurrence of County.
 3. Do not heat, bend, or cut bars without concurrence of County.
- C. Splices:
 1. Lap splices: Tie securely with wire to prevent displacement of splices during placement of concrete.
 2. Splice devices: Install in accordance with manufacturer's written instructions.
 3. Do not splice bars without concurrency of County, except at locations shown on Drawings.
- D. Wire Fabric:
 1. Install in longest practicable length.
 2. Lap adjoining pieces one full mesh minimum, and lay splices with 16 gauge wire.
 3. Do not make end laps midway between supporting beams, or directly over beams of continuous structures.
 4. Offset end laps in adjacent widths to prevent continuous laps.
- E. Cleaning: Remove dirt, grease, oil, loose mill scale, excessive rust, and foreign matter that will reduce bond with concrete.
- F. Protection During Concreting: Keep reinforcing steel in proper position during concrete placement.

END OF SECTION

SECTION 03300 CAST-IN-PLACE CONCRETE

PART 1 GENERAL

1.01 WORK INCLUDED

Poured-in-place concrete slabs, thrust blocks, pile caps and pipe support cradles.

1.02 QUALITY ASSURANCE

Perform cast-in-place concrete work in accordance with ACI 318, unless specified otherwise in this Section.

1.03 TESTING LABORATORY SERVICES

- A. Inspection and testing will be performed by the testing laboratory currently under contract to Manatee County in accordance with the Contract Documents.
- B. Provide free access to work and cooperate with appointed firm.
- C. Submit proposed mix design of each class of concrete to inspection and testing firm for review prior to commencement of work.
- D. Tests of cement and aggregates may be performed to ensure conformance with requirements stated herein.
- E. Three concrete test cylinders will be taken for every 100 cu. yds. or part thereof of each class of concrete placed each day. Smaller pours shall have cylinders taken as directed by the County.
- F. One slump test will be taken for each set of test cylinders taken.

1.04 REFERENCES

- A. ASTM C33 - Concrete Aggregates
- B. ASTM C150 - Portland Cement
- C. ACI 318 - Building Code Requirements for Reinforced Concrete
- D. ASTM C260 - Air Entraining Admixtures for Concrete
- E. ASTM C94 - Ready-Mixed Concrete
- F. ACI 304 - Recommended Practice for Measuring, Mixing, Transporting and Placing Concrete
- G. ACI 305 - Recommended Practice for Hot Weather Concreting

PART 2 PRODUCTS

2.01 CONCRETE MATERIALS

- A. Cement: Moderate-Type II, High early strength-Type III, Portland type, ASTM C150.
- B. Fine and Coarse Aggregates: ASTM C33.
- C. Water: Clean and free from injurious amounts of oil, alkali, organic matter, or other deleterious material.

2.02 ADMIXTURES

- A. Air Entrainment: ASTM C260.
- B. Chemical: ASTM C494 Type A - water reducing admixture.

2.03 ACCEPTABLE MANUFACTURERS

Acceptable Products:

- 1. Pozzolith
- 2. WRDA

2.04 ACCESSORIES

Non-shrink grout: Premixed compound consisting of non-metallic aggregate, cement, water reducing and plasticizing agents; capable of developing minimum compressive strength of 2400 psi in 2 days and 7000 psi in 28 days.

2.05 CONCRETE MIXES

- A. Mix concrete in accordance with ASTM C94.
- B. Provide concrete of following strength:
 - 1. Required concrete strengths as determined by 28 day cylinders shall be as shown on the Drawings, but shall not be less than 3000 psi.
 - 2. Select proportions for normal weight concrete in accordance with ACI 301 3.8 Method 1, Method 2, or Method 3. Add air entraining agent to concrete to entrain air as indicated in ACI 301 Table 3.4.1.
 - 3. All mixes shall be in accordance with FDOT Specifications.
- C. Use set-retarding admixtures during hot weather only when accepted by County.
- D. Add air entraining agent to concrete mix for concrete work exposed to exterior.

2.06 FORMS

- A. Forms shall be used for all concrete masonry, including footings. Form shall be so constructed and placed that the resulting concrete will be of the shape, lines, dimensions, appearance and to the elevations indicated on the Drawings.

- B. Forms shall be made of wood, metal, or other approved material. Wood forms shall be constructed of sound lumber or plywood of suitable dimensions, free from knotholes and loose knots; where used for expose surfaces, boards shall be dressed and matched. Plywood shall be sanded smooth and fitted with tight joints between panels. Metal forms shall be of an approved type for the class of work involved and of the thickness and design required for rigid construction.
- C. Edges of all form panels in contact with concrete shall be flush within 1/32-inch and forms for plane surfaces shall be such that the concrete will be plane within 1/16-inch in four feet. Forms shall be tight to prevent the passage of mortar and water and grout.
- D. Forms for walls shall have removable panels at the bottom for cleaning, inspection and scrubbing-in of bonding paste. Forms for walls of considerable height shall be arranged with tremies and hoppers for placing concrete in a manner that will prevent segregation and accumulation of hardened concrete on the forms or reinforcement above the fresh concrete.
- E. Molding or bevels shall be placed to produce a 3/4-inch chamfer on all exposed projecting corners, unless otherwise shown on the Drawings. Similar chamfer strips shall be provided at horizontal and vertical extremities of all wall placements to produce "clean" separation between successive placements as called for on the Plans.
- F. Forms shall be sufficiently rigid to withstand vibration, to prevent displacement or sagging between supports and constructed so the concrete will not be damaged by their removal. The Contractor shall be entirely responsible for their adequacy.
- G. Forms, including new pre-oiled forms, shall be oiled before reinforcement is placed, with an approved nonstaining oil or liquid form coating having a non-paraffin base.
- H. Before form material is re-used, all surfaces in contact with concrete shall be thoroughly cleaned, all damaged places repaired, all projecting nails withdrawn, all protrusions smoothed and in the case of wood forms pre-oiled.
- I. Form ties encased in concrete shall be designed so that after removal of the projecting part, no metal shall be within 1-inch of the face of the concrete. That part of the tie to be removed shall be at least 1/2-inch diameter or be provided with a wood or metal cone at least 1/2-inch in diameter and 1-inch long. Form ties in concrete exposed to view shall be the cone-washer type equal to the Richmond "Tyscru". Throughbolts or common wire shall not be used for form ties.

PART 3 EXECUTION

3.01 PLACING CONCRETE

- A. Place concrete in accordance with ACI 304.
- B. Notify County minimum 24 hours prior to commencement of concreting operations.
- C. Verify anchors, seats, plates and other items to be cast into concrete are placed, held securely and will not cause hardship in placing concrete. Rectify same and proceed with work.
- D. Maintain records of poured concrete items. Record date, location of pour, quantity, air temperature and test samples taken.

- E. Ensure reinforcement, inserts, embedded parts, formed expansion and contraction joints are not disturbed during concrete placement.
- F. Prepare previously placed concrete by cleaning with steel brush and applying bonding agent. Apply bonding agent in accordance with manufacturer's recommendations.
- G. Pour concrete continuously between predetermined construction and control joints. Do not break or interrupt successive pours such that cold joints occur.
- H. In locations where new concrete is dowelled to existing work, drill holes in existing concrete, insert steel dowels and pack solidly with non-shrink grout.
- I. Excessive honeycomb or embedded debris in concrete is not acceptable. Notify County upon discovery.
- J. Conform to ACI 305 when concreting during hot weather.

3.02 SCREEDING

Screed surfaces level, maintaining flatness within a maximum deviation of 1/8" in 10 feet.

3.03 PATCHING

Allow County to inspect concrete surfaces immediately upon removal of forms. Patch imperfections as directed. All patching procedures shall be submitted to and approved by the County prior to use.

3.04 DEFECTIVE CONCRETE

- A. Modify or replace concrete not conforming to required lines, details and elevations.
- B. Repair or replace concrete not properly placed resulting in excessive honeycomb and other defects. Do not patch, fill, touch-up, repair, or replace exposed architectural concrete except upon express direction of County for each individual area.

3.05 CONCRETE FINISHING

Provide concrete surfaces to be left exposed, columns, beams and joists with smooth rubbed finish.

3.06 CURING AND PROTECTION

Beginning immediately after placement, protect concrete from premature drying, excessively hot or cold temperatures and mechanical injury. Maintain concrete with minimal moisture loss at relatively constant temperature for a period of 7 days or until concrete strengths reaches 75% of the 28-day design strength.

Protection against moisture loss may be obtained with spray on curing compounds or plastic sheets. Protection against heat or cold may be obtained with insulated curing blankets or forms.

3.07 CONCRETE DRIVEWAY RESTORATION

Concrete driveways shall be restored with 6 inches of 3,000 psi concrete with W2.5 X W2.5, 6X6 wire mesh. Place ½-inch expansion joint between back of curb and new concrete. Area beneath restoration shall be mechanically tamped prior to placing concrete.

3.08 CONCRETE SIDEWALK RESTORATION

Concrete sidewalks across driveways shall be restored with 6 inches of 3,000 psi concrete with W2.5 X W2.5, 6X6 wire mesh. Place ½-inch expansion joint between back of curb and new concrete. Area beneath restoration shall be mechanically tamped prior to placing concrete.

Concrete sidewalks outside of driveways shall be restored with 4 inches of 3,000 psi concrete per FDOT Design Standards, Sections 522 & 310.

END OF SECTION

SECTION 03350 CONCRETE FINISHES

PART 1 GENERAL

1.01 SCOPE OF WORK

Furnish all labor, materials, equipment and incidentals required to finish cast-in-place concrete surfaces as specified herein.

1.02 SUBMITTALS

Submit to the County as provided in the Contract Documents, the proposed chemical hardener manufacturer's surface preparation and application procedures.

1.03 SCHEDULE OF FINISHES

- A. Concrete for the Project shall be finished in the various specified manners either to remain as natural concrete or to receive an additional applied finish or material under another Section.
- B. The base concrete for the following conditions shall be finished as noted and as further specified herein:
 - 1. Exterior, exposed concrete slabs and stairs - broomed finish.
 - 2. Interior, exposed concrete slabs - steel trowel finish.
 - 3. Concrete on which process liquids flow or in contact with sludge - steel trowel finish.
 - 4. Concrete where not exposed in the finished work and not scheduled to receive an additional applied finish or material - off-form finish.
 - 5. Provide concrete surfaces to be left exposed such as walls, columns, beams and joists with smooth rubbed finish.

1.04 RESPONSIBILITY FOR CHANGING FINISHES

- A. The surface finishes specified for concrete to receive additional applied finishes or materials are the finishes required for the proper application of the actual products specified under other Sections. Where different products are approved for use, it shall be the Contractor's responsibility to determine if changes in finishes are required and to provide the proper finishes to receive these products.
- B. Changes in finishes made to accommodate product different from those specified shall be performed at no additional cost to the County. Submit the proposed new finishes and their construction methods to the County for approval.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Portland cement and component materials required for finishing the concrete surfaces shall be as specified in the Contract Documents.
- B. Hardener shall be Lapidolith as manufactured by Sonneborn Building Products or approved equal. Hardener shall be used on all floors, stair treads and platforms.

PART 3 EXECUTION

3.01 FORMED SURFACES

- A. Forms shall not be stripped before the concrete has attained a strength of at least 50 percent of the ultimate design strength. This is equivalent to approximately five "100 day-degrees" of moist curing.
- B. Care shall be exercised to prevent damaging edges or obliterating the lines of chamfers, rustications, or corners when removing the forms or doing any work adjacent thereto.
- C. Clean all exposed concrete surfaces and adjoining work stained by leakage of concrete, to the satisfaction of the County.
- D. Off-form finish. Fins and other projections shall be removed as approved. Tie cone holes and other minor defects shall be filled with non-shrink grout specified under the Contract Documents.

3.02 FLOORS AND SLABS

- A. Floors and slabs shall be screeded to the established grades and shall be level with a tolerance of 1/8-inch when checked with a 10 foot straight edge, except where drains occur, in which case floors shall be pitched to drains as indicated. Failure to meet either of above shall be cause for removal, grinding, or other correction as approved by the County.
- B. Following screeding as specified above, power steel trowel as follows:
 - 1. Immediately after final screeding, a dry cement/sand shake in the proportion of 2-sacks of Portland cement to 350-pounds of coarse natural concrete sand shall be sprinkled evenly over the surface at the rate of approximately 500 pounds per 1,000 square feet of floor. Neat, dry cement shall not be sprinkled on the surface. This shake shall be thoroughly floated into the surface with an approved disc type power compacting machine weighing at least 200 pounds if a 20-inch disc is used or 300 pounds if a 24-inch disc is used (such as a "Kelly Float" as manufactured by the Weisner-Rapp Corporation of Buffalo, New York). A mechanical blade-type float or trowel is not acceptable for this work.
NOTE: This operation (application of the cement/sand shake) may be eliminated at the discretion of the County if the base slab concrete exhibits adequate fattiness and homogeneity.
 - 2. In lieu of power steel troweling, small areas as defined by the County shall be compacted by hand steel troweling with the dry cement/sand shake as ordered.
 - 3. The floor or slab shall be compacted to a smooth surface and the floating operation continued until sufficient mortar is brought to the surface to fill all voids. The surfaces shall be tested with a straight edge to detect high and low spots which shall be eliminated.
 - 4. Compaction shall be continued only until thorough densification is achieved and a small amount of mortar is brought to the surface. Excessive floating shall be avoided.
- C. After Paragraph 3.02A and B procedures are accomplished, floors and slabs for particular conditions shall be completed as scheduled in one of the following finishes:

1. Wood float finish: Hand wood float, maintaining the surface tolerance to provide a grained, nonslip finish as approved.
 2. Broomed finish: Hand wood float maintaining the surface tolerance and then broom with a stiff bristle broom in the direction of drainage to provide a nonslip finish as approved.
 3. Steel trowel finish: Hand steel trowel to a perfectly smooth, hard even finish free from high or low spots or other defects as approved.
- D. Floors, stair treads and platforms shall be given a floor hardener. Application shall be according to manufacturer's instructions.

3.03 APPROVAL OF FINISHES

- A. All concrete surfaces will be inspected during the finishing process by the County.
- B. Surfaces which, in the opinion of the County, are unsatisfactory shall be refinished or reworked until approved by the County.

END OF SECTION

SECTION 03410 PRECAST CONCRETE STRUCTURES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all materials, labor and equipment and construct valve vaults, meter vaults, concrete pipe and accessory items, consisting of precast sections as shown on the Drawings and as specified herein.
- B. The forms, dimensions, concrete and construction methods shall be approved by the County in advance of construction.
- C. These Specifications are intended to give a general description of what is required, but do not purport to cover all of the structural design details which will vary in accordance with the requirements of the plans. It is, however, intended to cover the furnishing, shop testing, delivery and complete installation of all precast structures whether specifically mentioned in these Specifications or not.
- D. The supplier of the precast items shall coordinate his work with that of the Contractor to insure that the units will be delivered and installed in the excavation provided by the Contractor, in accordance with the Contractor's construction schedule.
- E. The Contractor will ensure coordination of the precast structures fabrication with the supplier to achieve the proper structural top slab openings, spacings and related dimensions for the selected equipment frames and covers. The top slabs, frames, covers, and subsurface structures outside of roadways shall be capable of live load of 300 pounds per square foot unless noted otherwise.
- F. All interior surfaces of valve vaults and meter vaults shall be painted with two coats of coal tar epoxy paint dry film thickness of minimum 8-mils each coat per Section 09900.

1.02 SUBMITTALS

- A. Submit to the County in accordance with the Contract Documents, shop drawings showing details of construction, reinforcing, and joints.
- B. Shop Drawings
 - 1. Content
 - a. Dimensions and finishes.
 - b. Estimated camber.
 - c. Reinforcing and connection details.
 - d. Lifting and erection inserts.
 - e. Other items cast into members.
 - 2. Show location of unit by same identification mark placed on member.
 - 3. Include design calculations.
- C. Manufacturer's Literature: Manufacturer's recommended installation instructions.
- D. Manufacturer's certificates of material conformance with Specifications.
- E. Test Reports: Reports of tests on concrete. A minimum of three compression test cylinders

will be required for each pour.

1.03 INSPECTION

- A. The quality of all materials, the process of manufacture and the finished sections shall be subject to inspection and approval by the County, or other representatives of the County. Such inspection may be made at the place of manufacture, or at the site after delivery, or at both places and the sections shall be subject to rejection at any time due to failure to meet any of the Specification requirements; even though sample sections may have been accepted as satisfactory at the place of manufacture. Sections rejected after delivery to the project site shall be marked for identification and shall be removed from the project site at once. All sections, which have been damaged after delivery will be rejected and if already installed, shall be acceptably repaired, if permitted, or removed and replaced entirely at the Contractor's expense.
- B. At the time of inspection, the sections will be carefully examined for compliance with the applicable ASTM designation and these Specifications and with the approved manufacturer's drawings.
1. All sections shall be inspected for general appearance, dimension, "scratch-strength", blisters, cracks, roughness, soundness, etc. The surface shall be dense and close-textured.
 2. All sections shall meet the manufacturing tolerance requirements of ASTM C478 or the following casting tolerances, whichever are more severe:

Wall Thickness	$\pm 3/8"$
Inside Diameter	$\pm 3/8"$
Outside Diameter	$\pm 1/2"$
Height or Length	$\pm 3/8"$
- C. Imperfections may be repaired, subject to the approval of the County, after demonstration by the manufacturer that strong and permanent repairs result. Repairs shall be carefully inspected before final approval. Cement mortar used for repairs shall have a minimum compressive strength of 4,000 psi at the end of 7 days and 5,000 psi at the end of 28 days, when tested in 3-inch by 6-inch cylinders stored in the standard manner. Epoxy mortar may be utilized for repairs subject to the approval of the County.

PART 2 PRODUCTS

2.01 PRECAST CONCRETE SECTIONS

- A. Precast concrete manhole grade rings, flat slab tops, conical tops, risers and base sections shall be fabricated in accordance with the material and design standards of ASTM C478, except as modified herein.
- B. Portland cement shall conform to ASTM C150, Type II, and concrete shall have a minimum compressive 28-day strength of 4,000 psi.
- C. The manufacturer shall make a minimum of four standard test cylinders for each 100 cubic yards of concrete (or part thereof) that is cast each day. These test cylinders, along with sections cast that day, shall be marked in such a way that the test results can be matched with the appropriate castings. Two cylinders shall be cured with the product until the forms

are stripped. At this time, one cylinder shall be broken to ascertain that a minimum strength of 2,000 psi has been reached prior to moving the product from the forming location. The remaining two cylinders shall be cured and tested in accordance with ASTM C192 and C39. The average compressive strength for each day's production shall be greater than 4,000 psi with no more than 10% of the tested cylinders falling below 4,000 psi. In no case shall any cylinder strength fall below 3,500 psi. All cylinder strengths shall be certified by a Florida Licensed Professional Engineer. Failure to meet these requirements for any day's production is cause for rejection of all sections cast that day.

- D. Minimum wall thickness for manholes shall be 8 inches or 1/12 the inside diameter of the manhole, whichever is greater. The minimum thickness for the bottom of the base section shall be 8 inches.
- E. Reinforcing steel shall be as specified in ASTM C478.
- F. Precast manhole structures shall be free of cracks, holes, voids, blisters or rough surfaces. Manholes shall be water-tight, and shall be generally sound and free of defects of any sort. Lift holes shall not penetrate through the wall of any manhole tops, risers or base sections. Holes passing part-way through the manhole section walls for lifting devices shall be filled with cement or epoxy grout after the manhole has been set in place.
- G. Pipe openings shall meet the recommended tolerances of the individual manufactured pipe to manhole connectors; however, the horizontal location shall be within +/- 2 degrees of arc of that detailed on the shop drawings.

2.02 MANHOLE INVERTS

- A. Benched inverts shall be provided and shall be monolithically cast or shall be a secondary casting in a cured base section as per ASTM C478.
- B. The width of the invert channel shall be the same as the inside diameter of the connected sewer pipes and shall have a "U" - shaped cross-section with the bottom of the channel shaped to correspond with the lower half of the pipe. The depth of the channel shall be a minimum of half the inside diameter of the connected pipes.
- C. The channel shall be formed smooth and streamlined, and, where the flow changes directions, shall have true curves of the largest radius possible within the manhole base. The maximum change of direction of flow within a manhole shall be 90 degrees.
- D. The channel invert slope shall be uniform through the manhole and shall have a minimum vertical drop of 1 inch from the inlet(s) to the outlet.
- E. For all manholes with pipes 16 inches in diameter and larger, the base section and invert channels shall have a pre-molded plastic liner as described in subsection 1.12.6, "Concrete Manholes and Wetwells with Protective Liners."

2.03 RESILIENT PIPE CONNECTORS

- A. Provide cast-in resilient connectors conforming to requirements of ASTM C923 installed at the factory. All connectors are to be water tight. Install resilient connectors at each pipe entering and exiting the structure in accordance with manufacturer's instructions. The external take down clamp and its hardware shall be 316 stainless steel. Cold joint pipe stub grouting shall not be allowed. Cast-in resilient connectors shall be furnished per the latest

edition of the County's Approved Products List.

- B. All pipe penetrations shall be made in the factory unless otherwise specified in the plans.
- C. If the Contractor is required to connect a new line to an existing manhole, jack-in resilient connectors conforming to requirements of ASTM C923. All connectors are to be watertight. Install resilient connectors at each pipe entering and exiting the structure in accordance with manufacturer's instructions. The internal expansion band and hardware shall be minimum 304 stainless steel. The external take down clamp and its hardware shall be 316 stainless steel. Jack-in resilient connectors shall be furnished per the latest edition of the County's Approved Products List.
- D. Connectors shall be installed in strict accordance with the written installation instructions of the manufacturer. Non-shrink grout shall be placed in the gap between the boot or seal and the manhole invert channel, to make a smooth transition, unless otherwise directed by the manufacturer's instructions.

2.04 MANHOLE AND WETWELL JOINTS

- A. Joints between manhole and wetwell sections shall be tongue and groove smooth wall, or bell and spigot, with a continuous elastomeric ring gasket (O-ring) joint conforming to the requirements of ASTM C443. In addition to the ring gasket, additional sealing device shall be provided as follows:

For Tongue and Groove Smooth Wall Manholes:

- (1) A minimum of twelve-inches wide of elastomeric based plastic joint wrap shall be centered over the joints, on the outside of the manhole, including the chimney to manhole frame
- (2) A minimum of ½-inch x ¾-inch bead of hydrophilic urethane paste applied to the interior of the joint just before manhole section assembly.

For Bell and Spigot Manholes:

- (1) A minimum of eighteen (18) inches wide of heat shrinkable joint wrap shall be centered over the joints, on the outside of the manhole, including the chimney to manhole frame
- (2) A minimum 3-inch wide x ½-inch thick bead of sealant strips shall be applied to the interior of the joint just before manhole section assembly

- B. For standard manholes without liners, fill the joint at the inside face with non-shrink grout and strike the joint smooth and uniform with the manhole interior walls.
- D. For manholes with and without plastic liners and with concrete grade-adjustment rings, joints between the top section and the grade adjustment ring, and between grade rings, and between the grade adjustment ring and the frame shall be made with non-shrink cement mortar.
- E. Refer to the latest edition of the County's Approved Products List for acceptable manufacturers.

2.05 PROTECTIVE INSERT LINERS

- A. All manholes that are immediately upstream of a lift station wetwell as defined in Manatee County Utility Standards, force main termination manholes and the two downstream manholes in the flow direction, manholes with turbulent opposing flows as defined in the Manatee County Utility Standards, manholes with 12-inch diameter pipes or larger , drop manholes, and all lift station wetwells shall be manufactured from polymer concrete. However, under the written approval of the County, a structure at the locations referenced above, shall be installed with a protective insert liner in lieu of polymer concrete. The liners shall be integrally cast into the concrete tops, risers and base sections, which shall be in all other respects manufactured in accordance with ASTM C478 using Type II Portland Cement per ASTM C150. The plastic liner shall be generally chemically resistant to the wastewater environment and shall be mechanically affixed to the precast concrete manhole sections so that there can be no separation of the liner from the manhole sections during the service lifetime.
- B. The plastic liner shall have no surface degradation when exposed to nitric acid, hydrochloric acid, ammonia, sodium hydroxide, sulfuric acid, acetone, unleaded gasoline and turpentine in accordance with test method ASTM D1308, and shall not be attacked when immersed in acetone according to test method ASTM D2152.
- C. The base liner for manholes shall have preformed flow channels with water-tight gasketed pipe bell connections or boot holes that extend to the outside profile of the precast concrete structure.
- D. The wall thickness for manholes and wetwells with liners, including the liner thickness, shall be 8 inches minimum or 1/12 of the inside diameter, whichever is greater. The minimum thickness of the bottom of the base section shall be 8 inches under the bottom of the flow channel.
- E. Manhole frames shall be adjusted to grade with concrete grade rings same as for un-lined manholes. Lined manholes shall be equipped with a convertible collar. The collar shall form a water-tight seal to the manhole top with a lip seal rubber gasket. The collar shall be sealed water-tight against the base of the cast iron frame using a butyl rubber sealant.
- F. Refer to the latest edition of the County's Approved Products List for acceptable manufacturers.

2.06 MANHOLE FRAMES AND COVERS

- A. Frame and cover castings shall be dense and even grained, and shall be free of blowholes, warping, or any other defects not true to pattern. Seating surfaces of covers and frames shall be machined true to prevent rocking.
- B. Castings shall be designed and tested to bear an AASHTO H-20 wheel loading with and added 30 percent impact factor and shall be Class Heavy Duty traffic bearing.
- C. Castings shall have the words "MANATEE COUNTY", "SANITARY SEWER", and "(YEAR)" cast into them.
- D. Refer to the latest edition of the County's Approved Products List for acceptable manufacturers.

Standard Frame and Cover:

- E. Standard frame and covers shall be gray iron castings, conforming to ASTM A48, Class 30B.

Frame and Cover where Rim Elevation is Below Floodplain Requirements:

- F. Manhole rims and clean-out tops shall be elevated 4 inches above the 100-year flood level, or 8 inches above the 25-year flood level, or 4 inches above the surrounding unpaved ground surface within a 20-foot radius, whichever is highest. Manholes with rims less than the above required elevations shall have watertight, tamper proof gasketed covers with minimum three (3) 316 stainless steel locking bolts.

Frame and Cover for ARV Manholes:

- G. Manholes used to enclose air release valves with less than 44" from top of the pipe to the cover shall use a hinged cover. In Roadways, the lid shall open in the direction opposite of incoming traffic so that in the case that a vehicle travels over the lid, the lid is shut closed.

Frame and Cover for High Corrosion-Prone Manhole:

- H. All manholes that are directly upstream of a lift station wetwell as defined in the Manatee County Utility Standards, force main termination manholes and the two downstream manholes in the flow direction, manholes with turbulent opposing flows as defined in the Manatee County Utility Standards, manholes with 12-inch diameter pipe or larger, drop manholes, and all lift station wetwells shall use a heavy duty composite ring and cover.
- I. Shall have minimum three (3) 316 stainless steel locking bolts.
- J. When Work consists of rehabilitating a manhole with an existing liner, the Contractor shall replace the frame and cover, if ferrous, with a composite frame and cover. Concrete grade adjustment rings shall be replaced with polymer concrete grade adjustment rings as well.

2.07 MANHOLE INSERTS

- A. Manholes supplied with watertight inserts with neoprene gaskets shall be installed under the insert lip to insure a leak proof seal. Inserts shall be minimum 18 gauge 304 stainless steel.
- B. Refer to the latest edition of the County's Approved Products List for acceptable manufacturers.

2.08 PRECAST CONCRETE MANHOLE INSTALLATION

- A. Manholes shall be installed at the end of each line; at all change in grade, size, or alignment; at all intersections; and at distances not greater than 400 feet for sewers 15 inches or less and 500 feet for sewers 18 inches or larger. Cleanouts may be used only for special conditions with approval by the County and shall not be substituted for manholes.
- B. Drop manholes shall be provided for sewers entering a manhole at an elevation 24 inches or more above the manhole lowest invert. Where the drop is less than 24 inches, the invert shall have an elevated U-channel to prevent solids deposition. Drop manholes shall be

constructed with an outside drop connection and the entire outside drop connection shall be encased in concrete.

- C. Precast concrete sections shall be set vertical and in true alignment as indicated by the construction plans. Excavation, bedding foundation and backfill shall be done in accordance with the Trenching and Excavation section of these Standards. All manholes shall meet the following installation tolerances:
 - 1. The finished manholes shall not be out of plumb by more than 3/8 inch per 10 feet of height.
 - 2. Any jog or offset of the inside wall surface at a joint shall not exceed 1/2 inch.
 - 3. Variation in the joint width around the circumference of the manhole shall not exceed 1/4 inch.

2.09 SETTING MANHOLE FRAME AND COVERS

- A. Manhole rings and covers shall be set to conform accurately to the finished ground or pavement grade as indicated on the construction drawings or as directed by the County. Rings on manholes shall be set concentric with the adjusting rings and sealed so that the space between the top of the adjustment rings and the bottom flanges of the rings will be made watertight. A ring of butyl rubber sealant strip shall be placed around the outside of the bottom flange at least 3-inch wide and 1/2-inch thick. Mortar shall be extended to the outer edge of the masonry and finished smooth and flush with the top of the flange.

2.10 SPRAY-APPLIED MANHOLE LINERS

- A. Existing concrete or brick and mortar structures that are to be modified or rehabilitated by adding a manhole liner shall have a spray-applied liner installed according to the material and procedural requirements of the "Modifications to Existing Structures, Piping and Equipment," Section 1.2 of the Manatee County Public Works Standards. All recommendations of the product's manufacturer shall be followed.
- B. Refer to the latest edition of the County's Approved Products List for acceptable manufacturers.

2.11 PROTECTION FROM FLOODWATER INFLOW

- A. Wastewater sewer systems shall be designed to prevent flood or surface waters from entering the collection system. Manhole rims and clean-out tops shall be elevated 4 inches above the 100-year flood level, or 8 inches above the 25-year flood level, or 4 inches above the surrounding unpaved ground surface within a 20-foot radius, whichever is highest, or the manhole covers and clean-out lids shall be designed and installed with factory-made watertight, tamper proof, sealing devices.
- B. Cleanouts not at or above the required elevations shall have the clean-out adapter solvent welded watertight to the clean-out riser. Plugs are to be recessed square key with Teflon plumber's tape wrapped on threads to make a watertight seal.

PART 3 EXECUTION

3.01 INSTALLATION

- A. The Contractor shall be responsible for handling groundwater to provide firm, dry subgrade

for the structure, shall prevent water rising on new poured-in-place concrete or grouted joint sections within 24 hours after placing and shall guard against flotation or other damage resulting from ground water or flooding.

- B. A minimum of an 8-inch shell base compacted layer of washed shell or crushed stone shall be placed as a foundation for the structure's base slabs and valve and/or meter vault pits.
- C. Backfill materials around the structures and above the pipe bedding shall be select material as specified in the Contract Documents.
- D. Precast bases, conforming to all requirements of ASTM C478 and above listed requirements for precast sections, may be used.
- E. The structure shall not be set into the excavation until the installation procedure and excavation have been approved by the County.
- F. The base may be cast-in-place concrete placed on a thoroughly compacted crushed rock subbase, (98 percent of the maximum density as determined by AASHTO T-180.) The tops of the cast-in-place bases shall be shaped to mate with the precast barrel section and shall be adjusted in grade so that the top slab section is at the approximately correct elevation.
- G. Precast concrete structure sections shall be set so as to be vertical and with sections in true alignment with a 1/4-inch maximum tolerance to be allowed. The joints shall be prepared as in 2.04 above and finished flush with the adjoining surfaces. Allow joints to set for 24 hours before backfilling. Backfilling shall be done in a careful manner, bringing the fill up evenly on all sides. The Contractor shall install the precast sections in a manner that will result in a watertight joint. Leaking joints are not acceptable.
- H. Holes in the concrete sections required for handling or other purposes shall be plugged with a non-shrink grout or by grout in combination with concrete plugs.
- I. Where holes must be cut in the precast sections to accommodate pipes, cutting shall be done prior to setting them in place to prevent any subsequent jarring which may loosen the mortar joints.
- J. Frames and hatches specified and furnished shall be cast in the cover slab prior to setting. Normal installation shall include 6" to 12" of concrete grade rings between the top of the cone section and the cover plate ring slab.
- K. Penetrations and connections into precast or existing structures shall be accomplished by rotary core boring.
- L. Cast in place liners shall be repaired, fitted around penetrations, sealed at joints, etc. in accordance with the manufacturer's recommendations for that liner. As a general rule, repairs, sleeves and patches shall be welded in place, glues and sealants shall not be used unless approved by the manufacturer.

3.04 TESTING

- A. After constructed to its finished height and before being backfilled, each manhole must be visually inspected and shall meet the satisfaction of the County.
- B. If the visual inspection reveals defects, poor workmanship, or suspect installation, it shall

be at the sole discretion of the County to have the structure vacuum tested for water tightness.

1. Plug pipelines and perform vacuum test. Observing all recommended safety measures induce a backpressure of 5.0 psi equivalent to 10" Hg (mercury). The structure assembly is considered satisfactory if the vacuum loss is less than 1" Hg for the length of time listed in the following table:

Time of Test in Seconds			
Depth Feet	Structure Diameter in Feet		
	4	5	6 or Larger
4	10	13	16
8	20	26	32
12	30	39	48
16	40	52	64
20	50	65	80
24	60	78	96
T	5	6.5	8

Note: Add "T" seconds for each additional 2'- of depth.

- C. Failure to pass this test requires the Contractor to correct the problems and retest. The Contractor will replace leaking gaskets and/or concrete sections and retest the completed structure. No structure will be accepted without successfully passing this test.

END OF SECTION

SECTION 09865 SURFACE PREPARATION AND SHOP PRIME PAINTING

PART 1 GENERAL

1. This Section includes shop-applying a special coating product to items and surfaces scheduled, including surface preparation & cleanliness, environmental conditions during application, product preparation, and application method.
2. Documents affecting work of this Section include, but are not limited to, General Conditions, Supplementary Conditions, Sections in Division 1 of these Specifications, and including the following Divisions:
 - a. Division 5 - Metals
 - b. Division 7 - Thermal & Moisture Protection
 - c. Division 9 - Painting
3. REFERENCES
 - A. American Society for Testing and Materials (ASTM):
 1. ASTM B 117 Standard Test Method for Corrosion Resistance.
 2. ASTM D 2794 Standard Test Method for Measuring Direct Impact.
 3. ASTM D 3359 Standard Test Methods for Measuring Adhesion by Tape Test.
 4. ASTM D 3363 Standard Test Method for Film Hardness by Pencil Test.
 5. ASTM D 4060 Standard Test Method for Abrasion Resistance.
 6. ASTM D 4541 Standard Test Method for Pull-off Strength of Coatings Using Portable Adhesion Testers.
 7. ASTM E 119 (UL 263) Standard Test Method for Fire Tests of Building and Construction Materials.
 8. ASTM E 736 Standard Test Method for Cohesion/Adhesion of Sprayed Fire-Resistive Materials Applied to Structural Members.
 - B. Society of Protective Coatings (SSPC):
 1. SSPC Surface Preparation Specifications (SSPC-SP)
 2. SSPC Paint Application Specifications and Guides (SSPC-PA)
 - C. American Institute of Steel Construction
 1. Slip Coefficient and Tension Creep
 - D. NACE International
4. DEFINITIONS
 - A. Definitions as used in Finish Schedule shown on Drawings and Coating Schedule included herein.
 1. Coatings: Paint or heavy duty finishes for use on surfaces subject to interior and exterior exposure, submergence, high moisture, splash, or chemical environment, including primers, sealers, fillers, and intermediate and finish coats.
 2. Normal: Surfaces subject to normal temperature and humidity.
 3. First Coat: Factory primer or shop primer.
 4. DFT: Dry Film Thickness (Mils/coat).
 5. SqFt: Square feet per gallon (per coat).
 6. OWNER'S REPRESENTATIVE: Person, company, or architectural/engineering firm authorized by the property owner to make decisions regarding coating selection.
5. Submittals
 - A. Product Data:

1. Manufacturer's literature including application recommendations and generic makeup for each coating scheduled.
 2. List each material and cross-reference the specific coating, finish system, and application.
- B. Submit one copy of manufacturer's Material Safety Data Sheets (MSDS) for each type of coating to OWNER'S REPRESENTATIVE'S field office for information. CONTRACTOR shall post a copy of MSDS on the site at all times when coating is in progress.

6. QUALITY ASSURANCE

A. Regulatory Requirements:

1. All coatings shall conform to OSHA requirements for allowable exposure to lead and other hazardous substances.

B. Product Manufacturer:

1. Manufacturer shall be a company that specializes in producing high quality industrial coating materials. This company shall have 10 years or more experience demonstrated by case histories in the designated field of application.

C. Applicator Qualifications:

1. Engage an experienced applicator with 5 years or more experience who has successfully completed coating system applications similar in material and extent to those indicated.

D. Single-Source Responsibility:

1. Provide coating material produced by the same manufacturer for each system.

E. Performance Testing:

1. The OWNER'S REPRESENTATIVE may request testing from the manufacturer for required performance that may include but is not limited to adhesion to the substrate and between coating layers, and resistance to abrasion, humidity, freeze/thaw, and Ultra-violet light exposure.

7. DELIVERY, STORAGE, AND HANDLING

- A. Materials shall be delivered to the site in original containers with labels intact and seals unbroken.
- B. Protect and heat or cool material storage location to maintain temperature ranges recommended by coating manufacturers, but not less than 50 degrees F.
- C. Oily rags and waste must be removed from buildings each night or kept in appropriate metal containers. Provide fire extinguishers of the type recommended by coating manufacturers in areas of storage and where finishing is occurring. Allow no smoking or open containers of solvent.
- D. Empty containers shall have labels canceled and clearly marked as to use.

8. PROJECT / SITE CONDITIONS

A. Environmental Requirements:

1. Use indirect-fired dry heat and ventilate areas to obtain conditions recommended by coating manufacturer.
2. Relative humidity conditions as specified by coating manufacturer shall be adhered to.
3. No unprotected, unheated exterior coating shall be undertaken when cold, damp, foggy, or rainy weather appears probable, nor when the temperature of the substrate is below 35 degrees F, unless listed in this specification or approved in writing by the coating manufacturer.
4. Maintain the manufacturer's environmental requirements until the coating is fully cured.
5. Apply no coating in areas where dust is being generated.
6. Testing and disposal of any waste and coating shall be the responsibility of the CONTRACTOR.

PART 2 PRODUCTS

1. MANUFACTURERS

- A. Tnemec Company, Inc., or OWNER'S REPRESENTATIVE approved equal.

2. SHOP APPLIED PRIMERS FOR METAL

- A. Factory-applied coating products of Tnemec Company, Inc. are listed as the standard of quality and performance, and it is not the intent of the Specifier that these materials are to be used to the exclusion of equivalent products of other manufacturers.
- B. Only coatings that meet or exceed the performance of these specified coatings may be submitted for use. No substitutions will be considered that change the generic chemistry of the coatings specified.
- C. No substitution will be considered unless the Architect/Owner has received a written request for approval at least 10 days prior to the bid date for receipt of bids.
- D. Each request shall include the name of the specified material for which a substitute is being requested; name of the proposed substitute material; and a complete description of the proposed substitute including performance & test data, cure times, recoat windows, and generic composition.
- E. No request for substitution will be considered that would decrease film thickness or offer a change in the generic type of coating specified.
- F. The decision of the OWNER'S REPRESENTATIVE regarding approval or disapproval of the proposed substitution shall be final.

3. MIXING AND THINNING

- A. Where thinning is necessary, only the products of the manufacturer furnishing the coating will be allowed. All such thinning shall be done in strict accordance with the coating manufacturer's recommendations
- B. Mix in accordance to the manufacturer's recommendations

4. SOURCE QUALITY

- A. Source Quality: Obtain painting, coating, and thinning materials from a single manufacturer.

PART 3 EXECUTION

1. MANUFACTURER'S INSTRUCTIONS

- A. Compliance: Comply with manufacturer's product data, including technical information, catalogue instructions, and product instructions listed on material containers.

2. EXAMINATION

- A. Examine the areas and conditions under which work of this section will be performed. Correct conditions detrimental to the timely and proper completion of the work. Materials removed and replaced to correct defects due to errant application such as overspray or drips on unsuitable surfaces shall be at the CONTRACTOR'S expense.

3. SURFACE PREPARATION

A. General:

1. All surfaces to be coated shall be prepared as specified herein and in accordance with the coating manufacturer's recommendations. The object shall be to obtain a uniform, clean, and dry surface.
2. Quality of surface preparation described herein is considered a minimum. If the coating manufacturer requires a higher degree of preparation, comply with the coating manufacturer's recommendations.
3. Workmanship for surface preparation shall conform to the following Society of Protective Coatings (SSPC) / NACE specification:
 - a. Solvent Cleaning: SSPC-SP1
 - b. Hand Tool Cleaning: SSPC-SP2
 - c. Power Tool Cleaning: SSPC-SP3
 - d. White Metal Blast Cleaning: SSPC-SP5/NACE No. 1
 - e. Commercial Blast Cleaning: SSPC-SP6 / NACE No. 3
 - f. Brush-Off Blast Cleaning: SSPC-SP7 / NACE No. 4
 - g. Near-White Blast Cleaning: SSPC-SP10 / NACE No. 2
 - h. Power Tool to Bare Metal Cleaning: SSPC-SP11
 - i. High Pressure Water Jetting: SSPC-SP12 / NACE No. 5

4. FERROUS METAL

- A. Ferrous Metal unprimed or shop-primed with an incompatible primer shall be abrasive blast cleaned prior to the application of a primer. Enclosed structural metals or those scheduled for overcoating with fire-resistive materials shall be prepared in accordance with SSPC-SP3. Exposed exterior elements shall be prepared in accordance with SSPC-SP6. Slip critical connections shall be prepared in accordance with SSPC-SP3 or SP5.

5. APPLICATION

- A. Surfaces shall be dry at the time of application.
- B. The minimum surface temperature shall be 35 degrees F and rising unless noted otherwise.
- C. Apply in strict accordance to the manufacturer's recommendations by airless spray application.
- D. Each coat shall be allowed to dry in accordance to the manufacturer's requirements. Drying time shall be construed to mean "under normal conditions." Where conditions other than normal exist, because of weather or because of confined space, longer times will be necessary.
- E. Coatings shall be applied to provide an opaque smooth surface of uniform coverage. Cloudiness, spotting, holidays, laps, brush marks, runs, sags, or other surface imperfections will not be acceptable.
- F. Edges of coatings adjoining other materials or other colors shall be sharp and clean without overlapping.
- G. Crevices and other hard to apply areas shall be brushed in prior to the complete application.

6. FINAL TOUCH-UP AND CLEANING

- A. Prior to substantial completion, examine the coated surfaces and retouch or refinish surfaces to leave in condition acceptable to the OWNER'S REPRESENTATIVE

7. SHOP APPLIED COATING SCHEDULE

- A. All shop-applied coatings shall be in accordance with Section 09900, the High Performance Coatings section of this specification. This requirement supersedes all other options listed below.
- B. Perimeter Structural Steel, steel where extended field exposure is expected, steel intended for immersion service, slip-critical connections, wet conditions, moderate to severe exposures, all other circumstances, which may also include interior, dry, mild environments.
 - 1. Common Use: For use on unprimed structural and miscellaneous steel.
 - 2. Shop primer may be enclosed, covered with approved/tested spray-applied fireproofing, or finish painted.
 - 3. Surface Preparation:
 - a. SSPC-SP3 - Enclosed areas or members to be fireproofed
 - b. SSPC-SP6 - Exterior exposures, Moderate Exposures, or Slip Critical Connections
 - c. SSPC-SP10 - Immersion & Severe Exposures
 - 4. Moisture-Cured Urethane Primer
 - a. Shop Primer: Tnemec Series 394 PerimePrime @ 2.5 - 3.5 mils DFT.
 - b. Specifier Note Series 394 PerimePrime is UL Classified in accordance with UL 263 (ASTM E 119) for use under W.R. Grace Monokote MK-6/HY and Isolatek's (Cafco) Blaze-Shield II (Type II)

fire-resistive materials. PerimePrime is tested in accordance with ASTM E 736 and found compatible with a variety of widely used fire-resistive materials. Contact your Tnemec Representative for ASTM E 736 compatibility results.

Performance Requirements:

1. ASTM B 117: Primer Shall Pass 10,000 Hours Salt Fog Corrosion Resistance.
2. ASTM E 736: Primer Shall Pass Bond Test Requirements.
3. ASTM D 3359: Primer and complete coating system shall have a Rating not less than 5.
4. ASTM 2794: No Visible Cracking or Delamination of Film after 160 Inch-Pounds Or Less Direct And Indirect Impact.
5. ASTM D 4585: No Blistering, Cracking, Rusting or Delamination of Film after 5,000 Hours Exposure.
6. UL 263 (ASTM E 119): Primer Shall Be UL Classified for use Under Selected Fire-Resistive Materials.
7. AISC Static Fatigue: Primer Shall Meet Requirements Of A Class B Surface With A Mean Slip Coefficient No Less Than 0.56 And A Tension Creep Not In Excess Of .005 Inch Over SSPC-SP3 Or SP5 Prepared Substrate.

C. Steel intended for interior, dry, mild exposures only.

1. Common Use: For use on unprimed structural and miscellaneous steel.
2. Surface Preparation
 - a. SSPC-SP2 or SSPC-SP3
 - b. SSPC-SP6 - When extended field exposure is expected
3. Modified Alkyd Primer
 - a. Shop Primer: Tnemec Seies V10 Tnemec Primer @ 2.0 - 3.5 mils DFT.
 - b. Performance Requirements:
 - 1) ASTM D 4060: No more than 90.0 mg loss after 500 cycles with 500 gram load, average of three tests.
 - 2) ASTM D 4541 (On SSPC-SP1 solvent cleaned steel): No less than 825 psi (5.69 MPa) adhesion after ten freeze/thaw cycles, average of three trials.
 - 3) ASTM D 5894 (On SSPC-SP1 solvent cleaned steel): No blistering, cracking, rusting or delamination of the film and no rust creepage at the scribe after 1,008 hours (three cycles).
 - 4) Exterior Exposure (Mild industrial area, On SSPC-SP1 solvent cleaned steel): No blistering, cracking, rusting or delamination of the film after 12 months exposure.

END OF SECTION

SECTION 09900 PAINTING

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, tools, materials, equipment, scaffolding or other structures and incidentals necessary to complete this Contract in its entirety.
- B. The work includes painting and finishing of all new interior and exterior exposed items above and below grade and surfaces, such as structural steel, miscellaneous metals, ceilings, walls, floors, doors, frames, transoms, roof fans, construction signs, guardrails, posts, pipes, fittings, valves, tanks, equipment and all other work obviously required to be painted unless otherwise specified herein or on the Drawings. The omission of minor items in the Schedule of Work shall not relieve the Contractor of his obligation to include such items where they come within the general intent of the Specification as stated herein.
- C. The following items shall not be painted:
 - 1. Any code-requiring labels, such as Underwriter's Laboratories and Factory Mutual, or any equipment identification, performance rating, name or nomenclature plates.
 - 2. Any moving parts of operating units, mechanical and electrical parts, such as valve and damper operators, linkages, sinkages, sensing devices, motor and fan shafts, unless otherwise indicated.
 - 3. Aluminum handrails (except where in contact with concrete) walkways, windows, louvers and grating unless otherwise specified herein.
 - 4. Signs and nameplates.
 - 5. Finish hardware.
 - 6. Chain link fence.
 - 7. Piping buried in the ground or embedded in concrete.
 - 8. Concealed surfaces of pipe or crawl space.
 - 9. Nonferrous metals, unless specifically noted otherwise.
 - 10. Electrical switchgear and motor control centers.
 - 11. Stainless steel angles, tubes, pipe, etc.
 - 12. Products with polished chrome, aluminum, nickel or stainless steel finish.
 - 13. Plastic switch plates and receptacle plates.
 - 14. Flexible couplings, lubricated bearing surfaces, insulation and metal and plastic pipe interior.
 - 15. Sprinkler heads.
 - 16. Lifting chain on cranes and hoists
 - 17. Electrical cable, festooned conductor system, cables, collector pole brackets, etc.
- D. All work shall be done in strict accordance with this Specification, the Design Drawings and the painting package, including manufacturer's printed instructions.
- E. The Contractor will obtain, at its own expense, all permits, licenses and inspections and shall comply with all laws, codes, ordinances, rules and regulations promulgated by authorities having jurisdiction which may bear on the Work. This compliance will include Federal Public Law 91-596 more commonly known as the "Occupational Safety and Health Act of 1970".

1.02 DEFINITIONS

- A. Field Painting is the painting of new or rebuilt items at the job site. Field painting shall be the responsibility of the Contractor.
- B. Shop Painting is the painting of new or rebuilt items in the shop prior to delivery to the jobsite.
- C. Abbreviations: The abbreviations and definitions listed below, when used in this specification, shall have the following meanings:
 - 1. Owner - The term owner is used to refer to either the owner or an appointed owner's representative such as an engineer, architect, etc.
 - 2. SSPC - The Society for Protective Coatings
 - 3. Exterior - Outside, exposed to weather
 - 4. Interior Dry - Inside, concealed or protected from weather
 - 5. Interior Wet - Inside, subject to immersion services
 - 6. ASTM - American Society of Test Materials
 - 7. NACE - National Association of Corrosion Engineers
 - 8. NSF - National Sanitation Foundation
 - 9. AWWA - American Water Works Association
 - 10. ICRI - International Concrete Restoration Institute
 - 11. NAPF - National Association of Pipe Fitters
 - 12. Dry Film Thickness shall be in Mils

1.03 RESOLUTION OF CONFLICTS

- A. It shall be the responsibility of the Contractor to arrange a meeting prior to the start of any coatings applications between the Contractor, the Coating Manufacturer, whose products are to be used, and the Owner. All aspects of surface preparation, application and coating systems as covered by this Specification will be reviewed at this meeting.
- B. Clarification shall be requested promptly from the Owner when instructions are lacking, conflicts occur in the Specifications, or the procedure seems improper or inappropriate for any reason.
- C. Copies of all manufacturer's instructions and recommendations shall be furnished to the Owner by the Painting Contractor.
- D. It shall be the responsibility of the Coating Manufacturer to have their representative meet in person with the Contractor and Owner before and during the job as a consultant on proper preparation and application of the coating materials unless a meeting is determined to be unnecessary by the Owner.

1.04 SUBMITTALS

- A. Contractor shall submit catalog data and cut sheets for the painting system being used.
- B. Samples as detailed in 3.01 B shall be submitted regardless of system being used, showing each color to be used.
- C. Hazardous Material Disposal documentation shall be submitted if applicable.

PART 2 PRODUCTS

2.01 EQUIPMENT

- A. Effective oil and water separators shall be used in all compressed air lines serving spray painting and sandblasting operations to remove oil or moisture from the air before it is used. Separators shall be placed as far as practicable from the compressor.
- B. All equipment for application of the paint and the completion of the work shall be furnished by the Contractor in first-class condition and shall comply with recommendations of the paint manufacturer.
- C. Contractor will make available to the County a "Nordson-Mikrotest" or "Positest" dry film thickness gauge for ferrous metal and an OG232 "Tooke" gauge or equal for non-ferrous and cementitious surface, to be used to inspect coatings by the County and Contractor. The gauges may be used by the Contractor and returned each day to the County. County will return gauges to Contractor at completion of job.

2.02 MATERIALS

- A. All materials specified herein are specified to establish standards of quality and are approved for use on this Project. These materials shall be used unless otherwise stated in the Contract documents.
- B. Equivalent materials of other manufacturers may be substituted on approval of the County. Requests for substitution must include a side-by-side comparison of equality, including: manufacturer's literature for each product giving the name, generic type, volume solids, descriptive information, evidence of satisfactory past performance, and an independent laboratory certification that their product meets the performance criteria of the specified materials.
- C. To allow time for review, all requests for substitution shall be submitted by the coating manufacturer a minimum of 21 days prior to the scheduled work.
- D. Substitutions which decrease the total film thickness, change the generic type of coating, or fail to meet the performance criteria of the specified materials shall not be approved. Substitutions which otherwise reduce performance shall not be approved.
- E. All coatings to be shop applied must meet the requirements for volatile organic compounds (VOC) of not more than 3.5 lbs/gallon after thinning.
- F. Colors, where not specified, shall be as selected by the Owner or their Representative.
- G. All coatings in contact with potable water need to be NSF Certified, Tested, and Listed in

accordance with ANSI/NSF Standard 61.

- H. All above ground potable water mains and appurtenances shall be painted Safety Blue (Tnemec 11SF), above ground reclaimed water mains and appurtenances shall be painted purple (Pantone 522C), and above ground pressure sewer mains and appurtenances shall be painted green (Rustoleum 7538 Hunter Green).

2.03 REFERENCES

- A. This section contains references to the governing standards and documents listed below. They are a part of this section as specified and modified. In case of conflict between the requirements of this section and those of the listed documents, the more stringent of the requirements shall prevail
- B. Unless otherwise specified, references to documents shall mean the documents in effect at the time of receipt of Bids. If referenced documents have been discontinued by the issuing organization, references to those documents shall mean the replacement documents issued or otherwise identified by that organization or, if there are no replacement documents, the last version of the document before it was discontinued. Where document dates are given in the following listing, references to those documents shall mean the specific document version associated with that date, whether or not the document has been superseded by a version with a later date, discontinued, or replaced.
- C. Referenced publications found within this specification shall be the latest revision unless otherwise specified; and applicable parts of the referenced publications shall become a part of this specification as if fully included.
- D. ASTM International (ASTM):
 1. ASTM B117 - Salt Spray (Fog)
 2. ASTM C140 - Water Absorption (Applied to Cast Mortar Cubes)
 3. ASTM C307 - Tensile Strength, Elongation, Modulus of Elasticity
 4. ASTM C531 - Thermal Expansion
 5. ASTM C579 - Compressive Strength
 6. ASTM C580 - Flexural Strength and Modulus of Elasticity
 7. ASTM C67 - Water Absorption (Applied to Fire Clay Brick)
 8. ASTM C793 - Accelerated Weathering
 9. ASTM C97 - Water Absorption (Applied to Ohio Sandstone)
 10. ASTM D1014 - Exterior Exposure
 11. ASTM D2047 - Coefficient of Friction
 12. ASTM D2240 - Hardness
 13. ASTM D2247 - Humidity
 14. ASTM D2370 - Tensile Strength, Elongation, Modulus of Elasticity
 15. ASTM D2794 - Impact
 16. ASTM D3273 - Fungal/Mold/Mildew Resistance
 17. ASTM D4060 - Abrasion
 18. ASTM D4141, Method C (EMMAQUA) - Exterior Exposure
 19. ASTM D4541 - Adhesion
 20. ASTM D4585 - Humidity
 21. ASTM D4587 - QUV Exposure
 22. ASTM D522 - Flexibility and Elongation
 23. ASTM D5590 - Fungal/Mold/Mildew/Algal Resistance
 24. ASTM D5894 - Cyclic Salt Fog/UV Exposure

- 25. ASTM D624 - Tear Strength
- 26. ASTM D638 - Tensile Strength, Elongation, Modulus of Elasticity
- 27. ASTM D648 - Deflection Temperature
- 28. ASTM D6695 - Xenon Arc Weathering
- 29. ASTM D695 - Compressive Strength
- 30. ASTM D7234 - Adhesion
- 31. ASTM D790 - Flexural Strength and Modulus of Elasticity
- 32. ASTM D870 - Immersion
- 33. ASTM G85 - Prohesion

E. NACE International (NACE):

- 1. NACE TM-01-74

F. Federal Specification (FED):

- 1. FED TT-C-555B - Wind Driven Rain

G. Military and Government Specs & Standards:

- 1. MIL D3134 - Impact

H. British Standard:

- 1. BS EN 598: 2007+A1: 2009 - Rocking Abrasion

I. American Association of State Highway and Transportation Officials

- 1. AASHTO T-259 - Chloride Ion Penetration

PART 3 EXECUTION

3.01 INSPECTION OF SURFACES

- A. Before application of the prime coat and each succeeding coat, all surfaces to be coated shall be subject to inspection by the County. Any defects or deficiencies shall be corrected by the Contractor before application of any subsequent coating.
- B. Samples of surface preparation and of painting systems shall be furnished by the Contractor to be used as a standard throughout the job, unless omitted by the County.
- C. When any appreciable time has elapsed between coatings, previously coated areas shall be carefully inspected by the County, and where, in his opinion, surfaces are damaged or contaminated, they shall be cleaned and recoated at the Contractor's expense.
- D. The Contractor shall follow the Manufacturer's latest printed recommended minimum and maximum recoat times. If the maximum recoat time has been exceeded, the Contractor shall follow the Manufacturer's latest printed instructions.
- E. Coating thickness shall be determined by the use of a properly calibrated "Nordson-Mikrotest" or "Positest" Coating Thickness Gauge (or equal) for ferrous metal. Please note that a "Tooke" gauge may be used on cementitious surfaces, and that use of the "Tooke" gauge is classified as a destructive test.

- F. Before performing any destructive tests on a newly applied coating system, the Owner and Contractor shall determine which of them is responsible for the cost of repairing the damaged coatings.

3.02 STANDARDS FOR SURFACE PREPARATION

- A. SSPC-SP1: Solvent Cleaning: Remove all grease, oil, salt, acid, alkali, dirt, dust, wax, fat, foreign matter and contaminants, etc. by one of the following methods: steam cleaning, alkaline cleaning, or volatile solvent cleaning.
- B. SSPC-SP2: Hand Tool Cleaning: Removal of loose rust, loose mill scale and loose paint to a clean sound substrate by hand chipping, scraping, sanding and wire brushing.
- C. SSPC-SP3: Power Tool Cleaning: Removal of loose rust, loose mill scale and loose paint to a clean sound substrate by power tool chipping, descaling, sanding, wire brushing and grinding.
- D. SSPC-SP5/NACE No.1: White Metal Blast Cleaning: Complete removal of all mill scale, rust, rust scale, previous coating, etc., leaving the surface a uniform gray-white color.
- E. SSPC-SP6/NACE No.3: Commercial Blast Cleaning: Complete removal of all dirt, rust scale, mill scale, foreign matter and previous coating, etc., leaving only shadows and/or streaks caused by rust stain and mill scale oxides. At least 66% of each square inch of surface area is to be free of all visible residues, except slight discoloration.
- F. SSPC-SP7/NACE No.4: Brush-Off Blast Cleaning: Removal of rust scale, loose mill scale, loose rust and loose coatings, leaving tightly-bonded mill scale, rust and previous coatings. On concrete surfaces, brush-off blast cleaning shall remove all laitance, form oils and solid contaminants. Blasting should be performed sufficiently close to the surface so as to open up surface voids, bugholes, air pockets and other subsurface irregularities, but so as not to expose underlying aggregate.
- G. SSPC-SP10/NACE No.2: Near-White Blast Cleaning: Removal of all rust scale, mill scale, previous coating, etc., leaving only light stains from rust, mill scale and small specks of previous coating. At least 95% of each square inch of surface area is to be free of all visible residues and the remainder shall be limited to slight discoloration.
- H. SSPC-SP11: Power Tool Cleaning to Bare Metal: Complete removal of rust, rust scale, mill scale, foreign matter and previous coatings, etc., to a standard as specified on a Commercial Grade Blast Cleaning (SSPC-SP-6, NACE-3) by means of power tools that will provide the proper degree of cleaning and surface profile.
- I. SSPC-SP13/NACE No.6: Surface Preparation of Concrete: Provides requirements for surface preparation of concrete by mechanical, chemical, or thermal methods prior to the application of bonded protective coating or lining systems.
 - a. International Concrete Restoration Institute (ICRI):
 1. ICRI 310.1R - Exposed Reinforcing bar (Rebar) Repair
 2. ICRI-CSP 1 - Concrete Surface Profile 1
 3. ICRI-CSP 2 - Concrete Surface Profile 2
 4. ICRI-CSP 3 - Concrete Surface Profile 3

5. ICRI-CSP 4 - Concrete Surface Profile 4
 6. ICRI-CSP 5 - Concrete Surface Profile 5
 7. ICRI-CSP 6 - Concrete Surface Profile 6
- J. SSPC-SP14/NACE No.8: Industrial Blast Cleaning: An industrial blast cleaned surface, when viewed without magnification, shall be free of all visible oil, grease, dust, and dirt. Traces of tightly adherent mill scale, rust, and coating residues are permitted to remain on 10% of each unit area of the surface if they are evenly distributed.
 - K. SSPC-SP15: Commercial Grade Power Tool Cleaning: A commercial grade power tool cleaned steel surface, when viewed without magnification, shall be free of all visible oil, grease, dirt, rust, coating, oxides, mill scale, corrosion products, and other foreign matter, except as noted. Random staining shall be limited to no more than 33 percent of each unit area of surface as defined.
 - L. Visual standards "Pictorial Surface Preparation Standards for Painting Steel Surfaces", and the National Association of Corrosion Engineer, "Blasting Cleaning Visual Standards" TM-01-70 and TM-01-75 shall be considered as standards for proper surface preparation.
 - M. NAPF 500-03-04: External Pipe Surface: When viewed without magnification, the exterior surfaces shall be free of all visible dirt, dust, loose annealing oxide, rust, mold, coatings, and other foreign matter.
 - N. NAPF 500-03-05: Fitting Blast Clean #2: When viewed without magnification, no more than 5% staining may remain on the surface and the exterior surfaces shall be free of all visible dirt, dust, annealing oxide, rust, mold, coatings, and other foreign matter.

3.03 SURFACE PREPARATION

- A. The surface shall be cleaned as specified for the paint system being used.
- B. All cleaning shall be as outlined in the Society for Protective Coatings (SSPC) Surface Preparation Specification, National Association of Corrosion Engineers (NACE), and the International Concrete Repair Institute (ICRI) unless otherwise noted.
- C. If surfaces are subject to contamination, other than mill scale or normal atmospheric rusting, the surfaces shall be checked for chloride contamination, pressure washed, and acid or caustic pH residues neutralized, in addition to the specified surface preparation.
- D. Oil, grease, soil, dust, etc., deposited on the surface preparation that has been completed shall be removed prior to painting according to SSPC-SP1 Solvent Cleaning under this Specification.
- E. Weld flux, weld spatter, and rust scale shall be removed by a minimum of SSPC-SP3 Power Tool Cleaning as per these Specifications.
- F. All weld seams, sharp protrusions and edges shall be ground smooth prior to surface preparation or application of any coatings.
- G. All areas requiring field welding shall be masked off prior to shop coating, unless waived by the Owner.
- H. All areas which require field touch-up after erection, such as welds, burnbacks, and

mechanically damaged areas, shall be prepared per the Manufacturer's latest written recommendations.

- I. In the event that an existing coating's max recoat window has been exceeded, all surfaces to be overcoated must be thoroughly and uniformly de-glossed and scarified before the application of additional coatings.
- J. All surfaces must be clean and dry prior to the application of any coatings.
- K. All bare concrete surfaces exposed to wastewater or similar corrosive atmospheres shall be confirmed to have a minimum pH of 9 prior to the application of coatings.

3.04 PRETREATMENTS

When specified, the surface shall be pretreated in accordance with the specified pretreatment prior to application of the prime coat of paint.

3.05 STORAGE

Materials shall be delivered to the job site in the original packages with seals unbroken and with legible unmutated labels attached. Packages shall be available for inspection by the County. All coating materials shall be stored in accordance with the Manufacturer's latest written recommendations. The Contractor is responsible for following the Manufacturer's suggested storage temperatures and conditions. The Contractor shall be solely responsible for the protection of the materials stored by himself at the job site. Empty coating cans shall be neatly stacked in an area designated by the County and removed from the job site on a schedule determined by the Contractor. County may request a notarized statement from Contractor detailing all materials used on the Project.

3.06 PREPARATION OF MATERIALS

- A. Mechanical mixers, capable of thoroughly mixing the pigment and vehicle together, shall mix the paint prior to use where required by manufacturer's instructions; thorough hand mixing will be allowed for small amounts up to one gallon. Pressure pots shall be equipped with mechanical mixers to keep the pigment in suspension, when required by manufacturer's instructions. Otherwise, intermittent hand mixing shall be done to assure that no separation occurs. All mixing shall be done in accordance with SSPC Vol. 1, Chapter 4, "Practical Aspects, Use and Application of Paints" and/or with manufacturer's recommendations.
- B. Thinners shall be as recommended by the manufacturer and shall be added or discarded strictly in accordance with the manufacturer's instruction. Partial kits may only be used when components are accurately measured and mixed per the Manufacturer's latest written recommendations.

3.07 APPLICATION

- A. Paint shall be applied only on thoroughly dry surfaces and during periods of favorable weather, unless otherwise allowed by the paint manufacturer. Except as provided below, painting shall not be permitted when the atmospheric temperature is outside limit of the manufacturer's latest written recommendations, or when freshly painted surfaces may be damaged by rain, fog, dust, or condensation, and/or when it can be anticipated that these conditions will prevail during the drying period.
- B. No coatings shall be applied unless surface temperature is a minimum of 5°F above dew point; temperature must be maintained during curing.
- C. See coating schedule for actual coating systems to be used on this project.

3.08

DEW POINT CALCULATION CHART

DEW POINT CALCULATION CHART

Ambient Air Temperature - Fahrenheit

Relative Humidity	20	30	40	50	60	70	80	90	100	110	120
90%	18	28	37	47	57	67	77	87	97	107	117
85%	17	26	36	45	55	65	76	84	95	104	113
80%	16	25	34	44	54	63	73	82	93	102	110
75%	15	24	33	42	52	62	71	80	91	100	108
70%	13	22	31	40	50	60	68	78	88	96	105
65%	12	20	29	38	47	57	66	76	85	93	103
60%	11	20	27	36	45	55	64	73	83	92	101
55%	9	17	25	34	43	53	61	70	80	89	98
50%	6	15	23	31	40	50	59	67	77	86	94
45%	4	13	21	29	37	47	56	64	73	82	91
40%	1	11	18	26	35	43	52	61	69	78	87
35%	-2	8	16	23	31	40	48	57	65	74	83

SURFACE TEMPERATURE AT WHICH CONDENSATION OCCURS

Dew Point

Temperature at which moisture will condense on surface. No coatings should be applied unless surface temperature is a minimum of 5°F above this point. Temperature must be maintained during curing.

Example

If air temperature is 70°F and relative humidity is 65%, the dew point is 57°F. No coating should be applied unless surface temperature is 62°F minimum.

- A. No coating shall be applied unless the relative humidity is below 85%.
- B. Suitable enclosures to permit painting during inclement weather may be used if provisions are made to control atmospheric conditions artificially inside the enclosure, within limits suitable for painting throughout the painting operations.
- C. Field painting in the immediate vicinity of, or on, energized electrical and rotating equipment, and equipment and/or pipes in service shall not be performed without the approval of the Owner.
- D. Extreme care shall be exercised in the painting of all operable equipment, such as valves, electric motors, etc., so that the proper functioning of the equipment will not be affected.
- E. The Contractor's scaffolding shall be erected, maintained and dismantled without damage to structures, machinery, equipment or pipe. Drop cloths shall be used where required to protect buildings and equipment. All surfaces required to be clear for visual observation shall be cleaned immediately after paint application.

- F. Painting shall not be performed on insulated pipe within three (3) feet of insulation operations or on insulation whose covering and surface coat have not had time to set and dry. Painting shall not be performed on uninsulated pipe within one (1) foot of any type of connection until the connection has been made, except as directed by the Owner.
- G. The prime coat shall be applied immediately following surface preparation and in no case later than the same working day. All paint shall be applied by brushing, paint mitt and roller, conventional spraying, or airless spraying, using equipment approved by the paint manufacturer.
- H. Each coat of paint shall be recoated as per manufacturer's instructions. Paint shall be considered recoatable when an additional coat can be applied without any detrimental film irregularities such as lifting or loss of adhesion.
- I. Surfaces that will be inaccessible after assembly shall receive either the full specified paint system or three shop coats of the specified primer before assembly.
- J. Unless otherwise specified, each full coat within a coating system shall be of a different or alternating color.
- K. Finish colors shall be in accordance with the COLOR SCHEDULE and shall be factory mixed (i.e., there shall be no tinting by the Contractor, unless authorized by the Owner).
- L. All edges and weld seams in immersion service shall receive a "stripe coat" (applied by brush) of the 2nd coat prior to application of the full 2nd coat.
- M. All open seams in the roof area of tanks shall be filled after application of the topcoat with a flexible caulking such as Sika Flex 1A.

3.09 WORKMANSHIP

- A. The Contractor must show proof that all employees associated with this Project shall have been employed by the Contractor for a period not less than six (6) months.
- B. Painting shall be performed by experienced painters in accordance with the recommendations of the paint manufacturer. All paint shall be uniformly applied without sags, runs, spots, or other blemishes. Work which shows carelessness, lack of skill, or is defective in the opinion of the County, shall be corrected at the expense of the Contractor.
- C. The Contractor shall provide the names of at least three other projects of similar size and scope that they have successfully completed under their current company name.

3.10 APPLICATION OF PAINT

- A. By Brush and/or Rollers
 - 1. Top quality, properly styled brushes and rollers shall be used. Rollers with a baked phenol core shall be utilized.
 - 2. The brushing or rolling shall be done so that a smooth coat as nearly uniform in thickness as possible is obtained. Brush or roller strokes shall be made to smooth the film without leaving deep or detrimental marks.
 - 3. Surfaces not accessible to brushes or rollers may be painted by spray, by dauber or

- sheepskins, and paint mitt.
4. It may require two coats to achieve the specified dry film thickness if application is by brush and roller.

B. Air, Airless or Hot Spray

1. The equipment used shall be suitable for the intended purpose, shall be capable of properly atomizing the paint to be applied and shall be equipped with suitable pressure regulators and gauges.
2. Paint shall be applied in a uniform layer, with a 50% overlap pattern. All runs and sags should be brushed out immediately or the paint shall be removed and the surface resprayed.
3. High build coatings should be applied by a cross-hatch method of spray application to ensure proper film thickness of the coating.
4. Areas inaccessible to spray shall be brushed; if also inaccessible to brush, daubs or sheepskins shall be used, as authorized by the manufacturer.
5. Thinners shall be as recommended by the manufacturer and shall be added or discarded strictly in accordance with the manufacturer's instruction.
6. Nozzles, tips, etc., shall be of sizes and designs as recommended by the manufacturer of the paint being sprayed.
7. The first coat on concrete surfaces in immersion service should be sprayed and back rolled.

3.11 PROTECTION AND CLEANUP

- A. It shall be the responsibility of the Contractor to protect at all times, in areas where painting is being done, floors, materials of other crafts, equipment, vehicles, fixtures, and finished surfaces adjacent to paint work. Cover all electric plates, surface hardware, nameplates, gauge glasses, etc., before start of painting work.
- B. At the option of the County during the course of this project, the Contractor will contain all spent abrasives, old paint chips, paint overspray and debris by means suitable to the County, including, but not limited to, full shrouding of the area.
- C. If shrouding is required, the Contractor must provide a complete design of the intended shroud or cover. Care must be taken not to modify or damage the structure during the use of the shroud. If damage should occur, the Contractor is held responsible for all repairs.
- D. At completion of the work, remove all paint where spilled, splashed, spattered, sprayed or smeared on all surfaces, including glass, light fixtures, hardware, equipment, painted and unpainted surfaces.
- E. After completion of all painting, the Contractor shall remove from job site all painting equipment, surplus materials and debris resulting from this work.
- F. The Contractor is responsible for the removal and proper disposal of all hazardous materials from the job site in accordance with Local, State and Federal requirements as outlined by the Environmental Protection Agency.
- G. A notarized statement shall be presented to the County that all hazardous materials have been disposed of properly including, but not limited to: name of disposal company, disposal site, listing of hazardous materials, weights of all materials, cost per pound and EPA registration number.

3.12 TOUCH-UP MATERIALS

- A. All areas which require field touch-up after erection, such as welds, burnbacks, and mechanically damaged areas, shall be prepared per the Manufacturer's latest written recommendations.
- B. Strict adherence to manufacturer's complete touch-up recommendations shall be followed. Any questions relative to compatibility of products shall be brought to the Owner and Manufacturer's attention. Otherwise, Contractor assumes full responsibility.
- C. The Contractor shall provide, at the end of the Project, at least one (1) gallon of each generic topcoat in each color as specified by the Owner for future touch-up. Two gallons may be required for (2) component materials.

3.13 ON-SITE INSPECTION

During the course of this Project, the County will reserve the option of incorporating the services of a NACE Level III inspection service. The inspection service will be responsible for assuring the proper execution of this Specification by the successful Contractor.

3.14 STEEL & FERROUS METALS

A. FERROUS METALS - NON-IMMERSION / EXTERIOR / UV-EXPOSED

The coating systems in the FERROUS METALS - NON-IMMERSION / EXTERIOR / UV-EXPOSED section are listed in order of decreasing color & gloss retention and corrosion resistance. The first system has maximum color & gloss retention and maximum corrosion resistance.

1. System No. 700-1: Zinc/Epoxy/Fluoropolymer

This system provides outstanding resistance to ultra-violet light degradation and the absolute best color and gloss retention available. This system will have excellent resistance to abrasion and chalking, and is recommended for coastal environments and on structures where extremely long-term maintenance cycles are desired (such as elevated tanks and surfaces with custom artwork). (Note: Series 700 is gloss. If the Owner desires a semi-gloss finish then Series 700 may be replaced with Series 701.) Note: For single-component application, Series 90G-1K97 may be substituted as the primer.

Surface Preparation: SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum 1.5 mil angular anchor profile.

Primer: Series 90-97 Tneme-Zinc	2.5 - 3.5 mils
2nd Coat: Series 66HS Hi-Build Epoxoline	3.0 - 6.0 mils
3rd Coat: Series 700 Hydroflon	<u>2.0 - 3.0 mils</u>

Total Dry Film Thickness: 7.5 - 12.5 mils
Minimum Dry Film Thickness: 9.5 mils

2. System No. 1095-1: Zinc/Epoxy/Urethane

This system offers excellent color & gloss retention with the added corrosion protection of a zinc rich primer. Series 90-97 Tneme-Zinc is an organic zinc-rich primer that can be used for field touch up of a zinc primer or for touch up of galvanized surfaces that are damaged. For single-component applications, Series 90G-1K97 may be substituted for Series 90-97. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation: SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum 1.5 mil angular anchor profile.

Shop Coat: Series 90-97 Tneme-Zinc	2.5 - 3.5 mils
2nd Coat: Series 66HS Hi-Build Epoxoline	3.0 - 6.0 mils
3rd Coat: Series 1095 Endurashield	2.5 - 5.0 mils
Total Dry Film Thickness: 8.0 - 14.5 mils	
Minimum Dry Film Thickness: 10.0 mils	

3. System No. 1095-2: Epoxy/Epoxy/Urethane

This system is highly resistant to abrasion, wet conditions, corrosive fumes and chemical contact. It provides excellent color & gloss retention. This system should be used for exterior steel surfaces that are neither submerged, nor buried. Series 161HS may be substituted for Series 66HS for low temperature cure or quick recoats. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation: SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum 1.5 mil angular anchor profile.

Shop Coat: Series 66-1211 Hi-Build Epoxoline Primer	3.0 - 6.0 mils
2nd Coat: Series 66 Hi-Build Epoxoline	3.0 - 6.0 mils
3rd Coat: Series 1095 Endura-Shield	2.0 - 5.0 mils
Total Dry Film Thickness: 8.0 - 17.0 mils	
Minimum Dry Film Thickness: 10.0 mils	

4. System No. 1095-3: Epoxy Mastic/Urethane (Overcoat)

This system can be used over factory finish paint or over non-sandblasted steel and offers the high performance of an epoxy/urethane system. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation: High Pressure Water Clean (min. 3500 psi, 3 to 5 gallons per minute, using an oscillating tip and potable water). A cleaning detergent such as Trisodium Phosphate should be used to facilitate cleaning. A degreaser may be required for oil soaked areas or heavily contaminated areas.

Some spot areas may require Hand Tool (SSPC-SP2), Power Tool Cleaning (SSPC-SP3), or Brush Blast (SSPC-SP7/NACE No. 4) to remove loose surface rust.

Existing coatings must be clean, dry, and tightly adhering prior to application of

coatings.

Spot Prime (Areas of Bare Steel): Series 135 Chembuild	4.0 - 6.0 mils
1st Coat: Series 135 Chembuild	4.0 - 6.0 mils
2nd Coat: Series 1095 Endura-Shield	<u>2.0 - 5.0 mils</u>

Total Dry Film Thickness: 6.0 - 11.0 mils*
Minimum Dry Film Thickness: 7.0 mils

**Does not include spot prime or previously existing coatings.*

B. EXTERIOR BELOW GRADE EXPOSURE

1. System No. 66HS-1: Epoxy/Epoxy/Epoxy or Urethane

This system provides exceptional corrosion protection in buried environments. It offers better corrosion protection and a healthier application process than coal-tar epoxies. The 3rd coat is dependent on the exposure - for buried areas use an extra coat of high-solids epoxy, for uv-exposed, non-immersion areas use an aliphatic acrylic urethane. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation: SSPC-SP10/NACE No. 2 Near-White Blast Cleaning with a minimum angular anchor profile of 1.5 mils.

Shop Coat: Series N140 Pota-Pox Plus	2.0 - 10.0 mils
2nd Coat: Series N140 Pota-Pox Plus	4.0 - 10.0 mils
3rd Coat (Buried Area Only): Series N140 Pota-Pox Plus	4.0 - 10.0 mils
3 rd Coat (UV Exposed, Non Immersion Areas Only): Series 1095	<u>2.5 - 5.0 mils</u>

Total Dry Film Thickness: 10.0 - 30.0 mils
Minimum Dry Film Thickness: 11.0 mils

2. System No. 46H-413-1: Polyamide Epoxy-Coal Tar

This system provides a high-build coating for underground conditions.

Surface Preparation: SSPC-SP10/NACE No. 2 Near-White Blast Cleaning with a minimum angular anchor profile of 1.5 mils.

1st Coat: Series 46H-413 Hi-Build Tneme-Tar	8.0 - 10.0 mils
2nd Coat: Series 46H-413 Hi-Build Tneme-Tar	<u>8.0 - 10.0 mils</u>
Total Dry Film Thickness: 16.0 - 20.0 mils	
Minimum Dry Film Thickness: 18.0 mils	

C. INTERIOR (NON-IMMERSION)

1. System No.66HS-2: Polyamide Epoxy

This system will provide chemical and corrosion resistance against abrasion, moisture, corrosion fumes, and occasional chemical contact. Primer coat must be touched-up before second coat is applied. Substitute Series 161 for low temperature cure or quick recoats. Use this system for interior exposed, non-submerged metals.

Surface Preparation: SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum 1.5 mil angular anchor profile.

Shop Coat: Series 66 Hi-Build Epoxoline	3.0 - 5.0 mils
2nd Coat: Series 66 Hi-Build Epoxoline	4.0 - 6.0 mils
3rd Coat: Series 66 Hi-Build Epoxoline	<u>4.0 - 6.0 mils</u>
Total Dry Film Thickness: 7.0 - 11.0 mils	
Minimum Dry Film Thickness: 9.0 mils	

2. System No. 27WB-1: Inorganic Hybrid Water-Based Epoxy (Overcoat)

This low VOC system can be used over factory finish paint or over non-sandblasted steel and offers the high performance of an epoxy/urethane system. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation: Abrasive blast cleaning in accordance with SSPC-SP7/NACE No.4 generally produces the best coating performance. If conditions will not permit this, Series 27WB may be applied to SSPC-SP2 or SP3 Hand or Power Tool Cleaned surfaces (SSPC Rust Grade Condition C).

Shop Coat: Manufacturer's Standard (or existing coating)	varies
Spot Prime (Areas of Bare Steel): Series 27WB Typoxy	3.0 - 8.0 mils
2nd Coat: Series 27WB Typoxy	3.0 - 8.0 mils
3rd Coat: Series 1095 Endura-Shield	<u>2.5 - 5.0 mils</u>
Total Dry Film Thickness: 5.5 - 13.0 mils*	
Minimum Dry Film Thickness: 7.0 mils	

**Does not include spot prime or previously existing coatings.*

D. IMMERSION

1. System No. 104-1: Cycloaliphatic Amine Epoxy (Non-Potable Water)

This system will provide chemical and corrosion resistance for protection against moisture, corrosive fumes, chemical contact and immersion in **mild to moderate** wastewater, such as clarifiers, chlorine contact basins, aeration basins, settling basins and other open top (aerobic) structures. Shop coat must be touched-up before second coat is applied.

Surface Preparation: SSPC-SP10/NACE No.2 Near-White Blast Cleaning with a minimum 1.5 mil angular anchor profile.

Shop Coat: Series 1 Omnithane	2.5 - 3.5 mils
2nd Coat: Series 104 Hi-Build Epoxoline	6.0 - 8.0 mils
3rd Coat: Series 104 Hi-Build Epoxoline	<u>6.0 - 8.0 mils</u>
Total Dry Film Thickness: 14.5 - 19.5 mils	
Minimum Dry Film Thickness: 15.5 mils	

Allow Series 104 to cure for 7 days at 75°F prior to immersion service.

2. System No. 142-1: Flake / Aluminum Oxide Filled Polyamine Epoxy (Non-Potable Water)

This system will provide chemical and corrosion resistance for protection against moisture, corrosive fumes, chemical contact and immersion in **mild to moderate wastewater where increased abrasion resistance is required.**

Surface Preparation: SSPC-SP-10/NACE No.2 Near-White Metal Blast Cleaning (1.5 Mil Profile)

1st Coat: Series 1 Omnithane	2.5 - 3.5 mils
2nd Coat: Series 142 Epoxoline	<u>14 - 18.0 mils</u>
Total Dry Film Thickness: 16.5 - 23.5 mils	
Minimum Dry Film Thickness: 20.0 mils	

3. System No. 446-1: Hydrophobic Aromatic Polyurethane (Non-Potable Water)

This system will provide exceptional chemical and corrosion resistance for protection against moisture, corrosive fumes, chemical contact and **immersion in mild to moderate wastewater environments. This system is designed for situations where an extremely quick return to service is required.**

Surface Preparation: SSPC-SP10/NACE No.2 Near-White Blast Cleaning.

1st Coat: Series 1 Omnithane	2.5 - 3.5 mils
2nd Coat: 446 Perma-Shield MCU	6.0 - 8.0 mils*
3rd Coat: 446 Perma-Shield MCU	<u>6.0 - 8.0 mils*</u>
Total Dry Film Thickness: 14.5 - 19.5 mils	
Minimum Dry Film Thickness: 16.0 mils	

**Exceeding 10.0 mils per coat of Series 446 may cause blistering.*

Notes:

1. Series 446 is not color stable. Its color may change drastically, which will not affect the performance of the product.
2. Allow Series 446 to cure for 4 hours at 75°F prior to service.

4. System No. 142-2: Flake / Aluminum Oxide Filled Polyamine Epoxy (Methanol Liner)

This system will provide chemical and corrosion resistant liner suitable for methanol immersion service.

Surface Preparation: SSPC-SP-10/NACE No.2 Near-White Metal Blast Cleaning (1.5 Mil Profile)

2nd Coat: Series 142 Epoxoline

15.0 - 18.0 mils

Total Dry Film Thickness: 15.0 - 18.0 mils

Minimum Dry Film Thickness: 15.0 mils

5. System No. 365-1: Novolac Epoxy (Sulfuric Acid Liner)

This system is a spray applied, 100% solids, high build, reinforced epoxy formulated for general use as an internal lining for tanks and other aggressive chemical immersion service. This lining is suitable for immersion service in 98% sulfuric acid, and **requires the use of heated plural component equipment to apply.**

Surface Preparation: SSPC-SP5/NACE No. 1 White Metal Blast Cleaning with a minimum angular anchor profile of 3.0 mils. Refer to the Series 365 Application Guide.

Surfacer/Filler (as needed to fill pits and voids): Series 351 Tank Armor

*Stripe Coat: Brush Series 365 Tank Armor into welds, seams, and edges

*Full Coat: Series 365 Tank Armor

35.0 - 50.0 mils

Total Dry Film Thickness: 35.0 - 50.0 mils

*Consult the manufacturer's latest written recommendations and application guide before applying.

Notes:

1. If the humidity is anticipated to exceed 80%, dehumidification equipment is required.
2. Allow Series 365 to cure for 48 hours at 75°F prior to service.

6. System No. 22-1: Modified Polyamine Epoxy (Potable Water)

This is a low VOC system which meets the requirements of approval for potable water use as established by NSF Std 61. **This system may be applied up to 40.0 mils in a single coat, providing exceptional barrier protection and a quicker return to service.** This system is intended for use over simple shapes and areas with minimal detail work.

Surface Preparation: SSPC-SP10/NACE No.2 Near-White Blast Cleaning with a minimum angular anchor profile of 3.0 mils.

Pre-patch (sharp, angular pits and voids): Series 215 as needed
Stripe Coat: Series 22 Welds, seams, and edges
Topcoat: Series 22 22.0 - 27.0 mils*
Total Dry Film Thickness: 22.0 - 27.0 mils

**In order to maintain NSF Std. 61 approval, maximum allowable DFT is 50.0 mils.*

Notes:

1. Series 22 is to be spray applied only.
2. Allow Series 22 to cure for a minimum of 5 days at 75°F prior to service.

7. System No. 20HS-1: Epoxy-Polyamide (Potable Water)

This system meets American Water Works Association AWWA D 102 Inside Paint System Number 1. Series 20 meets the requirements of approval for potable water use as established by NSF Std 61. Substitute Series FC20 for low temperature cure or quick recoats.

Surface Preparation: SSPC-SP10/NACE No.2 Near-White Blast Cleaning with a minimum angular anchor profile of 2.0 mils.

Shop Coat: Series 94H₂O Hydro-Zinc 2.5 - 3.5 mils
Stripe Coat (Weld Seams and Edges): 20 Pota-Pox 3.0 - 5.0 mils
2nd Coat: 20 1255 Pota-Pox (Beige) 4.0 - 6.0 mils
3rd Coat: 20-15BL Pota-Pox (Tank White) 4.0 - 6.0 mils
Total Dry Film Thickness*: 10.5 - 15.5 mils**
Minimum Dry Film Thickness: 11.5 mils

**Excludes stripe coat*

***Note: In order to maintain NSF Std. 61 approval, maximum allowable DFT is 18 mils.*

Allow Series 20 to cure for 7 days at 75°F prior to service.

3.15 OVERHEAD METAL DECKING, JOISTS

A. EXTERIOR EXPOSURE

System No. 1029-1: HDP Acrylic Polymer

This system can be applied over a wide variety of coatings and factory finishes. It can also be applied direct to galvanized decking, joists, & conduits. Series 1029 is suitable for application in mild to moderate exposures.

Surface Preparation: Pressure clean to remove all dirt, oil, grease, chemicals and foreign contaminates. Remove loose paint and all rust by hand and power tool cleaning (SSPC-SP 2 & 3)

1st Coat: Series 115 Uni-Bond	2.5 - 4.0 mils
2nd Coat: Series 1029 Enduratone	<u>2.0 - 3.0 mils</u>
Total Dry Film Thickness: 4.5 - 7.0 mils	

B. INTERIOR EXPOSURE

System No. 115-1: Self-crosslinking Hydrophobic Acrylic

This system should be used on ceilings of non-chemical storage areas where a one-coat system is desired. Can be applied over steel, galvanized and aluminum decking, joist, shop primed beams, conduits and concrete. Note: Series 115 has "dry-fall" characteristics. See manufacturer's latest written Product Data Sheet for details.

Surface Preparation: Surfaces must be dry, clean and free of oil, grease and other contaminates.

One Coat: Series 115 Uni-Bond	<u>2.5 - 4.0 mils</u>
Total Dry Film Thickness: 2.5 - 4.0 mils	

3.16 GALVANIZED STEEL & NONFERROUS METALS

A. GALVANIZED STEEL, STAINLESS STEEL, ALUMINUM, OR COPPER

System No. 1095-4: Epoxy/High Build Urethane

Series 66 has excellent adhesion to galvanized steel & nonferrous metals. This system is highly resistant to abrasion, wet conditions, corrosive fumes and chemical contact. It provides excellent color & gloss retention. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation: SSPC-SP1 Solvent Cleaning, followed by mechanically abrading (SSPC-SP7/NACE No.4, minimum angular anchor profile of 1.5 mils)

1st Coat: Series 66 Hi-Build Epoxoline	2.0 - 4.0 mils
2nd Coat: Series 1095 Endura-Shield	<u>2.5 - 5.0 mils</u>
Total Dry Film Thickness: 4.5 - 9.0 mils	
Minimum Dry Film Thickness: 5.0 mils	

B. ALUMINUM IN CONTACT WITH CONCRETE

System No. 46H-413-2: Polyamide Epoxy

Surface Preparation: SSPC-SP1 Solvent Cleaning, followed by thoroughly scarifying to de-gloss and provide a minimum uniform angular anchor profile of 1.0 mil.

1st Coat: Series 46H-413 Hi-Build Tneme-Tar	3.0 - 5.0 mils
2nd Coat: Series 46H-413 Hi-Build Tneme-Tar	<u>8.0 - 10.0 mils</u>
Total Dry Film Thickness: 11.0 - 15.0 mils	
Minimum Dry Film Thickness: 13.0 mils	

3.17 CONCRETE & MASONRY

A. EXTERIOR - ABOVE GRADE (NON-IMMERSION, VERTICAL SURFACES)

1. System No. 156-1: Modified Waterborne Acrylate (Elastomeric)

This system provides exceptional elongation for spanning hairline cracks in concrete structures. It also provides mold & mildew resistance, as well as wind-driven rain resistance. For application over previously applied coatings, use TNESEC Series 151 Elasto-Grip at 0.7 - 1.5 mils DFT prior to the application of Series 156 Enviro-Crete. Note: If a textured finish is preferred, use 157 Enviro-Crete TX (medium texture) @ 6.0 - 9.0 mils dry film thickness per coat.

Surface Preparation: Allow concrete to cure for 28 days. Surface must be clean and dry.

1st Coat: Series 156 Enviro-Crete	4.0 - 8.0 mils
2nd Coat: Series 156 Enviro-Crete	<u>4.0 - 8.0 mils</u>
Total Dry Film Thickness: 8.0 - 16.0 mils	
Minimum Dry Film Thickness: 10.0 mils	

2. System No. 1026-1: Acrylic Emulsion (Non-Elastomeric)

This system provides a durable, easy-to-use, water-based coating that offers long-wearing protection. It is low odor, low VOC, and has "dry-fall" properties. See manufacturer's latest written Product Data Sheet for details. This system will provide a high vapor transmission rate.

Surface Preparation: Allow concrete to cure for 28 days. Surface shall be clean and dry.

Block Filler (CMU only): 1254 Epoxoblock	100 - 150 ft ² /Gallon
1st Coat: Series 1026 Enduratone	2.0 - 3.0 mils
2nd Coat: Series 1026 Enduratone	<u>2.0 - 3.0 mils</u>
Total Dry Film Thickness: 4.0 - 6.0 mils*	
Minimum Dry Film Thickness: 5.0 mils	

*Does not include Block Filler

3. System No. 662-1: Silane /Siloxane Sealer (Min. 42% Solids)

This provides a clear, filmless, penetrating water repellent for virtually all above-grade, vertical and horizontal concrete, stucco, block, and brick masonry. This will

allow the substrate to resist water and chloride ion intrusion, stain damage, freeze/thaw spalling, efflorescence, and rust damage. This system will not alter the color or texture of the surface, nor significantly affect the vapor transmission qualities of the substrate. This barrier is also resistant to ultraviolet and weather deterioration.

Surface Preparation: Allow new concrete to cure 28 days. All surfaces must be clean, dry, and free of oils, curing compounds, form release oils, and other contaminants that might interfere with the penetration of the sealer.

For Coating Brick & Concrete:
Tnemec Series 662 Two Coats @ 75-200 ft²/gallon

For Coating Split-faced or Porous Masonry:
Tnemec Series 662 Two Coats @ 35-100 ft²/gallon

4. System No. 626-1: Water Repellent and Graffiti Protectant

This provides superior protection against, and easy removal of, unwanted graffiti. **Series 626 is intended for use in conjunction with Series 680 Mark A Way (Cleaner) to provide a complete graffiti protection system.** This is a clear, silicone rubber-based formulation which protects vertical concrete block, brick, cast concrete, stone, and other masonry substrates with little or no change to the appearance of the untreated substrate. It has excellent stability against ultraviolet rays and salt spray.

Surface Preparation: Allow new concrete to cure 28 days. All surfaces must be clean, dry, and free of oils, curing compounds, form release oils, and other contaminants that might interfere with the penetration of the sealer.

For Coating Brick & Concrete:
Tnemec Series 626 Two Coats @ 125-200 ft²/gallon

For Coating Split-faced or Porous Masonry:
Tnemec Series 626 Two Coats @ 65-150 ft²/gallon

B. EXTERIOR - BELOW GRADE

1. System No. 46H-413-2: Polyamide Epoxy-Coal Tar

This system provides a high-build coating for underground conditions.

Surface Preparation: Allow new concrete to cure for 28 days. Surface shall be clean and dry.

One or Two Coats: 46H-413 Hi-Build Tnemec-Tar
Total Dry Film Thickness: 16.0 - 20.0 mils*

C. INTERIOR (NON-IMMERSION)

The coating systems in the INTERIOR (NON-IMMERSION) section are listed in order of decreasing performance with regards to chemical & corrosion resistance. This generally has an inverse correlation with color & gloss retention. The first system has extremely good

chemical resistance with the highest potential for yellowing, while the last system has extremely poor chemical resistance with the lowest potential for yellowing.

1. System No. 104-2: Cycloaliphatic Amine Epoxy

This system will produce a tile-like finish for easy cleaning and superior stain resistance. It will also provide protection against chemical attack, corrosive fumes, high humidity and wash down. Backroll first coat to fill porosity.

Surface Preparation: Allow new concrete and masonry to cure for 28 days. Surface must be clean and dry.

For New Concrete or Porous Masonry: Apply Tnemec Series 1254 Epoxoblock WB @ 100 - 150 ft²/Gallon.

1st Coat: Series 104 H.S. Epoxy (backrolled)	8.0 - 10.0 mils
2nd Coat: Series 104 H.S. Epoxy	<u>8.0 - 10.0 mils</u>
Total Dry Film Thickness: 16.0 - 20.0 mils	
Minimum Dry Film Thickness: 18.0 mils	

2. System No. 66HS-6: Polyamide Epoxy

This system provides excellent protection from abrasion, moisture, corrosive fumes and chemical contact.

Surface Preparation: Allow new concrete and masonry to cure for 28 days. Surface must be clean and dry.

For New Concrete or Porous Masonry: Apply Tnemec Series 1254 Epoxoblock WB @ 100 - 150 ft²/Gallon.

1st Coat: Series 66HS Hi-Build Epoxoline	3.0 - 5.0 mils
2nd Coat: Series 66HS Hi-Build Epoxoline	<u>4.0 - 6.0 mils</u>
Total Dry Film Thickness: 7.0 - 11.0 mils	
Minimum Dry Film Thickness: 9.0 mils	

3. System No. 113-1: Acrylic-Epoxy

This system will provide high performance and can be applied directly over existing coatings without lifting. Can be used when low odor is required during application. Note: Series 113 has a Satin finish. For a gloss finish, specify Series 114 Tneme-Tufcoat.

Surface Preparation: Allow new concrete and masonry to cure for 28 days. Surface must be clean and dry.

For New Concrete or Porous Masonry: Apply Tnemec Series 1254 Epoxoblock WB @ 100 - 150 ft²/Gallon.

1st Coat: 113 Tneme-Tufcoat	4.0 - 6.0 mils
2nd Coat: 113 Tneme-Tufcoat	<u>4.0 - 6.0 mils</u>
Total Dry Film Thickness: 8.0 - 12.0 mils	
Minimum Dry Film Thickness: 9.0 mils	

4. System No. 1026-2: Acrylic Emulsion

This system provides a durable, easy-to-use, water-based coating that offers long-wearing protection. It is low odor, low VOC, and has “dry-fall” properties. See manufacturer’s latest written Product Data Sheet for details. This system will provide a high vapor transmission rate. Note: Series 1026 has a Matte finish. For a Semi-Gloss finish, specify Series 1029 Enduratone.

Surface Preparation: Surface shall be clean and dry. Allow concrete to cure for 28 days.

Block Filler (CMU only): 54 Masonry Filler	80 - 100 ft ² /Gallon
1st Coat: Series 1026 Enduratone	2.0 - 3.0 mils
2nd Coat: Series 1026 Enduratone	<u>2.0 - 3.0 mils</u>
Total Dry Film Thickness: 4.0 - 6.0 mils*	
Minimum Dry Film Thickness: 5.0 mils	

**Does not include Block Filler*

D. IMMERSION

1. System No. 104-3: Cycloaliphatic Amine Epoxy (Non-Potable Water)

This system will provide chemical and corrosion resistance for protection against abrasion, moisture, corrosive fumes, chemical contact and immersion in ***mild to moderate*** Wastewater, such as clarifiers, chlorine contact basins, aeration basins, settling basins and other open top (aerobic) structures.

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI CSP 5 or greater.

Apply Tnemec Series 218 to all surfaces at a minimum of 1/16” to re-surface concrete, fill voids and bugholes, mitigate concrete outgassing, and to create a monolithic, paintable surface.

1st Coat: 104-1255 H.S. Epoxy Primer (backrolled)	6.0 - 8.0 mils
2nd Coat: 104 H.S. Epoxy	6.0 - 8.0 mils
3 rd Coat: 104 H.S. Epoxy	<u>6.0 - 8.0 mils</u>
Total Dry Film Thickness: 18.0 - 24.0 mils	
Minimum Dry Film Thickness: 20.0 mils	

Allow Series 104 to cure for 7 days at 75°F prior to immersion service.

2. System No. 142-3: Flake/Aluminum Oxide Filled Polyamine Epoxy (Non-Potable Water)

This system will provide chemical and corrosion resistance for protection against moisture, corrosive fumes, chemical contact and immersion in ***mild to moderate wastewater where increased abrasion resistance is required.***

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI CSP 5 or greater.

Apply Tnemec Series 218 to all surfaces at a minimum of 1/16" to re-surface concrete, fill voids and bugholes, mitigate concrete outgassing, and to create a monolithic, paintable surface.

1st Coat: Series 142 Epoxoline
2nd Coat: Series 142 Epoxoline

8.0 - 10.0 mils

8.0 - 10.0 mils

Total Dry Film Thickness: 16.0 - 20.0 mils
Minimum Dry Film Thickness: 18.0 mils

3. System No. 22-2: Modified Polyamine Epoxy (Potable Water)

This is a low VOC system which meets the requirements of approval for potable water use as established by NSF Std 61. **This system may be applied up to 40.0 mils in a single coat, providing exceptional barrier protection and a quicker return to service.** This system is intended for use over simple shapes and areas with minimal detail work.

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI CSP 5 or greater.

Apply Tnemec Series 218 to all surfaces at a minimum of 1/16" to re-surface concrete, fill voids and bugholes, and to create a monolithic, paintable surface.

Single Coat: Series 22

22.0 - 27.0 mils*

Total Dry Film Thickness: 22.0 - 27.0 mils

**In order to maintain NSF Std. 61 approval, maximum allowable DFT is 50.0 mils.*

Notes:

1. Series 22 is to be spray applied only.
2. Allow Series 22 to cure for a minimum of 5 days at 75°F prior to service.

4. System No. 20HS-2: Epoxy-Polyamide (Potable Water)

This system meets American Water Works Association AWWA D 102 Inside System No. 1. Series 20HS meets the requirements of approval for potable water use as established by NSF Std 61.

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI CSP 5 or greater.

Apply Tnemec Series 218 to all surfaces at a minimum of 1/16" to re-surface concrete, fill voids and bugholes, and to create a monolithic, paintable surface.

1st Coat: 20-15BL Pota-Pox	4.0 - 6.0 mils
2nd Coat: 20-1255 Pota-Pox Finish	4.0 - 6.0 mils
3rd Coat: 20 -15BL	<u>4.0 - 6.0 mils</u>
Total Dry Film Thickness: 12.0 - 17.0 mils*	
Minimum Dry Film Thickness: 13.0 mils	

**In order to maintain NSF Std. 61 approval, maximum allowable DFT is 18 mils.*

Allow Series 20 to cure for 7 days at 75°F prior to service.

5. System No. 262-1: Modified Polyurethane (Non-Potable Water)

This system is a flexible liner which provides a seamless monolithic membrane for repairing minor leaking in water basins and reservoirs. This system may also be used to span hairline cracks on substrates where movement may occur.

Surface Preparation: Prepare concrete surfaces in accordance with SSPC-SP13/NACE No.6 Joint Surface Preparation Standards and ICRI Technical Guidelines. Mechanically abrade in accordance with SSPC-SP13/NACE No.6 to remove all existing coatings, laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI-CSP 5 or greater.

Apply Tnemec Series 218 Mortarclad Modified Cementitious Mortar to fill all voids and bugholes, and to resurface the entire concrete substrate to a minimum of 1/16".

1st Coat: Series 66 Hi-Build Epoxoline	4.0 - 6.0 mils
2nd Coat: Series 66 Hi-Build Epoxoline	4.0 - 6.0 mils
3rd Coat: Series 262 Elasto-Shield*	<u>65.0 - 75.0 mils</u>
Total Dry Film Thickness: 73.0 - 87.0 mils	
Minimum Dry Film Thickness: 77.0 mils	

** Consult the manufacturer's latest written recommendations and application guide before applying.*

Notes:

1. In order to mitigate outgassing, Series 262 should be applied during periods of declining temperatures.
2. Series 262 Elasto-Shield must be allowed to cure for 2 days before returning to immersion service.

6. System No. 264-1: Modified Polyurethane (Potable Water)

This system is a flexible liner which provides a seamless monolithic membrane **for fixing minor leaking in potable water basins and reservoirs**. This system meets the requirements of approval for potable water use as established by NSF Std 61.

Surface Preparation: Prepare concrete surfaces in accordance with SSPC-SP13/NACE No.6 Joint Surface Preparation Standards and ICRI Technical Guidelines. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all existing coatings, laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI-CSP 5 or greater.

Apply Tnemec Series 218 Mortarclad Modified Cementitious Mortar to fill all voids and bugholes, and to resurface the entire concrete substrate to a minimum of 1/16".

1st Coat: 20 Pota-Pox	4.0 - 6.0 mils
2nd Coat: 20 Pota-Pox	4.0 - 6.0 mils
3rd Coat: 264 Elasto-Shield*	<u>60.0 - 70.0 mils</u>
Total Dry Film Thickness: 68.0 - 82.0 mils	
Minimum Dry Film Thickness: 72.0 mils	

**Consult the manufacturer's latest written recommendations and application guide before applying.*

Notes:

1. In order to mitigate outgassing, Series 264 should be applied during periods of declining temperatures.
2. Allow Series 264 to cure for 14 days at 75°F prior to service in a potable water tank (*For non-potable service, allow to cure for 48 hours at 75°F*).

3.18 CONCRETE FLOORS (RESINOUS FLOORING SYSTEMS)

A. EPOXY FLOOR COATINGS

5. System No. 248-1: Aliphatic Moisture Cured Urethane (Thin Film with Increased Chemical Resistance, UV Stability, and Durability)

This system will provide a durable, long-wearing coating that bonds tightly to concrete and stands up under heavy foot traffic, frequent cleaning, spillage of water, oil, grease, or chemical, and UV Exposure. It is recommended that the 2nd and 3rd coat are the same color.

Moisture vapor transmission should not exceed three lbs per 1,000 ft² in a 24 hour period. (Reference ASTM F 1869 "Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride.") Relative humidity should not exceed 80%. (Reference ASTM F 2170 "Standard Test Method for Determining Relative Humidity in Concrete using in situ Probes.")

Note: For moisture content up to 15 lbs per 1,000 ft² or relative humidity up to 90%, Series 208 should be substituted for Series 201 as the primer. See manufacturer's latest written recommendations for Series 208 coverage rates.

Surface Preparation: Allow new concrete to cure for 28 days.

Mechanically abrade in accordance with NACE No.6/SSPC-SP13 to provide a minimum ICRI-CSP3 or greater surface profile.

1st Coat: Series 201 Epoxoprime	6.0-12.0 mils
2nd Coat: Series 237 Tneme-Glaze	8.0-16.0 mils
3rd Coat: Series 248 Everthane*, tinted with S821 colorant	<u>2.0-3.0 mils*</u>
Total Dry Film Thickness: 16.0- 31.0 mils	
Minimum Dry Film Thickness: 18.0 mils	

**County's Options for the 3^d Coat:*

- *For exterior exposures and increased resistance to ultra-violet light, add Series 44-600 UV Blocker to Series 248.*
- *If a more textured finish is desired, mix Tnemec Series S211-0213 (Fine) Glass Beads into the 3rd Coat. The glass beads are typically added at approximately 4 - 6 oz. per gallon.*

6. System No. 222-1: Decorative Quartz Flooring (Non-Slip)

This system provides a decorative, chemical, abrasion, impact resistant, non-slip, seamless flooring system with a moisture mitigating base coat that **resists up to 20 lbs of moisture vapor pressure, 99% relative humidity, and can be applied on 10-day old concrete.** This floor utilizes clear resins, allowing for visibility of the quartz or other aggregate. For a solid-color floor, tint the 2nd and 3rd coats with Series 820 field tint.

Surface Preparation: Allow new concrete to cure for 10 days. Mechanically abrade in accordance with NACE No.6/SSPC-SP13 to provide a minimum surface profile equal to ICRI-CSP4-5.

1st Coat: 241 Ultra-Tread MVT (Broadcast with Quartz or aggregate of choice)	70 ft ² per small kit
2nd Coat: 222 Deco-Tread (Broadcast with Quartz or aggregate of choice)	1/16"
3rd Coat: 284 Tneme-Glaze (clear)	<u>8.0 - 12.0 mils*</u>
	Minimum Dry Film Thickness: 1/8"

**The degree of slip-resistance is affected by the thickness of the 3rd coat.*

7. System No. 287-1: Waterborne Epoxy-Amine Adduct (Thin-film)

This thin-film system provides a low odor, rapid cure, wear-resistant coating for floors, walls, and other substrates. It is capable of withstanding mild to moderate chemical and solvent exposures and repeated cleanings. **This system may also be used as an overcoat system over well-adhered, unidentified existing coatings.**

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade concrete surfaces in accordance with NACE No.6/SSPC-SP13 to provide an ICRI-CSP 1-3 surface profile.

1st Coat: Series 287 Enviro-Pox	2.0-4.0 mils
2nd Coat: Series 287 Enviro-Pox	<u>2.0-4.0 mils</u>
	Total Dry Film Thickness: 4.0-8.0 mils
	Minimum Dry Film Thickness: 5.0 mils

3.19 GYPSUM WALLBOARD & WOOD

B. GYPSUM WALLBOARD

The coating systems in the GYPSUM WALLBOARD Section are listed in order of decreasing performance with regards to chemical resistance. This generally has an inverse correlation with color & gloss retention. The first system has very good chemical resistance with the highest potential for yellowing, while the last system has extremely poor chemical resistance with the lowest potential for yellowing.

1. System No. N69-1: Polyamidoamine Epoxy (Interior Only)

This system provides a high-solids, low VOC epoxy coating which offers exceptional protection. It offers superior cleanup and stain-, abrasion-, chemical-, and moisture-resistance.

Surface Preparation: Surface must be clean and dry.

1st Coat: Series 151 Elasto-Grip FC	0.7 - 1.5 mils
2nd Coat: Series N69 Hi-Build Epoxoline II	<u>4.0 - 6.0 mils</u>
Total Dry Film Thickness: 4.7 - 7.5 mils	
Minimum Dry Film Thickness: 5.0 mils	

**If brushing or rolling, two coats may be required to achieve the specified film thickness.*

2. System No. 113-2: Acrylic-Epoxy (Interior Only)

This system is designed for mild environments where frequent cleaning is expected. It provides a higher build, low odor, and fade resistant colors. It offers easy cleanup and stain-, abrasion-, chemical-, and moisture-resistance. Note: Series 113 has a satin finish. If a gloss finish is desired, specify Series 114 Tneme-Tufcoat instead.

Surface Preparation: Surface must be clean and dry.

1st Coat: 51PVA Sealer	1.0 - 2.0 mils
2nd Coat: 113 H.B. Tneme-Tufcoat*	<u>4.0 - 6.0 mils</u>
Total Dry Film Thickness: 5.0 - 8.0 mils	
Minimum Dry Film Thickness: 6.0 mils	

**If brushing or rolling, two coats may be required to achieve the specified film thickness.*

3. System No. 1026--3: Acrylic Emulsion (Interior/Exterior Exposure)

This system is designed for mild use areas like office walls, laboratory ceilings, stairwells, etc. Note: Series 1026 has a Matte finish. For a Semi-Gloss finish, specify Series 1029 Enduratone.

Surface Preparation: Surface must be clean and dry.

1st Coat: Series 51PVA Sealer	1.0 - 2.0 mils
1st Coat: Series 1026 Enduratone	2.0 - 3.0 mils
2nd Coat: Series 1026 Enduratone	<u>2.0 - 3.0 mils</u>
Total Dry Film Thickness: 4.0 - 6.0 mils	
Minimum Dry Film Thickness: 5.0 mils	

B. WOOD - EXTERIOR OR INTERIOR EXPOSURE

1. System No. 1029-2: HDP Acrylic Polymer

Series 1029 has a low semi-gloss finish. If a gloss finish is desired, specify Series 1028 Enduratone.

Surface Preparation: Surface shall be clean and dry.

1st Coat: 10-99W Undercoater*	2.0 - 3.0 mils
2nd Coat: 1029 Enduratone	2.0 - 3.0 mils
3rd Coat: 1029 Enduratone	<u>2.0 - 3.0 mils</u>
Total Dry Film Thickness: 6.0 - 9.0 mils	
Minimum Dry Film Thickness: 7.0 mils	

**Allow Series 10 to cure for 3 days before topcoating with Series 1029.*

3.20 HIGH TEMPERATURE COATINGS

C. System No. 1552-1: Acrylic Silicone Copolymer (500°F Maximum)

This system provides heat and corrosion resistance for steel in service environments up to 500°F (315°C). This system has excellent resistance to weathering and UV-light degradation.

Surface Preparation: SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum angular profile of 1.5 mils and a maximum angular anchor profile of 2.0 mils.

1st Coat: Series 1501 Endura-Heat Primer	2.0 - 3.0 mils
2nd Coat: Series 1552 Endura-Heat	<u>2.0 - 3.0 mils</u>
Total Dry Film Thickness: 4.0 - 6.0 mils	
Minimum Dry Film Thickness: 4.5 mils	

D. System No. 1556-1: Modified Silicone Copolymer (1000°F Maximum)

This system provides galvanic protection for steel in service environments up to 1000°F (538°C). The topcoat outperforms conventional high-temperature topcoats with exceptional color stability, resistance to thermal cycling, and cure requirements.

Surface Preparation: SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum angular profile of 1.0 mil and a maximum angular anchor profile of 2.0 mils.

1st Coat: Series 1505 Endura-Heat ZR	2.0 - 3.0 mils
2nd Coat: Series 1556 Endura-Heat	<u>2.0 - 3.0 mils</u>
Total Dry Film Thickness: 4.0 - 6.0 mils	
Minimum Dry Film Thickness: 4.5 mils	

Note: Contractor must follow the manufacturer's most recent written recommendations regarding curing procedures.

E. System No. 1528-1: Inert Multipolymeric Matrix (1200°F Maximum)

This system provides high-performance coating protection to steel and stainless steel substrates in elevated temperatures up to 1200°F (648°C). Excellent adhesion properties allow this system to withstand severe thermal cycling (-300°F to 1200°F), and its tolerance to marginally prepared substrates makes it a viable alternative when abrasive blasting is not permitted. Its dry-fall spray characteristic provides a fast, labor-saving coating

application when used with the appropriate thinner.

Surface Preparation for Exterior Exposure: SSPC-SP6/NACE 3 Commercial Blast Cleaning or ISO Sa 2 Thorough Blast Cleaning with a minimum angular anchor profile of 1.5 mils and a maximum angular anchor profile of 3.0 mils. Note: Abrasive blast cleaning generally produces the best coating performance. If conditions will not permit this, Series 1528 may be applied to SSPCSP2 or SSPC-SP3 Hand or Power Tool Cleaned surfaces in maintenance situations where mill scale has previously been removed.

Surface Preparation for Under Insulation: SSPC-SP10/NACE 2 Near-White Blast Cleaning or ISO Sa 2 1/2 Very Thorough Blast Cleaning is required.

1st Coat: Series 1528 Endura-Heat DTM	6.0 - 8.0 mils
*2nd Coat: Series 1528 Endura-Heat DTM	<u>6.0 - 8.0 mils</u>
Total Dry Film Thickness: 12.0 - 16.0 mils	

**For mild environments, the 2nd Coat may be omitted.*

Note: Contractor must follow the manufacturer's most recent written recommendations regarding curing procedures.

3.21 SURFACES EXPOSED TO H₂S/H₂SO₄ (SEVERE EXPOSURE/IMMERSION)

The systems listed in this section are designed for severe wastewater exposure. Substrates are exposed to submergence and/or intermittent submergence in severe wastewater conditions. Substrates may also be exposed to H₂S Gas and the biogenic sulfide corrosion process associated with severe wastewater conditions.

A. CEMENTITIOUS SURFACES

1. System No. 434-1: Modified Aliphatic Amine Epoxy Mortar

This system is a 100% solids, hybrid epoxy mortar system designed for severe waste water immersion and fume environments. It is specifically formulated to withstand high levels of hydrogen sulfide gas (H₂S), sulfuric acid (H₂SO₄), as well as other gases common to sewer exposures. Aggregate reinforcement provides additional resistance to abrasions and impacts.

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI CSP 5 or greater.

Apply Tnemec Series 218 MortarClad to all surfaces at a minimum of 1/16" to re-surface concrete, fill voids and bugholes, mitigate concrete outgassing, and to create a monolithic, paintable surface.

1st Coat: 434 Perma-Shield	1/8" or 125.0 mils minimum
2nd Coat: 435 Perma-Glaze	<u>18.0 - 20.0 mils</u>
Minimum Dry Film Thickness: 144.0 mils	

Allow coatings to cure for a minimum of 2 days at 75°F prior to service.

2. System No. 436-1: Fiber-Reinforced Modified Polyamine Epoxy

This system provides a thick film, 100% solids, **spray-applied**, high build, abrasion-resistant coating specifically designed for wastewater immersion and fume environments. Provides excellent resistance to H₂S gas permeation, protects against MIC, and provides chemical resistance to severe wastewater environments. Fiber-reinforcement provides superior physical strength and higher film build.

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI CSP 5 or greater.

Apply Tnemec Series 218 MortarClad to all surfaces at a minimum of 1/16" to re-surface concrete, fill voids and bugholes, mitigate concrete outgassing, and to create a monolithic, paintable surface.

One Coat: 436 Perma-Shield FR 80.0 - 125.0 mils
Total Dry Film Thickness: 80.0 - 125.0 mils

Allow coatings to cure for a minimum of 2 days at 75°F prior to service.

B. FERROUS METAL SURFACES

1. System No. 435-1: Modified Polyamine Epoxy

This system provides a versatile, thick film, 100% solids lining specifically designed for wastewater immersion and fume environments. It provides low permeation to H₂S gas, protects against MIC, and provides chemical resistance to severe wastewater environments.

Surface Preparation: SSPC-SP5/NACE No.1 White Metal Blast Cleaning with a minimum 3.0 mil angular anchor profile.

1st Coat: 435 Perma-Glaze 15.0 - 20.0 mils
2nd Coat: 435 Perma-Glaze 15.0 - 20.0 mils
Total Dry Film Thickness: 30.0 - 40.0 mils
Minimum Dry Film Thickness: 33.0 mils

Allow coatings to cure for a minimum of 2 days at 75°F prior to service.

2. System No. 431-1: Modified Polyamine Ceramic Epoxy

This system is to be used in severe wastewater exposures where increased abrasion resistance is desired. It is specifically designed for immersion and fume environments and exposure to corrosive soils. It provides low permeation to H₂S gas, protects against MIC, and provides chemical resistance to steel and ductile iron pipe for severe wastewater or buried exposure. It is a coal-tar free, resin-rich formulation with low pigment volume concentration (PVC) for maximum performance.

Surface Preparation:

Steel - SSPC-SP5/NACE No.1 White Metal Blast Cleaning with a minimum 3.0 mil angular anchor profile.

Ductile Iron Pipe Interiors - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-04: Internal Pipe Surface condition with a minimum 3.0 mil angular anchor profile.

Ductile Iron Pipe Exteriors (Applicable if exposed to H₂S gas) - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-04: External Pipe Surface condition with a minimum 3.0 mil angular anchor profile.

Ductile Iron Fittings Interiors - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-05: Fitting Blast Clean #1 condition with a minimum 3.0 mil angular anchor profile.

Ductile Iron Fittings Exteriors (Applicable if exposed to H₂S gas) - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-05: Fitting Blast Clean #1 condition with a minimum 3.0 mil angular anchor profile.

One Coat*: 431 Perma-Shield PL

40.0 - 50.0 mils

Total Dry Film Thickness: 40.0 - 50.0 mils

Minimum Dry Film Thickness: 40.0 mils

**Series 431 may be applied in two coats to reach the above specified total dry film thickness. Consult the manufacturer's latest written recommendations and application guide before applying this product.*

Allow Series 431 to cure for 48 hours at 75°F prior to service.

3. System Permax-CTF: Amine Cured Novalac Epoxy

This system is to be used in severe wastewater exposures. It provides low chemical resistance to steel and ductile iron pipe for severe wastewater or buried exposure. It is a coal-tar free, minimum 20% by volume ceramic pigmentation, with no less than 97% solids by volume.

Surface Preparation:

Steel - SSPC-SP5/NACE No.1 White Metal Blast Cleaning with a minimum 3.0 mil angular anchor profile.

Ductile Iron Pipe/Fittings Interiors - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-04: Internal Pipe Surface condition with a minimum 3.0 mil angular anchor profile.

Ductile Iron Pipe/Fittings Exteriors (Applicable if exposed to H₂S gas) - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-04: External Pipe Surface condition with a minimum 3.0 mil angular anchor profile

One Coat: Permax-CTF

40.0 - 50.0 mils

Total Dry Film Thickness: 40.0 - 50.0 mils

3.22 EXTERIOR OF PRESTRESSED CONCRETE TANKS

A. System No. 156-2: New Tanks

This system provides exceptional elongation, allowing it fill and bridge minor hairline cracks. It also provides mold & mildew resistance, as well as wind-driven rain resistance.

Surface Preparation: Allow new concrete to cure for at least (3) days. Surface to be clean and dry.

1st Coat: Series 156 Envirocrete	4.0 - 6.0 mils
2nd Coat: Series 156 Envirocrete	4.0 - 6.0 mils
	Total Dry Film Thickness: 8.0 - 12.0 mils
	Minimum Dry Film Thickness: 10.0 mils

B. System No. 156-3: Existing Tanks (Previously Painted)

This system provides exceptional elongation for spanning hairline cracks in concrete structures. It also provides mold & mildew resistance, as well as wind-driven rain resistance. Note: If a textured finish is preferred, replace Series 156 with Series 157 Enviro-Crete TX (medium texture) @ 6.0 - 9.0 mils dry film thickness per coat.

Surface Preparation: Remove all dirt, oil, grease, chalk, and loose paint per high pressure water blast (min. 3500 psi).

1st Coat: 151 Elasto-Grip	0.7 - 1.5 mils
Stripe Coat: Use a brush to fill all hairline cracks with Series 156 Envirocrete*	
Topcoat: 156 Envirocrete	6.0 - 8.0 mils**
	Total Dry Film Thickness: 6.7 - 9.5 mils***
	Minimum Dry Film Thickness: 7.0 mils

**Deeper hairline cracks may require multiple brushed coats.*

***Roller or brush application may require multiple coats to obtain recommended film thickness.*

****Total Dry Film thickness does not include stripe coat.*

3.23 SECONDARY CONTAINMENT AREAS

A. System No. 239SC-1: Modified Novolac Epoxy

This system offers superior chemical resistance to a wide range of aggressive chemicals, including Sulfuric Acid, Hydrofluosilicic Acid, Sodium Hydroxide, Sodium Hypochlorite, Polymer Emulsion, and hydrocarbons. The fiber-reinforced mat within this system provides it with an exceptional ability to bridge the hairline cracks in concrete substrates.

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI CSP 5 or greater.

Moisture vapor transmission should not exceed three lbs per 1,000 ft² in a 24 hour period.

(Reference ASTM F 1869 "Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride.") Relative humidity should not exceed 80%. (Reference ASTM F 2170 "Standard Test Method for Determining Relative Humidity in Concrete using in situ Probes.") Note: For moisture content up to 10 lbs per 1,000 ft² or relative humidity up to 90%, Series 241 may be substituted for the primer. Refer to the Series 241 product data sheet for more information.

Apply Tnemec Series 218 MortarClad to all vertical surfaces at a minimum of 1/16" to re-surface concrete, fill voids and bugholes, and to create a monolithic, paintable surface.

Apply Tnemec Series 215 Surfacing Epoxy or Series 218 as needed to fill voids in horizontal surfaces.

Primer: Tnemec Series 239SC RCK	6.0 - 8.0 mils
Basecoat: Tnemec Series 239SC MCK	60.0 - 80.0 mils
Fiberglass Mat: Tnemec Series 211-0215SC	Embedded
Saturant Coat: Tnemec Series 239SC RCK	10.0 - 12.0 mils
Top Coat: Tnemec Series 282*	<u>8.0 - 10.0 mils</u>
Total Dry Film Thickness: 84.0 - 110.0 mils	

**Series 282 is not color stable. For extended color and gloss retention, apply an extra finish coat of Tnemec Series 290 CRU @ 2.0-3.0 mils DFT.*

Note: See Tnemec's Fiberglass Mat Reinforced Mortar Application Guide for System details.

B. System No. 61-1: Cycloaliphatic Amine Epoxy

This system offers excellent resistance to hydrocarbons and chemicals, such as gasoline, diesel fuel, sodium hydroxide, ferric chloride, and sodium hypochloride. Use Tnemec Series 215 Surfacing Epoxy between coats as a filler and surfacer if required.

Surface Preparation: Allow new concrete to cure for 28 days. Mechanically abrade per SSPC-SP13/NACE No.6 to remove all laitance, fines, curing compounds, form release oils, and other contaminants, and to establish a surface profile equal to ICRI CSP 5 or greater.

Moisture vapor transmission should not exceed three lbs per 1,000 ft² in a 24 hour period. (Reference ASTM F 1869 "Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride.") Relative humidity should not exceed 80%. (Reference ASTM F 2170 "Standard Test Method for Determining Relative Humidity in Concrete using in situ Probes.") Note: For moisture content up to 10 lbs per 1,000 ft² or relative humidity up to 90%, Series 241 may be applied prior to the "Primer" coat. Refer to the Series 241 product data sheet for more information.

Apply Tnemec Series 218 MortarClad to all **vertical** surfaces at a minimum of 1/16" to re-surface concrete, fill voids and bugholes, mitigate concrete outgassing, and to create a monolithic, paintable surface.

Apply Tnemec Series 215 Surfacing Epoxy or Series 218 MortarClad as needed to fill voids in **horizontal** surfaces.

Primer: 61-5002 Tneme-Liner (Beige)	8.0 - 12.0 mils
-------------------------------------	-----------------

Topcoat: 61-5001 Tneme-Liner (Gray)

8.0 - 12.0 mils

Total Dry Film Thickness: 16.0 - 24.0 mils

Minimum Dry Film Thickness: 18 mils

3.24 PIPE EXTERIOR COATING SYSTEMS

The coating systems in the PIPE EXTERIOR COATING SYSTEMS section are not intended for use over bitumastic coatings. Do not apply bitumastic prior to the application of any of these systems.

A. System No. 700-2: Zinc/Epoxy/Fluoropolymer (Ductile Iron Pipes and Fittings at Aerial Crossings or Similarly Difficult to Maintain Areas)

This system provides outstanding resistance to ultra-violet light degradation and extremely good color and gloss retention. This system will have excellent resistance to abrasion and chalking, and is recommended for coastal environments and on structures where extremely long-term maintenance cycles are desired. This system may also be applied to new steel pipes or existing steel pipes which require removal of existing coatings. (Note: Series 700 is gloss. If the Owner desires a semi-gloss finish then Series 700 may be replaced with Series 701.) Note: For single-component application, Series 90G-1K97 may be substituted as the primer.

Surface Preparation:

Steel - SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum 1.5 mil angular anchor profile.

Ductile Iron Pipe - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-04: External Pipe Surface condition.

Ductile Iron Fittings - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-05: Fitting Blast Clean #3 condition.

Primer: Series 90-97 Tneme-Zinc

2.5 - 3.5 mils

2nd Coat: Series 66 Hi-Build Epoxoline

2.0 - 3.0 mils

3rd Coat: Series 700 Hydroflon

2.0 - 3.0 mils

Total Dry Film Thickness: 6.5 - 9.5 mils

Minimum Dry Film Thickness: 8.0 mils

B. System No. N140-2: Epoxy/Epoxy/Epoxy or Urethane (Standard Ductile Iron Pipe and Fittings System - Exposed)

This system provides exceptional corrosion protection in atmospheric environments. This system is to be applied to new ductile iron pipes. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation:

Steel - SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum 1.5 mil angular anchor profile.

Ductile Iron Pipe - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-04: External Pipe Surface condition.

Ductile Iron Fittings - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-05: Fitting Blast Clean #3 condition.

Shop Primer: Series N140 Pota-Pox Plus	2.0 - 10.0 mils
2nd Coat: Series N140 Pota-Pox Plus	4.0 - 10.0 mils
3rd Coat (UV Exposed, Non-immersion Areas Only): Series 1095	<u>2.5 - 5.0 mils</u>
Total Dry Film Thickness: 10.0 - 30.0 mils	
Minimum Dry Film Thickness: 11.0 mils	

C. System No. 46H-413-3: Polyamide Epoxy-Coal Tar (Buried Ductile Iron Pipes and Fittings Only)

This system provides a high-build coating for underground conditions.

Surface Preparation:

Steel - SSPC-SP6/NACE No.3 Commercial Blast Cleaning with a minimum 1.5 mil angular anchor profile.

Ductile Iron Pipe - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-04: External Pipe Surface condition.

Ductile Iron Fittings - Uniformly abrasive blast using angular abrasive to a NAPF 500-03-05: Fitting Blast Clean #3 condition.

1st Coat: Series 46H-413 Hi-Build Tneme-Tar	8.0 - 10.0 mils
2nd Coat: Series 46H-413 Hi-Build Tneme-Tar	<u>8.0 - 10.0 mils</u>
Total Dry Film Thickness: 16.0 - 20.0 mils	
Minimum Dry Film Thickness: 18.0 mils	

D. System No. 1095-5: Acrylic Polyurethane (PVC or HDPE Pipe)

This system provides a user friendly, low VOC, aliphatic acrylic polyurethane coating which offers excellent color and gloss retention. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation: SSPC-SP1 followed by hand or power sanding to thoroughly and uniformly scarify and de-gloss the surface.

1st Coat: Series 66 Hi-Build Epoxoline	2.0 - 3.0 mils
2nd Coat: Series 1095 EnduraShield	<u>2.5 - 5.0 mils</u>
Total Dry Film Thickness: 4.5 - 8.0 mils	
Minimum Dry Film Thickness: 5.0 mils	

E. System No. 1026-4: Acrylic Emulsion (Interior Exposed, Insulated Pipe)

Surface Preparation: Surface shall be clean and dry.

1st Coat: Series 1026 Enduratone	2.0 - 3.0 mils
2nd Coat: Series 1026 Enduratone	<u>2.0 - 3.0 mils</u>
	Total Dry Film Thickness: 4.0 - 6.0 mils
	Minimum Dry Film Thickness: 5.0 mils

F. System No. 700-3: Epoxy Mastic/Fluoropolymer Overcoat (Existing, Previously Coated Aerial Pipes or Similarly Difficult to Maintain Areas)

This system provides outstanding resistance to ultra-violet light degradation and extremely good color and gloss retention. This system will have excellent resistance to abrasion and chalking, and is recommended for coastal environments and on structures where extremely long-term maintenance cycles are desired. This system is to be used for overcoating existing steel pipes whose surfaces have some rust present. (Note: Series 700 is gloss. If the Owner desires a semi-gloss finish then Series 700 may be replaced with Series 701.)

Surface Preparation: High Pressure Water Clean (min. 3500 psi, 3 to 5 gallons per minute, using an oscillating tip and potable water). A cleaning detergent such as Trisodium Phosphate should be used to facilitate cleaning. A degreaser may be required for oil soaked areas or heavily contaminated areas.

Some spot areas may require Hand Tool (SSPC-SP2), Power Tool Cleaning (SSPC-SP3), or Brush Blast (SSPC-SP7/NACE No. 4) to remove loose surface rust.

Existing coatings must be clean, dry and tightly adhering prior to application of coatings.

Spot Prime (Areas of Bare Steel): Series 135 Chembuild	4.0 - 6.0 mils
1st Coat: Series 135 Chembuild	4.0 - 6.0 mils
2nd Coat: Series 700 Hydroflon	<u>2.0 - 3.0 mils</u>
	Total Dry Film Thickness: 6.0 - 9.0 mils*
	Minimum Dry Film Thickness: 7.0 mils

*Does not include Spot Prime or previously existing coatings

G. System No. 1095-6: Epoxy Mastic/Urethane Overcoat (Existing Pipes Previously Coated with High Performance Coatings)

This system can be used over factory finish paint or over non-sandblasted steel and offer the high performance of a urethane coating. Series 1095 has a semi-gloss finish. For a different sheen, apply Series 1094 (gloss) or Series 1096 (eggshell) at the same thickness.

Surface Preparation: High Pressure Water Clean (min. 3500 psi, 3 to 5 gallons per minute, using an oscillating tip and potable water). A cleaning detergent such as Trisodium Phosphate should be used to facilitate cleaning. A degreaser may be required for oil soaked areas or heavily contaminated areas.

Some spot areas may require Hand Tool (SSPC-SP2), Power Tool Cleaning (SSPC-SP3), or Brush Blast (SSPC-SP7/NACE No. 4) to remove loose surface rust.

Existing coatings must be clean, dry, and tightly adhering prior to application of coatings.

Spot Prime (Areas of Bare Steel): Series 135 Chembuild	4.0 - 6.0 mils
1st Coat: Series 135 Chembuild	4.0 - 6.0 mils
2nd Coat: Series 1095 Endura-Shield	<u>2.5 - 5.0 mils</u>
Total Dry Film Thickness: 6.5 - 11.0 mils*	
Minimum Dry Film Thickness: 7.0 mils	

**Does not include spot prime or previously existing coatings.*

3.25 INSULATIVE COATINGS - THERMAL RESISTANCE

A. SUBSTRATES UP TO 325°F

1. System No. 971-1: Personnel Protection

This system utilizes fluid-applied aerogel particles to **provide “safe touch,” allowing a minimum 5 seconds of skin contact with the substrate (up to 325°F).** This system is ideal for hot pipes, valves, tanks, etc. This coating system eliminates the corrosion under insulation (CUI) issues associated with traditional insulations. **This system negates the need for a mineral wool + aluminum jacket system.**

Surface Preparation: SSPC-SP6/NACE No. 3 Commercial Blast Cleaning with a minimum angular anchor profile of 1.5 mils.*

1 st Coat: Series 1224 Epoxoline WB	5.0 - 8.0 mils
2 nd Coat: Series 971 Aerolon Acrylic	50.0 mils
3 rd Coat: Series 971 Aerolon Acrylic	50.0 mils
4 th Coat: Series 72T EnduraShield	<u>2.0 - 5.0 mils</u>
Total Dry Film Thickness: 107.0 - 113.0 mils	
Minimum Dry Film Thickness: 109.0 mils	

**Abrasive blast cleaning generally produces the best coating performance. If conditions will not permit this, Series 1224 may be applied to SSPC-SP2 or SSPC-SP3 Hand or Power Tool Cleaned surfaces.*

B. SUBSTRATES BELOW AMBIENT TEMPERATURE

1. System No. 971-2: Condensation Control (Sweating Substrates)

This system utilizes Series 971's fluid-applied aerogel particles and hydrophobic properties to **mitigate condensation on otherwise wet, “sweating” surfaces.** This is ideal for pipes, valves, and other substrates which have temperatures that create condensation (but do not freeze). **This system negates the need for a mineral wool + aluminum jacket system.**

Surface Preparation: SSPC-SP6/NACE No. 3 Commercial Blast Cleaning with a minimum angular anchor profile of 1.5 mils.*

1 st Coat: Series 1224 Epoxoline WB	5.0 - 8.0 mils
2 nd Coat: Series 971 Aerolon Acrylic	50.0 mils
3 rd Coat: Series 971 Aerolon Acrylic	50.0 mils

4th Coat: Series 72T EnduraShield

2.0 - 5.0 mils

Total Dry Film Thickness: 107.0 - 113.0 mils

Minimum Dry Film Thickness: 109.0 mils

**Abrasive blast cleaning generally produces the best coating performance. If conditions will not permit this, Series 1224 may be applied to SSPC-SP2 or SSPC-SP3 Hand or Power Tool Cleaned surfaces.*

2. System No. 971-3: Condensation Control (Freezing Substrates)

This system utilizes Series 971's fluid-applied aerogel particles and hydrophobic properties to **mitigate condensation on surfaces that would otherwise ice & freeze over**. This is ideal for pipes, valves, and other substrates which have temperatures & condensation that are creating ice on the substrate. This coating system will significantly reduce/eliminate ice formations. **This system negates the need for a mineral wool + aluminum jacket system.**

Surface Preparation: SSPC-SP6/NACE No. 3 Commercial Blast Cleaning with a minimum angular anchor profile of 1.5 mils.*

1st Coat: Series 1224 Epoxoline WB

5.0 - 8.0 mils

2nd Coat: Series 971 Aerolon Acrylic

50.0 mils

3rd Coat: Series 971 Aerolon Acrylic

50.0 mils

4th Coat: Series 971 Aerolon Acrylic

50.0 mils

5th Coat: Series 72T EnduraShield

2.0 - 5.0 mils

Total Dry Film Thickness: 157.0 - 163.0 mils

Minimum Dry Film Thickness: 159.0 mils

**Abrasive blast cleaning generally produces the best coating performance. If conditions will not permit this, Series 1224 may be applied to SSPC-SP2 or SSPC-SP3 Hand or Power Tool Cleaned surfaces.*

3.26 PERFORMANCE CRITERIA

The following shall serve as a basis of comparison for material substitution requests. Any substitutions which decrease the total film thickness, change the generic type of coating, or fail to meet the performance criteria of the specified materials shall not be approved.

- A. Series 1 Omnithane - Zinc/Micaceous Iron Oxide Urethane:
- Adhesion: ASTM D4541 (Method B, Type II) - No less than 1,433 psi (9.88 MPa) adhesion, average of three tests.
 - Salt Spray (Fog): ASTM B117 - No blistering, cracking or delamination of film. No more than .03% rusting on plane and no more than 3/16" rust creepage at scribe after 10,000 hours exposure.
- B. Series 20 Pota-Pox - Polyamide Epoxy:
- Special Qualification: Certified by NSF International in accordance with NSF/ANSI Std. 61.
 - Abrasion: ASTM D4060 (CS-17 Wheel, 1,000 gram load) - No more than 68.5 mg loss after 1,000 cycles with 1,000 gram load, average of three tests
 - Adhesion: ASTM D4541 - No less than 1909.3 psi (13.16 MPa) adhesion after ten freeze/thaw cycles, average of three tests

- Immersion: ASTM D870 - No blistering, cracking, rusting or delamination of the film after 1,500 hours continuous immersion in deionized water at 140°F.
 - Salt Spray: ASTM B117 - No blistering, cracking, rusting or delamination of the film and no creepage at the scribe after 5000 hours
 - Cyclic Salt Fog/UV Exposure: ASTM 5894 - No blistering, cracking, rusting or delamination of the film after 10,000 hours.
- C. Series 22 Epoxoline - Modified Polyamine Epoxy:
- Special Qualification: Certified by NSF International in accordance with NSF/ANSI Std. 61.
 - Product must be able to be applied in one single-coat application from 16.0 to 40.0 mils dry film thickness.
 - VOC Content: 0.10 lbs/gallon (12 grams/litre)
 - Immersion: ASTM 870 - No blistering, cracking, rusting or delamination of film after 2,000 hours continuous immersion in deionized water at 140°F (60°C), average of three tests.
- D. Series 27WB Typoxy - Inorganic Hybrid Water-Based Epoxy:
- Adhesion: ASTM D4541 (Type V Tester) - No less than 1,440 psi (9.93 MPa) pull, average of three tests.
 - Salt Spray: ASTM B117 - No blistering, cracking, rusting or delamination of film. No more than 3/16 inch rust creepage at scribe after 6,200 hours exposure.
- E. Series 46H-413 Hi-Build Tneme-Tar - Polyamide Epoxy-Coal Tar:
- Adhesion: ASTM D4541 - Exceeds the cohesive strength of the concrete substrate (400 psi), average of three tests.
 - Abrasion: ASTM D4060 (CS-17 wheel, 1,000 gram load) - No more than 142 mg loss after 1,000 cycles.
 - Salt Spray (Fog): ASTM B117 - No blistering, cracking, checking, rusting or delamination of film. No rust creepage at scribe after 9,000 hours continuous exposure.
- F. Series 61 Tneme-Liner - Cycloaliphatic Amine Epoxy:
- Chemical Immersion: NACE TM-01-74, Procedure B - No blistering, cracking, rusting or delamination of film after six months continuous immersion.
 - Immersion: ASTM D870 - No blistering, cracking or delamination of film after 12 months continuous immersion in deionized water at 200°F (93°C).
- G. Series 66 Hi-Build Epoxoline - Polyamide Epoxy:
- Salt Spray: ASTM B117 - No blistering, cracking, checking or delamination of film. No more than 1/8" rust creepage at scribe after 8,000 hours exposure.
- H. Series 66 Hi-Build Epoxoline - Polyamide Epoxy:
- Abrasion: ASTM D4060 (CS-17 Wheel, 1,000 gram load) - No More than 68.5 mg loss after 1,000 cycles with 1,000 gram load, average of three tests.
 - Adhesion: ASTM D4541 - No less than 1,909.3 psi (13.16 MPa) adhesion after ten freeze/thaw cycles, average of three trials.
 - Salt Spray: ASTM B117 - No blistering, cracking, rusting or delamination of the film and no creepage at the scribe after 4000 hours
- I. Series 90-97 Tneme-Zinc - Aromatic Zinc-Rich Urethane:
- Zinc Pigment: 83% by weight in dried film

- Adhesion: ASTM D4541 (Type II) - No less than 1,442 psi (9.94 MPa) adhesion, average of three tests.
 - Salt Spray: ASTM B117 - No blistering, cracking or delamination of film. No more than 1/8" creepage at scribe and no more than 1% rusting on plane after 50,000 hours exposure.
- J. Series 94H₂O Hydro-Zinc - Zinc-Rich Aromatic Urethane
- Special Qualification: Certified in accordance with ANSI/NSF Std. 61 for use on interior potable water tanks of 500 gallons or greater.
 - Zinc Pigment: 83% by weight in dried film.
 - Adhesion: ASTM D4541 (Type V Self-Aligning Adhesion Tester): No less than 1,713 psi adhesion, average of three tests.
 - Salt Spray: ASTM B117 - No blistering, cracking or delamination of film. No rusting on plane and no more than 1/16" rust creepage at scribe after 10,000 hours.
- K. Series 104 HS Epoxy - Cycloaliphatic Amine Epoxy:
- Adhesion: ASTM D4541 - No less than 900 psi (6.21 MPa) pull, average of three tests.
 - Chemical Immersion: NACE TM-01-74, Procedure B - No blistering, cracking or delamination of film after seven days.
 - Salt Spray (Fog): ASTM B117 - No blistering, cracking, rusting or delamination of film. No more than 1/32" (.8 mm) rust creepage at scribe after 1,500 hours exposure.
- L. Series 113 Tneme-Tufcoat - Waterborne Acrylic Epoxy:
- Adhesion: ASTM D4541 - No less than 380 psi (2.6 MPa) pull, average of three tests (applied directly to concrete block).
 - Humidity: ASTM D2247 - No blistering, cracking or delamination after 1,000 hours exposure.
- M. Series 115 Uni-Bond DF - Self-Crosslinking Hydrophobic Acrylic:
- Adhesion: ASTM D4541 (Method C - Type V Tester) - No less than 1,472 psi pull (10.15 MPa), average of three tests
 - Salt Spray: ASTM B117 - No more than 1/64" rust creepage at scribe, no more than 3% rusting on plane and no less than a blister rating of 8 after 500 hours exposure.
 - Humidity: ASTM D4585 - No blistering, cracking, rusting or delamination of film after 2,000 hours exposure.
- N. Series 135 Chembuild - Modified Polyamidoamine Epoxy:
- Adhesion: ASTM D4541 (Type II, Method B) - No less than 883 psi (5.86 MPa) pull, average of three tests.
 - Salt Spray: ASTM B117 (Two coats, applied to SSPC-SP10/NACE No.2 Near-White Metal Blast Cleaned steel which was exterior exposed for four months until uniformly rusted, then SSPC-SP2 Hand Tool Cleaned) - No blistering, cracking, rusting or delamination of the film and no creepage at the scribe after 4000 hours
- O. Series N140 Pota-Pox Plus - Polyamidoamine Epoxy:
- Adhesion: ASTM D4541 - No less than 1,943 psi (13.40 MPa) pull, average of three tests.
 - Exterior Exposure: ASTM D1014 - No blistering, cracking, checking, rusting or delamination of film. No rust creepage at scribe after 5 years exposure.
 - Humidity: ASTM D4585 - No blistering, cracking or delamination of film after 10,000 hours exposure.

- Immersion: ASTM D870 - No blistering, cracking, rusting or delamination of film after 2,000 hours continuous immersion in deionized water at 140°F, average of three tests.
 - Salt Spray (Fog): ASTM B117 (2 Coats Series N140) - No blistering, cracking or delamination of film. No more than 1% rusting on plane. No more than 1/16" rust creepage at scribe after 6,700 hours exposure.
 - Salt Spray (Fog): ASTM B117 (Series 91H₂O and 2 Coats Series N140) - No blistering, cracking, checking or delamination of film. No more than 1% rusting on plane and no more than 3/16" rust creepage at scribe after 20,000 hours exposure.
- P. Series 142 Epoxoline - Modified Polyamine Epoxy:
- Adhesion: ASTM D4541 - No less than 2,042 psi (14.08 MPa) pull, average of three tests.
 - Salt Spray (Fog): ASTM B117 - No blistering, cracking, rusting or delamination of film and less than 1/32 inch creepage at the scribe after 5,000 hours exposure.
 - Abrasion: ASTM D4060 - No more than 59.3 mg loss after 1,000 cycles, average of two tests.
- Q. Series 156 Enviro-Crete - Modified Waterborne Acrylate:
- Adhesion: ASTM D7234 - Exceeds the cohesive strength of concrete substrate (400 psi), average of three tests.
 - Salt Spray: ASTM B117 - No blistering, cracking or delamination of film. No visible damage to coating or substrate after 5,000 hours.
 - QUV Exposure: ASTM D4587 (UVA-340 bulbs, 8 hours UV, 4 hours condensation) - No blistering, cracking, chalking or delamination of the film. No less than 69% gloss retention, no more than 1.1 units gloss loss, and no more than 3.59 DE (FMC-2) color change (white) after 5,000 hours QUV exposure.
 - Fungal/Mold/Mildew Resistance: ASTM D3273 - No More than slight mold growth after five weeks exposure.
 - Tensile Strength, Elongation, Modulus of Elasticity: ASTM D2370 - Elongation no less than 200 percent, average of five tests. Tensile strength no less than 250 psi (1.7 MPa), average of three tests.
 - Wind Driven Rain Resistance: FED TT-C-555B, Section 4.4.7.3 - No damage to coating or substrate. No visible moisture on the back of lightweight block after 48 hours exposure.
- R. Series 201 Epoxoprime - Modified Polyamine Epoxy:
- Adhesion: ASTM D4541 - 400 psi (2.8 MPa) pull, average of three tests. 100% Concrete Failure.
 - Compressive Strength: ASTM D695 - 6,866 psi (47.34 MPa) compressive strength unfilled
 - Flexural Strength and Modulus of Elasticity: ASTM D790 - 12,873 psi (88.76 MPa) flexural strength average of five tests. 553,832 psi (3,818.54 MPa) flexural modulus, average of five tests.
 - Tensile Strength: ASTM D638 - 4,871 psi (33.59 MPa) tensile strength, average of five tests.
- S. Series 215 Surfacing Epoxy - Modified Polyamine Epoxy
- Special Qualification: Certified in accordance with ANSI/NSF Std. 61 for use on

interior potable water tanks of 200 gallons or greater at 80 mils DFT

- VOC Content: 0.08 lbs/gallon
- Adhesion: ASTM D7234 (Method B): Exceeds the cohesive strength of the concrete substrate (400 psi).
- Adhesion: ASTM D4541 - Not less than 2,226 psi (15.35 MPa) pull, average of three tests.
- Compressive Strength: ASTM C579 - No less than 9,183 psi (63.3 MPa) compressive strength, average of five tests.
- Flexural Strength and Modulus of Elasticity: C580 - No less than 4,330 psi (29.9 MPa) flexural strength and 324,877 psi (2,240 MPa) flexural modulus of elasticity, average of six tests.
- Flexural Strength and Modulus of Elasticity: ASTM D790 - No less than 10,630 psi (73.29 MPa) flexural strength and 87,440 psi (602.88 MPa) flexural modulus of elasticity, average of three tests.
- Tensile Strength, Elongation, Modulus of Elasticity: ASTM C307 - No less than 2,280 psi (15.72 MPa) tensile strength, average of six tests.
- Tensile Strength, Elongation, Modulus of Elasticity: ASTM D2370 - No less than 2,011 psi (13.86 MPa) tensile strength, 304,213 psi (2,102 MPa) tensile modulus of elasticity and 1.04% elongation, average of ten tests.
- Water Absorption: ASTM C413 - No weight gained after 2 hours continuous boiling water immersion, average of three tests.

T. Series 217 Mortarcrete - Cementitious Repair Mortar:

- VOC Content: 0.0 lbs/gallon
- Compressive Strength: ASTM C579 - No less than 10,650 psi (73.43 MPa) compressive strength, average of three tests.
- Density: ASTM C188 - 2.13 g/cm³ (133 pcf) density.
- Drying Shrinkage: ASTM C596 - No more than 0% drying shrinkage, average of four specimens.
- Set Times: ASTM C266 - Fresh Mortar Properties: Initial Setting Time - 65 minutes; Final Setting Time - 80 minutes.
- Splitting Tensile Strength: ASTM C496 - No less than 850 psi (5.86 MPa) splitting tensile strength, average of three tests.
- Thermal Expansion: ASTM C531 - No more than 7.46 X 10⁻⁶ linear coefficient of thermal expansion in/in/°F, average of three tests.

U. Series 222 Deco-Tread - Colored Quartz-Filled Modified Polyamine Epoxy:

- Compressive Strength: ASTM C579 - 15,567 psi (107.33 MPa) compressive strength.
- Flexural Strength and Modulus of Elasticity: ASTM D790 - No less than 2,867 psi (19.77 MPa) flexural strength and 127,876 psi (881.67 MPa) flexural modulus of elasticity, average of five tests.
- Tensile Strength: ASTM C307 - 2,100 psi (14.5 MPa) tensile strength, average of three tests.
- Thermal Expansion: ASTM C531 - No more than 1.85 x 10⁻⁵ linear coefficient of thermal expansion per °F, average of two rounds of six tests.

V. Series 237 Power-Tread - Modified Polyamine Epoxy:

- Flexural Strength and Modulus of Elasticity: ASTM D790 - 5,274 psi (36.4 MPa) flexural strength and 222,933 psi (1,537 MPa) flexural modulus of elasticity, average of five tests.

- Impact: Mil D3134 - No more than 1/16" permanent indentation. No cracking, checking or delamination of film after 240 in-lb (27 J) direct impact.
- W. Series 239SC Chembloc - Modified Novolac Polyamine Epoxy:
- Chemical Immersion: NACE TM-01-74, Procedure B - No blistering, cracking, rusting or delamination of film after 72 hours continuous contact with chemical.
 - Compressive Strength: ASTM C579 - Not less than 11,195 psi (77.19 MPa) compressive strength, average of six tests.
 - Flexural Strength and Modulus of Elasticity: ASTM D790 - Not less than 6,270 psi (43.23 MPa) flexural strength and 323,900 psi (2,233 MPa) flexural modulus of elasticity, average of five tests.
 - Impact: MIL D3134 (modified using 2.5 lb steel ball) - No more than 1/16" permanent indentation. No cracking, checking or delamination of film after 240 in-lb (27 J) direct impact, average of three tests.
 - Tensile Strength, Elongation, Modulus of Elasticity: ASTM D638 - No less than 7,913 psi (54.56 MPa) tensile strength, 222,975 psi (1,537 MPa) tensile modulus of elasticity and 6.14% elongation at break.
- X. Series 241 Ultra-Tread MVT - Polyurethane Modified Concrete:
- Can be applied to 10 day old concrete
 - Withstands moisture vapor transmission up to 20 lbs per ASTM F1869
 - Withstands relative humidity up to 99% per ASTM F2170
 - Adhesion: ASTM D7234 - Exceeds the cohesive strength of the concrete substrate (~400 psi), average of three tests.
 - Compressive Strength: ASTM C579 - No less than 4,922 psi (33.94 MPa) compressive strength, average of six tests.
 - Flexural Strength and Modulus of Elasticity: ASTM C580 - No less than 2,438 psi (16.81 MPa) flexural strength and 313,614 psi (2,162 MPa) modulus of elasticity (tangent), average of five tests.
 - Tensile Strength: ASTM C307 - No less than 1,015 psi (7.00 MPa) tensile strength, average of six tests.
- Y. Series 248 Everthane - Aliphatic Moisture Cured Urethane:
- Chemical Resistance: TTM-59 (Covered Spot Test) - No blistering, cracking, checking or delamination of film. No more than slight softening or very slight swelling and loss of gloss after 24 hours exposure to the following reagents: 30% Sulfuric Acid, 10% Hydrochloric Acid, 50% Phosphoric Acid, 10% Acetic Acid, 50% Sodium Hydroxide, 10% Ammonium Hydroxide, Methyl Ethyl Ketone, Ethyl Alcohol, Hexane, Xylene, Gasoline, Ethylene Glycol, Skydrol, Brake Fluid, Transmission Fluid, Aviation Gas, Jet Fuel (JP4)
 - Abrasion: ASTM D4060 (CS-17 Wheel, 1,000 gram load) - No more than 18 mg loss after 1,000 cycles, average of three tests.
- Z. Series 262 Elasto-Shield - Modified Polyurethane:
- Abrasion: ASTM D4060 (CS-17 Wheel, 1,000 grams load) - No more than 1.2 mg loss after 1,000 cycles.
 - Deflection Temperature: ASTM D648 - (Minimum use temp) Below -60°F (-15°C).
 - Flexibility and Elongation: ASTM D522 - Must pass 1/8" bend with no cracking or delamination.
 - Tear Strength: ASTM D624 - 150 lbs/inch.

- Tensile Strength, Elongation, Modulus of Elasticity: ASTM D412 - Requirement: (extension to break) 400%. 900 psi.
- AA. Series 264 Elasto-Shield - Modified Polyurethane:
- Special Qualification: Certified by NSF International in accordance with NSF/ANSI Std. 61. Maximum contact area is 20 cm² per litre of water, with minimum allowable size of tanks 5,000 gallons; cold water applications.
 - Abrasion: ASTM D4060 (CS-17 Wheel, 1,000 grams load) - No more than 1.2 mg loss after 1,000 cycles.
 - Deflection Temperature: ASTM D648 - (Minimum use temp) Below -60°F (-15°C).
 - Flexibility and Elongation: ASTM D522 - Must pass 1/8" bend with no cracking or delamination.
 - Tear Strength: ASTM D624 - 180 lbs/inch.
 - Tensile Strength, Elongation, Modulus of Elasticity: ASTM D412 - Requirement: (extension to break) 300%. 1,000 psi.
- BB. Series 282 Tneme-Glaze - Polyamine Novolac Epoxy:
- Chemical Immersion: NACE TM-01-74, Procedure B - No blistering, cracking, rusting or delamination of film after 72 hours continuous contact with chemical.
 - Compressive Strength: ASTM C579 - Not less than 11,195 psi (77.19 MPa) compressive strength, average of six tests.
 - Immersion: 140°F Deionized Water Immersion - No blistering, cracking, rusting or delamination of film after 2,000 hours continuous immersion.
 - Impact: ASTM D2794 - No visible cracking or delamination of film after 59 in/lbs direct impact, average of three tests.
 - Salt Spray (Fog) - ASTM B117 - No blistering, cracking, rusting or delamination of film. No more than 1/16 inch rust creepage at scribe after 3,500 hours exposure.
- CC. Series 284 Deco-Clear - Modified Polyamine Epoxy:
- Coefficient of Friction: ASTM D2047 - 1.2 static coefficient of friction, average of 12 tests.
 - Flexural Strength and Modulus of Elasticity: ASTM D790 - 2,867.1 psi (19.768 MPa) flexural strength average of five tests. 127,876 psi (881.67 MPa) flexural modulus, average of five tests.
 - Impact: ASTM D2794 - 160 inch pounds (18.08 J) average, direct impact.
 - Tensile Strength: ASTM D638 - 2,182.9 psi (15.1 MPa) tensile strength, average of five tests.
- DD. Series 287 Enviro-Pox - Waterborne Epoxy-Amine Adduct:
- Adhesion: ASTM D4541 - Exceeds the cohesive strength of the concrete substrate (400 psi), average of three tests.
 - Impact: ASTM D2794 - No visible cracking or delamination of film after 60 in-lb (6.8 J) direct impact, average of three tests.
 - Abrasion: ASTM D4060 (CS-17 Wheel, 1,000 grams load) - No more than 113.3 mg loss after 1,000 cycles, average of three tests.
- EE. Series 365 Tank Armor - Novolac Epoxy:
- Adhesion: ASTM D4541, Type II - No less than 1,650 psi (11.38 MPa) adhesion, average of three tests.
 - Hardness: ASTM D2240 (Shore D Durometer) - Not less than 90 Shore Type D

hardness, average of five tests.

- FF. Series 431 Perma-Shield PL - Modified Polyamine Ceramic Epoxy:
- Severe Wastewater Analysis Test: ASTM G210 - Initial impedance of 11.18 log-Z at 0.001 Hz (ohms cm²). No blistering, cracking, checking or delamination. No less than 88.7% EIS retention or not more than 1.26 ohms cm² reduction in log-Z electrochemical impedance at 0.001 Hz after 28 days exposure. No less than 2,363 psi (16.30 MPa) adhesion or no loss of adhesion after 28 days in S.W.A.T., average of three tests.
 - Abrasion Resistance: ASTM D4060-14 (CS-17 Wheel, 1,000 cycles, 1,000 gram load) - No more than 41 mg loss, average of three tests.
 - Abrasion Resistance: BS EN 598: 2007+A1: 2009 (Rocking Abrasion) - No more than 0.14 mm (5.5 mils) thickness of coating loss after 1,000,000 cycles.
- GG. System Permax-CTF: Amine Cured Novalac Epoxy
- Abrasion Resistance: ASTM D4060-14 (CS-17 Wheel, 1,000 cycles, 1,000 gram load) - No more than 300 mg loss
- HH. Series 434 Perma-Shield H₂S - Modified Aliphatic Amine Epoxy Mortar:
- Severe Wastewater Analysis Test: ASTM G210 - Initial impedance of 10.6 log-Z at 0.01 Hz (ohms cm²). No blistering, cracking or checking. No less than 86.7% retention or not more than 1.4 ohms cm² reduction in log-Z electrochemical impedance at 0.01 Hz after 28 days exposure.
 - Abrasion Resistance: ASTM D4060 (CS-17 Wheel, 1,000 gram load) - No more than 88 mg loss after 1,000 cycles, average of three tests.
 - Impact: ASTM D2794 - No visible cracking or delamination after 160 inch-pounds (18.1 J) direct impact.
 - Compressive Strength: ASTM D695 - Not less than 12,331 psi (85.0 MPa) compressive strength, average of five tests.
- II. Series 435 Perma-Glaze - Modified Polyamine Epoxy:
- Severe Wastewater Analysis Test: ASTM G210 - Initial impedance of 12.46 log-Z at 0.01 Hz (ohms cm²). No blistering, cracking, checking or delamination. No less than 84.3% retention and no more than 1.95 ohms cm² reduction in electrochemical impedance after 28 days exposure. No less than 93% loss of tensile adhesion after 28 days in S.W.A.T. average of three tests.
 - Abrasion Resistance: ASTM D4060 (CS-17 Wheel, 1,000 gram load) - No more than 72 mg loss after 1,000 cycles, average of three tests.
- JJ. Series 436 Perma-Shield FR - Fiber-Reinforced Modified Polyamine Epoxy:
- Severe Wastewater Analysis Test: ASTM G210 - Initial impedance of 10.2 log-Z at 0.01 Hz (ohms cm²). No blistering, cracking or checking. No less than 83.7% retention or not more than 1.6 ohms cm² reduction in log-Z electrochemical impedance at 0.01 Hz after 28 days exposure.
 - Abrasion: ASTM D4060 (CS-17 Wheel, 1,000 gram load) - No more than 74.6 mg loss after 1,000 cycles, average of three tests.
 - Impact: ASTM D2794 - No visible cracking or delamination of film after 88 inch-pounds direct impact.
 - Compressive Strength: ASTM D695 - No less than 8,866 psi (6.13 MPa) compressive strength, average of five tests.
- KK. Series 446 Perma-Shield MCU - Hydrophobic Aromatic Polyurethane:
- Minimum Time to Return to Immersion Service: 4 Hours

- Severe Wastewater Analysis Test: ASTM G210 - Initial impedance of 10.2 (log-Z). No blistering, cracking, checking or loss of adhesion. No more than 0.1 (log-Z) reduction in electrical impedance after 28 days exposure.
- LL. Series 626 Dur A Pell GS - RTV Silicone Rubber Water & Graffiti Protectant:
- Accelerated Weathering: ASTM C793 - No signs of deterioration except for dirt accumulation after 4,000 hours exposure.
 - Chloride Ion Penetration: AASHTO T-259 - No less than a 1500% reduction in the chloride ion content when compared to untreated concrete, average of two tests.
- MM. Series 662 Prime-A-Pell Plus - Modified Siloxane/Silane with Diffused Quartz Carbide:
- QUV Exposure: ASTM D4587 (UVA-340 bulbs, Cycle 4: 8 hours UV/4 hours condensation) - No reduction in water repellent performance after 5,000 hours exposure.
 - Water Absorption: ASTM C67 (Applied to Ohio Sandstone) - No less than a 96% reduction in water absorption as compared to untreated samples following 24 hours of immersion.
 - Water Absorption: ASTM C97 (Applied to Fire Clay Brick) - No less than a 93% reduction in water absorption as compared to untreated samples following 24 hours of immersion.
 - Water Absorption: ASTM C140 (Applied to Cast Mortar Cubes) - No less than a 96% reduction in water absorption as compared to untreated samples following 24 hours of immersion.
- NN. Series 700 Hydroflon - Advanced Thermoset Solution Fluoropolymer:
- Exterior Exposure: ASTM D1014 (AAMA 2604-98) (South Florida Marine Exposure) - exceeds the exterior weathering requirements of the American Architectural Manufacturers Association (AAMA) 2604-98 standard.
 - Exterior Exposure: ASTM D4141, Method C (EMMAQUA) - No blistering, cracking or chalking. No less than 100% gloss retention, no more than 1 unit gloss loss and no more than 0.23 DEHunter color change (white) after 1,500 MJ/m² (69,109MJ/m² total) EMMAQUA exposure.
 - QUV Exposure: ASTM D4587 - No blistering, cracking or chalking. No less than 61% gloss retention (31.4 units gloss change) and 1.89 DEFMC2 (MacAdam units) color change (white) after 25,000 hours exposure.
 - Xenon Arc Weathering: ASTM D6695 - No blistering, cracking or chalking. No less than 87% gloss retention (11.9 units gloss change) and no greater than 0.37 DE00 color change (white) after 8,000 hours Xenon Arc exposure.
- OO. Series 971 Aerolon - Fluid-Applied Acrylic Insulation Coating:
- Thermal Conductivity: ASTM C518 - Thermal Conductivity shall not be greater than 0.0356 W/m-°K or 0.2468 BTU-in/ft²-hr-°F (R value at one inch equals 4.1).
- PP. Series 1026 Enduratone - Acrylic Emulsion:
- VOC Content: 0.38 lbs/gallon (1.4 grams/litre)
 - QUV Exposure: ASTM D4587 (UVA-340 bulbs, 8 hours UV, 4 hours condensation) - No blistering, cracking, chalking or delamination of film. No less than 49% gloss retention (2.3 units gloss change) and 0.39 DE00 color change after 10,000 hours exposure.
- QQ. Series 1029 Enduratone - HDP Acrylic Polymer:
- Algal Resistance: ASTM D5590 - No more than traces of fungal growth (less than 10%) after three weeks continuous exposure.
 - Fungal/Mold/Mildew Resistance: ASTM D5590 - No more than traces of fungal growth

- (less than 10%) after four weeks continuous exposure.
- QUV Exposure: ASTM D4587 (UVA-340 bulbs, 8 hours UV, 4 hours condensation) - No blistering, cracking or delamination of film. No less than 100% gloss retention, no more than 0.45 DE00 color change and no units gloss loss after 3,000 hours.

RR. Series 1095 Endura-Shield - Aliphatic Acrylic Polyurethane:

- Volatile Organic Compounds (Thinned 5%): 0.77 lbs/gallon (92 grams/litre)
- QUV Exposure: ASTM D4587 (UVA-340 bulbs, 8 hours UV, 4 hours condensation) - No blistering, cracking or delamination. No less than 52% gloss retention or 23 units gloss change and .59 DECIE2000 color change (white) after 2,000 hours exposure.

3.27 SYSTEMS REFERENCE GUIDE

A. STEEL & FERROUS METALS

FERROUS METALS - NON-IMMERSION / EXTERIOR / UV-EXPOSED

- 3.14.A.1 System No. 700-1: Zinc/Epoxy/Fluoropolymer
- 3.14.A.2 System No. 1095-1: Zinc/Epoxy/Urethane
- 3.14.A.3 System No. 1095-2: Epoxy/Epoxy/Urethane
- 3.14.A.4 System No. 1095-3: Epoxy Mastic/Urethane (Overcoat)

EXTERIOR - BELOW GRADE

- 3.14.B.1 System No. N140-1: Epoxy/Epoxy/Epoxy or Urethane
- 3.14.B.2 System No. 46H-413-1: Polyamide Epoxy-Coal Tar

INTERIOR (NON-IMMERSION)

- 3.14.C.1 System No. 66-1: Polyamide Epoxy
- 3.14.C.2 System No. 27WB-1: Inorganic Hybrid WB Epoxy (Overcoat)

IMMERSION

- 3.14.D.1 System No. 104-1: Cycloaliphatic Amine Epoxy (Non-Potable)
- 3.14.D.2 System No. 142-1: Flake / Aluminum Oxide Epoxy (Non-Potable)
- 3.14.D.3 System No. 446-1: Aromatic Polyurethane (Non-Potable)
- 3.14.D.4 System No. 142-2: Methanol
- 3.14.D.5 System No. 365-1: Sulfuric Acid
- 3.14.D.6 System No. 22-1: Modified Polyamine Epoxy (Potable)
- 3.14.D.7 System No. 20-1: Polyamide Epoxy (Potable)

B. OVERHEAD METAL DECKING, JOIST

- 3.15.A System No. 115-1: Self-crosslinking Hydrophobic Acrylic (Interior)
- 3.15.B System No. 1029-1 HDP Acrylic Polymer (Exterior)

C. GALVANIZED STEEL & NONFERROUS METALS

GALVANIZED STEEL, STAINLESS STEEL, ALUMINUM, OR COPPER

- 3.16.A System No. 1095-4: Epoxy/High Build Urethane

ALUMINUM IN CONTACT WITH CONCRETE

3.16.B System No. 46H-413-2: Polyamide Epoxy-Coal Tar

D. CONCRETE & MASONRY

EXTERIOR-ABOVE GRADE (VERTICAL SURFACES)

3.17.A.1 System No. 156-1: Modified Waterborne Acrylate (Elastomeric)
3.17.A.2 System No. 1026-1: Acrylic Emulsion (Non-Elastomeric)
3.17.A.3 System No. 662-1: Clear Silane/Siloxane Sealer (Min. 42% Solids)
3.17.A.4 System No. 626-1: Clear Water Repellent and Graffiti Protectant

EXTERIOR-BELOW GRADE

3.17.B.1 System No. 46H-413-3: Polyamide Epoxy-Coal Tar

INTERIOR (NON-IMMERSION)

3.17.C.1 System No. 104-2: Cycloaliphatic Amine Epoxy
3.17.C.2 System No. 66-2: Polyamide Epoxy
3.17.C.3 System No. 113-1: Acrylic Epoxy
3.17.C.4 System No. 1026-2: Acrylic Emulsion

IMMERSION

3.17.D.1 System No. 104-3: Cycloaliphatic Amine Epoxy (Non-Potable)
3.17.D.2 System No. 142-3: Flake / Aluminum Oxide Epoxy (Non-Potable)
3.17.D.3 System No. 22-2: Modified Polyamine Epoxy (Potable Water)
3.17.D.4 System No. 20-2: Polyamide Epoxy (Potable)
3.17.D.5 System No. 262-1: Modified Polyurethane (Non-Potable Repairs)
3.17.D.6 System No. 264-1: Modified Polyurethane (Potable Repairs)

E. CONCRETE FLOORS (RESINOUS FLOORING SYSTEMS)

3.18.A.1 System No. 248-1: Moisture Cured Urethane (Thin film with increased chemical resistance, UV stability, and durability)
3.18.A.2 System No. 222-1: Decorative / Functional Flooring (Non-Slip)
3.18.A.3 System No. 287-1: Waterborne Epoxy-Amine Adduct (Thin-film)

F. GYPSUM WALLBOARD & WOOD

GYPSUM WALLBOARD

3.19.A.1 System No. N69-1: Polyamidoamine Epoxy
3.19.A.2 System No. 113-2: Acrylic Epoxy
3.19.A.3 System No. 1026-3: Acrylic Emulsion

WOOD - EXTERIOR or INTERIOR EXPOSURE

3.19.B.1 System No. 1029-2: HDP Acrylic Polymer

G. HIGH TEMPERATURE COATINGS

3.20.A System No. 1552-1: Acrylic Silicone Copolymer (500°F Max)
3.20.B System No. 1556-1: Modified Silicone Copolymer (1000°F Max)
3.20.C System No. 1528-1: Silicone Aluminum (1200°F Max)

H. SURFACES EXPOSED TO H₂S/H₂SO₄ (SEVERE EXPOSURE/IMMERSION)

CEMENTITIOUS SURFACES

3.21.A.1 System No. 434-1: Modified Aliphatic Amine Epoxy Mortar
3.21.A.2 System No. 436-1: Fiber-Reinforced Modified Polyamine Epoxy

FERROUS METAL SURFACES

3.21.B.1 System No. 435-1: Modified Polyamine Epoxy
3.21.B.2 System No. 431-1: Modified Polyamine Ceramic Epoxy
3.21.B.3 System Permax-CTF: Amine Cured Novalac Epoxy

I. EXTERIOR OF PRESTRESSED CONCRETE TANKS

3.22.A System 156-2: New Tanks
3.22.B System 156-3: Existing Tanks (Previously Painted)

J. SECONDARY CONTAINMENT AREAS

3.23.A System No. 239SC-1: Modified Novolac Epoxy
3.23.B System No. 61-1: Cycloaliphatic Amine Epoxy

K. PIPE EXTERIOR COATING SYSTEMS

3.24.A System No. 700-2: Zinc/Epoxy/Fluoropolymer (New Aerials)
3.24.B System No. N140-2: Epoxy/Epoxy/Topcoat (Exposed)
3.24.C System No. 46H-413-4: Polyamide Epoxy-Coal Tar (Buried Only)
3.24.D System No. 1095-5: Acrylic Polyurethane (PVC or HDPE Pipe)
3.24.E System No. 1026-4: Acrylic Emulsion (Interior Insulated Pipe)
3.24.F System No. 700-3: Epoxy Mastic/Fluoropolymer (Overcoat)
3.24.G System No. 1095-6: Epoxy Mastic/Urethane (Overcoat)

L. INSULATIVE COATINGS - THERMAL RESISTANCE

SUBSTRATES UP TO 325°F

3.25.A.1 System No. 971-1: Personnel Protection (up to 325°F)

SUBSTRATES BELOW AMBIENT TEMPERATURE

3.25.B.1 System No. 971-2: Condensation Control (Sweating)
3.25.B.2 System No. 971-3: Condensation Control (Freezing/Icing)

3.28 COATING SCHEDULE - TO BE DEVELOPED BY PROJECT AS NEEDED

END OF SECTION

SECTION 09970 SURFACE PROTECTION SPRAY SYSTEM

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. The Contractor shall furnish all labor, materials, equipment and incidentals required to install and test the coating system complete and ready for operation for the structures listed in the specifications and as shown on the Drawings.
- B. The work includes coating of all surfaces as shown and specified on the Drawings. This includes, but is not limited to stairs, walls, floors, concrete divider, concrete slabs, manholes wet wells, and all other work obviously required to be coated unless otherwise specified herein or on the Drawings. The omission of minor items in the Schedule of Work shall not relieve the Contractor of his obligation to include such items where they come within the general intent of the Specification as stated herein.

1.02 RELATED WORK

- A. Bypass pumping is the responsibility of the General Contractor.
- B. Concrete surface cleaning in each lift station/manhole is the responsibility of the General contractor.
- C. Removal and offsite disposal of rubble is the responsibility of the General Contractor.

1.03 SUBMITTALS

- A. Submit to the County shop drawings and schedules of all surfacing systems and appurtenances required. Submit design data and specification data sheets listing all parameters used in the surfacing system design and thickness calculations based on applicable provisions of ASTM.
- B. Submit to the County the name of the surfacing supplier, a list of materials to be furnished, and the qualification per 1.05A of the application contractor.

1.04 REFERENCE STANDARDS

- A. American Society for Testing and Materials (ASTM)
ASTM D-638
ASTM D-790
- B. Where reference is made to one of the above standards, the revision in effect at the time of bid opening shall apply.

1.05 QUALIFICATIONS

- A. The Contractor performing the surfacing work shall be fully qualified, experienced a minimum of seven years and equipped to complete this work expeditiously and in a satisfactory manner. The Contractor shall submit the following information to the County for review and approval before any surfacing work is performed.
 - 1. The number of years of experience in performing this type of specialized work must be seven years minimum.
 - 2. Name of the surfacing manufacturer and supplier for this work and previous work listed below. The Contractor shall be an approved installer as certified and licensed by the surfacing manufacturer and equipment supplier.
 - 3. A list of clients that the Contractor has performed this type of work for.
 - a. The list shall contain names and telephone numbers of persons who can be called to verify previous satisfactory performance.
 - b. Installation dates and a description of the actual work performed.
 - c. The surfacing manufacturer shall provide an installation list of product used for similar sewer rehabilitation projects. The list shall provide the same information as required in paragraphs 3.a and 3.b above.
- B. The County reserves the right to approve or disapprove the Contractor, based on the submitted qualifications.

1.06 GUARANTEE

All surfacing shall be guaranteed by the Contractor for a period of five years from the date of acceptance. During this period, all defects discovered in the surfacing, as determined by the County, shall be repaired or replaced in a satisfactory manner at no cost to the County, this shall include, but is not limited to, all work and costs associated with the shut down of any pump stations and all bypass operations needed for the proper repairs to be made.

1.07 QUALITY ASSURANCE

- A. All surfacing products shall be from a single manufacturer. The supplier shall be responsible for the provisions of all test requirements specified in ASTM Standards D-638 and D-790 as applicable.
- B. The Contractor shall employ specialty workers who have proven ability to perform the Work included herein. This will consist of a minimum of two years or two project experiences installing this product. This is a requirement for each and every employee.

1.08 DELIVERY, STORAGE AND HANDLING

- A. Care shall be taken in shipping, handling and placing to avoid damaging. Any material damaged in shipment shall be replaced as directed by the County.
- B. Any material showing deterioration, or which has been exposed to any other adverse storage condition that may have caused damage, even though no such damage can be

seen, shall be marked as rejected and removed at once from the work.

PART 2 PRODUCTS

2.01 GENERAL

- A. The material sprayed onto the surface shall be a urethane resin system formulated for the application within a sanitary sewer environment. The urethane will exhibit suitable corrosion resistance to corrosive gases and fluids found within domestic sanitary sewage. Unless dictated by varying effluent, the spray system shall be a urethane and exhibit the cured physical strengths specified herein.
- B. When cured, the surface coating shall form a continuous, tight-fitting, hard, impermeable surfacing data which is suitable for sewer system service and chemically resistant to any chemicals or vapors normally found in domestic sewage.
- C. The surface shall be an integral part of the structure being rehabilitated after being placed and cured. The surface shall cover the complete interior of the existing structure. The surface shall provide a continuous watertight seal or barrier.
 - 1. The surface shall effectively seal the interior surfaces of the structure and prevent any penetration or leakage of groundwater infiltration.
 - 2. Provide water resistance data on surface based on ASTM Standards.
 - 3. The surface shall be compatible with the thermal conditions of existing sewer lift stations and manholes. Surface temperature will range from 30 to 80 degrees F. Provide test data on thermal compatibility based on ASTM Standards.

2.02 MATERIALS

- A. Refer to the latest edition of the County's Approved Products List for Approved materials
- B. Polyurethane spray application shall comply with the following specifications:

The cured urethane system shall conform to the minimum physical standards, as listed below. The long-term data is for a 50-year design life of the process.

<u>Cured Urethane</u>	<u>Standard</u>	<u>Long-Term Data</u>
Tensile Stress	ASTM D-638	5,000 psi
Flexural Stress	ASTM D-790	10,000 psi
Flexural Modulus	ASTM D-790	550,000 psi

- C. Epoxy spray application shall be 100% VOC free / 100% solids.

PART 3 EXECUTION

3.01 SURFACE PREPARATION

- A. The Contractor shall clean each structure and shall dispose of any resulting material.
- B. All contaminants including: oils, grease, incompatible existing coatings, waxes, form release, curing compounds, efflorescence, sealers, salts, or other contaminants shall be removed.
- C. All concrete or mortar that is not sound or has been damaged by chemical exposure shall be removed to a sound concrete surface or replaced.
- D. Surface preparation method(s) should be based upon the conditions of the substrate, service environment and the requirements of the protective coating to be applied.
- E. Surfaces to receive protective coating shall be cleaned and abraded to produce a sound surface with adequate profile and porosity to provide a strong bond between the protective coating and the substrate. Generally, this can be achieved with a high pressure water cleaning using equipment capable of 5,000 psi at 4 gpm. Other methods such as abrasive blasting, shotblasting, grinding, scarifying or acid etching may also be used. Detergent water cleaning and hot water blasting may be necessary to remove oils, grease or other hydrocarbon residues from the concrete. Whichever method(s) are used, they shall be performed in a manner that provides a uniform, sound clean neutralized surface that is not excessively damaged.
- F. A concrete structure suitably prepared for coating shall have all loose, soft, discolored or otherwise deteriorated material removed from the manhole and the surface profile of the manhole shall be in accordance with ICRI Guidelines No. 03732. Expose aggregate and obtain a uniform surface texture resembling an ICRI - CPS (Concrete Surface Profile) #4-6. The County may use one or more of the following observations/tests to determine whether the manhole substrate has been properly cleaned and prepared:
 - a. Visual appearance of the manhole - The prepared substrate shall have the appearance of sound concrete, free from discolored, white, chalky and cracked areas.
 - b. Aural observations - When struck with a metal hammer or similar metal tool, the prepared substrate shall exhibit the characteristic sound of solid, competent concrete (or brick). Care should be taken not to fracture sound concrete.
 - c. Mechanical abrasion tests - The substrate should be competent enough such that it cannot be scraped off with the claw of a hammer or similar metal tool.
 - d. pH testing - The County may use wetted litmus paper applied to the surface of the substrate to ensure that the pH of the substrate is 7 or higher.
 - e. Phenolphthalein testing - The County may apply a few drops of phenolphthalein to the surface of the concrete, which if the concrete is competent should yield a purple color.
- G. The County is not obligated to use all of the above tests, but may do so at the County's sole discretion. Often visual, mechanical and/or aural observations and tests alone will be adequate, but the pH and/or phenolphthalein tests may be used if there is still some uncertainty.
- H. If after cleaning, a new or existing manhole does not meet these requirements, the County shall have authority to require additional cleaning effort and/or increased blasting pressure as required to adequately prepare the manhole. If necessary, the County may also require acid etching of the concrete surface to create the desired texture. For existing manholes, the

County may also require mechanical removal of deteriorated concrete or other substrate materials.

- I. A mild chlorine solution may be used to neutralize the surface to diminish microbiological bacteria growth prior to final rinse and coating system if approved by the Manufacturer's Representative.
- J. The time between structure cleaning and preparation activities and application of the first coating layer shall be within the coating manufacturer's recommendation.
- K. All infiltration shall be stopped by using a material which is compatible with and is suitable for topcoating with the specified protective coating.
- L. The area between the manhole and the manhole ring and any other area that might exhibit movement or cracking due to expansion and contraction, shall be grouted with a flexible grout or gel before surface coating spray application.
- M. All surfaces should be inspected by the Inspector during and after preparation and before the repair material is applied.
- N. No separate payment shall be made for any preparatory work required prior to application of the surface coating.

3.02 INSTALLATION

- A. The Contractor shall notify the Project Manager at least 48 hours in advance, giving the date, start time and estimated completion time for the work being conducted.
- B. The Contractor shall provide bypass pumping of sewage flows (as required) where and when the rehabilitation work is being performed. No flows will be permitted in the structure until the spray coating has properly cured to the manufactures specifications.
- C. The installation of the surface coating shall be in complete accordance with the applicable provisions of ASTM and the manufacturer's specifications. A representative of the manufacturer shall be present during the actual installation.
 - 1. Prior to placing the surface coating, the manufacturer's representative must approve the surface preparation work and installation conditions including temperatures.
 - 2. All surfaces shall be sufficiently smooth and even, to ensure good flow handling characteristics when complete.
 - 3. All surfaces shall have the surface coating applied to the required thickness by spray application.
- D. Application procedures shall conform to the recommendations of the protective coating manufacturer, including material handling, mixing, environmental controls during application, safety, and spray equipment.
- E. The spray equipment shall be specifically designed to accurately ratio and apply the specified protective coating materials and shall be regularly maintained and in proper working order.

- F. The protective coating material must be spray applied by a Certified Applicator of the protective coating manufacturer.
- G. Polyurethane spray application shall be applied such that all surfaces shall be coated in accordance with the manufacturer's recommended thickness but not be less than 125 mils.
- H. Epoxy spray application shall be applied such that all surfaces shall be coated in accordance with the following:

- 1. Specified surfaces shall be coated by spray application of a moisture tolerant, solvent-free, 100% solids, epoxy protective coating as further described herein. Spray application shall be to a minimum wet film thickness in accordance with the following table or manufacturer's recommendation, whichever is greater:

Concrete, New/Smooth	80-100 mils for immersion, 60-80 mils for atmospheric, splash and spill exposure
Concrete, Rough	100-125+ mils
Masonry/Brick	125-150+ mils
Steel	16-80 mils for immersion, 16-40 mils for atmospheric, splash and spill exposure; also profile dependent
Fiberglass Systems	40-60 mils tack coat, 9 oz/yd ² fabric, 40-60 mils top coat. Varies with circumstances

- 2. Airless spray application equipment approved by the coating manufacturer shall be used to apply each coat of the protective coating. Air assisted spray application equipment may be acceptable, especially for thinner coats (<10 mils), only if the air source is filtered to completely remove all oil and water.
- 3. If necessary, subsequent topcoating or additional coats of the protective coating should occur as soon as the basecoat becomes tack free, ideally within 12 hours but no later than the recoat window for the specified products. Additional surface preparation procedures will be required if this recoat window is exceeded.

3.03 FIELD TESTING AND ACCEPTANCE

- A. Field acceptance of surface coatings shall be based on the County's evaluation of the proper surfacing of the structure and the appropriate installation and curing test data along with review of the structure inspections.
- B. The surface coatings shall provide a continuous monolithic surfacing with uniform thickness throughout the structure interior. If the thickness of the coating surface is not uniform or is less than specified, it shall be repaired or replaced at no additional cost to the County.
 - 1. The County will measure the surface cured thickness from a specimen retrieved by the Contractor. The Contractor shall retrieve the specimen by physically cutting

through the surfacing (by drilling or coring). There will be up to three thickness measurement locations in each structure. A suitable non-destructive type of thickness measurement may also be used.

2. All the surface coating thickness measurement locations shall be repaired by the Contractor in accordance with the manufacturer's recommendations. These repairs shall be included in the five year surface coating guarantee.
- C. All pipe connections shall be open, clear, and watertight.
- D. There shall be no cracks, voids, pinholes, uncured spots, dry spots, lifts, delaminations or other type defects.
- E. If any defective surface coating is discovered after it has been installed, it shall be repaired or replaced in a satisfactory manner within 72 hours and at no additional cost to the County. This requirement shall apply for the entire five year guarantee period.

END OF SECTION

BID ATTACHMENT 3, PLAN SET / DRAWINGS

NOTE - This attachment is uploaded as a separate document on the Procurement page of the County website with the solicitation document and available for download.

SECTION D, SAMPLE CONSTRUCTION AGREEMENT WITH GENERAL CONDITIONS OF THE CONSTRUCTION AGREEMENT AND AGREEMENT EXHIBITS

CONSTRUCTION AGREEMENT

for

STIPULATED SUM

between

MANATEE COUNTY (AS OWNER)

and

_____ (AS CONTRACTOR)

**CONSTRUCTION AGREEMENT FOR
STIPULATED SUM
[PROJECT NAME]**

THIS AGREEMENT (“Agreement”) is made and entered into by and between Manatee County, a political subdivision of the State of Florida, referred to herein as “Owner”, and the firm of _____, incorporated in the State of _____ and registered and licensed to do business in the State of Florida (license # _____), referred to herein as “Contractor.”

WHEREAS, the Owner intends to construct **[PROJECT DESCRIPTION]**, the aforementioned improvements being hereinafter referred to and defined as the “Project”; and

WHEREAS, in response to Owner’s Invitation for Bid Construction No. _____ (the “IFBC”), Contractor has submitted its Bid (the “Contractor’s Bid”) to provide the aforementioned construction services.

NOW THEREFORE, the Owner and the Contractor, in consideration of the mutual covenants hereinafter set forth, the sufficiency of which is hereby acknowledged, agree as follows:

1. Contract Documents. The Contract Documents consist of this Agreement and attached Exhibits, the attached General Conditions of the Construction Agreement, Supplementary Conditions (if any), Special Conditions (if any), Drawings (the titles of which are attached hereto as Exhibit A), Specifications (the titles of which are attached hereto as Exhibit B), Addenda issued prior to execution of this Agreement, the Invitation for Bid (including any Instructions to Bidders, Scope of Work, Bid Summary, Supplements, and Technical Specifications), any interpretations issued pursuant to the Invitation for Bid, the Contractor’s Bid, permits, notice of intent to award, Notice to Proceed, purchase order(s), any other documents listed in this Agreement, and Modifications [to include written Amendment(s), Change Order(s), Work Directive Change(s) and Field Directive(s)] issued after execution of this Agreement. These form the Agreement, and are as fully a part of the Agreement as if attached or repeated herein. This Agreement represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations or agreements, either written or oral. No other documents shall be considered Contract Documents.

2. Work. The Contractor shall fully execute the Work described in the Contract Documents, except to the extent specifically indicated in the Contract Documents to be the responsibility of others.

3. Date of Commencement and Substantial Completion.

A. Date of Commencement. The date of commencement of the Work shall be the date fixed in a Notice to Proceed issued by the Owner.

B. Contract Time. The Contract Time shall be measured from the date of commencement.

C. Substantial Completion. The Contractor shall achieve Substantial Completion of the entire Work not later than ___ days from the date of commencement, or as follows:

Portion of Work	Substantial Completion Date
------------------------	------------------------------------

subject to adjustments of this Contract Time as provided in the Contract Documents.

Time is of the essence in the Contract Documents and all obligations thereunder. If the Contractor fails to achieve Substantial Completion of the Work within the Contract Time and as otherwise required by the Contract Documents (to include not only the entire Work but any portion of the Work as set forth above), the Owner shall be entitled to retain or recover from the Contractor, as liquidated damages and not as a penalty, the sum of \$_____ per calendar day, commencing upon the first day following expiration of the Contract Time and continuing until the actual date of Substantial Completion. Such liquidated damages are hereby agreed to be a reasonable estimate of damages the Owner will incur because of delayed completion of the Work. The Owner may deduct liquidated damages as described in this paragraph from any unpaid amounts then or thereafter due the Contractor under this Agreement. Any liquidated damages not so deducted from any unpaid amounts due the Contractor shall be payable to the Owner at the demand of the Owner, together with interest from the date of the demand at the maximum allowable rate.

4. Contract Sum.

A. Payment. The Owner shall pay the Contractor the Contract Sum in current funds for the Contractor's performance of the Contract. The Contract Sum shall be _____ Dollars and Zero Cents (\$_____), subject to additions and deductions as provided in the Contract Documents.

B. Alternates. The Contract Sum is based upon the following alternates, if any, which are described in the Contract Documents and are hereby accepted by the Owner. *(State the numbers or other identification of accepted alternates. If decisions on other alternates are to be made by the Owner subsequent to the execution of this Agreement, attach a schedule of such other alternates showing the amount for each and the date when that amount expires.)*

C. Unit Prices. Unit prices, if any, are reflected in the Contractor's Bid.

5. Payments.

A. Progress Payments.

(1) Based upon Applications for Payment submitted to the Architect/Engineer by the Contractor and Certificates for Payment issued by the Architect/Engineer, the Owner shall make progress payments on account of the Contract Sum to the Contractor as provided below and elsewhere in the Contract Documents.

- (2) The period covered by each Application for Payment shall be one calendar month ending on the last day of the month.
- (3) Payments shall be made by Owner in accordance with the requirements of Section 218.735, Florida Statutes.
- (4) Each Application for Payment shall be based on the most recent schedule of values submitted by the Contractor in accordance with the Contract Documents. The schedule of values shall allocate the entire Contract Sum among the various portions of the Work. The schedule of values shall be prepared in such form and supported by such data to substantiate its accuracy as the Architect/Engineer may require. This schedule, unless objected to by the Owner or Architect/Engineer, shall be used as a basis for reviewing the Contractor's Applications for Payment.
- (5) Applications for Payment shall indicate the percentage of completion of each portion of the Work as of the end of the period covered by the Application for Payment.
- (6) Subject to other provisions of the Contract Documents, the amount of each progress payment shall be computed as follows:
 - i. Take that portion of the Contract Sum properly allocable to completed Work as determined by multiplying the percentage completion of each portion of the Work by the share of the Contract Sum allocated to that portion of the Work in the schedule of values, less retainage of five percent (5.00%). Pending final determination of cost to the Owner of changes in the Work, amounts not in dispute shall be included as provided in Section 3.3.B. of the General Conditions;
 - ii. Add that portion of the Contract Sum properly allocable to materials and equipment delivered and suitably stored at the site for subsequent incorporation in the completed construction (or, if approved in advance by the Owner, suitably stored off the site at a location agreed upon in writing), supported by paid receipts, less retainage of five percent (5.00%);
 - iii. Subtract the aggregate of previous payments made by the Owner; and
 - iv. Subtract amounts, if any, for which the Architect/Engineer has withheld or nullified an Application for Payment, in whole or in part as provided in Section 3.3.C. of the General Conditions.
- (7) The progress payment amount determined in accordance with Section 5.A(6) shall be further modified under the following circumstances:

- i. Add, upon Substantial Completion of the Work, a sum sufficient to increase the total payments to the full amount of the Contract Sum, less such amounts as the Architect/Engineer shall determine for incomplete Work, retainage applicable to such work and unsettled claims.
- ii. Add, if final completion of the Work is thereafter materially delayed through no fault of the Contractor, any additional amounts payable in accordance with Section 3.2.B. of the General Conditions.

(8) Reduction or limitation of retainage, if any, shall be as follows:

Notwithstanding the foregoing, upon completion of at least 50% of the Work, as determined by the Architect/Engineer and Owner, the Owner may, with the concurrence of the Architect/Engineer, reduce to two and one-half percent (2.5%) the amount of retainage withheld from each subsequent progress payment.

(9) Except with the Owner's prior approval, the Contractor shall not make advance payments to suppliers for materials or equipment which have not been delivered and stored at the site.

B. Final Payment. Final Payment, constituting the entire unpaid balance of the Contract Sum, shall be made by the Owner to the Contractor when:

(1) The Contractor has fully performed the Work except for the Contractor's responsibility to correct Work as provided in Section 2.4.C. of the General Conditions, and to satisfy other requirements, if any, which extend beyond final payment; and

(2) A final Application for Payment has been approved by the Architect/Engineer.

6. Termination or Suspension.

A. Termination. The Agreement may be terminated by the Owner or the Contractor as provided in Article XIV of the General Conditions.

B. Suspension by Owner. The Work may be suspended by the Owner as provided in Article XIV of the General Conditions.

7. Other Provisions.

A. Substantial Completion Defined. Substantial Completion shall be defined as provided in Article I of the General Conditions. In the event a temporary certificate of occupancy or completion is issued establishing Substantial Completion, the Contractor shall diligently pursue the issuance of a permanent certificate of occupancy or completion.

B. Project Meetings. There shall be a project meeting, at the jobsite or other location acceptable to the parties, on a regularly scheduled basis. The meeting will be attended by a representative of the Contractor, Architect/Engineer and Owner. These representatives shall be authorized to make decisions that are not otherwise contrary to the requirements of this Agreement.

C. Weather. Any rainfall, temperatures below 32 degrees Fahrenheit or winds greater than 25 m.p.h. which actually prevents Work on a given day, shall be considered lost time and an additional day added to the Contract Time, provided no work could be done on site, and provided written notice has been submitted to the Owner by the Contractor documenting same.

D. Shop Drawings; Critical Submittals. In consideration of the impact of timely review of submittals and shop drawings on the overall progress of the Work, it is hereby agreed that the Owner shall cause his agents and design professionals to accomplish the review of any particular "critical" submittals and/or shop drawings and return same to the Contractor within fourteen (14) days.

E. Applications for Payment. Applications for Payment shall be submitted once monthly at regular intervals and shall include detailed documentation of all costs incurred.

F. Punch List. Within 30 days after obtainment of Substantial Completion, the Owner shall generate a "punch list" of all work items requiring remedial attention by the Contractor. Within 5 days thereafter the Architect/Engineer shall assign a fair value to the punch list items, which sum shall be deducted from the next scheduled progress payment to the Contractor. Upon satisfactory completion of the punch list items, as certified by the Architect/Engineer, the previously deducted sum shall be paid to the Contractor.

G. Closeout documentation. Within 30 days after obtainment of Substantial Completion and before final payment, Contractor shall gather and deliver to Owner all warranty documentation, all manufacturer's product and warranty literature, all manuals (including parts and technical manuals), all schematics and handbooks, and all as-built drawings.

H. Governing Provisions; Conflicts. In the event of a conflict between this Agreement and the Specifications or as between the General Conditions and the Specifications, the Specifications shall govern.

I. E-Verify. The Contractor's employment of unauthorized aliens is a violation of Section 274(e) of the Federal Immigration and Employment Act. The Contractor shall utilize the U.S. Department of Homeland Security E-Verify system to verify the employment eligibility of all new employees hired during the term of this Agreement, and shall require the same verification procedure of all Subcontractors.

8. Insurance and Bonding. If and to the extent required by the Invitation for Bid documents, the Contractor shall furnish insurance coverage for (but not necessarily limited to) workers' compensation, commercial general liability, auto liability, excess liability, and builder's risk. The Contractor shall furnish to the Owner all appropriate policies and Certificate(s) of Insurance. The Contractor shall also post a Payment and Performance Bond for the Contract Sum, within ten (10) days following notification of intent to award, and otherwise in accordance with the Invitation for Bid documents.

9. Independent Contractor. The Contractor acknowledges that it is functioning as an independent contractor in performing under the terms of this Agreement, and it is not acting as an employee of the Owner.

10. Entire Agreement. This Agreement (inclusive of the Contract Documents incorporated herein by reference) represents the full agreement of the parties.

11. Amendments; Waivers; Assignment.

A. Amendments. This Agreement may be amended only pursuant to an instrument in writing that has been jointly executed by authorized representatives of the parties hereto.

B. Waivers. Neither this Agreement nor any portion of it may be modified or waived orally. However, each party (through its governing body or properly authorized officer) shall have the right, but not the obligation, to waive, on a case-by-case basis, any right or condition herein reserved or intended for the benefit or protection of such party without being deemed or considered to have waived such right or condition for any other case, situation, or circumstance and without being deemed or considered to have waived any other right or condition. No such waiver shall be effective unless made in writing with an express and specific statement of the intent of such governing body or officer to provide such waiver.

C. Assignment. The rights and obligations of either party to this Agreement may be assigned to a third party only pursuant to a written amendment hereto.

12. Validity. Each of the Owner and Contractor represents and warrants to the other its respective authority to enter into this Agreement.

13. Covenant to Defend. Neither the validity of this Agreement nor the validity of any portion hereof may be challenged by any party hereto, and each party hereto hereby waives any right to initiate any such challenge. Furthermore, if this Agreement or any portion hereof is challenged by a third party in any judicial, administrative, or appellate proceeding (each party hereby covenanting with the other party not to initiate, encourage, foster, promote, cooperate with, or acquiesce to such challenge), the parties hereto collectively and individually agree, at their individual sole cost and expense, to defend in good faith its validity through a final judicial determination or other resolution, unless all parties mutually agree in writing not to defend such challenge or not to appeal any decision invalidating this Agreement or any portion thereof.

14. Disclaimer of Third-Party Beneficiaries; Successors and Assigns. This Agreement is solely for the benefit of the parties hereto, and no right, privilege, or cause of action shall by reason hereof accrue upon, to, or for the benefit of any third party. Nothing in this Agreement is intended or shall be construed to confer upon or give any person, corporation, partnership, trust, private entity, agency, or other governmental entity any right, privilege, remedy, or claim under or by reason of this Agreement or any provisions or conditions hereof. This Agreement shall be binding upon, and its benefits and advantages shall inure to, the successors and assigns of the parties hereto.

15. Construction.

A. Headings and Captions. The headings and captions of articles, sections, and paragraphs used in this Agreement are for convenience of reference only and are not intended to define or limit their contents, nor are they to affect the construction of or be taken into consideration in interpreting this Agreement.

B. Legal References. All references to statutory sections or chapters shall be construed to include subsequent amendments to such provisions, and to refer to the successor provision of any such provision. References to “applicable law” and “general law” shall be construed to include provisions of local, state and federal law, whether established by legislative action, administrative rule or regulation, or judicial decision.

16. Severability. The provisions of this Agreement are declared by the parties hereto to be severable. In the event any term or provision of this Agreement shall be held invalid by a court of competent jurisdiction, such invalid term or provision should not affect the validity of any other term or provision hereof; and all such terms and provisions hereof shall be enforceable to the fullest extent permitted by law as if such invalid term or provision had never been part of this Agreement; provided, however, if any term or provision of this Agreement is held to be invalid due to the scope or extent thereof, then, to the extent permitted by law, such term or provision shall be automatically deemed modified in order that it may be enforced to the maximum scope and extent permitted by law.

17. Governing Law; Venue. This Agreement shall be governed by the laws of the State of Florida. Venue for any petition for writ of certiorari or other court action allowed by this Agreement shall be in the Circuit Court of the Twelfth Judicial Circuit in and for Manatee County, Florida.

18. Attorney’s Fees and Costs. In any claim dispute procedure or litigation arising from this Agreement, each party hereto shall be solely responsible for paying its attorney’s fees and costs.

19. Notices. All notices, comments, consents, objections, approvals, waivers, and elections under this Agreement shall be in writing and shall be given only by hand delivery for which a receipt is obtained, or certified mail, prepaid with confirmation of delivery requested, or by electronic mail with delivery confirmation. All such communications shall be addressed to the applicable addressees set forth below or as any party may otherwise designate in the manner prescribed herein.

To the Owner: _____

Email: _____

To the Contractor: _____

Email: _____

Notices, comments, consents, objections, approvals, waivers, and elections shall be deemed given when received by the party for whom such communication is intended at such party's address herein specified, or such other physical address or email address as such party may have substituted by notice to the other.

20. Public Records Law. The Contractor shall comply with the Florida Public Records Act (Chapter 119, Florida Statutes), and shall:

- A. Keep and maintain public records required by the Owner to perform the services called for in this Agreement.
- B. Upon request from the Owner's custodian of public records, provide the Owner with a copy of the requested records or allow the records to be inspected or copied within a reasonable time at a cost that does not exceed the cost provided in Chapter 119, Florida Statutes or as otherwise provided by law.
- C. Ensure that public records that are exempt or confidential and exempt from public records disclosure requirements are not disclosed except as authorized by law for the duration of this Agreement and following completion of this Agreement if the Contractor does not transfer the records to the Owner.
- D. Upon completion of this Agreement, transfer, at no cost, to the Owner all public records in possession of the Contractor or keep and maintain such public records. If the Contractor transfers all public records to the Owner upon completion of the Agreement, the Contractor shall destroy any duplicate public records that are exempt or confidential and exempt from public records disclosure requirements. If the Contractor keeps and maintains public records upon completion of the Agreement, the Contractor shall meet all applicable requirements for retaining public records. All records stored electronically must be provided to the Owner, upon request from the Owner's custodian of public records, in a format that is compatible with the information technology systems of the Owner.

IF THE CONTRACTOR HAS QUESTIONS REGARDING THE APPLICATION OF CHAPTER 119, FLORIDA STATUTES, TO THE CONTRACTOR'S DUTY TO PROVIDE PUBLIC RECORDS RELATING TO THIS AGREEMENT, CONTACT THE OWNER'S CUSTODIAN OF PUBLIC RECORDS AT 941-748-4501, EXT. 5845; DEBBIE.SCACCIANOCE@MYMANATEE.ORG; POST OFFICE BOX 1000, BRADENTON, FLORIDA 34206.

21. Exhibits. Exhibits to this Agreement are as follows:

Exhibit A—Title(s) of Drawings

Exhibit B—Title(s) of Specifications

Exhibit C—Affidavit of No Conflict

Exhibit D—Certificate(s) of Insurance

Exhibit E—Payment and Performance Bond

Exhibit F—Standard Forms

- 1—Application for Payment
- 2—Certificate of Substantial Completion
- 3—Final Reconciliation / Warranty / Affidavit
- 4—Change Order

SAMPLE

WHEREFORE, the parties hereto have executed this Agreement as of the date last executed below.

Name of Contractor

By: _____

Printed Name: _____

Title: _____

Date: _____

MANATEE COUNTY, a political subdivision
of the State of Florida

By: _____

Printed Name: _____

Title: _____

Date: _____

SAMPLE

GENERAL CONDITIONS
of the
CONSTRUCTION AGREEMENT

SAMPLE

TABLE OF CONTENTS FOR GENERAL CONDITIONS

	<u>Page</u>
Article I -- Definitions.....	GC-1
1.1 Definitions.....	GC-1
A. Acceptance	GC-1
B. Application for Payment.....	GC-1
C. Architect/Engineer	GC-1
D. Change Order	GC-1
E. Construction Services.....	GC-1
F. Construction Team	GC-1
G. Contract Sum.....	GC-1
H. Contract Time.....	GC-1
I. Contractor's Personnel.....	GC-1
J. Days	GC-1
K. Defective.....	GC-2
L. Field Directive.....	GC-2
M. Final Completion Date.....	GC-2
N. Float Time	GC-2
O. Force Majeure	GC-2
P. Notice to Proceed	GC-2
Q. Owner	GC-2
R. Owner's Project Representative.....	GC-2
S. Payment and Performance Bond.....	GC-2
T. Permitting Authority.....	GC-2
U. Procurement Ordinance	GC-2
V. Progress Report.....	GC-2
W. Project	GC-2
X. Project Costs	GC-3
Y. Project Manager.....	GC-3
Z. Project Plans and Specifications.....	GC-3
AA Project Schedule	GC-3
BB. Project Site.....	GC-3
CC. Subcontractor	GC-3
DD. Substantial Completion and Substantially Complete.....	GC-3
EE. Substantial Completion Date	GC-3
FF. Substitute.....	GC-3
GG. Unit Price Work	GC-4
HH. Work.....	GC-4
II. Work Directive Change.....	GC-4
Article II -- Relationship and Responsibilities	GC-4
2.1 Relationship between Contractor and Owner	GC-4
A. Purpose.....	GC-4
B. Construction Team	GC-4
C. Owner's Reliance on Bid (or GMP).....	GC-4

2.2	General Contractor Responsibilities	GC-5
	A. Personnel.....	GC-5
	B. Cooperation with Architect/Engineer.....	GC-5
	C. Timely Performance	GC-5
	D. Duty to Defend Work.....	GC-5
	E. Trade and Industry Terminology.....	GC-5
2.3	Project Schedule.....	GC-6
2.4	Construction Services	GC-7
	A. Construction of Project	GC-7
	B. Notice to Proceed	GC-7
	C. Quality of Work	GC-7
	D. Materials	GC-7
	E. Accountability for Work.....	GC-7
	F. Contract Sum.....	GC-8
	G. Governing Specifications	GC-8
	H. Adherence to Project Schedule	GC-8
	I. Superintendent.....	GC-8
	J. Work Hours	GC-8
	K. Overtime-Related Costs.....	GC-8
	L. Insurance, Overhead and Utilities	GC-9
	M. Cleanliness.....	GC-9
	N. Loading.....	GC-9
	O. Safety and Protection	GC-9
	P. Emergencies	GC-10
	Q. Substitutes	GC-10
	R. Surveys and Stakes	GC-10
	S. Suitability of Project Site	GC-11
	T. Project Specification Errors	GC-11
	U. Remediation of Contamination	GC-11
	V. Interfacing	GC-12
	W. Job Site Facilities	GC-13
	X. Weather Protection.....	GC-13
	Y. Performance and Payment Bond	GC-13
	Z. Construction Phase; Building Permit; Code Inspections	GC-13
	(1) Building Permit	GC-13
	(2) Code Inspections	GC-14
	(3) Contractor's Personnel	GC-14
	(4) Lines of Authority	GC-14
	AA. Quality Control	GC-14
	BB. Management of Subcontractors	GC-15
	CC. Job Requirements	GC-15
	DD. As-Built Drawings	GC-17
	EE. Progress Reports	GC-17
	FF. Contractor's Warranty.....	GC-17
	GG. Apprentices.....	GC-18
	HH. Schedule of Values	GC-18
	II. Other Contracts.....	GC-18
Article III -- Compensation.....		GC-18
3.1	Compensation	GC-18

A. Adjustments.....	GC-18
B. Valuation	GC-18
C. Unit Price Work	GC-19
3.2 Schedule of Compensation.....	GC-19
A. Periodic Payments for Services	GC-19
B. Payment for Materials and Equipment	GC-19
C. Credit toward Contract Sum	GC-19
3.3 Invoice and Payment.....	GC-20
A. Invoices.....	GC-20
B. Additional Information; Processing of Invoices	GC-20
C. Architect/Engineer's Approval.....	GC-20
D. Warrants of Contractor with Respect to Payments	GC-20
E. All Compensation Included	GC-20
Article IV -- Subcontractors.....	GC-21
4.1 Subcontracts.....	GC-21
A. Subcontracts Generally	GC-21
B. No Damages for Delay	GC-21
C. Subcontractual Relations	GC-21
D. Insurance; Acts & Omissions.....	GC-22
4.2 Relationship and Responsibilities	GC-22
4.3 Payments to Subcontractors; Monthly Statements.....	GC-22
A. Payment	GC-22
B. Final Payment of Subcontractors	GC-22
4.4 Responsibility for Subcontractors.....	GC-22
4.5 Contingent Assignment of Subcontracts.....	GC-23
Article V -- Changes in Work	GC-23
5.1 General.....	GC-23
5.2 Minor Changes in the Work.....	GC-23
5.3 Emergencies.....	GC-24
5.4 Concealed Conditions	GC-24
5.5 Hazardous Materials	GC-24
5.6 Change Orders; Adjustments to Contract Sum	GC-25
A. Change Orders Generally	GC-25
5.7 Owner-Initiated Changes	GC-25
5.8 Unauthorized Work.....	GC-25
5.9 Defective Work.....	GC-25
5.10 Estimates for Changes.....	GC-26
5.11 Form of Proposed Changes.....	GC-26
5.12 Changes to Contract Time.....	GC-26
Article VI -- Role of Architect/Engineer	GC-26
6.1 General.....	GC-26
A. Retaining.....	GC-26
B. Duties.....	GC-26
C. Termination	GC-26
6.2 Administration	GC-27

A. <i>Site Visits</i>	GC-27
B. <i>Reporting</i>	GC-27
6.3 Interpretation of Project Plans and Specifications	GC-27
6.4 Rejection of Non-Conforming Work	GC-27
6.5 Correction of Work	GC-27
6.6 Timely Performance of Architect/Engineer	GC-28
Article VII -- Owner's Rights and Responsibilities	GC-28
7.1 Project Site; Title	GC-28
7.2 Project Plans and Specifications; Architect/Engineer	GC-28
7.3 Surveys; Soil Tests and Other Project Site Information	GC-28
7.4 Information; Communication; Coordination.....	GC-29
7.5 Governmental Body	GC-29
7.6 Pre-Completion Acceptance	GC-29
7.7 Ownership and Use of Drawings, Specifications and Other Instruments of Service.....	GC-29
7.8 Owner's Project Representative.....	GC-30
A. <i>Responsibilities</i>	GC-30
B. <i>Limitations</i>	GC-31
Article VIII -- Resolution of Disagreements; Claims for Compensation	GC-31
8.1 Owner to Decide Disputes	GC-31
8.2 Finality	GC-31
8.3 No Damages for Delay.....	GC-31
8.4 Permitted Claims Procedure.....	GC-32
8.5 Contract Claims and Disputes.....	GC-32
8.6 Claims for Consequential Damages.....	GC-33
Article IX -- Indemnity	GC-33
9.1 Indemnity	GC-33
A. <i>Indemnification Generally</i>	GC-33
B. <i>Indemnification; Enforcement Actions</i>	GC-33
C. <i>Claims by Employees</i>	GC-33
9.2 Duty to Defend.....	GC-33
Article X-- Accounting Records; Ownership of Documents	GC-33
10.1 Accounting Records.....	GC-34
10.2 Inspection and Audit	GC-34
10.3 Access	GC-34
10.4 Ownership of Documents.....	GC-34
Article XI -- Public Contract Laws	GC-35
11.1 Equal Opportunity Employment	GC-35
A. <i>Employment</i>	GC-35
B. <i>Participation</i>	GC-35
11.2 Immigration Reform and Control Act of 1986	GC-35
11.3 No Conflict of Interest	GC-35

A. <i>No Interest in Business Activity</i>	GC-35
B. <i>No Appearance of Conflict</i>	GC-36
11.4 Truth in Negotiations	GC-36
11.5 Public Entity Crimes	GC-36
Article XII-- Force Majeure, Fire or Other Casualty	GC-36
12.1 Force Majeure	GC-36
A. <i>Unavoidable Delays</i>	GC-36
B. <i>Concurrent Contractor Delays</i>	GC-36
C. <i>Notice; Mitigation</i>	GC-36
12.2 Casualty; Actions by Owner and Contractor	GC-37
12.3 Approval of Plans and Specifications	GC-37
12.4 Notice of Loss or Damage	GC-37
Article XIII -- Representations, Warranties and Covenants	GC-38
13.1 Representations and Warranties of Contractor	GC-38
13.2 Representations of the Owner	GC-40
Article XIV -- Termination and Suspension	GC-41
14.1 Termination for Cause by Owner.....	GC-41
A. <i>Nonperformance</i>	GC-41
B. <i>Insolvency</i>	GC-42
C. <i>Illegality</i>	GC-42
D. <i>Rights of Owner</i>	GC-42
14.2 Termination without Cause by Owner	GC-42
A. <i>Release of Contractor</i>	GC-43
B. <i>Waiver of Protest</i>	GC-43
14.3 Suspension without Cause	GC-43
14.4 Termination Based Upon Abandonment, Casualty or Force Majeure	GC-43
14.5 Vacation of Project Site; Delivery of Documents	GC-43
14.6 Termination by the Contractor	GC-44

GENERAL CONDITIONS
ARTICLE I
DEFINITIONS

1.1 Definitions. For purposes of the Contract Documents, the following terms shall have the following meanings.

A. Acceptance: The acceptance of the Project into the Owner's operating public infrastructure.

B. Application for Payment: The form approved and accepted by the Owner, which is to be used by Contractor in requesting progress payments or final payment and which is to include such supporting documentation as is required by the Contract Documents.

C. Architect/Engineer: _____, a _____ corporation or limited liability company, registered and licensed to do business in the State of Florida, OR _____, an employee of Owner.

D. Change Order: A written order signed by the Owner, the Architect/Engineer and the Contractor authorizing a change in the Project Plans and/or Specifications and, if necessary, a corresponding adjustment in the Contract Sum and/or Contract Time, pursuant to Article V.

E. Construction Services: The Construction Services to be provided by Contractor pursuant to Section 2.4, in accordance with the terms and provisions of the Contract Documents.

F. Construction Team: The working team established pursuant to Section 2.1.B.

G. Contract Sum: The total compensation to be paid to the Contractor for Construction Services rendered pursuant to the Contract Documents, as set forth in Contractor's Bid (or Guaranteed Maximum Price Addendum), unless adjusted in accordance with the terms of the Contract Documents

H. Contract Time: The time period during which all Construction Services are to be completed pursuant to the Contract Documents, to be set forth in the Project Schedule.

I. Contractor's Personnel: The Contractor's key personnel designated by Contractor.

J. Days: Calendar days except when specified differently. When time is referred to in the Contract Documents by days, it will be computed to exclude the first and include the last day of such period. If the last day of any such period falls on a Saturday or Sunday or legal holiday, such day will be omitted from the computation.

K. Defective: When modifying the term “Work”, referring to Work that is unsatisfactory, faulty or deficient, or does not conform to the Contract Documents, or that does not meet the requirements of any inspection, reference standard, test or approval referred to in the Contract Documents, or that has been damaged prior to Owner’s approval of final payment (unless responsibility for the protection thereof has been assumed by Owner).

L. Field Directive: A written order issued by Owner which orders minor changes in the Work not involving a change in Contract Time, to be paid from the Owner’s contingency funds.

M. Final Completion Date: The date upon which the Project is fully constructed and all Work required on the Project and Project Site is fully performed as verified in writing by the Owner.

N. Float Time: The time available in the Project Schedule during which an unexpected activity can be completed without delaying Substantial Completion of the Work.

O. Force Majeure: Those conditions constituting excuse from performance as described in and subject to the conditions described in Article XII.

P. Notice to Proceed: Written notice by Owner (after execution of Contract) to Contractor fixing the date on which the Contract Time will commence to run and on which Contractor shall start to perform the Work.

Q. Owner: Manatee County, a political subdivision of the State of Florida.

R. Owner’s Project Representative: The individual designated by Owner to perform those functions set forth in Section 7.8.

S. Payment and Performance Bond: The Payment and Performance Bond security posted pursuant to Section 2.4.Y to guarantee payment and performance by the Contractor of its obligations hereunder.

T. Permitting Authority: Any applicable governmental authority acting in its governmental and regulatory capacity which is required to issue or grant any permit, certificate, license or other approval which is required as a condition precedent to the commencement or approved of the Work, or any part thereof, including the building permit.

U. Procurement Ordinance: The Manatee County Procurement Code, Chapter 2-26 of the Manatee County Code of Laws, as amended from time to time.

V. Progress Report: A report to Owner that includes all information required pursuant to the Contract Documents and submitted in accordance with Section 2.4.EE, hereof.

W. Project: The total construction of which the Work performed under the Contract Documents may be the whole or a part and which may include construction by Owner and by separate contractors. For the purposes of the Contract Documents, the term Project shall

include all areas of proposed improvements and all areas which may reasonably be judged to have an impact on the Project.

X. Project Costs: The costs incurred by the Contractor to plan, construct and equip the Project and included within, and paid as a component of, the Contract Sum.

Y. Project Manager: Subject to the prior written consent of Owner, the individual designated to receive notices on behalf of the Contractor, or such other individual designated by the Contractor, from time to time, pursuant to written notice in accordance with the Contract Documents.

Z. Project Plans and Specifications: The one hundred percent (100%) construction drawings and specifications prepared by the Architect/Engineer, and any changes, supplements, amendments or additions thereto approved by the Owner, which shall also include any construction drawings and final specifications required for the repair or construction of the Project, as provided herein.

AA. Project Schedule: The schedule and sequence of events for the commencement, progression and completion of the Project, developed pursuant to Section 2.3., as such schedule may be amended as provided herein.

BB. Project Site: The site depicted in the Project Plans and Specifications, inclusive of all rights of way, temporary construction easements or licensed or leased sovereign lands.

CC. Subcontractor: Any individual (other than a direct employee of the Contractor) or organization retained by Contractor to plan, construct or equip the Project pursuant to Article IV.

DD. Substantial Completion and Substantially Complete: The stage in the progress of the Work when the Work or designated portion thereof is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use; provided, however, that as a condition precedent to Substantial Completion, the Owner has received all certificates of occupancy or completion and other permits, approvals, licenses, and other documents from any governmental authority which are necessary for the beneficial occupancy of the Project or any designated portion thereof.

EE. Substantial Completion Date: The date on which the Project or designated portion thereof is deemed to be Substantially Complete, as evidenced by receipt of (i) the Architect/Engineer's certificate of Substantial Completion, (ii) written Acceptance of the Project by the Owner, and (iii) approvals of any other authority as may be necessary or otherwise required.

FF. Substitute: Materials or equipment offered by the Contractor as an alternative to that set forth in the Project Plans and Specifications, where (i) the Project Plans and Specifications do not authorize an "approved equal", or (ii) the Owner, in its reasonable discretion, determines that a pre-authorized "approved equal" will result in a substantial change to the Work because of cost, quality or other difference in comparison to the materials or equipment specified.

GG. Unit Price Work: Work to be paid for on the basis of unit prices.

HH. Work: The term “Work” means the construction and services required by the Contract Documents, whether completed or partially completed, and includes all labor, materials, equipment and services provided or to be provided by the Contractor to fulfill the Contractor’s obligations. The Work may constitute the whole or a part of the Project.

II. Work Directive Change: A written directive to Contractor, issued on or after the effective date of the Agreement pursuant to Section 5.8 and signed by Owner’s Project Representative, ordering an addition, deletion or revision in the Work, or responding to differing or unforeseen physical conditions under which the Work is to be performed or responding to emergencies.

ARTICLE II RELATIONSHIP AND RESPONSIBILITIES

2.1 Relationship between Contractor and Owner. The Contractor accepts the relationship of trust and confidence established with Owner pursuant to the Contract Documents. The Contractor shall furnish its best skill and judgment and cooperate with Owner and Owner’s Project Representative in furthering the interests of the Owner. The Contractor agrees to provide the professional services required to complete the Project consistent with the Owner’s direction and the terms of the Contract Documents. All services provided hereunder by Contractor, either directly or through Subcontractors, shall be provided in accordance with sound construction practices and applicable professional construction standards.

A. Purpose. The purpose of the Contract Documents is to provide for the provision of construction services for the Project on the Project Site by the Contractor, and construction of the Project by the Contractor in accordance with the Project Plans and Specifications. The further purpose of the Contract Documents is to define and delineate the responsibilities and obligations of the parties to the Contract Documents and to express the desire of all such parties to cooperate to accomplish the purposes and expectations of the Contract Documents.

B. Construction Team. The Contractor, Owner and Architect/Engineer shall be called the “Construction Team” and shall work together as a team commencing upon full execution of the Contract Documents through Substantial Completion. As provided in Section 2.2, the Contractor and Architect/Engineer shall work jointly through completion and shall be available thereafter should additional services be required. The Contractor shall provide leadership to the Construction Team on all matters relating to construction. The Contractor understands, acknowledges and agrees that the Architect/Engineer shall provide leadership to the Construction Team on all matters relating to design.

C. Owner’s Reliance on Bid (or Guaranteed Maximum Price Addendum). The Contractor acknowledges that the representations, statements, information and pricing contained in its Bid (or Guaranteed Maximum Price Addendum) have been relied upon by the Owner and have resulted in the award of this Project to the Contractor.

2.2 General Contractor Responsibilities. In addition to the other responsibilities set forth herein, the Contractor shall have the following responsibilities pursuant to the Contract Documents:

A. Personnel. The Contractor represents that it has secured, or shall secure, all personnel necessary to perform the Work, none of whom shall be employees of the Owner. Primary liaison between the Contractor and the Owner shall be through the Owner's Project Representative and Contractor's Project Manager. All of the services required herein shall be performed by the Contractor or under the Contractor's supervision, and all personnel engaged in the Work shall be fully qualified and shall be authorized or permitted under law to perform such services.

B. Cooperation with Architect/Engineer. The Contractor's services shall be provided in conjunction with the services of the Architect/Engineer. In the performance of professional services, the Contractor acknowledges that time is critical for Project delivery. The Contractor acknowledges that timely construction utilizing the services of an Architect/Engineer and a Contractor requires maximum cooperation between all parties.

C. Timely Performance. The Contractor shall perform all services as expeditiously as is consistent with professional skill and care and the orderly progress of the Work, in accordance with the Project Schedule. Verification of estimated Project Schedule goals will be made as requested by the Owner.

D. Duty to Defend Work. In the event of any dispute between the Owner and any Permitting Authority that relates to the quality, completeness or professional workmanship of the Contractor's services or Work, the Contractor shall, at its sole cost and expense, cooperate with the Owner to defend the quality and workmanship of the Contractor's services and Work.

E. Trade and Industry Terminology. It is the intent of the Contract Documents to describe a functionally complete Project (or part thereof) to be constructed in accordance with the Contract Documents. Any Work, materials or equipment that may reasonably be inferred from the Contract Documents as being required to produce the intended result will be supplied whether or not specifically called for. When words which have a well-known technical or trade meaning are used to describe Work, materials, or equipment, such words shall be interpreted in accordance with that meaning. Reference to standard specifications, manuals or codes of any technical society, organization or association, or to the laws or regulations of any governmental authority, whether such reference be specific or by implication, shall mean the latest standard specification, manual, code or laws or regulations in effect at the time of opening of Bids (or at the time of execution of the Guaranteed Maximum Price Addendum), except as may be otherwise specifically stated. However, no provision of any referenced standard specification, manual or code (whether or not specifically incorporated by reference in the Contract Documents) shall be effective to change the duties and responsibilities of Owner or Contractor, or any of their agents or employees from those set forth in the Contract Documents. Computed dimensions shall govern over scaled dimensions.

2.3 Project Schedule. The Contractor, within ten (10) days after being awarded the Agreement, shall prepare and submit for the Owner's and Architect/Engineer's information a Contractor's construction schedule for the Work. The schedule shall not exceed time limits current under the Contract Documents, shall be revised at appropriate intervals as required by the conditions of the Work and Project, shall be related to the entire Project to the

extent required by the Contract Documents, and shall provide for expeditious and practicable execution of Work.

- A. The Project Schedule shall show a breakdown of all tasks to be performed, and their relationship in achieving the completion of each phase of Work, subject to review of Owner and Architect/Engineer and approval or rejection by Owner. The Project Schedule shall show, at a minimum, the approximate dates on which each segment of the Work is expected to be started and finished, the proposed traffic flows during each month, the anticipated earnings by the Contractor for each month and the approximate number of crews and equipment to be used. The Project Schedule shall include all phases of procurement, approval of shop drawings, proposed Change Orders in progress, schedules for Change Orders, and performance testing requirements. The Project Schedule shall include a construction commencement date and Project Substantial Completion Date, which dates shall accommodate known or reasonably anticipated geographic, atmospheric and weather conditions.
- B. The Project Schedule shall serve as the framework for the subsequent development of all detailed schedules. The Project Schedule shall be used to verify Contractor performance and to allow the Owner's Project Representative to monitor the Contractor's efforts.
- C. The Project Schedule may be adjusted by the Contractor pursuant to Article V. The Owner shall have the right to reschedule Work provided such rescheduling is in accord with the remainder of terms of the Contract Documents.
- D. The Contractor shall prepare a submittal schedule, promptly after being awarded the Agreement and thereafter as necessary to maintain a current submittal schedule, and shall submit the schedule(s) for the Architect/Engineer's approval. The Architect/Engineer's approval shall not be unreasonably delayed or withheld. The submittal schedule shall (1) be coordinated with the Contractor's construction schedule, and (2) allow the Architect/Engineer reasonable time to review submittals. If the Contractor fails to submit a submittal schedule, the Contractor shall not be entitled to any increase in Contract Sum or extension of Contract Time based on the time required for review of submittals.
- E. The Contractor shall perform the Work in general accordance with the most recent schedules submitted to the Owner and Architect/Engineer.

2.4 Construction Services. The Contractor shall provide the following Construction Services:

- A. Construction of Project. The Contractor shall work from the receipt of a Notice to Proceed through the Substantial Completion of the Project in accordance with the terms of the Contract Documents to manage the construction of the Project. The Construction Services provided by the Contractor to construct the Project shall include without limitation (1) all services

necessary and commensurate with established construction standards, and (2) all services described in the Invitation for Bid (or Request for Proposal) and the Bid (or Guaranteed Maximum Price Addendum).

B. Notice to Proceed. A Notice to Proceed may be given at any time within thirty (30) days after the effective date of the Agreement. Contractor shall start to perform the Work on the date specified in the Notice to Proceed, but no Work shall be done at the site prior to the issuance of the Notice to Proceed.

C. Quality of Work. If at any time the labor used or to be used appears to the Owner as insufficient or improper for securing the quality of Work required or the required rate of progress, the Owner may order the Contractor to increase its efficiency or to improve the character of its Work, and the Contractor shall conform to such an order. Any such order shall not entitle Contractor to any additional compensation or any increase in Contract Time. The failure of the Owner to demand any increase of such efficiency or any improvement shall not release the Contractor from its obligation to secure the quality of Work or the rate of progress necessary to complete the Work within the limits imposed by the Contract Documents. The Owner may require the Contractor to remove such personnel as the Owner deems incompetent, careless, insubordinate or otherwise objectionable, or whose continued employment on the Project is deemed to be contrary to the Owner's interest. The Contractor shall provide good quality workmanship and shall promptly correct construction defects without additional compensation. Acceptance of the Work by the Owner shall not relieve the Contractor of the responsibility for subsequent correction of any construction defects.

D. Materials. All materials and equipment shall be of good quality and new, except as otherwise provided in the Contract Documents. If required by Architect/Engineer, Contractor shall furnish satisfactory evidence (including reports of required tests) as to the kind and quality of materials and equipment. All materials and equipment shall be applied, installed, connected, erected, used, cleaned and conditioned in accordance with the instruction of the applicable supplier except as otherwise provided in the Contract Documents.

E. Accountability for Work. The Contractor shall be solely accountable for its Work, including plans review and complete submittals. The Contractor shall be solely responsible for means, methods, techniques, sequences and procedures of construction. If a specific means, method, technique, sequence or procedure of construction is required by the Contract Documents, the Contractor may utilize an alternative means, method, technique, sequence or procedure acceptable to the Architect/Engineer if the Contractor submits sufficient information to allow the Architect/Engineer to determine that the alternative is equivalent to that required by the Contract Documents.

F. Contract Sum. The Contractor shall construct the Project so that the Project can be built for a cost not to exceed the Contract Sum.

G. Governing Specifications. In the absence of specified Owner design standards or guidelines, the Architect/Engineer shall use, and the Contractor shall comply with, the most recent version of the applicable FDOT or AASHTO design standards. In general, the Project shall be constructed by the Contractor in accordance with applicable industry standards. The Contractor shall be responsible for utilizing and maintaining current knowledge of any laws,

ordinances, codes, rules, regulations, standards, guidelines, special conditions, specifications or other mandates relevant to the Project or the services to be performed.

H. Adherence to Project Schedule. The development and equipping of the Project shall be undertaken and completed in accordance with the Project Schedule, and within the Contract Time described therein.

I. Superintendent. The Contractor shall employ a competent superintendent and necessary assistants who shall be in attendance at the Project Site during performance of the Work. The superintendent shall represent the Contractor, and communications given to the superintendent shall be as binding as if given to the Contractor.

(1) The Contractor, as soon as practicable after award of the Agreement, shall furnish in writing to the Owner through the Architect/Engineer the name and qualifications of the proposed superintendent. The Architect/Engineer may reply within 14 days to the Contractor in writing stating (1) whether the Owner or the Architect/Engineer has reasonable objection to the proposed superintendent or (2) that the Architect/Engineer requires additional time to review. Failure of the Architect/Engineer to reply within 14 days shall constitute notice of no reasonable objection.

(2) The Contractor shall not employ a proposed superintendent to whom the Owner or Architect/Engineer has made reasonable and timely objection. The Contractor shall not change the superintendent without the Owner's consent, which shall not be unreasonably withheld or delayed.

J. Work Hours. Contractor shall provide competent, suitable qualified personnel to survey and lay out the Work and perform construction as required by the Contract Documents. Contractor shall at all times maintain good discipline and order at the site. Except in connection with the safety or protection of persons or the Work or property at the site or adjacent thereto and except as otherwise indicated in the Contract Documents, all Work at the site shall be performed during regular working hours, and Contractor shall not permit overtime work or the performance of Work on a Saturday, Sunday or legal holiday without Owner's written consent given after prior notice to Architect/Engineer (at least seventy-two (72) hours in advance).

K. Overtime-Related Costs. Contractor shall pay for all additional Architect/Engineer charges, inspection costs and Owner staff time for any overtime work which may be authorized. Such additional charges shall be an obligation of Contractor and no extra payment shall be made by Owner because such overtime work. At Owner's option, such overtime costs may be deducted from Contractor's monthly payment request or Contractor's retainage prior to release of final payment. Contractor's obligation to pay all overtime-related costs shall not apply if Contractor is directed by Owner to work overtime solely for Owner's convenience.

L. Insurance, Overhead and Utilities. Unless otherwise specified, Contractor shall furnish and assume full responsibility for all bonds, insurance, materials, equipment, labor, transportation, construction equipment and machinery, tools, appliances, fuel, power, light, heat, telephone, water, sanitary facilities, temporary facilities and all other facilities and incidentals necessary for the furnishing, performance, testing, start-up and completion of the Work.

M. Cleanliness. The Contractor shall keep the premises and surrounding area free from accumulation of waste materials or rubbish caused by operations under the Contract. At completion of the Work, the Contractor shall remove waste materials, rubbish, the Contractor's tools, construction equipment, machinery and surplus materials from and about the Project Site. Contractor shall restore to original conditions all property not designated for alteration by the Contract Documents. If the Contractor fails to clean up as provided in the Contract Documents, the Owner may do so and Owner shall be entitled to reimbursement from Contractor.

N. Loading. Contractor shall not load nor permit any part of any structure to be loaded in any manner that will endanger the structure, nor shall Contractor subject any part of the Work or adjacent property to stresses or pressures that will endanger it.

O. Safety and Protection. Contractor shall comply with all applicable federal, state and local safety regulations. Contractor shall be responsible for initiating, maintaining and supervising all safety precautions and programs in connection with the Work. Contractor shall take all necessary precautions for the safety of and shall provide the necessary protection to prevent damage, injury or loss to:

- (1) All employees on the Work and other persons and organizations who may be affected thereby;
- (2) All the Work and materials and equipment to be incorporated therein, whether in storage on or off the Project Site; and
- (3) Other property at the Project Site or adjacent thereto, including trees, shrubs, lawns, walks, pavements, roadways, structures, utilities and underground facilities not designated for removal, relocation or replacement during construction.

Contractor shall comply with all applicable laws and regulations of any public body having jurisdiction for the safety of persons or property or to protect them from damage, injury or loss, and shall erect and maintain all necessary safeguards for such safety and protection. Contractor shall provide and maintain all passageways, guard fences, lights and other facilities for the protection required by public authority or local conditions. Contractor shall provide reasonable maintenance of traffic for the public and preservation of the Owner's business, taking into full consideration all local conditions. Contractor's duties and responsibilities for safety and protection with regard to the Work shall continue until such time as all the Work is completed.

P. Emergencies. In emergencies affecting the safety or protection of persons or the Work or property at the Project Site or adjacent thereto, Contractor, without special instruction or authorization from Architect/Engineer or Owner, shall act to prevent threatened damage, injury or loss. Contractor shall give Owner prompt written notice if Contractor believes that any significant changes in the Work or variations from the Contract Documents have been caused thereby. If Owner determines that a change in the Project is required because of the action taken in response to an emergency, a Work Directive Change or Change Order will be issued to document the consequences of the changes or variation.

Q. Substitutes. For Substitutes not included with the Bid (or Guaranteed Maximum Price Addendum), but submitted after the effective date of the Agreement (or

Guaranteed Maximum Price Addendum), Contractor shall make written application to Architect/Engineer for acceptance thereof, certifying that the proposed Substitute will perform adequately the functions and achieve the results called for by the general design, be similar and of equal substance to that specified and be suited to the same use as that specified. The application will also contain an itemized estimate of all costs and delays or schedule impacts that will result directly or indirectly from review, acceptance and provision of such Substitute, including costs of redesign and claims of other contractors affected by the resulting change, all of which will be considered by the Architect/Engineer in evaluating the proposed Substitute. Architect/Engineer may require Contractor to furnish at Contractor's expense, additional data about the proposed Substitute. In rendering a decision, Owner, Architect/Engineer and Contractor shall have access to any available Float Time in the Project Schedule. If Substitute materials or equipment not included as part of the Bid (or Guaranteed Maximum Price Addendum), but proposed after the effective date of the Agreement, are accepted and are less costly than the originally specified materials or equipment, then the net difference in cost shall be credited to the Owner and an appropriate Change Order executed to adjust the Contract Sum.

- (1) Architect/Engineer will be allowed a reasonable time within which to evaluate each proposed Substitute. Architect/Engineer will be the sole judge of acceptability and no Substitute will be ordered, installed or utilized without Architect/Engineer's prior written acceptance which will be evidenced by either a Change Order or an approved shop drawing. Owner may require Contractor to furnish at Contractor's expense a special performance guarantee or other surety with respect to any Substitute.
- (2) Contractor shall reimburse Owner for the charges of Architect/Engineer and Architect/Engineer's Consultants for evaluating each proposed Substitute submitted after the effective date of the Agreement and all costs resulting from any delays in the Work while the Substitute was undergoing review.

R. Surveys and Stakes. The Contractor shall furnish, as part of the Contract Sum, all labor, stakes, surveys, batter boards for structures, grade lines and other materials and supplies and shall set construction stakes and batter boards for establishing lines, position of structures, slopes and other controlling points necessary for the proper prosecution of the Work. Where rights-of-way, easements, property lines or any other conditions which make the lay-out of the Project or parts of the Project critical are involved, the Contractor shall employ a competent surveyor who is registered in the State of Florida for lay-out and staking. These stakes and marks shall constitute the field control by and in accord with which the Contractor shall govern and execute the Work. The Contractor shall be held responsible for the preservation of all stakes and marks and if for any reason any of the stakes or marks or batter boards become destroyed or disturbed, they shall be immediately and accurately replaced by the Contractor.

S. Suitability of Project Site. The Contractor has, by careful examination, satisfied itself as to the nature and location of the Work and all other matters which can in any way affect the Work, including, but not limited to details pertaining to borings, as shown on the drawings. Such boring information is not guaranteed to be more than a general indication of the materials likely to be found adjacent to holes bored at the Project Site, approximately at the locations indicated. The Contractor has examined boring data, where available, made its own interpretation of the subsurface conditions and other preliminary data, and has based its Bid (or Guaranteed Maximum Price Addendum) on its own opinion of the conditions likely to be

encountered. Except as specifically provided in Sections 2.4.U., 5.4 and 5.5, no extra compensation or extension of time will be considered for any Project Site conditions that existed at the time of bidding (or at the time of execution of the Guaranteed Maximum Price Addendum). No verbal agreement or conversation with any officer, agent or employee of the Owner, before or after the execution of the Agreement, shall affect or modify any of the terms or obligations herein contained.

T. Project Specification Errors. If the Contractor, during the Work, finds that the drawings, specifications or other Contract Documents cannot be followed, the Contractor shall immediately inform the Owner in writing, and the Owner shall promptly check the accuracy of the information. Any Work done after such discovery, until any necessary changes are authorized, will be done at the Contractor's sole risk of non-payment and delay.

U. Remediation of Contamination. Owner and Contractor recognize that remediation of subsurface conditions may be necessary due to potential hazardous materials contamination. Because the presence or extent of any contamination is not known, Contractor shall include no cost in the Contract Sum, and no time in the Project Schedule, for cost or delays that might result from any necessary remediation. The Project Schedule will provide a period of time between demolition activities and the start of the next activity to commence any remediation if needed. Contractor shall use all reasonable efforts in scheduling the Project to minimize the likelihood that remediation delays construction. Any hazardous materials remediation Work which Contractor agrees to perform shall be done pursuant to a Change Order or amendment consistent with the following:

- (1) The dates of Substantial Completion shall be equitably adjusted based on delays, if any, incurred in connection with remediation efforts.
- (2) Contractor, and any Subcontractors which have mobilized on the Project Site, shall be paid for demonstrated costs of overhead operations at the Project Site during any period of delay of more than seven (7) days, except to the extent that Work proceeds concurrently with remediation. The categories of costs to be reimbursed are limited to those reasonably incurred at the jobsite during the delay period (such as trailers or offices, telephones, faxes, and the like); equipment dedicated to the Project and located at the Project Site; salaries and associated costs of personnel dedicated to the Project to the extent that they do not perform work on other projects; and other jobsite costs that are reasonable and which are incurred during the delay period. Subcontractors and suppliers which have not mobilized are limited to the costs set forth in Section 2.4.U(3).
- (3) Contractor and any Subcontractor or supplier on the Project who is eligible for compensation shall be paid any demonstrated costs of escalation in materials or labor, and reasonable costs of off-site storage of materials identified to the Project, arising because of any delay of more than seven (7) days. Such Contractor, Subcontractors and suppliers are obligated to take all reasonable steps to mitigate escalation costs, such as through early purchase of materials.

- (4) Contractor, for itself and all Subcontractors and suppliers on the Project, hereby agrees that the extension of time for delays under Section 2.4.U(1), and payment of the costs identified in Sections 2.4.U(2) and/or Section 2.4.U(3), are the sole remedies for costs and delays described in this Section, and waives all claims and demands for extended home office overhead (including, but not limited to, "Eichleay" claims), lost profit or lost opportunities, and any special, indirect, or consequential damages arising as a result of delays described in this Section. The Contract Sum shall be adjusted to reflect payment of allowable costs.
- (5) If any delay described in this section causes the time or cost for the Project to exceed the Contract Time or the Contract Sum, then the Owner may terminate the Agreement pursuant to Section 14.2.
- (6) Contractor and any Subcontractor or supplier seeking additional costs under this Section 2.4.U. shall promptly submit estimates or any costs as requested by Owner, and detailed back-up for all costs when payment is sought or whenever reasonably requested by Owner. All costs are auditable, at Owner's discretion. Bid, estimate and pricing information reasonably related to any request for additional compensation will be provided promptly upon request.
- (7) Contractor shall include provisions in its subcontracts and purchase orders consistent with this Section.

V. Interfacing.

- (1) The Contractor shall take such measures as are necessary to ensure proper construction and delivery of the Project, including but not limited to providing that all procurement of long-lead items, the separate construction Subcontractors, and the general conditions items are performed without duplication or overlap to maintain completion of all Work on schedule. Particular attention shall be given to provide that each Subcontractor bid package clearly identifies the Work included in that particular separate subcontract, its scheduling for start and completion, and its relationship to other separate contractors.
- (2) Without assuming any design responsibilities of the Architect/Engineer, the Contractor shall include in the Progress Reports required under this Section 2.4 comments on overlap with any other separate subcontracts, omissions, lack of correlation between drawings, and any other deficiencies noted, in order that the Architect/Engineer may arrange for necessary corrections.

W. Job Site Facilities. The Contractor shall arrange for all job site facilities required and necessary to enable the Contractor and Architect/Engineer to perform their respective duties and to accommodate any representatives of the Owner which the Owner may choose to have present on the Project Site.

X. Weather Protection. The Contractor shall provide temporary enclosures of building areas to assure orderly progress of the Work during periods when extreme weather conditions are likely to be experienced. The Contractor shall also be responsible for providing weather protection for Work in progress and for materials stored on the Project Site. A contingency plan shall be prepared upon request of the Owner for weather conditions that may affect the construction.

Y. Payment and Performance Bond. Prior to the construction commencement date, the Contractor shall obtain, for the benefit of and directed to the Owner, a Payment and Performance Bond satisfying the requirements of Section 255.05, Florida Statutes, covering the faithful performance by the Contractor of its obligations under the Contract Documents, including but not limited to the construction of the Project on the Project Site and the payment of all obligations arising thereunder, including all payments to Subcontractors, laborers, and materialmen. The surety selected by the Contractor to provide the Payment and Performance Bond shall be approved by the Owner prior to the issuance of such Bond, which approval shall not be unreasonably withheld or delayed provided that the surety is rated A or better by Best's Key Guide, latest edition. For Changes in the Work that result in an increase in the Contract Sum, Owner reserves the right to require the Contractor to secure and deliver additive riders to the Payment and Performance Bond.

Z. Construction Phase; Building Permit; Code Inspections. Unless otherwise provided, Contractor shall obtain and pay for all construction permits and licenses. Owner shall assist Contractor, when necessary, in obtaining such permits and licenses. Contractor shall pay all governmental charges and inspection fees necessary for the prosecution of the Work.

- (1) Building Permit. The Owner and Architect/Engineer shall provide such information to any Permitting Authority as is necessary to obtain approval from the Permitting Authority to commence construction prior to beginning construction. The Contractor shall pull any required building permit, and shall be responsible for delivering and posting the building permit at the Project Site prior to the commencement of construction. The cost of the building permit is included in the Contract Sum. The Owner and Architect/Engineer shall fully cooperate with the Contractor when and where necessary.
- (2) Code Inspections. The Project requires detailed code compliance inspection during construction in disciplines determined by any Permitting Authority. These disciplines normally include, but are not necessarily limited to, structural, mechanical, electrical, plumbing, general building and fire. The Contractor shall notify the appropriate inspector(s) and the Architect/Engineer, no less than 24 hours in advance, when the Work is ready for inspection and before the Work is covered up. All inspections shall be made for conformance with the applicable ordinances and building codes. Costs for all re-inspections of Work found defective and subsequently repaired shall not be included as Project Costs and shall be borne by the Contractor or as provided in the contract between Contractor and Subcontractor.

- (3) Contractor's Personnel. The Contractor shall maintain sufficient off-site support staff and competent full-time staff at the Project Site authorized to act on behalf of the Contractor to coordinate, inspect, and provide general direction of the Work and progress of the Subcontractors. At all times during the performance of the Work, the Owner shall have the right to demand replacement of Contractor Personnel to whom the Owner has reasonable objection, without liability to the Contractor.
- (4) Lines of Authority. To provide general direction of the Work, the Contractor shall establish and maintain lines of authority for its personnel and shall provide this information to the Owner and all other affected parties, such as the code inspectors of any Permitting Authority, the Subcontractors, and the Architect/Engineer. The Owner and Architect/Engineer may attend meetings between the Contractor and his Subcontractors; however, such attendance is optional and shall not diminish either the authority or responsibility of the Contractor to administer the subcontracts.

AA. Quality Control. The Contractor shall develop and maintain a program, acceptable to the Owner and Architect/Engineer, to assure quality control of the construction. The Contractor shall be responsible for and supervise the Work of all Subcontractors, providing instructions to each when their Work does not conform to the requirements of the Project Plans and Specifications, and the Contractor shall continue to coordinate the Work of each Subcontractor to ensure that corrections are made in a timely manner so as to not affect the efficient progress of the Work. Should a disagreement occur between the Contractor and the Architect/Engineer over the acceptability of the Work, the Owner, at its sole discretion and in addition to any other remedies provided herein, shall have the right to determine the acceptability, provided that such determination is consistent with standards for construction projects of this type and generally accepted industry standards for workmanship in the State of Florida.

BB. Management of Subcontractors. All Subcontractors shall be compensated in accordance with Article IV. The Contractor shall solely control the Subcontractors. The Contractor shall negotiate all Change Orders and Field Orders with all affected Subcontractors and shall review the costs and advise the Owner and Architect/Engineer of their validity and reasonableness, acting in the Owner's best interest. When there is an imminent threat to health and safety, and Owner's Project Representative concurrence is impractical, the Contractor shall act immediately to remove the threats to health and safety and shall subsequently fully inform Owner of all such action taken. The Contractor shall also carefully review all shop drawings and then forward the same to the Architect/Engineer for review and actions. The Architect/Engineer will transmit them back to the Contractor, who will then issue the shop drawings to the affected Subcontractor for fabrication or revision. The Contractor shall maintain a suspense control system to promote expeditious handling. The Contractor shall request the Architect/Engineer to make interpretations of the drawings or specifications requested of him by the Subcontractors and shall maintain a business system to promote timely response. The Contractor shall inform the Architect/Engineer which shop drawings or requests for clarification have the greatest urgency, to enable the Architect/Engineer to prioritize requests coming from the Contractor. The Contractor shall advise the Owner and Architect/Engineer when timely response is not occurring on any of the above.

CC. Job Requirements.

- (1) The Contractor shall provide each of the following as a part of its services hereunder:
 - (a) Maintain a log of daily activities, including manpower records, equipment on site, weather, delays, major decisions, etc;
 - (b) Maintain a roster of companies on the Project with names and telephone numbers of key personnel;
 - (c) Establish and enforce job rules governing parking, clean-up, use of facilities, and worker discipline;
 - (d) Provide labor relations management and equal opportunity employment for a harmonious, productive Project;
 - (e) Provide and administer a safety program for the Project and monitor for subcontractor compliance without relieving them of responsibilities to perform Work in accordance with best acceptable practice;
 - (f) Provide a quality control program as provided under Section 2.4.C above;
 - (g) Provide miscellaneous office supplies that support the construction efforts which are consumed by its own forces;
 - (h) Provide for travel to and from its home office to the Project Site and to those other places within Manatee County as required by the Project;
 - (i) Verify that tests, equipment, and system start-ups and operating and maintenance instructions are conducted as required and in the presence of the required personnel and provide adequate records of same to the Architect/Engineer;
 - (j) Maintain at the job site orderly files for correspondence, reports of job conferences, shop drawings and sample submissions, reproductions of original Contract Documents including all addenda, change orders, field orders, additional drawings issued after execution of the Agreement, Owner/Architect/Engineer's clarifications and interpretations of the Contract Documents, Progress Reports, as-built drawings, and other project related documents;
 - (k) Keep a diary or log book, recording hours on the job site, weather conditions, data relative to questions of extras or deductions; list of visiting officials and representatives or manufacturers, fabricators,

suppliers and distributors; daily activities, decisions, observations in general and specific observations in more detail as in the case of observing test procedures, and provide copies of same to Owner/Architect/Engineer;

- (l) Record names, addresses and telephone numbers of all Contractors, Subcontractors and major suppliers of materials and equipment;
 - (m) Furnish Owner/Architect/Engineer periodic reports, as required, of progress of the Work and Contractor's compliance with the approved progress schedule and schedule of shop drawing submissions;
 - (n) Consult with Owner/Architect/Engineer in advance of scheduling major tests, inspections or start of important phases of the Work;
 - (o) Verify, during the course of the Work, that certificates, maintenance and operations manuals and other data required to be assembled and furnished are applicable to the items actually installed, and deliver same to Owner/Architect/Engineer for review prior to final Acceptance of the Work; and
 - (p) Cooperate with Owner in the administration of grants.
- (2) The Contractor shall provide personnel and equipment, or shall arrange for separate Subcontractors to provide each of the following as a Project Cost:
- (a) Services of independent testing laboratories, and provide the necessary testing of materials to ensure conformance to contract requirements; and
 - (b) Printing and distribution of all required bidding documents and shop drawings, including the sets required by Permitting Authority inspectors.

DD. As-Built Drawings. The Contractor shall continuously review as-built drawings and mark up progress prints to provide as much accuracy as possible. Prior to, and as a requirement for authorizing final payment to the Contractor due hereunder, the Contractor shall provide to the Owner an original set of marked-up, as-built Project Plans and Specifications and an electronic format of those records showing the location and dimensions of the Project as constructed, which documents shall be certified as being correct by the Contractor and the Architect/Engineer. Final as-built drawings shall be signed and sealed by a registered Florida surveyor.

EE. Progress Reports. The Contractor shall forward to the Owner, as soon as practicable after the first day of each month, a summary report of the progress of the various parts of the Work, to include those parts of the Work in fabrication and in the field, stating the existing status, estimated time of completion and cause of delay, if any. Together with the summary report, the Contractor shall submit any necessary revisions to the original schedule for the Owner's review

and approval. In addition, more detailed schedules may be required by the Owner for daily traffic control.

FF. Contractor's Warranty. The Contractor warrants to the Owner and Architect/Engineer that materials and equipment furnished under the Contract will be of good quality and new unless the Contract Documents require or permit otherwise. The Contractor further warrants that the Work will conform to the requirements of the Contract Documents and will be free from defects, except for those inherent in the quality of the Work the Contract Documents require or permit. Work, materials, or equipment not conforming to these requirements will be considered defective. The Contractor's warranty excludes remedy for damage or defect caused by abuse, alterations to the Work not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear and normal usage. If required by the Architect/Engineer, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment.

- (1) Contractor shall use its best efforts and due diligence to ensure that during the warranty period, those entities or individuals who have provided direct warranties to the Owner as required by the Contract Documents perform all required warranty Work in a timely manner and at the sole cost and expense of such warranty providers. Any such cost or expense not paid by the warranty providers shall be paid by the Contractor, to include any costs and attorney's fees incurred in warranty-related litigation between Contractor and any Subcontractors.
- (2) The Contractor shall secure guarantees and warranties of Subcontractors, equipment suppliers and materialmen, and assemble and deliver same to the Owner in a manner that will facilitate their maximum enforcement and assure their meaningful implementation. The Contractor shall collect and deliver to the Owner any specific written guaranties or warranties given by others as required by subcontracts.
- (3) At the Owner's request, the Contractor shall conduct, jointly with the Owner and the Architect/Engineer, no more than two (2) warranty inspections within three (3) years after the Substantial Completion Date.

GG. Apprentices. If Contractor employs apprentices, their performance of Work shall be governed by and shall comply with the provisions of Chapter 446, Florida Statutes.

HH. Schedule of Values. Unit prices shall be established for this Agreement by the submission of a schedule of values within ten (10) days of receipt of the Notice to Proceed. The schedule shall include quantities and prices of items equaling the Contract Sum and will subdivide the Work into components in sufficient detail to serve as the basis for progress payments during construction. Such prices shall include an appropriate amount of overhead and profit applicable to each item of Work. Upon request of the County, the Contractor shall support the values with data which will substantiate their correctness.

II. Other Contracts. The Owner reserves the right to let other contracts in connection with this Work. The Contractor shall afford other contractors reasonable

opportunity for the introduction and storage of their materials and execution of their work, and promptly connect and coordinate the Work with theirs.

ARTICLE III COMPENSATION

3.1 Compensation. The Contract Sum constitutes the total compensation (subject to authorized adjustments) payable to Contractor for performing the Work. All duties, responsibilities and obligations assigned to or undertaken by Contractor shall be at Contractor's expense without change in the Contract Sum.

A. Adjustments. The Contract Sum may only be changed by Change Order or by a written amendment. Any claim for an increase or decrease in the Contract Sum shall be based on written notice delivered by the party making the claim to the other party. Notice of the amount of the claim with supporting data shall be delivered within fifteen (15) days from the beginning of such occurrence and shall be accompanied by claimant's written statement that the amount claimed covers all amounts to which the claimant is entitled as a result of the occurrence of said event. Failure to deliver a claim within the requisite 15-day period shall constitute a waiver of the right to pursue said claim.

B. Valuation. The value of any Work covered by a Change Order or of any claim for an increase or decrease in the Contract Sum shall be determined in one of the following ways (at Owner's discretion):

- (1) In the case of Unit Price Work, in accordance with Section 3.1.C, below; or
- (2) By mutual acceptance of a lump sum; or
- (3) On the basis of the cost of the Work, plus a negotiated Contractor's fee for overhead and profit. Contractor shall submit an itemized cost breakdown together with supporting data.

C. Unit Price Work. The unit price of an item of Unit Price Work shall be subject to re-evaluation and adjustment pursuant to a requested Change Order under the following conditions:

- (1) If the total cost of a particular item of Unit Price Work amounts to 5% or more of the Contract Sum and the variation in the quantity of the particular item of Unit Price Work performed by Contractor differs by more than 15% from the estimated quantity of such item indicated in the Agreement; and
- (2) If there is no corresponding adjustment with respect to any other item of Work; and
 - (i) If Contractor believes that it has incurred additional expense as a result thereof; or
 - (ii) If Owner believes that the quantity variation entitles it to an

adjustment in the unit price; or

- (iii) If the parties are unable to agree as to the effect of any such variations in the quantity of Unit Price Work performed.

3.2 Schedule of Compensation. All payments for services and material under the Contract Documents shall be made in accordance with the following provisions.

A. Periodic Payments for Services. The Contractor shall be entitled to receive payment for Construction Services rendered pursuant to Section 2.4 in periodic payments which shall reflect a fair apportionment of cost and schedule of values of services furnished prior to payment, subject to the provisions of this Section.

B. Payment for Materials and Equipment. In addition to the periodic payments authorized hereunder, payments may be made for material and equipment not incorporated in the Work but delivered and suitably stored at the Project Site, or another location, subject to prior approval and acceptance by the Owner on each occasion.

C. Credit toward Contract Sum. All payments for Construction Services made hereunder shall be credited toward the payment of the Contract Sum as Contractor's sole compensation for the construction of the Project.

3.3 Invoice and Payment. All payments for services and materials under the Contract Documents shall be invoiced and paid in accordance with the following provisions.

A. Invoices. The Contractor shall submit to the Owner periodic invoices for payment, in a form acceptable to the Owner, which shall include a sworn statement certifying that, to the best of the Contractor's knowledge, information and belief, the construction has progressed to the point indicated, the quality and the Work covered by the invoice is in accord with the Project Plans and Specifications, and the Contractor is entitled to payment in the amount requested, along with the cost reports required pursuant to Article II, showing in detail all monies paid out, Project Costs accumulated, or Project Cost incurred during the previous period. This data shall be attached to the invoice.

B. Additional Information; Processing of Invoices. Should an invoiced amount appear to exceed the Work effort believed to be completed, the Owner may, prior to processing of the invoice for payment, require the Contractor to submit satisfactory evidence to support the invoice. All Progress Reports and invoices shall be delivered to the attention of the Owner's Project Representative. Invoices not properly prepared (mathematical errors, billing not reflecting actual Work done, no signature, etc.) shall be returned to the Contractor for correction.

C. Architect/Engineer's Approval. Payment for Work completed shall be subject to the Architect/Engineer approving the payment requested by the Contractor and certifying the amount thereof that has been properly incurred and is then due and payable to the Contractor, and identifying with specificity any amount that has not been properly incurred and that should not be paid.

D. Warrants of Contractor with Respect to Payments. The Contractor warrants that (1) upon payment of any retainage, materials and equipment covered by a partial payment request will pass to Owner either by incorporation in construction or upon receipt of payment by the Contractor, whichever occurs first; (2) Work, materials and equipment covered by previous partial payment requests shall be free and clear of liens, claims, security interests, or encumbrances; and (3) no Work, materials or equipment covered by a partial payment request which has been acquired by the Contractor or any other person performing Work at the Project Site, or furnishing materials or equipment for the Project, shall be subject to an agreement under which an interest therein or an encumbrance thereon is retained by the seller or otherwise imposed by the Contractor or any other person.

E. All Compensation Included. Contractor's compensation includes full payment for services set forth in the Contract Documents, including but not limited to overhead, profit, salaries or other compensation of Contractor's officers, partners and/or employees, general operating expenses incurred by Contractor and relating to this Project, including the cost of management, supervision and data processing staff, job office equipment and supplies, and other similar items.

ARTICLE IV SUBCONTRACTORS

4.1 Subcontracts. At the Owner's request, the Contractor shall provide Owner's Project Representative with copies of all proposed and final subcontracts, including the general and supplementary conditions thereof.

A. Subcontracts Generally. All subcontracts shall: (1) require each Subcontractor to be bound to Contractor to the same extent Contractor is bound to Owner by the terms of the Contract Documents, as those terms may apply to the portion of the Work to be performed by the Subcontractor, (2) provide for the assignment of the subcontracts from Contractor to Owner at the election of Owner, upon termination of Contractor, (3) provide that Owner will be an additional indemnified party of the subcontract, (4) provide that Owner will be an additional insured on all insurance policies required to be provided by the Subcontractor, except workers' compensation, (5) assign all warranties directly to Owner, and (6) identify Owner as an intended third-party beneficiary of the subcontract.

(1) A Subcontractor is a person or entity who has a direct contract with Contractor to perform a portion of the Work at the site. The term "Subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Subcontractor or an authorized representative of the Subcontractor. The term "Subcontractor" does not include a separate contractor or subcontractors of a separate contractor.

(2) A Sub-subcontractor is a person or entity who has a direct or indirect contract with a Subcontractor to perform a portion of the Work at the site. The term "Sub-subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Sub-subcontractor or an authorized representative of the Sub-subcontractor.

B. No Damages for Delay. Except when otherwise expressly agreed to by Owner in writing, all subcontracts shall provide:

“LIMITATION OF REMEDIES – NO DAMAGES FOR DELAY. The Subcontractor's exclusive remedy for delays in the performance of the contract caused by events beyond its control, including delays claimed to be caused by the Owner or Architect/Engineer or attributable to the Owner or Architect/Engineer and including claims based on breach of contract or negligence, shall be an extension of its contract time and shall in no way involve any monetary claim.”

Each subcontract shall require that any claims by the Subcontractor for delay must be submitted to the Contractor within the time and in the manner in which the Contractor must submit such claims to the Owner, and that failure to comply with the conditions for giving notice and submitting claims shall result in the waiver of such claims.

C. Subcontractual Relations. The Contractor shall require each Subcontractor to assume all the obligations and responsibilities which the Contractor owes the Owner pursuant to the Contract Documents, by the parties to the extent of the Work to be performed by the Subcontractor. Said obligations shall be made in writing and shall preserve and protect the rights of the Owner and Architect/Engineer, with respect to the Work to be performed by the Subcontractor, so that the subcontracting thereof will not prejudice such rights. Where appropriate, the Contractor shall require each Subcontractor to enter into similar agreements with its sub-subcontractors.

D. Insurance; Acts and Omissions. Insurance requirements for Subcontractors shall be no more stringent than those requirements imposed on the Contractor by the Owner. The Contractor shall be responsible to the Owner for the acts and omissions of its employees, agents, Subcontractors, their agents and employees, and all other persons performing any of the Work or supplying materials under a contract to the Contractor.

4.2 Relationship and Responsibilities. Except as specifically set forth herein with respect to direct materials acquisitions by Owner, nothing contained in the Contract Documents or in any Contract Document does or shall create any contractual relation between the Owner or Architect/Engineer and any Subcontractor. Specifically, the Contractor is not acting as an agent of the Owner with respect to any Subcontractor. The utilization of any Subcontractor shall not relieve Contractor from any liability or responsibility to Owner, or obligate Owner to the payment of any compensation to the Subcontractor or additional compensation to the Contractor.

4.3 Payments to Subcontractors; Monthly Statements. The Contractor shall be responsible for paying all Subcontractors from the payments made by the Owner to Contractor pursuant to Article III, subject to the following provisions:

A. Payment. The Contractor shall, no later than ten (10) days after receipt of payment from the Owner, out of the amount paid to the Contractor on account of such Subcontractor's Work, pay to each Subcontractor the amount to which the Subcontractor is entitled in accordance with the terms of the Contractor's contract with such Subcontractor. The Contractor shall, by appropriate agreement with each Subcontractor, require each Subcontractor to make

payments to sub-Subcontractors in a similar manner. After receipt of payment from Owner, if the need should arise to withhold payments to Subcontractors for any reason, as solely determined by Contractor, the Contractor shall promptly restore such monies to the Owner, adjusting subsequent pay requests and Project bookkeeping as required.

B. Final Payment of Subcontractors. The final payment of retainage to Subcontractors shall not be made until the Project has been inspected by the Architect/Engineer or other person designated by the Owner for that purpose, and until both the Architect/Engineer and the Contractor have issued a written certificate that the Project has been constructed in accordance with the Project Plans and Specifications and approved Change Orders. Before issuance of final payment to any Subcontractor without any retainage, the Subcontractor shall submit satisfactory evidence that all payrolls, material bills, and other indebtedness connected with the Project have been paid or otherwise satisfied, warranty information is complete, as-built markups have been submitted, and instruction for the Owner's operating and maintenance personnel is complete. Final payment may be made to certain select Subcontractors whose Work is satisfactorily completed prior to the completion of the Project, but only upon approval of the Owner's Project Representative.

4.4 Responsibility for Subcontractors. As provided in Section 2.4.BB, Contractor shall be fully responsible to Owner for all acts and omissions of the Subcontractors, suppliers and other persons and organizations performing or furnishing any of the Work under a direct or indirect Contract with Contractor just as Contractor is responsible for Contractor's own acts and omissions.

4.5 Contingent Assignment of Subcontracts. Each subcontract agreement for a portion of the Work is assigned by the Contractor to the Owner, provided that:

- (1) assignment is effective only after termination of the Contract by the Owner for cause pursuant to Article XIV and only for those subcontract agreements that the Owner accepts by notifying the Subcontractor and Contractor in writing; and
- (2) assignment is subject to the prior rights of the surety, if any, obligated under bond relating to the Agreement.

When the Owner accepts the assignment of a subcontract agreement, the Owner assumes the Contractor's rights and obligations under the subcontract. Upon such assignment, if the Work has been suspended for more than thirty (30) days, the Subcontractor's compensation shall be equitably adjusted for increases in cost resulting from the suspension. Upon such assignment to the Owner, the Owner may further assign the subcontract to a successor contractor or other entity. If the Owner assigns the subcontract to a successor contractor or other entity, the Owner shall nevertheless remain legally responsible for all of the successor contractor's obligations under the subcontract.

ARTICLE V CHANGES IN WORK

5.1 General. Changes in the Work may be accomplished after execution of the Agreement, and without invalidating the Agreement, by Change Order, Work Directive Change

or order for a minor change in the Work, subject to the limitations stated in this Article V and elsewhere in the Contract Documents. A Change Order shall be based upon agreement among the Owner, Contractor and Architect/Engineer; a Work Directive Change requires agreement by the Owner and Architect/Engineer and may or may not be agreed to by the Contractor; an order for a minor change in the Work may be issued by the Architect/Engineer alone. Changes in the Work shall be performed under applicable provisions of the Contract Documents, and the Contractor shall proceed promptly, unless otherwise provided in the Change Order, Work Directive Change or order for a minor change in the Work.

5.2 Minor Changes in the Work. The Owner or Architect/Engineer shall have authority to order minor changes in the Work not involving adjustment in the Contract Sum or extension of the Contract Time and not inconsistent with the intent of the Contract Documents. Such change will be effected by written order signed by the Architect/Engineer and shall be binding on the Owner and Contractor. The Contractor shall abide by and perform such minor changes. Such changes shall be effected by a Field Directive or a Work Directive Change. Documentation of changes shall be determined by the Construction Team, and displayed monthly in the Progress Reports. Because such changes shall not affect the Contract Sum to be paid to the Contractor, they shall not require a Change Order pursuant to Section 5.6.

5.3 Emergencies. In any emergency affecting the safety of persons or property, the Contractor shall act at its discretion to prevent threatened damage, injury, or loss. Any increase in the Contract Sum or extension of time claimed by the Contractor because of emergency Work shall be determined as provided in Section 5.6. However, whenever practicable, the Contractor shall obtain verbal concurrence of the Owner's Project Representative and Architect/Engineer where the act will or may affect the Contract Sum or Contract Time.

5.4 Concealed Conditions. If the Contractor encounters conditions at the site that are (1) subsurface or otherwise concealed physical conditions that differ materially from those indicated in the Contract Documents or (2) unknown physical conditions of an unusual nature, that differ materially from those ordinarily found to exist and generally recognized as inherent in construction activities of the character provided for in the Contract Documents, the Contractor shall promptly provide notice to the Owner and the Architect/Engineer before conditions are disturbed and in no event later than ten (10) days after first observance of the conditions. The Architect/Engineer will promptly investigate such conditions and, if the Architect/Engineer determines that they differ materially and cause an increase or decrease in the Contractor's cost of, or time required for, performance of any part of the Work, will recommend an equitable adjustment in the Contract Sum or Contract Time, or both. If the Architect/Engineer determines that the conditions at the site are not materially different from those indicated in the Contract Documents and that no change in the terms of the Contract is justified, the Architect/Engineer shall promptly notify the Owner and Contractor in writing, stating the reasons. If the Contractor disputes the Architect/Engineer's determination or recommendation, the Contractor may proceed as provided in Article VIII. If the Owner disputes the Architect/Engineer's determination or recommendation, the Owner may appeal directly to the Purchasing Official and shall thereafter follow the process set forth in Section 8.5.

5.5 Hazardous Materials. In the event the Contractor encounters on the Project Site material reasonably believed to be hazardous, petroleum or petroleum related products, or other hazardous or toxic substances, except as provided in Section 2.4.U, the Contractor shall immediately stop Work in the area affected and report the condition to the Owner and the

Architect/Engineer in writing. The Work in the affected area shall not thereafter be resumed except by Change Order or written amendment, if in fact the material or substance has not been rendered harmless. The Work in the affected area shall be resumed when the Project Site has been rendered harmless, in accordance with the final determination by the Architect/Engineer or other appropriate professional employed by Owner. The Contractor shall not be required to perform without its consent any Work relating to hazardous materials, petroleum or petroleum related products, or other hazardous or toxic substances. In the event the Contractor encounters on the Project Site materials believed in good faith to be hazardous or contaminated material, and the presence of such hazardous or contaminated material was not known and planned for at the time the Contractor submitted its Bid (or Guaranteed Maximum Price proposal), and it is necessary for the Contractor to stop Work in the area affected and delays Work for more than a seven (7) day period, adjustments to the Contract Sum and/or Contract Time shall be made in accordance with this Article V.

5.6 Change Orders; Adjustments to Contract Sum.

A. Change Orders Generally. The increase or decrease in the Contract Sum resulting from a change authorized pursuant to the Contract Documents shall be determined:

- (1) By mutual acceptance of a lump sum amount properly itemized and supported by sufficient substantiating data, to permit evaluation by the Architect/Engineer and Owner; or
- (2) By unit prices stated in the Agreement or subsequently agreed upon; or
- (3) By any other method mutually agreeable to Owner and Contractor.

If Owner and Contractor are unable to agree upon increases or decreases in the Contract Sum and the Architect/Engineer certifies that the work needs to be commenced prior to any such agreement, the Contractor, provided it receives a written Change Order signed by or on behalf of the Owner, shall promptly proceed with the Work involved. The cost of such Work shall then be determined on the basis of the reasonable expenditures of those performing the Work attributed to the change. However, in the event a Change Order is issued under these conditions, the Owner, through the Architect/Engineer, will establish an estimated cost of the Work and the Contractor shall not perform any Work whose cost exceeds that estimated without prior written approval by the Owner. In such case, the Contractor shall keep and present in such form as the Owner may prescribe an itemized accounting, together with appropriate supporting data of the increase in overall costs of the Project. The amount of any decrease in the Contract Sum to be allowed by the Contractor to the Owner for any deletion or change which results in a net decrease in costs will be the amount of the actual net decrease.

5.7 Owner-Initiated Changes. Without invalidating the Agreement and without notice to any Surety, Owner may, at any time, order additions, deletions or revisions in the Work. These will be authorized by a written amendment, a Field Directive, a Change Order, or a Work Directive Change, as the case may be. Upon receipt of any such document, Contractor shall promptly proceed with the Work involved which will be performed under the applicable conditions of the

Contract Documents (except as otherwise specifically provided). A Work Directive Change may not change the Contract Sum or the Contract Time; but is evidence that the parties expect that the change directed or documented by a Work Directive Change will be incorporated in a subsequently issued Change Order following negotiations by the parties as to its effect, if any, on the Contract Sum or Contract Time.

5.8 Unauthorized Work. Contractor shall not be entitled to an increase in the Contract Sum or an extension of the Contract Time with respect to any Work performed that is not required by the Contract Documents.

5.9 Defective Work. Owner and Contractor shall execute appropriate Change Orders (or written amendments) covering changes in the Work which are ordered by Owner, or which may be required because of acceptance of defective Work, without adjustment to the Contract Sum.

5.10 Estimates for Changes. At any time Architect/Engineer may request a quotation from Contractor for a proposed change in the Work. Within twenty-one (21) calendar days after receipt, Contractor shall submit a written and detailed proposal for an increase or decrease in the Contract Sum or Contract Time for the proposed change. Architect/Engineer shall have twenty-one (21) calendar days after receipt of the detailed proposal to respond in writing. The proposal shall include an itemized estimate of all costs and time for performance that will result directly or indirectly from the proposed change. Unless otherwise directed, itemized estimates shall be in sufficient detail to reasonably permit an analysis by Architect/Engineer of all material, labor, equipment, subcontracts, overhead costs and fees, and shall cover all Work involved in the change, whether such Work was deleted, added, changed or impacted. Notwithstanding the request for quotation, Contractor shall carry on the Work and maintain the progress schedule. Delays in the submittal of the written and detailed proposal will be considered non-prejudicial.

5.11 Form of Proposed Changes. The form of all submittals, notices, Change Orders and other documents permitted or required to be used or transmitted under the Contract Documents shall be determined by the Owner. Standard Owner forms shall be utilized.

5.12 Changes to Contract Time. The Contract Time may only be changed pursuant to a Change Order or a written amendment to the Contract Documents. Any claim for an extension or shortening of the Contract Time shall be based on written notice delivered by the party making the claim to the other party. Notice of the extent of the claim with supporting data shall be delivered within fifteen (15) days from detection or beginning of such occurrence and shall be accompanied by the claimant's written statement that the adjustment claimed is the entire adjustment to which the claimant has reason to believe it is entitled to because of the occurrence of said event. The Contract time will be extended in an amount equal to time lost due to delays beyond the control of Contractor. Such delays shall include, but not be limited to, acts or neglect by Owner or others performing additional Work; or to fires, floods, epidemics, abnormal weather conditions or acts of God. Failure to deliver a written notice of claim within the requisite 15-day period shall constitute a waiver of the right to pursue said claim.

ARTICLE VI ROLE OF ARCHITECT/ENGINEER

6.1 General.

A. Retaining. The Owner shall retain an Architect/Engineer (whether an individual or an entity) lawfully licensed to practice in Florida. That person or entity is identified as the Architect/Engineer in the Agreement and is referred to throughout the Contract Documents as if singular in number.

B. Duties. Duties, responsibilities and limitations of authority of the Architect/Engineer as set forth in the Contract Documents shall not be restricted, modified or extended without written consent of the Owner and Architect/Engineer. Consent shall not be unreasonably withheld.

C. Termination. If the employment of the Architect/Engineer is terminated, the Owner shall employ a successor Architect/Engineer as to whom the Contractor has no reasonable objection and whose status under the Contract Documents shall be that of the Architect/Engineer.

6.2 Administration. The Architect/Engineer will provide administration of the Agreement as described in the Contract Documents and will be an Owner's representative during construction until the date the Architect/Engineer approves the final Application for Payment. The Architect/Engineer will have authority to act on behalf of the Owner only to the extent provided in the Contract Documents.

A. Site Visits. The Architect/Engineer will visit the site at intervals appropriate to the stage of construction, or as otherwise agreed with the Owner, to become generally familiar with the progress and quality of the portion of the Work complete, and to determine in general if the Work observed is being performed in a manner indicating that the Work, when fully completed, will be in accordance with the Contract Documents. Unless specifically instructed by Owner, the Architect/Engineer will not be required to make exhaustive or continuous on-site inspections to check the quality or quantity of the Work. The Architect/Engineer will not have control over, charge of, or responsibility for, the construction means, methods, techniques, sequences or procedures, or for the safety precautions and programs in connection with the Work, since these are solely the Contractor's rights and responsibilities under the Contract Documents.

B. Reporting. Based on the site visits, the Architect/Engineer will keep the Owner reasonably informed about the progress and quality of the portion of the Work completed, and report to the Owner (1) known deviations from the Contract Documents and from the most recent construction schedule submitted by the Contractor, and (2) defects and deficiencies observed in the Work. The Architect/Engineer will not be responsible for the Contractor's failure to perform the Work in accordance with the requirements of the Contract Documents. The Architect/Engineer will not have control over or charge of and will not be responsible for acts or omissions of the Contractor, Subcontractors, or their agents or employees, or any other persons or entities performing portions of the Work.

6.3 Interpretation of Project Plans and Specifications. The Architect/Engineer will be the interpreter of the requirements of the Project Plans and Specifications. Upon receipt of comments or objections by Contractor or Owner, the Architect/Engineer will make decisions on all claims, disputes, or other matters pertaining to the interpretation of the Project Plans and Specifications.

6.4 Rejection of Non-Conforming Work. Upon consultation with Owner, the Architect/Engineer shall have the authority to reject Work which does not conform to the Project Plans and Specifications.

6.5 Correction of Work. The Contractor shall promptly correct all Work rejected by the Architect/Engineer for being defective or as failing to conform to the Project Plans and Specifications, whether observed before or after the Substantial Completion Date and whether or not fabricated, installed, or completed. The Contractor shall bear all costs of correcting such rejected Work, including compensation for Architect/Engineer's additional services made necessary thereby.

6.6 Timely Performance of Architect/Engineer. The Contractor shall identify which requests for information or response from the Architect/Engineer have the greatest urgency and those items which require prioritizing in response by the Architect/Engineer. The Contractor shall also identify the preferred time period for response and shall request a response time which is reasonably and demonstrably related to the needs of the Project and Contractor. If Architect/Engineer claims that Contractor's expectations for a response are unreasonable, Owner shall require Architect/Engineer to communicate such claim to Contractor in writing together with the specific time necessary to respond and the date upon which such response will be made. If Contractor believes that Architect/Engineer is not providing timely services or responses, Contractor shall notify Owner of same in writing not less than two (2) weeks before Contractor believes performance or response time from Architect/Engineer is required without risk of delaying the Project.

ARTICLE VII OWNER'S RIGHTS AND RESPONSIBILITIES

7.1 Project Site; Title. The Owner shall provide the lands upon which the Work under the Contract Documents is to be done, except that the Contractor shall provide all necessary additional land required for the erection of temporary construction facilities and storage of his materials, together with right of access to same. The Owner hereby represents to the Contractor that it currently has and will maintain up through and including the Substantial Completion Date, good title to all of the real property constituting the Project Site. Owner agrees to resolve, at its expense, any disputes relating to the ownership and use of the Project Site which might arise during construction.

7.2 Project Plans and Specifications; Architect/Engineer. The parties hereto acknowledge and agree that Owner has previously entered into an agreement with Architect/Engineer. Pursuant to the terms of such agreement, the Architect/Engineer, as an agent and representative of Owner, is responsible for the preparation of Project Plans and Specifications which consist of drawings, specifications, and other documents setting forth in detail the requirements for the construction of the Project. All such Project Plans and Specifications shall be provided either by Owner or the Architect/Engineer, and Contractor shall be under no obligation to provide same and shall be entitled to rely upon the accuracy and completeness of the Project Plans and Specifications provided by the Architect/Engineer and all preliminary drawings prepared in connection therewith. The Contractor will be furnished a reproducible set of all drawings and specifications reasonably necessary for the performance of Contractor's services hereunder and

otherwise ready for printing. The Contractor shall be notified of any written modification in the agreement between Owner and Architect/Engineer.

7.3 Surveys; Soil Tests and Other Project Site Information. Owner shall be responsible for providing a legal description and certified land survey of the Project Site in a form and content and with such specificity as may be required by the Architect/Engineer and Contractor to perform their services. To the extent deemed necessary by Owner and Architect/Engineer, and solely at Owner's expense, Owner may engage the services of a geotechnical consultant to perform test borings and other underground soils testing as may be deemed necessary by the Architect/Engineer or the Contractor. Contractor shall not be obligated to provide such surveys or soil tests and shall be entitled to rely upon the accuracy and completeness of the information provided; subject, however, to the provisions of Section 2.4.S hereof. Owner shall provide Contractor, as soon as reasonably possible following the execution of the Contract Documents, all surveys or other survey information in its possession describing the physical characteristics of the Project Site, together with soils reports, subsurface investigations, utility locations, deed restrictions, easements, and legal descriptions then in its possession or control. Upon receipt of all surveys, soils tests, and other Project Site information, Contractor shall promptly advise Owner of any inadequacies in such information and of the need for any additional surveys, soils or subsoil tests. In performing this Work, Contractor shall use the standard of care of experienced contractors and will use its best efforts timely to identify all problems or omissions. Owner shall not be responsible for any delay or damages to the Contractor for any visible or disclosed site conditions or disclosed deficiencies in the Project Site which should have been identified by Contractor and corrected by Owner prior to the execution of the Contract Documents.

7.4 Information; Communication; Coordination. The Owner's Project Representative shall examine any documents or requests for information submitted by the Contractor and shall advise Contractor of Owner's decisions pertaining thereto within a reasonable period of time to avoid unreasonable delay in the progress of the Contractor's services. Contractor shall indicate if any such documents or requests warrant priority consideration. However, decisions pertaining to approval of the Project Schedule as it relates to the date of Substantial Completion, the Project Cost, Contractor's compensation, approving or changing the Contract Sum shall only be effective when approved by Owner in the form of a written Change Order or amendment to the Contract Documents. Owner reserves the right to designate a different Owner's Project Representative provided Contractor is notified in writing of any such change. Owner and Architect/Engineer may communicate with Subcontractors, materialmen, laborers, or suppliers engaged to perform services on the Project, but only for informational purposes. Neither the Owner nor the Architect/Engineer shall attempt to direct the Work of or otherwise interfere with any Subcontractor, materialman, laborer, or supplier, or otherwise interfere with the Work of the Contractor. Owner shall furnish the data required of Owner under the Contract Documents promptly.

7.5 Governmental Body. The Contractor recognizes that the Owner is a governmental body with certain procedural requirements to be satisfied. The Contractor has and will make reasonable allowance in its performance of services for such additional time as may be required for approvals and decisions by the Owner and any other necessary government agency.

7.6 Pre-Completion Acceptance. The Owner shall have the right to take possession of and use any completed portions of the Work, although the time for completing the entire Work

or such portions may not have expired, but such taking possession and use shall not be deemed an acceptance of any Work not completed in accordance with the Contract Documents.

7.7 Ownership and Use of Drawings, Specifications and Other Instruments of Service.

- (1) The Architect/Engineer and the Architect/Engineer's consultants shall be deemed the authors and owners of their respective instruments of service, including the Project Plans and Specifications, and will retain all common law, statutory and other reserved rights, including copyrights. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers shall not own or claim a copyright in the instruments of service. Submittal or distribution to meet official regulatory requirements or for other purposes in connection with this Project is not to be constructed as publication in derogation of the Architect/Engineer's or Architect/Engineer's consultants' reserved rights.
- (2) The Contractor, Subcontractors, Sub-subcontractors and material or equipment suppliers are authorized to use and reproduce the drawings and specifications provided to them solely and exclusively for execution of the Work. All copies made under this authorization shall bear the copyright notice, if any, shown on the Project Plans and Specifications or other instruments of service. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers may not use the drawings or specifications on other projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner, Architect/Engineer and the Architect/Engineer's consultants.

7.8 Owner's Project Representative. Owner's Project Representative is Owner's Agent, who will act as directed by and under the supervision of the Owner, and who will confer with Owner/Architect/Engineer regarding his actions. The Owner's Project Representative's dealings in matters pertaining to the on-site Work shall, in general, be only with the Owner/Architect/Engineer and Contractor and dealings with Subcontractors shall only be through or with the full knowledge of Contractor.

A. Responsibilities. Except as otherwise instructed in writing by Owner, the Owner's Project Representative will:

- (1) Attend preconstruction conferences; arrange a schedule of progress meetings and other job conferences as required in consultation with Owner/Architect/Engineer and notify those expected to attend in advance; and attend meetings and maintain and circulate copies of minutes thereof;
- (2) Serve as Owner/Architect/Engineer's liaison with Contractor, working principally through Contractor's superintendent, to assist in understanding the intent of the Contract Documents. As requested by Owner/Architect/Engineer, assist in obtaining additional details or information when required at the job site for proper execution of the Work;

- (3) Report to Owner/Architect/Engineer whenever he believes that any Work is unsatisfactory, faulty or defective or does not conform to the Contract Documents;
- (4) Accompany visiting inspectors representing public or other agencies having jurisdiction over the project; record the outcome of these inspections and report to Owner/Architect/Engineer;
- (5) Review applications for payment with Contractor for compliance with the established procedure for their submission and forward them with recommendations to Owner/Architect/Engineer; and
- (6) Perform those duties as set forth elsewhere within the Contract Documents.

B. Limitations. Except upon written instructions of Owner, Owner's Project Representative shall not:

- (1) Authorize any deviation from the Contract Documents or approve any substitute materials or equipment;
- (2) Exceed limitations on Owner/Architect/Engineer's authority as set forth in the Contract Documents;
- (3) Undertake any of the responsibilities of Contractor, Subcontractors or Contractor's superintendent, or expedite the Work;
- (4) Advise on or issue directions relative to any aspect of the means, methods, techniques, sequences or procedures of construction unless such is specifically called for in the Contract Documents;
- (5) Advise on or issue directions as to safety precautions and programs in connection with the Work;
- (6) Authorize Owner to occupy the project in whole or in part; or
- (7) Participate in specialized field or laboratory tests.

ARTICLE VIII RESOLUTION OF DISAGREEMENTS; CLAIMS FOR COMPENSATION

8.1 Owner to Decide Disputes. The Owner shall reasonably decide all questions and disputes (with the exception of matters pertaining to the interpretation of the Project Plans and Specifications which shall be resolved by the Architect/Engineer pursuant to Section 6.3) that may arise in the execution and fulfillment of the services provided for under the Contract Documents, in accordance with the Procurement Ordinance.

8.2 Finality. The decision of the Owner upon all claims, questions, disputes and conflicts shall be final and conclusive, and shall be binding upon all parties to the Contract Documents, subject to judicial review as provided in Section 8.5 below.

8.3 No Damages for Delay. If at any time Contractor is delayed in the performance of Contractor's responsibilities under the Contract Documents as the result of a default or failure to perform in a timely manner by Owner or Owner's agents or employees, Contractor shall not be entitled to any damages except for compensation specifically authorized in Article III. Contractor's sole remedy will be a right to extend the time for performance. Nothing herein shall preclude Contractor from any available remedy against any responsible party other than Owner. Contractor shall be responsible for liquidated damages for delay if otherwise provided for in the Contract Documents.

8.4 Permitted Claims Procedure. Where authorized or permitted under the Contract Documents, all claims for additional compensation by Contractor, extensions of time affecting the Substantial Completion Date, for payment by the Owner of costs, damages or losses due to casualty, Force Majeure, Project Site conditions or otherwise, shall be governed by the following:

- (1) All claims must be submitted as a request for Change Order in the manner as provided in Article V.
- (2) The Contractor must submit a notice of claim to Owner's Project Representative and to the Architect/Engineer within fifteen (15) days of the beginning of such occurrence. Failure to submit a claim within the requisite 15-day period shall constitute a waiver of the right to pursue said claim.
- (3) Within twenty (20) days of submitting its notice of claim, the Contractor shall submit to the Owner's Project Representative its request for Change Order, which shall include a written statement of all details of the claim, including a description of the Work affected.
- (4) After receipt of a request for Change Order, the Owner's Project Representative, in consultation with the Architect/Engineer, shall deliver to the Contractor, within twenty (20) days after receipt of request, its written response to the claim.
- (5) In the event the Owner and Contractor are unable to agree on the terms of a Change Order, the Owner shall have the option to instruct the Contractor to proceed with the Work. In that event, the Owner shall pay for those parts of the Work, the scope and price of which are not in dispute. The balance of the disputed items in the order to proceed will be resolved after completion of the Work, based upon completed actual cost.
- (6) The rendering of a decision by Owner with respect to any such claim, dispute or other matter (except any which have been waived by the making or acceptance of final payment) will be a condition precedent to any exercise by Owner or Contractor of such right or remedies as either may otherwise have under the Contract Documents or by laws or regulations in respect of any such claim, dispute or other matter.

8.5 Contract Claims and Disputes. After completion of the process set forth in Section 8.4 above, any unresolved dispute under this Agreement shall be decided by the Purchasing Official in accordance with Section 2-26-63 of the Manatee County Code of Laws, subject to an administrative hearing process as provided in Section 2-26-64. The decision of the hearing officer in accordance with Section 2-26-64 of the Manatee County Code of Laws shall be the final and conclusive decision subject to exclusive judicial review in circuit court by a petition for certiorari.

8.6 Claims for Consequential Damages. The Contractor and Owner waive claims against each other for consequential damages arising out of or relating to this Agreement. This mutual waiver includes:

- (1) damages incurred by the Owner for rental expenses, for losses of use, income, profit, financing, business and reputation, and for loss of management or employee productivity or of the services of such persons, unless any of such damages or losses are covered by insurance placed by the Contractor; and
- (2) damages incurred by the Contractor for principal office expenses including the compensation of personnel stationed there, for losses of financing, business and reputation, and for loss of profit except anticipated profit arising directly from the Work.

This mutual waiver is applicable, without limitation, to all consequential damages due to either party's termination in accordance with Article XIV. Nothing contained in this Section 8.6 shall be deemed to preclude assessment of liquidated direct damages, when applicable, in accordance with the requirements of the Contract Documents.

ARTICLE IX INDEMNITY

9.1 Indemnity.

A. Indemnification Generally. To the fullest extent permitted by law, the Contractor shall indemnify and hold harmless the Owner, Architect/Engineer, Architect/Engineer's consultants, and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorney's fees, arising out of or resulting from performance of the Work, provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property, but only to the extent caused by the negligent acts or omissions of the Contractor, a Subcontractor or anyone directly or indirectly employed by them or anyone for whose acts they may be liable, regardless of whether such claim, damage, loss or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce other rights or obligations of indemnity which would otherwise exist as to a party or person described in this Section 9.1.

B. Indemnification; Enforcement Actions. The Contractor's duty to indemnify and hold harmless the Owner in Section 9.1 above shall extend to fines, penalties and costs incurred by the Owner as related to any enforcement action taken by local, state, regional or federal regulatory entities. The Owner may deduct any of such fines, penalties and costs as described in this Section from any unpaid amounts then or thereafter due the Contractor under the Contract Documents. Any of such fines, penalties and costs not so deducted from any unpaid amounts due the Contractor shall be payable to the Owner at the demand of the Owner, together with interest from the date of the demand at the maximum allowable rate.

C. Claims by Employees. In claims against any person or entity indemnified under this Section 9.1 by an employee of the Contractor, a Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, the indemnification obligation under Section 9.1.A. shall not be limited by a limitation on amount or type of damages, compensation or benefits payable by or for the Contractor or a Subcontractor under workers' compensation acts, disability benefit acts or other employee benefit acts.

9.2 Duty to Defend. The Contractor shall defend the Owner in any action, lawsuit, mediation or arbitration arising from the alleged negligence, recklessness or intentionally wrongful conduct of the Contractor and other persons employed or utilized by the Contractor in the performance of the Work. Notwithstanding any other provisions within this Article IX, so long as Contractor, through its own counsel, performs its obligation to defend the Owner pursuant to this Section, Contractor shall not be required to pay the Owner's costs associated with the Owner's participation in the defense.

ARTICLE X ACCOUNTING RECORDS; OWNERSHIP OF DOCUMENTS

10.1 Accounting Records. Records of expenses pertaining to all services performed shall be kept in accordance with generally accepted accounting principles and procedures.

10.2 Inspection and Audit. The Contractor's records shall be open to inspection and subject to examination, audit, and/or reproduction during normal working hours by the Owner's agent or authorized representative to the extent necessary to adequately permit evaluation and verification of any invoices, payments or claims submitted by the Contractor or any of its payees during the performance of the Work. These records shall include, but not be limited to, accounting records, written policies and procedures, Subcontractor files (including proposals of successful and unsuccessful bidders), original estimates, estimating worksheets, correspondence, Change Order files (including documentation covering negotiated settlements), and any other supporting evidence necessary to substantiate charges related to the Contract Documents. They shall also include, but not be limited to, those records necessary to evaluate and verify direct and indirect costs (including overhead allocations) as they may apply to costs associated with the Contract Documents. For such audits, inspections, examinations and evaluations, the Owner's agent or authorized representative shall have access to said records from the effective date of the

Contract Documents, for the duration of Work, and until three (3) years after the date of final payment by the Owner to the Contractor pursuant to the Contract Documents.

10.3 Access. The Owner's agent or authorized representative shall have access to the Contractor's facilities and all necessary records to conduct audits in compliance with this Article. The Owner's agent or authorized representative shall give the Contractor reasonable advance notice of intended inspections, examinations, and/or audits.

10.4 Ownership of Documents. Upon obtainment of Substantial Completion or termination of the Agreement, all records, documents, tracings, plans, specifications, maps, evaluations, reports, transcripts and other technical data, other than working papers, prepared or developed by the Contractor shall be delivered to and become the property of the Owner. The Contractor at its own expense may retain copies for its files and internal use.

ARTICLE XI PUBLIC CONTRACT LAWS

11.1 Equal Opportunity Employment.

A. Employment. The Contractor shall not discriminate against any employee or applicant for employment because of race, creed, sex, color, national origin, disability or age, and will take affirmative action to ensure that all employees and applicants are afforded equal employment opportunities without discrimination because of race, creed, sex, color, national origin, disability or age. Such action will be taken with reference to, but shall not be limited to, recruitment, employment, job assignment, promotion, upgrading, demotion, transfer, layoff or termination, rates of training or retraining, including apprenticeship and on-the-job training.

B. Participation. No person shall, on the grounds of race, creed, sex, color, national origin, disability or age, be excluded from participation in, be denied the proceeds of, or be subject to discrimination in the performance of the Agreement.

11.2 Immigration Reform and Control Act of 1986. Contractor acknowledges that it is responsible for complying with the provisions of the Immigration Reform and Control Act of 1986, located at 8 U.S.C. Section 1324, et seq., and regulations relating thereto. Failure to comply with the above statutory provisions shall be considered a material breach and shall be grounds for immediate termination of this Agreement.

11.3 No Conflict of Interest. The Contractor warrants that it has not employed or retained any company or person, other than a bona fide employee working solely for the Contractor to solicit or secure this Agreement, and that it has not paid or agreed to pay any person, company, corporation, individual, or firm other than a bona fide employee working solely for the Contractor, any fee, commission, percentage, gift or any other consideration, contingent upon or resulting from the award or making of this Agreement.

A. No Interest in Business Activity. By accepting award of this Agreement, the Contractor, which shall include its directors, officers and employees, represents that it presently has no interest in and shall acquire no interest in any business or activity which would conflict in any manner with the performance of services required hereunder, including without limitation as described in the Contractor's own professional ethical requirements. An interest in a business or activity which shall be deemed a conflict includes but is not limited to direct financial interest in any of the material and equipment manufacturers, suppliers, distributors, or contractors who will be eligible to supply material and equipment for the Project for which the Contractor is furnishing its services required hereunder.

B. No Appearance of Conflict. The Contractor shall not knowingly engage in any contractual or professional obligations that create an appearance of a conflict of interest with respect to the services provided pursuant to the Agreement. The Contractor has provided the Affidavit of No Conflict, incorporated into the Contract Documents as Exhibit "C", as a material inducement for Owner entering the Agreement. If, in the sole discretion of the County Administrator or designee, a conflict of interest is deemed to exist or arise during the term of this Agreement, the County Administrator or designee may cancel this Agreement, effective upon the date so stated in a written notice of cancellation, without penalty to the Owner.

11.4 Truth in Negotiations. By execution of the Contract Documents, the Contractor certifies to truth-in-negotiations and that wage rates and other factual unit costs supporting the compensation are accurate, complete and current at the time of contracting. Further, the original Contract Sum and any additions thereto shall be adjusted to exclude any significant sums where the Owner determines the Contract Sum was increased due to inaccurate, incomplete or non-current wage rates and other factual unit costs. Such adjustments must be made within one (1) year after final payment to the Contractor.

11.5 Public Entity Crimes. The Contractor is directed to the Florida Public Entity Crimes Act, Section 287.133, Florida Statutes, specifically section 2(a), and the Owner's requirement that the Contractor comply with it in all respects prior to and during the term of the Agreement.

ARTICLE XII FORCE MAJEURE, FIRE OR OTHER CASUALTY

12.1 Force Majeure.

A. Unavoidable Delays. Delays in any performance by any party contemplated or required hereunder due to fire, flood, sinkhole, earthquake or hurricane, acts of God, unavailability of materials, equipment or fuel, war, declaration of hostilities, revolt, civil strife, altercation or commotion, strike, labor dispute, or epidemic, archaeological excavation, lack of or failure of transportation facilities, or any law, order, proclamation, regulation, or ordinance of any government or any subdivision thereof, or for any other similar cause to those enumerated, beyond the reasonable control and which with due diligence could not have been reasonably anticipated, shall be deemed to be events of Force Majeure and any such delays shall be excused. In the event such party is delayed in the performance of any Work or obligation pursuant to the Contract Documents for any of the events of Force Majeure stated in this Section 12.1, the date for

performance required or contemplated by the Contract Documents shall be extended by the number of calendar days such party is actually delayed.

B. Concurrent Contractor Delays. If a delay is caused for any reason provided in Section 12.1.A. and during the same time period a delay is caused by Contractor, the date for performance shall be extended as provided in 12.1.A. but only to the extent the time is or was concurrent.

C. Notice; Mitigation. The party seeking excuse for nonperformance based on Force Majeure shall give written notice to the Owner, if with respect to the Contractor, or to the Contractor if with respect to the Owner, specifying its actual or anticipated duration. Each party seeking excuse from nonperformance based on Force Majeure shall use its best efforts to rectify any condition causing a delay and will cooperate with the other party, except that neither party shall be obligated to incur any unreasonable additional costs and expenses to overcome any loss of time that has resulted.

12.2 Casualty; Actions by Owner and Contractor. During the construction period, if the Project or any part thereof shall have been damaged or destroyed, in whole or in part, the Contractor shall promptly make proof of loss; and Owner and Contractor shall proceed promptly to collect, or cause to be collected, all valid claims which may have arisen against insurers or others based upon such damage or destruction. The Contractor shall diligently assess the damages or destruction and shall prepare an estimate of the cost, expenses, and other charges, including normal and ordinary compensation to the Contractor, necessary for reconstruction of the Project substantially in accordance with the Project Plans and Specifications. Within fifteen (15) days following satisfaction of the express conditions described in subsections (1), (2) and (3) below, the Contractor covenants and agrees diligently to commence reconstruction and to complete the reconstruction or repair of any loss or damage by fire or other casualty to the Project to substantially the same size, floor area, cubic content, and general appearance as prior to such loss or damage:

- (1) Receipt by the Owner or the trustee of the proceeds derived from collection of all valid claims against insurers or others based upon such damage or destruction, and receipt of other sums from any source such that the funds necessary to pay the Project Cost and any additions to the Project Cost necessitated for repair or reconstruction are available;
- (2) Written agreement executed by the Contractor and the Owner, by amendment to the Contract Documents or otherwise, authorizing and approving the repair or reconstruction and any additions to the Project Cost necessitated thereby, including any required adjustment to the Contract Sum; and
- (3) Final approval by the Owner of the Project Plans and Specifications for such repair or reconstruction and issuance of any required building permit.

12.3 Approval of Plans and Specifications. The Owner agrees to approve the plans and specifications for such reconstruction or repair if the reconstruction or repair contemplated by such plans and specifications is economically feasible, and will restore the Project, or the damaged portion thereof, to substantially the same condition as prior to such loss or damage, and such plans

and specifications conform to the applicable laws, ordinances, codes, and regulations. The Owner agrees that all proceeds of any applicable insurance or other proceeds received by the Owner or the Contractor as a result of such loss or damage shall be used for payment of the costs, expenses, and other charges of the reconstruction or repair of the Project.

12.4 Notice of Loss or Damage. The Contractor shall promptly give the Owner written notice of any significant damage or destruction to the Project, defined as loss or damage which it is contemplated by Contractor will increase the Contract Sum or extend the Substantial Completion Date, stating the date on which such damage or destruction occurred, the then expectations of Contractor as to the effect of such damage or destruction on the use of the Project, and the then proposed schedule, if any, for repair or reconstruction of the Project. Loss or damage which the Contractor determines will not affect the Contract Sum or Substantial Completion Date will be reported to Owner and Architect/Engineer immediately, and associated corrective actions will be undertaken without delay.

ARTICLE XIII REPRESENTATIONS, WARRANTIES AND COVENANTS

13.1 Representations and Warranties of Contractor. The Contractor represents and warrants to the Owner each of the following.

A. The Contractor is a construction company, organized under the laws of the State of _____, authorized to transact business in the State of Florida, with _____ as the primary qualifying agent. Contractor has all requisite power and authority to carry on its business as now conducted, to own or hold its properties, and to enter into and perform its obligations hereunder and under each instrument to which it is or will be a party, and is in good standing in the State of Florida.

B. Each Contract Document to which the Contractor is or will be a party constitutes, or when entered into will constitute, a legal, valid, and binding obligation of the Contractor enforceable against the Contractor in accordance with the terms thereof, except as such enforceability may be limited by applicable bankruptcy, insolvency, or similar laws from time to time in effect which affect creditors' rights generally and subject to usual equitable principles in the event that equitable remedies are involved.

C. There are no pending or, to the knowledge of the Contractor, threatened actions or proceedings before any court or administrative agency, within or without the State of Florida, against the Contractor or any partner, officer, or agent of the Contractor which question the validity of any document contemplated hereunder, or which are likely in any case, or in the aggregate, to materially adversely affect the consummation of the transactions contemplated hereunder, or materially adversely affect the financial condition of the Contractor.

D. The Contractor has filed or caused to be filed all federal, state, local, or foreign tax returns, if any, which were required to be filed by the Contractor, and has paid, or caused to be paid, all taxes shown to be due and payable on such returns or on any assessments levied against the Contractor.

E. Neither Contractor nor any agent or person employed or retained by Contractor has acted fraudulently or in bad faith or in violation of any statute or law in the procurement of this Agreement.

F. The Contractor shall timely fulfill or cause to be fulfilled all of the terms and conditions expressed herein which are within the control of the Contractor or which are the responsibility of the Contractor to fulfill. The Contractor shall be solely responsible for the means and methods of construction.

G. It is recognized that neither the Architect/Engineer, the Contractor, nor the Owner has control over the cost of labor, materials, or equipment, over a Subcontractor's methods of determining bid prices, or over competitive bidding, market, or negotiating conditions.

H. During the term of the Contract Documents, and the period of time that the obligations of the Contractor under the Contract Documents shall be in effect, the Contractor shall cause to occur and to continue to be in effect those instruments, documents, certificates, and events contemplated by the Contract Documents that are applicable to, and the responsibility of, the Contractor.

I. The Contractor shall assist and cooperate with the Owner and shall accomplish the construction of the Project in accordance with the Contract Documents and the Project Plans and Specifications, and will not knowingly violate any laws, ordinances, rules, regulations, or orders that are or will be applicable thereto.

J. Contractor warrants and guarantees to Owner that all Work will be in accordance with the Contract Documents and will not be defective, and that Owner, representatives of Owner, and governmental agencies with jurisdictional interests will have access to the Work at reasonable times for their observation, inspecting and testing. Contractor shall give Architect/Engineer timely notice of readiness of the Work for all required approvals and shall assume full responsibility, including costs, in obtaining required tests, inspections, and approval certifications and/or acceptance, unless otherwise stated by Owner.

K. If any Work (including Work of others) that is to be inspected, tested, or approved is covered without written concurrence of Architect/Engineer, it must, if requested by Architect/Engineer, be uncovered for observation. Such uncovering shall be at Contractor's expense unless Contractor has given Architect/Engineer timely notice of Contractor's intention to cover the same and Architect/Engineer has not acted with reasonable promptness in response to such notice. Neither observations by Architect/Engineer nor inspections, tests, or approvals by others shall relieve Contractor from Contractor's obligations to perform the Work in accordance with the Contract Documents.

L. If the Work is defective, or Contractor fails to supply sufficient skilled workers, or suitable materials or equipment, or fails to furnish or perform the Work in such a way that the completed Work will conform to the Contract Documents, Owner may order Contractor to stop the Work, or any portion thereof and terminate payments to the Contractor until the cause for such order has been eliminated. Contractor shall bear all direct, indirect and consequential costs for satisfactory reconstruction or removal and replacement with non-defective Work, including, but not limited to fees and charges of Architect/Engineers, attorneys and other professionals and any additional expenses experienced by Owner due to delays to other

Contractors performing additional Work and an appropriate deductive change order shall be issued. Contractor shall further bear the responsibility for maintaining the schedule and shall not be entitled to an extension of the Contract Time or the recovery of delay damages due to correcting or removing defective Work.

M. If Contractor fails within seven (7) days after written notice to correct defective Work, or fails to perform the Work in accordance with the Contract Documents, or fails to comply with any other provision of the Contract Documents, Owner may correct and remedy any such deficiency to the extent necessary to complete corrective and remedial action. Owner may temporarily exclude Contractor from all or part of the site, temporarily take possession of all or part of the Work, Contractor's tools, construction equipment and machinery at the site or for which Owner has paid Contractor but which are stored elsewhere, all for such duration as is reasonably necessary to correct the deficiency. All direct and indirect costs of Owner in exercising such rights and remedies will be charged against Contractor in an amount approved as to reasonableness by Architect/Engineer and a Change Order will be issued incorporating the necessary revisions.

N. If within three (3) years after the Substantial Completion Date or such longer period of time as may be prescribed by laws or regulations or by the terms of any applicable special guarantee required by the Contract Documents, any Work is found to be defective, Contractor shall promptly, without cost to Owner and in accordance with Owner's written instructions, either correct such defective Work or if it has been rejected by Owner, remove it from the site and replace it with non-defective Work. If Contractor does not promptly comply with the terms of such instruction, Owner may have the defective Work corrected/removed and all direct, indirect and consequential costs of such removal and replacement will be paid by Contractor. Failing payment by the Contractor and notwithstanding any other provisions of the Contract Documents to the contrary, Owner shall have the right to bring a direct action in the Circuit Court to recover such costs.

13.2 Representations of the Owner. To the extent permitted by law, the Owner represents to the Contractor that each of the following statements is presently true and accurate:

- A. The Owner is a validly existing political subdivision of the State of Florida.
- B. The Owner has all requisite corporate or governmental power and authority to carry on its business as now conducted and to perform its obligations under the Contract Documents and each Contract Document contemplated hereunder to which it is or will be a party.
- C. The Contract Documents and each Contract Document contemplated hereby to which the Owner is or will be a party has been duly authorized by all necessary action on the part of, and has been or will be duly executed and delivered by, the Owner, and neither the execution and delivery thereof nor compliance with the terms and provisions thereof or hereof:
 - (a) requires the approval and consent of any other person or party, except such as have been duly obtained or as are specifically noted herein;
 - (b) contravenes any existing law, judgment, governmental rule, regulation or order applicable to or binding on the Owner; or
 - (c) contravenes or results in any breach of, default under, or result in the creation of any lien or encumbrance upon the Owner under any indenture, mortgage, deed of trust, bank loan, or credit agreement, the charter, ordinances, resolutions, or any other agreement or instrument to which the Owner is a

party, specifically including any covenants of any bonds, notes, or other forms of indebtedness of the Owner outstanding on the date of the Contract Documents.

D. The Contract Documents and each document contemplated hereby to which the Owner is or will be a party constitutes, or when entered into will constitute, a legal, valid, and binding obligation of the Owner enforceable against the Owner in accordance with the terms thereof, except as such enforceability may be limited by applicable bankruptcy, insolvency, or similar laws from time to time in effect which affect creditors' rights generally, and subject to usual equitable principles in the event that equitable remedies are involved.

E. There are no pending or, to the knowledge of the Owner, threatened actions or proceedings before any court or administrative agency against the Owner which question the validity of the Contract Documents or any document contemplated hereunder, or which are likely in any case or in the aggregate to materially adversely affect the consummation of the transactions contemplated hereunder or the financial or corporate condition of the Owner.

F. The Owner shall use due diligence to timely fulfill or cause to be fulfilled all of the conditions expressed in the Contract Documents which are within the control of the Owner or which are the responsibility of the Owner to fulfill.

G. During the pendency of the Work and while the obligations of the Owner under the Contract Documents shall be in effect, the Owner shall cause to occur and to continue to be in effect and take such action as may be necessary to enforce those instruments, documents, certificates and events contemplated by the Contract Documents that are applicable to and the responsibility of the Owner.

H. The Owner shall assist and cooperate with the Contractor in accomplishing the construction of the Project in accordance with the Contract Documents and the Project Plans and Specifications, and will not knowingly violate any laws, ordinances, rules, regulations, orders, contracts, or agreements that are or will be applicable thereto or, to the extent permitted by law, enact or adopt any resolution, rule, regulation, or order, or approve or enter into any contract or agreement, including issuing any bonds, notes, or other forms of indebtedness, that will result in the Contract Documents or any part thereof, or any other instrument contemplated by and material to the timely and effective performance of a party's obligations hereunder, to be in violation thereof.

ARTICLE XIV TERMINATION AND SUSPENSION

14.1 Termination for Cause by Owner. This Agreement may be terminated by Owner upon written notice to the Contractor should Contractor fail substantially to perform a material obligation in accordance with the terms of the Contract Documents through no fault of the Owner. In the event Owner terminates for cause and it is later determined by a court of competent jurisdiction that such termination for cause was not justified, then in such event such termination for cause shall automatically be converted to a termination without cause pursuant to Section 14.2.

A. Nonperformance. If the Contractor fails to timely perform any of its

obligations under the Contract Documents, including any obligation the Contractor assumes to perform Work with its own forces, or if it persistently or repeatedly refuses or fails, except in case for which extension of time is provided, to supply enough properly skilled workmen or proper materials, or fails, without being excused, to maintain an established schedule (failure to maintain schedule shall be defined as any activity that falls thirty (30) days or more behind schedule) which has been adopted by the Construction Team, or it fails to make prompt payment to Subcontractors for materials or labor, or disregards laws, rules, ordinances, regulations, or orders of any public authority having jurisdiction, or otherwise is guilty of substantial violations of the Agreement the Owner may, after seven (7) days written notice, during which period the Contractor fails to perform such obligation, make good such deficiencies and perform such actions. The Contract Sum shall be reduced by the cost to the Owner of making good such deficiencies, and the Contractor's compensation shall be reduced by an amount required to manage the making good of such deficiencies. Provided, however, nothing contained herein shall limit or preclude Owner from pursuing additional damages from Contractor because of its breach.

B. Insolvency. If the Contractor is adjudged bankrupt, or if it makes a general assignment for the benefit of its creditors, or if a receiver is appointed because its insolvency, then the Owner may, without prejudice to any other right or remedy, and after giving the Contractor and its surety, if any, fourteen (14) days written notice, and during which period the Contractor fails to cure the violation, terminate the Agreement. In such case, the Contractor shall not be entitled to receive any further payment. Owner shall be entitled to recover all costs and damages arising because of failure of Contractor to perform as provided in the Contract Documents, as well as reasonable termination expenses, and costs and damages incurred by the Owner may be deducted from any payments left owing the Contractor.

C. Illegality. Owner may terminate the Agreement if Contractor disregards laws or regulations of any public body having jurisdiction.

D. Rights of Owner. The Owner may, after giving Contractor (and the surety, if there is one) seven (7) days written notice, terminate the services of Contractor for cause; exclude Contractor from the Project Site and take possession of the Work and of all Contractor's tools, construction equipment and machinery at the Project Site and use the same to the full extent they could be used (without liability to Contractor for trespass or conversion); incorporate in the Work all materials and equipment stored at the Project Site or for which Owner has paid Contractor but which are stored elsewhere, and finish the Work as Owner may deem expedient. In such case, Contractor shall not be entitled to receive any further payment beyond an amount equal to the value of material and equipment not incorporated in the Work, but delivered and suitably stored, less the aggregate of payments previously made. If the direct and indirect costs of completing the Work exceed the unpaid balance of the Contract Sum, Contractor shall pay the difference to Owner. Such costs incurred by Owner shall be verified by Owner in writing; but in finishing the Work, Owner shall not be required to obtain the lowest quote for the Work performed. Contractor's obligations to pay the difference between such costs and such unpaid balance shall survive termination of the Agreement. In such event and notwithstanding any other provisions of the Contract Documents to the contrary, Owner shall be entitled to bring a direct action in the Circuit Court to recover such costs.

14.2 Termination without Cause by Owner. The Owner, through its County Administrator or designee, shall have the right to terminate the Agreement, in whole or in part, without cause upon sixty (60) calendar days' written notice to the Contractor. In the event of

such termination for convenience, the Owner shall compensate Contractor for payments due through the date of termination, and one subsequent payment to cover costs of Work performed through the date of termination, subject to the terms and conditions of Section 3.1. The Contractor shall not be entitled to any other further recovery against the Owner, including, but not limited to, anticipated fees or profit on Work not required to be performed, or consequential damages or costs resulting from such termination.

A. Release of Contractor. As a condition of Owner's termination rights provided for in this subsection, Contractor shall be released and discharged from all obligations arising by, through, or under the terms of the Contract Documents, and the Payment and Performance Bond shall be released. Owner shall assume and become responsible for the reasonable value of Work performed by Subcontractors prior to termination plus reasonable direct close-out costs, but in no event shall Subcontractors be entitled to unabsorbed overhead, anticipatory profits, or damages for early termination.

B. Waiver of Protest. Contractor hereby waives any right to protest the exercise by Owner of its rights under this Section that may apply under the Procurement Ordinance.

14.3 Suspension without Cause. Owner may, at any time and without cause, suspend the Work or any portion thereof for a period of not more than ninety (90) days by written notice to Contractor, which will fix the date on which Work will be resumed. Contractor shall be allowed an increase in the Contract Sum or an extension of the Contract Time, or both, directly attributable to any suspension if Contractor makes an approved claim therefor.

14.4 Termination Based Upon Abandonment, Casualty or Force Majeure. If, after the construction commencement date (i) Contractor abandons the Project (which for purposes of this paragraph shall mean the cessation of all construction and other activities relating to the Project, excluding those which are necessary to wind down or otherwise terminate all outstanding obligations with respect to the Project, and no recommencement of same within one hundred twenty (120) days following the date of cessation), or (ii) the Project is stopped for a period of thirty (30) consecutive days due to an instance of Force Majeure or the result of a casualty resulting in a loss that cannot be corrected or restored within one hundred twenty (120) days (excluding the time required to assess the damage and complete the steps contemplated under Section 12.2), the Owner shall have the right to terminate the Agreement and pay the Contractor its compensation earned or accrued to date.

14.5 Vacation of Project Site; Delivery of Documents. Upon termination by Owner pursuant to Section 14.2 or 14.4, Contractor shall withdraw its employees and its equipment, if any, from the Project Site on the effective date of the termination as specified in the notice of termination (which effective date shall not be less than two (2) working days after the date of delivery of the notice), regardless of any claim the Contractor may or may not have against the Owner. Upon termination, the Contractor shall deliver to the Owner all original papers, records, documents, drawings, models and other material set forth and described in the Contract Documents.

14.6 Termination by the Contractor. If, through no act or fault of Contractor, the

Work is suspended for a period of more than ninety (90) consecutive days by Owner or under an order of court or other public authority, or Owner fails to act on any Application for Payment or fails to pay Contractor any sum finally determined to be due; then Contractor may, upon fourteen (14) days written notice to Owner terminate the Agreement and recover from Owner payment for all Work executed, any expense sustained plus reasonable termination expenses. In lieu of terminating the Agreement, if Owner has failed to act on any Application for Payment or Owner has failed to make any payment as aforesaid, Contractor may upon fourteen (14) days written notice to Owner stop the Work until payment of all amounts then due.

(Remainder of this page intentionally left blank)

SAMPLE

Exhibit A
Title(s) of Drawings

SAMPLE

Exhibit B
Title(s) of Specifications

SAMPLE

Exhibit C
Affidavit of No Conflict

SAMPLE

Exhibit D
Contractor's Certificate(s) of Insurance

SAMPLE

Exhibit E
Contractor's Payment and Performance Bond

SAMPLE

Exhibit F
Standard Forms

SAMPLE

APPLICATION FOR PAYMENT

Request No.: _____ Project No.: _____
 Purchase Order No.: _____
 County Bid No.: _____
 Consultant: _____

Project: _____
 From: _____ To: _____

CONTRACT PAYMENT SUMMARY

Original Contract Amount:				\$	-
Change Order(s):				\$	-
Change order summary:					
Number	Date Approved	Additive	Deductive		
SUBTOTALS:		\$	-	\$	-
Net change order subtotal (Additive less Deductive):				\$	-
Current Contract Amount (CCA): (Original Amount + Change Order(s))				\$	-
		Previous Status	Total WIP		
Value of the Work in Place (WIP)	\$	-	\$	-	
Value of Stored Materials	\$	-	\$	-	
Total Earned (\$ and % of CCA)	\$	-	\$	-	
Retainage (\$ and % of CCA)	\$	-	\$	-	
Net Earned (Total earned minus retainage)				\$	-
TOTAL PREVIOUS PAYMENTS				\$	-
AMOUNT DUE THIS PAYMENT (Net Earned minus Previous Payments)				\$	-

CONTRACTOR'S AFFIDAVIT OF NOTICE

CERTIFICATE: The undersigned CONTRACTOR certifies that all items and amounts shown on this Application for Payment are on account of work performed, materials supplied and/or materials stored on site and paid for by Contractor in accordance with the Contract Documents with due consideration for previous Payment(s), if any, received by the Contractor from the County, and that the Amount Due this Payment shown is now due.

NOTARY:

CONTRACTOR:

State of Florida, County of _____

 Name of person authorized to sign Affidavit of Notice

Sworn to (or affirmed) and subscribed before me this _____ day of _____ by _____

 TITLE

 (Name of person giving notice)

Contractor name, address and telephone no.:

 (Signature of Notary Public - State of Florida)
 Print, Type or Stamp Commissioned Name of
 Notary Public:

Personally Known _____ or Produced Identification _____
 Type of Identification Produced: _____

VERIFICATION, RECOMMENDATION, CONCURRENCES AND APPROVALS

(Signatures)

(Date)

Quantities verified by: _____

Consultant/Engineer: _____

Project Management: _____

Department Head: _____

Payment approved by the
 Board of County Commissioners: _____

Attested to by the Clerk of Circuit Court: _____

CERTIFICATE OF SUBSTANTIAL COMPLETION (S.C.)	CHECK ONE:	
	Partial	Total
Project Title:	Date Submitted:	
Contractor Data: Name: Address: City/State/Zip:	Project No:	
	S. C. Date (Proposed)	
<p>If the "Partial" completion box above is checked, the following description applies to the work for which substantial completion is being sought. Otherwise, the work described in the Contract including approved changes, if any, is certified to be substantially complete: (Description of the portion of work substantially completed):</p> <div style="text-align: center; font-size: 2em; opacity: 0.2; transform: rotate(-30deg); pointer-events: none;"> SAMPLE </div> <p style="text-align: center;">(USE CONTINUATION SHEETS IF NECESSARY)</p>		
<p>A tentative list of items to be completed or corrected is attached hereto. This list may not be all-inclusive, and the failure to include an item does not alter the Contractor's responsibility to complete all of the contract work in accordance with the Contract Documents. The items in the tentative list shall be completed or corrected by the Contractor within _____ days of substantial completion. The approved substantial completion date is: _____</p>		
Contractor Signature	Date	Engineer's Approval
		Date
Printed Name and Title	Printed Name and Title	
<p>The Contractor shall be responsible for security, operation, safety, maintenance, HVAC, insurance and warranties in accordance with the Contract. The County will assume the responsibility for paying the cost of electrical power from midnight of the date of Engineer's approval as indicated above.</p>		
<p>ATTACH THE INSPECTOR'S FINAL WALKTHROUGH LIST OF DEFICIENCIES.</p>		

**FINAL RECONCILIATION, WARRANTY PERIOD DECLARATION
AND CONTRACTOR'S AFFIDAVIT**

Project Title:	Date Submitted:
----------------	-----------------

Contractor Data: Name: Address: City/State/Zip:	Project No:
	Warranty (months):

This Final Reconciliation is for the work performed for Manatee County by the above named contractor, hereinafter called CONTRACTOR, pursuant to the contract dated _____ as amended, and acts as an addendum thereto.

It is agreed that all quantities and prices in the attached Final Pay Estimate No. _____ are correct and that the amount of \$ _____ including retainage is due to the CONTRACTOR, that no claims are outstanding as between the parties, and that the above stated sum represents the entirety of monies owed the CONTRACTOR.

It is further agreed that the warranty period for CONTRACTOR'S work pursuant to the Contract is from _____ to _____

As (title) _____ for CONTRACTOR, I have authority to bind said CONTRACTOR, and as such make this final reconciliation, declaration and affidavit for the purpose of inducing Manatee County to make final payment to CONTRACTOR for work done at/upon _____ under said contract:

CONTRACTOR has paid all social security and withholding taxes accrued in connection with the construction project.

CONTRACTOR has paid all workers' compensation and other insurance premiums incurred in connection with this construction project.

CONTRACTOR has paid for all required permits in connection with this construction project.

All laborers, material, men, suppliers, subcontractors and service professionals who worked for and/or supplied materials, equipment and/or services to the CONTRACTOR under this construction contract have been paid in full.

(Affiant Signature)

NOTARY:
State of Florida, County of _____, Sworn to (or affirmed) and subscribed before me this _____ day of _____, _____, by _____ (person giving notice).

Signature of Notary Public - State of Florida: _____
Print, Type or Stamp Commissioned Name of Notary Public:

Personally Known or Produced Identification
Type of Identification Produced _____

CONTRACT CHANGE ORDER

(for Total Contract Adjusted Amount Greater than \$1,000,000)

PROJECT: _____

Change Order No.: _____

**Contract Amount
(Present Value)**

Project Number: _____

NO. OF ITEM	DESCRIPTION OF ITEM AND CHANGE	DECREASE	INCREASE

BY EXECUTION OF THIS CHANGE ORDER THE CONTRACTOR AGREES THAT ALL CLAIMS FOR ADDITIONAL CONTRACT TIME AND FEES FOR THE ITEMS IN THIS CHANGE ORDER HAVE BEEN SATISFIED.

TOTAL DECREASE: _____

TOTAL INCREASE: _____

Contractor: _____
Address: _____
City / State: _____

THE NET CHANGE OF
 ADJUSTS THE CURRENT CONTRACT AMOUNT FROM
 _____ TO

Contractor Signature: _____ **Date:** _____

____ CALENDAR DAYS ARE ADDED TO THE SCHEDULE
 WHICH CHANGES THE FINAL COMPLETION DATE TO
 _____ MONTH _____ DAY, _____ YEAR

RECOMMENDATION, CONCURRENCES AND APPROVALS

SIGNATURES

DATE

Consultant / Engineer: _____

Project Manager: _____

Division Manager: _____

Project Management Division Manager

Manatee County Purchasing: _____

Purchasing Official

Authority to execute this contract per Manatee County Code, Chapter 2-26,
 and per the delegation by the County Administrator effective 1/26/2009

JUSTIFICATION FOR CHANGE

Change Order No :

Project Number:

1. NECESSITY FOR CHANGE:



2. Is change an alternate bid? (If yes, explain)

3. Does change substantially alter the physical size of the project? (If yes, explain)

4 Effect of this change on other "Prime" contractors?

5 Has the Surety and insurance company been notified, if applicable? CONTRACTOR RESPONSIBILITY