SECTION 05 12 00

STRUCTURAL STEEL

APPROVAL STATUS							
PREPARED BY:	PB	DATE	27July2021	CHECKED BY:	ML	DATE	27July2021
APPROVED BY:	DB	DATE	27July2021				

REVISION STATUS						
REV	ISSUED FOR	REVISED BY	CHECKED BY	APPROVAL	APPROVAL	DATE
0	Bidding					

Engineer's Seal

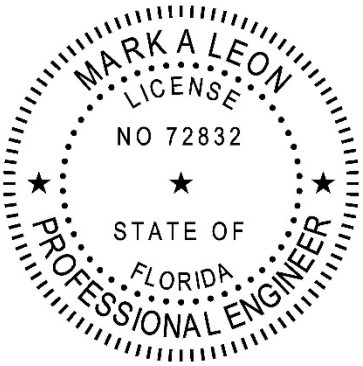

Digital Signature

Mark A. Leon

Digitally signed by Mark A. Leon
DN: cn=Mark A. Leon, o=Wood Environment & Infrastructure Solutions, Inc., ou, email=mark.leon@woodplc.com, c=US
Date: 2021.07.28 16:47:57 -05'00'

MARK A LEON P.E., STATE OF FLORIDA, PROFESSIONAL ENGINEER, LICENSE NO. 72832.

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY MARK A LEON ON 28 JULY 2021, USING AN SHA ATHENTICATION CODE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND THE DIGITAL SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

SECTION 05 12 00

STRUCTURAL STEEL

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO LRFD	(8th Edition; 2017) Bridge Design Specifications

AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC)

AISC 207	(2016; R 2017) Certification Standard for Steel Fabrication and Erection, and Manufacturing of Metal Components
AISC 303	(2016) Code of Standard Practice for Steel Buildings and Bridges
AISC 325	(2017) Steel Construction Manual
AISC 326	(2009) Detailing for Steel Construction
AISC 341	(2016) Seismic Provisions for Structural Steel Buildings
AISC 360	(2016) Specification for Structural Steel Buildings
AISC 420	(2010) Certification Standard for Shop Application of Complex Protective Coating Systems
AISC DESIGN GUIDE 10	(1997) Erection Bracing of Low-Rise Structural Steel Buildings

AMERICAN SOCIETY FOR NONDESTRUCTIVE TESTING (ASNT)

ANSI/ASNT CP-189	(2016) ASNT Standard for Qualification and Certification of Nondestructive Testing Personnel (ANSI/ASNT CP-105-2006)

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B46.1	(2020) Surface Texture, Surface Roughness, Waviness and Lay

AMERICAN WELDING SOCIETY (AWS)

AWS A2.4	(2012) Standard Symbols for Welding, Brazing and Nondestructive Examination
AWS D1.1/D1.1M	(2020) Structural Welding Code - Steel
AWS D1.8/D1.8M	(2016) Structural Welding Code—Seismic Supplement
AWS QC1	(2016) Specification for AWS Certification of Welding Inspectors

ASTM INTERNATIONAL (ASTM)

ASTM A6/A6M	(2017a) Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
ASTM A29/A29M	(2020) Standard Specification for General Requirements for Steel Bars, Carbon and Alloy, Hot-Wrought
ASTM A36/A36M	(2019) Standard Specification for Carbon Structural Steel
ASTM A53/A53M	(2020) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
ASTM A108	(2013) Standard Specification for Steel Bar, Carbon and Alloy, Cold-Finished
ASTM A123/A123M	(2017) Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
ASTM A143/A143M	(2007; R 2020) Standard Practice for Safeguarding Against Embrittlement of Hot-Dip Galvanized Structural Steel Products and Procedure for Detecting Embrittlement
ASTM A193/A193M	(2020) Standard Specification for Alloy-Steel and Stainless Steel Bolting Materials for High-Temperature Service and Other Special Purpose Applications
ASTM A276/A276M	(2017) Standard Specification for Stainless Steel Bars and Shapes
ASTM A307	(2014; E 2017) Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength
ASTM A500/A500M	(2020) Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes

ASTM A563	(2015) Standard Specification for Carbon and Alloy Steel Nuts
ASTM A668/A668M	(2020a) Standard Specification for Steel Forgings, Carbon and Alloy, for General Industrial Use
ASTM A780/A780M	(2020) Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings
ASTM A992/A992M	(2020) Standard Specification for Structural Steel Shapes
ASTM A1085/A1085M	(2015) Standard Specification for Cold-Formed Welded Carbon Steel Hollow Structural Sections (HSS)
ASTM B695	(2004; R 2016) Standard Specification for Coatings of Zinc Mechanically Deposited on Iron and Steel
ASTM C827/C827M	(2016) Standard Test Method for Change in Height at Early Ages of Cylindrical Specimens of Cementitious Mixtures
ASTM C1107/C1107M	(2020) Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Nonshrink)
ASTM F436/F436M	(2019) Standard Specification for Hardened Steel Washers Inch and Metric Dimensions
ASTM F844	(2007a; R 2013) Washers, Steel, Plain (Flat), Unhardened for General Use
ASTM F959/F959M	(2017a) Standard Specification for Compressible-Washer-Type Direct Tension Indicators for Use with Structural Fasteners, Inch and Metric Series
ASTM F1136/F1136M	(2011) Standard Specification for Zinc/Aluminum Corrosion Protective Coatings for Fasteners
ASTM F1554	(2018) Standard Specification for Anchor Bolts, Steel, 36, 55, and 105-ksi Yield Strength
ASTM F2329/F2329M	(2015) Standard Specification for Zinc Coating, Hot-Dip, Requirements for Application to Carbon and Alloy Steel Bolts, Screws, Washers, Nuts, and Special Threaded Fasteners
ASTM F2833	(2011; R 2017) Standard Specification for Corrosion Protective Fastener Coatings with Zinc Rich Base Coat and Aluminum Organic/Inorganic Type

ASTM F3125/F3125M	(2019) Standard Specification for High Strength Structural Bolts and Assemblies, Steel and Alloy Steel, Heat Treated, Inch Dimensions 120 ksi and 150 ksi Minimum Tensile Strength, and Metric Dimensions 830 MPa and 1040 MPa Minimum Tensile Strength

CRANE MANUFACTURERS ASSOCIATION OF AMERICA (CMAA)

CMAA 70	(2015) Specification for Top Running Bridge and Gantry Type Multiple Girder Electric Overhead Traveling Cranes

SOCIETY FOR PROTECTIVE COATINGS (SSPC)

SSPC PA 1	(2016) Shop, Field, and Maintenance Coating of Metals
SSPC Paint 20	(2019) Zinc-Rich Primers (Type I, Inorganic, and Type II, Organic)
SSPC Paint 29	(2002; E 2004) Zinc Dust Sacrificial Primer, Performance-Based
SSPC SP 3	(2018) Power Tool Cleaning
SSPC SP 6/NACE No.3	(2007) Commercial Blast Cleaning

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR Part 1926, Subpart R	Steel Erection

1.2 SUBMITTALS

Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Erection and Erection Bracing Drawings

SD-02 Shop Drawings

Fabrication Drawings Including Details of Connections

SD-03 Product Data

Welding Electrodes and Rods

Non-Shrink Grout

Steel Shims

SD-05 Design Data

Design Calculations for Steel Connections

Shoring and Temporary Bracing

SD-06 Test Reports

Weld Inspection Reports

Bolt Testing Reports

SD-07 Certificates

Steel

Bolts, Nuts, and Washers

AISC Structural Steel Fabricator Quality Certification

Welding Procedures and Qualifications

Welding Electrodes and Rods

Certified Welding Inspector

NDT Technician

Welding Procedure Specifications (WPS)

1.3 AISC QUALITY CERTIFICATION

Work must be fabricated by an AISC Certified Structural Steel Fabricator, in accordance with AISC 207, Category BU. Submit AISC Structural Steel Fabricator quality certification.

1.4 QUALITY ASSURANCE

1.4.1 Preconstruction Submittals

1.4.1.1 Erection and Erection Bracing Drawings

Submit for record purposes. Indicate the sequence of erection, temporary shoring and bracing. The erection drawings must conform to AISC 303. Erection drawings must be reviewed, stamped and sealed by a registered professional engineer.

1.4.2 Fabrication Drawing Requirements

Submit fabrication drawings for approval prior to fabrication. Prepare in accordance with AISC 303, AISC 326 and AISC 325. Fabrication drawings must not be reproductions of contract drawings. Sign and seal fabrication drawings by a registered professional engineer. Include complete information for the fabrication and erection of the structure's components, including the location, type, and size of bolts, welds, member sizes and lengths, connection details, blocks, copes, and cuts. Use AWS A2.4 standard welding symbols. Shoring and temporary bracing must be designed and sealed by a registered professional engineer and submitted for record purposes, with calculations, as part of the drawings. Clearly highlight any deviations from the details shown on the contract drawings highlighted on the fabrication drawings. Explain the reasons for any deviations from the contract drawings.

1.4.3 Delegated Connection Design

Design structural steel connection indicated in the contract documents per AISC 303, Option 3, using the connection loads indicated. Submit design calculations for steel connections signed and sealed by a registered professional engineer.

1.4.4 Certifications

1.4.4.1 Welding Procedures and Qualifications

Prior to welding, submit certification for each welder stating the type of welding and positions qualified for, the code and procedure qualified under, date qualified, and the firm and individual certifying the qualification tests. If the qualification date of the welder or welding operator is more than 6 months old, the welding operator's qualification certificate must be accompanied by a current certificate by the welder attesting to the fact that he has been engaged in welding since the date of certification, with no break in welding service greater than 6 months.

Conform to all requirements specified in AWS D1.1/D1.1M

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Provide the structural steel system, including shop primer on permanent structural framing, complete and ready for use. Provide structural steel systems including design, materials, installation, workmanship, fabrication, assembly, erection, inspection, quality control, and testing in accordance with AISC 303, and AISC 360except as modified in this contract.

2.2 STEEL

2.2.1 Structural Steel

Wide flange and WT shapes, ASTM A992/A992M. Angles, Channels and Plates, ASTM A36/A36M.

2.2.2 Structural Steel Tubing

ASTM A500/A500M, Grade C or ASTM A1085/A1085M.

2.2.3 Steel Pipe

ASTM A53/A53M, Type E or S, Grade B, weight class STD (Standard) or as indicated.

2.3 BOLTS, NUTS, AND WASHERS

Submit the certified manufacturer's mill reports which clearly show the applicable ASTM mechanical and chemical requirements together with the actual test results for the supplied fasteners.

2.3.1 Common Grade Bolts

2.3.1.1 Bolts

ASTM A307, Grade A, plain finish. Bolts installed in a permanent, below grade application shall have a hot dipped zinc coating. The bolt heads and the nuts of the supplied fasteners must be marked with the manufacturer's identification mark, the strength grade and type specified by ASTM specifications.

2.3.1.2 Nuts

ASTM A563, Grade A, heavy hex style.

2.3.1.3 Washers

ASTM F844.

2.3.2 High-Strength Bolts

High strength bolts and nuts must be shipped together in the same shipping container. Fasteners indicated to be galvanized shall be tested by the supplier to show that the galvanized nut with the supplied lubricant provided may be rotated from the snug tight condition well in excess of the rotation required for pretentioned installation without stripping. The supplier shall supply nuts that have been lubricated and tested with the supplied bolts.

2.3.2.1 Bolts

ASTM F3125/F3125M, Grade A325M A325, Type 1 Heavy Hex Head Style, plain finish. Bolts installed in a permanent, below grade application shall have a hot dipped zinc coating.

2.3.2.2 Nuts

ASTM A563, Grade and Style as specified in the applicable ASTM bolt standard.

2.3.2.3 Washers

ASTM F436/F436M, plain carbon steel.

2.3.4 Foundation Anchorage

2.3.4.1 Anchor Rods

ASTM F1554 Gr 36, Class 1A.

2.3.4.2 Anchor Nuts

ASTM A563, Grade A, hex style. Stainless steel ASTM A193/A193M.

2.3.4.3 Anchor Washers

ASTM F844.

2.3.4.4 Anchor Plate Washers

ASTM A36/A36M

2.4 STRUCTURAL STEEL ACCESSORIES

2.4.1 Welding Electrodes and Rods

AWS D1.1/D1.1M. Submit product data for welding electrodes and rods.

2.4.2 Non-Shrink Grout

ASTM C1107/C1107M, with no ASTM C827/C827M shrinkage. Grout must be nonmetallic. Submit product data for non-shrink grout.

2.4.3 Welded Shear Stud Connectors

ASTM A29/A29M, Grades 1010 through 1020. AWS D1.1/D1.1M, Table 7.1, Type B.

2.5 FABRICATION

Fabrication must be in accordance with the applicable provisions of AISC 325. Fabrication and assembly must be done in the shop to the greatest extent possible. Punch, subpunch and ream, or drill bolt [and pin] holes perpendicular to the surface of the member.

Compression joints depending on contact bearing must have a surface roughness not in excess of 500 micro inch as determined by ASME B46.1, and ends must be square within the tolerances for milled ends specified in ASTM A6/A6M.

Shop splices of members between field splices will be permitted only where indicated on the Contract Drawings. Splices not indicated require the approval of the Engineer of Record.

2.5.1 Markings

Prior to erection, identify members by a painted erection mark. Connecting parts assembled in the shop for reaming holes in field connections must be match marked with scratch and notch marks. Do not locate erection markings on areas to be welded. Do not locate match markings in areas that will decrease member strength or cause stress concentrations.

2.5.2 Shop Primer

SSPC Paint 20 or SSPC Paint 29, (zinc rich primer). Shop prime structural steel, except as modified herein, in accordance with SSPC PA 1. Do not prime steel surfaces embedded in concrete, galvanized surfaces, surfaces to receive epoxy coatings, or surfaces within 0.5 inch of the toe of the welds prior to welding (except surfaces on which metal decking and shear studs are to be welded). If flash rusting occurs, re-clean the surface prior to application of primer. Apply primer to a minimum dry film thickness of 2.0 mil. Submit shop primer product data.

Prime slip critical surfaces with a Class B coating in accordance with AISC 325. Submit test report for Class B coating.

Prior to assembly, prime surfaces which will be concealed or inaccessible after assembly. Do not apply primer in foggy or rainy weather; when the ambient temperature is below 45 degrees F or over 95 degrees F; or when the primer may be exposed to temperatures below 40 degrees F within 48 hours after application, unless approved otherwise by the Engineer of Record. Repair damaged primed surfaces with an additional coat of primer.

2.6 DRAINAGE HOLES

Drill adequate drainage holes to eliminate water traps. Hole diameter must be 1/2 inch and location indicated on the detail drawings. Hole size and locations must not affect the structural integrity.

PART 3 EXECUTION

3.1 ERECTION

Erection of structural steel, except as indicated in item b. below, must be in accordance with the applicable provisions of AISC 325, AISC 303 and 29 CFR Part 1926, Subpart R.

After final positioning of steel members, provide full bearing to all sheet piling, pipe piling and other members. Shim members to provide full bearing as required to provide for bearing against structural members.

3.1.1 STORAGE

Store the material out of contact with the ground in such manner and location as to minimize deterioration.

3.2 CONNECTIONS

Except as modified in this section, design connections indicated in accordance with AISC 360. Build connections into existing work. Do not tighten anchor bolts set in concrete with impact torque wrenches. Holes must not be cut or enlarged by burning. Bolts, nuts, and washers must be clean of dirt and rust, and lubricated immediately prior to installation.

3.2.1 Common Grade Bolts

Tighten ASTM A307 bolts to a "snug tight" fit. "Snug tight" is the tightness that exists when plies in a joint are in firm contact. If firm contact of joint plies cannot be obtained with a few impacts of an impact wrench, or the full effort of a man using a spud wrench, contact the Engineer of Record for further instructions.

3.2.2 High-Strength Bolts

Bolts must be installed in accordance with design/shop drawings.

Fastener components shall be protected from dirt and moisture in closed containers at the site of the installation. Fastener components that are not incorporated into the work shall be returned to protected storage at the end of the work shift.

3.3 GAS CUTTING

Use of gas-cutting torch in the field for correcting fabrication errors is not permitted on any major member in the structural framing. Use of a gas cutting torch will be permitted on minor members not under stress only after approval has been obtained from the Engineer of Record.

3.4 WELDING

Welding must be in accordance with AWS D1.1/D1.1MProvide AWS D1.1/D1.1M qualified welders, welding operators, and tackers.

Develop and submit the Welding Procedure Specifications (WPS) for all welding, including welding done using prequalified procedures. Submit for approval all WPS, whether prequalified or qualified by testing.

3.5 SHOP PRIMER REPAIR

Repair shop primer in accordance with the paint manufacturer's recommendation for surfaces damaged by handling, transporting, cutting, welding, or bolting.

3.5.1 Field Priming

Field prime steel exposed to the weather or located in building areas without HVAC for control of relative humidity. After erection, the field bolt heads and nuts, field welds, and any abrasions in the shop coat must be cleaned and primed with paint of the same quality as that used for the shop coat.

3.6 FIELD QUALITY CONTROL

Perform field tests, and provide labor, equipment, and incidentals required for testing. Notify the Engineer of Record in writing of defective welds, bolts, nuts, and washers within 7 working days of the date of the inspection.

3.6.1 Welds

3.6.1.1 Visual Inspection

AWS D1.1/D1.1M. Furnish the services of AWS-certified welding inspectors for fabrication and erection inspection and testing and verification inspections. A Certified Welding Inspector must perform visual inspection on 100 percent of all welds. Document this inspection in the Visual Weld Inspection Log. Submit certificates indicating that certified welding inspectors meet the requirements of AWS QC1.

Inspect proper preparation, size, gaging location, and acceptability of all welds; identification marking; operation and current characteristics of welding sets in use.

3.6.1.2 Nondestructive Testing

Nondestructive testing must be in accordance with AWS D1.1/D1.1M. Ultrasonic testing must be performed in accordance with Table 6.2 of AWS D1.1/D1.1M. All personnel performing NDT must be certified in accordance with ANSI/ASNT CP-189 in the method of testing being performed. Submit certificates showing compliance with ANSI/ASNT CP-189 for all NDT technicians. If more than 20percent of welds made by a welder contain defects identified by testing, then all groove welds made by that welder must be tested by ultrasonic testing, and all fillet welds made by that welder must be inspected by magnetic particle testing (MT) or dye penetrant testing (PT) as approved by the Engineer of Record. When groove welds made by an individual welder are required to be tested, magnetic particle or dye penetrant testing may be used only in areas inaccessible to ultrasonic testing. Retest all repaired areas. Submit weld inspection reports.

3.6.2 High-Strength Bolts

3.6.2.1 Inspection

Inspection procedures must be in accordance with AISC 360. Confirm and report to the Engineer of Record that the materials meet the project specification and that they are properly stored. Confirm that the faying surfaces have been properly prepared before the connections are assembled. Observe the specified job site testing and calibration and confirm that the procedure to be used provides the required tension. Monitor the work to ensure the testing procedures are routinely followed on joints that are specified to be fully tensioned.

-- End of Section --