



MANATEE COUNTY FLORIDA

March 24, 2011

TO: All Interested Bidders
SUBJECT: **Invitation for Bid # 11-1021-DS**
Coquina Concession Building Remodel
(Project No. 49643)

ADDENDUM # 1

Bidders are hereby notified that this Addendum shall be acknowledged on pages 00300-1 of the Bid Form and made a part of the above named bidding and contract documents. Bids submitted without acknowledgement of the Addendum will be considered incomplete.

The following items are issued to add to, modify, and clarify the bid and contract documents. These items shall have the same force and effect as the original bidding and contract documents, and cost involved shall be included in the bid prices. Bids to be submitted on the specified bid date, shall conform to the additions and revisions listed herein.

The deadline for clarification of questions is **April 14, 2011 at 2:00 pm**. This deadline has been established to maintain fair treatment of all potential bidders, while maintaining the expedited nature of the Economic Stimulus that the contracting of this work may achieve. Questions received after this date and time shall not be considered.


Attached please find drawing # E101 that was omitted from the original Bid package. All contractors are to make drawing E101 a component of the bid package.

If you have submitted a bid prior to receiving this addendum, you may request in writing that your original, sealed bid be returned to your firm. All sealed bids received will be opened on the date stated.

END OF ADDENDUM # 1

The deadline for submitting sealed Bids at the Manatee County Purchasing Division, 1112 Manatee Avenue West, Suite 803, Bradenton, Florida 34205 is until 3:00 pm on April 22, 2011.

Sincerely,

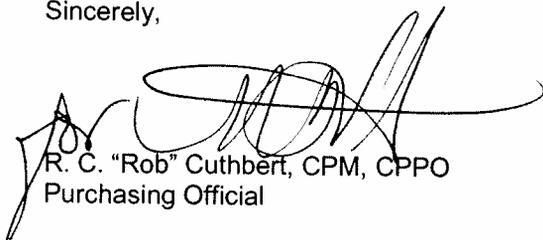



R. C. "Rob" Cuthbert, CPM, CPPO
Purchasing Official

/ds
Attachment (1 page)

Finance Management Department
Mailing Address: Purchasing Division: 1112 Manatee Avenue West, Suite 803, Bradenton, FL 34205
PHONE: 941-749-3045 * FAX: 941-749-3034
www.mymanatee.org

- GENERAL ELECTRICAL NOTES**
1. PROVIDE ALL LIGHTING FIXTURES AND CIRCUITS SHOWN AT LOCATIONS WITH NEW MASONRY WALLS. ALL CONDUITS MUST BE CONCEALED IN THE WALLS, COLUMNS OR ABOVE THE CEILINGS. ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED ABOVE 3'-0" AFF DUE TO THE FLOOD PLAIN ELEVATION.
 2. PROVIDE LIGHTING FIXTURE 'A' U.O.N.. MOUNT TIGHT TO STRUCTURE. EXACT MOUNTING HEIGHT TO BE DETERMINED.
 3. COORDINATE PROGRAMMING OF LIGHTING CONTROL WITH ARCHITECT, OWNER AND ENGINEER. INCLUDE LIGHTING CONTROL PROGRAMMING COSTS IN BID.
 4. SEE LIGHTING CONTROL DIAGRAM(S) FOR OTHER DETAILS.
 5. ROUTE LIGHTING CIRCUITS THROUGH LIGHTING CONTROL PANEL.
 7. PROVIDE "DOUBLE HOTS" FOR ALL EMERGENCY LIGHTING. SEE LIGHTING CONTROL DIAGRAMS FOR DETAILS.

- KEYED NOTES**
- 1 PROVIDE WATTSTOPPER LIGHTING CONTROL PANEL. LP8 PEANUT PANEL WITH 4 RELAYS AND PHOTOCELL. INSTALL LIGHTING CONTROL PANEL NEAR POWER PANELBOARD.
 - 2 PROVIDE PHOTOCELL. SEE LEGEND FOR DETAILS.
 - 3 RECIRCUIT EXISTING EXTERIOR EAVE LIGHTING TO NEW CIRCUIT A-1.
 - 4 PROVIDE ATTIC LIGHTING AND RECEPTACLE BRANCH CIRCUIT A-7 IN ATTIC. FIELD LOCATE SWITCH AND RECEPTACLE ADJACENT TO PULL DOWN STAIRS.

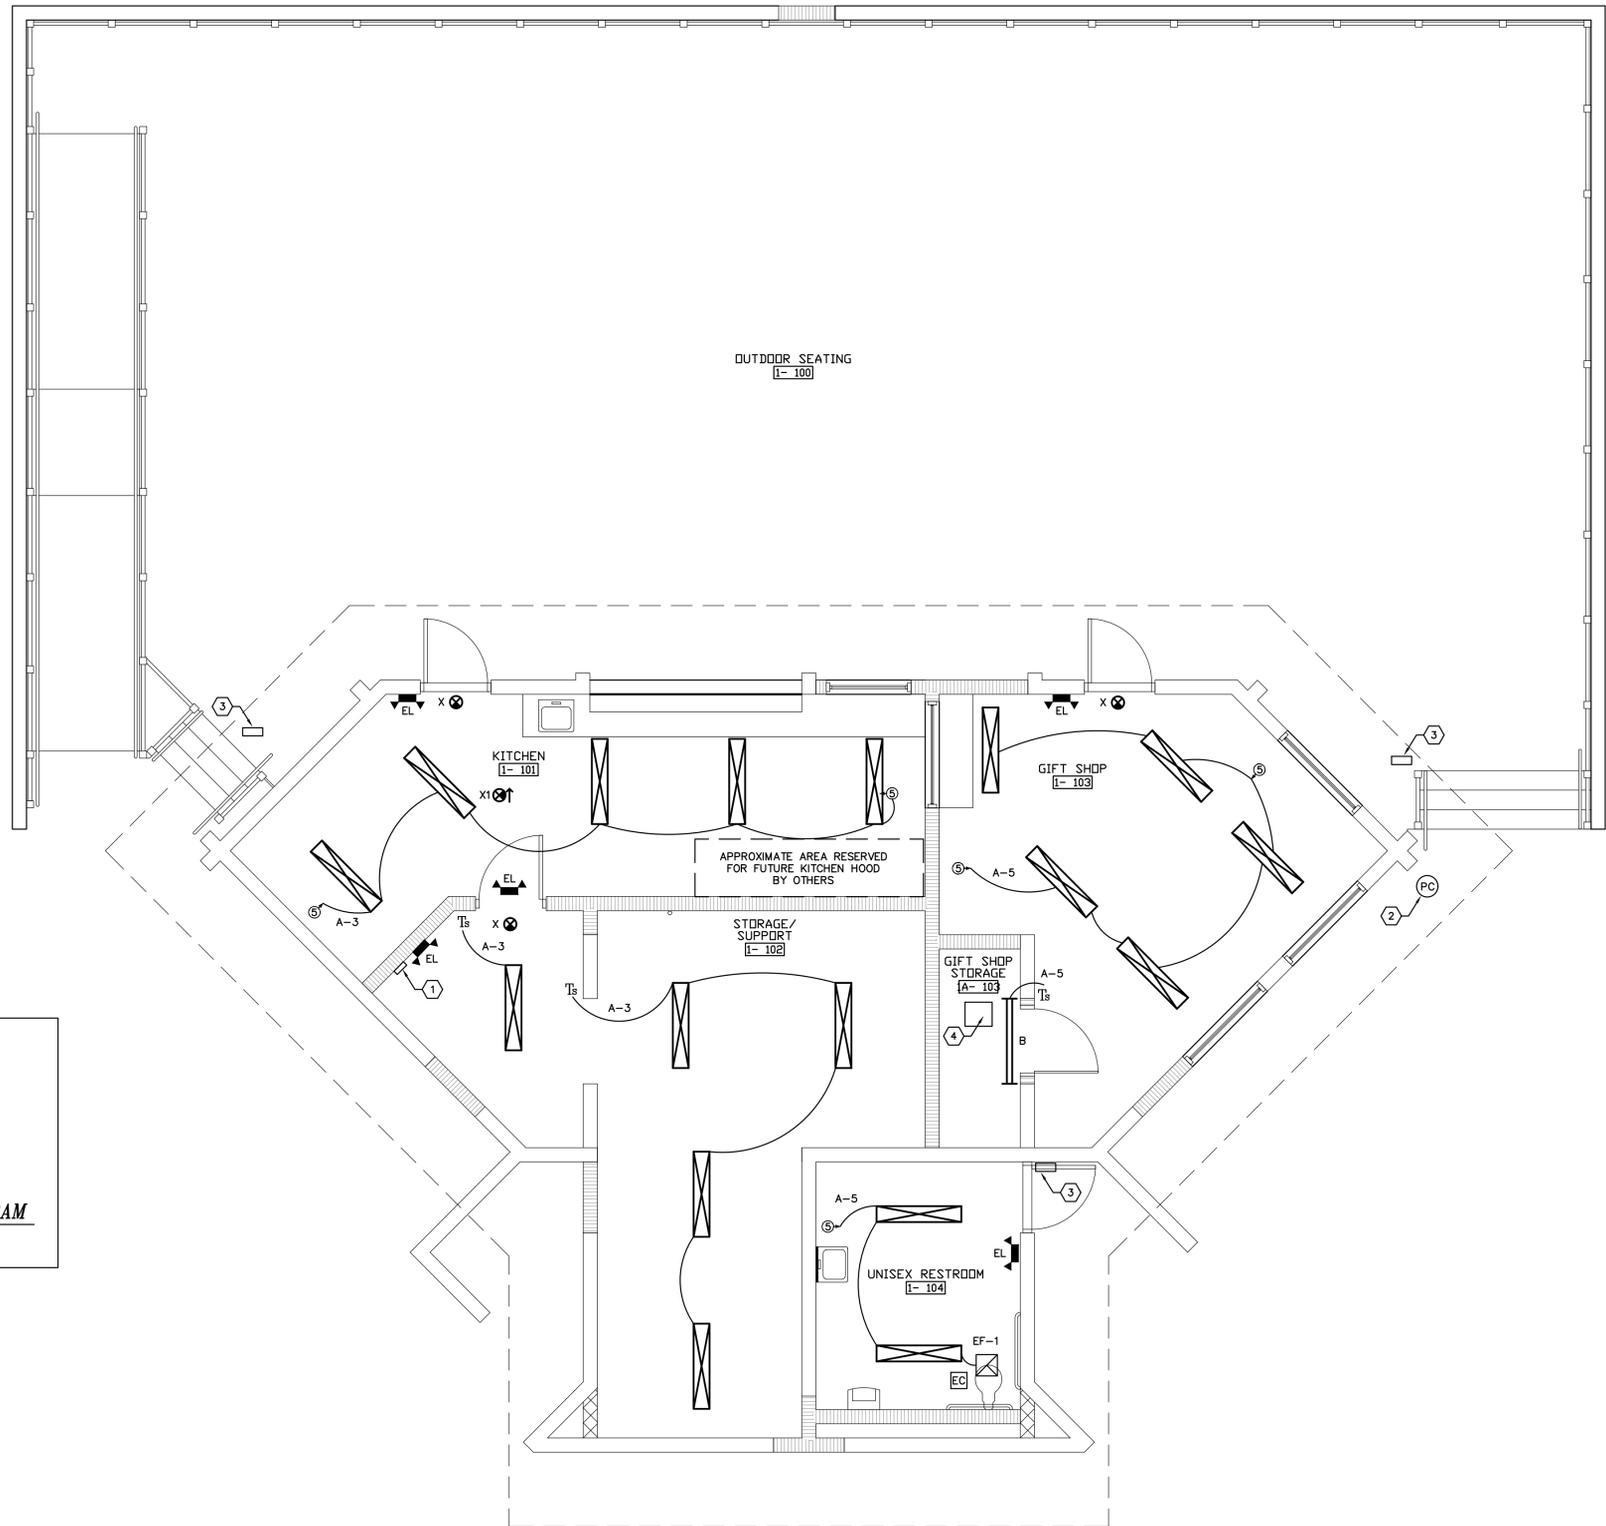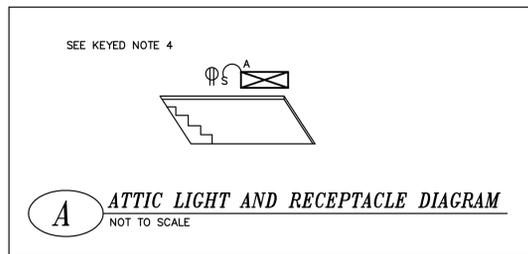

CONCESSIONS BUILDING
LIGHTING FLOOR PLAN
1/4"=1'-0"